

Markings such as "ASME," "ASME Standard," or any other marking including "ASME," ASME logos, or the ASME Single Certification Mark shall not be used on any item that is not constructed in accordance with all of the applicable requirements of the Code or Standard. Use of the ASME Single Certification Mark requires formal ASME certification; if no certification program is available, such ASME markings may not be used. (For Certification and Accreditation Programs, see https://www.asme.org/certification-accreditation.)

Items produced by parties not formally possessing an ASME Certificate may not be described, either explicitly or implicitly, as ASME certified or approved in any code forms or other document.

AN INTERNATIONAL CODE

2023 ASME Boiler & Pressure Vessel Code

2023 Edition July 1, 2023

|| | MATERIALS

Part A

Ferrous Material Specifications (Beginning to SA-450)

ASME Boiler and Pressure Vessel Committee on Materials



Date of Issuance: July 1, 2023

This international code or standard was developed under procedures accredited as meeting the criteria for American National Standards and it is an American National Standard. The standards committee that approved the code or standard was balanced to ensure that individuals from competent and concerned interests had an opportunity to participate. The proposed code or standard was made available for public review and comment, which provided an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.

ASME does not "approve," "certify," "rate," or "endorse" any item, construction, proprietary device, or activity. ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable letters patent, nor does ASME assume any such liability. Users of a code or standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representatives or persons affiliated with industry is not to be interpreted as government or industry endorsement of this code or standard.

ASME accepts responsibility for only those interpretations of this document issued in accordance with the established ASME procedures and policies, which precludes the issuance of interpretations by individuals.

The endnotes and preamble in this document (if any) are part of this American National Standard.



ASME Collective Membership Mark



ASME Single Certification Mark

"ASME" and the above ASME symbols are registered trademarks of The American Society of Mechanical Engineers.

The ASTM standards included within this ASME publication have been reproduced through a license agreement with ASTM International.

No part of this document may be reproduced in any form, in an electronic retrieval system or otherwise, without the prior written permission of the publisher.

Library of Congress Catalog Card Number: 56-3934

Adopted by the Council of The American Society of Mechanical Engineers, 1914; latest edition 2023.

The American Society of Mechanical Engineers Two Park Avenue, New York, NY 10016-5990

Copyright © 2023 by
THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS
All rights reserved
Printed in U.S.A.

TABLE OF CONTENTS

Statement of Policy on the Use of the ASME Single Certification Mark and Code Authorization in Advertising statement of Policy on the Use of ASME Marking to Identify Manufactured Items xix Personnel xxxxvi Correspondence With the Committee xxxxvi Correspondence With the Committee xxxvi Specifications Listed by Materials xix Specification Removal xix Statement of Policy on the Use of ASME Material Specifications Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling xix SA-6/SA-6M Specification for General Requirements for Steel Plates for Pressure Vessels SA-29/SA-29M Specification for General Requirements for Steel Plates for Pressure Vessels SA-29/SA-29M Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought 103-3-3-4 Specification for Steel Rivets and Bars for Rivets, Pressure Vessels 115-3-3-3/SA-36M Specification for Steel Rivets and Bars for Rivets, Pressure Vessels 115-3-3-3/SA-47/M Specification for Ferritic Malleable Iron Castings 125-3-3/SA-47/M Specification for Ferritic Malleable Iron Castings 125-3-3-3/SA-53M Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless 135-3-105/SA-106M Specification for Seamless Carbon Steel Pipe for High-Temperature Service 136-3-134/SA-134M Specification for Seamless Carbon Steel Pipe for High-Temperature Service 136-3-134/SA-135M Specification for Electric-Resistance-Welded Steel Pipe 1185-3-135/SA-135M Specification for Electric-Resistance-Welded Carbon Steel And Carbon Manganese Steel Boiler and Superheater Tubes 199-3-141/SA-181M Specification for Carbon Steel Forgings, for General-Purpose Piping 199-3-141/SA-181M Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Forged Fittings, and Valves and Parts for High-Temperature Service 211
Ratement of Policy on the Use of ASME Marking to Identify Manufactured Items xiversonnel xxxvi XSTM Personnel xxxvi Xxvvi Xxxvi Xxxvi Xxxvi Xxxvi Xxxvi Xxxvi Xxxvi Xxxvi Xxvi
Ratement of Policy on the Use of ASME Marking to Identify Manufactured Items xiversonnel xxxvi XSTM Personnel xxxvi Xxvvi Xxxvi Xxxvi Xxxvi Xxxvi Xxxvi Xxxvi Xxxvi Xxxvi Xxvi
ASTM Personnel xxxxvi Correspondence With the Committee xxxvi Correspondence With the
Correspondence With the Committee xxxvii Preface x Specifications Listed by Materials x Specification Removal x Summary of Changes Cross-Referencing in the ASME BPVC lititatement of Policy on the Use of ASME Material Specifications SA-6/SA-6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
Architections Listed by Materials
Architections Listed by Materials
Specifications Listed by Materials xlipperification Removal xlipperification Referencing in the ASME BPVC like Statement of Policy on the Use of ASME Material Specifications SA-6/SA-6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling SA-20/SA-20M Specification for General Requirements for Steel Plates for Pressure Vessels SA-29/SA-29M Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought SA-31 Specification for Steel Rivets and Bars for Rivets, Pressure Vessels 119 SA-36/SA-36M Specification for Carbon Structural Steel 125 SA-47/SA-47M Specification for Carbon Structural Steel 125 SA-45/SA-53M Specification for Ferritic Malleable Iron Castings 125 SA-53/SA-53M Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless SA-105/SA-105M Specification for Carbon Steel Forgings for Piping Applications 136 SA-106/SA-106M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-134/SA-134M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-135/SA-135M Specification for Electric-Resistance-Welded Steel Pipe 175 Specification for Electric-Resistance-Welded Carbon Steel and Carbon-Manganese Steel Boiler and Superheater Tubes 195 Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Specification for Forged or Rolled Alloy and Stainless Stee
Specification Removal Summary of Changes Cross-Referencing in the ASME BPVC Statement of Policy on the Use of ASME Material Specifications SA-6/SA-6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling SA-20/SA-20M Specification for General Requirements for Steel Plates for Pressure Vessels SA-29/SA-29M Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought SA-31 Specification for Steel Rivets and Bars for Rivets, Pressure Vessels SA-31 Specification for Steel Rivets and Bars for Rivets, Pressure Vessels SA-36/SA-36M Specification for Steel Rivets and Bars for Rivets, Pressure Vessels SA-36/SA-36M Specification for Ferritic Malleable Iron Castings SA-35/SA-47M Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless SA-105/SA-105M Specification for Carbon Steel Forgings for Piping Applications SA-106/SA-106M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-134/SA-134M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-135/SA-135M Specification for Electric-Resistance-Welded Steel Pipe SA-178/SA-178M Specification for Electric-Resistance-Welded Carbon Steel and Carbon Manganese Steel Boiler and Superheater Tubes SA-179/SA-179M Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes Specification for Carbon Steel Forgings, for General-Purpose Piping SA-182/SA-182M Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges,
Summary of Changes Cross-Referencing in the ASME BPVC Cross-Referencing in the ASME BPVC SA-6/SA-6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling SA-20/SA-20M Specification for General Requirements for Steel Plates for Pressure Vessels SA-29/SA-29M Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought SA-31 Specification for Steel Rivets and Bars for Rivets, Pressure Vessels SA-36/SA-36M Specification for Carbon Structural Steel SA-47/SA-47M Specification for Ferritic Malleable Iron Castings SA-53/SA-53M Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless SA-105/SA-105M Specification for Carbon Steel Forgings for Piping Applications SA-106/SA-106M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-134/SA-134M Specification for Pipe, Steel, Electric-Fusion (ARC)-Welded (Sizes NPS 16 and Over) SA-135/SA-135M Specification for Electric-Resistance-Welded Steel Pipe SA-179/SA-179M Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes SA-181/SA-181M Specification for Carbon Steel Forgings, for General-Purpose Piping SA-182/SA-182M Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges,
Cross-Referencing in the ASME BPVC
Statement of Policy on the Use of ASME Material Specifications SA-6/SA-6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Pilling SA-20/SA-20M Specification for General Requirements for Steel Plates for Pressure Vessels SA-29/SA-29M Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought SA-31 Specification for Steel Rivets and Bars for Rivets, Pressure Vessels SA-36/SA-36M Specification for Carbon Structural Steel SA-47/SA-47M Specification for Ferritic Malleable Iron Castings SA-53/SA-53M Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless SA-105/SA-105M Specification for Carbon Steel Forgings for Piping Applications SA-106/SA-106M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-134/SA-134M Specification for Pipe, Steel, Electric-Fusion (ARC)-Welded (Sizes NPS 16 and Over) SA-135/SA-135M Specification for Electric-Resistance-Welded Steel Pipe SA-179/SA-178M Specification for Electric-Resistance-Welded Carbon Steel and Carbon-Manganese Steel Boiler and Superheater Tubes SPECIFICATION Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes SPECIFICATION Specification for Carbon Steel Forgings, for General-Purpose Piping SA-182/SA-181M Specification for Carbon Steel Forgings, for General-Purpose Piping SA-182/SA-182M Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges,
SA-6/SA-6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling SA-20/SA-20M Specification for General Requirements for Steel Plates for Pressure Vessels SA-29/SA-29M Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought SA-31 Specification for Steel Rivets and Bars for Rivets, Pressure Vessels SA-36/SA-36M Specification for Carbon Structural Steel SA-47/SA-47M Specification for Ferritic Malleable Iron Castings SA-53/SA-53M Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless SA-105/SA-105M Specification for Carbon Steel Forgings for Piping Applications SA-106/SA-106M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-134/SA-134M Specification for Pipe, Steel, Electric-Fusion (ARC)-Welded (Sizes NPS 16 and Over) Over) SA-135/SA-135M Specification for Electric-Resistance-Welded Carbon Steel and Carbon- Manganese Steel Boiler and Superheater Tubes Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes Specification for Carbon Steel Forgings, for General-Purpose Piping Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges,
SA-20/SA-20M Specification for General Requirements for Steel Plates for Pressure Vessels SA-29/SA-29M Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought SA-31 Specification for Steel Rivets and Bars for Rivets, Pressure Vessels SA-36/SA-36M Specification for Carbon Structural Steel SA-47/SA-47M Specification for Ferritic Malleable Iron Castings SA-53/SA-53M Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless SA-105/SA-105M Specification for Carbon Steel Forgings for Piping Applications SA-106/SA-106M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-134/SA-134M Specification for Pipe, Steel, Electric-Fusion (ARC)-Welded (Sizes NPS 16 and Over) Over) SA-135/SA-135M Specification for Electric-Resistance-Welded Steel Pipe SA-178/SA-178M Specification for Electric-Resistance-Welded Carbon Steel and Carbon- Manganese Steel Boiler and Superheater Tubes SA-179/SA-179M Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes SA-181/SA-181M Specification for Carbon Steel Forgings, for General-Purpose Piping SA-182/SA-182M Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges,
SA-29/SA-29M Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought SA-31 Specification for Steel Rivets and Bars for Rivets, Pressure Vessels SA-36/SA-36M Specification for Carbon Structural Steel SA-47/SA-47M Specification for Ferritic Malleable Iron Castings SA-53/SA-53M Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless SA-105/SA-105M Specification for Carbon Steel Forgings for Piping Applications SA-106/SA-106M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-134/SA-134M Specification for Pipe, Steel, Electric-Fusion (ARC)-Welded (Sizes NPS 16 and Over) SA-135/SA-135M Specification for Electric-Resistance-Welded Steel Pipe SA-178/SA-178M Specification for Electric-Resistance-Welded Carbon Steel and Carbon- Manganese Steel Boiler and Superheater Tubes SA-179/SA-179M Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes SA-181/SA-181M Specification for Carbon Steel Forgings, for General-Purpose Piping SA-182/SA-182M Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges,
Hot-Wrought
SA-31 Specification for Steel Rivets and Bars for Rivets, Pressure Vessels
SA-36/SA-36M Specification for Carbon Structural Steel
Specification for Ferritic Malleable Iron Castings Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless SA-105/SA-105M Specification for Carbon Steel Forgings for Piping Applications SA-106/SA-106M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-134/SA-134M Specification for Pipe, Steel, Electric-Fusion (ARC)-Welded (Sizes NPS 16 and Over) SA-135/SA-135M Specification for Electric-Resistance-Welded Steel Pipe SA-178/SA-178M Specification for Electric-Resistance-Welded Carbon Steel and Carbon-Manganese Steel Boiler and Superheater Tubes SA-179/SA-179M Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes SA-181/SA-181M Specification for Carbon Steel Forgings, for General-Purpose Piping Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges,
SA-53/SA-53M Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
Seamless
SA-105/SA-105M Specification for Carbon Steel Forgings for Piping Applications SA-106/SA-106M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-134/SA-134M Specification for Pipe, Steel, Electric-Fusion (ARC)-Welded (Sizes NPS 16 and Over) SA-135/SA-135M Specification for Electric-Resistance-Welded Steel Pipe SA-178/SA-178M Specification for Electric-Resistance-Welded Carbon Steel and Carbon-Manganese Steel Boiler and Superheater Tubes SA-179/SA-179M Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes SA-181/SA-181M Specification for Carbon Steel Forgings, for General-Purpose Piping Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges,
SA-106/SA-106M Specification for Seamless Carbon Steel Pipe for High-Temperature Service SA-134/SA-134M Specification for Pipe, Steel, Electric-Fusion (ARC)-Welded (Sizes NPS 16 and Over)
SA-134/SA-134M Specification for Pipe, Steel, Electric-Fusion (ARC)-Welded (Sizes NPS 16 and Over)
Over)
SA-135/SA-135M Specification for Electric-Resistance-Welded Steel Pipe
SA-178/SA-178M Specification for Electric-Resistance-Welded Carbon Steel and Carbon- Manganese Steel Boiler and Superheater Tubes
Manganese Steel Boiler and Superheater Tubes
SA-179/SA-179M Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes
and Condenser Tubes
SA-181/SA-181M Specification for Carbon Steel Forgings, for General-Purpose Piping 205 SA-182/SA-182M Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges,
SA-182/SA-182M Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges,
ronged intelligs, and valves and rants for ingli reinperature service 211
SA-192/SA-192M Specification for Seamless Carbon Steel Boiler Tubes for High-Pressure
Service
SA-193/SA-193M Specification for Alloy-Steel and Stainless Steel Bolting for High-Temperature
or High Pressure Service and Other Special Purpose Applications
SA-194/SA-194M Specification for Carbon and Alloy Steel Nuts for Bolts for High Pressure or
High Temperature Service, or Both
SA-203/SA-203M Specification for Pressure Vessel Plates, Alloy Steel, Nickel
SA-204/SA-204M Specification for Pressure Vessel Plates, Alloy Steel, Molybdenum 265
SA-209/SA-209M Specification for Seamless Carbon-Molybdenum Alloy-Steel Boiler and Su-
perheater Tubes
SA-210/SA-210M Specification for Seamless Medium-Carbon Steel Boiler and Superheater
Tubes
SA-213/SA-213M Specification for Seamless Ferritic and Austenitic Alloy-Steel Boiler, Super-
heater, and Heat-Exchanger Tubes

SA-214/SA-214M	Specification for Electric-Resistance-Welded Carbon Steel Heat-Exchanger and Condenser Tubes
SA-216/SA-216M	Specification for Steel Castings, Carbon, Suitable for Fusion Welding for
511 210/511 21011	High-Temperature Service
SA-217/SA-217M	Specification for Steel Castings, Martensitic Stainless and Alloy, for
211 211 7 211 217 11	Pressure-Containing Parts, Suitable for High-Temperature Service
SA-225/SA-225M	Specification for Pressure Vessel Plates, Alloy Steel, Manganese-Vanadium-
511 225/511 22511	Nickel
SA-231/SA-231M	Specification for Chromium-Vanadium Alloy Steel Spring Wire
SA-232/SA-232M	Specification for Chromium-Vanadium Alloy Steel Valve Spring Quality Wire
SA-234/SA-234M	Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for
3H-23+/3H-23+M	Moderate and High-Temperature Service
SA-240/SA-240M	Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet,
3A-240/3A-240M	and Strip for Pressure Vessels and for General Applications
SA-249/SA-249M	Specification for Welded Austenitic Steel Boiler, Superheater,
511 2 1 7 511 2 1 7 11	Heat-Exchanger, and Condenser Tubes
SA-250/SA-250M	Specification for Electric-Resistance-Welded Ferritic Alloy-Steel Boiler and
311 230/311 23011	Superheater Tubes
SA-263	Specification for Stainless Chromium Steel-Clad Plate
SA-264	Specification for Stainless Chromium-Nickel Steel-Clad Plate
SA-265	Specification for Nickel and Nickel-Base Alloy-Clad Steel Plate
SA-266/SA-266M	Specification for Carbon Steel Forgings for Pressure Vessel Components
SA-268/SA-268M	Specification for Seamless and Welded Ferritic and Martensitic Stainless Steel
3A-200/3A-200M	Tubing for General Service
SA-276/SA-276M	Specification for Stainless Steel Bars and Shapes
SA-270/SA-270M SA-278/SA-278M	Specification for Gray Iron Castings for Pressure Containing Parts for Tem-
3A-270/3A-270M	peratures up to 650°F (350°C)
SA-283/SA-283M	Specification for Low and Intermediate Tensile Strength Carbon Steel Plates
SA-285/SA-285M	Specification for Pressure Vessel Plates, Carbon Steel, Low- and
3A-203/3A-203M	Intermediate-Tensile Strength
SA-299/SA-299M	Specification for Pressure Vessel Plates, Carbon Steel, Manganese-Silicon .
SA-299/SA-299M SA-302/SA-302M	Specification for Pressure Vessel Plates, Alloy Steel, Manganese-Molybdenum
3A-302/3A-302M	and Manganese-Molybdenum-Nickel
SA-307	· · · · · · · · · · · · · · · · · · ·
SA-311/SA-311M	Specification for Carbon Steel Bolts and Studs, 60 000 PSI Tensile Strength
3A-311/3A-311M	Specification for Cold-Drawn, Stress-Relieved Carbon Steel Bars Subject to
SA-312/SA-312M	Mechanical Property Requirements
3A-312/3A-312M	Specification for Seamless, Welded, and Heavily Cold Worked Austenitic Stainless Steel Pipes
SA-320/SA-320M	Specification for Alloy-Steel and Stainless Steel Bolting for Low-Temperature
3A-320/3A-320M	
SA-325	Service
3A-323	Tensile Strength
CA 222/CA 222M	Specification for Seamless and Welded Steel Pipe for Low-Temperature Ser-
SA-333/SA-333M	
CA 224/CA 224M	vice and Other Applications With Required Notch Toughness
SA-334/SA-334M	Specification for Seamless and Welded Carbon and Alloy-Steel Tubes for
CA 22E/CA 22EM	Low-Temperature Service
SA-335/SA-335M	Specification for Seamless Ferritic Alloy-Steel Pipe for High-Temperature
CA 226/CA 22684	Service Specification for Alloy Steel Forgings for Proggues and High Temporature
SA-336/SA-336M	Specification for Alloy Steel Forgings for Pressure and High-Temperature
CA 250/CA 250M	Parts
SA-350/SA-350M	Specification for Carbon and Low-Alloy Steel Forgings, Requiring Notch
CA 251/CA 251%	Toughness Testing for Piping Components
SA-351/SA-351M	Specification for Castings, Austenitic, for Pressure-Containing Parts
SA-352/SA-352M	Specification for Steel Castings, Ferritic and Martensitic, for Pressure- Containing Parts, Suitable for Low-Temperature Service
	Containing Parts, Sultable for LOW-Lemberature Service

SA-353/SA-353M	Specification for Pressure Vessel Plates, Alloy Steel, Double-Normalized and	EE2
SA-354	Tempered 9% Nickel	553
511 55 1	Externally Threaded Fasteners	557
SA-358/SA-358M	Specification for Electric-Fusion-Welded Austenitic Chromium-Nickel Stain-	
SA-369/SA-369M	less Steel Pipe for High-Temperature Service and General Applications . Specification for Carbon and Ferritic Alloy Steel Forged and Bored Pipe for	565
3A-307/3A-307M	High-Temperature Service	575
SA-370	Test Methods and Definitions for Mechanical Testing of Steel Products	581
SA-372/SA-372M	Specification for Carbon and Alloy Steel Forgings for Thin-Walled Pressure	
	Vessels	631
SA-376/SA-376M	Specification for Seamless Austenitic Steel Pipe for High-Temperature Service	637
SA-387/SA-387M	Specification for Pressure Vessel Plates, Alloy Steel, Chromium-	
SA-395/SA-395M	Molybdenum	645
3A-373/3A-373M	Elevated Temperatures	651
SA-401/SA-401M	Specification for Steel Wire, Chromium-Silicon Alloy	665
SA-403/SA-403M	Specification for Wrought Austenitic Stainless Steel Piping Fittings	671
SA-409/SA-409M	Specification for Welded Large Diameter Austenitic Steel Pipe for Corrosive	
,	or High-Temperature Service	683
SA-414/SA-414M	Specification for Steel, Sheet, Carbon, and High-Strength, Low-Alloy for	
	Pressure Vessels	691
SA-420/SA-420M	Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for	
CA 422 /CA 422M	Low-Temperature Service	697
SA-423/SA-423M	Specification for Seamless and Electric-Welded Low-Alloy Steel Tubes	705
SA-426/SA-426M	Specification for Centrifugally Cast Ferritic Alloy Steel Pipe for High- Temperature Service	709
SA-437/SA-437M	Specification for Stainless and Alloy-Steel Turbine-Type Bolting Specially	707
011 107/011 10711	Heat Treated for High-Temperature Service	715
SA-439/SA-439M	Specification for Austenitic Ductile Iron Castings	719
SA-449	Specification for Hex Cap Screws, Bolts and Studs, Steel, Heat Treated, 120/	
	105/90 ksi Minimum Tensile Strength, General Use	727
SA-450/SA-450M	Specification for General Requirements for Carbon and Low Alloy Steel Tubes	735
SA-451/SA-451M	Specification for Centrifugally Cast Austenitic Steel Pipe for High-	, 55
,	Temperature Service	747
SA-453/SA-453M	Specification for High-Temperature Bolting, With Expansion Coefficients	
	Comparable to Austenitic Stainless Steels	753
SA-455/SA-455M	Specification for Pressure Vessel Plates, Carbon Steel, High-Strength	
0.4.50.04.450.4	Manganese	761
SA-476/SA-476M	Specification for Ductile Iron Castings for Paper Mill Dryer Rolls	765
SA-479/SA-479M	Specification for Stainless Steel Bars and Shapes for Use in Boilers and Other Pressure Vessels	773
SA-480/SA-480M	Specification for General Requirements for Flat-Rolled Stainless and	773
511 100/511 1001-1	Heat-Resisting Steel Plate, Sheet, and Strip	783
SA-484/SA-484M	Specification for General Requirements for Stainless Steel Bars, Billets, and	
,	Forgings	809
SA-487/SA-487M	Specification for Steel Castings Suitable for Pressure Service	823
SA-508/SA-508M	Specification for Quenched and Tempered Vacuum-Treated Carbon and Alloy	
	Steel Forgings for Pressure Vessels	831
SA-513	Specification for Electric-Resistance-Welded Carbon and Alloy Steel Me-	0.44
CA	chanical Tubing	841
SA-515/SA-515M	Specification for Pressure Vessel Plates, Carbon Steel, for Intermediate- and Higher-Temperature Service	867
	ingher temperature bervice	007

SA-516/SA-516M	Specification for Pressure Vessel Plates, Carbon Steel, for Moderate- and Lower-Temperature Service
SA-517/SA-517M	Specification for Pressure Vessel Plates, Alloy Steel, High-Strength, Quenched and Tempered
SA-522/SA-522M	Specification for Forged or Rolled 8 and 9% Nickel Alloy Steel Flanges, Fittings, Valves, and Parts for Low-Temperature Service
SA-524/SA-524M	Specification for Seamless Carbon Steel Pipe for Atmospheric and Lower Temperatures
SA-530/SA-530M	Specification for General Requirements for Specialized Carbon and Alloy Steel Pipe
SA-533/SA-533M	Specification for Pressure Vessel Plates, Alloy Steel, Quenched and Tempered, Manganese-Molybdenum and Manganese-Molybdenum-Nickel
SA-537/SA-537M	Specification for Pressure Vessel Plates, Heat-Treated, Carbon-Manganese-Silicon Steel
SA-540/SA-540M	Specification for Alloy-Steel Bolting for Special Applications
SA-541/SA-541M	Specification for Quenched and Tempered Carbon and Alloy Steel Forgings for Pressure Vessel Components
SA-542/SA-542M	Specification for Pressure Vessel Plates, Alloy Steel, Quenched- and-Tempered, Chromium-Molybdenum, and Chromium-Molybdenum- Vanadium
SA-543/SA-543M	Specification for Pressure Vessel Plates, Alloy Steel, Quenched and Tempered, Nickel-Chromium-Molybdenum
SA-553/SA-553M	Specification for Pressure Vessel Plates, Alloy Steel, Quenched and Tempered 7, 8, and 9% Nickel
SA-556/SA-556M	Specification for Seamless Cold-Drawn Carbon Steel Feedwater Heater Tubes
SA-557/SA-557M	Specification for Electric-Resistance-Welded Carbon Steel Feedwater Heater Tubes
SA-562/SA-562M	Specification for Pressure Vessel Plates, Carbon Steel, Manganese-Titanium for Glass or Diffused Metallic Coatings
SA-563	Specification for Carbon and Alloy Steel Nuts
SA-564/SA-564M	Specification for Hot-Rolled and Cold-Finished Age-Hardening Stainless Steel Bars and Shapes
SA-568/SA-568M	Specification for Steel, Sheet, Carbon, Structural, and High-Strength, Low-Alloy, Hot-Rolled and Cold-Rolled, General Requirements for
SA-572/SA-572M	Specification for High-Strength Low-Alloy Columbium-Vanadium Structural Steel
SA-574	Specification for Alloy Steel Socket-Head Cap Screws
SA-587	Specification for Electric-Resistance-Welded Low-Carbon Steel Pipe for the Chemical Industry
SA-592/SA-592M	Specification for High-Strength Quenched and Tempered Low-Alloy Steel Forged Fittings and Parts for Pressure Vessels
SA-609/SA-609M	Specification for Castings, Carbon, Low-Alloy, and Martensitic Stainless Steel, Ultrasonic Examination Thereof
SA-612/SA-612M	Specification for Pressure Vessel Plates, Carbon Steel, High Strength, for Moderate and Lower Temperature Service
SA-638/SA-638M	Specification for Precipitation Hardening Iron Base Superalloy Bars, Forgings, and Forging Stock for High-Temperature Service
SA-645/SA-645M	Specification for Pressure Vessel Plates, 5% and $5\frac{1}{2}$ % Nickel Alloy Steels, Specially Heat Treated
SA-649/SA-649M	Specification for Forged Steel Rolls, Used for Corrugating Paper Machinery
SA-656/SA-656M	Specification for Hot-Rolled Structural Steel, High-Strength Low-Alloy Plate With Improved Formability
SA-660	Specification for Centrifugally Cast Carbon Steel Pipe for High-Temperature

SA-662/SA-662M	Specification for Pressure Vessel Plates, Carbon-Manganese-Silicon Steel, for Moderate and Lower Temperature Service
SA-666	Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet,
311 000	Strip, Plate, and Flat Bar
SA-667/SA-667M	Specification for Centrifugally Cast Dual Metal (Gray and White Cast Iron) Cylinders
SA-671/SA-671M	Specification for Electric-Fusion-Welded Steel Pipe for Atmospheric and Lower Temperatures
SA-672/SA-672M	Specification for Electric-Fusion-Welded Steel Pipe for High-Pressure Service at Moderate Temperatures
SA-675/SA-675M	Specification for Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties
SA-688/SA-688M	Specification for Seamless and Welded Austenitic Stainless Steel Feedwater Heater Tubes
SA-691/SA-691M	Specification for Carbon and Alloy Steel Pipe, Electric-Fusion-Welded for High-Pressure Service at High Temperatures
SA-693	Specification for Precipitation-Hardening Stainless and Heat-Resisting Steel Plate, Sheet, and Strip
SA-696	Specification for Steel Bars, Carbon, Hot-Wrought or Cold-Finished, Special Quality, for Pressure Piping Components
SA-703/SA-703M	Specification for Steel Castings, General Requirements, for Pressure-
SA-705/SA-705M	Specification for Age-Hardening Stainless Steel Forgings
SA-723/SA-723M	Specification for Alloy Steel Forgings for High-Strength Pressure Component Application
SA-724/SA-724M	Specification for Pressure Vessel Plates, Carbon-Manganese-Silicon Steel, Quenched and Tempered, for Welded Pressure Vessels
SA-727/SA-727M	Specification for Carbon Steel Forgings for Piping Components with Inherent Notch Toughness
SA-731/SA-731M	Specification for Seamless, Welded Ferritic, and Martensitic Stainless Steel Pipe
SA-736/SA-736M	Specification for Pressure Vessel Plates, Low-Carbon Age-Hardening Nickel-Copper-Chromium-Molybdenum-Columbium (Niobium) Alloy Steel
SA-737/SA-737M	Specification for Pressure Vessel Plates, High-Strength Low-Alloy Steel
SA-738/SA-738M	Specification for Pressure Vessel Plates, Heat-Treated, Carbon-Manganese-Silicon Steel, for Moderate and Lower Temperature Service
SA-739	Specification for Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both
SA-747/SA-747M	Specification for Steel Castings, Stainless, Precipitation Hardening
SA-748/SA-748M	Specification for Statically Cast Chilled White Iron-Gray Iron Dual Metal Rolls for Pressure Vessel Use
SA-749/SA-749M	Specification for Steel, Strip, Carbon and High-Strength, Low-Alloy, Hot-Rolled, General Requirements for
SA-751	Test Methods and Practices for Chemical Analysis of Steel Products
SA-765/SA-765M	Specification for Carbon Steel and Low-Alloy Steel Pressure-Vessel- Component Forgings With Mandatory Toughness Requirements
SA-770/SA-770M	Specification for Through-Thickness Tension Testing of Steel Plates for Special Applications
SA-781/SA-781M	Specification for Castings, Steel and Alloy, Common Requirements, for General Industrial Use
SA-788/SA-788M	Specification for Steel Forgings, General Requirements
SA-789/SA-789M	Specification for Seamless and Welded Ferritic/Austenitic Stainless Steel Tubing for General Service
SA-790/SA-790M	Specification for Seamless and Welded Ferritic/Austenitic Stainless Steel Pipe

SA-803/SA-803M	Specification for Seamless and Welded Ferritic Stainless Steel Feedwater Heater Tubes
SA-813/SA-813M	Specification for Single- or Double-Welded Austenitic Stainless Steel Pipe .
SA-814/SA-814M	Specification for Cold-Worked Welded Austenitic Stainless Steel Pipe
SA-815/SA-815M	Specification for Wrought Ferritic, Ferritic/Austenitic, and Martensitic
511 613/511 61511	Stainless Steel Piping Fittings
SA-832/SA-832M	Specification for Pressure Vessel Plates, Alloy Steel, Chromium-
3A-032/3A-032W	· · · · · · · · · · · · · · · · · · ·
CA 024	Molybdenum-Vanadium
SA-834	Specification for Common Requirements for Iron Castings for General In-
GA 026/GA 026M	dustrial Use
SA-836/SA-836M	Specification for Titanium-Stabilized Carbon Steel Forgings for Glass-Lined
	Piping and Pressure Vessel Service
SA-841/SA-841M	Specification for Steel Plates for Pressure Vessels, Produced by Thermo-
	Mechanical Control Process (TMCP)
SA-874/SA-874M	Specification for Ferritic Ductile Iron Castings Suitable for Low-Temperature
	Service
SA-905	Specification for Steel Wire, Pressure Vessel Winding
SA-941	Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroal-
	loys
SA-960/SA-960M	Specification for Common Requirements for Wrought Steel Piping Fittings
SA-961/SA-961M	Specification for Common Requirements for Steel Flanges, Forged Fittings,
· , · · · · · · · · · · · · ·	Valves, and Parts for Piping Applications
SA-962/SA-962M	Specification for Common Requirements for Bolting Intended for Use at any
21. 202, 01. 2021.1	Temperature From Cryogenic to the Creep Range
SA-965/SA-965M	Specification for Steel Forgings, Austenitic, for Pressure and High-
3A-903/3A-903M	
CA OOF /CA OOFM	Temperature Parts
SA-985/SA-985M	Specification for Steel Investment Castings General Requirements, for
GA 000 /GA 000M	Pressure-Containing Parts
SA-988/SA-988M	Specification for Hot Isostatically-Pressed Stainless Steel Flanges, Fittings,
	Valves, and Parts for High Temperature Service
SA-989/SA-989M	Specification for Hot Isostatically-Pressed Alloy Steel Flanges, Fittings,
	Valves, and Parts for High Temperature Service
SA-995/SA-995M	Specification for Castings, Austenitic-Ferritic (Duplex) Stainless Steel, for
	Pressure-Containing Parts
SA-999/SA-999M	Specification for General Requirements for Alloy and Stainless Steel Pipe .
SA-1008/SA-1008M	Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength
•	Low-Alloy and High-Strength Low-Alloy With Improved Formability
SA-1010/SA-1010M	Specification for Higher-Strength Martensitic Stainless Steel Plate, Sheet, and
, ,	Strip
SA-1011/SA-1011M	Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-
511 1011/511 10111	Strength Low-Alloy, High-Strength Low-Alloy With Improved Formability,
	and Ultra-High-Strength
SA-1016/SA-1016M	Specification for General Requirements for Ferritic Alloy Steel, Austenitic
3A-1010/3A-1010M	· · · · · · · · · · · · · · · · · · ·
CA 1017/CA 1017M	Alloy Steel, and Stainless Steel Tubes
SA-1017/SA-1017M	Specification for Pressure Vessel Plates, Alloy-Steel, Chromium-
CA 1050	Molybdenum-Tungsten
SA-1058	Test Methods for Mechanical Testing of Steel Products—Metric
SF-568M	Specification for Carbon and Alloy Steel Externally Threaded Metric
	Fasteners
SA/AS 1548	Specification for Fine Grained, Weldable Steel Plates for Pressure
	Equipment
SA/CSA-G40.21	Specification for Structural Quality Steels
SA/EN 10025-2	Specification for Hot Rolled Products of Structural Steels
SA/EN 10028-2	Specification for Flat Products Made of Steels for Pressure Purposes
SA/EN 10028-3	Specification for Flat Products Made of Steels For Pressure Purposes
SA/EN 10028-4	Specification for Flat Products Made of Steels For Pressure Purposes

SA/EN 10028-7	Specification for Flat Products Made of Steels for Pressure Purposes	1581
SA/EN 10088-2	Specification for Stainless Steels	1583
SA/EN 10088-3	Specification for Stainless Steel	1585
SA/EN 10216-2	Specification for Seamless Steel Tubes for Pressure Purposes	1589
SA/EN 10217-1	Specification for Welded Steel Tubes for Pressure Purposes	1591
SA/EN 10222-2	Specification for Steel Forgings for Pressure Purposes	1593
SA/GB 713	Specification for Steel Plates for Boilers and Pressure Vessels	1595
SA/IS 2062	Specification for Hot Rolled Medium and High Tensile Structural Steel	1597
SA/JIS G3118	Specification for Carbon Steel Plates for Pressure Vessels for Intermediate and Moderate Temperature Service	1599
SA/JIS G4303	Specification for Stainless Steel Bars	1603
SA/JIS G5504	Specification for Heavy-Walled Ferritic Spheroidal Graphite Iron Castings for Low Temperature Service	1605
Mandatory Appendix I	Standard Units for Use in Equations	1607
Mandatory Appendix II	Framework of ASME Material Specifications	1608
II-100	General	1608
II-200	Source Standards	1608
II-300	Permissibility of Superseded Editions for ASME Construction	1608
II-400	Structure of ASME Material Specifications	1608
Mandatory Appendix III	Guidelines on Multiple Marking of Materials	1622
III-100	Background	1622
III-200	Guidelines	1622
Mandatory Appendix IV	Guidelines on the Approval of New Materials Under the ASME Boiler and	
	Pressure Vessel Code	1624
IV-100	Code Policy	1624
IV-200	Application	1624
IV-300	Chemical Composition	1626
IV-400	Metallurgical Structure and Heat Treatment	1626
IV-500	Mechanical Properties	1626
IV-600	Definitions for Data Collection Purposes	1626
IV-700	Required Sampling	1626
IV-800	Time-Independent Properties	1627
IV-900	Time-Dependent Properties	1627
IV-1000	Low-Temperature Properties	1629
IV-1100	Toughness Data	1629
IV-1200	Stress-Strain Curves	1629
IV-1300	Fatigue Data	1629
IV-1400	Physical Properties	1629
IV-1500	Data Requirements for Welds, Weldments, and Weldability	1630
IV-1600	Long-Term Properties Stability	1630
IV-1700	Requests for Additional Data	1632
	•	
IV-1800	New Materials Checklist	1632
IV-1900	New Materials Checklist	1632
IV-1900 IV-2000	New Materials Checklist	1632 1632
IV-1900	New Materials Checklist	1632

IARLES		
I-1	Standard Units for Use in Equations	1607
II-200-1	Material Specifications Acceptable for ASME Construction	1610
II-200-2	Material Specifications Acceptable for ASME Construction	1619
IV-100-1	Hot Isostatically Pressed Component Requirements for Austenitic Stainless Steels, Austenitic-	
	Ferritic (Duplex) Stainless Steels, Martensitic Stainless Steels, Ferritic Steels, and Nickel	
	Alloys	1625
IV-800-1	ASTM Test Methods and Units for Reporting	1628
IV-1500-1	Example of a Comparison of Allowable Stresses of Base Metals With Compositions Similar to	
	Those of Selected Welding Consumables and the Proposed New Base Metal	1631
FIGURES		
II-400-1	Illustrative Table of ASME Material Specifications (for II-400 Explanation Purposes Only)	1621

LIST OF SECTIONS

(23)

SECTIONS

- I Rules for Construction of Power Boilers
- II Materials
 - Part A Ferrous Material Specifications
 - Part B Nonferrous Material Specifications
 - Part C Specifications for Welding Rods, Electrodes, and Filler Metals
 - Part D Properties (Customary)
 - Part D Properties (Metric)
- III Rules for Construction of Nuclear Facility Components
 - Subsection NCA General Requirements for Division 1 and Division 2
 - Appendices
 - Division 1
 - Subsection NB Class 1 Components
 - Subsection NCD Class 2 and Class 3 Components
 - Subsection NE Class MC Components
 - Subsection NF Supports
 - Subsection NG Core Support Structures
 - Division 2 Code for Concrete Containments
 - Division 3 Containment Systems for Transportation and Storage of Spent Nuclear Fuel and High-Level Radioactive Material
 - Division 4 Fusion Energy Devices
 - Division 5 High Temperature Reactors
- IV Rules for Construction of Heating Boilers
- V Nondestructive Examination
- VI Recommended Rules for the Care and Operation of Heating Boilers
- VII Recommended Guidelines for the Care of Power Boilers
- VIII Rules for Construction of Pressure Vessels
 - Division 1
 - Division 2 Alternative Rules
 - Division 3 Alternative Rules for Construction of High Pressure Vessels
- IX Welding, Brazing, and Fusing Qualifications
- X Fiber-Reinforced Plastic Pressure Vessels
- XI Rules for Inservice Inspection of Nuclear Reactor Facility Components
 - Division 1 Rules for Inspection and Testing of Components of Light-Water-Cooled Plants
 - Division 2 Requirements for Reliability and Integrity Management (RIM) Programs for Nuclear Reactor Facilities
- XII Rules for Construction and Continued Service of Transport Tanks
- XIII Rules for Overpressure Protection

FOREWORD*

In 1911, The American Society of Mechanical Engineers established the Boiler and Pressure Vessel Committee to formulate standard rules for the construction of steam boilers and other pressure vessels. In 2009, the Boiler and Pressure Vessel Committee was superseded by the following committees:

- (a) Committee on Power Boilers (I)
- (b) Committee on Materials (II)
- (c) Committee on Construction of Nuclear Facility Components (III)
- (d) Committee on Heating Boilers (IV)
- (e) Committee on Nondestructive Examination (V)
- (f) Committee on Pressure Vessels (VIII)
- (g) Committee on Welding, Brazing, and Fusing (IX)
- (h) Committee on Fiber-Reinforced Plastic Pressure Vessels (X)
- (i) Committee on Nuclear Inservice Inspection (XI)
- (j) Committee on Transport Tanks (XII)
- (k) Committee on Overpressure Protection (XIII)
- (1) Technical Oversight Management Committee (TOMC)

Where reference is made to "the Committee" in this Foreword, each of these committees is included individually and collectively.

The Committee's function is to establish rules of safety relating only to pressure integrity, which govern the construction** of boilers, pressure vessels, transport tanks, and nuclear components, and the inservice inspection of nuclear components and transport tanks. The Committee also interprets these rules when questions arise regarding their intent. The technical consistency of the Sections of the Code and coordination of standards development activities of the Committees is supported and guided by the Technical Oversight Management Committee. This Code does not address other safety issues relating to the construction of boilers, pressure vessels, transport tanks, or nuclear components, or the inservice inspection of nuclear components or transport tanks. Users of the Code should refer to the pertinent codes, standards, laws, regulations, or other relevant documents for safety issues other than those relating to pressure integrity. Except for Sections XI and XII, and with a few other exceptions, the rules do not, of practical necessity, reflect the likelihood and consequences of deterioration in service related to specific service fluids or external operating environments. In formulating the rules, the Committee considers the needs of users, manufacturers, and inspectors of pressure vessels. The objective of the rules is to afford reasonably certain protection of life and property, and to provide a margin for deterioration in service to give a reasonably long, safe period of usefulness. Advancements in design and materials and evidence of experience have been recognized.

This Code contains mandatory requirements, specific prohibitions, and nonmandatory guidance for construction activities and inservice inspection and testing activities. The Code does not address all aspects of these activities and those aspects that are not specifically addressed should not be considered prohibited. The Code is not a handbook and cannot replace education, experience, and the use of engineering judgment. The phrase *engineering judgment* refers to technical judgments made by knowledgeable engineers experienced in the application of the Code. Engineering judgments must be consistent with Code philosophy, and such judgments must never be used to overrule mandatory requirements or specific prohibitions of the Code.

The Committee recognizes that tools and techniques used for design and analysis change as technology progresses and expects engineers to use good judgment in the application of these tools. The designer is responsible for complying with Code rules and demonstrating compliance with Code equations when such equations are mandatory. The Code neither requires nor prohibits the use of computers for the design or analysis of components constructed to the

^{*} The information contained in this Foreword is not part of this American National Standard (ANS) and has not been processed in accordance with ANSI's requirements for an ANS. Therefore, this Foreword may contain material that has not been subjected to public review or a consensus process. In addition, it does not contain requirements necessary for conformance to the Code.

^{**} Construction, as used in this Foreword, is an all-inclusive term comprising materials, design, fabrication, examination, inspection, testing, certification, and overpressure protection.

requirements of the Code. However, designers and engineers using computer programs for design or analysis are cautioned that they are responsible for all technical assumptions inherent in the programs they use and the application of these programs to their design.

The rules established by the Committee are not to be interpreted as approving, recommending, or endorsing any proprietary or specific design, or as limiting in any way the manufacturer's freedom to choose any method of design or any form of construction that conforms to the Code rules.

The Committee meets regularly to consider revisions of the rules, new rules as dictated by technological development, Code Cases, and requests for interpretations. Only the Committee has the authority to provide official interpretations of this Code. Requests for revisions, new rules, Code Cases, or interpretations shall be addressed to the Secretary in writing and shall give full particulars in order to receive consideration and action (see Submittal of Technical Inquiries to the Boiler and Pressure Vessel Standards Committees). Proposed revisions to the Code resulting from inquiries will be presented to the Committee for appropriate action. The action of the Committee becomes effective only after confirmation by ballot of the Committee and approval by ASME. Proposed revisions to the Code approved by the Committee are submitted to the American National Standards Institute (ANSI) and published at http://go.asme.org/BPVCPublicReview to invite comments from all interested persons. After public review and final approval by ASME, revisions are published at regular intervals in Editions of the Code.

The Committee does not rule on whether a component shall or shall not be constructed to the provisions of the Code. The scope of each Section has been established to identify the components and parameters considered by the Committee in formulating the Code rules.

Questions or issues regarding compliance of a specific component with the Code rules are to be directed to the ASME Certificate Holder (Manufacturer). Inquiries concerning the interpretation of the Code are to be directed to the Committee. ASME is to be notified should questions arise concerning improper use of the ASME Single Certification Mark.

When required by context in this Section, the singular shall be interpreted as the plural, and vice versa, and the feminine, masculine, or neuter gender shall be treated as such other gender as appropriate.

The words "shall," "should," and "may" are used in this Standard as follows:

- Shall is used to denote a requirement.
- Should is used to denote a recommendation.
- May is used to denote permission, neither a requirement nor a recommendation.

STATEMENT OF POLICY ON THE USE OF THE ASME SINGLE CERTIFICATION MARK AND CODE AUTHORIZATION IN ADVERTISING

ASME has established procedures to authorize qualified organizations to perform various activities in accordance with the requirements of the ASME Boiler and Pressure Vessel Code. It is the aim of the Society to provide recognition of organizations so authorized. An organization holding authorization to perform various activities in accordance with the requirements of the Code may state this capability in its advertising literature.

Organizations that are authorized to use the ASME Single Certification Mark for marking items or constructions that have been constructed and inspected in compliance with the ASME Boiler and Pressure Vessel Code are issued Certificates of Authorization. It is the aim of the Society to maintain the standing of the ASME Single Certification Mark for the benefit of the users, the enforcement jurisdictions, and the holders of the ASME Single Certification Mark who comply with all requirements.

Based on these objectives, the following policy has been established on the usage in advertising of facsimiles of the ASME Single Certification Mark, Certificates of Authorization, and reference to Code construction. The American Society of Mechanical Engineers does not "approve," "certify," "rate," or "endorse" any item, construction, or activity and there shall be no statements or implications that might so indicate. An organization holding the ASME Single Certification Mark and/or a Certificate of Authorization may state in advertising literature that items, constructions, or activities "are built (produced or performed) or activities conducted in accordance with the requirements of the ASME Boiler and Pressure Vessel Code," or "meet the requirements of the ASME Boiler and Pressure Vessel Code." An ASME corporate logo shall not be used by any organization other than ASME.

The ASME Single Certification Mark shall be used only for stamping and nameplates as specifically provided in the Code. However, facsimiles may be used for the purpose of fostering the use of such construction. Such usage may be by an association or a society, or by a holder of the ASME Single Certification Mark who may also use the facsimile in advertising to show that clearly specified items will carry the ASME Single Certification Mark.

STATEMENT OF POLICY ON THE USE OF ASME MARKING TO IDENTIFY MANUFACTURED ITEMS

The ASME Boiler and Pressure Vessel Code provides rules for the construction of boilers, pressure vessels, and nuclear components. This includes requirements for materials, design, fabrication, examination, inspection, and stamping. Items constructed in accordance with all of the applicable rules of the Code are identified with the ASME Single Certification Mark described in the governing Section of the Code.

Markings such as "ASME," "ASME Standard," or any other marking including "ASME" or the ASME Single Certification Mark shall not be used on any item that is not constructed in accordance with all of the applicable requirements of the Code.

Items shall not be described on ASME Data Report Forms nor on similar forms referring to ASME that tend to imply that all Code requirements have been met when, in fact, they have not been. Data Report Forms covering items not fully complying with ASME requirements should not refer to ASME or they should clearly identify all exceptions to the ASME requirements.

PERSONNEL ASME Boiler and Pressure Vessel Standards Committees, Subgroups, and Working Groups

January 1, 2023

TECHNICAL OVERSIGHT MANAGEMENT COMMITTEE (TOMC)

R. E. McLaughlin, Chair	W. M. Lundy
N. A. Finney, Vice Chair	D. I. Morris
S. J. Rossi, Staff Secretary	T. P. Pastor
G. Aurioles, Sr.	M. D. Rana
R. W. Barnes	S. C. Roberts
T. L. Bedeaux	F. J. Schaaf, Jr.
C. Brown	G. Scribner
D. B. DeMichael	W. J. Sperko
R. P. Deubler	D. Srnic
J. G. Feldstein	
G. W. Galanes	R. W. Swayne
I. A. Hall	J. Vattappilly
T. E. Hansen	M. Wadkinson
G. W. Hembree	B. K. Nutter, Ex-Office

cio Member R. B. Keating M. J. Pischke, Ex-Officio Member B. Linnemann J. F. Henry, Honorary Member

Subgroup on Research and Development (TOMC)

S. C. Roberts, Chair R. B. Keating S. J. Rossi, Staff Secretary R. E. McLaughlin R. W. Barnes T. P. Pastor

N. A. Finney D. Andrei, Contributing Member

W. Hoffelner

Subgroup on Strategic Initiatives (TOMC)

N. A. Finney, Chair M. H. Jawad S. J. Rossi, Staff Secretary R. B. Keating R. W. Barnes R. E. McLaughlin T. L. Bedeaux T. P. Pastor S. C. Roberts G. W. Hembree

Task Group on Remote Inspection and Examination (SI-TOMC)

S. C. Roberts, Chair M. Tannenbaum P. J. Coco J. Cameron, Alternate N. A. Finney A. Byk, Contributing Member S. A. Marks J. Pang, Contributing Member R. Rockwood S. J. Rossi, Contributing Member C. Stevens C. A. Sanna, Contributing Member

Special Working Group on High Temperature Technology (TOMC)

B. F. Hantz D. Dewees, Chair F. W. Brust R. I. Jetter T. D. Burchell P. Smith

P. R. Donavin

ADMINISTRATIVE COMMITTEE

R. E. McLaughlin, Chair M. J. Pischke N. A. Finney, Vice Chair M. D. Rana S. J. Rossi, Staff Secretary S. C. Roberts J. Cameron R. R. Stevenson R. B. Keating R. W. Swayne B. Linnemann B. K. Nutter M. Wadkinson

MARINE CONFERENCE GROUP

H. N. Patel J. Oh, Staff Secretary J. G. Hungerbuhler, Jr. N. Prokopuk G. Nair J. D. Reynolds

CONFERENCE COMMITTEE

R. D. Troutt — Texas, Chair J. T. Amato — Ohio, Secretary W. Anderson — Mississippi R. Becker — Colorado T. D. Boggs — Missouri R. A. Boillard — Indiana D. P. Brockerville -Newfoundland and Labrador,

Canada R. J. Bunte — Iowa

J. H. Burpee — Maine M. Carlson — Washington T. G. Clark — Oregon

B. J. Crawford — Georgia

E. L. Creaser — New Brunswick, Canada

J. J. Dacanay — Hawaii

R. DeLury — Manitoba, Canada A. Denham — Michigan

C. Dinic — Ontario, Canada D. A. Ehler — Nova Scotia, Canada

S. D. Frazier — Washington T. J. Granneman II — Oklahoma

S. Harder — Arizona M. L. Jordan — Kentucky

R. Kamboj — British Columbia, Canada

E. Kawa — Massachusetts A. Khssassi — Quebec, Canada

D. Kinney — North Carolina

K. S. Lane — Alaska

J. LeSage, Jr. — Louisiana A. M. Lorimor — South Dakota

M. Mailman — Northwest Territories, Canada

W. McGivney - City of New York, New York

(23)

S. F. Noonan — Maryland

C. L. O'Guin — Tennessee B. S. Oliver - New Hampshire

J. L. Oliver — Nevada P. B. Polick — Illinois

J. F. Porcella — West Virginia

B. Ricks — Montana

W. I. Ross — Pennsylvania M. H. Sansone — New York

T. S. Seime - North Dakota

C. S. Selinger - Saskatchewan, Canada

J. E. Sharier — Ohio

R. Spiker - North Carolina D. Srnic — Alberta, Canada

D. J. Stenrose — Michigan

R. J. Stimson II — Kansas R. K. Sturm — Utah

D. K. Sullivan — Arkansas J. Taveras — Rhode Island

G. Teel — California

D. M. Warburton — Florida M. Washington — New Jersey

E. Wiggins — Alabama

INTERNATIONAL INTEREST REVIEW GROUP

Subgroup on General Requirements and Piping (BPV I)

 V. Felix
 C. Minu

 Y.-G. Kim
 Y.-W. Park

 S. H. Leong
 A. R. Reynaga

S. H. Leong A. R. Reynaga Nogales W. Lin P. Williamson

O. F. Manafa

D. E. Tompkins, Chair
M. Wadkinson, Vice Chair
M. Lemmons, Secretary
R. Antoniuk
T. E. Hansen
M. Ishikawa
R. E. McLaughlin
B. J. Mollitor
Y. Oishi
E. M. Ortman
D. E. Tuttle
J. Vattappilly
R. V. Wielgoszinski

L. Moedinger W. L. Lowry, Contributing Member

COMMITTEE ON POWER BOILERS (BPV I)

R. E. McLaughlin, *Chair* M. Wadkinson E. M. Ortman, *Vice Chair* R. V. Wielgoszinski

U. D'Urso, Staff Secretary F. Zeller

D. I. Anderson H. Michael, Delegate

J. L. Arnold
D. L. Berger, Honorary Member
K. K. Coleman
P. D. Edwards, Honorary Member
J. G. Feldstein
D. N. French, Honorary Member
J. Hainsworth, Honorary Member
J. F. Henry, Honorary Member
J. F. Henry, Honorary Member
J. S. Hunter
J. P. MacKay, Honorary Member

J. S. Hunter
M. Ishikawa
M. Lemmons
L. Moedinger
Y. Oishi
J. R. MacKay, Honorary Member
P. A. Molvie, Honorary Member
J. T. Pillow, Honorary Member
B. W. Roberts, Honorary Member

M. Ortolani R. D. Schueler, Jr., Honorary
A. Spangenberg Member

D. E. Tompkins J. M. Tanzosh, Honorary Member

D. E. Tuttle R. L. Williams, Honorary Member

J. Vattappilly L. W. Yoder, Honorary Member

Subgroup on Locomotive Boilers (BPV I)

J. R. Braun, Chair S. A. Lee
S. M. Butler, Secretary L. Moedinger
G. W. Galanes G. M. Ray
D. W. Griner M. W. Westland

M. A. Janssen

Subgroup on Materials (BPV I)

K. K. Coleman, Chair
L. S. Nicol
K. Hayes, Vice Chair
M. Lewis, Secretary
D. W. Rahoi
S. H. Bowes
F. Zeller

G. W. Galanes
P. F. Gilston
B. W. Roberts, Contributing

J. S. Hunter Member

E. Liebl J. M. Tanzosh, Contributing

F. Masuyama Member

Executive Committee (BPV I)

E. M. Ortman, Chair
R. E. McLaughlin, Vice Chair
D. I. Anderson
J. L. Arnold
J. R. Braun
K. K. Coleman
H. Dalal
D. E. Tompkins
T. Dhanraj
U. D'Urso
P. F. Gilston
K. Hayes
P. Jennings
A. Spangenberg
A. Spangenberg
M. Wadkinson

Subgroup on Solar Boilers (BPV I)

P. Jennings, *Chair* J. S. Hunter R. E. Hearne, *Secretary* P. Swarnkar

S. Fincher

Task Group on Modernization (BPV I)

Subgroup on Design (BPV I)

D. I. Anderson, Chair
N. S. Ranck
L. S. Tsai, Secretary
J. Vattappilly
P. Becker
M. Wadkinson

L. Krupp D. Dewees, Contributing Member
C. T. McDaris J. P. Glaspie, Contributing Member

D. I. Anderson, Chair
U. D'Urso, Staff Secretary
J. L. Arnold
D. Dewees
G. W. Galanes
J. P. Glaspie
T. E. Hansen
R. E. McLaughlin
E. M. Ortman
D. E. Tuttle
J. Vattappilly

Germany International Working Group (BPV I)

Subgroup on Fabrication and Examination (BPV I)

P. Chavd.
J. L. Arnold, Chair
P. F. Gilston, Vice Chair
M. Lewis
J. Fleisch
P. Becker, Secretary
C. T. McDaris
C. Jaekel
K. K. Coleman
R. E. McLaughlin
R. Kauer

S. Fincher R. J. Newell
G. W. Galanes Y. Oishi

T. E. Hansen R. V. Wielgoszinski

A. Spangenberg, Chair
P. Chavdarov, Secretary
B. Daume
J. Fleischfresser
R. A. Meyers
H. Michael
F. Miunske
M. Sykora

. Jaekel R. Helmholdt, *Contributing*

R. Kauer Member

D. Koelbl J. Henrichsmeyer, *Contributing*

S. Krebs Member

T. Ludwig B. Müller, Contributing Member

India International Working Group (BPV I)

H. Dalal <i>, Chair</i>	S. Purkait
T. Dhanraj, Vice Chair	M. G. Rao
K. Thanupillai, Secretary	G. U. Shanker
P. Brahma	D. K. Shrivastava
S. Chakrabarti	K. Singha
A. Hantodkar	R. Sundararaj
A. J. Patil	S. Venkataramana

Subgroup on International Material Specifications (BPV II)

M. Ishikawa, Chair	F. Zeller
P. Chavdarov, Vice Chair	C. Zhou
A. Chaudouet	O Oldoni

O. Oldani, Delegate H. Chen

H. Lorenz, Contributing Member A. F. Garbolevsky T. F. Miskell, Contributing Member D. O. Henry W. M. Lundy E. Upitis, Contributing Member

COMMITTEE ON MATERIALS (BPV II)

J. Cameron, <i>Chair</i>	D. W. Rahoi
G. W. Galanes, Vice Chair	W. Ren
C. E. Rodrigues, Staff Secretary	E. Shapiro
A. Appleton	R. C. Sutherlin
P. Chavdarov	F. Zeller
K. K. Coleman	O. Oldani, Delegate
D. W. Gandy	A. Chaudouet, Contributing
J. F. Grubb	Member
J. A. Hall	J. D. Fritz, Contributing Member
D. O. Henry	W. Haffalman Contributing Manual

W. Hoffelner, Contributing Member K. M. Hottle K. E. Orie, Contributing Member M. Ishikawa D. T. Peters, Contributing Member K. Kimura B. W. Roberts, Contributing M. Kowalczyk

Member D. L. Kurle

J. M. Tanzosh, Contributing F. Masuyama

Member S. Neilsen

L. S. Nicol E. Upitis, Contributing Member M. Ortolani R. G. Young, Contributing Member

Subgroup on Nonferrous Alloys (BPV II)

E. Shapiro, <i>Chair</i>	J. A. McMaster
W. MacDonald, Vice Chair	D. W. Rahoi
J. Robertson, Secretary	W. Ren
R. M. Beldyk	R. C. Sutherlin
J. M. Downs	R. Wright
J. F. Grubb	S. Yem

D. B. Denis, Contributing Member J. A. Hall D. Maitra D. T. Peters, Contributing Member

Subgroup on Physical Properties (BPV II)

P. K. Rai, Chair R. D. Jones S. Neilsen, Vice Chair P. K. Lam G. Aurioles, Sr. D. W. Rahoi D. Chandiramani E. Shapiro P. Chavdarov D. K. Verma H. Eshraghi S. Yem J. F. Grubb

B. F. Hantz D. B. Denis, Contributing Member

Executive Committee (BPV II)

J. Cameron, <i>Chair</i>	W. Hoffelner
C. E. Rodrigues, Staff Secretary	M. Ishikawa
A. Appleton	M. Ortolani
K. K. Coleman	P. K. Rai
G. W. Galanes	
J. F. Grubb	J. Robertson
S. Guzey	E. Shapiro

Subgroup on Strength, Ferrous Alloys (BPV II)

M. Ortolani, Chair M. Osterfoss L. S. Nicol, Secretary D. W. Rahoi G. W. Galanes S. Rosinski J. A. Hall M. Ueyama M. Ishikawa F. Zeller

S. W. Knowles F. Abe, Contributing Member F. Masuyama R. G. Young, Contributing Member

Subgroup on External Pressure (BPV II)

S. Guzey, Chair	M. H. Jawad
E. Alexis, Vice Chair	S. Krishnamurthy
J. A. A. Morrow, Secretary	D. L. Kurle
L. F. Campbell	R. W. Mikitka
H. Chen D. S. Griffin	P. K. Rai
J. F. Grubb	M. Wadkinson

Subgroup on Strength of Weldments (BPV II & BPV IX)

K. K. Coleman, Chair I. Penso K. L. Hayes, Vice Chair D. W. Rahoi S. H. Bowes, Secretary W. J. Sperko M. Denault J. P. Swezy, Jr. G. W. Galanes M. Ueyama

D. W. Gandy P. D. Flenner, Contributing Member M. Ghahremani B. W. Roberts, Contributing

W. F. Newell, Jr. Member

Subgroup on Ferrous Specifications (BPV II)

A. Appleton, Chair	S. G. Lee
K. M. Hottle, Vice Chair	W. C. Mack
C. Hyde, Secretary	J. Nickel
D. Amire-Brahimi	K. E. Orie
G. Cuccio	D. Poweleit
O. Elkadim	E. Upitis
D. Fialkowski	•
J. F. Grubb	L. Watzke

J. D. Fritz, Contributing Member D. S. Janikowski C. Meloy, Contributing Member Y.-J. Kim

Working Group on Materials Database (BPV II)

W. Hoffelner, Chair J. Cameron, Contributing Member C. E. Rodrigues, Staff Secretary J. F. Grubb, Contributing Member F. Abe D. T. Peters, Contributing Member W. MacDonald W. Ren, Contributing Member R. C. Sutherlin B. W. Roberts, Contributing Member

D. Andrei, Contributing Member

J. L. Arnold, Contributing Member E. Shapiro, Contributing Member

Working Group on Creep Strength Enhanced Ferritic Steels (BPV II)

M. Ortolani, Chair G. W. Galanes, Vice Chair P. Becker, Secretary S. H. Bowes K. K. Coleman K. Kimura W. F. Newell, Jr. J. J. Sanchez-Hanton J. A. Siefert W. J. Sperko F. Zeller

M. Lang F. Abe, Contributing Member
S. Luke P. D. Flenner, Contributing Member
F. Masuyama J. M. Tanzosh, Contributing

T. Melfi Member

Executive Committee (BPV III)

R. B. Keating, Chair
A. Maslowski, Secretary
D. E. Matthews
T. M. Adams
P. R. Donavin
J. V. Gardiner
J. V. Gardiner
J. Grimm
D. W. Lewis
K. A. Kavanagh, Alternate

Working Group on Data Analysis (BPV II)

J. F. Grubb <i>, Chair</i>	F. Abe, Contributing Member
W. Ren, Vice Chair	W. Hoffelner, Contributing Member
K. Kimura	W. C. Mack, Contributing Member
F. Masuyama	, 0
S. Neilsen	D. T. Peters, Contributing Member
M. Ortolani	B. W. Roberts, Contributing
M. J. Swindeman	Member

China International Working Group (BPV II)

T. Xu, Secretary S. Tan W. Cai C. Wang W. Fang Jinguang Wang Q. C. Feng Jiongxiang Wang S. Huo Q.-J. Wang F. Kong X. Wang H. Leng H.-C. Yang Hli Li J. Yang Hongbin Li L. Yin J. Li H. Zhang

S. Liu

Z. Rongcan

M. A. Lockwood K. A. Manoly

COMMITTEE ON CONSTRUCTION OF NUCLEAR FACILITY COMPONENTS (BPV III)

X.-H. Zhang

Y. Zhang

R. B. Keating, Chair	K. Matsunaga
T. M. Adams, Vice Chair	B. McGlone
D. E. Matthews, Vice Chair	S. McKillop
A. Maslowski, Staff Secretary	J. McLean
A. Appleton	J. C. Minichiello
S. Asada	M. N. Mitchell
R. W. Barnes	T. Nagata
W. H. Borter	J. B. Ossmann
M. E. Cohen	S. Pellet
R. P. Deubler	E. L. Pleins
P. R. Donavin	TL. Sham
A. C. Eberhardt	W. J. Sperko
J. V. Gardiner	W. Windes
J. Grimm	C. Basavaraju, Alternate
S. Hunter	C. T. Smith, Contributing Member
R. M. Jessee	W. K. Sowder, Jr., Contributing
R. I. Jetter	Member
C. C. Kim	M. Zhou, Contributing Member
G. H. Koo	E. B. Branch, Honorary Member
D. W. Lewis	G. D. Cooper, Honorary Member

Argentina International Working Group (BPV III)

M. F. J. J. Cl. :	4 1 D 1110 1
M. F. Liendo, <i>Chair</i>	A. J. Dall'Osto
J. Fernández, Vice Chair	J. I. Duo
O. Martinez, Staff Secretary	M. M. Gamizo
O. A. Verastegui, Secretary	I. M. Guerreiro
E. H. Aldaz	I. A. Knorr
G. O. Anteri	
A. P. Antipasti	D. E. Matthews
1	A. E. Pastor
D. O. Bordato	M. Rivero
G. Bourguigne	M. Rivero
M. Brusa	M. D. Vigliano
A. Claus	P. Yamamoto
R. G. Cocco	M. Zunino

China International Working Group (BPV III)

Y. Wang, Chair	C. Peiyin
H. Yu, Secretary	Z. Sun
L. Feng	G. Tang
J. Gu	L. Ting
L. Guo	F. Wu
C. Jiang	C. Yang
D. Kang	P. Yang
Y. Li	W. Yang
H. Lin	H. Yin
S. Liu	
W. Liu	D. Yuangang
J. Ma	G. Zhang
K. Mao	D. Zhao
D. E. Matthews	Z. Zhong
J. Ming	Q. Zhou
W. Pei	H. Zhu

Germany International Working Group (BPV III)

J. Wendt <i>, Chair</i>	C. Kuschke
D. Koelbl, Vice Chair	HW. Lange
R. Gersinska, Secretary	T. Ludwig
P. R. Donavin	X. Pitoiset
R. Döring	M. Reichert
C. G. Frantescu	G. Roos
A. Huber	J. Rudolph
R. E. Hueggenberg	L. Sybertz
C. Huttner	I. Tewes
E. Iacopetta	R. Tiete
M. H. Koeppen	F. Wille

D. F. Landers, Honorary Member

C. Pieper, Honorary Member

India International Working Group (BPV III)

R. N. Sen, Chair	R. Kumar
S. B. Parkash, Vice Chair	S. Kumar
A. D. Bagdare, Secretary	M. Lakshminarasimhan
S. Aithal	T. Mukherjee
S. Benhur	D. Narain
N. M. Borwankar	A. D. Paranjpe
M. Brijlani	J. R. Patel
H. Dalal	E. L. Pleins
S. K. Goyal	T. J. P. Rao
A. Johori	V. Sehgal
A. P. Kishore	S. Singh
D. Kulkarni	B. K. Sreedhar

Korea International Working Group (BPV III)

G. H. Koo, Chair	YS. Kim
OS. Kim, Secretary	D. Kwon
H. Ahn	B. Lee
S. Cho	D. Lee
GS. Choi	S. Lee
MJ. Choi	SG. Lee
S. Choi	H. Lim
J. Y. Hong	IK. Nam
NS. Huh	CK. Oh
JK. Hwang	CY. Oh
S. S. Hwang	EJ. Oh
C. Jang	C. Park
I. I. Jeong	H. Park
S. H. Kang	Y. S. Pyun
JI. Kim	T. Shin
JS. Kim	S. Song
MW. Kim	W. J. Sperko
SS. Kim	J. S. Yang
YB. Kim	O. Yoo

Seismic Design Steering Committee (BPV III)

T. M. Adams, Chair	G. H. Koo
F. G. Abatt, Secretary	A. Maekawa
G. A. Antaki	K. Matsunag
C. Basavaraju	J. McLean
D. Chowdhury	R. M. Pace
R. Döring	D. Watkins

Task Group on Alternate Requirements (BPV III)

rask droup on meeri	iate Requirements (1
J. Wen, Chair	D. E. Matthews
R. R. Romano, Secretary	S. McKillop
P. J. Coco	B. P. Nolan
P. R. Donavin	J. B. Ossmann
J. V. Gardiner	E. C. Renaud
J. Grimm	M. A. Richter
R. S. Hill III	
M. Kris	I. H. Tseng
M. A. Lockwood	Y. Wang

United Kingdom International Working Group (BPV III)

C. D. Bell, Chair	G. Innes
P. M. James, Vice Chair	S. A. Jones
C. B. Carpenter, Secretary	B. Pellereau
T. M. Adams	C. R. Schneider
T. Bann	J. W. Stairmand
M. J. Chevalier A. J. Cole-Baker	J. Sulley
M. Consonni	J. Talamantes-Silva
i ii doilloiliii	

M. Consonni J. Talamantes-Silva
M. J. Crathorne A. J. Holt, Contributing Member

Special Working Group on New Plant Construction Issues (BPV III)

J. B. Ossmann, <i>Chair</i>	R. E. McLaughlin
A. Maslowski, Staff Secretary	E. L. Pleins
M. C. Buckley, Secretary	D. W. Sandusky
M. Arcaro	M. C. Scott
A. Cardillo	R. R. Stevenson
P. J. Coco	H. Xu
K. Harris	J. Yan

J. Honcharik J. C. Minichiello, Contributing

M. Kris Member

Special Working Group on Editing and Review (BPV III)

D. E. Matthews, Chair	S. Hunter
R. P. Deubler	J. C. Minichiello
A. C. Eberhardt	J. F. Strunk
J. V. Gardiner	C. Wilson

Special Working Group on HDPE Stakeholders (BPV III)

S. Patterson, Secretary	D. P. Munson
S. Choi	T. M. Musto
C. M. Faidy	J. E. O'Sullivan
M. Golliet	V. Rohatgi
R. M. Jessee	F. J. Schaaf, Jr.
J. Johnston, Jr.	, , ,
M. Kuntz	R. Stakenborghs
M. Lashley	M. Troughton
K. A. Manoly	B. Lin, Alternate

Special Working Group on Honors and Awards (BPV III)

J. C. Minichiello <i>, Chair</i>	R. M. Jessee
A. Appleton	D. E. Matthews

R. W. Barnes

Special Working Group on International Meetings and IWG Liaisons (BPV III)

D. E. Matthews, Chair	P. R. Donavin
A. Maslowski, Staff Secretary	E. L. Pleins
T. M. Adams	W. J. Sperko

R. W. Barnes

Joint ACI-ASME Committee on Concrete Components for Nuclear Service (BPV III)

J. McLean, Chair G. Thomas L. J. Colarusso, Vice Chair A. Varma J. Cassamassino, Staff Secretary S. Wang A. Dinizulu, Staff Secretary A. Istar, Alternate

C. J. Bang A. Adediran, Contributing Member A. C. Eberhardt S. Bae, Contributing Member B. D. Hovis J.-B. Domage, Contributing Member T. C. Inman P. S. Ghosal, Contributing Member C. Jones B. B. Scott, Contributing Member T. Kang M. R. Senecal, Contributing N.-H. Lee

Member J. A. Munshi

Z. Shang, Contributing Member T. Muraki M. Sircar, Contributing Member I. S. Saini J. F. Strunk C. T. Smith, Contributing Member

Special Working Group on Modernization (BPV III-2)

S. Wang, Chair A. Varma

J. McLean, Vice Chair F. Lin, Contributing Member A. Adediran J. A. Pires, Contributing Member S. Malushte I. Zivanovic, Contributing Member

J. S. Saini

Task Group on Steel-Concrete Composite Containments (BPV III-2)

A. Varma, Chair J. A. Pires S. Malushte J. S. Saini

J. McLean

Working Group on Design (BPV III-2)

N.-H. Lee. Chair G. Thomas S. Wang, Vice Chair A. Istar, Alternate

M. Allam P. S. Ghosal, Contributing Member S. Bae S.-Y. Kim, Contributing Member L. J. Colarusso J. Kwon, Contributing Member A. C. Eberhardt S. E. Ohler-Schmitz, Contributing B. D. Hovis Member T. C. Inman

B. B. Scott, Contributing Member C. Jones Z. Shang, Contributing Member I. A. Munshi M. Shin, Contributing Member T. Muraki J. S. Saini M. Sircar, Contributing Member

Working Group on Materials, Fabrication, and Examination (BPV III-2)

C. Jones, Chair Z. Shang A. Eberhardt, Vice Chair J. F. Strunk

C. J. Bang A. A. Aboelmagd, Contributing

B. Birch Member

J.-B. Domage P. S. Ghosal, Contributing Member T. Kang B. B. Scott, Contributing Member N.-H. Lee I. Zivanovic, Contributing Member

Subcommittee on Design (BPV III)

P. R. Donavin, Chair B. Pellereau S. McKillop, Vice Chair T.-L. Sham R. P. Deubler W. F. Weitze

C. Basavaraju, Alternate M. A. Gray R. I. Jetter G. L. Hollinger, Contributing

R. B. Keating Member

I.-I. Kim M. H. Jawad, Contributing Member K. A. Manoly W. J. O'Donnell, Sr., Contributing D. E. Matthews Member M. N. Mitchell K. Wright, Contributing Member

Subgroup on Component Design (SC-D) (BPV III)

D. E. Matthews, Chair T. Mitsuhashi P. Vock, Vice Chair D. Murphy S. Pellet, Secretary T. M. Musto T. M. Adams T. Nagata D. J. Ammerman G. Z. Tokarski G. A. Antaki S. Willoughby-Braun

J. J. Arthur C. Wilson

S. Asada A. A. Dermenjian, Contributing

J. F. Ball Member

C. Basavaraju P. Hirschberg, Contributing

D. Chowdhury Member

N. A. Costanzo R. B. Keating, Contributing Member R. P. Deubler O.-S. Kim, Contributing Member M. Kassar R. J. Masterson, Contributing D. Keck

Member

T. R. Liszkai H. S. Mehta, Contributing Member K. A. Manoly I. Saito, Contributing Member J. P. Tucker, Contributing Member J. C. Minichiello

Task Group to Improve Section III/XI Interface (SG-CD) (BPV III)

P. Vock, Chair C. A. Nove E. Henry, Secretary T. Nuoffer G. A. Antaki J. B. Ossmann A. Cardillo A. T. Roberts III D. Chowdhury J. Sciulli J. Honcharik A. Udyawar J. Hurst S. Willoughby-Braun J. Lambin

Working Group on Core Support Structures (SG-CD) (BPV III)

D. Keck, Chair M. D. Snyder R. Z. Ziegler, Vice Chair R. Vollmer R. Martin, Secretary T. M. Wiger G. W. Delport C. Wilson L. C. Hartless Y. Wong T. R. Liszkai

M. Nakajima H. S. Mehta, Contributing Member

Working Group on Design of Division 3 Containment Systems (SG-CD) (BPV III)

D. J. Ammerman, Chair D. Siromani S. Klein, Secretary R. Sypulski G. Bjorkman X. Zhai V. Broz X. Zhang D. W. Lewis

C. R. Sydnor, Alternate J. M. Piotter

J. C. Minichiello, Contributing A. Rigato

P. Sakalaukus, Jr. Member

Working Group on HDPE Design of Components (SG-CD) (BPV III)

T. M. Musto, Chair
J. B. Ossmann, Secretary
M. Brandes
S. Choi
R. Stakenborghs
J. R. Hebeisen
M. T. Audrain, Alternate
P. Krishnaswamy
J. C. Minichiello, Contributing

Working Group on Valves (SG-CD) (BPV III)

P. Vock, Chair H. O'Brien S. Jones, Secretary J. O'Callaghan M. C. Buckley M. Rain A. Cardillo K. E. Reid II G. A. Jolly J. Sulley J. Lambin I. H. Tseng J. P. Tucker T. Lippucci C. A. Mizer Y. Wong, Alternate

Working Group on Piping (SG-CD) (BPV III)

Member

G. A. Antaki, *Chair*G. Z. Tokarski, *Secretary*C. Basavaraju

K. E. Reid II
D. Vlaicu
S. Weindorf

M. Kuntz

J. Catalano
T. M. Adams, Contributing Member
F. Claeys
R. B. Keating, Contributing Member
T. B. Littleton, Contributing
Member
N. M. Graham

M. A. Gray
M. A. Gray
J. F. McCabe, Contributing Member
J. Gurdal
J. C. Minichiello, Contributing
Member
A. Hirano
A. Hirano
A. N. Nguyen, Contributing Member

P. Hirschberg
M. Kassar
M. S. Sills, Contributing Member
J. Kawahata
D. Lieb
A. N. Nguyen, Contributing Member
M. S. Sills, Contributing Member
N. C. Sutherland, Contributing
Member

I.-K. Nam E. A. Wais, Contributing Member
J. O'Callaghan C.-I. Wu, Contributing Member

Working Group on Vessels (SG-CD) (BPV III)

D. Murphy, Chair T. J. Schriefer S. Willoughby-Braun, Secretary M. C. Scott J. J. Arthur P. K. Shah C. Basavaraju D. Vlaicu M. Brijlani C. Wilson L. Constantinescu R. Z. Ziegler J. I. Kim R. J. Huang, Alternate O.-S. Kim B. Basu, Contributing Member R. B. Keating, Contributing Member D. E. Matthews W. F. Weitze, Contributing Member T. Mitsuhashi

Working Group on Pressure Relief (SG-CD) (BPV III)

K. R. May, Chair
R. Krithivasan, Secretary
B. J. Yonsky
M. Brown
J. W. Dickson
J. Yu, Alternate

S. Jones
R. Lack
D. Miller
D. B. Ross, Contributing Member
T. Patel
S. Ruesenberg, Contributing

K. Shores Member

Subgroup on Design Methods (SC-D) (BPV III)

S. McKillop, Chair
P. R. Donavin, Vice Chair
R. Vollmer
J. Wen, Secretary
W. F. Weitze
K. Avrithi
L. Davies
P. Smith
R. Vollmer
T. W. Adams, Contributing Member

M. A. Gray
J. V. Gregg, Jr.

C. W. Bruny, Contributing Member
S. R. Gosselin, Contributing

K. Hsu Member

R. Kalnas H. T. Harrison III, Contributing

D. Keck Member

I. I. Kim W. J. O'Donnell, Sr., Contributing

B. Pellereau Member

W. D. Reinhardt K. Wright, Contributing Member

Working Group on Pumps (SG-CD) (BPV III)

D. Chowdhury, Chair
J. V. Gregg, Jr., Secretary
B. Busse
J. H. Tseng, Al

B. Busse
M. D. Eftychiou
R. A. Fleming
K. J. Noel
J. Sulley

I. H. Tseng, Alternate
X. Di, Contributing Member
C. Gabhart, Contributing Member
R. Ladefian, Contributing Member

Working Group on Supports (SG-CD) (BPV III)

N. A. Costanzo, Chair
G. Thomas
U. S. Bandyopadhyay, Secretary
K. Avrithi
L. Vandersip
R. P. Deubler
P. Wiseman

N. M. Graham R. J. Masterson, *Contributing*

Y. Matsubara Member

S. Pellet J. R. Stinson, Contributing Member

Special Working Group on Computational Modeling for Explicit Dynamics (SG-DM) (BPV III)

G. Bjorkman, Chair
D. J. Ammerman, Vice Chair
V. Broz, Secretary
S. Kuehner
D. Molitoris
D. Siromani
C.-F. Tso
M. C. Yaksh
U. Zencker

W. D. Reinhardt Y. Wong, Contributing Member

Working Group on Design Methodology (SG-DM) (BPV III)

B. Pellereau, *Chair* T. M. Wiger R. Vollmer, *Secretary* K. Hsu, *Alternate*

K. Avrithi G. Banyay, Contributing Member
C. Basavaraju D. S. Bartran, Contributing Member
F. Berkepile R. D. Blevins, Contributing Member
C. M. Faidy M. R. Breach, Contributing Member
Y. Gao

M. Kassar
J. I. Kim

C. W. Bruny, Contributing Member
D. L. Caldwell, Contributing

T. R. Liszkai Member

D. Lytle H. T. Harrison III, Contributing

K. Matsunaga Member

S. McKillop C. F. Heberling II, Contributing

S. Ranganath Member

W. D. Reinhardt P. Hirschberg, Contributing

P. K. Shah Member

S. Wang R. B. Keating, Contributing Member
W. F. Weitze A. Walker, Contributing Member
J. Wen K. Wright, Contributing Member

Working Group on Environmental Fatigue Evaluation Methods (SG-DM) (BPV III)

M. A. Gray, Chair
W. F. Weitze, Secretary
D. Vlaicu
S. Asada
K. Wang
K. Avrithi
R. Z. Ziegler

R. C. Cipolla S. Cuvilliez, Contributing Member
T. M. Damiani T. D. Gilman, Contributing Member
C. M. Faidy S. R. Gosselin, Contributing

A. Hirano Member

P. Hirschberg Y. He, Contributing Member
K. Hsu H. S. Mehta, Contributing Member
J.-S. Park K. Wright, Contributing Member

Working Group on Fatigue Strength (SG-DM) (BPV III)

P. R. Donavin, Chair
J. I. Kim
M. S. Shelton, Secretary
S. H. Kleinsmith
R. S. Bass
B. Pellereau
T. M. Damiani
S. Ranganath
D. W. DeJohn
C. M. Faidy
P. Gill
S. R. Gosselin
J. I. Kim
W. H. Weinsmith
S. H. Kleinsmith
S. H. Kleinsmith
W. Pellereau
V. Wang
W. F. Weitze
Y. Zou

R. J. Gurdal S. Majumdar, Contributing Member
C. F. Heberling II H. S. Mehta, Contributing Member
C. E. Hinnant W. J. O'Donnell, Sr., Contributing

P. Hirschberg Member

K. Hsu K. Wright, Contributing Member

Subgroup on Containment Systems for Spent Nuclear Fuel and High-Level Radioactive Material (BPV III)

D. W. Lewis, Chair
R. Sypulski
D. J. Ammerman, Vice Chair
J. Wellwood
S. Klein, Secretary
X. J. Zhai
G. Bjorkman
X. Zhang

V. Broz D. Dunn, Alternate

A. Rigato W. H. Borter, Contributing Member
P. Sakalaukus, Jr. E. L. Pleins, Contributing Member
D. Siromani N. M. Simpson, Contributing

D. B. Spencer Member

Subgroup on Fusion Energy Devices (BPV III)

W. K. Sowder, Jr., Chair C. J. Lammi A. Maslowski, Staff Secretary S. Lawler M. Ellis, Secretary P. Mokaria M. Bashir D. J. Roszman J. P. Blanchard F. J. Schaaf, Jr. T. P. Davis P. Smith B. R. Doshi Y. Song L. El-Guebaly C. Vangaasbeek G. Holtmeier I. J. Zatz D. Johnson

I. Kimihiro R. W. Barnes, Contributing Member

Special Working Group on Fusion Stakeholders (BPV III-4)

T. P. Davis, Chair
R. W. Barnes
R. J. Pearson
V. Chugh
S. S. Desai
F. Deschamps
M. Hua
S. Lawler
S. C. Middleburgh
R. J. Pearson
W. K. Sowder, Jr.
D. A. Sutherland
N. Young
J. Zimmermann

Working Group on General Requirements (BPV III-4)

D. J. Roszman, *Chair* P. Mokaria M. Ellis W. K. Sowder, Jr.

Working Group on In-Vessel Components (BPV III-4)

M. Bashir, *Chair* M. Kalsey
Y. Carin S. T. Madabusi

T. P. Davis

Working Group on Magnets (BPV III-4)

W. K. Sowder, Jr., *Chair* D. S. Bartran

Working Group on Materials (BPV III-4)

Working Group on Probabilistic Methods in Design (SG-DM) (BPV III) M. Porton, Chair T. P. Davis

M. Golliet, Chair A. Hirano
R. Kalnas, Vice Chair K. A. Manoly
K. Avrithi P. J. O'Regan

K. Avrithi P. J. O'Regan
G. Brouette B. Pellereau
J. Hakii M. Yagodich

D. O. Henry R. S. Hill III, Contributing Member

Working Group on Vacuum Vessels (BPV III-4)

I. Kimihiro, Chair D. Johnson
L. C. Cadwallader Q. Shijun
B. R. Doshi Y. Song

Subgroup on General Requirements (BPV III)

Subgroup on High Temperature Reactors (BPV III)

J. V. Gardiner <i>, Chair</i>	T. N. Rezk	TL. Sham, Chair	A. Mann
N. DeSantis, Secretary	J. Rogers	Y. Wang, Secretary	M. C. Messner
V. Apostolescu	R. Spuhl	M. Ando	X. Wei
A. Appleton	D. M. Vickery	N. Broom	W. Windes
S. Bell	J. DeKleine, Contributing Member	F. W. Brust	R. Wright
J. R. Berry	H. Michael, Contributing Member	P. Carter	G. L. Zeng
G. Brouette	, ,	M. E. Cohen	o a
G. C. Deleanu	D. J. Roszman, Contributing	W. J. Geringer	D. S. Griffin, Contributing Member
J. W. Highlands	Member	B. F. Hantz	X. Li, Contributing Member
E. V. Imbro	C. T. Smith, Contributing Member	M. H. Jawad	W. O'Donnell, Sr., Contributing

W. K. Sowder, Jr., Contributing Member K. A. Kavanagh W. T. Jessup

L. Shi, Contributing Member Y.-S. Kim Member R. I. Jetter B. McGlone G. E. Szabatura, Contributing K. Kimura R. W. Swindeman, Contributing

E. C. Renaud Memher G. H. Koo Memher

Special Working Group on General Requirements Consolidation (SG-GR) (BPV III)

(SG-HTR) (BPV III) M. E. Cohen. Chair G. H. Koo J. V. Gardiner, Chair E. C. Renaud

M. C. Albert N. J. McTiernan J. Grimm, Vice Chair J. L. Williams M. Arcaro T. Nguyen G. C. Deleanu C. T. Smith, Contributing Member R. W. Barnes K. J. Noel A. C. Eberhardt N. Broom

T.-L. Sham R. Christensen B. Song V. Chugh X. Wei W. Corwin

G. L. Zeng G. C. Deleanu R. A. Fleming

Working Group on General Requirements (SG-GR) (BPV III)

B. McGlone, Chair D. T. Meisch J. Grimm, Secretary E. C. Renaud V. Apostolescu T. N. Rezk A. Appleton J. Rogers S. Bell B. S. Sandhu J. R. Berry R. Spuhl G. Brouette J. F. Strunk P. J. Coco D. M. Vickery N. DeSantis J. L. Williams

Y. Diaz-Castillo J. DeKleine, Contributing Member O. Elkadim S. F. Harrison, Jr., Contributing

J. Harris Member J. W. Highlands

E. V. Imbro D. J. Roszman, Contributing

K. A. Kavanagh Member

G. E. Szabatura, Contributing Y.-S. Kim

Y. K. Law Member

T. Asayama, Contributing Member X. Li, Contributing Member K. Harris L. Shi, Contributing Member R. I. Jetter Y. W. Kim G. Wu, Contributing Member

Special Working Group on High Temperature Reactor Stakeholders

Task Group on Division 5 AM Components (SG-HTR) (BPV III)

R. Wright, Chair M. McMurtrey R. Bass, Secretary M. C. Messner M. C. Albert T. Patterson R. W. Barnes E. C. Renaud F. W. Brust D. Rudland Z. Feng T.-L. Sham S. Lawler I. J. Van Rooyen

X. Lou X. Wei

Working Group on General Requirements for Graphite and Ceramic

Composite Core Components and Assemblies (SG-GR) (BPV III) W. J. Geringer, Chair M. N. Mitchell A. Appleton J. Potgieter

E. C. Renaud

C. Cruz R. Spuhl Y. Diaz-Castillo W. Windes

B. Lin, Alternate J. Lang

J. R. Berry

Working Group on Allowable Stress Criteria (SG-HTR) (BPV III)

R. Wright, Chair W. Ren M. McMurtrey, Secretary T.-L. Sham R. Bass Y. Wang K. Kimura X. Wei D. Maitra

M. Yoo, Alternate R. J. McReynolds

M. C. Messner R. W. Swindeman, Contributing

J. C. Poehler Member

Working Group on Analysis Methods (SG-HTR) (BPV III)

M. C. Messner, Chair T.-L. Sham H. Mahajan, Secretary X. Wei R. W. Barnes S. X. Xu J. A. Blanco J. Young

P. Carter M. R. Breach, Contributing Member W. T. Jessup T. Hassan, Contributing Member R. I. Jetter S. Krishnamurthy, Contributing G. H. Koo Member H. Qian M. J. Swindeman, Contributing T. Riordan Member

Subgroup on Materials, Fabrication, and Examination (BPV III)

J. Grimm, Chair M. Kris S. Hunter, Secretary D. W. Mann W. H. Borter T Melfi M. Brijlani I.-K. Nam G. R. Cannell J. B. Ossmann A. Cardillo J. E. O'Sullivan S. Cho M. C. Scott P. J. Coco W. J. Sperko R. H. Davis J. R. Stinson D. B. Denis I. F. Strunk B. D. Frew W. Windes D. W. Gandy R. Wright S. E. Gingrich S. Yee M. Golliet

H. Michael, Delegate L. S. Harbison R. M. Jessee A. L. Hiser, Jr., Alternate C. C. Kim R. W. Barnes, Contributing Member

Working Group on Creep-Fatigue and Negligible Creep (SG-HTR) (BPV III)

M. C. Messner Y. Wang, Chair M. Ando T. Nguyen P. Carter J. C. Poehler M. E. Cohen H. Qian I. I. Duo R. Rajasekaran R. I. Jetter T.-L. Sham G. H. Koo X. Wei H. Mahajan J. Young M. McMurtrey M. Yoo, Alternate

Task Group on Advanced Manufacturing (BPV III)

D. W. Mann, Chair T. Melfi D. W. Gandy, Secretary E. C. Renaud R. Bass W. J. Sperko D. Chowdhury J. F. Strunk P. J. Coco J. Sulley B. D. Frew S. Tate J. Grimm S. Wolbert A. L. Hiser, Jr. H. Xu J. Lambin

D. W. Pratt, Alternate T. Lippucci K. Matsunaga S. Malik, Contibuting Member

Working Group on High Temperature Flaw Evaluation (SG-HTR) (BPV III)

C. J. Sallaberry, Chair H. Oian F. W. Brust D. A. Scarth P. Carter D. J. Shim A. Udyawar S. Kalyanam B.-L. Lyow X. Wei M. C. Messner S. X. Xu J. C. Poehler M. Yoo, Alternate

Joint Working Group on HDPE (SG-MFE) (BPV III)

M. Brandes, Chair K. Manoly T. M. Musto, Chair D. P. Munson J. B. Ossmannn, Secretary J. O'Sullivan G. Brouette V. Rohatgi M. C. Buckley F. Schaaf, Jr. S. Choi S. Schuessler M. Golliet R. Stakenborghs J. Hebeisen M. Troughton J. Johnston, Jr. P. Vibien P. Krishnaswamy M. Kuntz J. Wright

B. Lin T. Adams, Contributing Member

Working Group on Nonmetallic Design and Materials (SG-HTR) (BPV III)

W. Windes, Chair J. Parks W. J. Geringer, Vice Chair T.-L. Sham J. Potgieter, Secretary A. Tzelepi G. Beirnaert G. L. Zeng C. Chen M. Yoo, Alternate A. N. Chereskin A. Appleton, Contributing Member V. Chugh R. W. Barnes, Contributing Member

C. Contescu A. A. Campbell, Contributing N. Gallego Member

S. T. Gonczy

M. G. Jenkins A. Mack, Contributing Member J. Lang M. P. Metcalfe J. B. Ossmann, Contributing

S.-H. Chi, Contributing Member K. Harris Y. Katoh, Contributing Member M. N. Mitchell Member

COMMITTEE ON HEATING BOILERS (BPV IV)

M. Wadkinson. Chair C. Dinic I. L. Kleiss, Vice Chair J. M. Downs C. R. Ramcharran, Staff Secretary J. A. Hall B. Ahee M. Mengon L. Badziagowski D. Nelson T. L. Bedeaux H. Michael, Delegate B. Calderon D. Picart, Delegate

J. P. Chicoine P. A. Molvie, Contributing Member

Executive Committee (BPV IV)

M. Wadkinson, Chair J. P. Chicoine C. R. Ramcharran, Staff Secretary J. A. Hall L. Badziagowski J. L. Kleiss T. L. Bedeaux

Subgroup on Cast Boilers (BPV IV)

J. P. Chicoine, Chair	J. A. Hall
J. M. Downs, Vice Chair	J. L. Kleiss
C. R. Ramcharran, Staff Secretary	M. Mengon

T. L. Bedeaux

Subgroup on Materials (BPV IV)

J. A. Hall, Chair T. L. Bedeaux J. M. Downs, Vice Chair Y. Teng C. R. Ramcharran, Staff Secretary M. Wadkinson

L. Badziagowski

Subgroup on Water Heaters (BPV IV)

J. L. Kleiss, Chair B. J. Iske L. Badziagowski, Vice Chair M. Mengon C. R. Ramcharran, Staff Secretary Y. Teng B. Ahee T. E. Trant I. P. Chicoine

C. Dinic P. A. Molvie, Contributing Member

Subgroup on Welded Boilers (BPV IV)

T. L. Bedeaux, Chair J. L. Kleiss C. R. Ramcharran, Staff Secretary M. Mengon B. Ahee M. Wadkinson L. Badziagowski M. J. Melita, Alternate B. Calderon D. Nelson, Alternate J. P. Chicoine

C. Dinic P. A. Molvie, Contributing Member

Europe International Working Group (BPV IV)

E. Van Bruggen L. Badziagowski, Chair D. Picart, Vice Chair G. Vicchi

R. Lozny A. Alessandrini, Alternate

COMMITTEE ON NONDESTRUCTIVE EXAMINATION (BPV V)

N. A. Finney, Chair B. D. Laite C. May, Vice Chair P. B. Shaw C. R. Ramcharran, Staff Secretary C. Vorwald D. Bajula S. J. Akrin, Contributing Member

P. L. Brown J. E. Batey, Contributing Member M. A. Burns A. S. Birks, Contributing Member N. Carter N. Y. Faransso, Contributing T. Clausing Member C. Emslander J. F. Halley, Contributing Member A. F. Garbolevsky R. W. Kruzic, Contributing Member

L. E. Mullins, Contributing Member P. T. Hayes G. W. Hembree F. J. Sattler, Contributing Member F. B. Kovacs H. C. Graber, Honorary Member K. Krueger T. G. McCarty, Honorary Member

Executive Committee (BPV V)

C. May, Chair G. W. Hembree N. A. Finney, Vice Chair F. B. Kovacs C. R. Ramcharran, Staff Secretary K. Krueger N. Carter E. Peloquin V. F. Godinez-Azcuaga C. Vorwald P. T. Hayes

Subgroup on General Requirements/Personnel Qualifications and Inquiries (BPV V)

C. Vorwald. Chair K. Krueger D. Bajula

N. Carter S. J. Akrin, Contributing Member P. Chavdarov N. Y. Faransso, Contributing

T. Clausing Member

J. F. Halley, Contributing Member C. Emslander N. A. Finney D. I. Morris, Contributing Member G. W. Hembree J. P. Swezy, Jr., Contributing

F. B. Kovacs Member

Project Team on Assisted Analysis (BPV V)

K. Hayes, Chair C. Hansen I. Aldrin G. W. Hembree I. Chen R. S. F. Orozco E. Peloquin N. A. Finney V. F. Godinez-Azcuaga T. Thulien

Subgroup on Volumetric Methods (BPV V)

C. May, Chair E. Peloquin P. T. Hayes, Vice Chair C. Vorwald

D. Adkins S. J. Akrin, Contributing Member P. L. Brown N. Y. Faransso, Contributing N. A. Finney

Member

A. F. Garbolevsky J. F. Halley, Contributing Member R. W. Hardy R. W. Kruzic, Contributing Member G. W. Hembree L. E. Mullins, Contributing Member F. B. Kovacs K. Krueger F. J. Sattler, Contributing Member

Working Group on Radiography (SG-VM) (BPV V)

C. Vorwald, Chair C. Mav D. M. Woodward, Vice Chair R. J. Mills J. Anderson J. F. Molinaro P. L. Brown T. Vidimos C. Emslander B. White A. F. Garbolevsky

S. J. Akrin, Contributing Member R. W. Hardy T. L. Clifford, Contributing Member G. W. Hembree N. Y. Faransso, Contributing F. B. Kovacs

Memher B. D. Laite

T. R. Lerohl R. W. Kruzic, Contributing Member

Working Group on Ultrasonics (SG-VM) (BPV V)

K. Krueger, Chair D. Van Allen D. Bajula, Vice Chair J. Vinyard D. Adkins C. Vorwald C. Brown C. Wassink

C. Emslander N. Y. Faransso, Contributing

N. A. Finney Member P. T. Hayes J. F. Halley, Contributing Member G. W. Hembree R. W. Kruzic, Contributing Member B. D. Laite P. Mudge, Contributing Member T. R. Lerohl L. E. Mullins, Contributing Member C. May M. J. Quarry, Contributing Member E. Peloquin F. J. Sattler, Contributing Member J. Schoneweis D. Tompkins J. Vanvelsor, Contributing Member

Working Group on Acoustic Emissions (SG-VM) (BPV V)

India International Working Group (BPV V)

V. F. Godinez-Azcuaga, Chair

J. Catty, Vice Chair S. R. Doctor

N. F. Douglas, Jr.

N. Carter, Chair

R. K. Miller

N. Y. Faransso, Contributing

Memher

P. Kumar, Chair A. V. Bhagwat J. Chahwala S. Jobanputra D. Joshi

G. R. Joshi A. Relekar V. J. Sonawane D. B. Tanpure

Working Group on Full Matrix Capture (SG-VM) (BPV V)

G. W. Hembree E. Peloquin, Chair C. Wassink, Vice Chair K. Krueger D. Bajula M. Lozev D. Bellistri R. Nogueira J. Catty D. Richard N. A. Finney M. Sens D. Tompkins J. L. Garner

R. T. Grotenhuis J. F. Halley, Contributing Member P. T. Hayes L. E. Mullins, Contributing Member

Italy International Working Group (BPV V)

D. D. Raimander, Chair M. A. Grimoldi O. Oldani. Vice Chair G. Luoni C. R. Ramcharran, Staff Secretary U. Papponetti P. Campli, Secretary P. Pedersoli M. Agostini A. Veroni T. Aldo M. Zambon F. Bresciani

V. Calo, Contributing Member N. Caputo G. Gobbi, Contributing Member M. Colombo P. L. Dinelli A. Gusmaroli, Contributing

Member F. Ferrarese

E. Ferrari G. Pontiggia, Contributing Member

Subgroup on Inservice Examination Methods and Techniques (BPV V)

P. T. Haves. Chair G. W. Hembree E. Peloquin, Vice Chair K. Krueger M. A. Burns C. May M. Carlson N. A. Finney V. F. Godinez-Azcuaga

D. D. Raimander C. Vorwald

COMMITTEE ON PRESSURE VESSELS (BPV VIII)

J. C. Sowinski S. C. Roberts, Chair M. D. Lower, Vice Chair D. Srnic S. J. Rossi, Staff Secretary D. B. Stewart G. Aurioles, Sr. P. L. Sturgill K. Subramanian S. R. Babka R. J. Basile D. A. Swanson P. Chavdarov J. P. Swezy, Jr. D. B. DeMichael S. Terada J. F. Grubb E. Upitis B. F. Hantz A. Viet M. Kowalczyk K. Xu

D. L. Kurle P. A. McGowan, Delegate R. Mahadeen H. Michael, Delegate S. A. Marks K. Oyamada, Delegate M. E. Papponetti, Delegate P. Matkovics R. W. Mikitka A. Chaudouet, Contributing

B. R. Morelock Memher T. P. Pastor J. P. Glaspie, Contributing Member D. T. Peters K. T. Lau, Contributing Member U. R. Miller, Contributing Member M. J. Pischke M. D. Rana K. Mokhtarian, Contributing

G. B. Rawls, Jr. Member

F. L. Richter G. G. Karcher, Honorary Member C. D. Rodery K. K. Tam, Honorary Member

Subgroup on Surface Examination Methods (BPV V)

P R Shaw

B. D. Laite, Vice Chair R. Tedder R. M. Beldyk C. Vorwald P. L. Brown C. Wassink T. Clausing D. M. Woodward C. Emslander S. J. Akrin, Contributing Member N. Y. Faransso, Contributing N. Farenbaugh N. A. Finney Member A. F. Garbolevsky J. F. Halley, Contributing Member K. Hayes R. W. Kruzic, Contributing Member G. W. Hembree L. E. Mullins, Contributing Member F. J. Sattler, Contributing Member C. May

Executive Committee (BPV VIII)

Germany International Working Group (BPV V)

P. Chavdarov, Chair D. Kaiser C. Kringe, Vice Chair S. Mann H.-P. Schmitz, Secretary V. Reusch K.-H. Gischler

G. Aurioles, Sr. C. W. Cary J. Hoskinson M. Kowalczyk

M. D. Lower, Chair S. A. Marks S. J. Rossi, Staff Secretary P. Matkovics S. C. Roberts J. C. Sowinski K. Subramanian K. Xu

Subgroup on Design (BPV VIII)

J. C. Sowinski, Chair G. B. Rawls, Jr. C. S. Hinson, Vice Chair S. C. Roberts G. Aurioles, Sr. C. D. Rodery S. R. Babka T. G. Seipp O. A. Barsky D. Srnic R. J. Basile D. A. Swanson D. Chandiramani S. Terada M. D. Clark J. Vattappilly M. Faulkner K. Xu

B. F. Hantz
C. E. Hinnant
M. H. Jawad
S. Krishnamurthy
D. L. Kurle
K. Kuscu
K. Oyamada, Delegate
M. E. Papponetti, Delegate
P. K. Lam, Contributing Member
K. Mokhtarian, Contributing
Member

K. Kuscu
M. D. Lower
R. W. Mikitka
S. C. Shah, Contributing Member
B. Millet
K. K. Tam, Contributing Member
M. D. Rana
E. Upitis, Contributing Member

Subgroup on General Requirements (BPV VIII)

J. Hoskinson, Chair F. L. Richter M. Faulkner, Vice Chair S. C. Roberts N. Barkley J. Rust R. J. Basile J. C. Sowinski T. P. Beirne P. Speranza D. B. DeMichael D. Srnic M. D. Lower D. B. Stewart T. P. Pastor D. A. Swanson

I. Powell J. P. Glaspie, Contributing Member G. B. Rawls, Jr. Y. Yang, Contributing Member

Task Group on Fired Heater Pressure Vessels (BPV VIII)

J. Hoskinson, Chair
R. Robles
W. Kim
J. Rust
S. Kirk
P. Shanks
D. Nelson
E. Smith
T. P. Pastor
D. Srnic

Working Group on Design-by-Analysis (BPV VIII)

B. F. Hantz, Chair	S. Krishnamurthy
T. W. Norton, Secretary	A. Mann
D. A. Arnett	C. Nadarajah
J. Bedoya	P. Prueter
S. Guzey	T. G. Seipp
C. F. Heberling II	M. A. Shah
C. E. Hinnant	S. Terada

M. H. Jawad
S. Terada
S. Kataoka
R. G. Brown, Contributing Member
S. Kilambi
D. Dewees, Contributing Member
K. D. Kirkpatrick
K. Saboda, Contributing Member

Task Group on Subsea Applications (BPV VIII)

M. Sarzynski, Chair
A. J. Grohmann, Vice Chair
L. P. Antalffy
R. C. Biel
J. Ellens
J. Hademenos

C. Lan
P. Lutkiewicz
R. C. Handler
S. K. Parimi
R. H. Patil
J. Hademenos
M. P. Vaclavik

J. Kaculi R. Cordes, Contributing Member
K. Karpanan D. T. Peters, Contributing Member
F. Kirkemo J. R. Sims, Contributing Member

Working Group on Elevated Temperature Design (BPV I and VIII)

A. Mann, Chair	M. C. Messner
C. Nadarajah, Secretary	M. N. Mitchell
D. Anderson	P. Prueter
D. Dewees	M. J. Swindeman
B. F. Hantz	J. P. Glaspie, Contributing Member
M. H. Jawad	N. McMurray, Contributing
R. I. Jetter S. Krishnamurthy	Member
T. Le	B. J. Mollitor, Contributing Member
I. Le	b. J. Monitor, Contributing Member

Subgroup on Heat Transfer Equipment (BPV VIII)

P. Matkovics, Chair
M. D. Clark, Vice Chair
L. Bower, Secretary
G. Aurioles, Sr.
E. Smith
S. R. Babka
J. H. Barbee
O. A. Barsky
R. Mahadeen
R. Mayeux
E. Smeilsen
E. Smith
A. M. Voytko

T. Bunyarattaphantu J. Pasek, Contributing Member
A. Chaudouet D. Srnic, Contributing Member
D. L. Kurle Z. Tong, Contributing Member

Subgroup on Fabrication and Examination (BPV VIII)

S. A. Marks, Chair	B. F. Shelley
D. I. Morris, Vice Chair	D. Smith
T. Halligan <i>, Secretary</i>	P. L. Sturgill
N. Carter	J. P. Swezy, Jr.
J. Lu	E. Upitis
B. R. Morelock	C. Violand

O. Mulet K. Oyamada, Delegate
M. J. Pischke W. J. Bees, Contributing Member
M. J. Rice L. F. Campbell, Contributing

J. Roberts *Member*C. D. Rodery R. Uebel, *Contributing Member*

Working Group on Plate Heat Exchangers (BPV VIII)

D. I. Morris, Chair
S. R. Babka
M. J. Pischke
J. F. Grubb
P. Shanks
V. Gudge
E. Smith
R. Mahadeen
D. Srnic
S. A. Marks
S. Sullivan

Subgroup on High Pressure Vessels (BPV VIII)

K. Subramanian, Chair	Y. Xu
M. Sarzynski, Vice Chair	A. M. Clayton, Contributing
A. Dinizulu, Staff Secretary	Member
L. P. Antalffy	R. Cordes, Contributing Member
J. Barlow	R. D. Dixon, Contributing Member
R. C. Biel	Q. Dong, Contributing Member
P. N. Chaku	T. A. Duffey, Contributing Membe
L. Fridlund	R. M. Hoshman, Contributing
D. Fuenmayor	Member
J. Gibson	F. Kirkemo, Contributing Member
R. T. Hallman	R. A. Leishear, Contributing
K. Karpanan	Member
J. Keltjens	G. M. Mital, Contributing Member
A. K. Khare	M. Parr, Contributing Member
G. T. Nelson	,
D. T. Peters	M. D. Rana, Contributing Member
E. D. Roll	C. Romero, Contributing Member
J. R. Sims	C. Tipple, Contributing Member
E. Smith	KJ. Young, Contributing Member
F. W. Tatar	D. J. Burns, Honorary Member

Argentina International Working Group (BPV VIII)

A. Dominguez, Chair M. Favareto M. D. Kuhn R. Robles, Vice Chair G. Glissenti, Secretary F. P. Larrosa M. M. Acosta L. M. Leccese R. A. Barey C. Meinl C. Alderetes M. A. Mendez J. J. Monaco F. A. Andres A. Antipasti C. Parente M. A. A. Pipponzi D. A. Bardelli L. C. Rigoli L. F. Boccanera O. S. Bretones A. Rivas A. Burgueno D. Rizzo G. Casanas J. C. Rubeo D. H. Da Rold S. Schamun G. Telleria D. A. Del Teglia J. I. Duo M. M. C. Tocco

China International Working Group (BPV VIII)

X. Chen, Chair C. Miao B. Shou, Vice Chair L. Sun Z. Fan, Secretary C. Wu Y. Chen J. Xiaobin J. Cui F. Xu R. Duan G. Xu J.-G. Gong F. Yang B. Han Y. Yang J. Hu Y. Yuan Q. Hu Yanfeng Zhang H. Hui Yijun Zhang K. Li S. Zhao D. Luo J. Zheng Y. Luo G. Zhu

Subgroup on Materials (BPV VIII)

S. Terada

G. J. Mraz, Honorary Member

M. Kowalczyk, Chair	E. Upitis
P. Chavdarov, Vice Chair	K. Xu
S. Kilambi, Secretary	S. Yem
J. Cameron	A. Di Rienzo, Contributing Member
J. F. Grubb	J. D. Fritz, Contributing Member
D. Maitra	, ,
D. W. Rahoi	M. Katcher, Contributing Member
J. Robertson	W. M. Lundy, Contributing Member
R. C. Sutherlin	J. Penso, Contributing Member

Germany International Working Group (BPV VIII)

Subgroup on Toughness (BPV VIII)

K. Xu, Chair	D. A. Swanson
T. Halligan, Vice Chair	J. P. Swezy, Jr.
T. Finn	S. Terada
C. S. Hinson	E. Upitis
S. Kilambi	J. Vattappilly
D. L. Kurle	K. Oyamada, Delegate
T. Newman	L. Dong, Contributing Member
J. Qu	S. Krishnamurthy, Contributing
M. D. Rana	Member
F. L. Richter	K. Mokhtarian, Contributing
K. Subramanian	Member

Subgroup on Graphite Pressure Equipment (BPV VIII)

J. D. Clements

H. Lee, Jr.

S. Mehrez

T. Rudy

C. W. Cary, Chair

A. Viet, Vice Chair

G. C. Becherer

F. L. Brown

R. Kauer, Chair	S. Krebs
M. Sykora, Vice Chair	T. Ludwig
A. Aloui	R. A. Meyers
P. Chavdarov	H. Michael
A. Emrich	S. Reich
J. Fleischfresser	A. Spangenberg
C. Jaekel	C. Stobbe
D. Koelbl	G. Naumann, Con

Koelbl G. Naumann, Contributing Member

India International Working Group (BPV VIII)

D. Chandiramani, Chair A. Kakumanu V. V. P. Kumar D. Kulkarni, Vice Chair A. D. Dalal, Secretary T. Mukherjee P. Arulkumar P. C. Pathak B. Basu D. Prabhu P. Gandhi A. Sadasivam M. P. Shah U. Ganesan S. K. Goyal R. Tiru V. Jayabalan V. T. Valavan

R. J. Bulgin A. A. Stupica V. K. Joshi M. Sharma, Contributing Member

Italy International Working Group (BPV VIII)

A. Teli, Chair M. Guglielmetti M. Millefanti. Vice Chair A. F. Magri P. Campli, Secretary P. Mantovani B. G. Alborali L. Moracchioli P. Aliprandi P. Pacor A. Avogadri S. Sarti A. Camanni V. Calo, Contributing Member

N. Caputo G. Gobbi, Contributing Member M. Colombo A. Gusmaroli, Contributing P. Conti Member G. Pontiggia, Contributing Member D. Cortassa

P. L. Dinelli D. D. Raimander, Contributing

F. Finco Member

COMMITTEE ON WELDING, BRAZING, AND FUSING (BPV IX)

M. J. Pischke, Chair W. J. Sperko P. L. Sturgill, Vice Chair J. P. Swezy, Jr. R. Rahaman, Staff Secretary A. D. Wilson M. Bernasek E. W. Woelfel M. A. Boring D. Pojatar, Delegate D. A. Bowers A. Roza, Delegate N. Carter

M. Consonni, Contributing Member J. G. Feldstein P. D. Flenner, Contributing Member P. Gilston S. A. Jones, Contributing Member S. E. Gingrich D. K. Peetz, Contributing Member K. L. Hayes S. Raghunathan, Contributing R. M. Jessee

Member J. S. Lee M. J. Stanko, Contributing Member W. M. Lundy

P. L. Van Fosson, Contributing D. W. Mann Member S. A. Marks

T. Melfi R. K. Brown, Jr., Honorary Member W. F. Newell, Jr. M. L. Carpenter, Honorary Member B. R. Newmark, Honorary Member E. G. Reichelt M. J. Rice S. D. Reynolds, Jr., Honorary

M. B. Sims Member

Subgroup on Brazing (BPV IX)

M. J. Pischke

Special Working Group on Bolted Flanged Joints (BPV VIII)

W. Brown, Chair W. McDaniel M. Osterfoss, Vice Chair R. W. Mikitka G. Aurioles, Sr. D. Nash D. Bankston, Ir. M. Ruffin H. Bouzid R. Wacker

A. Chaudouet E. Jamalyaria, Contributing

H. Chen Member

D. Francis J. R. Payne, Contributing Member H. Lejeune G. Van Zyl, Contributing Member A. Mann J. Veiga, Contributing Member

E. W. Beckman P. L. Sturgill A. F. Garbolevsky J. P. Swezy, Jr.

N. Mohr

S. A. Marks, Chair

Subgroup on General Requirements (BPV IX)

N. Carter, Chair P. L. Sturgill P. Gilston. Vice Chair J. P. Swezy, Jr. J. P. Bell E. W. Woelfel D. A. Bowers

E. W. Beckman, Contributing M. Heinrichs

Member A. Howard

A. Davis, Contributing Member R. M. Jessee D. K. Peetz, Contributing Member S. A. Marks H. B. Porter B. R. Newmark, Honorary Member

Subgroup on Materials (BPV IX)

M. Bernasek, Chair M. J. Pischke T. Anderson A. Roza L. Constantinescu C. E. Sainz Subgroup on Interpretations (BPV VIII) E. Cutlip P. L. Sturgill M. Denault J. C. Sowinski C. Zanfir S. E. Gingrich

J. Oh, Staff Secretary D. B. Stewart V. G. V. Giunto, Delegate L. S. Harbison K. Subramanian

S. R. Babka D. J. Kotecki, Contributing Member M. James J. Cameron D. A. Swanson B. Krueger, Contributing Member R. M. Jessee C. W. Cary J. P. Swezy, Jr. W. J. Sperko, Contributing Member T. Melfi J. Vattappilly B. F. Hantz S. D. Nelson M. J. Stanko, Contributing Member M. Kowalczyk A. Viet

D. L. Kurle K. Xu M. D. Lower R. J. Basile, Contributing Member S. A. Marks D. B. DeMichael, Contributing P. Matkovics Member

D. I. Morris R. D. Dixon, Contributing Member D. T. Peters S. Kilambi, Contributing Member F. L. Richter R. Mahadeen, Contributing

S. C. Roberts Member

G. Aurioles, Sr., Chair

C. D. Rodery T. P. Pastor, Contributing Member T. G. Seipp P. L. Sturgill, Contributing Member

Subgroup on Plastic Fusing (BPV IX)

K. L. Hayes, Chair S. Schuessler R. M. Jessee M. Troughton J. Johnston, Jr. C. Violand J. E. O'Sullivan E. W. Woelfel E. G. Reichelt J. Wright M. J. Rice

Subgroup on Welding Qualifications (BPV IX)

T. Melfi, Chair E. G. Reichelt A. D. Wilson, Vice Chair M. I. Rice K. L. Hayes, Secretary M. B. Sims M. Bernasek W. J. Sperko M. A. Boring P. L. Sturgill D. A. Bowers J. P. Swezy, Jr. R. Campbell C. Violand R. B. Corbit D. Chandiramani, Contributing L. S. Harbison Member

M. Heinrichs M. Consonni, Contributing Member M. Dehghan, Contributing Member I. S. Lee W. M. Lundy P. D. Flenner, Contributing Member D. W. Mann T. C. Wiesner, Contributing

Member W. F. Newell, Jr.

Argentina International Working Group (BPV IX)

A. Burgueno, Chair M. Favareto A. R. G. Frinchaboy, Vice Chair I. A. Gandola R. Rahaman, Staff Secretary C. A. Garibotti M. D. Kuhn, Secretary I. A. Herrera B. Bardott M. A. Mendez L. F. Boccanera A. E. Pastor P. J. Cabot G. Telleria J. Caprarulo M. M. C. Tocco

Germany International Working Group (BPV IX)

S. Wegener A. Roza, Chair A. Spangenberg, Vice Chair F. Wodke R. Rahaman, Staff Secretary

J. Daldrup, Contributing Member P. Chavadarov E. Floer, Contributing Member B. Daume R. Helmholdt, Contributing J. Fleischfresser Member

P. Khwaja

G. Naumann, Contributing Member S. Krebs T. Ludwig K.-G. Toelle, Contributing Member

Italy International Working Group (BPV IX)

L. Moracchioli D. D. Raimander, Chair F. Ferrarese, Vice Chair P. Pacor R. Rahaman, Staff Secretary P. Siboni

M. Bernasek V. Calo, Contributing Member A. Camanni G. Gobbi, Contributing Member P. L. Dinelli A. Gusmaroli, Contributing

M. Mandina Memher

A. S. Monastra G. Pontiggia, Contributing Member

(BPV X) B. Linnemann. Chair D. H. McCauley

COMMITTEE ON FIBER-REINFORCED PLASTIC PRESSURE VESSELS

D. Eisberg, Vice Chair N. L. Newhouse P. D. Stumpf, Staff Secretary G. Ramirez A. L. Beckwith I. R. Richter F. L. Brown B. F. Shellev J. L. Bustillos G. A. Van Beek B. R. Colley S. L. Wagner T. W. Cowley D. O. Yancey, Jr. I. L. Dinovo P. H. Ziehl J. Eihusen

D. H. Hodgkinson, Contributing M. R. Gorman

B. Hebb Member

L. E. Hunt D. L. Keeler, Contributing Member

COMMITTEE ON NUCLEAR INSERVICE INSPECTION (BPV XI)

R. W. Swayne, Chair T. Nuoffer D. W. Lamond. Vice Chair J. Nygaard A. T. Roberts III, Vice Chair J. E. O'Sullivan D. Miro-Quesada, Staff Secretary N. A. Palm I. F. Ball G. C. Park W. H. Bamford D. A. Scarth M. L. Benson F. J. Schaaf, Jr. J. M. Boughman S. Takaya C. Brown D. Vetter S. B. Brown T. V. Vo T. L. Chan J. G. Weicks R. C. Cipolla M. Weis D. R. Cordes

Y.-K. Chung, Delegate H. Do C. Ye, Delegate E. V. Farrell, Jr. B. Lin, Alternate M. J. Ferlisi R. O. McGill, Alternate T. I. Griesbach L. A. Melder, Alternate J. Hakii A. Udyawar, Alternate M. L. Hall

E. B. Gerlach, Contributing Member P. I. Hennessev C. D. Cowfer, Honorary Member D. O. Henry R. E. Gimple, Honorary Member K. Hojo F. E. Gregor, Honorary Member S. D. Kulat R. D. Kerr, Honorary Member C. Latiolais P. C. Riccardella, Honorary Member J. T. Lindberg R. A. West, Honorary Member H. Malikowski S. L. McCracken C. I. Wirtz. Honorary Member S. A. Norman R. A. Yonekawa, Honorary Member

Executive Committee (BPV XI)

D. W. Lamond, Chair S. L. McCracken R. W. Swayne, Vice Chair T. Nuoffer D. Miro-Quesada, Staff Secretary N. A. Palm M. L. Benson G. C. Park M. J. Ferlisi A. T. Roberts III S. D. Kulat J. T. Lindberg B. L. Lin, Alternate

Spain International Working Group (BPV IX)

F. J. Q. Pandelo, Chair F. Manas F. L. Villabrille, Vice Chair B. B. Miguel R. Rahaman, Staff Secretary A. D. G. Munoz F. R. Hermida, Secretary A. B. Pascual C. A. Celimendiz S. Sevil M. A. F. Garcia

R. G. Garcia G. Gobbi, Contributing Member

Argentina International Working Group (BPV XI)

O. Martinez, Staff Secretary F. J. Schaaf, Jr. A. Claus F. M. Schroeter I. M. Guerreiro P. Yamamoto L. R. Miño

China International Working Group (BPV XI)

J. H. Liu, Chair S. Shuo J. F. Cai, Vice Chair Y. Sixin C. Ye, Vice Chair Y. X. Sun M. W. Zhou, Secretary G. X. Tang H. Chen Q. Wang H. D. Chen Q. W. Wang Y. Cheng Z. S. Wang Y. B. Guo L. Xing Y. Hongqi F. Xu D. R. Horn S. X. Xu Y. Hou Q. Yin S. X. Lin K. Zhang Y. Nie W. N. Pei Y. Zhe L. Shiwei Z. M. Zhong

Working Group on Spent Nuclear Fuel Storage and Transportation Containment Systems (BPV XI)

K. Hunter, Chair	K. Mauskar
M. Orihuela, Secretary	R. M. Meyer
D. J. Ammerman	R. M. Pace
W. H. Borter	E. L. Pleins
J. Broussard	M. A. Richter
C. R. Bryan	B. Sarno
T. Carraher	R. Sindelar
S. Corcoran	M. Staley
D. Dunn	•
N. Fales	J. Wellwood
R. C. Folley	K. A. Whitney
G. Grant	X. J. Zhai
B Gutherman	PS. Lam, Altern

B. Gutherman P.-S. Lam, Alternate
M. W. Joseph G. White, Alternate
M. Keene J. Wise, Alternate

M. Liu H. Smith, Contributing Member

Germany International Working Group (BPV XI)

R. Döring, <i>Chair</i>	N. Legl
M. Hagenbruch, Vice Chair	T. Ludwig
R. Piel, Secretary	X. Pitoiset
A. Casse	M. Reichert
C. G. Frantescu	L. Sybertz
E. Iacopetta	I. Tewes
S. D. Kulat	R. Tiete
HW. Lange	J. Wendt

Task Group on Mitigation and Repair of Spent Nuclear Fuel Canisters (WG-SNFS & TCS) (BPV XI)

J. Tatman, Chair	M. Kris
D. J. Ammerman	M. Liu
J. Broussard	K. Mauskar
C. R. Bryan	S. L. McCracken
G. R. Cannell	M. Orihuela
K. Dietrich	M. Richter
D. Dunn	K. E. Ross
N. Fales	B. Sarno
R. C. Folley	R. Sindelar
D. Jacobs	J. Wellwood
N. Klymyshyn	A. Williams

India International Working Group (BPV XI)

S. B. Parkash, Chair	N. Palm
D. Narain, Vice Chair	D. Rawal
K. K. Rai, Secretary	R. Sahai
Z. M. Mansuri	R. K. Sharma

M. R. Nadgouda

Subgroup on Evaluation Standards (SG-ES) (BPV XI)

N. A. Palm, Chair	Y. S. Li
S. X. Xu, Secretary	R. O. McGill
W. H. Bamford	K. Miyazaki
M. Brumovsky	R. M. Pace
H. D. Chung	J. C. Poehler
R. C. Cipolla	S. Ranganath
C. M. Faidy	D. A. Scarth
M. M. Farooq	D. J. Shim
B. R. Ganta	,
T. J. Griesbach	A. Udyawar
K. Hasegawa	T. V. Vo
K Hojo	G. M. Wilkowski

Special Working Group on Editing and Review (BPV XI)

R. W. Swayne, *Chair* M. Orihuela R. C. Cipolla D. A. Scarth

D. O. Henry

D. R. Lee H. S. Mehta, Contributing Member

M. L. Benson, Alternate

Task Group on Inspectability (BPV XI)

J. Honcharik J. T. Lindberg, Chair E. Henry, Secretary C. Latiolais A. Bushmire G. A. Lofthus A. Cardillo S. Matsumoto K. Caver D. E. Matthews D. R. Cordes P. J. O'Regan P. Gionta J. B. Ossmann D. O. Henry C. Thomas

Task Group on Evaluation of Beyond Design Basis Events (SG-ES) (BPV XI)

R. M. Pace, Chair
S. X. Xu, Secretary
S. A. Kleinsmith
F. G. Abatt
S. M. Moenssens
G. A. Antaki
P. R. Donavin
R. G. Gilada
R. M. Wilkowski

T. J. Griesbach H. S. Mehta, Contributing Member
M. Hayashi T. Weaver, Contributing Member

D. N. Hopkins

Working Group on Flaw Evaluation (SG-ES) (BPV XI)

Working Group on Pipe Flaw Evaluation (SG-ES) (BPV XI)

•
Y. S. Li
C. Liu
M. Liu
G. A. Miessi
K. Miyazaki
S. Noronha
R. K. Qashu
S. Ranganath
D. A. Scarth
W. L. Server
D. J. Shim
S. Smith
M. Uddin
A. Udyawar
T. V. Vo
K. Wang
B. Wasiluk
G. M. Wilkowski
H. S. Mehta, Contributing Member

D. A. Scarth, Chair Y. Kim S. Kalyanam, Secretary V. Lacroix K. Azuma Y. S. Li W. H. Bamford R. O. McGill M. L. Benson G. A. Miessi M. Brumovsky K. Miyazaki F. W. Brust S. M. Parker H. D. Chung S. H. Pellet R. C. Cipolla C. J. Sallaberry N. G. Cofie W. L. Server C. M. Faidy D. J. Shim M. M. Farooq S. Smith B. R. Ganta M. F. Uddin R. G. Gilada A. Udyawar S. R. Gosselin T. V. Vo C. E. Guzman-Leong K. Wang K. Hasegawa B. Wasiluk P. H. Hoang G. M. Wilkowski K. Hojo S. X. Xu D. N. Hopkins Y. Zou E. J. Houston

K. Gresh. Alternate R. Janowiak

K. Kashima H. S. Mehta, Contributing Member

Working Group on Flaw Evaluation Reference Curves (SG-ES) (BPV XI)

Task Group on Code Case N-513 (WG-PFE) (BPV XI)

A. Udyawar, Chair	V. Lacroix
D. A. Scarth, Secretary	K. Miyazaki
W. H. Bamford	B. Pellereau
M. L. Benson	S. Ranganath
F. W. Brust	D. J. Shim
R. C. Cipolla	S. Smith
M. M. Farooq	M. Uddin
A. E. Freed	T. V. Vo
P. Gill	G. White
K. Hasegawa	S. X. Xu
IZ II .: .	II C Malata

R. O. McGill, Chair	E. J. Houston
S. M. Parker, Secretary	R. Janowiak
G. A. Antaki	S. H. Pellet
R. C. Cipolla	D. Rudland
M. M. Farooq	D. A. Scarth
K. Gresh	S. X. Xu

H. S. Mehta, Contributing Member K. Hojo

Working Group on Operating Plant Criteria (SG-ES) (BPV XI)

Task Group on Evaluation Procedures for Degraded Buried Pipe (WG-PFE) (BPV XI)

R. Janowiak

N. A. Palm, Chair	A. D. Odell
A. E. Freed, Secretary	R. M. Pace
W. H. Bamford	J. C. Poehler
M. Brumovsky	S. Ranganath
M. A. Erickson	W. L. Server
T. J. Griesbach	C. A. Tomes
M. Hayashi	A. Udyawar
R. Janowiak	T. V. Vo
M. Kirk	1. v. vo

S. X. Xu, Secretary	M. Kassar
F. G. Abatt	M. Moenssens
G. A. Antaki	D. P. Munson
R. C. Cipolla	R. M. Pace
R. G. Gilada	S. H. Pellet
K. Hasegawa	D. Rudland
K. M. Hoffman	D. A. Scarth

H. Q. Xu S. A. Kleinsmith H. Kobayashi H. S. Mehta, Contributing Member S. Kalyanam, Chair D. J. Shim P. Krishnaswamy M. Troughton

M. Moenssens J. Wright S. X. Xu D. P. Munson

D. A. Scarth

R. O. McGill, Chair

Task Group on Appendix L (WG-OPC) (BPV XI)

Subgroup on Nondestructive Examination (SG-NDE) (BPV XI)

Task Group on Flaw Evaluation for HDPE Pipe (WG-PFE) (BPV XI)

N. Glunt <i>, Chair</i>	CS. Oh
R. M. Pace, Secretary	H. Park
J. I. Duo	S. Ranganath
A. E. Freed	A. Scott
M. A. Gray	D. J. Shim
T. J. Griesbach	S. Smith
H. Nam	
A. Nana	A. Udyawar
A. D. Odell	T. V. Vo

J. T. Lindberg, Chair S. E. Cumblidge K. J. Hacker D. O. Henry, Vice Chair T. Cinson, Secretary J. Harrison M. Briley D. A. Kull C. Brown C. Latiolais A. Bushmire F. J. Schaaf, Jr. T. L. Chan R. V. Swain D. R. Cordes C. A. Nove, Alternate

Working Group on Personnel Qualification and Surface Visual and Eddy Current Examination (SG-NDE) (BPV XI)

C. Brown, Chair D. O. Henry M. Orihuela, Secretary J. T. Lindberg J. Bennett C. Shinsky T. Cinson R. Tedder S. E. Cumblidge T. Thulien A. Diaz N. Farenbaugh J. T. Timm

ASME/JSME Joint Working Group on RIM Processes and System-Based Code (SG-RIM) (BPV XI)

S. Takaya, <i>Chair</i>	R. Meyer
R. J. McReynolds, Vice Chair	T. Muraki
M. T. Audrain	S. Okajima
K. Dozaki	A. T. Roberts III
J. T. Fong	C. J. Sallaberry
J. Hakii	F. J. Schaaf, Jr.
K. Harris	R. Vayda
M. Hayashi	D. Watanabe
S. Kalyanam	H. Yada
D. R. Lee	K. Yamada

H. Machida T. Asayama, Contributing Member

Working Group on Procedure Qualification and Volumetric Examination (SG-NDE) (BPV XI)

J. Harrison, Chair	C. Latiolais
D. A. Kull, Secretary	C. A. Nove
M. Briley	D. R. Slivon
A. Bushmire	R. V. Swain
D. R. Cordes	D. Van Allen
K. J. Hacker	
R. E. Jacob	J. Williams
W. A. Jensen	B. Lin, Alternate
,	•

Subgroup on Repair/Replacement Activities (SG-RRA) (BPV XI)

S. L. McCracken, Chair	L. A. Melder
E. V. Farrell, Jr., Secretary	S. A. Norman
J. F. Ball	G. T. Olson
M. Brandes	J. E. O'Sullivan
S. B. Brown	G. C. Park
R. Clow	R. R. Stevenson
S. J. Findlan	R. W. Swayne
M. L. Hall	D. J. Tilly
J. Honcharik	J. G. Weicks
A. B. Meichler	B. Lin, Alternate

Subgroup on Reliability and Integrity Management Program (SG-RIM) (BPV XI)

A. T. Roberts III, Chair	P. J. Hennessey
D. Vetter, Secretary	S. Kalyanam
T. Anselmi	D. R. Lee
M. T. Audrain	R. J. McReynolds
N. Broom	R. Meyer
F. W. Brust	M. Orihuela
V. Chugh	C. J. Sallaberry
S. R. Doctor	F. J. Schaaf, Jr.
J. D. Fletcher	H. M. Stephens, Jr.
J. T. Fong	R. W. Swayne
R. Grantom	S. Takaya
K. Harris	R. Vayda

Working Group on Design and Programs (SG-RRA) (BPV XI)

	U	-	Ü	Ü	•
S. B. Brown	ı, Chai	r		H. Malil	kowski
R. A. Patel,	Secret	ary		A. B. Mo	eichler
O. Bhatty				G. C. Pa	rk
R. Clow				M. A. P	vne
R. R. Croft				•	evenson
E. V. Farrel	l, Jr.				
K. Harris				K. Sulliv	<i>i</i> an
B. Lin				R. W. S	wayne

S. L. McCracken, Chair

J. E. O'Sullivan, Chair

M. Brandes

M. Golliet

D. R. Dechene

J. Johnston, Jr.

S. Schuessler, Secretary

Task Group on Repair and Replacement Optimization (WG-D&P) (BPV XI)

M. L. Hall

Working Group on MANDE (SG-RIM) (BPV XI)		S. J. Findlan, Secretary	D. Jacobs
H. M. Stephens, Jr., Chair S. R. Doctor, Vice Chair M. Turnbow, Secretary T. Anselmi M. T. Audrain N. A. Finney	J. T. Fong D. O. Henry R. J. McReynolds R. Meyer M. Orihuela K. Yamada	T. Basso R. Clow K. Dietrich E. V. Farrell, Jr. M. J. Ferlisi R. C. Folley	H. Malikowski T. Nuoffer G. C. Park A. Patel R. R. Stevenson J. G. Weicks

Working Group on Nonmetals Repair/Replacement Activities (SG-RRA) (BPV XI)

T. M. Musto

A. Pridmore

P. Vibien

F. J. Schaaf, Jr.

R. Stakenborghs

Task Group on Nonmetallic Component Degradation and Failure Monitoring (SG-RIM) (BPV XI)

M. P. Metcalfe, Chair	W. J. Geringer
A. Tzelepi, Secretary	K. Harris
M. T. Audrain	J. Lang
G. Beirnaert	J. Potgieter

A. Tzelepi, Secretary	K. Harris
M. T. Audrain	J. Lang
G. Beirnaert	J. Potgieter
C. Chen	

B. Lin M. P. Marohl, Contributing Member

Task Group on HDPE Piping for Low Safety Significance Systems (WG-NMRRA) (BPV XI)

T. M. Musto M. Brandes, Chair J. E. O'Sullivan, Secretary F. J. Schaaf, Jr. M. Golliet S. Schuessler B. Lin R. Stakenborghs

Task Group on Repair by Carbon Fiber Composites (WG-NMRRA) (BPV XI)

J. E. O'Sullivan, Chair	C. A. Nove
S. F. Arnold	R. P. Ojdrovic
S. W. Choi	A. Pridmore
D. R. Dechene	S. Rios
M. Golliet	C. W. Rowley
L. S. Gordon	J. Sealey
P. Krishnaswamy	R. Stakenborghs
M. Kuntz	N. Stoeva
H. Lu	M. F. Uddin
M. P. Marohl	J. Wen
I Madaay	P Daviannant Alta

L. Nadeau B. Davenport, Alternate

Working Group on Welding and Special Repair Processes (SG-RRA) (BPV XI)

J. G. Weicks, Chair	D. Jacobs
G. T. Olson, Secretary	M. Kris
D. Barborak	S. E. Marlette
S. J. Findlan	S. L. McCracken
R. C. Folley	L. A. Melder
M. L. Hall	J. E. O'Sullivan
J. Honcharik	D. J. Tilly

Task Group on Temper Bead Welding (WG-W&SRP) (BPV XI)

S. J. Findlan, Chair	S. L. McCracker
D. Barborak	N. Mohr
R. C. Folley	G. T. Olson
J. Graham	J. E. O'Sullivan
M. L. Hall	A. Patel
D. Jacobs	J. Tatman
H. Kobayashi	J. G. Weicks

Task Group on Weld Overlay (WG-W&SRP)(BPV XI)

S. L. McCracken, <i>Chair</i> S. Hunter, <i>Secretary</i> D. Barborak S. J. Findlan J. Graham M. L. Hall	C. Lohse S. E. Marlette G. T. Olson A. Patel D. W. Sandusky D. E. Waskey
<i>'</i>	D. E. Waskey J. G. Weicks

Subgroup on Water-Cooled Systems (SG-WCS) (BPV XI)		
M. J. Ferlisi, Chair	S. D. Kulat	
J. Nygaard, Secretary	D. W. Lamond	
J. M. Boughman	T. Nomura	
S. T. Chesworth	T. Nuoffer	
J. Collins	M. A. Pyne	
H. Q. Do	H. M. Stephens, Jr.	
K. W. Hall	R. Thames	
P. J. Hennessey	M. Weis	
A. E. Keyser	I. A. Anchondo-Lopez, Alternate	

Task Group on High Strength Nickel Alloys Issues (SG-WCS) (BPV XI)

H. Malikowski, Chair	H. Kobayashi
C. Waskey, Secretary	S. E. Marlette
E. Blackard	G. C. Park
T. Cinson	C. Wax
J. Collins	
K. Dietrich	G. White
P. R. Donavin	K. A. Whitney

Working Group on Containment (SG-WCS) (BPV XI)

M. J. Ferlisi, Chair	P. Leininger
R. Thames, Secretary	J. A. Munshi
P. S. Ghosal	M. Sircar
H. T. Hill	P. C. Smith
S. Johnson	S. Walden
A. E. Keyser	M. Weis

B. Lehman S. G. Brown, Alternate

Working Group on Inspection of Systems and Components (SG-WCS) (BPV XI)

H. Q. Do, Chair	J. Howard
M. Weis, Secretary	A. Keller
I. A. Anchondo-Lopez	S. D. Kulat
R. W. Blyde	E. Lantz
K. Caver	A. Maekawa
C. Cueto-Felgueroso	T. Nomura
M. J. Ferlisi	J. C. Nygaard
M. L. Garcia Heras	S. Orita
K. W. Hall	A. W. Wilkens

Working Group on Pressure Testing (SG-WCS) (BPV XI)

	8	8 (
J. M. Bough	man <i>, Chair</i>	D. W. Lamond
S. A. Norma	ın, Secretary	M. Moenssens
T. Anselmi		R. A. Nettles
M. J. Homia	ck	C. Thomas
A. E. Keyser	r	K. Whitney

Working Group on Risk-Informed Activities (SG-WCS) (BPV XI)

•	•
M. A. Pyne, <i>Chair</i>	M. J. Homiack
S. T. Chesworth, Secretary	S. D. Kulat
G. Brouette	D. W. Lamond
C. Cueto-Felgueroso	E. Lantz
R. Haessler	P. J. O'Regan
J. Hakii	N. A. Palm
K. W. Hall	D. Vetter

Working Group on General Requirements (BPV XI)

working droup on deneral kequitements		
T. Nuoffer, Chair	T. N. Rezk	
J. Mayo, Secretar	y A. T. Roberts III	
J. F. Ball	S. R. Scott	
T. L. Chan	D. Vetter	
P. J. Hennessey	S. E. Woolf	
K. A. Kavanagh	B. Harris, Alternate	
G. Ramaraj	R. S. Spencer, Alterna	

COMMITTEE ON TRANSPORT TANKS (BPV XII)

N. J. Paulick, Chair M. Pitts M. D. Rana, Vice Chair J. Roberts J. Oh, Staff Secretary T. A. Rogers A. N. Antoniou R. C. Sallash K. W. A. Cheng M. Shah P. Chilukuri S. Staniszewski W. L. Garfield A. P. Varghese

P. Miller R. Meyers, Contributing Member

Subgroup on Nonmandatory Appendices (BPV XII)

Г. A. Rogers, Chair	R. C. Sallash
S. Staniszewski, Secretary	D. G. Shelton

P. Chilukuri D. D. Brusewitz, *Contributing* N. J. Paulick *Member*

Y. Doron, Contributing Member

M. Pitts T. J. Rishel

Executive Committee (BPV XII)

M. D. Rana, Chair	T. A. Rogers
N. J. Paulick, Vice Chair	R. C. Sallash
J. Oh, Staff Secretary	S. Staniszewski
M. Pitts	A. P. Varghese

Subgroup on Design and Materials (BPV XII)

R. C. Sallash, Chair	A. P. Varghe
D. K. Chandiramani	K. Xu

K. W. A. Cheng
P. Chilukuri
S. L. McWilliams

Y. Doron, Contributing Member
A. T. Duggleby, Contributing

S. L. McWilliams

N. J. Paulick

M. D. Rana

R. D. Hayworth, Contributing

M. D. Rana
T. J. Rishel

R. D. Hayw

Member

T. A. Rogers
B. E. Spencer, Contributing
M. Shah
Member

S. Staniszewski J. Zheng, Contributing Member

COMMITTEE ON OVERPRESSURE PROTECTION (BPV XIII)

B. K. Nutter, <i>Chair</i> A. Donaldson, <i>Vice Chair</i>	R. D. Danzy, Contributing Member A. Frigerio, Contributing Member
C. E. Rodrigues, <i>Staff Secretary</i> J. F. Ball	J. P. Glaspie, Contributing Member S. F. Harrison, Jr., Contributing
J. Burgess B. Calderon	Member
D. B. DeMichael	A. Hassan, Contributing Member P. K. Lam, Contributing Member
J. W. Dickson J. M. Levy	M. Mengon, Contributing Member
D. Miller	J. Mize, Contributing Member M. Mullavey, Contributing Member
T. Patel B. F. Pittel	S. K. Parimi, Contributing Member
T. R. Tarbay D. E. Tompkins	J. Phillips, Contributing Member M. Reddy, Contributing Member
Z. Wang	S. Ruesenberg, Contributing Member
J. A. West B. Engman <i>, Alternate</i>	K. Shores, Contributing Member
H. Aguilar, Contributing Member R. W. Barnes, Contributing Member	D. E. Tezzo, Contributing Member A. Wilson, Contributing Member
N. W. Daines, Continuumy Member	A. Wilson, Contributing Member

Subgroup on Fabrication, Inspection, and Continued Service (BPV XII)

M. Pitts, Chair	T. A. Rogers
K. W. A. Cheng	R. C. Sallash
P. Chilukuri	S. Staniszewski
M Konrivnak	or otamoze work

P. Miller
O. Mulet
R. D. Hayworth, Contributing
Manubar

T. J. Rishel Member

M. Pitts

J. Roberts G. McRae, Contributing Member

Executive Committee (BPV XIII)

A. Donaldson, Chair

B. K. Nutter, Vice Chair

C. E. Rodrigues, Staff Secretary

D. Miller

D. Miller

J. F. Ball

Subgroup on Design and Materials (BPV XIII)

Subgroup on General Requirements (BPV XII)

B	- 4 (:)
S. Staniszewski, <i>Chair</i>	R. C. Sallash
A. N. Antoniou	Y. Doron, Contributing Member
P. Chilukuri H. Ebben III	T. J. Hitchcock, Contributing Member
J. L. Freiler W. L. Garfield O. Mulet	S. L. McWilliams, Contributing Member
B. F. Pittel	T. A. Rogers, Contributing Member

D. Miller, Chair	J. A. West
T. Patel, Vice Chair	A. Williams
T. K. Acharya	D. J. Azukas, Contributing Member
C. E. Beair	R. D. Danzy, Contributing Member
W. E. Chapin	A. Hassan, Contributing Member
J. L. Freiler	R. Miyata, Contributing Member
B. Joergensen V. Kalyanasundaram	M. Mullavey, Contributing Member
R. Krithivasan	S. K. Parimi, Contributing Member
B. J. Mollitor	G. Ramirez, Contributing Member
T. R. Tarbay	K. Shores, Contributing Member

D. G. Shelton, Contributing Member

Subgroup on General Requirements (BPV XIII)

A. Donaldson, Chair B. F. Pittel, Vice Chair J. M. Levy, Secretary R. Antoniuk D. J. Azukas J. F. Ball J. Burgess D. B. DeMichael S. T. French

J. Grace C. Haldiman I. Horne R. Klimas, Jr. Z. E. Kumana P. K. Lam D. Mainiero-Cessna K. R. May J. Mize L. Moedinger M. Mullavey

K. Shores D. E. Tezzo D. E. Tompkins J. F. White

B. Calderon, Contributing Member

P. Chavdarov, Contributing

Member

T. M. Fabiani, Contributing Member J. L. Freiler, Contributing Member J. P. Glaspie, Contributing Member G. D. Goodson, Contributing

Member

B. Joergensen, Contributing

Member

C. Lasarte, Contributing Member M. Mengon, Contributing Member D. E. Miller, Contributing Member R. Miyata, Contributing Member

B. Mruk, Contributing Member J. Phillips, Contributing Member M. Reddy, Contributing Member S. Ruesenberg, Contributing Member

R. Sadowski, Contributing Member A. Swearingin, Contributing

Member

A. P. Varghese, Contributing Member

Subgroup on Nuclear (BPV XIII)

K. R. May, Chair K. Shores J. F. Ball, Vice Chair I. H. Tseng R. Krithivasan, Secretary B. J. Yonsky M. Brown J. M. Levy, Alternate J. W. Dickson Y. Wong, Alternate S. Jones J. Yu, Alternate R. Lack

S. T. French, Contributing Member D. Miller T. Patel D. B. Ross, Contributing Member

US TAG to ISO TC 185 Safety Devices for Protection Against **Excessive Pressure (BPV XIII)**

D. Miller. Chair B. K. Nutter C. E. Rodrigues, Staff Secretary T. Patel J. F. Ball J. R. Thomas, Jr. T. J. Bevilacqua D. Tuttle D. B. DeMichael J. A. West J. W. Dickson J. F. White

COMMITTEE ON BOILER AND PRESSURE VESSEL CONFORMITY ASSESSMENT (CBPVCA)

R. V. Wielgoszinski, Chair G. Scribner, Vice Chair G. Moino, Staff Secretary M. Blankinship J. P. Chicoine T. E. Hansen W. Hibdon B. L. Krasiun L. E. McDonald N. Murugappan I. Powell D. E. Tuttle E. A. Whittle P. Williams

T. P. Beirne, Alternate N. Caputo, Alternate P. Chavdarov, Alternate J. M. Downs, Alternate P. D. Edwards, Alternate Y.-S. Kim, Alternate B. Morelock, Alternate M. Prefumo, Alternate R. Rockwood. Alternate K. Roewe, Alternate B. C. Turczynski, Alternate J. Yu, Alternate

D. Cheetham, Contributing Member A. J. Spencer, Honorary Member

COMMITTEE ON NUCLEAR CERTIFICATION (CNC)

Subgroup on Testing (BPV XIII) B. K. Nutter, Chair C. Sharpe J. W. Dickson, Vice Chair J. R. Thomas, Jr. R. Houk, Secretary Z. Wang T. P. Beirne D. Nelson, Alternate

J. Mize, Contributing Member M. Brown B. Calderon M. Mullavey, Contributing Member V. Chicola III S. Ruesenberg, Contributing

B. Engman Member

R. J. Garnett K. Shores, Contributing Member A. Strecker, Contributing Member R. Lack M. Mengon A. Wilson, Contributing Member

R. R. Stevenson, Chair M. A. Lockwood, Vice Chair S. Khan, Staff Secretary A. Appleton J. F. Ball G. Claffey N. DeSantis C. Dinic G. Gobbi J. W. Highlands K. A. Kavanagh J. C. Krane T. McGee E. L. Pleins T. E. Quaka T. N. Rezk D. M. Vickery E. A. Whittle

T. Aldo, Alternate M. Blankinship, Alternate G. Brouette, Alternate M. Burke. Alternate P. J. Coco, Alternate Y. Diaz-Castillo, Alternate P. D. Edwards, Alternate J. Grimm, Alternate K. M. Hottle, Alternate P. Krane, Alternate S. I. Montano. Alternate I. Olson, Alternate L. Ponce, Alternate M. Wilson, Alternate S. Yang, Alternate

S. F. Harrison, Jr., Contributing

Member

ASTM PERSONNEL

(23)

The ASTM standards included within this ASME publication have been reproduced through a license agreement with ASTM International. Information regarding the ASTM standards process can be found at www.astm.org.

General

ASME codes and standards are developed and maintained by committees with the intent to represent the consensus of concerned interests. Users of ASME codes and standards may correspond with the committees to propose revisions or cases, report errata, or request interpretations. Correspondence for this Section of the ASME Boiler and Pressure Vessel Code (BPVC) should be sent to the staff secretary noted on the Section's committee web page, accessible at https://go.asme.org/CSCommittees.

NOTE: See ASME BPVC Section II, Part D for guidelines on requesting approval of new materials. See Section II, Part C for guidelines on requesting approval of new welding and brazing materials ("consumables").

Revisions and Errata

The committee processes revisions to this Code on a continuous basis to incorporate changes that appear necessary or desirable as demonstrated by the experience gained from the application of the Code. Approved revisions will be published in the next edition of the Code.

In addition, the committee may post errata and Special Notices at http://go.asme.org/BPVCerrata. Errata and Special Notices become effective on the date posted. Users can register on the committee web page to receive e-mail notifications of posted errata and Special Notices.

This Code is always open for comment, and the committee welcomes proposals for revisions. Such proposals should be as specific as possible, citing the paragraph number(s), the proposed wording, and a detailed description of the reasons for the proposal, including any pertinent background information and supporting documentation.

Cases

- (a) The most common applications for cases are
 - (1) to permit early implementation of a revision based on an urgent need
 - (2) to provide alternative requirements
- (3) to allow users to gain experience with alternative or potential additional requirements prior to incorporation directly into the Code
 - (4) to permit use of a new material or process
- (b) Users are cautioned that not all jurisdictions or owners automatically accept cases. Cases are not to be considered as approving, recommending, certifying, or endorsing any proprietary or specific design, or as limiting in any way the freedom of manufacturers, constructors, or owners to choose any method of design or any form of construction that conforms to the Code.
 - (c) The committee will consider proposed cases concerning the following topics only:
 - (1) equipment to be marked with the ASME Single Certification Mark, or
 - (2) equipment to be constructed as a repair/replacement activity under the requirements of Section XI
- (d) A proposed case shall be written as a question and reply in the same format as existing cases. The proposal shall also include the following information:
 - (1) a statement of need and background information
 - (2) the urgency of the case (e.g., the case concerns a project that is underway or imminent)
 - (3) the Code Section and the paragraph, figure, or table number(s) to which the proposed case applies
 - (4) the edition(s) of the Code to which the proposed case applies
- (e) A case is effective for use when the public review process has been completed and it is approved by the cognizant supervisory board. Cases that have been approved will appear in the next edition or supplement of the Code Cases books, "Boilers and Pressure Vessels" or "Nuclear Components." Each Code Cases book is updated with seven Supplements. Supplements will be sent or made available automatically to the purchasers of the Code Cases books until the next edition of the Code. Annulments of Code Cases become effective six months after the first announcement of the annulment in a Code Case Supplement or Edition of the appropriate Code Case book. The status of any case is available at http://go.asme.org/BPVCCDatabase. An index of the complete list of Boiler and Pressure Vessel Code Cases and Nuclear Code Cases is available at http://go.asme.org/BPVCC.

Interpretations

- (a) Interpretations clarify existing Code requirements and are written as a question and reply. Interpretations do not introduce new requirements. If a revision to resolve conflicting or incorrect wording is required to support the interpretation, the committee will issue an intent interpretation in parallel with a revision to the Code.
- (b) Upon request, the committee will render an interpretation of any requirement of the Code. An interpretation can be rendered only in response to a request submitted through the online Interpretation Submittal Form at http://go.as-me.org/InterpretationRequest. Upon submitting the form, the inquirer will receive an automatic e-mail confirming receipt.
- (c) ASME does not act as a consultant for specific engineering problems or for the general application or understanding of the Code requirements. If, based on the information submitted, it is the opinion of the committee that the inquirer should seek assistance, the request will be returned with the recommendation that such assistance be obtained. Inquirers may track the status of their requests at http://go.asme.org/Interpretations.
- (d) ASME procedures provide for reconsideration of any interpretation when or if additional information that might affect an interpretation is available. Further, persons aggrieved by an interpretation may appeal to the cognizant ASME committee or subcommittee. ASME does not "approve," "certify," "rate," or "endorse" any item, construction, proprietary device, or activity.
- (e) Interpretations are published in the ASME Interpretations Database at http://go.asme.org/Interpretations as they are issued.

Committee Meetings

The ASME BPVC committees regularly hold meetings that are open to the public. Persons wishing to attend any meeting should contact the secretary of the applicable committee. Information on future committee meetings can be found at http://go.asme.org/BCW.

PREFACE

The American Society of Mechanical Engineers (ASME) and the American Society for Testing and Materials (ASTM) have cooperated for more than fifty years in the preparation of material specifications adequate for safety in the field of pressure equipment for ferrous and nonferrous materials, contained in Section II (Part A — Ferrous and Part B — Nonferrous) of the ASME Boiler and Pressure Vessel Code.

The evolution of this cooperative effort is contained in Professor A. M. Greene's "History of the ASME Boiler Code," which was published as a series of articles in *Mechanical Engineering* from July 1952 through August 1953 and is now available from ASME in a special bound edition. The following quotations from this history, which was based upon the minutes of the ASME Boiler and Pressure Vessel Committee, will help focus on the cooperative nature of the specifications found in Section II, Material Specifications.

"General discussion of material specifications comprising Paragraphs 1 to 112 of Part 2 and the advisability of having them agree with ASTM specifications," (1914).

"ASME Subcommittee appointed to confer with ASTM," (1916).

"Because of this cooperation the specifications of the 1918 Edition of the ASME Boiler Code were more nearly in agreement with ASTM specifications. In the 1924 Edition of the Code, 10 specifications were in complete agreement with ASTM specifications, 4 in substantial agreement and 2 covered materials for which ASTM had no corresponding specifications."

"In Section II, Material Specifications, the paragraphs were given new numbers beginning with S-1 and extending to S-213," (1925).

"Section II was brought into agreement with changes made in the latest ASTM specifications since 1921," (1932).

"The Subcommittee on Material Specifications arranged for the introduction of the revisions of many of the specifications so that they would agree with the latest form of the earlier ASTM specifications...," (1935).

From the preceding, it is evident that many of the material specifications were prepared by the Boiler and Pressure Vessel Code Committees, then subsequently, by cooperative action, modified and identified as ASTM specifications. Section II, Parts A and B, currently contain many material specifications that are identical with the corresponding ASTM specifications and some that have been modified for Code usage. Many of these specifications are published in dual format. That is, they contain both U.S. Customary units and SI units. The metrication protocols followed in the specifications are those adopted by ASTM, and are usually to the rules of IEEE/ASTM SI 10-1997, Standard for the Use of the International System of Units (SI): The Modern Metric System.

In 1969, the American Welding Society began publication of specifications for welding rods, electrodes, and filler metals, hitherto issued by ASTM. The Boiler and Pressure Vessel Committee has recognized this new arrangement, and is now working with AWS on these specifications. Section II, Part C, contains the welding material specifications approved for Code use.

In 1992, the ASME Board of Pressure Technology Codes and Standards endorsed the use of non-ASTM material for Boiler and Pressure Vessel Code applications. It is the intent to follow the procedures and practices currently in use to implement the adoption of non-ASTM materials.

All identical specifications are indicated by the ASME/originating organization symbols. The specifications prepared and copyrighted by ASTM, AWS, and other originating organizations are reproduced in the Code with the permission of the respective Society. The ASME Boiler and Pressure Vessel Committee has given careful consideration to each new and revised specification, and has made such changes as they deemed necessary to make the specification adaptable for Code usage. In addition, ASME has furnished ASTM with the basic requirements that should govern many proposed new specifications. Joint action will continue an effort to make the ASTM, AWS, and ASME specifications identical.

To assure that there will be a clear understanding on the part of the users of Section II, ASME publishes both the identical specifications and those amended for Code usage every 2 years.

The ASME Boiler and Pressure Vessel Code has been adopted into law by 50 states and many municipalities in the United States and by all of the Canadian provinces.

SPECIFICATIONS LISTED BY MATERIALS

Corrosion-Resisting and Heat-Resisting Steels

SA-182/SA-182M	Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Forged Fittings, and Valves and Parts for High-Temperature Service	211
SA-193/SA-193M	Specification for Alloy-Steel and Stainless Steel Bolting for High-Temperature or High	
SA-194/SA-194M	Pressure Service and Other Special Purpose Applications	233
SA-213/SA-213M	perature Service, or Both	247
SA-216/SA-216M	Heat-Exchanger Tubes	279
511 210/511 21011	Temperature Service	299
SA-217/SA-217M	Specification for Steel Castings, Martensitic Stainless and Alloy, for Pressure-Containing Parts, Suitable for High-Temperature Service	305
SA-234/SA-234M	Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High-Temperature Service	329
SA-240/SA-240M	Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications	339
SA-249/SA-249M	Specification for Welded Austenitic Steel Boiler, Superheater, Heat-Exchanger, and Con-	
	denser Tubes	355
SA-264	Specification for Stainless Chromium-Nickel Steel-Clad Plate	379
SA-265	Specification for Nickel and Nickel-Base Alloy-Clad Steel Plate	385
SA-268/SA-268M	Specification for Seamless and Welded Ferritic and Martensitic Stainless Steel Tubing for General Service	399
SA-312/SA-312M	Specification for Seamless, Welded, and Heavily Cold Worked Austenitic Stainless Steel Pipes	451
SA-320/SA-320M	Specification for Alloy-Steel and Stainless Steel Bolting for Low-Temperature Service	465
SA-336/SA-336M	Specification for Alloy Steel Forgings for Pressure and High-Temperature Parts	517
SA-351/SA-351M	Specification for Castings, Austenitic, for Pressure-Containing Parts	539
SA-358/SA-358M	Specification for Electric-Fusion-Welded Austenitic Chromium-Nickel Stainless Steel Pipe for High-Temperature Service and General Applications	565
SA-369/SA-369M	Specification for Carbon and Ferritic Alloy Steel Forged and Bored Pipe for High-	303
•	Temperature Service	575
SA-376/SA-376M	Specification for Seamless Austenitic Steel Pipe for High-Temperature Service	637
SA-401/SA-401M	Specification for Steel Wire, Chromium-Silicon Alloy	665
SA-403/SA-403M	Specification for Wrought Austenitic Stainless Steel Piping Fittings	671
SA-409/SA-409M	Specification for Welded Large Diameter Austenitic Steel Pipe for Corrosive or High- Temperature Service	683
SA-426/SA-426M	Specification for Centrifugally Cast Ferritic Alloy Steel Pipe for High-Temperature Service	709
SA-437/SA-437M	Specification for Stainless and Alloy-Steel Turbine-Type Bolting Specially Heat Treated for	
,	High-Temperature Service	715
SA-451/SA-451M	Specification for Centrifugally Cast Austenitic Steel Pipe for High-Temperature Service .	747
SA-479/SA-479M	Specification for Stainless Steel Bars and Shapes for Use in Boilers and Other Pressure Vessels	773
SA-484/SA-484M	Specification for General Requirements for Stainless Steel Bars, Billets, and Forgings	809
SA-515/SA-515M	Specification for Pressure Vessel Plates, Carbon Steel, for Intermediate- and Higher-	
SA-564/SA-564M	Temperature Service	867
•	Shapes	969

SA-638/SA-638M	Specification for Precipitation Hardening Iron Base Superalloy Bars, Forgings, and Forging Stock for High-Temperature Service
SA-660	Specification for Centrifugally Cast Carbon Steel Pipe for High-Temperature Service
SA-666	Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar
SA-691/SA-691M	Specification for Carbon and Alloy Steel Pipe, Electric-Fusion-Welded for High-Pressure Service at High Temperatures
SA-705/SA-705M	Specification for Age-Hardening Stainless Steel Forgings
SA-789/SA-789M	Specification for Seamless and Welded Ferritic/Austenitic Stainless Steel Tubing for General Service
SA-790/SA-790M	Specification for Seamless and Welded Ferritic/Austenitic Stainless Steel Pipe
SA-814/SA-814M	Specification for Cold-Worked Welded Austenitic Stainless Steel Pipe
SA-815/SA-815M	Specification for Wrought Ferritic, Ferritic/Austenitic, and Martensitic Stainless Steel Piping Fittings
SA-995/SA-995M	Specification for Castings, Austenitic-Ferritic (Duplex) Stainless Steel, for Pressure-Containing Parts
SA/EN 10088-2	Specification for Stainless Steels Part 2: Technical Delivery Conditions for Sheet/Plate and Strip of Corrosion Resisting Steels for General Purposes
SA/EN 10088-3	Specification for Stainless Steel Part 3: Technical Delivery Conditions for Semi-Finished Products, Bars, Rods, Wire, Sections, and Bright Products of Corrosion Resisting Steels for General Purposes
Methods	
SA-370	Test Methods and Definitions for Mechanical Testing of Steel Products
SA-751	Test Methods and Practices for Chemical Analysis of Steel Products
SA-1058	Test Methods for Mechanical Testing of Steel Products—Metric
Steel Bars	
SA-6/SA-6M	Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
SA-29/SA-29M	Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought .
SA-31	Specification for Steel Rivets and Bars for Rivets, Pressure Vessels
SA-276/SA-276M	Specification for Stainless Steel Bars and Shapes
SA-311/SA-311M	Specification for Cold-Drawn, Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements
SA-479/SA-479M	Specification for Stainless Steel Bars and Shapes for Use in Boilers and Other Pressure Vessels
SA-484/SA-484M	Specification for General Requirements for Stainless Steel Bars, Billets, and Forgings
SA-564/SA-564M	Specification for Hot-Rolled and Cold-Finished Age-Hardening Stainless Steel Bars and Shapes
SA-638/SA-638M	Specification for Precipitation Hardening Iron Base Superalloy Bars, Forgings, and Forging Stock for High-Temperature Service
SA-675/SA-675M	Specification for Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties
SA-696	Specification for Steel Bars, Carbon, Hot-Wrought or Cold-Finished, Special Quality, for Pressure Piping Components
SA-739	Specification for Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both
SA/JIS G4303	Specification for Stainless Steel Bars
Steel Billets and F	orgings
SA-105/SA-105M	Specification for Carbon Steel Forgings for Piping Applications
SA-181/SA-181M	Specification for Carbon Steel Forgings, for General-Purpose Piping
SA-266/SA-266M	Specification for Carbon Steel Forgings for Pressure Vessel Components
SA-336/SA-336M	Specification for Alloy Steel Forgings for Pressure and High-Temperature Parts

SA-350/SA-350M	Specification for Carbon and Low-Alloy Steel Forgings, Requiring Notch Toughness
CA 272/CA 272M	Testing for Piping Components
SA-372/SA-372M SA-484/SA-484M	
SA-484/SA-484M SA-508/SA-508M	Specification for General Requirements for Stainless Steel Bars, Billets, and Forgings Specification for Quenched and Tempered Vacuum-Treated Carbon and Alloy Steel
3A-300/3A-300M	
CA F41 /CA F41M	Forgings for Pressure Vessels
SA-541/SA-541M	Specification for Quenched and Tempered Carbon and Alloy Steel Forgings for Pressure Vessel Components
SA-638/SA-638M	Specification for Precipitation Hardening Iron Base Superalloy Bars, Forgings, and Forg-
3A-030/3A-030M	ing Stock for High-Temperature Service
SA-649/SA-649M	Specification for Forged Steel Rolls, Used for Corrugating Paper Machinery
SA-705/SA-705M	Specification for Age-Hardening Stainless Steel Forgings
SA-723/SA-723M	Specification for Alloy Steel Forgings for High-Strength Pressure Component Application
SA-765/SA-765M	Specification for Carbon Steel and Low-Alloy Steel Pressure-Vessel-Component Forgings
511 7 05 7 511 7 051-1	With Mandatory Toughness Requirements
SA-788/SA-788M	Specification for Steel Forgings, General Requirements
SA-836/SA-836M	Specification for Titanium-Stabilized Carbon Steel Forgings for Glass-Lined Piping and
21. 000, 011 0001.1	Pressure Vessel Service
SA-965/SA-965M	Specification for Steel Forgings, Austenitic, for Pressure and High-Temperature Parts
SA/EN 10222-2	Specification for Steel Forgings for Pressure Purposes Part 2: Ferritic and Martensitic
,	Steels With Specified Elevated Temperature Properties
	r
Steel Bolting Mater	ials
SA-193/SA-193M	Specification for Alloy-Steel and Stainless Steel Bolting for High-Temperature or High
	Pressure Service and Other Special Purpose Applications
SA-194/SA-194M	Specification for Carbon and Alloy Steel Nuts for Bolts for High Pressure or High Tem-
	perature Service, or Both
SA-307	Specification for Carbon Steel Bolts and Studs, 60 000 PSI Tensile Strength
SA-320/SA-320M	Specification for Alloy-Steel and Stainless Steel Bolting for Low-Temperature Service
SA-325	Specification for Structural Bolts, Steel, Heat Treated, 120/105 ksi Minimum Tensile
a. a=.	Strength
SA-354	Specification for Quenched and Tempered Alloy Steel Bolts, Studs, and Other Externally
0.1 10E/0.1 10EN	Threaded Fasteners
SA-437/SA-437M	Specification for Stainless and Alloy-Steel Turbine-Type Bolting Specially Heat Treated for
04.440	High-Temperature Service
SA-449	Specification for Hex Cap Screws, Bolts and Studs, Steel, Heat Treated, 120/105/90 ksi
CA 452/CA 452N4	Minimum Tensile Strength, General Use
SA-453/SA-453M	Specification for High-Temperature Bolting, With Expansion Coefficients Comparable to
CA E40/CA E40M	Austenitic Stainless Steels Specification for Alloy Steel Politing for Special Applications
SA-540/SA-540M	Specification for Alloy-Steel Bolting for Special Applications
SA-563 SA-574	Specification for Carbon and Alloy Steel Nuts
	Specification for Alloy Steel Socket-Head Cap Screws
SA-962/SA-962M	Specification for Common Requirements for Bolting Intended for Use at any Temperature
SF-568M	From Cryogenic to the Creep Range
31-300M	specification for Carbon and Alloy Steel Externally Threaded Metric Pastellers
Steel Castings	
SA-216/SA-216M	Specification for Steel Castings, Carbon, Suitable for Fusion Welding for High-
,	Temperature Service
SA-217/SA-217M	Specification for Steel Castings, Martensitic Stainless and Alloy, for Pressure-Containing
,	Parts, Suitable for High-Temperature Service
SA-351/SA-351M	Specification for Castings, Austenitic, for Pressure-Containing Parts
SA-352/SA-352M	Specification for Steel Castings, Ferritic and Martensitic, for Pressure-Containing Parts,
,	Suitable for Low-Temperature Service
SA-487/SA-487M	Specification for Steel Castings Suitable for Pressure Service

SA-609/SA-609M	Specification for Castings, Carbon, Low-Alloy, and Martensitic Stainless Steel, Ultrasonic Examination Thereof	1041
SA-667/SA-667M	Specification for Centrifugally Cast Dual Metal (Gray and White Cast Iron) Cylinders	1041 1101
-		
SA-703/SA-703M	Specification for Steel Castings, General Requirements, for Pressure-Containing Parts	1159
SA-747/SA-747M	Specification for Steel Castings, Stainless, Precipitation Hardening	1221
SA-781/SA-781M	Specification for Castings, Steel and Alloy, Common Requirements, for General Industrial Use	1261
SA-985/SA-985M	Specification for Steel Investment Castings General Requirements, for Pressure- Containing Parts	1435
SA-995/SA-995M	Specification for Castings, Austenitic-Ferritic (Duplex) Stainless Steel, for Pressure-	1100
511 775/511 775141	Containing Parts	1481
Steel Flanges, Fitti	ings, Valves, and Parts	
SA-105/SA-105M	Specification for Carbon Steel Forgings for Piping Applications	163
SA-181/SA-181M	Specification for Carbon Steel Forgings, for General-Purpose Piping	205
SA-182/SA-182M	Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Forged Fittings,	
CA 246/CA 246M	and Valves and Parts for High-Temperature Service	211
SA-216/SA-216M	Specification for Steel Castings, Carbon, Suitable for Fusion Welding for High-	200
CA 217/CA 217M	Temperature Service	299
SA-217/SA-217M	Specification for Steel Castings, Martensitic Stainless and Alloy, for Pressure-Containing	205
CA 224 /CA 224M	Parts, Suitable for High-Temperature Service	305
SA-231/SA-231M	Specification for Chromium-Vanadium Alloy Steel Spring Wire	317
SA-232/SA-232M	Specification for Chromium-Vanadium Alloy Steel Valve Spring Quality Wire	323
SA-234/SA-234M	Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High-Temperature Service	329
SA-350/SA-350M	Specification for Carbon and Low-Alloy Steel Forgings, Requiring Notch Toughness	349
3A-330/3A-330M		527
CA 2E1 /CA 2E1M	Testing for Piping Components	539
SA-351/SA-351M	Specification for Castings, Austenitic, for Pressure-Containing Parts	339
SA-352/SA-352M	Specification for Steel Castings, Ferritic and Martensitic, for Pressure-Containing Parts, Suitable for Low-Temperature Service	547
CA 402/CA 402M		
SA-403/SA-403M SA-420/SA-420M	Specification for Wrought Austenitic Stainless Steel Piping Fittings	671
3A-420/3A-420W	Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Low- Temperature Service	697
SA-522/SA-522M	Specification for Forged or Rolled 8 and 9% Nickel Alloy Steel Flanges, Fittings, Valves,	0,7,
011 022/011 0221-1	and Parts for Low-Temperature Service	879
SA-592/SA-592M	Specification for High-Strength Quenched and Tempered Low-Alloy Steel Forged Fittings	
,	and Parts for Pressure Vessels	1037
SA-815/SA-815M	Specification for Wrought Ferritic, Ferritic/Austenitic, and Martensitic Stainless Steel	1337
CA OOF	Piping Fittings	1375
SA-905		
SA-960/SA-960M	Specification for Common Requirements for Wrought Steel Piping Fittings	1391
SA-961/SA-961M	Specification for Common Requirements for Steel Flanges, Forged Fittings, Valves, and	1402
CA OOT /CA OOTM	Parts for Piping Applications	1403
SA-985/SA-985M	Specification for Steel Investment Castings General Requirements, for Pressure-	1435
SA-988/SA-988M	Containing Parts	1433
3A-900/3A-900M	Parts for High Temperature Service	1457
CA 000 /CA 000M		1437
SA-989/SA-989M	Specification for Hot Isostatically-Pressed Alloy Steel Flanges, Fittings, Valves, and Parts	1 1 7 1
CA OOF /CA OOFM	for High Temperature Service	1471
SA-995/SA-995M	Specification for Castings, Austenitic-Ferritic (Duplex) Stainless Steel, for Pressure-	1 401
	Containing Parts	1481
Steel Pipe		
SA-53/SA-53M	Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless .	139
SA-106/SA-106M	Specification for Seamless Carbon Steel Pipe for High-Temperature Service	169
SA-134/SA-134M	Specification for Pipe, Steel, Electric-Fusion (ARC)-Welded (Sizes NPS 16 and Over)	179

SA-135/SA-135M SA-312/SA-312M	Specification for Electric-Resistance-Welded Steel Pipe	18
·	Pipes	45
SA-333/SA-333M	Specification for Seamless and Welded Steel Pipe for Low-Temperature Service and Other Applications With Required Notch Toughness	483
SA-335/SA-335M	Specification for Seamless Ferritic Alloy-Steel Pipe for High-Temperature Service	505
SA-358/SA-358M	Specification for Electric-Fusion-Welded Austenitic Chromium-Nickel Stainless Steel Pipe for High-Temperature Service and General Applications	565
SA-369/SA-369M	Specification for Carbon and Ferritic Alloy Steel Forged and Bored Pipe for High- Temperature Service	575
SA-376/SA-376M	Specification for Seamless Austenitic Steel Pipe for High-Temperature Service	637
SA-409/SA-409M	Specification for Welded Large Diameter Austenitic Steel Pipe for Corrosive or High- Temperature Service	683
SA-426/SA-426M	Specification for Centrifugally Cast Ferritic Alloy Steel Pipe for High-Temperature Service	709
SA-451/SA-451M	Specification for Centrifugally Cast Austenitic Steel Pipe for High-Temperature Service .	747
SA-524/SA-524M	Specification for Seamless Carbon Steel Pipe for Atmospheric and Lower Temperatures	885
SA-530/SA-530M	Specification for General Requirements for Specialized Carbon and Alloy Steel Pipe	893
SA-587	Specification for Electric-Resistance-Welded Low-Carbon Steel Pipe for the Chemical Industry	1033
SA-660	Specification for Centrifugally Cast Carbon Steel Pipe for High-Temperature Service	1079
SA-671/SA-671M	Specification for Electric-Fusion-Welded Steel Pipe for Atmospheric and Lower Temperatures	1105
SA-672/SA-672M	Specification for Electric-Fusion-Welded Steel Pipe for High-Pressure Service at Moderate Temperatures	1113
SA-691/SA-691M	Specification for Carbon and Alloy Steel Pipe, Electric-Fusion-Welded for High-Pressure Service at High Temperatures	1137
SA-727/SA-727M	Specification for Carbon Steel Forgings for Piping Components with Inherent Notch Toughness	1195
SA-731/SA-731M	Specification for Seamless, Welded Ferritic, and Martensitic Stainless Steel Pipe	1201
SA-790/SA-790M	Specification for Seamless and Welded Ferritic/Austenitic Stainless Steel Pipe	1301
SA-813/SA-813M	Specification for Single- or Double-Welded Austenitic Stainless Steel Pipe	1319
SA-814/SA-814M	Specification for Cold-Worked Welded Austenitic Stainless Steel Pipe	1329
SA-941	Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys	1381
SA-961/SA-961M	Specification for Common Requirements for Steel Flanges, Forged Fittings, Valves, and Parts for Piping Applications	1403
SA-999/SA-999M	Specification for General Requirements for Alloy and Stainless Steel Pipe	1487
Steel Plate, Sheet,	-	
SA-568/SA-568M	Specification for Steel, Sheet, Carbon, Structural, and High-Strength, Low-Alloy, Hot-Rolled and Cold-Rolled, General Requirements for	981
SA-749/SA-749M	Specification for Steel, Strip, Carbon and High-Strength, Low-Alloy, Hot-Rolled, General Requirements for	1231
Steel Plates, Sheet	s, and Strip for Pressure Vessels	
SA-20/SA-20M	Specification for General Requirements for Steel Plates for Pressure Vessels	67
SA-203/SA-203M	Specification for Pressure Vessel Plates, Alloy Steel, Nickel	261
SA-204/SA-204M	Specification for Pressure Vessel Plates, Alloy Steel, Molybdenum	265
SA-225/SA-225M	Specification for Pressure Vessel Plates, Alloy Steel, Manganese-Vanadium-Nickel	313
SA-240/SA-240M	Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications	339
SA-263	Specification for Stainless Chromium Steel-Clad Plate	373
SA-264	Specification for Stainless Chromium-Nickel Steel-Clad Plate	379
SA-265	Specification for Nickel and Nickel-Base Alloy-Clad Steel Plate	385
SA-285/SA-285M	Specification for Pressure Vessel Plates, Carbon Steel, Low- and Intermediate-Tensile Strength	427

SA-299/SA-299M	Specification for Pressure Vessel Plates, Carbon Steel, Manganese-Silicon	431
SA-302/SA-302M	Specification for Pressure Vessel Plates, Alloy Steel, Manganese-Molybdenum and Manganese-Molybdenum-Nickel	435
SA-353/SA-353M	Specification for Pressure Vessel Plates, Alloy Steel, Double-Normalized and Tempered 9% Nickel	553
SA-387/SA-387M	Specification for Pressure Vessel Plates, Alloy Steel, Chromium-Molybdenum	645
SA-414/SA-414M	Specification for Steel, Sheet, Carbon, and High-Strength, Low-Alloy for Pressure Vessels	691
SA-455/SA-455M	Specification for Pressure Vessel Plates, Carbon Steel, High-Strength Manganese	761
SA-480/SA-480M	Specification for General Requirements for Flat-Rolled Stainless and Heat-Resisting Steel Plate, Sheet, and Strip	783
SA-515/SA-515M	Specification for Pressure Vessel Plates, Carbon Steel, for Intermediate- and Higher-Temperature Service	867
SA-516/SA-516M	Specification for Pressure Vessel Plates, Carbon Steel, for Moderate- and Lower- Temperature Service	871
SA-517/SA-517M	Specification for Pressure Vessel Plates, Alloy Steel, High-Strength, Quenched and Tempered	875
SA-533/SA-533M	Specification for Pressure Vessel Plates, Alloy Steel, Quenched and Tempered, Manganese-Molybdenum and Manganese-Molybdenum-Nickel	903
SA-537/SA-537M	Specification for Pressure Vessel Plates, Heat-Treated, Carbon-Manganese-Silicon Steel	907
SA-542/SA-542M	Specification for Pressure Vessel Plates, Alloy Steel, Quenched-and-Tempered,	
, , ,	Chromium-Molybdenum, and Chromium-Molybdenum-Vanadium	929
SA-543/SA-543M	Specification for Pressure Vessel Plates, Alloy Steel, Quenched and Tempered, Nickel-Chromium-Molybdenum	935
SA-553/SA-553M	Specification for Pressure Vessel Plates, Alloy Steel, Quenched and Tempered 7, 8, and 9% Nickel	939
SA-562/SA-562M	Specification for Pressure Vessel Plates, Carbon Steel, Manganese-Titanium for Glass or Diffused Metallic Coatings	953
SA-612/SA-612M	Specification for Pressure Vessel Plates, Carbon Steel, High Strength, for Moderate and Lower Temperature Service	1055
SA-645/SA-645M	Specification for Pressure Vessel Plates, 5% and 5½% Nickel Alloy Steels, Specially Heat Treated	1065
SA-662/SA-662M	Specification for Pressure Vessel Plates, Carbon-Manganese-Silicon Steel, for Moderate and Lower Temperature Service	1085
SA-666	Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar	1089
SA-693	Specification for Precipitation-Hardening Stainless and Heat-Resisting Steel Plate, Sheet, and Strip	1145
SA-724/SA-724M	Specification for Pressure Vessel Plates, Carbon-Manganese-Silicon Steel, Quenched and Tempered, for Welded Pressure Vessels	1189
SA-736/SA-736M	Specification for Pressure Vessel Plates, Low-Carbon Age-Hardening Nickel-Copper-Chromium-Molybdenum-Columbium (Niobium) Alloy Steel	1203
SA-737/SA-737M	Specification for Pressure Vessel Plates, High-Strength Low-Alloy Steel	1207
SA-738/SA-738M	Specification for Pressure Vessel Plates, Heat-Treated, Carbon-Manganese-Silicon Steel, for Moderate and Lower Temperature Service	1211
SA-770/SA-770M	Specification for Through-Thickness Tension Testing of Steel Plates for Special Applications	1255
SA-832/SA-832M	Specification for Pressure Vessel Plates, Alloy Steel, Chromium-Molybdenum-Vanadium	1345
SA-841/SA-841M	Specification for Steel Plates for Pressure Vessels, Produced by Thermo-Mechanical Control Process (TMCP)	1361
SA-1010/SA-1010M	Specification for Higher-Strength Martensitic Stainless Steel Plate, Sheet, and Strip	1509
SA-1017/SA-1017M	Specification for Pressure Vessel Plates, Alloy-Steel, Chromium-Molybdenum-Tungsten	1535
SA/AS 1548	Specification for Fine Grained, Weldable Steel Plates for Pressure Equipment	1563
SA/EN 10028-2	Specification for Flat Products Made of Steels for Pressure Purposes Part 2: Non-Alloy and Alloy Steels With Specified Elevated Temperature Properties	1571
SA/EN 10028-3	Specification for Flat Products Made of Steels For Pressure Purposes Part 3: Weldable	
	Fine Grain Steels, Normalized	1575

SA/EN 10028-4	Specification for Flat Products Made of Steels For Pressure Purposes Part 4: Nickel Alloy Steels With Specified Low Temperature Properties	157
SA/EN 10028-7	Specification for Flat Products Made of Steels for Pressure Purposes Part 7: Stainless	137
5A/LN 10020-7		
SA/GB 713	Specification for Steel Plates for Boilers and Pressure Vessels	1581 1591
SA/JIS G3118	Specification for Carbon Steel Plates for Pressure Vessels for Intermediate and Moderate	
511/ 110 00 110	Temperature Service	1599
Steel Tubes		
SA-178/SA-178M	Specification for Electric-Resistance-Welded Carbon Steel and Carbon-Manganese Steel	
•	Boiler and Superheater Tubes	19
SA-179/SA-179M	Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes	20
SA-192/SA-192M	Specification for Seamless Carbon Steel Boiler Tubes for High-Pressure Service	229
SA-209/SA-209M	Specification for Seamless Carbon-Molybdenum Alloy-Steel Boiler and Superheater Tubes	269
SA-210/SA-210M	Specification for Seamless Medium-Carbon Steel Boiler and Superheater Tubes	273
SA-213/SA-213M	Specification for Seamless Ferritic and Austenitic Alloy-Steel Boiler, Superheater, and Heat-Exchanger Tubes	279
SA-214/SA-214M	Specification for Electric-Resistance-Welded Carbon Steel Heat-Exchanger and Condenser Tubes	29!
SA-249/SA-249M	Specification for Welded Austenitic Steel Boiler, Superheater, Heat-Exchanger, and Con-	35!
SA-250/SA-250M	denser Tubes	33.
·	Tubes	36
SA-268/SA-268M	Specification for Seamless and Welded Ferritic and Martensitic Stainless Steel Tubing for General Service	399
SA-334/SA-334M	Specification for Seamless and Welded Carbon and Alloy-Steel Tubes for Low- Temperature Service	493
SA-423/SA-423M	Specification for Seamless and Electric-Welded Low-Alloy Steel Tubes	70!
SA-450/SA-450M	Specification for General Requirements for Carbon and Low Alloy Steel Tubes	73.
SA-513	Specification for Electric-Resistance-Welded Carbon and Alloy Steel Mechanical Tubing	84
SA-556/SA-556M	Specification for Seamless Cold-Drawn Carbon Steel Feedwater Heater Tubes	943
SA-557/SA-557M	Specification for Electric-Resistance-Welded Carbon Steel Feedwater Heater Tubes	95
SA-688/SA-688M	Specification for Seamless and Welded Austenitic Stainless Steel Feedwater Heater Tubes	112'
SA-789/SA-789M	Specification for Seamless and Welded Ferritic/Austenitic Stainless Steel Tubing for General Service	129
SA-803/SA-803M	Specification for Seamless and Welded Ferritic Stainless Steel Feedwater Heater Tubes	131
SA-941	Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys	138
SA-1016/SA-1016M	Specification for General Requirements for Ferritic Alloy Steel, Austenitic Alloy Steel, and Stainless Steel Tubes	1523
SA/EN 10216-2	Specification for Seamless Steel Tubes for Pressure Purposes Part 2: Technical Delivery Conditions for Non-Alloy and Alloy Steel Tubes With Specified Elevated Temperature	1589
SA/EN 10217-1	Properties	159:
Structural Steel		
SA-6/SA-6M	Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling	
SA-36/SA-36M	Specification for Carbon Structural Steel	12
SA-283/SA-283M	Specification for Low and Intermediate Tensile Strength Carbon Steel Plates	423
SA-572/SA-572M	Specification for High-Strength Low-Alloy Columbium-Vanadium Structural Steel	101

SA-656/SA-656M	Specification for Hot-Rolled Structural Steel, High-Strength Low-Alloy Plate With Improved Formability	1075
SA-1008/SA-1008M		1499
SA-1011/SA-1011M		1513
SA/CSA-G40.21	Specification for Structural Quality Steels	1565
SA/EN 10025-2	Specification for Hot Rolled Products of Structural Steels Part 2: Technical Delivery	
	Conditions for Non-Alloy Structural Steels	1567
SA/IS 2062	Specification for Hot Rolled Medium and High Tensile Structural Steel	1597
Wrought Iron, Cast	Iron, and Malleable Iron	
SA-47/SA-47M	Specification for Ferritic Malleable Iron Castings	129
SA-278/SA-278M	Specification for Gray Iron Castings for Pressure Containing Parts for Temperatures up to 650°F (350°C)	417
SA-395/SA-395M	Specification for Ferritic Ductile Iron Pressure-Retaining Castings for Use at Elevated Temperatures	651
SA-439/SA-439M	Specification for Austenitic Ductile Iron Castings	719
SA-476/SA-476M	Specification for Ductile Iron Castings for Paper Mill Dryer Rolls	765
SA-748/SA-748M	Specification for Statically Cast Chilled White Iron-Gray Iron Dual Metal Rolls for Pressure	
,	Vessel Use	1227
SA-834	Specification for Common Requirements for Iron Castings for General Industrial Use	1351
SA-874/SA-874M	Specification for Ferritic Ductile Iron Castings Suitable for Low-Temperature Service	1371
SA/JIS G5504	Specification for Heavy-Walled Ferritic Spheroidal Graphite Iron Castings for Low Tem-	
•	perature Service	1605

SPECIFICATION REMOVAL

(23)

From time to time, it becomes necessary to remove specifications from this Part of Section II. This occurs because the sponsoring society (e.g., ASTM, AWS, CEN) has notified ASME that the specification has either been replaced with another specification, or that there is no known use and production of a material. Removal of a specification from this Section also results in concurrent removal of the same specification from Section IX and from all of the ASME Boiler and Pressure Vessel Construction Codes that reference the material. This action effectively prohibits further use of the material in ASME Boiler and Pressure Vessel construction.

The following specifications will be dropped from this Section in the next Edition, unless information concerning current production and use of the material is received before December 1 of this year:

SA-557 SA-731 (withdrawn by ASTM; see SA-268/SA-268M)

If you are currently using and purchasing new material to this specification for ASME Boiler and Pressure Vessel Code construction, and if discontinuance of this specification would present a hardship, please notify the Secretary of the ASME Boiler and Pressure Vessel Committee, at the address shown below:

Secretary ASME Boiler and Pressure Vessel Committee Two Park Avenue New York, NY 10016-5990

SUMMARY OF CHANGES

Changes listed below are identified on the pages by a margin note, (23), placed next to the affected area.

Page	Location	Change
xi	List of Sections	(1) Under Section III, Division 4 added(2) Title of Section XI and subtitle of Section XI, Division 2 revised(3) Information on interpretations and Code cases moved to "Correspondence With the Committee"
XV	Personnel	Updated
xxxvii	ASTM Personnel	Updated
xxxviii	Correspondence With the Committee	Added (replaces "Submittal of Technical Inquiries to the Boiler and Pressure Vessel Standards Committees")
xlix	Specification Removal	Updated
liii	Cross-Referencing in the ASME BPVC	Updated
1	Statement of Policy on the Use of ASME Material Specifications	Added
3	SA-6/SA-6M	Revised in its entirety
67	SA-20/SA-20M	Revised in its entirety
101	SA-29/SA-29M	Revised in its entirety
125	SA-36/SA-36M	Revised in its entirety
139	SA-53/SA-53M	Revised in its entirety
163	SA-105/SA-105M	Revised in its entirety
169	SA-106/SA-106M	Revised in its entirety
201	SA-179/SA-179M	Revised in its entirety
211	SA-182/SA-182M	Revised in its entirety
229	SA-192/SA-192M	Revised in its entirety
233	SA-193/SA-193M	Revised in its entirety
247	SA-194/SA-194M	Revised in its entirety
279	SA-213/SA-213M	Revised in its entirety
295	SA-214/SA-214M	Revised in its entirety
355	SA-249/SA-249M	Revised in its entirety
393	SA-266/SA-266M	Revised in its entirety
399	SA-268/SA-268M	Revised in its entirety
407	SA-276/SA-276M	Revised in its entirety
423	SA-283/SA-283M	Revised in its entirety
465	SA-320/SA-320M	Revised in its entirety

Page	Location	Change
539	SA-351/SA-351M	Revised in its entirety
565	SA-358/SA-358M	Revised in its entirety
581	SA-370	Revised in its entirety
631	SA-372/SA-372M	Revised in its entirety
637	SA-376/SA-376M	Revised in its entirety
665	SA-401/SA-401M	Added
671	SA-403/SA-403M	Revised in its entirety
683	SA-409/SA-409M	Revised in its entirety
691	SA-414/SA-414M	Revised in its entirety
705	SA-423/SA-423M	Revised in its entirety
715	SA-437/SA-437M	Revised in its entirety
719	SA-439/SA-439M	Added
735	SA-450/SA-450M	Revised in its entirety
753	SA-453/SA-453M	Revised in its entirety
773	SA-479/SA-479M	Revised in its entirety
809	SA-484/SA-484M	Revised in its entirety
823	SA-487/SA-487M	Revised in its entirety
831	SA-508/SA-508M	Revised in its entirety
885	SA-524/SA-524M	Revised in its entirety
893	SA-530/SA-530M	Revised in its entirety
911	SA-540/SA-540M	Revised in its entirety
929	SA-542/SA-542M	Revised in its entirety
951	SA-557/SA-557M	Deleted
1017	SA-572/SA-572M	Revised in its entirety
1075	SA-656/SA-656M	Revised in its entirety
1137	SA-691/SA-691M	Revised in its entirety
1159	SA-703/SA-703M	Revised in its entirety
1195	SA-727/SA-727M	Revised in its entirety
1201	SA-731/SA-731M	Deleted
1211	SA-738/SA-738M	Revised in its entirety
1243	SA-751	Revised in its entirety
1319	SA-813/SA-813M	Revised in its entirety
1329	SA-814/SA-814M	Revised in its entirety
1357	SA-836/SA-836M	Revised in its entirety
1381	SA-941	Revised in its entirety
1391	SA-960/SA-960M	Revised in its entirety

Page	Location	Change
1403	SA-961/SA-961M	Revised in its entirety
1413	SA-962/SA-962M	Revised in its entirety
1427	SA-965/SA-965M	Revised in its entirety
1481	SA-995/SA-995M	Revised in its entirety
1539	SA-1058	Added
1565	SA/CSA-G40.21	Revised in its entirety
1567	SA/EN 10025-2	Revised in its entirety
1571	SA/EN 10028-2	Revised
1575	SA/EN 10028-3	Revised
1577	SA/EN 10028-4	Revised
1593	SA/EN 10222-2	Revised
1597	SA/IS 2062	Revised in its entirety
1599	SA/JIS G3118	Revised in its entirety
1608	Mandatory Appendix II	Revised in its entirety
1610	Table II-200-1	Updated
1619	Table II-200-2	Updated

CROSS-REFERENCING IN THE ASME BPVC

(23)

Paragraphs within the ASME BPVC may include subparagraph breakdowns, i.e., nested lists. The following is a guide to the designation and cross-referencing of subparagraph breakdowns:

- (a) Hierarchy of Subparagraph Breakdowns
 - (1) First-level breakdowns are designated as (a), (b), (c), etc.
 - (2) Second-level breakdowns are designated as (1), (2), (3), etc.
 - (3) Third-level breakdowns are designated as (-a), (-b), (-c), etc.
 - (4) Fourth-level breakdowns are designated as (-1), (-2), (-3), etc.
 - (5) Fifth-level breakdowns are designated as (+a), (+b), (+c), etc.
 - (6) Sixth-level breakdowns are designated as (+1), (+2), etc.
- (b) Cross-References to Subparagraph Breakdowns. Cross-references within an alphanumerically designated paragraph (e.g., PG-1, UIG-56.1, NCD-3223) do not include the alphanumerical designator of that paragraph. The cross-references to subparagraph breakdowns follow the hierarchy of the designators under which the breakdown appears. The following examples show the format:
 - (1) If X.1(c)(1)(-a) is referenced in X.1(c)(1), it will be referenced as (-a).
 - (2) If X.1(c)(1)(-a) is referenced in X.1(c)(2), it will be referenced as (1)(-a).
 - (3) If X.1(c)(1)(-a) is referenced in X.1(e)(1), it will be referenced as (c)(1)(-a).
 - (4) If X.1(c)(1)(-a) is referenced in X.2(c)(2), it will be referenced as X.1(c)(1)(-a).



STATEMENT OF POLICY ON THE USE OF ASME MATERIAL SPECIFICATIONS

(23)

The material specifications in Section II, Part A or Section II, Part B shall be used when ordering, producing, and certifying materials for ASME BPV Code construction. The use of a specification not in Section II, Part A or Section II, Part B is acceptable only when it is referenced in an approved Code Case.

A complete list of ASME material specifications can be found in Mandatory Appendix II, Tables II-200-1 and II-200-2. Since the framework of ASME material specifications does not originate with the Section II committee (see Mandatory Appendix II, II-100 for more information), the following information is provided to assist the user in understanding and applying the specifications:

- (a) Scope. Some specifications contain a statement in the Scope about the uses or service temperatures for alloys within. Such statements are to be viewed as guidance in the corresponding ASME material specification. Alloys approved for ASME BPV Code construction are restricted by maximum design temperatures stipulated in Section II, Part D, and any stipulations of the individual construction Codes.
- (b) Units. Specifications often designate one unit (SI or Customary) as the standard for the specification with conversions of the other being cited as for information only. Compliance and acceptance for the purposes of Code usage is not governed by this. Section II, Part D has a U.S. Customary volume and an SI volume for mechanical and physical properties of all materials approved for Code construction.
- (c) References. References to other material specifications within the text often carry the original title given to it by the parent organization. The following are two examples:

- (1) From 2021 Edition of Section II, Part A, SA-203
- 4.1 Steelmaking Practice The steel shall be killed and shall conform to the fine grain size requirement of Specification A20/A20M.
- (2) From 2021 Edition of Section II, Part B, SB-98/SB-98M
 - 9.1 Refer to the appropriate paragraphs in Specification B249/B249M with particular reference to the following tables.

Such references shall be interpreted as referring to the corresponding ASME material specification. If no corresponding ASME specification exists, then the user is bound to the latest revision of the cited specification.

- (d) Ordering Information. The Ordering Information section of some specifications state that furnishing test reports and certification is optional. This is not valid for ASME BPVC. When alloys are purchased for use in ASME construction, test reports and certifications shall be furnished to the purchaser.
- (e) Individual Alloys. To be used for Code construction, any alloy listed in an ASME material specification shall also have either allowable stress values or mechanical properties listed in either a Section II, Part D table or a Code Case.

Material produced to an acceptable material specification is not limited to country of origin. Before the material is ordered, it is the responsibility of the user to ensure that the intended construction Code permits materials certified to the desired specification.

With the exception of ASTM International, ASME has not entered into copyright agreements with publishers of material specifications. Limits on usage appear on the specification's cover sheets. For sources from which an official English-language version of a specification can be purchased, see Nonmandatory Appendix A.



SPECIFICATION FOR GENERAL REQUIREMENTS FOR ROLLED STRUCTURAL STEEL BARS, PLATES, SHAPES, AND SHEET PILING



SA-6/SA-6M



(23)

(Identical with ASTM Specification A6/A6M-21.)

A827/A827M

Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling

1. Scope

1.1 This general requirements specification covers a group of common requirements that, unless otherwise specified in the applicable product specification, apply to rolled structural steel bars, plates, shapes, and sheet piling covered by each of the following product specifications issued by ASTM:

ASTM	Title of Specification
Designation	Title of Specification
A36/A36M	Carbon Structural Steel
A131/A131M	Structural Steel for Ships
A242/A242M	High-Strength Low-Alloy Structural Steel
A283/A283M	Low and Intermediate Tensile Strength Carbon Steel Plates
A328/A328M	Steel Sheet Piling
A514/A514M	High-Yield-Strength, Quenched and Tempered Alloy Steel Plate, Suitable for Welding
A529/A529M	High-Strength Carbon-Manganese Steel of Structural Quality
A572/A572M	High-Strength Low-Alloy Columbium-Vanadium Structural Steel
A573/A573M	Structural Carbon Steel Plates
A588/A588M	High-Strength Low-Alloy Structural Steel, up to 50 ksi [345 MPa] Minimum Yield Point, with Atmospheric Corrosion Resistance
A633/A633M	Normalized High-Strength Low-Alloy Structural Steel Plates
A656/A656M	Hot-Rolled Structural Steel, High-Strength Low-Alloy Plate with Improved Formability
A690/A690M	High-Strength Low-Alloy Nickel, Copper, Phosphorus Steel H-Piles and Sheet Piling with Atmospheric Corrosion Re- sistance for Use in Marine Environments
A709/A709M	Structural Steel for Bridges
A710/A710M	Precipitation-Strengthened Low-Carbon Nickel-Copper- Chromium-Molybdenum-Columbium Alloy Structural Steel Plates
A769/A769M	Carbon and High-Strength Electric Resistance Forge- Welded Steel Structural Shapes
A786/A786M	Hot-Rolled Carbon, Low-Alloy, High-Strength Low-Alloy, and Alloy Steel Floor Plates

A829/A829M	Alloy Structural Steel Plates
A830/A830M	Plates, Carbon Steel, Structural Quality, Furnished to
	Chemical Composition Requirements
A857/A857M	Steel Sheet Piling, Cold Formed, Light Gage
A871/A871M	High-Strength Low-Alloy Structural Steel Plate With Atmospheric Corrosion Resistance
A913/A913M	High-Strength Low-Alloy Steel Shapes of Structural Quality,
	Produced by Quenching and Self-Tempering Process (QST)
A945/A945M	High-Strength Low-Alloy Structural Steel Plate with Low Carbon and Restricted Sulfur for Improved Weldability, Formability, and Toughness
A950/A950M	Fusion-Bonded Epoxy-Coated Structural Steel H-Piles and Sheet Piling
A992/A992M	Structural Steel Shapes
A1043/A1043M	Structural Steel with Low Yield to Tensile Ratio for Use in Buildings
A1066/A1066M	High-Strength Low-Alloy Structural Steel Plate Produced by Thermo-Mechanical Controlled Process (TMCP)

Plates, Carbon Steel, for Forging and Similar Applications

1.2 Annex A1 lists permitted variations in dimensions and mass (Note 1) in SI units. The values listed are not exact conversions of the values in Tables 1 to 31 inclusive but are, instead, rounded or rationalized values. Conformance to Annex A1 is mandatory when the "M" specification designation is used.

Note 1—The term "weight" is used when inch-pound units are the standard; however, under SI, the preferred term is "mass."

- 1.3 Annex A2 lists the dimensions of some shape profiles.
- 1.4 Appendix X1 provides information on coil as a source of structural products.
- 1.5 Appendix X2 provides information on the variability of tensile properties in plates and structural shapes.
 - 1.6 Appendix X3 provides information on weldability.
- 1.7 Appendix X4 provides information on cold bending of plates, including suggested minimum inside radii for cold bending.
- 1.8 This general requirements specification also covers a group of supplementary requirements that are applicable to several of the above product specifications as indicated therein. Such requirements are provided for use where additional testing or additional restrictions are required by the purchaser, and apply only where specified individually in the purchase order.

- 1.9 In case of any conflict in requirements, the requirements of the applicable product specification prevail over those of this general requirements specification.
- 1.10 Additional requirements that are specified in the purchase order and accepted by the supplier are permitted, provided that such requirements do not negate any of the requirements of this general requirements specification or the applicable product specification.
- 1.11 For purposes of determining conformance with this general requirements specification and the applicable product specification, values are to be rounded to the nearest unit in the right-hand place of figures used in expressing the limiting values in accordance with the rounding method of Practice E29.
- 1.12 The text of this general requirements specification contains notes or footnotes, or both, that provide explanatory material. Such notes and footnotes, excluding those in tables and figures, do not contain any mandatory requirements.
- 1.13 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with this specification.
- 1.14 This general requirements specification and the applicable product specification are expressed in both inch-pound units and SI units; however, unless the order specifies the applicable "M" specification designation (SI units), the structural product is furnished to inch-pound units.
- 1.15 This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.
- 1.16 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A131/A131M Specification for Structural Steel for Ships A370 Test Methods and Definitions for Mechanical Testing of Steel Products

A673/A673M Specification for Sampling Procedure for Impact Testing of Structural Steel

A700 Guide for Packaging, Marking, and Loading Methods for Steel Products for Shipment

A751 Test Methods and Practices for Chemical Analysis of Steel Products

A829/A829M Specification for Alloy Structural Steel Plates A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys E29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications

E112 Test Methods for Determining Average Grain Size E208 Test Method for Conducting Drop-Weight Test to Determine Nil-Ductility Transition Temperature of Ferritic Steels

2.2 American Welding Society Standards:

A5.1/A5.1M Mild Steel Covered Arc-Welding Electrodes A5.5/A5.5M Low-Alloy Steel Covered Arc-Welding Electrodes

A5.17/A5.17M Specification For Carbon Steel Electrodes And Fluxes For Submerged Arc Welding

A5.18/A5.18M Specification For Carbon Steel Electrodes And Rods For Gas Shielded Arc Welding

A5.20/A5.20M Carbon Steel Electrodes For Flux Cored Arc Welding

A5.23/A5.23M Low Alloy Steel Electrodes And Fluxes For Submerged Arc Welding

A5.28/A5.28M Specification For Low-Alloy Steel Electrodes And Rods For Gas Shielded Arc Welding

A5.29/A5.29M Specification for Low-Alloy Steel Electrodes for Flux Cored Arc Welding

D1.1/D1.1M Structural Welding Code Steel

2.3 U.S. Military Standards:

MIL-STD-129 Marking for Shipment and Storage MIL-STD-163 Steel Mill Products Preparation for Shipment and Storage

2.4 U.S. Federal Standard:

Fed. Std. No. 123 Marking for Shipments (Civil Agencies) 2.5 *American Society of Mechanical Engineers Code:* ASME Boiler and Pressure Vessel Code, Section IX

3. Terminology

- 3.1 Definitions of Terms Specific to This Standard:
- 3.1.1 *Plates (other than floor plates)*—Flat, hot-rolled steel, ordered to thickness or weight [mass] and typically width and length, commonly classified as follows:
 - 3.1.1.1 When Ordered to Thickness:
- (1) Over 8 in. [200 mm] in width and 0.230 in. [6 mm] or over in thickness.
- (2) Over 48 in. [1200 mm] in width and 0.180 in. [4.5 mm] or over in thickness.
 - 3.1.1.2 When Ordered to Weight [Mass]:
- (1) Over 8 in. [200 mm] in width and 9.392 lb/ft² [47.10 kg/m²] or heavier.
- (2) Over 48 in. [1200 mm] in width and 7.350 lb/ft^2 [35.32 kg/m²] or heavier.
- 3.1.1.3 *Discussion*—Steel products are available in various thickness, width, and length combinations depending upon equipment and processing capabilities of various manufacturers and processors. Historic limitations of a product based upon

dimensions (thickness, width, and length) do not take into account current production and processing capabilities. To qualify any product to a particular product specification requires all appropriate and necessary tests be performed and that the results meet the limits prescribed in that product specification. If the necessary tests required by a product specification cannot be conducted, the product cannot be qualified to that specification. This general requirement standard contains permitted variations for the commonly available sizes. Permitted variations for other sizes are subject to agreement between the customer and the manufacturer or processor, whichever is applicable.

- 3.1.1.4 Slabs, sheet bars, and skelp, though frequently falling in the foregoing size ranges, are not classed as plates.
- 3.1.1.5 Coils are excluded from qualification to the applicable product specification until they are decoiled, leveled or straightened, formed (if applicable), cut to length, and, if required, properly tested by the processor in accordance with ASTM specification requirements (see Sections 9-15, 18, and 19 and the applicable product specification).
 - 3.1.2 Shapes (Flanged Sections):
- 3.1.2.1 *structural-size shapes*—rolled flanged sections having at least one dimension of the cross section 3 in. [75 mm] or greater.
- 3.1.2.2 bar-size shapes—rolled flanged sections having a maximum dimension of the cross section less than 3 in. [75 mm].
- 3.1.2.3 "W" shapes—doubly-symmetric, wide-flange shapes with inside flange surfaces that are substantially parallel
- 3.1.2.4 "HP" shapes—are wide-flange shapes generally used as bearing piles whose flanges and webs are of the same nominal thickness and whose depth and width are essentially the same.
- 3.1.2.5 "S" shapes—doubly-symmetric beam shapes with inside flange surfaces that have a slope of approximately 16\%3\%.
- 3.1.2.6 "M" shapes—doubly-symmetric shapes that cannot be classified as "W," "S," or "HP" shapes.
- 3.1.2.7 "C" shapes—channels with inside flange surfaces that have a slope of approximately 16% %.
- 3.1.2.8 "MC" shapes—channels that cannot be classified as "C" shapes.
- 3.1.2.9 "L" shapes—shapes having equal-leg and unequalleg angles.
- 3.1.3 *sheet piling*—rolled steel sections that are capable of being interlocked, forming a continuous wall when individual pieces are driven side by side.
- $3.1.4\ bars$ —rounds, squares, and hexagons, of all sizes; flats 13 /64 in. (0.203 in.) and over [over 5 mm] in specified thickness, not over 6 in. [150 mm] in specified width; and flats 0.230 in. and over [over 6 mm] in specified thickness, over 6 to 8 in. [150 to 200 mm] inclusive, in specified width.
- 3.1.5 *exclusive*—when used in relation to ranges, as for ranges of thickness in the tables of permissible variations in dimensions, is intended to exclude only the greater value of the

- range. Thus, a range from 60 to 72 in. [1500 to 1800 mm] exclusive includes 60 in. [1500 mm], but does not include 72 in. [1800 mm].
- 3.1.6 *rimmed steel*—steel containing sufficient oxygen to give a continuous evolution of carbon monoxide during solidification, resulting in a case or rim of metal virtually free of voids.
- 3.1.7 *semi-killed steel*—incompletely deoxidized steel containing sufficient oxygen to form enough carbon monoxide during solidification to offset solidification shrinkage.
- 3.1.8 *capped steel*—rimmed steel in which the rimming action is limited by an early capping operation. Capping is carried out mechanically by using a heavy metal cap on a bottle-top mold or chemically by an addition of aluminum or ferrosilicon to the top of the molten steel in an open-top mold.
- 3.1.9 *killed steel*—steel deoxidized, either by addition of strong deoxidizing agents or by vacuum treatment, to reduce the oxygen content to such a level that no reaction occurs between carbon and oxygen during solidification.
- 3.1.10 *mill edge*—the normal edge produced by rolling between horizontal finishing rolls. A mill edge does not conform to any definite contour. Mill edge plates have two mill edges and two trimmed edges.
- 3.1.11 *universal mill edge*—the normal edge produced by rolling between horizontal and vertical finishing rolls. Universal mill plates, sometimes designated UM Plates, have two universal mill edges and two trimmed edges.
- 3.1.12 *sheared edge*—the normal edge produced by shearing. Sheared edge plates are trimmed on all edges.
- 3.1.13 gas cut edge—the edge produced by gas flame cutting.
- 3.1.14 *special cut edge*—usually the edge produced by gas flame cutting involving special practices such as pre-heating or post-heating, or both, in order to minimize stresses, avoid thermal cracking and reduce the hardness of the gas cut edge. In special instances, special cut edge is used to designate an edge produced by machining.
- 3.1.15 *sketch*—when used to describe a form of plate, denotes a plate other than rectangular, circular, or semi-circular.
- 3.1.16 *normalizing*—a heat treating process in which a steel plate is reheated to a uniform temperature above the upper critical temperature and then cooled in air to below the transformation range.
- 3.1.17 *plate-as-rolled*—when used in relation to the location and number of tests, the term refers to the unit plate rolled from a slab or directly from an ingot. It does not refer to the condition of the plate.
- 3.1.18 *fine grain practice*—a steelmaking practice that is intended to produce a killed steel that is capable of meeting the requirements for fine austenitic grain size.
- 3.1.18.1 *Discussion*—It normally involves the addition of one or more austenitic grain refining elements in amounts that have been established by the steel producer as being sufficient.

Austenitic grain refining elements include, but are not limited to, aluminum, columbium (niobium), titanium, and vanadium.

- 3.1.19 *structural product*—a hot-rolled steel plate, shape, sheet piling, or bar.
- 3.1.20 *coil*—hot-rolled steel in coiled form that is intended to be processed into a finished structural product.
- 3.1.21 *manufacturer*—the organization that directly controls the conversion of steel ingots, slabs, blooms, or billets, by hot-rolling, into an as-rolled structural product or into coil; and for structural products produced from as-rolled structural products, the organization that directly controls, or is responsible for, the operations involved in finishing the structural product.
- 3.1.21.1 *Discussion*—Such finishing operations include leveling or straightening, hot forming or cold forming (if applicable), welding (if applicable), cutting to length, testing, inspection, conditioning, heat treatment (if applicable), packaging, marking, loading for shipment, and certification.
- 3.1.22 processor—the organization that directly controls, or is responsible for, the operations involved in the processing of coil into a finished structural product. Such processing operations include decoiling, leveling or straightening, hot-forming or cold-forming (if applicable), welding (if applicable), cutting to length, testing, inspection, conditioning, heat treatment (if applicable), packaging, marking, loading for shipment, and certification.
- 3.1.22.1 Discussion—The processing operations need not be done by the organization that did the hot rolling of the coil. If only one organization is involved in the hot rolling and processing operations, that organization is termed the manufacturer for the hot rolling operation and the processor for the processing operations. If more than one organization is involved in the hot rolling and processing operations, the organization that did the hot rolling is termed the manufacturer and an organization that does one or more processing operations is termed a processor.
- 3.2 Refer to Terminology A941 for additional definitions of terms used in this standard.

4. Ordering Information

- 4.1 Information items to be considered, if appropriate, for inclusion in purchase orders are as follows:
- 4.1.1 ASTM product specification designation (see 1.1) and year-date;
- 4.1.2 Name of structural product (plate, shape, bar, or sheet piling);
 - 4.1.3 Shape designation, or size and thickness or diameter;
 - 4.1.4 Grade, class, and type designation, if applicable;
 - 4.1.5 Condition (see Section 6), if other than as-rolled;
 - 4.1.6 Quantity (weight [mass] or number of pieces);
 - 4.1.7 Length;
- 4.1.8 Exclusion of either structural product produced from coil or structural product produced from an as-rolled structural product (see 5.4 and Appendix X1), if applicable;
 - 4.1.9 Heat treatment requirements (see 6.2 and 6.3), if any;
 - 4.1.10 Testing for fine austenitic grain size (see 8.3.2);

- 4.1.11 Mechanical property test report requirements (see Section 14), if any;
- 4.1.12 Special packaging, marking, and loading for shipment requirements (see Section 19), if any;
- 4.1.13 Supplementary requirements, if any, including any additional requirements called for in the supplementary requirements;
- 4.1.14 End use, if there are any end-use-specific requirements (see 18.1, 11.3.4, Table 22 or Table A1.22, and Table 24 or Table A1.24);
 - 4.1.15 Special requirements (see 1.10), if any; and
 - 4.1.16 Repair welding requirements (see 9.5), if any.

5. Materials and Manufacture

- 5.1 The steel shall be made in a basic-oxygen or electric-arc furnace, possibly followed by additional refining in a ladle metallurgy furnace (LMF) or secondary melting by vacuum-arc remelting (VAR) or electroslag remelting (ESR).
 - 5.2 The steel shall be killed.
 - 5.3 The steel shall be strand cast or cast in stationary molds.
 - 5.3.1 Strand Cast:
- 5.3.1.1 When heats of the same nominal chemical composition are consecutively strand cast at one time, the heat number assigned to the cast product need not be changed until all of the steel in the cast product is from the following heat.
- 5.3.1.2 When two consecutively strand cast heats have different nominal chemical composition ranges, the manufacturer shall remove the transition material by an established procedure that positively separates the grades.
- 5.4 Structural products shall be produced from an as-rolled structural product or from coil.
- 5.5 Where part of a heat is rolled into an as-rolled structural product and the balance of the heat is rolled into coil, each part shall be tested separately.
- 5.6 Structural products produced from coil shall not contain splice welds, unless previously approved by the purchaser.

6. Heat Treatment

6.1 Where the structural product is required to be heat treated, such heat treatment shall be performed by the manufacturer, the processor, or the fabricator, unless otherwise specified in the applicable product specification.

Note 2—When no heat treatment is required, the manufacturer or processor has the option of heat treating the structural product by normalizing, stress relieving, or normalizing then stress relieving to meet the applicable product specification.

- 6.2 Where the heat treatment is to be performed by other than the manufacturer, the order shall so state.
- 6.2.1 Where the heat treatment is to be performed by other than the manufacturer, the structural products shall be accepted on the basis of tests made on test specimens taken from full thickness test coupons heat treated in accordance with the requirements specified in the applicable product specification or in the purchase order. If the heat-treatment temperatures are not specified, the manufacturer or processor shall heat treat the test coupons under conditions the manufacturer or processor

considers appropriate, provided that the purchaser is informed of the procedure followed in heat treating the test coupons.

- 6.3 Where the heat treatment is to be performed by the manufacturer or the processor, the structural product shall be heat treated as specified in the applicable product specification, or as specified in the purchase order, provided that the heat treatment specified by the purchaser is not in conflict with the requirements of the applicable product specification.
- 6.4 Where normalizing is to be performed by the fabricator, the structural product shall be either normalized or heated uniformly for hot forming, provided that the temperature to which the structural product is heated for hot forming does not significantly exceed the normalizing temperature.
- 6.5 The use of cooling rates that are faster than those obtained by cooling in air to improve the toughness shall be subject to approval by the purchaser, and structural products so treated shall be tempered subsequently in the range from 1100 to 1300°F [595 to 705°C].

7. Chemical Analysis

- 7.1 Heat Analysis:
- 7.1.1 Sampling for chemical analysis and methods of analysis shall be in accordance with Test Methods, Practices, and Terminology A751.
- 7.1.2 For each heat, the heat analysis shall include determination of the content of carbon, manganese, phosphorus, sulfur, silicon, nickel, chromium, molybdenum, copper, vanadium, columbium (niobium); any other element that is specified or restricted by the applicable product specification for the applicable grade, class, and type; and any austenitic grain refining element whose content is to be used in place of austenitic grain size testing of the heat (see 8.3.2). Boron shall be reported if intentionally added.
- Note 3—For steels that do not have intentional boron additions for hardenability, the boron content will not normally exceed 0.0008 %.
- 7.1.3 Except as allowed by 7.1.4 for primary heats, heat analyses shall conform to the heat analysis requirements of the applicable product specification for the applicable grade, class, and type.
- 7.1.4 Where vacuum-arc remelting or electroslag remelting is used, a remelted heat is defined as all ingots remelted from a single primary heat. If the heat analysis of the primary heat conforms to the heat analysis requirements of the applicable product specification for the applicable grade, class, and type, the heat analysis for the remelted heat shall be determined from one test sample taken from one remelted ingot, or the product of one remelted ingot, from the primary heat. If the heat analysis of the primary heat does not conform to the heat analysis requirements of the applicable product specification for the applicable grade, type, and class, the heat analysis for the remelted heat shall be determined from one test sample taken from each remelted ingot, or the product of each remelted ingot, from the primary heat.
- 7.2 *Product Analysis*—For each heat, the purchaser shall have the option of analyzing representative samples taken from the finished structural product. Sampling for chemical analysis

- and methods of analysis shall be in accordance with Test Methods, Practices, and Terminology A751. The product analyses so determined shall conform to the heat analysis requirements of the applicable product specification for the applicable grade, class, and type, subject to the permitted variations in product analysis given in Table A. If a range is specified, the determinations of any element in a heat shall not vary both above and below the specified range. Rimmed or capped steel is characterized by a lack of homogeneity in its composition, especially for the elements carbon, phosphorus, and sulfur. Therefore, the limitations for these elements shall not be applicable unless misapplication is clearly indicated.
- 7.3 Referee Analysis—For referee purposes, Test Methods, Practices, and Terminology A751 shall be used.
- 7.4 *Grade Substitution*—Alloy steel grades that meet the chemical requirements of Table 1 of Specification A829/A829M shall not be substituted for carbon steel grades.

8. Metallurgical Structure

- 8.1 Where austenitic grain size testing is required, such testing shall be in accordance with Test Methods E112 and at least 70 % of the grains in the area examined shall meet the specified grain size requirement.
- 8.1.1 Discussion—Austenitic Grain Size—All requirements for austenitic grain size control in Section 8, Metallurgical Structure, refer to a size of austenite grains that form when and if the structural product is reheated to a temperature at or above the transformation temperature, Ac₃, after the product has experienced the complete rolling operation and has cooled to ambient temperature. The requirements for austenitic grain size control in Section 8, including the results of the referenced testing methods, do not measure or control the prior austenitic grain size or the ferritic grain size of the structural product in the as-rolled condition.
- 8.2 Coarse Austenitic Grain Size—Where coarse austenitic grain size is specified, one austenitic grain size test per heat shall be made and the austenitic grain size number so determined shall be in the range of 1 to 5 inclusive.
 - 8.3 Fine Austenitic Grain Size:
- 8.3.1 Where fine austenitic grain size is specified, except as allowed in 8.3.2, one austenitic grain size test per heat shall be made and the austenitic grain size number so determined shall be 5 or higher.
- Note 4—Such austenitic grain size numbers may be achieved with lower contents of austenitic grain refining elements than 8.3.2 requires for austenitic grain size testing to be waived.
- 8.3.2 Unless testing for fine austenitic grain size is specified in the purchase order, an austenitic grain size test need not be made for any heat that has, by heat analysis, one or more of the following:
 - 8.3.2.1 A total aluminum content of 0.020 % or more.
- 8.3.2.2 An acid soluble aluminum content of 0.015~% or more.
- 8.3.2.3 A content for an austenitic grain refining element that exceeds the minimum value agreed to by the purchaser as being sufficient for austenitic grain size testing to be waived, or

TABLE A Permitted Variations in Product Analysis

Note 1-Where "..." appears in this table, there is no requirement.

Value, % Minimum Limit Maximum Limit Carbon to 0.15 incl over 0.15 to 0.40 incl over 0.40 to 0.75 incl over 0.60 to 0.90 incl over 0.60 to 0.90 incl over 0.60 to 0.90 incl over 0.90 to 1.20 incl over 1.20 to 1.35 incl over 1.20 to 1.35 incl over 1.35 to 1.65 incl over 1.85 to 1.65 incl over 1.85 to 1.95 incl over 0.04 to 0.15 incl over 0.04 to 0.15 incl over 0.06 incl over 0.30 to 0.40 incl over 0.40 to 2.20 incl 0.06 incl over 2.00 to 3.75 incl over 3.75 to 5.30 incl over 3.75 to 5.30 incl over 0.90 to 2.00 incl over 5.30 incl over 2.00 to 10.00 incl over 0.90 to 2.00 incl over 2.00 to 10.00 incl over 0.90 to 2.00 incl over 2.00 to 10.00 incl over 0.90 to 2.00 incl over 2.00 to 10.00 incl over 0.90 to 2.00 incl over 0.90 to 0.00 incl over 0.90 to 0.90 incl over 0.90	Perm Upper Limit, or Variatio			
over 0.15 to 0.40 incl over 0.40 to 0.75 incl over 0.40 to 0.75 incl over 0.75 Manganese ^A to 0.60 incl over 0.90 to 1.20 incl over 1.20 to 1.35 incl over 1.20 to 1.35 incl over 1.20 to 1.35 incl over 1.35 to 1.95 incl over 1.85 to 1.95 incl over 1.95 Phosphorus to 0.04 incl over 0.04 to 0.15 incl over 0.06 incl over 0.06 incl over 0.30 to 0.40 incl over 0.30 to 0.40 incl over 0.40 to 2.20 incl over 0.40 to 2.20 incl over 0.40 to 2.35 incl over 0.40 to 2.35 incl over 0.40 to 0.15 incl To 0.06 incl over 0.30 incl over 0.30 incl over 0.30 to 0.40 incl over 0.40 to 2.20 incl over 0.40 to 2.30 incl over 1.00 to 2.00 incl over 2.00 to 3.75 incl over 3.75 to 5.30 incl over 5.30 Chromium to 0.90 incl over 0.90 to 2.00 incl over 0.90 to 2.00 incl over 0.90 to 2.00 incl over 0.90 to 10.00 incl over 0.90 to 2.00 incl over 0.00 to 15.00 incl over 0.00 to 0.00 incl ov	Element	Maximum Specified Value, %	Minimum	Maximum
over 0.40 to 0.75 incl over 0.75 O.04 O.05 Over 0.75 O.04 O.06 Manganese ^A to 0.60 incl over 0.60 to 0.90 incl over 0.90 to 1.20 incl over 1.35 to 1.65 incl Over 1.35 incl Over 1.95 O.12 O.16 Phosphorus to 0.04 incl Over 0.04 to 0.15 incl Over 0.06 Sulfur to 0.06 incl Over 0.06 Sulfur to 0.06 incl Over 0.06 Sulfur to 0.03 incl Over 0.30 to 0.40 incl Over 0.30 to 0.40 incl Over 0.40 to 2.20 incl Over 0.40 to 2.20 incl Over 2.00 to 3.75 incl Over 2.00 to 3.75 incl Over 3.75 to 5.30 incl Over 2.00 to 1.75 incl Over 2.00 to 1.75 incl Over 2.00 to 1.00 incl Over 0.90 to 2.00 incl Over 2.00 to 1.00 incl Over 0.00 to 15.00 incl Over 0.00 to 1.50 incl Over 0.00 to 1.50 incl Over 0.20 incl Over 0.20 to 0.40 incl Over 0.00 to 1.50 incl Over 0.00 to 1.50 incl Over 0.00 to 15.00 incl Over 0.00 to 1.50 incl Over 0.00 to 1.00 incl Over 0.00 to 0.00 incl O	Carbon		0.02	0.03
over 0.75 Over 0.75 Over 0.60 to 0.90 incl over 0.60 to 0.90 incl over 0.90 to 1.20 incl over 1.20 to 1.35 incl over 1.20 to 1.35 incl over 1.20 to 1.35 incl over 1.35 to 1.65 incl over 1.65 to 1.95 incl over 1.95 Over 0.04 incl over 0.04 incl over 0.04 incl over 0.05 incl over 0.06 incl over 0.06 Silicon To 0.03 incl over 0.40 to 0.22 incl over 0.40 to 0.23 incl over 0.40 to 0.23 incl over 0.40 to 0.25 incl over 1.00 to 0.05 over 0.00 incl over				
Manganese ^A to 0.60 incl over 0.60 to 0.90 incl over 0.90 to 1.20 incl over 1.35 to 1.65 incl over 1.35 to 1.65 incl over 1.95 to 1.95 incl over 1.95 to 1.95 incl over 0.90 to 0.15 incl over 1.95 to 0.01 to 0.02 Over 0.04 to 0.15 incl Sulfur to 0.06 incl over 0.00 to 0.00 incl over 0.00 to 0.00 incl over 0.00 incl o				
over 0.60 to 0.90 incl over 0.90 to 1.20 incl over 1.20 to 1.25 incl over 1.20 to 1.35 incl over 1.35 to 1.65 incl over 1.95 0.08 0.10 over 1.20 to 1.35 incl over 1.95 0.09 0.11 0.12 over 1.95 0.12 0.16 Phosphorus to 0.04 incl over 0.04 to 0.15 incl 0.010 Sulfur to 0.06 incl over 0.06 0.010 Silicon to 0.30 incl over 0.30 to 0.40 incl over 0.40 to 2.20 incl 0.05 0.05 Nickel to 1.00 incl over 1.00 to 2.00 incl over 2.00 to 3.75 incl over 2.00 to 3.75 incl over 3.75 to 5.30 incl over 5.30 0.03 0.03 Chromium to 0.90 incl over 0.90 to 2.00 incl over 0.90 to 2.00 incl over 0.90 to 10.00 incl over 0.90 to 10.00 incl over 0.90 to 15.00 incl 0.04 0.04 0.04 Molybdenum to 0.20 incl over 0.20 to 0.40 incl over 0.20 to 0.40 incl over 0.20 to 0.40 incl over 0.20 to 0.40 incl over 0.20 incl 0.01 0.03 0.03 0.03 0.03 0.03 0.03 0.03		over 0.75	0.04	0.06
over 0.90 to 1.20 incl over 1.35 to 1.56 incl over 1.36 to 1.05 incl over 1.65 to 1.95 incl over 1.95 0.09 0.11 0.09 0.11 0.09 0.11 0.09 0.11 0.11	Manganese ^A	to 0.60 incl	0.05	0.06
over 1.20 to 1.35 incl over 1.65 to 1.95 incl over 1.95 0.09 0.11 0.09 0.11 0.11 0.11 0.11 0.11 0.11 0.11 0.11	-	over 0.60 to 0.90 incl	0.06	0.08
over 1.35 to 1.65 incl over 1.95 0.09 0.12 over 1.01 0.14 over 1.01 0.11 over 1.01 0.14 over 1.01 0.11 over 0.16 Phosphorus to 0.04 incl over 0.04 to 0.15 incl 0.010 0.010 Sulfur to 0.06 incl over 0.06 0.010 0.010 Silicon to 0.30 incl over 0.30 to 0.40 incl over 0.30 to 0.05 over 0.30 to 0.05 over 0.30 to 0.05 over 0.30 to 0.06 over 0.06 over 0.375 incl over 1.00 to 2.00 incl over 0.05 over 2.00 to 3.75 incl over 2.00 to 3.75 incl over 0.90 to 2.00 incl over 0.90 to 10.00 incl over 0.90 to 15.00 incl over 0.10 to 0.15.00 incl over 0.15 over 0.20 to 0.40 incl over 0.15 over 0.20 to 0.40 incl over 0.20 to 0.40 to 1.15 incl over 0.05 over 0.05 over 0.40 to 1.15 incl over 0.05 over 0.05 over 0.05 over 0.00 incl over 0.10 to 2.00 incl over 0.05 over 0.00 incl over 0.10 to 0.25 incl over 0.25 over 0.25 over 0.25 over 0.22 over 0.25 over 0.20 over 0.25 incl over 0.40 incl over 0.10 incl ove		over 0.90 to 1.20 incl	0.08	0.10
over 1.65 to 1.95 incl over 1.95 0.11 0.14 over 1.95 Phosphorus to 0.04 incl over 0.04 to 0.15 incl 0.010 gr Sulfur to 0.06 incl over 0.06 0.010 gr Silicon to 0.30 incl over 0.30 to 0.40 incl over 0.30 to 0.40 incl over 0.30 to 0.40 incl over 0.40 to 2.20 incl 0.05 over 0.05 over 0.40 to 0.05 over 0.05 over 0.40 to 2.20 incl 0.06 over 0.06 Nickel to 1.00 incl over 2.00 incl over 2.00 to 3.75 incl over 3.75 to 5.30 incl over 0.93 to 2.00 incl over 0.90 to 10.00 incl over 0.90 to 10.00 incl over 0.10 to 15.00 incl over 0.15 over 0.20 to 10.00 incl over 0.15 over 0.20 to 10.40 incl over 0.20 to 0.40 incl over 0.20 to 0.00 incl over 0.00 to 2.00 incl over 0.00 to 0.05 over 0.00 over 0.00 incl over 0.10 to 0.025 incl over 0.00 o		over 1.20 to 1.35 incl	0.09	0.11
over 1.95 0.12 0.16 Phosphorus to 0.04 incl over 0.04 to 0.15 incl		over 1.35 to 1.65 incl	0.09	0.12
Phosphorus to 0.04 incl over 0.04 to 0.15 incl B		over 1.65 to 1.95 incl	0.11	0.14
Sulfur to 0.06 incl over 0.06		over 1.95	0.12	0.16
Sulfur to 0.06 incl	Phosphorus	to 0.04 incl		0.010
Sulfur	Поорногао			
Silicon to 0.30 incl over 0.30 to 0.40 incl over 0.30 to 0.40 incl over 0.30 to 0.40 incl over 0.40 to 2.20 incl 0.06 0.06 Nickel to 1.00 incl over 1.00 to 2.00 incl over 2.00 to 3.75 incl over 3.75 to 5.30 incl over 5.30 0.10 0.10 Chromium to 0.90 incl over 2.00 incl over 2.00 to 10.00 incl over 2.00 to 10.00 incl over 2.00 incl over 2.00 to 10.00 incl over 0.90 to 2.00 incl over 0.90 to 10.00 incl over 0.10 to 15.00 incl 0.15 0.15 Molybdenum to 0.20 incl over 0.40 to 1.15 incl 0.04 0.04 Copper 0.20 minimum only over 0.40 to 1.15 incl 0.05 Titanium to 0.15 incl 0.01 0.01 Vanadium to 0.10 incl over 0.20 incl 0.05 Titanium to 0.10 incl 0.05 0.05 Titanium to 0.10 incl 0.01 0.01 Vanadium to 0.10 incl 0.025 incl 0.02 0.02 over 0.25 0.02 0.03 minimum only specified 0.01 0.01 Boron any B B Columbium (Niobium) ^D Zirconium to 0.15 incl 0.03 0.03 O.03 0.03 O.03 0.03 O.01 Copper 0.01 incl 0.01 0.01 O.01		0ver 0.04 to 0.15 mer	•••	
Silicon to 0.30 incl over 0.30 to 0.40 incl 0.05 0.05 over 0.40 to 2.20 incl 0.06 0.06 0.06 0.06 0.06 0.06 0.06 0.0	Sulfur	to 0.06 incl		0.010
over 0.30 to 0.40 incl over 0.40 to 2.20 incl 0.05 0.05 Nickel to 1.00 incl over 1.00 to 2.00 incl over 2.00 to 3.75 incl over 3.75 to 5.30 incl over 5.30 0.03 0.03 Chromium to 0.90 incl over 0.90 to 2.00 incl over 2.00 to 10.00 incl over 10.00 to 15.00 incl 0.04 0.04 0.06 0.06 0.06 0.06 0.06 0.06 0.07 0.06 0.06 0.06 0.06 0.06 0.06 0.07 Molybdenum to 0.20 incl over 0.20 to 0.40 incl over 0.20 to 0.40 incl over 0.40 to 1.15 incl 0.01 0.03 0.03 0.03 0.03 0.04 0.01 0.04 Copper 0.20 minimum only to 1.00 incl over 1.00 to 2.00 incl 0.02 0.03 0.03 0.03 0.03 Titanium to 0.15 incl 0.01 ^C 0.01 0.01 0.02 0.02 0.02 0.02 0.02 0.03 minimum only specified 0.01 ^C 0.01 0.01 Boron any B B Columbium (Niobium) ^D to 0.15 incl 0.03 0.03 0.03 Zirconium to 0.15 incl 0.03 0.03 0.03		over 0.06	В	В
over 0.30 to 0.40 incl over 0.40 to 2.20 incl 0.05 0.05 Nickel to 1.00 incl over 1.00 to 2.00 incl over 2.00 to 3.75 incl over 3.75 to 5.30 incl over 5.30 0.03 0.03 Chromium to 0.90 incl over 0.90 to 2.00 incl over 2.00 to 10.00 incl over 10.00 to 15.00 incl 0.04 0.04 0.06 0.06 0.06 0.06 0.06 0.06 0.07 0.06 0.06 0.06 0.06 0.06 0.06 0.07 Molybdenum to 0.20 incl over 0.20 to 0.40 incl over 0.20 to 0.40 incl over 0.40 to 1.15 incl 0.01 0.03 0.03 0.03 0.03 0.04 0.01 0.04 Copper 0.20 minimum only to 1.00 incl over 1.00 to 2.00 incl 0.02 0.03 0.03 0.03 0.03 Titanium to 0.15 incl 0.01 ^C 0.01 0.01 0.02 0.02 0.02 0.02 0.02 0.03 minimum only specified 0.01 ^C 0.01 0.01 Boron any B B Columbium (Niobium) ^D to 0.15 incl 0.03 0.03 0.03 Zirconium to 0.15 incl 0.03 0.03 0.03	Silicon	to 0.30 incl	0.02	0.03
Nickel to 1.00 incl over 1.00 to 2.00 incl over 1.00 to 2.00 incl over 1.00 to 2.00 incl over 2.00 to 3.75 incl over 3.75 to 5.30 incl over 3.75 to 5.30 incl over 5.30 0.05 over 0.07 over 3.00 over 3.00 over 3.00 over 5.30 Chromium to 0.90 incl over 0.90 to 2.00 incl over 2.00 to 10.00 incl over 10.00 to 15.00 incl over 10.00 to 15.00 incl over 0.20 to 0.40 incl over 0.20 incl over 0.30 over 0.40 to 1.15 incl 0.01 over 0.03 over 0.03 over 0.03 over 0.03 over 0.03 over 0.05 over 0.05 Titanium to 0.10 incl over 0.25 incl over 0.25 incl over 0.25 incl over 0.25 minimum only specified 0.01 over 0.01 over 0.01 over 0.00 over 0.02 over 0.25 incl over 0.02 over 0.25 incl over 0.00				
over 1.00 to 2.00 incl over 2.00 to 3.75 incl over 3.75 to 5.30 incl over 5.30 0.07 0.07 0.08 0.08 0.08 0.08 0.010 0.07 0.07 0.07 0.07 0.07 0.08 0.08 0.08				
over 1.00 to 2.00 incl over 2.00 to 3.75 incl over 3.75 to 5.30 incl over 5.30 0.07 0.07 0.08 0.08 0.08 0.08 0.010 0.07 0.07 0.07 0.07 0.07 0.08 0.08 0.08	Niekol	to 1.00 incl	0.02	0.02
over 2.00 to 3.75 incl over 3.75 to 5.30 incl over 5.30 0.07 0.08 0.08 0.08 0.10 0.07 0.08 0.08 0.08 0.08 0.00 0.08 0.08 0.00 Chromium to 0.90 incl over 0.90 to 2.00 incl over 2.00 to 10.00 incl over 10.00 to 15.00 incl 0.15 0.04 0.06 0.06 0.06 0.06 0.06 0.01 0.10 0.10	INICKEI			
over 3.75 to 5.30 incl over 5.30 0.08 0.08 over 5.30 0.10 0.10 Chromium to 0.90 incl over 0.90 to 2.00 incl over 2.00 to 10.00 incl over 10.00 to 15.00 incl 0.06 0.06 0.06 0.06 0.06 0.01 Molybdenum to 0.20 incl over 0.20 to 0.40 incl over 0.20 to 0.40 incl over 0.40 to 1.15 incl 0.01 0.03 0.03 0.03 0.04 0.01 0.04 Copper 0.20 minimum only to 1.00 incl over 1.00 to 2.00 incl 0.02 0.03 0.03 0.05 Titanium to 0.15 incl 0.01 ^C 0.01 0.01 Vanadium to 0.10 incl over 0.10 to 0.25 incl over 0.25 minimum only specified 0.02 0.02 0.02 0.03 minimum only specified 0.01 Boron any B B Columbium (Niobium) ^D to 0.15 incl 0.01 0.01 Zirconium to 0.15 incl 0.03 0.03 0.03				
Over 5.30 0.10 0.10 Chromium to 0.90 incl over 0.90 to 2.00 incl over 0.90 to 2.00 incl over 0.90 to 10.00 incl over 10.00 to 15.00 incl 0.10 0.10 over 10.00 to 15.00 incl 0.15 0.06 0.06 0.06 0.06 0.06 0.01 0.10 0.10				
over 0.90 to 2.00 incl over 2.00 to 10.00 incl over 10.00 to 15.00 incl 0.06 0.10 0.10 0.10 0.15 0.06 0.10 0.10 0.15 Molybdenum to 0.20 incl over 0.20 to 0.40 incl over 0.40 to 1.15 incl 0.01 0.03 0.03 0.03 0.04 0.01 0.04 Copper 0.20 minimum only to 1.00 incl over 1.00 to 2.00 incl 0.02 0.03 0.03 0.05 0.05 Titanium to 0.15 incl 0.01 ^C 0.01 0.01 0.02 0.02 0.02 0.02 0.03 minimum only specified 0.01 0.01 0.01 Boron any B B Columbium (Niobium) ^D to 0.15 incl 0.01 0.01 Zirconium to 0.15 incl 0.03 0.03 0.03				
over 0.90 to 2.00 incl over 2.00 to 10.00 incl over 10.00 to 15.00 incl 0.06 0.10 0.10 0.10 0.15 0.06 0.10 0.10 0.15 Molybdenum to 0.20 incl over 0.20 to 0.40 incl over 0.40 to 1.15 incl 0.01 0.03 0.03 0.04 0.01 0.04 Copper 0.20 minimum only to 1.00 incl over 1.00 to 2.00 incl 0.02 0.03 0.03 0.03 0.05 Titanium to 0.15 incl 0.01 ^C 0.01 0.01 0.02 0.02 0.02 0.02 0.02 0.03 minimum only specified 0.01 0.01 0.01 Boron any B B Columbium (Niobium) ^D to 0.15 incl 0.01 0.01 Zirconium to 0.15 incl 0.03 0.03 0.03	01	to 0.00 in al	0.04	0.04
over 2.00 to 10.00 incl over 10.00 to 15.00 incl 0.10 0.15 0.10 0.15 Molybdenum to 0.20 incl over 0.20 to 0.40 incl over 0.20 to 0.40 incl over 0.40 to 1.15 incl 0.01 0.03 0.03 0.04 0.03 0.03 0.03 0.03 0.03 0.03 0.05 Copper 0.20 minimum only to 1.00 incl over 1.00 to 2.00 incl 0.02 0.05 0.05 Titanium to 0.15 incl 0.01 ^C 0.01 0.01 Vanadium to 0.10 incl over 0.10 to 0.25 incl over 0.25 minimum only specified 0.02 0.02 0.03 minimum only specified 0.01 0.01 Boron any B B Columbium (Niobium) ^D to 0.10 incl 0.01 ^C 0.01 0.01 Zirconium to 0.15 incl 0.03 0.03 0.03	Chromium			
over 10.00 to 15.00 incl 0.15 0.15 Molybdenum to 0.20 incl over 0.20 to 0.40 incl over 0.20 to 0.40 incl over 0.40 to 1.15 incl 0.03				
Molybdenum to 0.20 incl over 0.20 to 0.40 incl over 0.20 to 0.40 incl over 0.40 to 1.15 incl 0.01 0.03 0.03 0.03 0.04 Copper 0.20 minimum only to 1.00 incl over 1.00 to 2.00 incl 0.03 0.03 0.03 0.05 Titanium to 0.15 incl 0.01° 0.01 Vanadium to 0.10 incl over 0.10 to 0.25 incl over 0.10 to 0.25 incl over 0.25 incl over 0.25 incl over 0.25 incl over 0.02 0.03 minimum only specified 0.01 0.01 0.01 0.01 0.01 0.01 0.01 0.01				
over 0.20 to 0.40 incl over 0.40 to 1.15 incl 0.03 0.03 Copper 0.20 minimum only to 1.00 incl over 1.00 to 2.00 incl 0.02 Titanium to 0.15 incl 0.01° 0.01 Vanadium to 0.10 incl over 0.10 to 0.25 incl over 0.25 minimum only specified 0.02 0.02 0.02 0.03 minimum only specified Boron any B B Columbium (Niobium) ^D to 0.10 incl 0.01° 0.01 Zirconium to 0.15 incl 0.03 0.03		over 10.00 to 15.00 inci	0.15	0.15
Over 0.40 to 1.15 incl 0.04 0.04 Copper 0.20 minimum only to 1.00 incl over 1.00 to 2.00 incl 0.03 o.03 o.03 o.05 Titanium to 0.15 incl 0.01 ^C o.01 Vanadium to 0.10 incl over 0.10 to 0.25 incl over 0.25 over 0.25 over 0.25 minimum only specified 0.02 o.03 over 0.03 minimum only specified Boron any B Columbium (Niobium) ^D to 0.10 incl 0.01 ^C o.01 Zirconium to 0.15 incl 0.03 o.03	Molybdenum		0.01	0.01
Copper 0.20 minimum only to 1.00 incl over 1.00 to 2.00 incl 0.03 0.03 0.03 0.05 Titanium to 0.15 incl 0.01° 0.01 Vanadium to 0.10 incl over 0.10 to 0.25 incl over 0.25 incl over 0.25 incl over 0.25 incl over 0.02 0.03 minimum only specified 0.01 0.01 0.01 0.01 0.01 Boron any B Columbium (Niobium) ^D to 0.10 incl 0.03 0.03 0.03			0.03	0.03
to 1.00 incl		over 0.40 to 1.15 incl	0.04	0.04
to 1.00 incl	Copper	0.20 minimum only	0.02	
Titanium to 0.15 incl 0.01^{C} 0.01 Vanadium to 0.10 incl over 0.10 to 0.25 incl over 0.25 minimum only specified 0.02 0.02 0.03 minimum only specified 0.02 0.03 0.01 Boron any B B Columbium (Niobium) D to 0.10 incl 0.01^{C} 0.01 Zirconium to 0.15 incl 0.03 0.03		to 1.00 incl	0.03	0.03
Vanadium to 0.10 incl over 0.10 to 0.25 incl over 0.10 to 0.25 incl over 0.25 minimum only specified 0.02 0.02 0.03 minimum only specified Boron any B Boron to 0.10 incl 0.01 C Columbium (Niobium) D to 0.15 incl 0.03 0.03		over 1.00 to 2.00 incl	0.05	0.05
$\begin{array}{cccccccccccccccccccccccccccccccccccc$	Titanium	to 0.15 incl	0.01 ^C	0.01
$\begin{array}{cccccccccccccccccccccccccccccccccccc$	Vanadium	to 0.10 incl	0.01 ^C	0.01
over 0.25 minimum only specified 0.02 0.03 minimum only specified 0.01 Boron any B B Columbium (Niobium) D to 0.10 incl 0.01 0.01 Zirconium to 0.15 incl 0.03 0.03				
minimum only specified 0.01 Boron any B B Columbium to 0.10 incl 0.01^C 0.01 (Niobium) D Zirconium to 0.15 incl 0.03 0.03				
Columbium to 0.10 incl 0.01^{C} 0.01 (Niobium) D 2irconium to 0.15 incl 0.03 0.03				
$(Niobium)^D$ Zirconium to 0.15 incl 0.03 0.03	Boron	any	В	В
	Columbium (Niobium) ^D	to 0.10 incl	0.01 ^C	0.01
Nitrogen to 0.030 incl 0.005 0.005	Zirconium	to 0.15 incl	0.03	0.03
	Nitrogen	to 0.030 incl	0.005	0.005

 $[^]A$ Permitted variations in manganese content for bars and bar size shapes shall be: to 0.90 incl ± 0.03 ; over 0.90 to 2.20 incl ± 0.06 . B Product analysis not applicable.

Index to Tables of Permitted Variations

	Tab	ole
Dimension	Inch-Pound Units	SI Units
Camber		
Plates, Carbon Steel; Sheared and Gas-Cut	12	A1.12
Plates, Carbon Steel; Universal Mill	11	A1.11
Plates, Other than Carbon Steel; Sheared,	11	A1.11
Gas-Cut and Universal Mill		
Shapes, Rolled; S, M, C, MC, and L	21	A1.21
Shapes, Rolled; W and HP	24	A1.24
Shapes, Split; L and T	25	A1.25
Cross Section of Shapes and Bars		
Flats	26	A1.26
Hexagons	28	A1.28
Rounds and Squares	27	A1.27
Shapes, Rolled; L, Bulb Angles, and Z	17	A1.17
Shapes, Rolled; W, HP, S, M, C, and MC	16	A1.16
Shapes, Rolled; T	18	A1.18
Shapes, Split; L and T	25	A1.25
Diameter Plates Charred	6	A1.6
Plates, Sheared	7	A1.6 A1.7
Plates, Other than Alloy Steel, Gas-Cut	10	A1.7 A1.10
Plates, Alloy Steel, Gas-Cut Rounds	27	A1.10
End Out-of-Square	21	A1.27
Shapes, Other than W	20	A1.20
Shapes, W	22	A1.22
Shapes, Milled, Other than W	23	A1.23
Flatness	20	A1.20
Plates, Carbon Steel	13	A1.13
Plates, Other than Carbon Steel	14	A1.14
Plates, Restrictive—Carbon Steel	S27.1	S27.2
Plates, Restrictive—Other than Carbon Steel	S27.3	S27.4
Length		
Bars	30	A1.30
Bars, Recut	31	A1.31
Plates, Sheared and Universal Mill	3	A1.3
Plates, Other than Alloy Steel, Gas-Cut	9	A1.9
Plates, Alloy Steel, Gas-Cut	8	A1.8
Plates, Mill Edge	4	A1.4
Shapes, Rolled; Other than W	19	A1.19
Shapes, Rolled; W and HP	22	A1.22
Shapes, Split; L and T	25	A1.25
Shapes, Milled	23	A1.23
Straightness		
Bars	29	A1.29
Shapes, Other than W	21	A1.21
Sweep		
Shapes, W and HP	24	A1.24
Thickness		
Flats	26	A1.26
Plates, Ordered to Thickness	1	A1.1
Waviness		
Plates	15	A1.15
Weight [Mass]		
Plates, Ordered to Weight [Mass]	2	A1.2
Width		
Flats	26	A1.26
Plates, Sheared	3	A1.3
Plates, Universal Mill	5	A1.5
Plates, Other than Alloy Steel, Gas-Cut	9	A1.9
Plates, Alloy Steel, Gas-Cut	8	A1.8
Plates, Mill Edge	4	A1.4

8.3.2.4 Contents for the combination of two or more austenitic grain refining elements that exceed the applicable minimum values agreed to by the purchaser as being sufficient for austenitic grain size testing to be waived.

9. Quality

9.1 General—Structural products shall be free of injurious defects and shall have a workmanlike finish.

 $^{^{\}it C}$ 0.005, if the minimum of the range is 0.01 %.

 $^{^{\}it D}$ Columbium and niobium are interchangeable names for the same element.

Note 5—Unless otherwise specified, structural products are normally furnished in the as-rolled condition and are subjected to visual inspection by the manufacturer or processor. Non-injurious surface or internal imperfections, or both, may be present in the structural product as delivered and the structural product may require conditioning by the purchaser to improve its appearance or in preparation for welding, coating, or other further operations.

More restrictive requirements may be specified by invoking supplementary requirements or by agreement between the purchaser and the supplier.

Structural products that exhibit injurious defects during subsequent fabrication are deemed not to comply with the applicable product specification. (See 17.2.) Fabricators should be aware that cracks may initiate upon bending a sheared or burned edge during the fabrication process; this is not considered to be a fault of the steel but is rather a function of the induced cold-work or the heat-affected zone.

The conditioning requirements in 9.2, 9.3, and 9.4 limit the conditioning allowed to be performed by the manufacturer or processor. Conditioning of imperfections beyond the limits of 9.2, 9.3, and 9.4 may be performed by parties other than the manufacturer or processor at the discretion of the purchaser.

9.2 Plate Conditioning:

- 9.2.1 The grinding of plates by the manufacturer or processor to remove imperfections on the top or bottom surface shall be subject to the limitations that the area ground is well faired without abrupt changes in contour and the grinding does not reduce the thickness of the plate by (I) more than 7% under the nominal thickness for plates ordered to weight per square foot or mass per square metre, but in no case more than $\frac{1}{8}$ in. [3 mm]; or (2) below the permissible minimum thickness for plates ordered to thickness in inches or millimetres.
- 9.2.2 The deposition of weld metal (see 9.5) following the removal of imperfections on the top or bottom surface of plates by chipping, grinding, or arc-air gouging shall be subject to the following limiting conditions:
- 9.2.2.1 The chipped, ground, or gouged area shall not exceed 2% of the area of the surface being conditioned.
- 9.2.2.2 After removal of any imperfections preparatory to welding, the thickness of the plate at any location shall not be reduced by more than 30 % of the nominal thickness of the plate. (Specification A131/A131M restricts the reduction in thickness to 20 % maximum.)
- 9.2.3 The deposition of weld metal (see 9.5) following the removal of injurious imperfections on the edges of plates by grinding, chipping, or arc-air gouging by the manufacturer or processor shall be subject to the limitation that, prior to welding, the depth of the depression, measured from the plate edge inward, is not more than the thickness of the plate or 1 in. [25 mm], whichever is the lesser.
- 9.3 Structural Size Shapes, Bar Size Shapes, and Sheet Piling Conditioning:
- 9.3.1 The grinding, or chipping and grinding, of structural size shapes, bar size shapes, and sheet piling by the manufacturer or processor to remove imperfections shall be subject to the limitations that the area ground is well faired without abrupt changes in contour and the depression does not extend below the rolled surface by more than (1) $\frac{1}{32}$ in. [1 mm], for material less than $\frac{3}{8}$ in. [10 mm] in thickness; (2) $\frac{1}{16}$ in. [2 mm], for material $\frac{3}{8}$ to 2 in. [10 to 50 mm] inclusive in thickness; or (3) $\frac{1}{8}$ in. [3 mm], for material over 2 in. [50 mm] in thickness.

- 9.3.2 The deposition of weld metal (see 9.5) following removal of imperfections that are greater in depth than the limits listed in 9.3.1 shall be subject to the following limiting conditions:
- 9.3.2.1 The total area of the chipped or ground surface of any piece prior to welding shall not exceed 2% of the total surface area of that piece.
- 9.3.2.2 The reduction of thickness of the material resulting from removal of imperfections prior to welding shall not exceed 30 % of the nominal thickness at the location of the imperfection, nor shall the depth of depression prior to welding exceed 1½ in. [32 mm] in any case except as noted in 9.3.2.3.
- 9.3.2.3 The deposition of weld metal (see 9.5) following grinding, chipping, or arc-air gouging of the toes of angles, beams, channels, and zees and the stems and toes of tees shall be subject to the limitation that, prior to welding, the depth of the depression, measured from the toe inward, is not more than the thickness of the material at the base of the depression or ½ in. [12.5 mm], whichever is the lesser.
- 9.3.2.4 The deposition of weld metal (see 9.5) and grinding to correct or build up the interlock of any sheet piling section at any location shall be subject to the limitation that the total surface area of the weld not exceed 2% of the total surface area of the piece.

9.4 Bar Conditioning:

- 9.4.1 The conditioning of bars by the manufacturer or processor to remove imperfections by grinding, chipping, or some other means shall be subject to the limitations that the conditioned area is well faired and the affected sectional area is not reduced by more than the applicable permitted variations (see Section 12).
- 9.4.2 The deposition of weld metal (see 9.5) following chipping or grinding to remove imperfections that are greater in depth than the limits listed in 9.4.1 shall be subject to the following conditions:
- 9.4.2.1 The total area of the chipped or ground surface of any piece, prior to welding, shall not exceed 2% of the total surface area of the piece.
- 9.4.2.2 The reduction of sectional dimension of a round, square, or hexagon bar, or the reduction in thickness of a flat bar, resulting from removal of an imperfection, prior to welding, shall not exceed 5 % of the nominal dimension or thickness at the location of the imperfection.
- 9.4.2.3 For the edges of flat bars, the depth of the conditioning depression prior to welding shall be measured from the edge inward and shall be limited to a maximum depth equal to the thickness of the flat bar or $\frac{1}{2}$ in. [12.5 mm], whichever is less.

9.5 Repair by Welding:

- 9.5.1 General Requirements:
- 9.5.1.1 Repair by welding shall be in accordance with a welding procedure specification (WPS) using shielded metal arc welding (SMAW), gas metal arc welding (GMAW), flux cored arc welding (FCAW), or submerged arc welding (SAW) processes. Shielding gases used shall be of welding quality.
- 9.5.1.2 Electrodes and electrode-flux combinations shall be in accordance with the requirements of AWS Specifications A5.1/A5.1M, A5.5/A5.5M, A5.17/A5.17M, A5.18/A5.18M,

- A5.20/A5.20M, A5.23/A5.23M, A5.28/A5.28M, or A5.29/A5.29M, whichever is applicable. For SMAW, low hydrogen electrodes shall be used.
- 9.5.1.3 Electrodes and electrode-flux combinations shall be selected so that the tensile strength of the deposited weld metal (after any required heat treatment) is consistent with the tensile strength specified for the base metal being repaired.
- 9.5.1.4 Welding electrodes and flux materials shall be dry and protected from moisture during storage and use.
- 9.5.1.5 Prior to repair welding, the surface to be welded shall be inspected to verify that the imperfections intended to be removed have been removed completely. Surfaces to be welded and surfaces adjacent to the weld shall be dry and free of scale, slag, rust, moisture, grease, and other foreign material that would prevent proper welding.
- 9.5.1.6 Welders and welding operators shall be qualified in accordance with the requirements of AWS D1.1/D1.1M or ASME Boiler and Pressure Vessel Code, Section IX, except that any complete joint penetration groove weld qualification also qualifies the welder or welding operator to do repair welding.
- 9.5.1.7 Repair welding of structural products shall be in accordance with a welding procedure specification (WPS) that is in accordance with the requirements of AWS D1.1/D1.1M or ASME Boiler and Pressure Vessel Code, Section IX, with the following exceptions or clarifications:
- (1) The WPS shall be qualified by testing a complete joint penetration groove weld or a surface groove weld.
- (2) The geometry of the surface groove weld need not be described in other than a general way.
- (3) An AWS D1.1/D1.1M prequalified complete joint penetration groove weld WPS is acceptable.
- (4) Any material not listed in the prequalified base metal-filler metal combinations of AWS D1.1/D1.1M also is considered to be prequalified if its chemical composition and mechanical properties are comparable to those for one of the prequalified base metals listed in AWS D1.1/D1.1M.
- 9.5.1.8 When so specified in the purchase order, the WPS shall include qualification by Charpy V-notch testing, with the test locations, test conditions, and the acceptance criteria meeting the requirements specified for repair welding in the purchase order.
- 9.5.1.9 When so specified in the purchase order, the welding procedure specification shall be subject to approval by the purchaser prior to repair welding.
- 9.5.2 Structural Products with a Specified Minimum Tensile Strength of 100 ksi [690 MPa] or Higher—Repair welding of structural products with a specified minimum tensile strength of 100 ksi [690 MPa] or higher shall be subject to the following additional requirements:
- 9.5.2.1 When so specified in the purchase order, prior approval for repair by welding shall be obtained from the purchaser.
- 9.5.2.2 The surface to be welded shall be inspected using a magnetic particle method or a liquid penetrant method to verify that the imperfections intended to be removed have been completely removed. When magnetic particle inspection is

- employed, the surface shall be inspected both parallel and perpendicular to the length of the area to be repaired.
- 9.5.2.3 When weld repairs are to be post-weld heat-treated, special care shall be exercised in the selection of electrodes to avoid those compositions that embrittle as a result of such heat treatment.
- 9.5.2.4 Repairs on structural products that are subsequently heat-treated at the mill shall be inspected after heat treatment; repairs on structural products that are not subsequently heat-treated at the mill shall be inspected no sooner than 48 h after welding. Such inspection shall use a magnetic particle method or a liquid penetrant method; where magnetic particle inspection is involved, such inspection shall be both parallel to and perpendicular to the length of the repair.
- 9.5.2.5 The location of the weld repairs shall be marked on the finished piece.
- 9.5.3 Repair Quality—The welds and adjacent heat-affected zone shall be sound and free of cracks, the weld metal being thoroughly fused to all surfaces and edges without undercutting or overlap. Any visible cracks, porosity, lack of fusion, or undercut in any layer shall be removed prior to deposition of the succeeding layer. Weld metal shall project at least ½ in. (2 mm) above the rolled surface after welding, and the projecting metal shall be removed by chipping or grinding, or both, to make it flush with the rolled surface, and to produce a workmanlike finish.
- 9.5.4 *Inspection of Repair*—The manufacturer or processor shall maintain an inspection program to inspect the work to see that:
 - 9.5.4.1 Imperfections have been completely removed.
- 9.5.4.2 The limitations specified above have not been exceeded.
- 9.5.4.3 Established welding procedures have been followed, and
- 9.5.4.4 Any weld deposit is of acceptable quality as defined above.

10. Test Methods

- 10.1 All tests shall be conducted in accordance with Test Methods and Definitions A370.
- 10.2 Yield strength shall be determined either by the 0.2 % offset method or by the 0.5 % extension under load method, unless otherwise stated in the material specification.
- 10.3 Rounding Procedures—For purposes of determining conformance with the specification, a calculated value shall be rounded to the nearest 1 ksi [5 MPa] tensile and yield strength, and to the nearest unit in the right-hand place of figures used in expressing the limiting value for other values in accordance with the rounding method given in Practice E29.
- 10.4 For full-section test specimens of angles, the cross-sectional area used for calculating the yield and tensile strengths shall be a theoretical area calculated on the basis of the weight of the test specimen (see 12.1).

11. Tension Tests

11.1 Condition—Test specimens for non-heat-treated structural products shall be taken from test coupons that are representative of the structural products in their delivered

condition. Test specimens for heat-treated structural products shall be taken from test coupons that are representative of the structural products in their delivered condition, or from separate pieces of full thickness or full section from the same heat similarly heat treated.

- 11.1.1 Where the plate is heat treated with a cooling rate faster than still-air cooling from the austenitizing temperature, one of the following shall apply in addition to other requirements specified herein:
- 11.1.1.1 The gage length of the tension test specimen shall be taken at least 1T from any as-heat treated edge where T is the thickness of the plate and shall be at least $\frac{1}{2}$ in. [12.5 mm] from flame cut or heat-affected-zone surfaces.
- 11.1.1.2 A steel thermal buffer pad, 1 T by 1T by at least 3T, shall be joined to the plate edge by a partial penetration weld completely sealing the buffered edge prior to heat treatment.
- 11.1.1.3 Thermal insulation or other thermal barriers shall be used during the heat treatment adjacent to the plate edge where specimens are to be removed. It shall be demonstrated that the cooling rate of the tension test specimen is no faster than, and not substantially slower than, that attained by the method described in 11.1.1.2.
- 11.1.1.4 When test coupons cut from the plate but heat treated separately are used, the coupon dimensions shall be not less than 3T by 3T by T and each tension specimen cut from it shall meet the requirements of 11.1.1.1.
- 11.1.1.5 The heat treatment of test specimens separately in the device shall be subject to the limitations that (I) cooling rate data for the plate are available; (2) cooling rate control devices for the test specimens are available; and, (3) the method has received prior approval by the purchaser.
- 11.2 Orientation—For plates wider than 24 in. [600 mm], test specimens shall be taken such that the longitudinal axis of the test specimen is transverse to the final direction of rolling of the plate. Test specimens for all other structural products shall be taken such that the longitudinal axis of the test specimen is parallel to the final direction of rolling.
 - 11.3 Location:
- 11.3.1 *Plates*—Test specimens shall be taken from a corner of the plate.
- 11.3.2 W and HP Shapes with Flanges 6 in. [150 mm] or Wider—Test specimens shall be selected from a point in the flange ²/₃ of the way from the flange centerline to the flange toe.
- 11.3.3 Shapes Other Than Those in 11.3.2—Test specimens shall be selected from the webs of beams, channels, and zees; from the stems of rolled tees; and from the legs of angles and bulb angles, except where full-section test specimens for angles are used and the elongation acceptance criteria are increased accordingly. (See 11.6.2.)
 - 11.3.4 Bars:
- 11.3.4.1 Test specimens for bars to be used for pins and rollers shall be taken so that the axis is: midway between the center and the surface for pins and rollers less than 3 in. [75 mm] in diameter; 1 in. [25 mm] from the surface for pins and rollers 3 in. [75 mm] and over in diameter; or as specified in

- Annex A1 of Test Methods and Definitions A370 if the applicable foregoing requirement is not practicable.
- 11.3.4.2 Test specimens for bars other than those to be used for pins and rollers shall be taken as specified in Annex A1 of Test Methods and Definitions A370.
 - 11.4 Test Frequency:
- 11.4.1 Structural Products Produced from an As-Rolled Structural Product—The minimum number of pieces or plates-as-rolled to be tested for each heat and strength gradation, where applicable, shall be as follows, except that it shall be permissible for any individual test to represent multiple strength gradations:
 - 11.4.1.1 As given in Table B, or
- 11.4.1.2 One taken from the minimum thickness in the heat and one taken from the maximum thickness in the heat, where thickness means the specified thickness, diameter, or comparable dimension, whichever is appropriate for the applicable structural product rolled.
- 11.4.2 Structural Products Produced from Coil and Furnished without Heat Treatment or with Stress Relieving Only:
- 11.4.2.1 Except as allowed by 11.4.4, the minimum number of coils to be tested for each heat and strength gradation, where applicable, shall be as given in Table C, except that it shall be permissible for any individual coil to represent multiple strength gradations.
- 11.4.2.2 Except as required by 11.4.2.3, two tension test specimens shall be taken from each coil tested, with the first being taken immediately prior to the first structural product to be qualified, and the second being taken from the approximate center lap.
- 11.4.2.3 If, during decoiling, the amount of material decoiled is less than that required to reach the approximate center lap, the second test for the qualification of the decoiled portion of such a coil shall be taken from a location adjacent to the end of the innermost portion decoiled. For qualification of successive portions from such a coil, an additional test shall be taken adjacent to the innermost portion decoiled, until a test is obtained from the approximate center lap.
- 11.4.3 Structural Products Produced from Coil and Furnished Heat Treated by other than Stress Relieving—The minimum number of pieces to be tested for each heat and strength gradation, where applicable, shall be as follows, except that it shall be permissible for any individual test to represent multiple strength gradations:
 - 11.4.3.1 As given in Table B, or
- 11.4.3.2 One taken from the minimum thickness in the heat and one taken from the maximum thickness in the heat, where thickness means the specified thickness, diameter, or comparable dimension, whichever is appropriate for the applicable structural product rolled.
- 11.4.4 Structural Products Produced from Coil and Qualified Using Test Specimens Heat Treated by Other than Stress Relieving—The minimum number of pieces to be tested for each heat and strength gradation, where applicable, shall be as follows, except that it shall be permissible for any individual test to represent multiple strength gradations:

TABLE B Minimum Number of Tension Tests Required

Thickness ^A Range Rolled for the Heat	Thickness ^A Difference Between Pieces or Plates-as-rolled in the Thickness ^A Range	Minimum Number of Tension Tests Required
Under % in. [10 mm]	$1/_{16}$ in. [2 mm] or less	Two ^B tests per heat, taken from different pieces or plates-as-rolled having any thickness ^A in the thickness ^A range
	More than 1/16 in. [2 mm]	Two ^B tests per heat, one taken from the minimum thickness ^A in the thickness ^A range and one taken from the maximum thickness ^A in the thickness ^A range
% to 2 in. [10 to 50 mm], incl	Less than % in. [10 mm]	Two ^B tests per heat, taken from different pieces or plates-as-rolled having any thickness ^A in the thickness ^A range
	% in. [10 mm] or more	Two ^B tests per heat, one taken from the minimum thickness ^A in the thickness ^A range and one taken from the maximum thickness ^A in the thickness ^A range
Over 2 in. [50 mm]	Less than 1 in. [25 mm]	Two ^B tests per heat, taken from different pieces or plates-as-rolled having any thickness ^A in the thickness ^A range
	1 in. [25 mm] or more	Two ^ś tests per heat, one taken from the minimum thickness ^A in the thickness ^A range and one taken from the maximum thickness ^A in the thickness ^A range

A Thickness means the specified thickness, diameter, or comparable dimension, whichever is appropriate for the specific structural product rolled.

TABLE C Minimum Number of Coils Required to be Tension Tested

Note 1—See 11.4.2.2 and 11.4.2.3 for the number of tests to be taken per coil.

$Thickness^A$ $Difference$ $Between$ $Coils$ in the $Heat$	Minimum Number of Coils Required to be Tension Tested
Less than 1/16 in. [2 mm] 1/16 in. [2 mm] or more	Two ^B coils per heat, at any thickness ^A in the heat Two ^B coils per heat, one at the minimum thickness ^A in the heat and one at the maximum thickness ^A in the heat

A Thickness means the specified thickness, diameter, or comparable dimension, whichever is appropriate for the specific structural product rolled.

11.4.4.1 As given in Table B, or

11.4.4.2 One taken from the minimum thickness in the heat, where thickness means the specified thickness, diameter, or comparable dimension, whichever is appropriate for the applicable structural product rolled.

11.5 Preparation:

11.5.1 Plates:

11.5.1.1 Tension test specimens for plates $\frac{3}{4}$ in. [20 mm] and under in thickness shall be the full thickness of the plates. The test specimens shall conform to the requirements shown in Fig. 3 of Test Methods and Definitions A370 for either the $\frac{1}{2}$ -in. [40-mm] wide test specimen or the $\frac{1}{2}$ -in. [12.5-mm] wide test specimen.

11.5.1.2 For plates up to 4 in. [100 mm] inclusive, in thickness, the use of $1\frac{1}{2}$ -in. [40-mm] wide test specimens, full thickness of the plate and conforming to the requirements shown in Fig. 3 of Test Methods and Definitions A370, shall be subject to the limitation that adequate testing machine capacity is available.

11.5.1.3 For plates over ¾ in. [20 mm] in thickness, except as permitted in 11.5.1.2, tension test specimens shall conform to the requirements shown in Fig. 4 of Test Methods and Definitions A370 for the 0.500-in. [12.5-mm] diameter test specimen. The axis of such test specimens shall be located midway between the center of thickness and the top or bottom surface of the plate.

11.5.2 Shapes:

11.5.2.1 Except where angles are tested in full section, tension test specimens for shapes ³/₄ in. [20 mm] and under in thickness shall be the full thickness of the shape. Such test specimen shall conform to the requirements shown in Fig. 3 of

Test Methods and Definitions A370 for either the $1\frac{1}{2}$ -in. [40-mm] wide test specimen or the $\frac{1}{2}$ -in. [12.5-mm] wide test specimen.

11.5.2.2 For shapes up to 5 in. [125 mm] inclusive, in thickness, the use of 1½-in. [40-mm] wide test specimens, full thickness of the shape and conforming to the requirements shown in Fig. 3 of Test Methods and Definitions A370, shall be subject to the limitation that adequate testing machine capacity is available.

11.5.2.3 For shapes over ¾ in. [20 mm] in thickness, except as permitted in 11.5.2.2, tension test specimens shall conform to the requirements shown in Fig. 4 of Test Methods and Definitions A370 for the 0.500-in. [12.5-mm] diameter test specimens. The axis of such test specimens shall be located midway between the center of thickness and the top or bottom surface of the shape.

11.5.3 Bars:

11.5.3.1 Except as otherwise provided below, test specimens for bars shall be in accordance with Annex A1 of Test Methods and Definitions A370.

11.5.3.2 Except as provided in 11.5.3.5, test specimens for bars $\frac{3}{4}$ in. [20 mm] and under in thickness shall conform to the requirements shown in Fig. 3 of Test Methods and Definitions A370 for either the $\frac{1}{2}$ -in. [40-mm] wide test specimen or the $\frac{1}{2}$ -in. [12.5-mm] wide specimen.

11.5.3.3 Except as provided in 11.5.3.4 and 11.5.3.5, test specimens for bars over ³/₄ in. [20 mm] in thickness or diameter shall conform either to the requirements for the 1½-in. [40-mm] or ½-in. [12.5-mm] wide test specimen shown in Fig. 3 of Test Methods and Definitions A370, or to the requirements for the 0.500-in. [12.5-mm] diameter test specimen shown in Fig. 4 of Test Methods and Definitions A370.

^B One test, if only one piece or plate-as-rolled is to be qualified.

^B One coil, if the product of only one coil is to be qualified.

- 11.5.3.4 For bars other than those to be used for pins and rollers, the manufacturer or processor shall have the option of using test specimens that are machined to a thickness or diameter of at least ³/₄ in. [20 mm] for a length of at least 9 in. [230 mm].
- 11.5.3.5 Test specimens for bars to be used for pins and rollers shall conform to the requirements shown in Fig. 4 of Test Methods and Definitions A370 for the 0.500-in. [12.5-mm] diameter test specimen.

11.6 Elongation Requirement Adjustments:

11.6.1 Due to the specimen geometry effect encountered when using the rectangular tension test specimen for testing thin material, adjustments in elongation requirements must be provided for thicknesses under 0.312 in. [8 mm]. Accordingly, the following deductions from the base elongation requirements shall apply:

Nominal Thickness Range,	Elongation
in. [mm]	Deduction, %
0.299-0.311 [7.60-7.89]	0.5
0.286-0.298 [7.30-7.59]	1.0
0.273-0.285 [7.00-7.29]	1.5
0.259-0.272 [6.60-6.99]	2.0
0.246-0.258 [6.20-6.59]	2.5
0.233-0.245 [5.90-6.19]	3.0
0.219-0.232 [5.50-5.89]	3.5
0.206-0.218 [5.20-5.49]	4.0
0.193-0.205 [4.90-5.19]	4.5
0.180-0.192 [4.60-4.89]	5.0
0.166-0.179 [4.20-4.59]	5.5 ^A
0.153-0.165 [3.90-4.19]	6.0 ^A
0.140-0.152 [3.60-3.89]	6.5 ^A
0.127-0.139 [3.20-3.59]	7.0 ^A
< 0.127 [3.20]	7.5 ^A

 $^{^{\!} A}$ Elongation deductions for thicknesses less than 0.180 in. [4.60 mm] apply to plates and structural shapes only.

- 11.6.2 Due to the specimen geometry effect encountered when using full-section test specimens for angles, the elongation requirements for structural-size angles shall be increased by six percentage points when full-section test specimens are used.
- 11.6.3 Due to the inherently lower elongation that is obtainable in thicker structural products, adjustments in elongation requirements shall be provided. For structural products over 3.5 in. [90 mm] in thickness, a deduction of 0.5 percentage point from the specified percentage of elongation in 2 in. [50 mm] shall be made for each 0.5-in. [12.5-mm] increment of thickness over 3.5 in. [90 mm], up to a maximum deduction of 3.0 percentage points. Accordingly, the following deductions from the base elongation requirements shall apply:

Nominal Thickness Range,	Elongation
in. [mm]	Deduction, %
3.500-3.999 [90.00-102.49]	0.5
4.000-4.499 [102.50-114.99]	1.0
4.500-4.999 [115.00-127.49]	1.5
5.000-5.499 [127.50-139.99]	2.0
5.500-5.999 [140.00-152.49]	2.5
5.000 and thicker [152.50 and thicker]	3.0

11.6.4 The tensile property requirements tables in many of the product specifications covered by this general requirements specification specify elongation requirements in both 8-in. [200-mm] and 2-in. [50-mm] gage lengths. Unless otherwise

provided in the applicable product specification, both requirements are not required to be applied simultaneously and the elongation need only be determined in the gage length appropriate for the test specimen used. After selection of the appropriate gage length, the elongation requirement for the alternative gage length shall be deemed not applicable.

- 11.7 Yield Strength Application:
- 11.7.1 When test specimens do not exhibit a well-defined disproportionate yield point, yield strength shall be determined and substituted for yield point.
- 11.7.2 The manufacturer or processor shall have the option of substituting yield strength for yield point if the test specimen exhibits a well-defined disproportionate yield point.
- 11.7.3 Yield strength shall be determined either by the $0.2\,\%$ offset method or by the $0.5\,\%$ extension-under-load method.
- 11.8 *Product Tension Tests*—This specification does not provide requirements for product tension testing subsequent to shipment (see 15.1). Therefore, the requirements of 11.1 11.7 inclusive and Section 13 apply only for tests conducted at the place of manufacture prior to shipment.

Note 6—Compliance to this specification and the applicable product specification by a manufacturer or processor does not preclude the possibility that product tension test results might vary outside specified ranges. The tensile properties will vary within the same heat or piece, be it as-rolled, control-rolled, or heat-treated. Tension testing according to the requirements of this specification does not provide assurance that all products of a heat will be identical in tensile properties with the products tested. If the purchaser wishes to have more confidence than that provided by this specification testing procedures, additional testing or requirements, such as Supplementary Requirement S4, should be imposed.

11.8.1 Appendix X2 provides additional information on the variability of tensile properties in plates and structural shapes

12. Permitted Variations in Dimensions and Weight [Mass]

- 12.1 One cubic foot of rolled steel is assumed to weigh 490 lb. One cubic metre of rolled steel is assumed to have a mass of 7850 kg.
- 12.2 *Plates*—The permitted variations for dimensions and weight [mass] shall not exceed the applicable limits in Tables 1 to 15 [Annex A1, Tables A1.1 to A1.15] inclusive.
 - 12.3 Shapes:
- 12.3.1 Annex A2 lists the designations and dimensions, in both inch-pound and SI units, of shapes that are most commonly available. Radii of fillets and toes of shape profiles vary with individual manufacturers and therefore are not specified.
- 12.3.2 The permitted variations in dimensions shall not exceed the applicable limits in Tables 16 to 25 [Annex A1, Tables A1.16 to A1.25] inclusive. Permitted variations for special shapes not listed in such tables shall be as agreed upon between the manufacturer and the purchaser.

Note 7—Permitted variations are given in Tables 16 to 25 [Annex A1, Tables A1.16 to A1.25] inclusive for some shapes that are not listed in Annex A2 (that is, bulb angles, tees, zees). Addition of such sections to Annex A2 will be considered by Subcommittee A01.02 when and if a need for such listing is shown.

- 12.3.3 Shapes Having One Dimension of the Cross Section 3 in. [75 mm] or Greater (Structural-Size Shapes)—The cross-sectional area or weight [mass] of each shape shall be within ±2.5 % of the theoretical or specified amounts except for shapes with a nominal weight of less than 100 lb/ft [149 kg/m], in which the variation shall be within -2.5 % to +3.0 % of the theoretical cross-sectional area or the specified nominal weight [mass].
- 12.4 Sheet Piling—The weight [mass] of each steel sheet pile shall be within ± 2.5 % of the theoretical or specified weight [mass]. The length of each steel sheet pile shall be not less than the specified length, and not more than 5 in. [125 mm] over the specified length.
- 12.5 *Hot-Rolled Bars*—The permitted variations in dimensions shall not exceed the applicable limits in Tables 26 to 31 [Annex A1, Tables A1.26 to A1.31] inclusive.
- 12.6 Conversion of Permitted Variations from Fractions of an Inch to Decimals—Permitted variations in dimensions for products covered by this specification are generally given as fractions of an inch and these remain the official permitted variations, where so stated. If the material is to be measured by equipment reporting dimensions as decimals, conversion of permitted variations from fractions of an inch to decimals shall be made to three decimal places; using the rounding method prescribed in Practice E29.

13. Retests

- 13.1 If any test specimen shows defective machining or develops flaws, the manufacturer or processor shall have the option of discarding it and substituting another test specimen.
- 13.2 If the percentage of elongation of any tension test specimen is less than that specified and any part of the fracture is more than ³/₄ in. [20 mm] from the center of the gage length of a 2-in. [50-mm] specimen or is outside the middle half of the gage length of an 8-in. [200-mm] specimen, as indicated by scribe scratches marked on the specimen before testing, a retest shall be allowed.
- 13.3 Except as provided in 13.3.1, if the results from an original tension specimen fails to meet the specified requirements, but are within 2 ksi [14 MPa] of the required tensile strength, within 1 ksi [7 MPa] of the required yield strength or yield point, or within 2 percentage points of the required elongation, a retest shall be permitted to replace the failing test. A retest shall be performed for the failing original test, with the specimen being randomly selected from the heat. If the results of the retest meet the specified requirements, the heat or lot shall be approved.
- 13.3.1 For structural products that are tested as given in Table C, both tests from each coil tested to qualify a heat are required to meet all mechanical property requirements. Should either test fail to do so, then that coil shall not be used to qualify the heat; however, the portion of that individual coil that is bracketed by acceptable tests (see 11.4.2.3) is considered to be qualified.
- 13.4 Quenched and tempered steel plates shall be subject to any additional retest requirements contained in the applicable product specification.

13.5 When the full-section option of 11.3.3 is used and the elongation falls below the specified requirement, the manufacturer or processor shall have the option of making another test using a test specimen permitted in 11.5.2.

14. Test Reports

- 14.1 Test reports for each heat supplied are required and they shall report the following:
- 14.1.1 The applicable product specification designation, including year-date and whichever of grade, class, and type are specified in the purchase order, to which the structural product is furnished.
- 14.1.2 The heat number, heat analysis (see 7.1), and nominal sizes.

Note 8—If the amount of copper, chromium, nickel, molybdenum, or silicon is less than 0.02 %, the heat analysis for that element may be reported as <0.02 %. If the amount of columbium (niobium) or vanadium is less than 0.008 %, the heat analysis for that element may be reported as <0.008 %.

- 14.1.3 For structural products that are tested as given in Table B, two tension test results appropriate to qualify the shipment (see 11.4), except that only one tension test result need be reported if the shipment consists of a single piece or plate-as-rolled.
- 14.1.3.1 In reporting elongation values, both the percentage increase and the original gage length shall be stated.
- 14.1.3.2 Yield to tensile ratio when such a requirement is contained in the product specification.
- 14.1.4 For structural products that are required to be heat treated, either by the applicable product specification or by the purchase order, all heat treatments, including temperature ranges and times at temperature, unless the purchaser and the supplier have agreed to the supply of a heat treatment procedure in place of the actual temperatures and times.
- 14.1.4.1 Subcritical heat treatment to soften thermally cut edges need not be reported, except for structural products having a specified minimum tensile strength of 95 ksi [655 MPa] or higher, unless such subcritical heating is accomplished at temperatures at least 75°F [40°C] lower than the minimum tempering temperature.
- 14.1.5 The results of any required austenitic grain size tests (see 8.2 or 8.3, whichever is applicable).
- 14.1.6 The results of any other test required by the applicable product specification, the applicable supplementary requirements, and the purchase order.
- 14.2 The thickness of the structural product tested is not necessarily the same as an individual ordered thickness, given that it is the heat that is tested, rather than each ordered item. Tests from specified thicknesses in accordance with 11.4 and encompassing the thicknesses in a shipment shall be sufficient for qualifying the structural product in the shipment. Such test thicknesses are not required to be within previously tested and shipped thicknesses from the same heat.
- 14.3 For structural products produced from coil that are supplied in the as-rolled condition or have been heat treated by stress relieving only, the test report shall state "Produced from

Coil." Both test results shall be reported for each qualifying coil, and the location within the coil for each test shall be stated.

- 14.4 For structural products produced from coil, both the manufacturer and the processor shall be identified on the test report.
- 14.5 When full-section test specimens have been used for the qualification of angles, that information shall be stated on the test report.
- 14.6 A signature is not required on the test report; however, the document shall clearly identify the organization submitting the report. Notwithstanding the absence of a signature, the organization submitting the report is responsible for the content of the report.
- 14.7 For structural products finished by other than the original manufacturer, the supplier of the structural product shall also provide the purchaser with a copy of the original manufacturer's test report.
- 14.8 A test report, certificate of inspection, or similar document printed from or used in electronic form from an electronic data interchange (EDI) transmission shall be regarded as having the same validity as a counterpart printed in the certifier's facility. The content of the EDI transmitted document shall meet the requirements of the applicable product specification and shall conform to any existing EDI agreement between the purchaser and the supplier. Notwithstanding the absence of a signature, the organization submitting the EDI transmission shall be responsible for the content of the report.

Note 9—The industry definition as invoked here is: EDI is the computer to computer exchange of business information in a standard format such as ANSI ASC X12.

15. Inspection and Testing

- 15.1 The inspector representing the purchaser shall have free entry, at all times, while work on the contract of the purchaser is being performed, to all parts of the manufacturer's works that concern the manufacture of the structural product ordered. The manufacturer shall afford the inspector all reasonable facilities to be satisfied that the structural product is being furnished in accordance with this general requirements specification, the applicable product specification, and the purchase order. All tests (except product analysis) and inspection shall be made at the place of manufacture prior to shipment, unless otherwise specified, and shall be conducted so as not to interfere with the operation of the manufacturer's works
- 15.2 Where structural products are produced from coil, 15.1 shall apply to the processor instead of the manufacturer, and the place of process shall apply instead of the place of manufacture. Where structural products are produced from coil and the processor is different from the manufacturer, the inspector representing the purchaser shall have free entry at all times while work on the contract of the purchaser is being performed to all parts of the manufacturer's works that concern the manufacture of the structural product ordered.

16. Retreatment

16.1 If any heat-treated structural product fails to meet the mechanical property requirements of the applicable product specification, the manufacturer or the processor shall have the option of heat treating the structural product again. All mechanical property tests shall be repeated and the structural product shall be reexamined for surface defects when it is resubmitted for inspection.

17. Rejection

- 17.1 Any rejection based upon product analysis made in accordance with the applicable product specification shall be reported to the supplier and samples that represent the rejected structural product shall be preserved for two weeks from the date of notification of such rejection. In case of dissatisfaction with the results of the tests, the supplier shall have the option of making claim for a rehearing within that time.
- 17.2 The purchaser shall have the option of rejecting structural product that exhibits injurious defects subsequent to its acceptance at the manufacturer's or processor's works, and so notifying the manufacturer or processor.

18. Identification of Structural Products

- 18.1 Required Plate Markings:
- 18.1.1 Except as allowed by 18.1.4.2 and 18.6, plates shall be legibly marked with the following: applicable ASTM designation (see 1.1) (year-date not required); "G" or "MT" if applicable (see 18.1.2); applicable grade; heat number; size and thickness; and name, brand, or trademark of the manufacturer (for plates produced from an as-rolled structural product) or the processor (for plates produced from coil).
- 18.1.2 Plates that are required to be heat treated, but have not been so heat treated, shall be marked, by the manufacturer or processor, with the letter "G" (denoting green) following the required ASTM designation mark, except that "G" marking is not necessary if such plates are for shipment, for the purpose of obtaining the required heat treatment, to an organization under the manufacturer's control. Such plates shall have been qualified for shipment on the basis of test specimens that have been so heat treated. Plates that are required to be heat treated, and have been so heat treated, shall be marked, by the party that performed the heat treatment, with the letter "MT" (denoting material treated) following the required ASTM designation mark.
- 18.1.3 Except as allowed by 18.1.4.2 and 18.6, the required markings for plates shall be by steel die stamping, paint marking, or by means of permanently affixed, colorfast, weather-resistant labels or tags. It shall be the responsibility of the supplier that all required markings be intact and fully legible upon receipt by the purchaser.
 - 18.1.4 Location of Markings:
- 18.1.4.1 The required markings for plates shall be in at least one place on each finished plate.
- 18.1.4.2 For secured lifts of all sizes of plates \(^3\)/s in. [10 mm] (or \(^5\)/16 in. [8 mm] for material specified for bridge construction end use) or under in thickness, and for secured lifts of all thicknesses of plates 36 in. [900 mm] or under in width, the manufacturer or processor shall have the option of placing such

markings on only the top piece of each lift, or of showing such markings on a substantial tag attached to each lift, unless otherwise specified.

18.2 Shapes:

18.2.1 Except as allowed by 18.2.2 and 18.6, shapes shall be marked with the heat number, size of section, length, and mill identification marks on each piece. Shapes with the greatest cross-sectional dimension greater than 6 in. [150 mm] shall have the manufacturer's name, brand, or trademark shown in raised letters at intervals along the length. In addition, shapes shall be identified with the ASTM designation (year-date not required) and grade, either by marking each piece individually, by permanently affixing a colorfast, weather-resistant label or tag, or, if bundled, by attaching a substantial tag to the bundle.

18.2.2 Bundling for shipment of small shapes with the greatest cross-sectional dimension not greater than 6 in. [150 mm] is permissible. Each lift or bundle shall be marked or substantially tagged showing the identification information listed in 18.2.1.

18.2.3 It shall be permissible for the manufacturer to make a full size bundle at the end of a heat by adding product from a consecutively rolled heat of the same nominal chemical composition. The manufacturer shall identify a bundle consisting of product from two heats with the number of the first heat rolled or identify both heats. The manufacturer shall maintain records of the heats contained in each bundle.

18.3 Steel Sheet Piling—Steel sheet piling shall be marked with the heat number, size of section, length, and mill identification marks on each piece, either by marking, or by permanently affixing colorfast, weather-resistant label or tag. The manufacturer's name, brand, or trademark shall be shown in raised letters at intervals along the length.

18.4 Bars—Bars of all sizes, when loaded for shipment, shall be properly identified with the name or brand of manufacturer, purchaser's name and order number, the ASTM designation number (year-date not required), grade number where appropriate, size and length, weight [mass] of lift, and the heat number for identification. Unless otherwise specified, the method of marking is at the manufacturer's option and shall be made by hot stamping, cold stamping, painting, or marking tags attached to the lifts of bars. Bars are not required to be die-stamped.

18.4.1 It shall be permissible for the manufacturer to make a full size bundle at the end of a heat by adding product from a consecutively rolled heat of the same nominal chemical composition. The manufacturer shall identify a bundle consisting of product from two heats with the number of the first heat rolled or identify both heats. The manufacturer shall maintain records of the heats contained in each bundle.

18.5 *Bar Coding*—In addition to the requirements of 18.1 – 18.4 inclusive, the manufacturer or processor shall have the option of using bar coding as a supplementary identification method.

Note 10—Bar coding should be consistent with AIAG Standards.

18.6 Subdivided Material:

18.6.1 Except as allowed by 18.6.2, pieces separated from a master structural product by an organization other than the original manufacturer shall be identified with the ASTM designation (year-date not required), grade, heat number, and the heat treatment identification, if applicable, along with the trademark, brand, or name of the organization subdividing the structural product. The identification methods shall be in accordance with the requirements of 18.1 – 18.4 inclusive, except that the raised letters method for shapes and steel sheet piling is not required. If the original manufacturer's identification remains intact, the structural product need not be additionally identified by the organization supplying the structural product.

18.6.2 It shall be permissible for pieces from the same heat of structural product to be bundled or placed in secured lifts, with the identification specified in 18.6.1 placed on the top piece of each lift or shown on a substantial tag attached to each bundle or lift.

19. Packaging, Marking, and Loading for Shipment

19.1 Packaging, marking, and loading for shipment shall be in accordance with Practices A700.

19.2 When Level A is specified, and when specified in the contract or order, and for direct procurement by or direct shipment to the U.S. government, preservation, packaging, and packing shall be in accordance with the Level A requirements of MIL-STD-163.

19.3 When specified in the contract or order, and for direct procurement by or direct shipment to the U.S. government, marking for shipment, in addition to requirements specified in the contract or order, shall be in accordance with MIL-STD-129 for military agencies and with Fed. Std. No. 123 for civil agencies.

20. Keywords

20.1 bars; general requirements; plates; rolled; shapes; sheet piling; structural steel

TABLE 1 Permitted Variations in Thickness for Rectangular, Carbon, High-Strength, Low-Alloy, and Alloy-Steel Plates, 15 in. and Under in Thickness When Ordered to Thickness

Note 1—Tables 1-31 inclusive contain permitted variations in dimensions and weight stated in inch-pound units.

Note 2—Permitted variation under specified thickness, 0.01 in. When so specified, these permitted variations may be taken all over, in which case the sum of these permitted variations applies.

Note 3—Thickness to be measured at 3/8 to 3/4 in. from the longitudinal edge.

Note 4—For thicknesses measured at any location other than that specified in Note 4, the permitted variations over specified thickness shall be 13/4 times the amounts in this table, rounded to the nearest 0.01 in.

Note 5—Where "..." appears in this table, there is no requirement.

	Permitted Variations Over Specified Thickness for Widths Given in Inches, in.											
Specified Thickness, in.	48 and under	Over 48 to 60, excl	60 to 72, excl	72 to 84, excl	84 to 96, excl	96 to 108, excl	108 to 120, excl	120 to 132, excl	132 to 144, excl	144 to 168, excl	168 to 182, excl	182 and over
To 1/4, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.04			
1/4 to 5/16, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04			
5/16 to 3/8, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.05		
3/8 to 7/16, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.05	0.06	0.06	
7/16 to 1/2, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.05	0.06	0.06	
½ to 5/8, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.05	0.06	0.07	
5/8 to 3/4, excl	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.04	0.05	0.06	0.07	0.07
3/4 to 1, excl	0.03	0.03	0.03	0.03	0.04	0.04	0.05	0.05	0.06	0.07	0.08	0.09
1 to 2, excl	0.06	0.06	0.06	0.06	0.06	0.07	0.08	0.10	0.10	0.11	0.13	0.16
2 to 3, excl	0.09	0.09	0.09	0.10	0.10	0.11	0.12	0.13	0.14	0.15	0.15	
3 to 4, excl	0.11	0.11	0.11	0.11	0.11	0.13	0.14	0.14	0.14	0.15	0.17	
4 to 6, excl	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.20	0.20	
6 to 10, excl	0.23	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.27	0.28	
10 to 12, excl	0.29	0.29	0.33	0.33	0.33	0.33	0.33	0.33	0.33	0.33	0.35	
12 to 15, incl	0.29	0.29	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	

TABLE 2 Permitted Variations in Weight for Rectangular Sheared Plates and Universal Mill Plates 613.0 lb/ft² and Under When Ordered to Weight

Note 1—Permitted variations in overweight for lots of circular and sketch plates shall be 11/4 times the amounts in this table.

Note 2—Permitted variations in overweight for single plates shall be 11/3 times the amounts in this table.

Note 3—Permitted variations in overweight for single circular and sketch plates shall be 1½ times the amounts in this table.

Note 4—The adopted standard density of rolled steel is 490 lb/ft³.

Note 5—Where "..." appears in this table, there is no requirement.

		Permitted Variations in Average Weight of Lots ^A for Widths Given in Inches, Expressed in Percentage of the Specified Weights per Square Foot																				
Specified Weights,lb/ft ²		and		48 to excl		o 72,		o 84,	84 t	o 96, xcl	96 to	108, ccl	108 to		120 to	o 132,		o 144,		o 168, kcl		and er
	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under
To 10, excl	4.0	3.0	4.5	3.0	5.0	3.0	5.5	3.0	6.0	3.0	7.5	3.0	9.0	3.0	11.0	3.0	13.0	3.0				
10 to 12.5, excl	4.0	3.0	4.5	3.0	4.5	3.0	5.0	3.0	5.5	3.0	6.5	3.0	7.0	3.0	8.0	3.0	9.0	3.0	12.0	3.0		
12.5 to 15.0, excl	4.0	3.0	4.0	3.0	4.5	3.0	4.5	3.0	5.0	3.0	5.5	3.0	6.0	3.0	7.5	3.0	8.0	3.0	11.0	3.0		
15 to 17.5, excl	3.5	3.0	3.5	3.0	4.0	3.0	4.5	3.0	4.5	3.0	5.0	3.0	5.5	3.0	6.0	3.0	7.0	3.0	9.0	3.0	10.0	3.0
17.5 to 20, excl	3.5	2.5	3.5	2.5	3.5	3.0	4.0	3.0	4.5	3.0	4.5	3.0	5.0	3.0	5.5	3.0	6.0	3.0	8.0	3.0	9.0	3.0
20 to 25, excl	3.5	2.5	3.5	2.5	3.5	3.0	3.5	3.0	4.0	3.0	4.0	3.0	4.5	3.0	5.0	3.0	5.5	3.0	7.0	3.0	8.0	3.0
25 to 30, excl	3.0	2.5	3.5	2.5	3.5	2.5	3.5	3.0	3.5	3.0	3.5	3.0	4.0	3.0	4.5	3.0	5.0	3.0	6.5	3.0	7.0	3.0
30 to 40, excl	3.0	2.0	3.0	2.0	3.0	2.0	3.0	2.0	3.5	2.0	3.5	2.5	3.5	2.5	4.0	3.0	4.5	3.0	6.0	3.0	6.5	3.0
40 to 81.7, excl	2.5	2.0	3.0	2.0	3.0	2.0	3.0	2.0	3.5	2.0	3.5	2.0	3.5	2.5	3.5	3.0	4.0	3.0	5.5	3.0	6.0	3.0
81.7 to 122.6, excl	2.5	2.0	3.0	2.0	3.0	2.0	3.0	2.0	3.5	2.0	3.5	2.0	3.5	2.5	3.5	3.0	3.5	3.0	4.0	3.0	4.5	3.0
122.6 to 163.4, excl	2.5	1.5	2.5	1.5	2.5	1.5	2.5	1.5	2.5	2.0	2.5	2.0	2.5	2.0	2.5	2.0	2.5	2.0	3.0	2.0	3.5	2.0
163.4 to 245.1, excl	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	3.0	1.0	3.5	1.0
245.1 to 409.0, excl	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	3.0	1.0
409.0 to 490.1, excl	2.0	1.0	2.0	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0
490.1 to 613.0, excl	2.0	1.0	2.0	1.0	2.0	1.0	2.0	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0

^A The term "lot" means all the plates of each tabular width and weight group represented in each shipment.

TABLE 3 Permitted Variations in Width and Length for Sheared Plates 1½ in. and Under in Thickness; Length Only of Universal Mill Plates 2½ in. and Under in Thickness

Specified [Dimensions, in.	Permitted \	/ariations Over	Specified Wid	th and Length ^A fo Pounds per	or Thicknesses (Square Foot, in		or Equivalent We	eights Given in
		To 3/	s, excl	3/8 to	5/8 , excl	5⁄8 to	1, excl	1 to 2	, incl ^B
Length	Width	To 15	.3, excl	15.3 to	25.5, excl	25.5 to 4	40.8, excl	40.8 to 8	31.7, incl
		Width	Length	Width	Length	Width	Length	Width	Length
To 120, excl	To 60, excl	3/8	1/2	7/16	5/8	1/2	3/4	5/8	1
	60 to 84, excl	7/16	5/8	1/2	11/16	5/8	7/8	3/4	1
	84 to 108, excl	1/2	3/4	5/8	7/8	3/4	1	1	1 1/8
	108 and over	5/8	7/8	3/4	1	7/8	11/8	11/8	11/4
120 to 240, excl	To 60, excl	3/8	3/4	1/2	7/8	5/8	1	3/4	1 1/8
	60 to 84, excl	1/2	3/4	5/8	7/8	3/4	1	7/8	11/4
	84 to 108, excl	9/16	7/8	11/16	15/16	13/16	11/8	1	13/8
	108 and over	5/8	1	3/4	11/8	7/8	11/4	11/8	13/8
240 to 360, excl	To 60, excl	3/8	1	1/2	11/8	5/8	11/4	3/4	11/2
	60 to 84, excl	1/2	1	5/8	11/8	3/4	11/4	7/8	11/2
	84 to 108, excl	9/16	1	11/16	11/8	7/8	13/8	1	11/2
	108 and over	11/16	11/8	7/8	11/4	1	13/8	11/4	13/4
360 to 480, excl	To 60, excl	7/16	11/8	1/2	11/4	5/8	13/8	3/4	15/8
	60 to 84, excl	1/2	11/4	5/8	13/8	3/4	11/2	7/8	15/8
	84 to 108, excl	9/16	11/4	3/4	13/8	7/8	11/2	1	17/8
	108 and over	3/4	13/8	7/8	11/2	1	15/8	11/4	17/8
480 to 600, excl	To 60, excl	7/16	11/4	1/2	11/2	5/8	15/8	3/4	17/8
	60 to 84, excl	1/2	13/8	5/8	11/2	3/4	15/8	7/8	17/8
	84 to 108, excl	5/8	13/8	3/4	11/2	7/8	15/8	1	17/8
	108 and over	3/4	11/2	7/8	15/8	1	13/4	11/4	17/8
600 to 720, excl	To 60, excl	1/2	13/4	5/8	1 ⁷ / ₈	3/4	17/8	7/8	21/4
	60 to 84, excl	5/8	13/4	3/4	17/8	7/8	17/8	1	21/4
	84 to 108, excl	5/8	13/4	3/4	17/8	7/8	17/8	11/8	21/4
	108 and over	7/8	13/4	1	2	11/8	21/4	11/4	21/2
720 and over	To 60, excl	9/16	2	3/4	21/8	7/8	21/4	1	23/4
	60 to 84, excl	3/4	2	7/8	21/8	1	21/4	11/8	23/4
	84 to 108, excl	3/4	2	7/8	21/8	1	21/4	11/4	23/4
	108 and over	1	2	11/8	23/8	11/4	21/2	13/8	3

A Permitted variation under specified width and length, 1/4 in. By agreement, these permitted variations may be taken all over, in which case the sum of the permitted variations applies.

TABLE 4 Permitted Variations in Width for Mill Edge Carbon and High-Strength, Low-Alloy Plates Produced on Strip Mills (Applies to Plates Produced from Coil and to Plates Produced from an As-Rolled Structural Product)

Specified Width, in.	Permitted Variation Over Specified Width, in. ^A
To 14, excl	7/16
14 to 17, excl	1/2
17 to 19, excl	9/16
19 to 21, excl	5/8
21 to 24, excl	11/16
24 to 26, excl	13/16
26 to 28, excl	15/16
28 to 35, excl	11/8
35 to 50, excl	11/4
50 to 60, excl	11/2
60 to 65, excl	1 5/8
65 to 70, excl	13/4
70 to 80, excl	17/8
80 and over	2

^A No permitted variation under specified width.

TABLE 5 Permitted Variations in Rolled Width for Universal Mill

Pia	tes 15 in.	and Un	aer in i	nicknes	S					
	Permitted Variations Over Specified Width ^A for Thicknesses Given in Inches or Equivalent Weights Giver in Pounds per Square Foot, in.									
Specified Width, in.	To 3/8 , excl	3/8 to 5/8, excl	5/8 to 1, excl	1 to 2, incl	Over 2 to 10, incl	Over 10 to 15, incl				
	To 15.3, excl	15.3 to 25.5, excl	25.5 to 40.8, excl	40.8 to 81.7, incl	81.7 to 409.0, incl	409.0 to 613.0, incl				
Over 8 to 20, excl	1/8	1/8	3/16	1/4	3/8	1/2				
20 to 36, excl	3/16	1/4	5/16	3/8	7/16	9/16				
36 and over	5/16	3/8	7/16	1/2	9/16	5/8				

^A Permitted variation under specified width, ½ in.

B Permitted variations in length apply also to Universal Mill plates up to 12 in. in width for thicknesses over 2 to 2½ in., incl, except for alloy steel up to 2 in. thick.

TABLE 6 Permitted Variations in Diameter for Sheared Circular Plates 1 in. and Under in Thickness

Specified Diameters, in.	Permitted Variations Over Specified Diameter for Thicknesses Given in Inches, in. ^A							
Specified Diameters, III.	To 3/8 , excl	3/s to 5/s, excl	% to 1, incl					
To 32, excl	1/4	3/8	1/2					
32 to 84, excl	5/16	7/16	9/16					
84 to 108, excl	3/8	1/2	5/8					
108 to 130, excl	7/16	9/16	11/16					
130 and over	1/2	5/8	3/4					

^A No permitted variation under specified diameter.

TABLE 7 Permitted Variations in Diameter for Gas-Cut Circular Plates (Not Applicable to Alloy Steel)

Specified	Permitted Variation Over Specified Diameter for Thicknesses Given in Inches, in. ^A									
Diameter, in.	to 1, excl	1 to 2, excl	2 to 4, excl	4 to 6, excl	6 to 8, excl	8 to 15, incl				
To 32, excl	3/8	3/8	1/2	1/2	5/8	3/4				
32 to 84, excl	3/8	1/2	1/2	5/8	3/4	7/8				
84 to 108, excl	1/2	9/16	5/8	3/4	7/8	1				
108 to 130, excl	1/2	9/16	11/16	7/8	1	1 ½				
130 and over	5/8	3/4	7/8	1	11/8	11/4				

A No permitted variation under specified diameter.

TABLE 8 Permitted Variations in Width and Length for Rectangular Plates When Gas Cuttings is Specified or Required (Applies to Alloy Steel Specifications Only)

Note 1—These permitted variations shall be taken all under or divided over and under, if so specified.

Note 2—Plates with universal rolled edges will be gas cut to length only.

Specified Thickness, in.	Permitted Variation Over Specified Width and Length, in.
To 2, excl	3/4
2 to 4, excl	1
4 to 6, excl	11/8
6 to 8, excl	15/16
8 to 15, incl	1½

TABLE 9 Permitted Variations in Width and Length for Rectangular Plates When Gas Cutting is Specified or Required (Not Applicable to Alloy Steel)

Note 1—These permitted variations may be taken all under or divided over and under, if so specified.

 $\ensuremath{\mathsf{Note}}\xspace\,2$ —Plates with universal rolled edges will be gas cut to length only.

Specified Thickness, in.	Permitted Variation Over Specified Width and Length, in.
To 2, excl	1/2
2 to 4, excl	5/8
4 to 6, excl	3/4
6 to 8, excl	7/8
8 to 15, incl	1

TABLE 10 Permitted Variations in Diameter for Gas-Cut Circular Plates (Applies to Alloy Steel Specifications Only)

Specified	Permitted	Permitted Variations Over Specified Diameter for Specified Thicknesses Given in Inches, in. ^A										
Diameter, in.	to 1, excl	1 to 2, excl	2 to 4, excl	4 to 6, excl	6 to 8, excl	8 to 15, incl						
To 32, excl	1/2	1/2	3/4	3/4	1	1						
32 to 84, excl	1/2	5/8	7/8	1	11/8	11/4						
84 to 108, excl	5/8	3/4	1	11/8	1 1/4	13/8						
108 to 130, incl	7/8	1	11/8	11/4	13/8	11/2						

^A No permitted variation under specified diameter.

TABLE 11 Permitted Camber^A for Carbon Steel, High-Strength Low-Alloy Steel, and Alloy Steel Universal Mill Plates and High-Strength Low-Alloy Steel and Alloy Steel Sheared, Special-Cut, or Gas-Cut Rectangular Plates

Specified Thickness, in.	Specified Weight, lb/ft ²	Specified Width, in.	Permitted Camber, in.
To 2, incl	to 81.7, incl	all	1/8 × (no. of feet of length/5)
Over 2 to 15, incl	81.7 to 613.0, incl	to 30, incl	3/16 × (no. of feet of length/5)
Over 2 to 15, incl	81.7 to 613.0, incl	over 30	$^{1/4}$ × (no. of feet of length/5)

^A Camber as it relates to plates is the horizontal edge curvature in the length, measured over the entire length of the plate in the flat position.

TABLE 12 Permitted Camber^A for Sheared Plates and Gas-Cut Rectangular Plates, All Thicknesses (Applies to Carbon Steel Only)

Permitted camber, in. = 1/8 × (number of feet of length/5)

A Camber as it relates to plates is the horizontal edge curvature in the length, measured over the entire length of the plate in the flat position.

TABLE 13 Permitted Variations From a Flat Surface for Standard Flatness Carbon Steel Plates

Note 1—When the longer dimension is under 36 in., the permitted variation from a flat surface shall not exceed ¼ in. When the longer dimension is from 36 to 72 in., incl, the permitted variation from a flat surface shall not exceed 75 % of the tabular amount for the specified width, but in no case less than ¼ in.

Note 2—These permitted variations apply to plates that have a specified minimum tensile strength of not more than 60 ksi or comparable chemical composition or hardness. The limits in this table are increased 50 % for plates that have a higher specified minimum tensile strength or comparable chemical composition or hardness.

Note 3—This table and these notes cover the permitted variations from a flat surface for circular and sketch plates, based upon the maximum dimensions of such plates.

Note 4—Where "..." appears in this table, there is no requirement.

Note 5—Plates must be in a horizontal position on a flat surface when flatness is measured.

		Permitted Variations from a Flat Surface for Specified Widths Given in Inches, in. ^{A,B}										
Specified Thickness, in.	Specified Weight, lb/ft ²	To 36, excl	36 to 48, excl	48 to 60, excl	60 to 72, excl	72 to 84, excl	84 to 96, excl	96 to 108, excl	108 to 120, excl	120 to 144, excl	144 to 168, excl	168 and Over
To 1/4, excl	To 10.2, excl	9/16	3/4	15/16	11/4	1%	11/2	15/8	13/4	17/8		
1/4 to 3/8, excl	10.2 to 15.3, excl	1/2	5/8	3/4	15/16	1 ½	11/4	13/8	11/2	15/8		
3/8 to 1/2, excl	15.3 to 20.4, excl	1/2	9/16	5/8	5/8	3/4	7/8	1	11/8	11/4	1 7/8	21/8
1/2 to 3/4, excl	20.4 to 30.6, excl	7/16	1/2	9/16	5/8	5/8	3/4	1	1	1 1/8	11/2	2
3/4 to 1, excl	30.6 to 40.8, excl	7/16	1/2	9/16	5/8	5/8	5/8	3/4	7/8	1	13/8	13/4
1 to 2, excl	40.8 to 81.7, excl	3/8	1/2	1/2	9/16	9/16	5/8	5/8	5/8	11/16	1 1/8	11/2
2 to 4, excl	81.7 to 163.4, excl	5/16	3/8	7/16	1/2	1/2	1/2	1/2	9/16	5/8	7/8	11/8
4 to 6, excl	163.4 to 245.1, excl	3/8	7/16	1/2	1/2	9/16	9/16	5/8	3/4	7/8	7/8	1
6 to 8, excl	245.1 to 326.8, excl	7/16	1/2	1/2	5/8	11/16	3/4	7/8	7/8	1	1	1
8 to 10, excl	326.8 to 409.0, excl	1/2	1/2	5/8	11/16	3/4	13/16	7/8	15/16	1	1	1
10 to 12, excl	409.0 to 490.1, excl	1/2	5/8	3/4	13/16	7/8	15/16	1	1	1	1	1
12 to 15, excl	490.1 to 613.0, incl	5/8	3/4	13/16	7/8	15/16	1	1	1	1	1	

A Permitted Variation from a Flat Surface for Length—The longer dimension specified is considered the length, and the permitted variation from a flat surface along the length shall not exceed the tabular amount for the specified width for plates up to 12 ft in length, or in any 12 ft for longer plates.

TABLE 14 Permitted Variations From a Flat Surface for Standard Flatness High-Strength Low-Alloy Steel and Alloy Steel Plates, Hot Rolled or Thermally Treated

Note 1—When the longer dimension is under 36 in., the permitted variation from a flat surface shall not exceed 3/8 in. When the longer dimension is from 36 to 72 in. incl, the permitted variation from a flat surface shall not exceed 75 % of the tabular amount for the specified width.

Note 2—This table and these notes cover the permitted variations from a flat surface for circular and sketch plates, based upon the maximum dimensions of such plates.

Note 3—Where "..." appears in this table, there is no requirement.

Note 4—Plates must be in a horizontal position on a flat surface when flatness is measured.

	Specified Weight, lb/ft ²			Permitte	d Variation	s from a l	Flat Surfac	ce for Spe	cified Widt	hs, in. ^{A,B}		
Specified Thickness, in.		To 36, excl	36 to 48, excl	48 to 60, excl	60 to 72, excl	72 to 84, excl	84 to 96, excl	96 to 108, excl	108 to 120, excl	120 to 144, excl	144 to 168, excl	168 and Over
To 1/4, excl	To 10.2 excl	13/16	11/8	13/8	17/8	2	21/4	23/8	25/8	23/4		
1/4 to 3/8, excl	10.2 to 15.3, excl	3/4	15/16	11/8	13/8	13/4	1 7/8	2	21/4	23/8		
3/8 to 1/2, excl	15.3 to 20.4, excl	3/4	7/8	15/16	15/16	11/8	15/16	11/2	15/8	17/8	23/4	31/8
1/2 to 3/4, excl	20.4 to 30.6, excl	5/8	3/4	13/16	7/8	1	11/8	11/4	13/8	15/8	21/4	3
3/4 to 1, excl	30.6 to 40.8, excl	5/8	3/4	7/8	7/8	15/16	1	11/8	15/16	11/2	2	25/8
1 to 2, excl	40.8 to 81.7, excl	9/16	5/8	3/4	13/16	7/8	15/16	1	1	1	15/8	21/4
2 to 4, excl	81.7 to 163.4, excl	1/2	9/16	11/16	3/4	3/4	3/4	3/4	7/8	1	11/4	15/8
4 to 6, excl	163.4 to 245.1, excl	9/16	11/16	3/4	3/4	7/8	7/8	15/16	11/8	11/4	11/4	11/2
6 to 8, excl	245.1 to 326.8, excl	5/8	3/4	3/4	15/16	1	11/8	11/4	1 5/16	11/2	11/2	11/2
8 to 10, excl	326.8 to 409.0, excl	3/4	13/16	15/16	1	11/8	11/4	15/16	13/8	11/2	11/2	11/2
10 to 12, excl	409.0 to 490.1, excl	3/4	15/16	11/8	11/4	15/16	13/8	11/2	11/2	11/2	11/2	11/2
12 to 15, incl	490.1 to 613.0, incl	7/8	1	1 3/ ₁₆	1 5/ ₁₆	13/8	11/2	11/2	11/2	11/2	11/2	11/2

A Permitted Variation from a Flat Surface for Length—The longer dimension specified is considered the length, and the permitted variation from a flat surface along the length shall not exceed the tabular amount for the specified width in plates up to 12 ft in length, or in any 12 ft for longer plates.

B Permitted Variation from a Flat Surface for Width—The permitted variation from a flat surface across the width shall not exceed the tabular amount for the specified width.

B Permitted Variation from a Flat Surface for Width—The permitted variation from a flat surface across the width shall not exceed the tabular amount for the specified width.

TABLE 15 Permitted Variations in Waviness for Standard Flatness Plates

Note 1—Waviness denotes the maximum deviation of the surface of the plate from a plane parallel to the surface of the point of measurement and contiguous to the surface of the plate at each of the two adjacent wave peaks, when the plate is resting on a flat horizontal surface, as measured in an increment of less than 12 ft of length. The permitted variation in waviness is a function of the permitted variation from a flat surface as obtained from Table 13 or Table 14, whichever is applicable.


Note 2—Plates must be in a horizontal position on a flat surface when waviness is measured.

Permitted Variation from a		Permitted Variation in Waviness, in., When Number of Waves in 12 ft is									
Flat Surface (from Table 13 Table 14), in.		2	3	4	5	6	7				
5/16	5/16	1/4	3/16	1/8	1/8	1/16	1/16				
3/8	3/8	5/16	3/16	3/16	1/8	1/16	1/16				
7/16	7/16	5/16	1/4	3/16	1/8	1/8	1/16				
1/2	1/2	3/8	5/16	3/16	3/16	1/8	1/16				
9/16	9/16	7/16	5/16	1/4	3/16	1/8	1/8				
5/8	5/8	1/2	3/8	1/4	3/16	1/8	1/8				
11/16	11/16	1/2	3/8	5/16	3/16	3/16	1/8				
3/4	3/4	9/16	7/16	5/16	1/4	3/16	1/8				
13/16	13/16	5/8	7/16	5/16	1/4	3/16	1/8				
7/8	7/8	11/16	1/2	3/8	1/4	3/16	1/8				
15/16	15/16	11/16	1/2	3/8	5/16	1/4	3/16				
1	1	3/4	9/16	7/16	5/16	1/4	3/16				
11/8	1 ½	7/8	5/8	1/2	3/8	1/4	3/16				
11/4	11/4	15/16	11/16	1/2	3/8	5/16	1/4				
13/8	13/8	11/16	3/4	9/16	7/16	5/16	1/4				
11/2	11/2	11/8	7/8	5/8	1/2	3/8	1/4				
15/8	15/8	11/4	15/16	11/16	1/2	3/8	5/16				
13/4	13/4	15/16	1	3/4	9/16	7/16	5/16				
17/8	17/8	17/16	11/16	13/16	9/16	7/16	5/16				
2	2	11/2	11/8	7/8	5/8	1/2	3/8				
21/8	21/8	15/8	13/16	7/8	11/16	1/2	3/8				
21/4	21/4	111/16	11/4	15/16	11/16	9/16	3/8				
23/8	23/8	113/16	15/16	1	3/4	9/16	7/16				
21/2	21/2	17/8	17/16	11/16	13/16	9/16	7/16				
25/8	25/8	2	11/2	1 ½	13/16	5/8	7/16				
23/4	23/4	21/16	19/16	1 1/8	7/8	5/8	1/2				
27/8	27/8	23/16	15/8	1 3/16	15/16	11/16	1/2				
3	3	21/4	111/16	11/4	15/16	11/16	9/16				
31/8	31/8	23/8	13/4	15/16	1	3/4	9/16				

TABLE 16 Permitted Variations in Cross Section for W, HP, S, M, C, and MC Shapes

Note 1—A is measured at center line of web for S, M, and W and HP shapes; at back of web for C and MC shapes. Measurement is overall for C shapes under 3 in. B is measured parallel to flange. C is measured parallel to web.

Note 2—Where "..." appears in this table, there is no requirement.

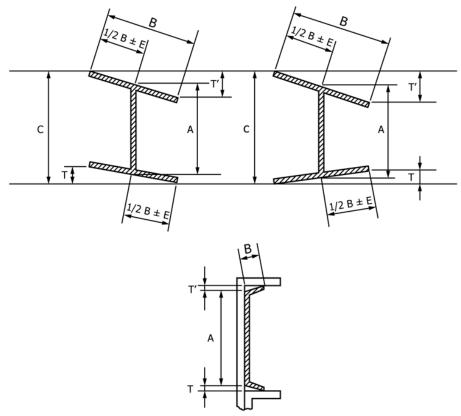


			Perm	nitted Variati	ions in Section	onal Dimension	s Given, in.			
Shape	Section Nominal Sizes, in.	A, Depth		B, Flange Width		T + T' A Flanges Out-of-	E, Web off Cen- ter ^C	C, Maximum Depth at any Cross Section	Permitted Variations Over or Under Theoret cal Web Thickness for Thicknesses Given in Inches, in.	
		Over Theo- retical	Under Theo- retical	Over Theo- retical	Under Theo- retical	Square ^B	iel ·	over Theo- retical Depth, in.	3/16 and under	Over 3/16
W and HP	Up to 12, incl	1/8	1/8	1/4	3/16	1/4	3/16	1/4		
	Over 12	1/8	1/8	1/4	3/16	5/16	3/16	1/4		
S and M	3 to 7, incl	3/32	1/16	1/8	1/8	1/32	3/16			
	Over 7 to 14, incl	1/8	3/32	5/32	5/32	1/32	3/16			
	Over 14 to 24, incl	3/16	1/8	3/16	3/16	1/32	3/16			
C and MC	11/2 and under	1/32	1/32	1/32	1/32	1/32			0.010	0.015
	Over 11/2 to 3, excl	1/16	1/16	1/16	1/16	1/32			0.015	0.020
	3 to 7, incl	3/32	1/16	1/8	1/8	1/32				
	Over 7 to 14, incl	1/8	3/32	1/8	5/32	1/32				
	Over 14	3/16	1/8	1/8	3/16	1/32				

A T+T' applies when flanges of channels are toed in or out. For channels % in. and under in depth, the permitted out-of-square is $\%_4$ in./in. of depth. B Permitted variation is per inch of flange width for S, M, C, and MC shapes. C Permitted variation of $5\%_6$ in. max for sections over 426 lb/ft.

TABLE 17 Permitted Variations in Cross Section for Angles (L Shapes), Bulb Angles, and Zees

Note 1—Where "..." appears in this table, there is no requirement.

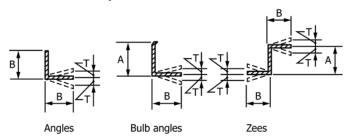


		Permitt	ed Variation	s in Sectiona	I Dimensions	Given, in.				
Section	Nominal Size, in.	<i>A</i> , D	A, Depth		e Width or of Leg	T, Out-of- Square per	Permitted Variations Over or Under Theoretical Thickness for Thicknesses Given in Inches, in.			
	Over Under Over Theoretical Theoretical Theoretical		Under Theoretical	Inch of B, in.	3/16 and under	Over 3/16 to 3/8, incl	Over 3/8			
Angles ^A	1 and under			1/32	1/32	3/ ₁₂₈ B	0.008	0.010		
(L Shapes)	Over 1 to 2, incl			3/64	3/64	3/ ₁₂₈ B	0.010	0.010	0.012	
. ,	Over 2 to 21/2, incl			1/16	1/16	3/ ₁₂₈ B	0.012	0.015	0.015	
	Over 21/2 to 4, incl			1/8	3/32	3/ ₁₂₈ B				
	Over 4 to 6, incl			1/8	1/8	3/ ₁₂₈ B				
	Over 6 to 8, incl			3/16	1/8	3/ ₁₂₈ B				
	Over 8 to 10, incl			1/4	1/4	3/ ₁₂₈ B				
	Over 10			1/4	3/8	3/ ₁₂₈ B				
Bulb angles	(Depth) 3 to 4, incl	1/8	1/16	1/8	3/32	3/ ₁₂₈ B				
J	Over 4 to 6, incl	1/8	1/16	1/8	1/8	3/ ₁₂₈ B				
	Over 6	1/8	1/16	3/16	1/8	3/ ₁₂₈ B				
Zees	3 to 4, incl	1/8	1/16	1/8	3/32	3/ ₁₂₈ B				
	Over 4 to 6, incl	1/8	1/16	1/8	1/8	3∕ ₁₂₈ B				

 $^{^{\}rm A}$ For unequal leg angles, longer leg determines classification. $^{\rm B}$ $_{\rm ^{9}128}$ in./in. = 1½ $^{\circ}.$

TABLE 18 Permitted Variations in Sectional Dimensions for Rolled Tees

Note 1-*Back of square and center line of stem are to be parallel when measuring "out-of-square."

Note 2—Where "..." appears in this table, there is no requirement.



				Pe	ermitted Variation Tees		al Dimensions	Given, in.			
Nominal Size, ^A	A, Depth ^B		B, V	/idth ^B	T, Out- of-Square	E, Web-off-	Stem Out-of-	Thickness of Flange		Thickness of Stem	
	Over	Under	Over	Under	per Inch of B	Center	Square ^C	Over	Under	Over	Under
11/4 and under	3/64	3/64	3/64	3/64			1/32	0.010	0.010	0.005	0.020
Over 11/4 to 2, incl	1/16	1/16	1/16	1/16			1/16	0.012	0.012	0.010	0.020
Over 2 to 3, excl	3/32	3/32	3/32	3/32			3/32	0.015	0.015	0.015	0.020
3 to 5, incl	3/32	1/16	1/8	1/8	1/32	3/32					
Over 5 to 7, incl	3/32	1/16	1/8	1/8	1/32	1/8					

A The longer member of an unequal tee determines the size for permitted variations.

B Measurements for both depth and width are overall.

C Stem-out-of-square is the permitted variation from its true position of the center line of stem, measured at the point.

TABLE 19 Permitted Variations in Length for S, M, C, MC, L, T, Z, and Bulb Angle Shapes

Note 1—Where "..." appears in this table, there is no requirement.

Nominal	Permitted Variations from Specified Length for Lengths Given in Feet, in.													
Size. ^A in.	5 to 1	0, excl	10 to	20,excl	20 to	30, incl	Over 30	to 40, incl	Over 40	to 50, incl	Over 50	to 65, incl	Ove	r 65 ft
Size, III.	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under
Under 3	5/8	0	1	0	11/2	0	2	0	21/2	0	21/2	0		
3 and over	1	0	11/2	0	13/4	0	21/4	0	23/4	0	23/4	0		


A Greatest cross-sectional dimension.

TABLE 20 Permitted Variations in End Out-Of-Square for S, M, C, MC, L, T, Z, Bulb Angle, and Flat Bar Shapes

	•
Shapes	Permitted Variation
S, M, C, and MC	1/64 in. per inch of depth
L ^A	3/128 in. per inch of leg length or 11/2 °
Bulb angles	3/128 in. per inch of depth or 11/2 °
Rolled Tees ^A	1/64 in. per inch of flange or stem
Zees	3/128 in. per inch of sum of both flange
	lengths
Flat Bars ^B	1/16 in. per inch of width but not less than 5/16
	in.

 $^{^{}A}$ Permitted variations in end out-of-square are determined on the longer members of the shape. $^{\mathcal{B}}$ For flat bars, permitted variations in end out-of-square are determined on the width of the bar.

TABLE 21 Permitted Variations in Straightness for S, M, C, MC, L, T, Z, and Bulb Angle Shapes

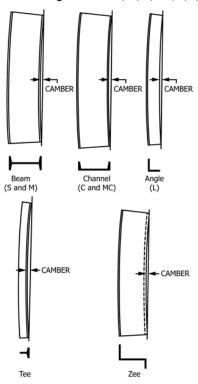

	Positions for Measuring Camber of Shapes								
Variable	Nominal Size, ^A in.	Permitted Variation, in.							
Camber	Under 3	1/4 in. in any 5 ft, or 1/4 × (number of feet of total length/5)							
	3 and over	1/8 × (number of feet of total length/5)							
Sweep	All	ue to the extreme variations in flexibility of these shapes, permitted variations for sweep are subject to negotiations between the manufacturer and the purchaser for the individual sections involved.							

A Greatest cross-sectional dimension.

TABLE 22 Permitted Variations in Length for W and HP Shapes

Permitted Variations from Specified Le	ength for Lengths Given in Feet, in. A, B
Over	Under
4	0

^A For HP and W shapes specified in the order for use as bearing piles, the permitted variations in length are plus 5 in. and minus 0 in. These permitted variations in length also apply to sheet piles.

^B The permitted variations in end out-of-square for W and HP shapes shall be ½4 in. per inch of depth, or per inch of flange width if the flange width is larger than the depth.


ASME BPVC.II.A-2023

TABLE 23 Permitted Variations in Length and End Out-of-Square, Milled Shapes

		Permitted Variations in Length and End Out-of-Square, in. ^A							
Milled Bo			Milled Both End	ed Both Ends ^C			$d^{\mathcal{C}}$		
Nominal Depth, in.	Length, ft ^B	Lei	ngth	End Out-of-	Length		End Out-of- Square (for		
		Over	Under	Square	Over	Under	Milled End)		
6 to 36	6 to 70	1/32	1/32	1/32	1/4	1/4	1/32		

A Length is measured along center line of web. Measurements are made with the steel and tape at the same temperature.

TABLE 24 Permitted Variations in Straightness for W and HP Shapes



Positions for Measuring Camber and Sweep of W and HP Shapes							
	Permitted Variation in Straightness, in.						
Camber and sweep	$\frac{1}{8}$ × (number of feet of total length/10) ^A						
When certain sections ^B with a flange width approximately equal to depth are specified in the order for use as columns:							
Lengths of 45 ft and under	1/8 × (number of feet of total length/10) but not over 3/8						
Lengths over 45 ft	$\frac{3}{8}$ + [$\frac{1}{8}$ × ([number of feet of total length – 45]/10)]						

A Sections with a flange width less than 6 in., permitted variation for sweep, in. = 1/6 x (number of feet of total length/5).

For other sections specified in the order for use as columns, the permitted variation is subject to negotiation with the manufacturer.

TABLE 25 Permitted Variations in Dimensions for Split Tees and Split Angles (L Shapes)^A

9.00 (
Specified Depth, in.	Permitted Variation Over or Under Specified Depth, ^B in.
To 6, excl (beams and channels)	1/8
6 to 16, excl (beams and channels)	3/16
16 to 20, excl (beams and channels)	1/4
20 to 24, excl (beams)	5/16
24 and over (beams)	3/8

^A The permitted variations in length for split tees or angles are the same as those applicable to the section from which the tees or angles are split. ^B The above permitted variations in depth of tees or angles include the permitted

^B The permitted variations in length and end out-of-square are additive.

^c End out-of-square is measured by (a) squaring from the center line of the web and (b) squaring from the center line of the flange. The measured variation from true squareness in either plane shall not exceed the total tabular amount.

^B Applies only to:

⁸⁻in. deep sections 31 lb/ft and heavier,

¹⁰⁻in. deep sections 49 lb/ft and heavier, 12-in. deep sections 65 lb/ft and heavier,

¹⁴⁻in. deep sections 90 lb/ft and heavier,

¹⁶⁻in. deep sections 88 lb/ft and heavier, and

¹⁸⁻in, deep sections 135 lb/ft and heavier.

variations in depth for the beams or channels before splitting. Permitted variations in dimensions and straightness, as set up for the beams or channels from which these tees or angles are cut, apply, except: straightness = 1/8 in. × (length in feet/5)

TABLE 26 Permitted Variations in Sectional Dimensions for Square-Edge and Round-Edge Flat Bars

Note 1—Where "..." appears in this table, there is no requirement.

Specified Widths, in.	Permitte	Permitted Variations Over or Under Specified Thickness, for Thicknesses Given in Inches, in.										
	0.203 to 0.230, excl	0.230 to ¹ / ₄ , excl	½ to ½, incl	Over ½ to 1, incl	Over 1 to 2, incl	Over 2 to 3, incl	Over 3	Over	Under			
To 1, incl	0.007	0.007	0.008	0.010				1/64	1/64			
Over 1 to 2, incl	0.007	0.007	0.012	0.015	1/32			1/32	1/32			
Over 2 to 4, incl	0.008	0.008	0.015	0.020	1/32	3/64	3/64	1/16	1/32			
Over 4 to 6, incl	0.009	0.009	0.015	0.020	1/32	3/64	3/64	3/32	1/16			
Over 6 to 8, incl	Α	0.015	0.016	0.025	1/32	3/64	1/16	1/8 B	3/32 B			

^A Flats over 6 to 8 in., incl, in width are not available as hot-rolled carbon steel bars in thickness under 0.230 in. ^B For flats over 6 to 8 in., in width, and to 3 in. incl in thickness.

TABLE 27 Permitted Variations in Sectional Dimensions for Round and Square Bars and Round-Cornered Squares

		•	•
Specified Size, in.	Permitted Specif	Permitted Out-of- Round or Out-of-Square,	
	Over	Under	in. ^A
To 5/16	0.005	0.005	0.008
Over 5/16 to 7/16, incl	0.006	0.006	0.009
Over 7/16 to 5/8, incl	0.007	0.007	0.010
Over 5% to 7/8, incl	0.008	0.008	0.012
Over % to 1, incl	0.009	0.009	0.013
Over 1 to 11/8, incl	0.010	0.010	0.015
Over 11/8 to 11/4, incl	0.011	0.011	0.016
Over 11/4 to 13/8, incl	0.012	0.012	0.018
Over 13/8 to 11/2, incl	0.014	0.014	0.021
Over 11/2 to 2, incl	1/64	1/64	0.023
Over 2 to 21/2, incl	1/32	0	0.023
Over 21/2 to 31/2, incl	3/64	0	0.035
Over 31/2 to 41/2, incl	1/16	0	0.046
Over 41/2 to 51/2, incl	5/64	0	0.058
Over 5½ to 6½, incl	1/8	0	0.070
Over 61/2 to 81/4, incl	5/32	0	0.085
Over 81/4 to 91/2, incl	3/16	0	0.100
Over 91/2 to 10, incl	1/4	0	0.120

A Out-of-round is the difference between the maximum and minimum diameters of the bar, measured at the same transverse cross section. Out-of-square section is the difference in perpendicular distance between opposite faces, measured at the same transverse cross section.

TABLE 28 Permitted Variations in Sectional Dimensions for Hexagons

Specified Sizes Between		Variations from ied Size, in.	Permitted Out-of- Hexagon Section,
Opposite Sides, in.	Over	Under	Three Measurements, in. ^A
½ and under	0.007	0.007	0.011
Over 1/2 to 1, incl	0.010	0.010	0.015
Over 1 to 11/2, incl	0.021	0.013	0.025
Over 1½ to 2, incl	1/32	1/64	1/32
Over 2 to 21/2, incl	3/64	1/64	3/64
Over 21/2 to 31/2, incl	1/16	1/64	1/16

A Out-of-hexagon section is the greatest difference in distance between any two opposite faces measured at the same transverse cross section.

TABLE 29 Permitted Variations in Straightness for Bars

Permitted Variations in Straightness, in. ^A
$\frac{1}{4}$ in any 5 ft and $\frac{1}{4}$ × (number of feet of total length/5)

^A Permitted variations in straightness do not apply to hot-rolled bars if any subsequent heating operation has been performed.

TABLE 30 Permitted Variations in Length for Hot-Cut Steel Bars^A

Note 1—Where "..." appears in this table, there is no requirement.

Specified Sizes of Rounds,	Specified Si	zes of Flats, in.		Permitted Variations Over Specified Length Given in Feet, in. (No Variation Under)									
Squares, and Hexagons, in.	Thickness	Width	5 to 10, excl	10 to 20, excl	20 to 30, excl	30 to 40, excl	40 to 60, incl						
To 1, incl	To 1, incl	To 3, incl	1/2	3/4	11/4	13/4	21/4						
Over 1 to 2, incl	Over 1	To 3, incl	5/8	1	11/2	2	21/2						
Over 1 to 2, incl	To 1, incl	Over 3 to 6, incl	5/8	1	11/2	2	21/2						
Over 2 to 5, incl	Over 1	Over 3 to 6, incl	1	11/2	13/4	21/4	23/4						
Over 5 to 10, incl	•••		2	21/2	23/4	3	31/4						
	0.230 to 1, incl	Over 6 to 8, incl	3/4	11/4	13/4	31/2	4						
	Over 1 to 3, incl	Over 6 to 8, incl	11/4	13/4	2	31/2	4						
		Hot Sawing											
2 to 5, incl ^B	1 and over	3 and over	В	11/2	13/4	21/4	23/4						
Over 5 to 10, incl			В	21/2	23/4	3	31/4						

A For flats over 6 to 8 in., incl, in width and over 3 in. in thickness, consult the manufacturer for permitted variations in length.

^B Smaller sizes and shorter lengths are not commonly hot sawed.

TABLE 31 Permitted Variations in Length for Bars Recut Both Ends After Straightening^{A,B}

Sizes of Rounds, Squares,			pecified Lengths Given in Feet in.	t,				
Hexagons, Width of Flats and Maximum Dimension	To 12	, incl	Over 12					
of Other Sections, in.	Over	Un-	Over	Un-				
of Other Sections, in.	Over	der	Ovei	der				
To 3, incl	3/16	1/16	1/4	1/16				
Over 3 to 6, incl	1/4	1/16	3/8	1/16				
Over 6 to 8, incl	3/8	1/16	1/2	1/16				
Rounds over 8 to 10, incl	1/2	1/16	5/8	1/16				

A For flats over 6 to 8 in., incl, in width, and over 3 in. in thickness, consult the manufacturer or processor for permitted variations in length.

SUPPLEMENTARY REQUIREMENTS

The following standardized supplementary requirements are for use when desired by the purchaser. Those that are considered suitable for use with each material specification are listed in the specification. Other tests may be performed by agreement between the supplier and the purchaser. These additional requirements shall apply only when specified in the order, in which event the specified tests shall be made by the manufacturer or processor before shipment of the material.

S1. Vacuum Treatment

S1.1 The steel shall be made by a process that includes vacuum degassing while molten. Unless otherwise agreed upon with the purchaser, it is the responsibility of the manufacturer to select suitable process procedures.

S2. Product Analysis

S2.1 Product analyses shall be made for those elements specified or restricted by the applicable product specification for the applicable grade, class, and type. Specimens for analysis shall be taken adjacent to or from the tension test

specimen, or from a sample taken from the same relative location as that from which the tension test specimen was taken.

S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons

S3.1 Prior to testing, the test specimens representing the structural product for acceptance purposes for mechanical properties shall be thermally treated to simulate a post-weld heat treatment below the critical temperature (Ac_3), using the heat treatment parameters (such as temperature range, time,

⁸ Permitted variations are sometimes required all over or all under the specified length, in which case the sum of the two permitted variations applies.

and cooling rates) specified in the order. The test results for such heat-treated test specimens shall meet the applicable product specification requirements.

S4. Additional Tension Test

S4.1 *Plate*—One tension test shall be made from each unit plate rolled from a slab or directly from an ingot, except that for quenched and tempered plates, a test shall be taken from each unit plate heat treated. The results obtained shall be reported on the mill test reports when such tests are required by the order.

S5. Charpy V-Notch Impact Test

S5.1 Charpy V-notch impact tests shall be conducted in accordance with Specification A673/A673M.

S5.2 The frequency of testing, the test temperature to be used, and the absorbed energy requirements shall be as specified on the order.

S6. Drop-Weight Test (for Material 0.625 in. [16 mm] and Over in Thickness)

S6.1 Drop-weight tests shall be made in accordance with Test Method E208. The specimens shall represent the material in the final condition of heat treatment. Agreement shall be reached between the purchaser and the manufacturer or processor as to the number of pieces to be tested and whether a maximum nil-ductility transition (NDT) temperature is mandatory or if the test results are for information only.

S8. Ultrasonic Examination

S8.1 The material shall be ultrasonically examined in accordance with the requirements specified on the order.

S15. Reduction of Area Measurement

S15.1 The reduction of area, as determined on the 0.500-in. [12.5-mm] diameter round tension test specimen in accordance with Test Methods and Definitions A370, shall not be less than 40 %.

S18. Maximum Tensile Strength

S18.1 Steel having a specified minimum tensile strength of less than 70 ksi [485 MPa] shall not exceed the minimum specified tensile strength by more than 30 ksi [205 MPa].

S18.2 Steel having a minimum specified tensile strength of 70 ksi [485 MPa] or higher shall not exceed the minimum specified tensile strength by more than 25 ksi [170 MPa].

S23. Copper-Bearing Steel (for improved atmospheric corrosion resistance)

S23.1 The copper content shall be a minimum of 0.20% on heat analysis, 0.18 on product analysis.

S26. Subdivided Material—Marking of Individual Pieces

S26.1 Subdivided pieces shall be individually identified by marking, stenciling, or die stamping the applicable product specification designation (year-date not required), grade, heat number, and the heat treatment identification, if applicable, along with the trademark, brand, or name of the organization that subdivided the structural product. As an alternative, individual subdivided pieces shall be identified by a code traceable to the original required identification, provided that the trademark, name, or brand of the organization that subdivided the structural product is also placed on the structural product and the original required identification, cross referenced on the code, is furnished with the structural product.

S27. Restrictive Plate Flatness

S27.1 As-rolled or normalized carbon steel plates ordered to restrictive flatness shall conform to the permitted variations from a flat surface given in Table S27.1 or Table S27.2, whichever is applicable.

S27.2 As-rolled or normalized high-strength low-alloy steel plates ordered to restrictive flatness shall conform to the permitted variations from a flat surface given in Table S27.3 or Table S27.4, whichever is applicable.

TABLE S27.1 Permitted Variations From a Flat Surface for As-Rolled or Normalized Carbon Steel Plates Ordered to Half-Standard Flatness

Note 1—Permitted Variation From a Flat Surface Along the Length—The longer dimension specified is considered the length, and the permitted variation from a flat surface along the length shall not exceed the tabular amount for the specified width in plates up to 12 ft in length, or in any 12 ft of longer plates.

Note 2—Permitted Variation From a Flat Surface Across the Width—The permitted variation from a flat surface across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 36 in., the permitted variation from a flat surface shall not exceed ¼ in. in each direction. When the longer dimension is from 36 to 72 in., incl, the permitted variation from a flat surface shall not exceed 75 % of the tabular amount for the specified width, but in no case less than ¼ in.

Note 4—The permitted variations given in this table apply to plates that have a minimum specified tensile strength not over 60 ksi or comparable chemistry or hardness. For plates specified to a higher minimum tensile strength or compatible chemistry or hardness, the permitted variations are 1½ times the amounts in this table.

Note 5—This table and these notes cover the permitted variations from a flat surface for circular and sketch plates, based upon the maximum dimensions of such plates.

Note 6—Permitted variations in waviness do not apply.

Note 7—Plates must be in a horizontal position on a flat surface when flatness is measured.

Considered Thickness	Consisted Weights	Pe	ermitted Variations I	From a Flat Surface	for Specified Widt	hs Given in Inches,	in.
Specified Thickness, in.	Specified Weights, lb/ft ²	48 to 60, excl	60 to 72, excl	72 to 84, excl	84 to 96, excl	96 to 108, excl	108 to 120, incl
To 1/4, excl	To 10.2, excl	15/32	5/8	11/16	3/4	13/16	7/8
1/4 to 3/8, excl	10.2 to 15.3, excl	3/8	15/32	9/16	5/8	11/16	3/4
3/8 to 1/2, excl	15.3 to 20.4, excl	5/16	5/16	3/8	7/16	1/2	9/16
1/2 to 3/4, excl	20.4 to 30.6, excl	9/32	5/16	5/16	3/8	1/2	1/2
3/4 to 1, excl	30.6 to 40.8, excl	9/32	5/16	5/16	5/16	3/8	7/16
1 to 2, incl	40.8 to 51.7, incl	1/4	9/32	9/32	5/16	5/16	5/16

TABLE S27.2 Permitted Variations From a Flat Surface for As-Rolled or Normalized Carbon Steel Plates Ordered to Half-Standard

Note 1—Permitted Variation From a Flat Surface Along the Length—The longer dimension specified is considered the length, and the permitted variation from a flat surface along the length shall not exceed the tabular amount for the specified width in plates up to 3700 mm in length, or in any 3700 mm of longer plates.

Note 2—Permitted Variation From a Flat Surface Across the Width—The permitted variation from a flat surface across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 900 mm, the permitted variation from a flat surface shall not exceed 6 mm in each direction. When the longer dimension is from 900 to 1800 mm, incl., the permitted flatness variation should not exceed 75 % of the tabular amount for the specified width, but in no case less than 6 mm.

Note 4—The permitted variations given in this table apply to plates that have a minimum specified tensile strength not over 415 MPa or comparable chemistry or hardness. For plates specified to a higher minimum tensile strength or compatible chemistry or hardness, the permitted variations are 1½ times the amounts in this table.

Note 5—This table and these notes cover the permitted variations from a flat surface for circular and sketch plates, based upon the maximum dimensions of such plates.

Note 6—Permitted variations in waviness do not apply.

Note 7—Plates must be in a horizontal position on a flat surface when flatness is measured.

Considered This leases	Consider Mainte	Permitted Variations From a Flat Surface for Specified Widths Given in Millimetres, mm												
Specified Thickness, mm	Specified Weights, kg/m ²	1200 to 1500, excl	1500 to 1800, excl	1800 to 2100, excl	2100 to 2400, excl	2400 to 2700, excl	2700 to 3000, incl							
To 6, excl	To 47.1 excl	12	16	17	19	20	22							
6 to 10, excl	47.1 to 78.5, excl.	9	12	14	16	17	19							
10 to 12, excl	78.5 to 94.2, excl	8	8	9	11	12	14							
12 to 20, excl	94.2 to 157.0, excl	7	8	8	9	12	12							
20 to 25, excl	157.0 to 196.2, excl	7	8	8	8	9	11							
25 to 50, incl	196.2 to 392.5, incl	6	7	7	8	8	8							

TABLE S27.3 Permitted Variations From a Flat Surface for As-Rolled or Normalized High-Strength Low-Alloy Steel Plates Ordered to Half-Standard Flatness

Note 1—Permitted Variation From a Flat Surface Along the Length—The longer dimension specified is considered the length, and the permitted variation from a flat surface along the length shall not exceed the tabular amount for the specified width in plates up to 12 ft in length, or in any 12 ft of longer plates.

Note 2—Permitted Variation From a Flat Surface Across the Width—The permitted variation from a flat surface across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 36 in., the permitted variation from a flat surface shall not exceed 3% in. in each direction. When the larger dimension is from 36 to 72 in., incl, the permitted variation from a flat surface shall not exceed 75 % of the tabular amount for the specified width, but in no case less than 3% in.

Note 4—This table and these notes cover the permitted variations from a flat surface for circular and sketch plates, based upon the maximum dimensions of those plates.

Note 5—Permitted variations in waviness do not apply.

Note 6—Plates must be in a horizontal position on a flat surface when flatness is measured.

Considered Thirdeness	Consider Wainleto	Pe	Permitted Variations From a Flat Surface for Specified Widths Given in Inches, in.												
Specified Thickness, in.	Specified Weights, lb/ft ²	48 to 60, excl	60 to 72, excl	72 to 84, excl	84 to 96, excl	96 to 108, excl	108 to 120, incl								
To 1/4, excl	To 10.2 excl	11/16	15/16	1	1 1/8	13/16	15/16								
1/4 to 3/8, excl	10.2 to 15.3, excl	9/16	11/16	7/8	15/16	1	11/8								
3/8 to 1/2, excl	15.3 to 20.4, excl	15/32	15/32	9/16	21/32	3/4	¹³ / ₁₆								
1/2 to 3/4, excl	20.4 to 30.6, excl	13/32	7/16	1/2	9/16	5/8	11/16								
3/4 to 1, excl	30.6 to 40.8, excl	7/16	7/16	15/32	1/2	9/16	21/32								
1 to 2, incl	40.8 to 51.7, incl	3/8	13/32	7/16	15/32	1/2	1/2								

TABLE S27.4 Permitted Variations From a Flat Surface for As-Rolled or Normalized High-Strength Low-Alloy Steel Plates Ordered to Half-Standard Flatness

Note 1—Permitted Variation From a Flat Surface Along the Length—The longer dimension specified is considered the length, and the permitted variation from a flat surface along the length shall not exceed the tabular amount for the specified width in plates up to 3700 mm in length, or in any 3700 mm of longer plates.

Note 2—Permitted Variation From a Flat Surface Across the Width—The permitted variation from a flat surface across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 900 mm, the permitted variation from a flat surface shall not exceed 10 mm in each direction. When the larger dimension is from 900 to 1800 mm, incl., the permitted variation from a flat surface shall not exceed 75 % of the tabular amount for the specified width but in no case less than 10 mm.

Note 4—This table and these notes cover the permitted variations from a flat surface for circular and sketch plates, based upon the maximum dimensions of such plates.

Note 5—Permitted variations in waviness do not apply.

Note 6—Plates must be in a horizontal position on a flat surface when flatness is measured.

Specified Thickness,	Specified Weights,	Permi	tted Variations Fror	n a Flat Surface fo	r Specified Widths	Given in Millimetres	s, mm
mm	kg/m ²	1200 to 1500, excl	1500 to 1800, excl	1800 to 2100, excl	2100 to 2400, excl	2400 to 2700, excl	2700 to 3000, incl
To 6, excl	To 47.1 excl	17	24	25	28	30	33
6 to 10, excl	47.1 to 78.5, excl	14	17	22	24	25	28
10 to 12, excl	78.5 to 94.2, excl	12	12	14	16	19	20
12 to 20, excl	94.2 to 157.0, excl	11	11	12	14	16	17
20 to 25, excl	157.0 to 196.2, excl	11	11	12	12	14	16
25 to 50, incl	196.2 to 392.5, incl	9	10	11	12	12	12

S28. Fine Grain Practice

S28.1 The steel shall be made to fine grain practice.

S29. Fine Austenitic Grain Size

S29.1 The requirements for fine austenitic grain size (see 8.1 and 8.3) shall be met.

S30. Charpy V-Notch Impact Test for Structural Shapes: Alternate Core Location

S30.1 For shapes with a flange thickness equal to or greater than 1½ in. [38.1 mm] that are specified in the purchase order to be tested in accordance with this supplementary

requirement, Charpy V-notch impact tests shall be conducted in accordance with Specification A673/A673M, using specimens taken from the alternate core location. Unless otherwise specified in the purchase order, the minimum average absorbed energy for each test shall be 20 ft·lbf [27 J] and the test temperature shall be 70°F [21°C].

S30.2 The frequency of testing shall be Frequency (H), except that, for rolled shapes produced from ingots, the frequency shall be Frequency (P) and the specimens shall be

taken from a location representing the top of an ingot or part of an ingot used to produce the product represented by such specimens.

S31. Maximum Carbon Equivalent for Weldability

S31.1 Plates and shapes shall be supplied with a specific maximum carbon equivalent value as specified by the purchaser. This value shall be based upon heat analysis. The required chemical analysis as well as the carbon equivalent shall be reported.

S31.2 The carbon equivalent shall be calculated using the following formula:

$$CE = C + Mn/6 + (Cr + Mo + V)/5 + (Ni + Cu)/15$$

S31.3 For additional information on the weldability of steel, see Appendix X3.

S32. Single Heat Bundles

S32.1 Bundles containing shapes or bars shall be from a single heat of steel.

ANNEXES

(Mandatory Information)

A1. PERMITTED VARIATIONS IN DIMENSIONS AND MASS IN SI UNITS

A1.1 Tables A1.1-A1.31 inclusive contain permitted variations in dimensions and mass stated in SI Units.

TABLE A1.1 Permitted Variations in Thickness for Rectangular Carbon, High-Strength Low Alloy, and Alloy Steel Plates, 300 mm and Under in Thickness When Ordered to Thickness

Note 1—Permitted variation under specified thickness, 0.3 mm. When so specified, these permitted variations may be taken all over, in which case the sum of these permitted variations applies.

Note 2—Thickness to be measured at 10 to 20 mm from the longitudinal edge.

Note 3—For specified thicknesses not listed in this table, the permitted variations in thickness shall be as given for the next higher value of specified thickness that is listed in this table.

Note 4—For thickness measured at any location other than that specified in Note 2, the permitted variations over specified thickness shall be $1\frac{3}{4}$ times the amounts in this table, rounded to the nearest 0.1 mm.

Note 5—Where "..." appears in this table, there is no requirement.

Consider			Permitte	d Variations C	over Specified	Thickness for	r Widths Giver	n in Millimetres	s, mm		
Specified Thickness, mm	1200 and Under	Over 1200 to 1500, excl	1500 to 1800, excl	1800 to 2100, excl	2100 to 2400, excl	2400 to 2700, excl	2700 to 3000, excl	3000 to 3300, excl	3300 to 3600, excl	3600 to 4200, excl	4200 and Ove
5.0	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.9	1.0		
5.5	0.8	0.8	0.8	0.8	0.8 0.8		0.8	0.9	1.0		
6.0	0.8	0.8	0.8	0.8	0.8	0.8	0.9	1.0	1.1		
7.0	0.8	0.8	0.8	0.8	0.8	0.8	0.9	1.0	1.2	1.4	
8.0	0.8	0.8	0.8	0.8	0.8	0.8	0.9	1.0	1.2	1.4	
9.0	0.8	0.8	0.8	0.8	0.8	0.8	1.0	1.0	1.3	1.5	
10.0	0.8	0.8	0.8	0.8	0.8	0.8	1.0	1.0	1.3	1.5	1.7
11.0	0.8	0.8	0.8	0.8	0.8	0.8	1.0	1.0	1.3	1.5	1.7
12.0	0.8	0.8	0.8	0.8	0.8	0.9	1.0	1.0	1.3	1.5	1.8
14.0	0.8	0.8	0.8	0.8	0.9	0.9	1.0	1.1	1.3	1.5	1.8
16.0	0.8	0.8	0.8	0.8	0.9	0.9	1.0	1.1	1.3	1.5	1.8
18.0	0.8	0.8	0.8	0.8	0.9	1.0	1.1	1.2	1.4	1.6	2.0
20.0	0.8	0.8	0.8	0.8	0.9	1.0	1.2	1.2	1.4	1.6	2.0
22.0	0.8	0.9	0.9	0.9	1.0	1.1	1.3	1.3	1.5	1.8	2.0
25.0	0.9	0.9	1.0	1.0	1.0	1.2	1.3	1.5	1.5	1.8	2.2
28.0	1.0	1.0	1.1	1.1	1.1	1.3	1.4	1.8	1.8	2.0	2.2
30.0	1.1	1.1	1.2	1.2	1.2	1.4	1.5	1.8	1.8	2.1	2.4
32.0	1.2	1.2	1.3	1.3	1.3	1.5	1.6	2.0	2.0	2.3	2.6
35.0	1.3	1.3	1.4	1.4	1.4	1.6	1.7	2.3	2.3	2.5	2.8
38.0	1.4	1.4	1.5	1.5	1.5	1.7	1.8	2.3	2.3	2.7	3.0
40.0	1.5	1.5	1.6	1.6	1.6	1.8	2.0	2.5	2.5	2.8	3.3
45.0	1.6	1.6	1.7	1.8	1.8	2.0	2.3	2.8	2.8	3.0	3.5
50.0	1.8	1.8	1.8	2.0	2.0	2.3	2.5	3.0	3.0	3.3	3.8
55.0	2.0	2.0	2.0	2.2	2.2	2.5	2.8	3.3	3.3	3.5	3.8
60.0	2.3	2.3	2.3	2.4	2.4	2.8	3.0	3.4	3.4	3.8	4.0
70.0	2.5	2.5	2.5	2.6	2.6	3.0	3.3	3.5	3.6	4.0	4.0
80.0	2.8	2.8	2.8	2.8	2.8	3.3	3.5	3.5	3.6	4.0	4.0
90.0	3.0	3.0	3.0	3.0	3.0	3.5	3.5	3.5	3.6	4.0	4.4
100.0	3.3	3.3	3.3	3.3	3.5	3.8	3.8	3.8	3.8	4.4	4.4
110.0	3.5	3.5	3.5	3.5	3.5	3.8	3.8	3.8	3.8	4.4	4.4
120.0	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	4.8	4.8
130.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	5.2	5.2
140.0	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	5.6	5.6
150.0	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	5.6	5.6
160.0	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8	5.6	5.6
180.0	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	6.3	6.3
200.0	5.8	5.8	6.0	6.0	6.0	6.0	6.0	6.0	6.0	7.0	7.0
250.0	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	8.8
300.0	7.5	7.5	9.0	9.0	9.0	9.0	9.0	9.0	9.0	9.0	9.0

TABLE A1.2 Permitted Variations in Mass for Rectangular Sheared Plates and Universal Mill Plates 2983 kg/m² and Under When Ordered to Mass

Note 1—Permitted variations in excess mass for lots of circular and sketch plates shall be 11/4 times the amounts in this table.

Note 2—Permitted variations in excess mass for single plates shall be 11/3 times the amounts in this table.

Note 3—Permitted variations in excess mass for single circular and sketch plates shall be 12/3 times the amounts in this table.

Note 4—The adopted standard density for rolled steel is 7850 kg/m³.

Note 5—Where "..." appears in this table, there is no requirement.

					Permitte	ed Variation	ons in A	verage M	ass of L	ots ^A for V Mas		iven in Mi Square M		, Express	sed in Pe	ercentage	of the S	specified				
Specified Mass, kg/m ²	a	200 nd der	to 1	1200 500, xcl	1500 to 1800, excl		1800 to 2100, excl		24	2100 to 2400, excl		0 to 00, kcl	30	0 to 00, ccl	33	00 to 00, kcl	3300 to 3600, excl		3600 to 4200, excl		4200 and Over	
	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under
To 51.02, excl	4.0	3.0	4.5	3.0	5.0	3.0	5.5	3.0	6.0	3.0	7.5	3.0	9.0	3.0								
51.02 to 62.80, excl	4.0	3.0	4.5	3.0	5.0	3.0	5.5	3.0	6.0	3.0	6.5	3.0	7.0	3.0	8.0	3.0	9.0	3.0				
62.80 to 74.58, excl	4.0	3.0	4.0	3.0	4.5	3.0	5.0	3.0	5.5	3.0	5.5	3.0	6.0	3.0	7.5	3.0	8.0	3.0	11	3.0		
74.58 to 86.35, excl	3.5	3.0	3.5	3.0	4.0	3.0	4.5	3.0	5.0	3.0	5.0	3.0	5.5	3.0	6.0	3.0	7.0	3.0	9.0	3.0	10	3.0
86.35 to 102.0, excl	3.5	2.5	3.5	2.5	3.5	3.0	4.0	3.0	4.5	3.0	4.5	3.0	5.0	3.0	5.5	3.0	6.0	3.0	8.0	3.0	9.0	3.0
102.0 to 125.6, excl	3.5	2.5	3.5	2.5	3.5	3.0	3.5	3.0	4.0	3.0	4.0	3.0	4.5	3.0	5.0	3.0	5.5	3.0	7.0	3.0	8.0	3.0
125.6 to 149.2, excl	3.0	2.5	3.5	2.5	3.5	2.5	3.5	3.0	3.5	3.0	3.5	3.0	4.0	3.0	4.5	3.0	5.0	3.0	6.5	3.0	7.0	3.0
149.2 to 196.2, excl	3.0	2.0	3.0	2.0	3.0	2.0	3.0	2.0	3.5	2.0	3.5	2.5	3.5	2.5	4.0	3.0	4.5	3.0	6.0	3.0	6.5	3.0
196.2 to 392.5, excl	2.5	2.0	3.0	2.0	3.0	2.0	3.0	2.0	3.5	2.0	3.5	2.0	3.5	2.5	3.5	3.0	4.0	3.0	5.5	3.0	6.0	3.0
392.5 to 588.8, excl	2.5	2.0	3.0	2.0	3.0	2.0	3.0	2.0	3.5	2.0	3.5	2.0	3.5	2.5	3.5	3.0	3.5	3.0	4.0	3.0	4.5	3.0
588.8 to 785.0, excl	2.5	1.5	2.5	1.5	2.5	1.5	2.5	1.5	2.5	2.0	2.5	2.0	2.5	2.0	2.5	2.0	2.5	2.0	3.0	2.0	3.5	2.0
785.0 to 1178, excl	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	3.0	1.0	3.5	1.0
1178 to 1962, excl	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	3.0	1.0
1962 to 2355, excl	2.0	1.0	2.0	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0
2355 to 2983, incl	2.0	1.0	2.0	1.0	2.0	1.0	2.0	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0	2.5	1.0

^A The term "lot" means all the plates of each tabular width and mass group represented in each shipment.

TABLE A1.3 Permitted Variations in Width and Length for Sheared Plates 40 mm and Under in Thickness; Length Only of Universal Mill Plates 65 mm and Under in Thickness

Specified Dimensions, mm		Permitted Variations Over Specified Width and Length ^a for Thicknesses Given in Millimetres and Equivaler Masses Given in Kilograms per Square Metre, mm									
		To 1	0.5, excl	10.5 t	o 16, excl	16 to	25, excl	25 to 50, incl ^B			
Length	Width	To 78	3.50, excl	78.50 to	125.6, excl	125.6 to	196.2, excl	196.2 to 392.5, excl			
		Width	Length	Width	Length	Width	Length	Width	Length		
To 3000, excl	To 1500, excl	10	13	11	16	13	19	16	25		
	1500 to 2100, excl	11	16	13	18	16	22	19	25		
	2100 to 2700, excl	13	19	16	22	19	25	25	29		
	2700 and over	16	22	19	25	22	29	29	32		
8000 to 6000, excl	To 1500, excl	10	19	13	22	16	25	19	29		
	1500 to 2100, excl	13	19	16	22	19	25	22	32		
	2100 to 2700, excl	14	22	18	24	21	29	25	35		
	2700 and over	16	25	19	29	22	32	29	35		
6000 to 9000, excl	To 1500, excl	10	25	13	29	16	32	19	38		
,	1500 to 2100, excl	13	25	16	29	19	32	22	38		
	2100 to 2700, excl	14	25	18	32	22	35	25	38		
	2700 and over	18	29	22	32	25	35	32	44		
9000 to 12 000, excl	To 1500, excl	11	29	13	32	16	35	19	41		
,	1500 to 2100, excl	13	32	16	35	19	38	22	41		
	2100 to 2700, excl	14	32	19	35	22	38	25	48		
	2700 and over	19	35	22	38	25	41	32	48		
2 000 to 15 000, excl	To 1500, excl	11	32	13	38	16	41	19	48		
	1500 to 2100, excl	13	35	16	38	19	41	22	48		
	2100 to 2700, excl	16	35	19	38	22	41	25	48		
	2700 and over	19	38	22	41	25	44	32	48		
5 000 to 18 000, excl	To 1500, excl	13	44	16	48	19	48	22	57		
,	1500 to 2100, excl	16	44	19	48	22	48	25	57		
	2100 to 2700, excl	16	44	19	48	22	48	29	57		
	2700 and over	22	44	25	51	29	57	32	64		
8 000 and over	To 1500, excl	14	51	19	54	22	57	25	70		
	1500 to 2100, excl	19	51	22	54	25	57	29	70		
	2100 to 2700, excl	19	51	22	54	25	57	32	70		
	2700 and over	25	51	29	60	32	64	35	76		

A Permitted variations under specified width and length, 6 mm. By agreement, these permitted variations may be taken all over, in which case the sum of the permitted variations applies.

B Permitted variations in length apply also to Universal Mill plates up to 300 mm in width for thicknesses over 50 to 65 mm, incl, except for alloy steel up to 50 mm thick.

TABLE A1.4 Permitted Variations in Width for Mill Edge Carbon and High Strength Low-Alloy Plates Produced on Strip Mills (Applies to Plates Produced from Coil and to Plates Produced from an As-Rolled Structural Product)

Specified Width, mm	Permitted Variation Over Specified Width, mm ^A
To 360, excl	11
360 to 430, excl	13
430 to 480, excl	14
480 to 530, excl	16
530 to 610, excl	17
610 to 660, excl	21
660 to 710, excl	24
710 to 890, excl	29
890 to 1270, excl	32
1270 to 1520, excl	38
1520 to 1650, excl	41
1650 to 1780, excl	44
1780 to 2030, excl	47
2030 and over	51

^A No permitted variation under specified width.

TABLE A1.5 Permitted Variations in Rolled Width for Universal Mill Plates 380 mm and Under in Thickness

	Permitte										
	Permitted Variations Over Specified Width ^A for Thickness Given in Millimetres or Equivalent Masses Given in Kilograms per Square Metre, mm										
Specified Width, mm	To 10, excl	10 to 16, excl	16 to 25, incl	25 to 50, incl	Over 50 to 250, incl	Over 250 to 400, incl					
	To 78.50, excl	78.50 to 125.6, excl	125.6 to 196.2, excl	196.2 to 392.5, incl	Over 392.5 to 1962, incl	Over 1962 to 3140, incl					
Over 200 to 500, excl		3	5	6	10	13					
500 to 900, excl 900 and over	5 8	6 10	8 11	10 13	11 14	14 16					

^A Permitted variation under specified width, 3 mm.

TABLE A1.6 Permitted Variations in Diameter for Sheared Circular Plates 25 mm and Under in Thickness

Specified Diameters, mm	Diame	Permitted Variations Over Specified Diameter for Thicknesses Given in Millimetres, mm ^A					
	To 10, excl	10 to 16, excl	16 to 25, incl				
To 800, excl	6	10	13				
800 to 2100, excl	8	11	14				
2100 to 2700, excl	10	13	16				
2700 to 3300, excl	11	14	17				
3300 and over	13	16	19				

^A No permitted variation under specified diameter.

TABLE A1.7 Permitted Variations in Diameter for Gas-Cut Circular Plates (Not Applicable to Alloy Steel)

Charified				over Specified Diamete es Given, mm ^A	r	
Specified Diameters, mm	To 25, excl	25 to 50, excl	50 to 100, excl	100 to 150, excl	150 to 200, excl	200 to 400, incl
To 800, excl	10	10	13	13	16	19
800 to 2100, excl	10	13	13	16	19	22
2100 to 2700, excl	13	14	16	19	22	25
2700 to 3300, excl	13	14	17	22	25	29
3300 and over	16	19	22	25	29	32

A No permitted variations under specified diameter.

TABLE A1.8 Permitted Variations in Width and Length for Rectangular Plates When Gas Cutting is Specified or Required (Applies to Alloy Steel Specifications Only)

Note 1—Plates with universal rolled edges will be gas cut to length only.

Note 2—These permitted variations shall be taken all under or divided over and under, if so specified.

Specified Thickness, mm	Permitted Variation Over Specified Width and Length, mm
To 50, excl	19
50 to 100, excl	25
100 to 150, excl	29
150 to 200, excl	33
200 to 400, excl	38

TABLE A1.9 Permitted Variations in Width and Length for Rectangular Plates When Gas Cutting is Specified or Required (Not Applicable to Alloy Steel)

Note 1—Plates with universal rolled edges will be gas cut to length only.

Specified Thickness, mm	Permitted Variation Over Specified Width and Length, mm ^A
To 50, excl	13
50 to 100, excl	16
100 to 150, excl	19
150 to 200, excl	22
200 to 400, incl	25

A These permitted variations shall be taken all under or divided over and under, if so specified.

TABLE A1.10 Permitted Variations in Diameter for Gas-Cut Circular Plates (Applies to Alloy Steel Specifications Only)

		Permitted Vari		Diameter for Specifi	ed Thicknesses	
Specified Diameter, mm			Given in Mil	imetres, mm ^A		
	To 25, excl	25 to 50, excl	50 to 100, excl	100 to 150, excl	150 to 200, excl	200 to 400, incl
To 800, excl	13	13	19	19	25	25
800 to 2100, excl	13	16	22	25	29	32
2100 to 2700, excl	16	19	25	29	32	35
2700 to 3300, incl	22	25	29	32	35	38

A No permitted variations under specified diameter.

TABLE A1.11 Permitted Camber^A for Carbon Steel, High-Strength Low-Alloy Steel, and Alloy Steel Universal Mill Plates and High-Strength Low-Alloy Steel and Alloy Steel Sheared or Gas-Cut Rectangular Plates

Specified Width, mm	Permitted Camber, mm
To 750, incl	Length in millimetres/300
Over 750 to 1500	Length in millimetres/250

A Camber as it relates to plates is the horizontal edge curvature in the length, measured over the entire length of the plate in the flat position.

TABLE A1.12 Permitted Camber^A for Sheared Plates and Gas-Cut Rectangular Plates, All Thicknesses (Applies to Carbon Steel Only)

Permitted camber, mm = length in millimetres/500

^A Camber as it relates to plates is the horizontal edge curvature in the length, measured over the entire length of the plate in the flat position.

TABLE A1.13 Permitted Variations From a Flat Surface for Standard Flatness Carbon Steel Plates

Note 1—When the longer dimension is under 900 mm, the permitted variation from a flat surface shall not exceed 6 mm. When the longer dimension is from 900 to 1800 mm, incl, the permitted variation from a flat surface shall not exceed 75 % of the tabular amount for the specified width, but in no case less than 6 mm.

Note 2—These permitted variations apply to plates that have a specified minimum tensile strength of not more than 415 MPa or comparable chemical composition or hardness. The limits in this table are increased 50 % for plates that have a higher specified minimum tensile strength or comparable chemical composition or hardness.

Note 3—This table and these notes cover the permitted variations from a flat surface for circular and sketch plates, based upon the maximum dimensions of such plates.

Note 4—Where "..." appears in this table, there is no requirement.

Note 5—Plates must be in a horizontal position on a flat surface when flatness is measured.

			Permitted Variations From a Flat Surface for Specified Widths Given in Millimetres, mm ^{A,B}										
Specified Thickness, mm	Specified Mass, kg/m ²	To 900, excl	900 to 1200, excl	1200 to 1500, excl	1500 to 1800, excl	1800 to 2100, excl	2100 to 2400, excl	2400 to 2700, excl	2700 to 3000, excl	3000 to 3600, excl	3600 to 4200, excl	4200 and over	
To 6, excl	To 47.1, excl	14	19	24	32	35	38	41	44	48			
6 to 10, excl	47.1 to 78.5, excl	13	16	19	24	29	32	35	38	41			
10 to 12, excl	78.5 to 94.2, excl	13	14	16	16	19	22	25	29	32	48	54	
12 to 20, excl	94.2 to 157.0, excl	11	13	14	16	16	19	25	25	29	38	51	
20 to 25, excl	157.0 to 196.2, excl	11	13	14	16	16	16	19	22	25	35	44	
25 to 50, excl	196.2 to 392.5, excl	10	13	13	14	14	16	16	16	18	29	38	
50 to 100, excl	392.5 to 785.0, excl	8	10	11	13	13	13	13	14	16	22	29	
100 to 150, excl	785.0 to 1178, excl	10	11	13	13	14	14	16	19	22	22	25	
150 to 200, excl	1178 to 1570, excl	11	13	13	16	18	19	22	22	25	25	25	
200 to 250, excl	1570 to 1962, excl	13	13	16	18	19	21	22	24	25	25	25	
250 to 300, excl	1962 to 2355, excl	13	16	19	21	22	24	25	25	25	25	25	
300 to 400, incl	2355 to 3140, incl	16	19	21	22	24	25	25	25	25	25		

A Permitted Variation From a Flat Surface Along the Length—The longer dimension specified is considered the length, and the permitted variation from a flat surface along the length shall not exceed the tabular amount for the specified width for plates up to 4000 mm in length, or in any 4000 mm for longer plates.

TABLE A1.14 Permitted Variations From a Flat Surface for Standard Flatness High-Strength Low-Alloy Steel and Alloy Steel Plates, Hot Rolled or Thermally Treated

Note 1—When the longer dimension is under 900 mm, the permitted variation from a flat surface shall not exceed 10 mm. When the longer dimension is from 900 to 1800 mm, incl, the permitted variation from a flat surface shall not exceed 75 % of the tabular amount for the specified width.

Note 2—This table and these notes cover the permitted variations from a flat surface for circular and sketch plates, based upon the maximum dimensions of such plates.

Note 3—Where "..." appears in this table, there is no requirement.

Note 4—Plates must be in a horizontal position on a flat surface when flatness is measured.

		Permitted Variations from a Flat Surface for Specified Widths Given in Millimetres, mm ^{A,B}										
Specified Thickness, mm	Specified Mass, kg/m²	To 900, excl	900 to 1200, excl	1200 to 1500, excl	1500 to 1800, excl	1800 to 2100, excl	2100 to 2400, excl	2400 to 2700, excl	2700 to 3000, excl	3000 to 3600, excl	3600 to 4200, excl	4200 and over
To 6, excl	To 47.1, excl	21	29	35	48	51	57	60	67	70		
6 to 10, excl	47.1 to 78.5, excl	19	24	29	35	44	48	51	57	60		
10 to 12, excl	78.5 to 94.2, excl	19	22	24	24	29	33	38	41	48	70	79
12 to 20, excl	94.2 to 157.0, excl	16	19	22	22	25	29	32	35	41	57	76
20 to 25, excl	157.0 to 196.2, excl	16	19	22	22	24	25	29	33	38	51	67
25 to 50, excl	196.2 to 392.5, excl	14	16	19	21	22	24	25	25	25	41	57
50 to 100, excl	392.5 to 785.0, excl	13	14	18	19	19	19	19	22	25	32	41
100 to 150, excl	785.0 to 1178, excl	14	18	19	19	22	22	24	29	32	32	38
150 to 200, excl	1178 to 1570, excl	16	19	19	24	25	29	32	33	38	38	38
200 to 250, excl	1570 to 1962, excl	19	21	24	25	29	32	33	35	38	38	38
250 to 300, excl	1962 to 2355, excl	19	24	29	32	33	35	38	38	38	38	38
300 to 400, incl	2355 to 3140, incl	22	25	30	33	35	38	38	38	38	38	38

A Permitted Variation From a Flat Surface Along the Length—The longer dimension specified is considered the length, and the permitted variation from a flat surface along the length shall not exceed the tabular amount for the specified width in plates up to 4000 mm in length, or in any 4000 mm for longer plates.

B Permitted Variation From a Flat Surface Across the Width—The permitted variation from a flat surface across the width shall not exceed the tabular amount for the specified width.

B Permitted Variation From a Flat Surface Across the Width—The permitted variation from a flat surface across the width shall not exceed the tabular amount for the specified width.

TABLE A1.15 Permitted Variations in Waviness for Standard Flatness Plates

Note 1—Waviness denotes the maximum deviation of the surface of the plate from a plane parallel to the surface of the point of measurement and contiguous to the surface of the place at each of the two adjacent wave peaks, when the plate is resting on a flat horizontal surface, as measured in an increment of less than 4000 mm of length. The permitted variation in waviness is a function of the permitted variation from a flat surface as obtained from Table A1.13 or Table A1.14, whichever is applicable.


Note 2—Plates must be in a horizontal position on a flat surface when waviness is measured.

Permitted Variation from a Flat Surface (from Table	Permitted Variations in Waviness, mm, When Number of Waves in 4000 mm is								
Table A1.13 or Table A1.14), mm	1	2	3	4	5	6	7		
8	8	6	5	3	3	2	2		
10	10	8	5	5	3	2	2		
11	11	8	6	5	3	3	2		
13	13	10	8	5	5	3	2		
14	14	11	8	6	5	3	2		
16	16	13	10	6	5	3	2		
17	17	13	10	8	5	5	2		
19	19	14	11	8	6	5	2		
21	21	16	11	8	6	5	2		
22	22	17	13	10	6	5	2		
24	24	17	13	10	8	6	5		
25	25	19	14	11	8	6	5		
29	29	22	16	13	10	6	5		
32	32	24	17	13	10	8	6		
35	35	27	19	14	11	8	6		
38	38	29	22	16	13	10	6		
41	41	32	24	17	13	10	8		
44	44	33	25	19	14	11	8		
48	48	37	27	21	14	11	8		
51	51	38	29	22	16	13	10		
54	54	41	30	22	17	13	10		
57	57	43	32	24	17	14	10		
60	60	46	33	25	19	14	11		
64	64	48	37	27	21	14	11		
67	67	51	38	29	21	16	11		
70	70	52	40	29	22	16	13		
73	73	56	41	30	24	17	13		
76	76	57	43	32	24	17	14		
79	79	60	44	33	25	19	14		

TABLE A1.16 Permitted Variations in Cross Section for W, HP, S, M, C, and MC Shapes

Note 1—A is measured at center lines of web for S, M, W, and HP shapes; at back of web for C and MC shapes. Measurement is overall for C shapes under 75 mm. B is measured parallel to flange. C is measured parallel to web.

Note 2—Where "..." appears in this table, there is no requirement.

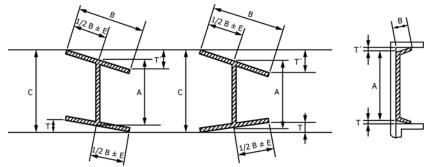

			Permit							
Shape	Section Nominal Size, mm	A, Depth B, Flange Width		T + T ' ^A Flanges Out- of-Square ^B	E, Web	C, Maximum Depth at any Cross Section	Permitted Variations Over or Un- der Theoretical Web Thickness for Thicknesses Given in Millimetres, mm			
		Over Theoretical	Under Theoretical	Over Theoretical	Under Theoretical	oi-oquale		over Theoret- ical Depth	5 and Under	Over 5
W and HP	up to 310, incl	4	3	6	5	6	5	6		
	over 310	4	3	6	5	8	5	6		
S and M	75 to 180, incl	2	2	3	3	0.03	5			
	over 180 to 360, incl	3	2	4	4	0.03	5			
	over 360 to 610, incl	5	3	5	5	0.03	5			
C and MC	40 and under	1	1	1	1	0.03			0.2	0.4
	over 40 to 75, excl	2	2	2	2	0.03			0.4	0.5
	75 to 180, incl	3	2	3	3	0.03				
	over 180 to 360, incl	3	3	3	4	0.03				
	over 360	5	4	3	5	0.03				


A T + T applies when flanges of channels are toed in or out. For channels 16 mm and under in depth, the permitted out-of-square is 0.05 mm/mm of depth. The permitted variation shall be rounded to the nearest millimetre after calculation.

^B Permitted variation is per millimetre of flange width for S, M, C, and MC shapes.

^C Permitted variation of 8 mm max for sections over 634 kg/m.

TABLE A1.17 Permitted Variations in Cross Section for Angles (L Shapes), Bulb Angles, and Zees

Note 1—Where "..." appears in this table, there is no requirement.

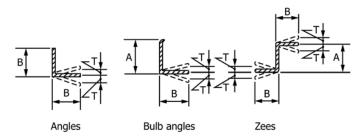


		Permitt	ed Variations in	Sectional Dime	ensions Give	n, mm			
Section	Nominal Size, mm	A, D	epth	B, Flange Width, or Length of Leg		T, Out-of- Square per	Permitted Variations Over or Under Theoretical Thickness for Thick- nesses Given in Millimetres, mm		
		Over Theoretical	Under Theoretical	Over Theoretical	Under Theoretical	Millimetre of B	5 and Under	Over 5 to 10	Over 10
Angles ^A (L shapes)	25 and under			1	1	0.026 ^B	0.2	0.2	
	Over 25 to 51, incl			1	1	0.026^{B}	0.2	0.2	0.3
	Over 51 to 64, incl			2	2	0.026^{B}	0.3	0.4	0.4
	Over 64 to 102, incl			3	2	0.026^{B}			
	Over 102 to 152, incl			3	3	0.026^{B}			
	Over 152 to 203, incl			5	3	0.026^{B}			
	Over 203 to 254, incl			6	6	0.026^{B}			
	Over 254		•••	6	10	0.026 ^B			
Bulb angles	(depth) 76 to 102, incl	3	2	4	2	0.026 ^B			
· ·	Over 102 to 155, incl	3	2	4	3	0.026^{B}			
	Over 152	3	2	5	3	0.026^{B}			
Zees	76 to 102, incl	3	2	4	2	0.026 ^B			
	Over 102 to 152, incl	3	2	4	3	0.026^{B}			

TABLE A1.18 Permitted Variations in Sectional Dimensions for Rolled Tees

Note 1-*Back of square and center line of stem are to be parallel when measuring "out-of-square."

Note 2—Where "..." appears in this table, there is no requirement.



		Permitted Variations in Sectional Dimensions Given, mm									
Naminal CineA	A, Depth ^B		B, W	/idth ^B	T, Out-of-	E, Web	Stem	Thickness of Flange		Thickness of Stem	
Nominal Size ^A	Over	Under	Over	Under	 Square per Millimetre of B 	Off-Cen- ter, max	Out-of- Square ^C	Over	Under	Over	Under
30 and under	1	1	1	1			1	0.2	0.2	0.1	0.5
Over 30 to 50, incl	2	2	2	2			2	0.3	0.3	0.2	0.5
Over 50 to 75, excl	2	2	2	2			2	0.4	0.4	0.4	0.5
75 to 125, incl	2	2	3	3	0.03	2					
Over 125 to 180, incl	2	2	3	3	0.03	3					

A The longer member of an unequal tee determines the size for permitted variations.

 $^{^{}A}$ For unequal leg angles, longer leg determines classification. B 0.026 mm/mm = 1½ $^{\circ}$. The permitted variation shall be rounded to the nearest millimetre after calculation.

B Measurements for both depth and width are overall.

Stem out-of-square is the permitted variation from its true position of the center line of stem, measured at the point.

TABLE A1.19 Permitted Variations in Length for S, M, C, MC, L, T, Z, and Bulb Angle Shapes

Note 1—Where "..." appears in this table, there is no requirement.

Nominal		Permitted Variations From Specified Length for Lengths Given in Metres, mm												
Size, ^A mm	1.5 to 3, excl 3 to 6, excl		6, excl	6 to 9, incl		Over 9 to 12, incl		Over 12 to 15, incl		Over 15 to 20, incl		Over 20 m		
Size," mm	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under	Over	Under
Under 75	16	0	25	0	38	0	51	0	64	0	64	0		
75 and over	25	0	38	0	45	0	57	0	70	0	70	0		

A Greatest cross-sectional dimension.


TABLE A1.20 Permitted Variations in End Out-of-Square for S, M, C, MC, L, T, Z, Bulb Angle, and Flat Bar Shapes

	-
Shapes	Permitted Variation
S, M, C, and MC	0.017 mm per millimetre of depth 0.026 mm per millimetre of leg length or 1½ °
Bulb angles	0.026 mm per millimetre of depth or 1½ °
Rolled tees ^A	0.017 mm per millimetre of flange or stem
Zees	0.026 mm per millimetre of sum of both flange lengths
Flat Bars ^B	0.017 mm per millimetre of width but not less than 2 mm

^A Permitted variations in ends out-of-square are determined on the longer mem-

bers of the shape. $\ensuremath{^{\mathcal{B}}}$ For flat bars, permitted variations in end out-of-square are determined on the width of the bar.

TABLE A1.21 Permitted Variations in Straightness for S, M, C, MC, L, T, Z, and Bulb Angle Shapes

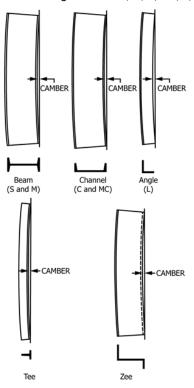

Positions for Measuring Camber of Shapes

Variable	Nominal Size, ^A mm	Permitted Variation, mm
Camber	Under 75	4 × number of metres of total length
	75 and over	2 × number of metres of total length
Sweep	All	Due to the extreme variations in flexibility of these shapes, permitted variations for sweep are subject to negotiations
		between the manufacturer and the purchaser for the individual sections involved.

A Greatest cross-sectional dimension.

TABLE A1.22 Permitted Variations in Length for W and HP Shapes

Permitted Variations from Specified Leng	gth for Lengths Given in Metres, mm ^{A, B}
Over	Under
100	0

^A For HP and W shapes specified in the order for use as bearing piles, the permitted variations in length are plus 125 and minus 0 mm. These permitted variations in length also apply to sheet piles.

^B The permitted variations in end out-of-square for W and HP shapes shall be


^B The permitted variations in end out-of-square for W and HP shapes shall be 0.016 mm per millimetre of depth, or per millimetre of flange width if the flange width is larger than the depth. The permitted variations shall be rounded to the nearest millimetre after calculation.

TABLE A1.23 Permitted Variations for Length and End Out-of-Square, Milled Shapes

			Permitted Variations in Length and End Out-of-Square, mm ^A								
			Milled Both Ends ^B Milled One End ^B								
		Le	ngth		Length						
Nominal Depth, mm	Length, ^C m	Over	Under	End Out- of-Square	Over	Under	End Out- of-Square- (for Milled End)				
150 to 920	2 to 21	1	1	1	6	6	1				

A The permitted variations in length and end out-of-square are additive.

TABLE A1.24 Permitted Variations in Straightness for W and HP Shapes



Positions for Measuring Camber and Sweep of W and HP Shapes

	Permitted Variation in Straightness, mm
Camber and sweep	1 × number of metres of total length ^A
When certain sections ^B with a flange width approximately equal to depth are specified in the order for use as columns:	
Lengths of 14 m and under	1 × number of metres of total length, but not over 10
Lengths over 14 m	10 + [1 × (number of metres of total length – 14 m)]

A Sections with a flange width less than 150 mm, permitted variation for sweep, mm = 2 × number of metres of total length.

^B End out-of-square is measured by (a) squaring from the center line of the web and (b) squaring from the center line of the flange. The measured variation from true squareness in either plane shall not exceed the total tabular amount.

^C Length is measured along center line of web. Measurements are made with the steel and tape at the same temperature.

^B Applies only to:

Applies only to:
200-mm deep sections—46.1 kg/m and heavier,
250-mm deep sections—73 kg/m and heavier,
310-mm deep sections—97 kg/m and heavier,
360-mm deep sections—116 kg/m and heavier,
410-mm deep sections—131 kg/m and heavier,
410-mm deep sections—202 kg/m and heavier,
For other sections specified in the order for use as columns, the permitted variation is subject to negotiation with the manufacturer.

TABLE A1.25 Permitted Variations in Dimensions for Split Tees and Split Angles (L Shapes)A

	ap/
	Permitted Variation Over or
Specified Depth, mm	Under
	Specified Depth, ^B mm
To 150, excl (beams and channels)	3
150 to 410, excl (beams and channels)	5
410 to 510, excl (beams and channels)	6
510 to 610, excl (beams)	8
610 and over (beams)	10

A The permitted variations in length for split tees or angles are the same as those

 $straightness = 2 \text{ mm} \times length in metres}$

TABLE A1.26 Permitted Variations in Sectional Dimensions for Square-Edge and Round-Edge Flat Bars

Note 1-Where "..." appears in this table, there is no requirement.

Specified Widths,	Permitted Variations Over or Under Specified Thickness, for Thicknesses Given in Millimetres, mm Permitted Variations from Specified Width, mm								
mm	Over 5 to 6, incl	Over 6 to 12, incl	Over 12 to 25, incl	Over 25 to 50, incl	Over 50 to 75	Over 75	Over	Under	
To 25, incl	0.18	0.20	0.25				0.5	0.5	
Over 25 to 50, incl	0.18	0.30	0.40	0.8			1.0	1.0	
Over 50 to 100, incl	0.20	0.40	0.50	0.8	1.2	1.2	1.5	1.0	
Over 100 to 150, incl	0.25	0.40	0.50	0.8	1.2	1.2	2.5	1.5	
Over 150 to 200, incl	Α	0.40	0.65	0.8	1.2	1.6	3.0	2.5	

^A Flats over 150 to 200 mm, incl, in width are not available as hot-rolled bars in thickness 6 mm and under.

TABLE A1.27 Permitted Variations in Sectional Dimensions for Round and Square Bars and Round-Cornered Squares

Note 1—Where "..." appears in this table, there is no requirement.

Specified Sizes, mm	Permitted Ov or Under Siz	er Specified	Permitted Out-of- Round or Out-of- Square Section ^A		
	mm	%	mm	%	
Up to 7.0, incl	0.13		0.20		
Over 7.0 to 11.0, incl	0.15		0.22		
Over 11.0 to 15.0, incl	0.18		0.27		
Over 15.0 to 19.0, incl	0.20		0.30		
Over 19.0 to 250, incl		1 ^B		1½ B	

A Out-of-round is the difference between the maximum and minimum diameters of the bar, measured at the same transverse cross section. Out-of-square section is the difference in perpendicular distance between opposite faces, measured at the same transverse cross section.

^B The permitted variation shall be rounded to the nearest tenth of a millimetre after

applicable to the section from which the tees or angles are split.

B The above permitted variations in depth of tees or angles include the permitted variations in depth for the beams or channels before splitting. Permitted variations in dimensions and straightness, as set up for the beams or channels from which these tees or angles are cut, apply, except

calculation.

TABLE A1.28 Permitted Variations in Sectional Dimensions for Hexagons

Specified Sizes Between Opposite Sides, mm		ariations from Size, mm	Out-of- Hexagon Section.
Opposite Sides, film	Over	Under	mm ^A
To 13 incl	0.18	0.18	0.3
Over 13 to 25 incl	0.25	0.25	0.4
Over 25 to 40 incl	0.55	0.35	0.6
Over 40 to 50 incl	0.8	0.40	0.8
Over 50 to 65 incl	1.2	0.40	1.2
Over 65 to 80 incl	1.6	1.6	

A Out-of-hexagon section is the greatest difference in distance between any two opposite faces, measured at the same transverse cross section.

TABLE A1.29 Permitted Variations in Straightness for Bars

Maximum Permitted Variation in Straightness, mm^A 6 mm in any 1500 mm and (length in millimetres/250)^B

TABLE A1.30 Permitted Variations in Length for Hot-Cut Steel Bars^A

Note 1—Where "..." appears in this table, there is no requirement.

Specified Sizes of Rounds,	Specified	Sizes of Flats, mm		Permitted Variations Over Specified Lengths Given in Metres, mm (No Variation Under)					
Squares, and Hexagon mm	s, Thickness	Width	1.5 to 3, excl	3 to 6, excl	6 to 9, excl	9 to 12, excl	12 to 18, incl		
To 25, incl	to 25, incl	to 75, incl	15	20	35	45	60		
Over 25 to 50, incl	over 25	to 75, incl	15	25	40 40	50 50	65		
	to 25, incl	over 75 to 150, incl	15	25			65		
Over 50 to 125, incl	over 25	over 75 to 150, incl	25	40	45	60	70		
Over 125 to 250, incl				65	70 45	75 90	85 100		
	over 6 to 25, incl			30					
	over 25 to 75, incl	over 150 to 200, incl	30	45	50	90	100		
Bar size sections		•••	15	25	40	50	65		
		ŀ	Hot Sawing						
50 to 125, incl	25 and over	75 and over	В	40	45	60	70		
Over 125 to 250, incl		•••	В	65	70	75	85		

^A For flats over 150 to 200 mm, incl, in width and over 75 mm in thickness, consult the manufacturer for permitted variations in length.

TABLE A1.31 Permitted Variations in Length for Bars Recut Both Ends After Straightening A,B

Sizes of Rounds, Squares, Hexagons, Widths of Flats and Maximum Dimen-	Permitted Va Specified Length G (No Variat	
sions of Other Sections, mm	to 3.7, incl	over 3.7
To 75, incl	6	8
Over 75 to 150, incl	8	11
Over 150 to 200, incl	11	14
Rounds over 200 to 250, incl	14	18

A For flats over 150 to 200 mm, incl, in width, and over 75 mm in thickness, consult the manufacturer or the processor for permitted variations in length.

^A Permitted variations in straightness do not apply to hot-rolled bars if any subsequent heating operation has been performed.

Bround to the nearest whole millimetre.

^B Smaller sizes and shorter lengths are not commonly hot sawed.


^B Permitted variations are sometimes required all over or all under the specified length, in which case the sum of the two permitted variations applies.

A2. DIMENSIONS OF STANDARD SHAPE PROFILES

A2.1 Listed herein are dimensions and weight [mass] of some standard shape profiles. The values stated in inch-pound units are independent of the values stated in SI units, and the values from the two systems are not to be combined in any

way. Unless the order specifies the applicable "M" specification designation (SI units), the material shall be furnished to inch-pound units.

TABLE A2.1 "W" Shapes



Designation (Nominal			Flar	nge		Designation [Nominal			Fla	nge	Web
Depth in Inches and Weight in Pounds per Linear Foot)	Area A, in. ²	Depth d, in.	Width b _f , in.	Thick- ness t _f , in. ^A	Web Thickness t_{w} , in. ^A	Depth in Milli- metres and Mass in Kilo- grams per Metre]	Area <i>A</i> , mm²	Depth d, mm	Width b _f mm	Thick- ness, $t_{\mathfrak{f}}$ mm ^A	Thick- ness t _w , mm ^A
W44 × 408	120.5	44.80	16.142	2.165	1.220	W1100 × 607	77 740	1 138	410	55.0	31.0
× 368	108.9	44.41	16.024	1.969	1.102	× 548	70 250	1 128	407	50.0	28.0
× 335	98.7	44.02	15.945	1.770	1.025	× 499	63 500	1 118	405	45.0	26.0
× 290	85.8	43.62	15.825	1.575	0.865	× 433	55 100	1 108	402	40.0	22.0
× 262	77.2	43.31	15.750	1.415	0.785	× 390	49 700	1 100	400	36.0	20.0
× 230	67.9	42.91	15.750	1.220	0.710	× 343	43 600	1 090	400	31.0	18.0
W40 × 655	192.6	43.62	16.870	3.540	1.970	W1000 × 976	124 300	1 108	428	89.9	50.0
× 593	174.4	42.99	16.690	3.230	1.790	× 883	112 500	1 092	424	82.0	45.5
× 503	147.8	42.05	16.415	2.755	1.535	× 748	95 300	1 068	417	70.0	39.0
× 431	126.7	41.26	16.220	2.360	1.340	× 642	81 800	1 048	412	60.0	34.0
× 397	117.0	40.95	16.120	2.200	1.220	× 591	75 300	1 040	409	55.9	31.0
× 372	109.4	40.63	16.065	2.045	1.160	× 554	70 600	1 032	408	52.0	29.5
× 362	107.0	40.55	16.020	2.010	1.120	× 539	68 700	1 030	407	51.1	28.4
× 324	95.3	40.16	15.910	1.810	1.000	× 483	61 500	1 020	404	46.0	25.4
× 297	87.4	39.84	15.825	1.650	0.930	× 443	56 400	1 012	402	41.9	23.6
× 277	81.3	39.69	15.830	1.575	0.830	× 412	52 500	1 008	402	40.0	21.1
× 249	73.3	39.38	15.750	1.420	0.750	× 371	47 300	1 000	400	36.1	19.0
× 215	63.3	38.98	15.750	1.220	0.650	× 321	40 800	990	400	31.0	16.5
× 199	58.4	38.67	15.750	1.065	0.650	× 296	37 700	982	400	27.1	16.5
W40 × 392	115.3	41.57	12.360	2.520	1.415	W1000 × 584	74 400	1 056	314	64.0	36.0
× 331	97.5	40.79	12.165	2.125	1.220	× 494	62 900	1 036	309	54.0	31.0
× 327	95.9	40.79	12.130	2.130	1.180	× 486	61 900	1 036	308	54.1	30.0
× 294	86.2	40.39	12.010	1.930	1.060	× 438	55 600	1 026	305	49.0	26.9
× 278	81.9	40.16	11.970	1.810	1.025	× 415	52 800	1 020	304	46.0	26.0
× 264	77.6	40.00	11.930	1.730	0.960	× 393	50 100	1 016	303	43.9	24.4
× 235	68.9	39.69	11.890	1.575	0.830	× 350	44 600	1 008	302	40.0	21.1
× 211	62.0	39.37	11.810	1.415	0.750	× 314	40 000	1 000	300	35.9	19.1
× 183	53.7	38.98	11.810	1.200	0.650	× 272	34 600	990	300	31.0	16.5
× 167	49.1	38.59	11.810	1.025	0.650	× 249	31 700	980	300	26.0	16.5
× 149	43.8	38.20	11.810	0.830	0.630	× 222	28 200	970	300	21.1	16.0
W36 × 925	271.9	43.05	18.620	4.530	3.020	W920 × 1377	175 400	1 093	473	115.1	76.7
× 853	250.6	43.05	18.150	4.530	2.520	× 1269	161 700	1 093	461	115.1	64.0
× 802	235.9	42.57	17.990	4.290	2.380	× 1194	152 200	1 081	457	109.0	60.5
× 723	212.7	41.79	17.755	3.900	2.165	× 1077	137 200	1 061	451	99.1	55.0
× 652	191.7	41.05	17.575	3.540	1.970	× 970	123 700	1 043	446	89.9	50.0
× 529	155.6	39.79	17.220	2.910	1.610	× 787	100 400	1 011	437	73.9	40.9
× 487	143.2	39.33	17.105	2.680	1.500	× 725	92 400	999	434	68.1	38.1
× 441	129.7	38.85	16.965	2.440	1.360	× 656	83 700	987	431	62.0	34.5

TABLE A2.1 Continued

					IADLL AZ.I	Continued					
Designation			Floor			Designation					
(Nominal			Flar	nge		[Nominal			Flar	nge	Web
Depth in	Area	Depth		Thick-	Web	Depth in Milli-	Area A,	Depth		Thick-	Thick-
Inches and	Α,	d,	Width		Thickness	metres and		d,	Width		ness
Weight in	in. ²	in.	b_t	ness	t _w , in. ^A	Mass in Kilo-	mm ²	mm	b_{f}	ness,	t _w ,
	"".			t_f ,	'w' '''.					t_f	'w' A
Pounds per			in.	in. ^A		grams per			mm	mm ^A	mm ^A
Linear Foot)						Metre]					1
205	1100	00.07	10.000	0.000	1,220	500	75 000	975	427	55.9	01.0
× 395	116.2	38.37	16.830	2.200		× 588					31.0
× 361	106.1	37.99	16.730	2.010	1.120	× 537	68 500	965	425	51.1	28.4
× 330	97.0	37.67	16.630	1.850	1.020	× 491	62 600	957	422	47.0	25.9
× 302	88.8	37.33	16.655	1.680	0.945	× 449	57 600	948	423	42.7	24.0
× 282	82.9	37.11	16.595	1.570	0.885	× 420	53 500	943	422	39.9	22.5
× 262	77.0	36.85	16.550	1.440	0.840	× 390	49 700	936	420	36.6	21.3
× 247	72.5	36.67	16.510	1.350	0.800	× 368	46 800	931	419	34.3	20.3
× 231	68.0	36.49	16.470	1.260	0.760	× 344	43 900	927	418	32.0	19.3
× 201	00.0	00.43	10.470	1.200	0.700	1 ^ 0	1 40 300	327	710	02.0	10.0
						1					1
W36 × 387	113.6	39.09	12.677	2.559	1.421	W920 × 576	73 320	993	322	65.0	36.1
× 350	102.9	38.62	12.559	2.319	1.299	× 521	66 370	981	319	58.9	33.0
× 318	93.6	38.23	12.441	2.130	1.181	× 474	60 390	971	316	54.1	30.0
						1					
× 286	84.0	37.83	12.323	1.929	1.059	× 425	54 200	961	313	49.0	26.9
× 256	75.4	37.43	12.215	1.730	0.960	× 381	48 600	951	310	43.9	24.4
× 232	68.1	37.12	12.120	1.570	0.870	× 345	44 000	943	308	39.9	22.1
× 210	61.8	36.69	12.180	1.360	0.830	× 313	39 900	932	309	34.5	21.1
× 194	57.0	36.49	12.115	1.260	0.765	× 289	36 800	927	308	32.0	19.4
× 182	53.6	36.33	12.075	1.180	0.725	× 271	34 600	923	307	30.0	18.4
× 170	50.0	36.17	12.030	1.100	0.680	× 253	32 300	919	306	27.9	17.3
× 160	47.0	36.01	12.000	1.020	0.650	× 238	30 300	915	305	25.9	16.5
× 150	44.2	35.85	11.975	0.940	0.625	× 223	28 500	911	304	23.9	15.9
× 135	39.7	35.55	11.950	0.790	0.600	× 201	25 600	903	304	20.1	15.2
W00 007	1110	05.05	10 000	0 000	1 000	W040 570	70 500	040	444	F7.0	1 00 0
W33 × 387	114.0	35.95	16.200	2.280	1.260	W840 × 576	73 500	913	411	57.9	32.0
× 354	104.1	35.55	16.100	2.090	1.160	× 527	67 200	903	409	53.1	29.5
× 318	93.5	35.16	15.985	1.890	1.040	× 473	60 300	893	406	48.0	26.4
× 291	85.6	34.84	15.905	1.730	0.960	× 433	55 200	885	404	43.9	24.4
× 263	77.4	34.53	15.805	1.570	0.870	× 392	49 900	877	401	39.9	22.1
× 241	70.9	34.18	15.860	1.400	0.830	× 359	45 700	868	403	35.6	21.1
× 221	65.0	33.93	15.805	1.275	0.775	× 329	41 900	862	401	32.4	19.7
× 201	59.1				0.715	× 299	38 100	855	400	29.2	18.2
X 201	59.1	33.68	15.745	1.150	0.715	× 299	36 100	000	400	29.2	10.2
						1					1
W33 × 169	49.5	33.82	11.500	1.220	0.670	W840 × 251	31 900	859	292	31.0	17.0
× 152	44.7	33.49	11.565	1.055	0.635	× 226	28 800	851	294	26.8	16.1
× 141		33.30			0.605	× 210	26 800		293	24.4	15.4
	41.6		11.535	0.960		1		846			
× 130	38.3	33.09	11.510	0.855	0.580	× 193	24 700	840	292	21.7	14.7
× 118	34.7	32.86	11.480	0.740	0.550	× 176	22 400	835	292	18.8	14.0
						1					1
W00 001	1150	00.40	15 500	0.440	1 000	W/700 500	74 000	040	200	62.0	045
W30 × 391	115.0	33.19	15.590	2.440	1.360	W760 × 582	74 200	843	396		34.5
× 357	104.8	32.80	15.470	2.240	1.240	× 531	67 600	833	393	56.9	31.5
× 326	95.7	32.40	15.370	2.050	1.140	× 484	61 700	823	390	52.1	29.0
× 292	85.7	32.01	15.255	1.850	1.020	× 434	55 300	813	387	47.0	25.9
	76.7					× 389	49 500	803	385	41.9	23.6
× 261		31.61	15.155	1.650	0.930						
× 235	69.0	31.30	15.055	1.500	0.830	× 350	44 500	795	382	38.1	21.1
× 211	62.0	30.94	15.105	1.315	0.775	× 314	40 000	786	384	33.4	19.7
× 191	56.1	30.68	15.040	1.185	0.710	× 284	36 200	779	382	30.1	18.0
							32 800		381		
× 173	50.8	30.44	14.985	1.065	0.655	× 257	JZ 600	773	301	27.1	16.6
						1					1
W30 × 148	43.5	30.67	10.480	1.180	0.650	W760 × 220	28 100	779	266	30.0	16.5
× 132	38.9	30.31	10.545	1.000	0.615	× 196	25 100	770	268	25.4	15.6
× 124						× 185					
	36.5	30.17	10.515	0.930	0.585		23 500	766	267	23.6	14.9
× 116	34.2	30.01	10.495	0.850	0.565	× 173	22 100	762	267	21.6	14.4
× 108	31.7	29.83	10.475	0.760	0.545	× 161	20 500	758	266	19.3	13.8
× 99	29.1	29.65	10.450	0.670	0.520	× 147	18 800	753	265	17.0	13.2
× 90	26.4	29.53	10.400	0.610	0.470	× 134	17 000	750	264	15.5	11.9
						1					1
W27 × 539	158.4	32.52	15.255	3.540	1.970	W690 × 802	102 200	826	387	89.9	50.0
× 368	108.1	30.39	14.665	2.480	1.380	× 548	69 800	772	372	63.0	35.1
× 336	98.7	30.0	14.550	2.280	1.260	× 500	63 700	762	369	57.9	32.0
× 307	90.2	29.61	14.445	2.090	1.160	× 457	58 200	752	367	53.1	29.5
× 281	82.6	29.29	14.350	1.930	1.060	× 419	53 300	744	364	49.0	26.9
× 258	75.7	28.98	14.270	1.770	0.980	× 384	48 900	736	362	45.0	24.9
× 235	69.1	28.66	14.190	1.610	0.910	× 350	44 600	728	360	40.9	23.1
× 217	63.8	28.43	14.115	1.500	0.830	× 323	41 100	722	359	38.1	21.1
× 194	57.0	28.11	14.035	1.340	0.750	× 289	36 800	714	356	34.0	19.0
× 178	52.3	27.81	14.085	1.190	0.725	× 265	33 700	706	358	30.2	18.4
× 161	47.4	27.59	14.020	1.080	0.660	× 240	30 600	701	356	27.4	16.8
× 146	42.9	27.38	13.965	0.975	0.605	× 217	27 700	695	355	24.8	15.4
						1	1				I

TABLE A2.1 Continued

					IADLL AZ.I	Continued					
Designation			ГІон			Designation			Fla		
(Nominal			Flar	nge		[Nominal		1	Flai	nge	Web
	A == =	Depth		1	Web	,		Damila			Thick-
Depth in	Area			Thick-		Depth in Milli-	Area A.	Depth	l	Thick-	1
Inches and	A,_	d,	Width	ness	Thickness	metres and	mm ²	d,	Width	ness,	ness
Weight in	in. ²	in.	b_f		t_w , in. ^A	Mass in Kilo-	'''''	mm	b_{t}		t _w ,
Pounds per			in.	t_{f}		grams per		1	mm	t_{f}	mm ^A
Linear Foot)				in. ^A		Metre]			l	mm ^A	
						· · · · · · · · · · · · · · · · · · ·					
$W27 \times 129$	37.8	27.63	10.010	1.100	0.610	W690 × 192	24 400	702	254	27.9	15.5
× 114	33.5	27.29	10.070	0.930	0.570	× 170	21 600	693	256	23.6	14.5
× 102	30.0	27.09	10.015	0.830	0.515	× 152	19 400	688	254	21.1	13.1
	1										1
× 94	27.7	26.92	9.990	0.745	0.490	× 140	17 900	684	254	18.9	12.4
× 84	24.8	26.71	9.960	0.640	0.460	× 125	16 000	678	253	16.3	11.7
								1	l	1	
W24 × 370	108.0	27.99	13.660	2.720	1.520	W610 × 551	70 200	711	347	69.1	38.6
× 335	98.4	27.52	13.520	2.480	1.380	× 498	63 500	699	343	63.0	35.1
	1										1
× 306	89.8	27.13	13.405	2.280	1.260	× 455	57 900	689	340	57.9	32.0
× 279	82.0	26.73	13.305	2.090	1.160	× 415	52 900	679	338	53.1	29.5
× 250	73.5	26.34	13.185	1.890	1.040	× 372	47 400	669	335	48.0	26.4
× 229	67.2	26.02	13.110	1.730	0.960	× 341	43 400	661	333	43.9	24.4
	1										
× 207	60.7	25.71	13.010	1.570	0.870	× 307	39 100	653	330	39.9	22.1
× 192	56.3	25.47	12.950	1.460	0.810	× 285	36 100	647	329	37.1	20.6
× 176	51.7	25.24	12.890	1.340	0.750	× 262	33 300	641	327	34.0	19.0
× 162	47.7	25.00	12.955	1.220	0.705	× 241	30 800	635	329	31.0	17.9
	1										
× 146	43.0	24.74	12.900	1.090	0.650	× 217	27 700	628	328	27.7	16.5
× 131	38.5	24.48	12.855	0.960	0.605	× 195	24 800	622	327	24.4	15.4
× 117	34.4	24.26	12.800	0.850	0.550	× 174	22 200	616	325	21.6	14.0
× 104	30.6	24.06	12.750		0.500	× 155	19 700	611	324	19.0	12.7
X 104	30.6	24.06	12.750	0.750	0.500	× 155	19 700	611	324	19.0	12.7
1446	l	l		1	l l	l				l ,.	l
W24 × 103	30.3	24.53	9.000	0.980	0.550	W610 × 153	19 600	623	229	24.9	14.0
× 94	27.7	24.31	9.065	0.875	0.515	× 140	17 900	617	230	22.2	13.1
× 84	24.7	24.10	9.020	0.770	0.470	× 125	15 900	612	229	19.6	11.9
	1										
× 76	22.4	23.92	8.990	0.680	0.440	× 113	14 500	608	228	17.3	11.2
× 68	20.1	23.73	8.965	0.585	0.415	× 101	13 000	603	228	14.9	10.5
								1	l	1	
W24 × 62	18.2	23.74	7.040	0.590	0.430	W610 × 92	11 700	603	179	15.0	10.9
× 55	16.2	23.57	7.005	0.505	0.395	× 82	10 500	599	178	12.8	10.0
X 33	10.2	23.57	7.005	0.505	0.595	X 62	10 300	399	170	12.0	10.0
W04 075		0440	40.000	0.400	4 000	14/500 400	50.000	040	007		04.0
$W21 \times 275$	80.9	24.13	12.890	2.190	1.220	W530 × 409	52 200	613	327	55.6	31.0
× 248	72.9	23.74	12.775	1.990	1.100	× 369	47 000	603	324	50.5	27.9
× 223	65.6	23.35	12.675	1.790	1.000	× 332	42 300	593	322	45.5	25.4
× 201	59.2	23.03	12.575	1.630	0.910	× 300	38 200	585	319	41.4	23.1
	1										1
× 182	53.7	22.72	12.500	1.480	0.830	× 272	34 600	577	317	37.6	21.1
× 166	48.9	22.48	12.420	1.360	0.750	× 248	31 500	571	315	34.5	19.0
× 147	43.2	22.06	12.510	1.150	0.720	× 219	27 900	560	318	29.2	18.3
× 132	38.8	21.83	12.440	1.035	0.650	× 196	25 000	554	316	26.3	16.5
× 122	35.9	21.68	12.390	0.960	0.600	× 182	23 200	551	315	24.4	15.2
× 111	32.7	21.51	12.340	0.875	0.550	× 165	21 100	546	313	22.2	14.0
× 101	29.8	21.36	12.290	0.800	0.500	× 150	19 200	543	312	20.3	12.7
									'		
W21 × 93	27.3	21.62	8.420	0.930	0.580	W530 × 138	17 600	549	214	23.6	14.7
	1								212	21.2	1
× 83	24.3	21.43	8.355	0.835	0.515	× 123		544			13.1
× 73	21.5	21.24	8.295	0.740	0.455	× 109	13 900	539	211	18.8	11.6
× 68	20.0	21.13	8.270	0.685	0.430	× 101	12 900	537	210	17.4	10.9
× 62	18.3	20.99	8.240	0.615	0.400	× 92	11 800	533	209	15.6	10.2
× 55	16.2	20.80	8.220	0.522	0.375	× 82	10 500	528	209	13.3	9.50
	1										
× 48	14.1	20.62	8.140	0.430	0.350	× 72	9 180	524	207	10.9	9.00
				l						l	
$W21 \times 57$	16.7	21.06	6.555	0.650	0.405	W530 × 85	10 800	535	166	16.5	10.3
× 50	14.7	20.83	6.530	0.535	0.380	× 74	9 480	529	166	13.6	9.7
× 44	13.0	20.66	6.500	0.450	0.350	× 66	8 390	525	165	11.4	8.9
										l	
\M/10 \ \ 011	01 5	22.22	12.005	2.740	1 500	W460 464	59 100	567	205	60.6	20.6
W18 × 311	91.5	22.32	12.005	2.740	1.520	W460 × 464		567	305	69.6	38.6
× 283	83.2	21.85	11.890	2.500	1.400	× 421	53 700	555	302	63.5	35.6
× 258	75.9	21.46	11.770	2.300	1.280	× 384	49 000	545	299	58.4	32.5
× 234	68.8	21.06	11.650	2.110	1.160	× 349	44 400	535	296	53.6	29.5
	1										1
× 211	62.1	20.67	11.555	1.910	1.060	× 315	40 100	525	293	48.5	26.9
× 192	56.4	20.35	11.455	1.750	0.960	× 286	36 400	517	291	44.4	24.4
× 175	51.3	20.04	11.375	1.590	0.890	× 260	33 100	509	289	40.4	22.6
× 158	46.3	19.72	11.300	1.440	0.810	× 235	29 900	501	287	36.6	20.6
× 143	42.1	19.49	11.220	1.320	0.730	× 213	27 100	495	285	33.5	18.5
× 130	38.2	19.25	11.160	1.200	0.670	× 193	24 700	489	283	30.5	17.0
× 119	35.1	18.97	11.265	1.060	0.655	× 177	22 600	482	286	26.9	16.6
× 106	31.1	18.73	11.200	0.940	0.590	× 158	20 100	476	284	23.9	15.0
× 97	28.5	18.59	11.145	0.870	0.535	× 144	18 400	472	283	22.1	13.6
× 86	25.3	18.39	11.090	0.770	0.480	× 128	16 300	467	282	19.6	12.2
× 76	22.3	18.21	11.035	0.680	0.425	× 113	14 400	463	280	17.3	10.8

TABLE A2.1 Continued

TABLE A2.1 Continued											
Designation			ГІан			Designation			Fla.		
(Nominal			Flar	ige		[Nominal			Flai	ige	Web
Depth in	Area	Depth			Web	Depth in Milli-		Depth			Thick-
Inches and	Α,	d,	Width	Thick-	Thickness	metres and	Area A,	d,	Width	Thick-	ness
Weight in	in. ²	in.		ness	t_w , in. ^A	Mass in Kilo-	mm ²	mm	b _f ,	ness,	t _w ,
Pounds per	""	""	b _f ,	t_f ,	'w,	grams per				t_f	mm ^A
Linear Foot)			in.	in. ^A		Metre]			mm	mm ^A	'''''
						· · · · · · · · · · · · · · · · · · ·					
$W18 \times 71$	20.8	18.47	7.635	0.810	0.495	W460 × 106	13 400	469	194	20.6	12.6
× 65	19.1	18.35	7.590	0.750	0.450	× 97	12 300	466	193	19.0	11.4
× 60	17.6	18.24	7.555	0.695	0.415	× 89	11 400	463	192	17.7	10.5
× 55	16.2	18.11	7.530	0.630	0.390	× 82	10 500	460	191	16.0	9.9
× 50	14.7	17.99	7.495	0.570	0.355	× 74	9 480	457	190	14.5	9.0
											1
W18 × 46	13.5	18.06	6.060	0.605	0.360	W460 × 68	8 710	459	154	15.4	9.1
× 40	11.8	17.90	6.015	0.525	0.315	× 60	7 610	455	153	13.3	8.0
× 35	10.3	17.70	6.000	0.425	0.300	× 52	6 650	450	152	10.8	7.6
× 03	10.0	17.70	0.000	0.423	0.000	^ 32	0 050	1 450	132	10.0	/.0
W16 × 100	29.4	16.97	10.425	0.985	0.585	W410 × 149	19 000	431	265	25.0	14.9
	1					1				22.2	
× 89	26.2	16.75	10.365	0.875	0.525	× 132		425	263		13.3
× 77	22.6	16.52	10.295	0.760	0.455	× 114	14 600	420	261	19.3	11.6
× 67	19.7	16.33	10.235	0.665	0.395	× 100	12 700	415	260	16.9	10.0
W16 × 57	16.8	16.43	7.120	0.715	0.430	W410 × 85	10 800	417	181	18.2	10.9
× 50	14.7	16.26	7.070	0.630	0.380	× 75	9 480	413	180	16.0	9.7
× 45	13.3	16.13	7.035	0.565	0.345	× 67	8 580	410	179	14.4	8.8
× 40	11.8	16.01	6.995	0.505	0.305	× 60	7 610	407	178	12.8	7.7
× 36	10.6	15.86	6.985	0.430	0.295	× 53	6 840	403	177	10.9	7.5
W16 × 31	9.12	15.88	5.525	0.440	0.275	W410 × 46.1	5 880	403	140	11.2	7.0
× 26	7.68	15.69	5.500	0.345	0.250	× 38.8	4 950	399	140	8.8	6.4
× 20			0.000	0.0.0	0.200	7 55.5				0.0	"
W14 × 873	256.5	23.62	18.755	5.510	3.935	W360 × 1299	165 000	600	476	140.0	100.0
× 808	237.3	22.84	18.560	5.120	3.740	× 1202	153 000	580	471	130.0	95.0
							139 000				
× 730	215.0	22.42	17.890	4.910	3.070	× 1086		569	454	125.0	78.0
× 665	196.0	21.64	17.650	4.520	2.830	× 990	126 000	550	448	115.0	71.9
× 605	178.0	20.92	17.415	4.160	2.595	× 900	115 000	531	442	106.0	65.9
× 550	162.0	20.24	17.200	3.820	2.380	× 818	105 000	514	437	97.0	60.5
× 500	147.0	19.60	17.010	3.500	2.190	× 744	94 800	498	432	88.9	55.6
× 455	134.0	19.02	16.835	3.210	2.015	× 677	86 500	483	428	81.5	51.2
× 426	125.0	18.67	16.695	3.035	1.875	× 634	80 600	474	424	77.1	47.6
× 398	117.0	18.29	16.590	2.845	1.770	× 592	75 500	465	421	72.3	45.0
× 370	109.0	17.92	16.475	2.660	1.655	× 551	70 300	455	418	67.6	42.0
× 342	101.0	17.54	16.360	2.470	1.540	× 509	65 200	446	416	62.7	39.1
× 311	91.4	17.12	16.230	2.260	1.410	× 463	59 000	435	412	57.4	35.8
× 283	83.3	16.74	16.110	2.070	1.290	× 421	53 700	425	409	52.6	32.8
× 257	75.6	16.38	15.995	1.890	1.175	× 382	48 800	416	406	48.0	29.8
× 233	68.5	16.04	15.890	1.720	1.070	× 347	44 200	407	404	43.7	27.2
× 211	62.0	15.72	15.800	1.560	0.980	× 314	40 000	399	401	39.6	24.9
× 193	56.8	15.48	15.710	1.440	0.890	× 287	36 600	393	399	36.6	22.6
× 176	51.8	15.22	15.650	1.310	0.830	× 262	33 400	387	398	33.3	21.1
× 159	46.7	14.98	15.565		0.745	× 202 × 237	30 100	380	395	30.2	18.9
	1			1.190		1					
× 145	42.7	14.78	15.500	1.090	0.680	× 216	27 500	375	394	27.7	17.3
10/4 4 400	000	1400	14705	1 000	0.045	14/000 100	05.000	070	07.		10.4
W14 × 132	38.8	14.66	14.725	1.030	0.645	W360 × 196	25 000	372	374	26.2	16.4
× 120	35.3	14.48	14.670	0.940	0.590	× 179	22 800	368	373	23.9	15.0
× 109	32.0	14.32	14.605	0.860	0.525	× 162	20 600	364	371	21.8	13.3
× 99	29.1	14.16	14.565	0.780	0.485	× 147	18 800	360	370	19.8	12.3
× 90	26.5	14.02	14.520	0.710	0.440	× 134	17 100	356	369	18.0	11.2
W14 × 82	24.1	14.31	10.130	0.855	0.510	W360 x 122	15 500	363	257	21.7	13.0
× 74	21.8	14.17	10.070	0.785	0.450	× 110	14 100	360	256	19.9	11.4
× 68	20.0	14.04	10.035	0.720	0.415	× 101	12 900	357	255	18.3	10.5
× 61	17.9	13.89	9.995	0.645	0.375	× 91	11 500	353	254	16.4	9.5
						1					
W14 × 53	15.6	13.92	8.060	0.660	0.370	W360 × 79	10 100	354	205	16.8	9.4
× 48	14.1	13.79	8.030	0.595	0.340	× 72	9 100	350	203	15.1	8.6
	1					× 64					
× 43	12.6	13.66	7.995	0.530	0.305	× 04	8 130	347	203	13.5	7.7
14/4 4 00	_, _	1440	0 7-0	0.51-	0.040	14/000 50	7	050	170	40.4	-
W14 × 38	11.2	14.10	6.770	0.515	0.310	W360 × 58	7 230	358	172	13.1	7.9
× 34	10.0	13.98	6.745	0.455	0.285	× 51	6 450	355	171	11.6	7.2
× 30	8.85	13.84	6.730	0.385	0.270	× 44.6	5 710	352	171	9.8	6.9
	1	l		I					1		1
$W14 \times 26$	7.69	13.91	5.025	0.420	0.255	W360 × 39.0	4 960	353	128	10.7	6.5
× 22	6.49	13.74	5.000	0.335	0.230	× 32.9	4 190	349	127	8.5	5.8
	1	l				1	1				
											1

TABLE A2.1 Continued


					TABLE A2.1	Continuea					
Designation			Flar	190		Designation			Flai	200	
(Nominal			Fiai	ige		[Nominal			гіаі	ige	Web
Depth in	Area	Depth			Web	Depth in Milli-		Depth			Thick-
Inches and		d,	Width	Thick-	Thickness	metres and	Area A,	d,	Width	Thick-	ness
Weight in	<i>A</i> , in. ²	in.		ness	t_w , in. ^A	Mass in Kilo-	mm ²	mm		ness,	t _w ,
•	"".		b _f ,	t_f ,	'w,				b _f	t_f	mm ^A
Pounds per			in.	in. ^A		grams per			mm	mm ^A	1111111
Linear Foot)						Metre]					
W12 × 336	98.8	16.82	13.385	2.955	1.775	W310 × 500	63 700	427	340	75.1	45.1
× 305	89.6	16.32	13.235	2.705	1.625	× 454	57 800	415	336	68.7	41.3
× 279	81.9	15.85	13.140	2.470	1.530	× 415	52 800	403	334	62.7	38.9
× 252	74.1	15.41	13.005	2.250	1.395	× 375	47 800	391	330	57.2	35.4
× 230	67.7						43 700	382	328	52.6	
		15.05	12.895	2.070	1.285	× 342	I				32.6
× 210	61.8	14.71	12.790	1.900	1.180	× 313	39 900	374	325	48.3	30.0
× 190	55.8	14.38	12.670	1.735	1.060	× 283	36 000	365	322	44.1	26.9
× 170	50.0	14.03	12.570	1.560	0.960	× 253	32 300	356	319	39.6	24.4
× 152	44.7	13.71	12.480	1.400	0.870	× 226	28 800	348	317	35.6	22.1
× 136	39.9	13.41	12.400	1.250	0.790	× 202	25 700	341	315	31.8	20.1
× 120	35.3	13.12	12.320	1.105	0.710	× 179	22 800	333	313	28.1	18.0
× 106	31.2	12.89	12.220	0.990	0.610	× 158	20 100	327	310	25.1	15.5
× 96	28.2	12.71	12.160	0.900	0.550	× 143	18 200	323	309	22.9	14.0
							I				
× 87	25.6	12.53	12.125	0.810	0.515	× 129	16 500	318	308	20.6	13.1
× 79	23.2	12.38	12.080	0.735	0.470	× 117	15 000	314	307	18.7	11.9
× 72	21.1	12.25	12.040	0.670	0.430	× 107	13 600	311	306	17.0	10.9
× 65	19.1	12.12	12.000	0.605	0.390	× 97	12 300	308	305	15.4	9.9
											1
W12 × 58	17.0	12.19	10.010	0.640	0.360	W310 × 86	11 000	310	254	16.3	9.1
× 53	15.6	12.06	9.995	0.575	0.345	× 79	10 100	306	254	14.6	8.8
						1			•		' '
W12 × 50	14.7	12.19	8.080	0.640	0.370	W310 × 74	9 480	310	205	16.3	9.4
× 45	13.2	12.06	8.045	0.575	0.335	× 67	8 520	306	204	14.6	8.5
× 40						× 60					
× 40	11.8	11.94	8.005	0.515	0.295	× 60	7 610	303	203	13.1	7.5
$W12 \times 35$	10.3	12.50	6.560	0.520	0.300	W310 × 52	6 650	317	167	13.2	7.6
× 30	8.79	12.34	6.520	0.440	0.260	× 44.5	5 670	313	166	11.2	6.6
× 26	7.65	12.22	6.490	0.380	0.230	× 38.7	4 940	310	165	9.7	5.8
W12 × 22	6.48	12.31	4.030	0.425	0.260	W310 × 32.7	4 180	313	102	10.8	6.6
× 19	5.57	12.16	4.005	0.350	0.235	× 28.3	3 590	309	102	8.9	6.0
× 16	4.71	11.99	3.990	0.265	0.220	× 23.8	3 040	305	101	6.7	5.6
× 14	4.16	11.91	3.970	0.225	0.200	× 21.0	2 680	303	101	5.7	5.1
X 14	4.10	11.91	3.970	0.225	0.200	X 21.0	2 000	303	101	5.7	3.1
1440 440	00.0	44.00	40.445	4.050	0.755	14/050 407	04 000	000	005	04.0	400
W10 × 112	32.9	11.36	10.415	1.250	0.755	W250 × 167	21 200	289	265	31.8	19.2
× 100	29.4	11.10	10.340	1.120	0.680	× 149	19 000	282	263	28.4	17.3
× 88	25.9	10.84	10.265	0.990	0.605	× 131	16 700	275	261	25.1	15.4
× 77	22.6	10.60	10.190	0.870	0.530	× 115	14 600	269	259	22.1	13.5
× 68	20.0	10.40	10.130	0.770	0.470	× 101	12 900	264	257	19.6	11.9
× 60	17.6	10.22	10.080	0.680	0.420	× 89	11 400	260	256	17.3	10.7
× 54	15.8	10.09	10.030	0.615	0.370	× 80	10 200	256	255	15.6	9.4
× 49	14.4	9.98	10.000	0.560	0.340	× 73	9 290	253	254	14.2	8.6
X 10		0.00	10.000	0.000	0.010	1 ^,*	0 200	200	201		0.0
W10 × 45	13.3	10.10	8.020	0.620	0.350	W250 × 67	8 580	257	204	15.7	8.9
							I		_		
× 39	11.5	9.92	7.985	0.530	0.315	× 58	7 420	252	203	13.5	8.0
× 33	9.71	9.73	7.960	0.435	0.290	× 49.1	6 260	247	202	11.0	7.4
											l
$W10 \times 30$	8.84	10.47	5.810	0.510	0.300	W250 × 44.8	5 700	266	148	13.0	7.6
× 26	7.61	10.33	5.770	0.440	0.260	× 38.5	4 910	262	147	11.2	6.6
× 22	6.49	10.17	5.750	0.360	0.240	× 32.7	4 190	258	146	9.1	6.1
W10 × 19	5.62	10.24	4.020	0.395	0.250	W250 × 28.4	3 630	260	102	10.0	6.4
× 17	4.99	10.11	4.010	0.330	0.240	× 25.3	3 220	257	102	8.4	6.1
× 15	4.41	9.99	4.000	0.270	0.230	× 22.3	2 850	254	102	6.9	5.8
× 12	3.54			0.210	0.190	× 17.9	2 280		101	5.3	
X 12	3.54	9.87	3.960	0.210	0.190	× 17.9	2 200	251	101	5.3	4.8
WO 07	107	0.00	0.000	0.005	0.570	W000 400	10 700	000	040	00.7	145
W8 × 67	19.7	9.00	8.280	0.935	0.570	W200 × 100	12 700	229	210	23.7	14.5
× 58	17.1	8.75	8.220	0.810	0.510	× 86	11 000	222	209	20.6	13.0
× 48	14.1	8.50	8.110	0.685	0.400	× 71	9 100	216	206	17.4	10.2
× 40	11.7	8.25	8.070	0.560	0.360	× 59	7 550	210	205	14.2	9.1
× 35	10.3	8.12	8.020	0.495	0.310	× 52	6 650	206	204	12.6	7.9
× 31	9.13	8.00	7.995	0.435	0.285	× 46.1	5 890	203	203	11.0	7.2
		00								•	l <u>-</u>
W8 × 28	8.25	8.06	6.535	0.465	0.285	W200 × 41.7	5 320	205	166	11.8	7.2
× 24	7.08		6.495		0.245	× 35.9	4 570	205	165	10.2	6.2
x 24	7.00	7.93	0.495	0.400	0.245	× 35.8	4 5/0	201	100	10.2	0.2
MO · · O4	6.10	0.00	E 070	0.400	0050	W200 04 0	2 070	010	104	10.0	6.4
W8 × 21	6.16	8.28	5.270	0.400	0.250	W200 × 31.3	3 970	210	134	10.2	6.4
× 18	5.26	8.14	5.250	0.330	0.230	× 26.6	3 390	207	133	8.4	5.8
											<u> </u>

TABLE A2.1 Continued

Designation (Nominal			Flar	nge		Designation [Nominal			Flai	nge	Web
Depth in Inches and Weight in Pounds per Linear Foot)	Area <i>A</i> , in. ²	Depth d, in.	Width b _f , in.	Thick- ness $t_{\mathfrak{h}}$ in. ^A	Web Thickness t_{w} , in. ^A	Depth in Milli- metres and Mass in Kilo- grams per Metre]	Area <i>A</i> , mm²	Depth d, mm	Width b _f , mm	Thick- ness, t _f , mm ^A	Thick- ness t _w , mm ^A
W8 × 15	4.44	8.11	4.015	0.315	0.245	W200 × 22.5	2 860	206	102	8.0	6.2
× 13	3.84	7.99	4.000	0.255	0.230	× 19.3	2 480	203	102	6.5	5.8
× 10	2.96	7.89	3.940	0.205	0.170	× 15.0	1 910	200	100	5.2	4.3
						1					
W6 × 25	7.34	6.38	6.080	0.455	0.320	W150 × 37.1	4 740	162	154	11.6	8.1
× 20	5.87	6.20	6.020	0.365	0.260	× 29.8	3 790	157	153	9.3	6.6
× 15	4.43	5.99	5.990	0.260	0.230	× 22.5	2 860	152	152	6.6	5.8
W6 × 16	4.74	6.28	4.030	0.405	0.260	W150 × 24.0	3 060	160	102	10.3	6.6
× 12	3.55	6.03	4.000	0.280	0.230	× 18.0	2 290	153	102	7.1	5.8
× 9	2.68	5.90	3.940	0.215	0.170	× 13.5	1 730	150	100	5.5	4.3
× 8.5	2.52	5.83	3.940	0.195	0.170	× 13.0	1 630	148	100	4.9	4.3
W5 × 19	5.54	5.15	5.030	0.430	0.270	W130 × 28.1	3 590	131	128	10.9	6.9
× 16	4.68	5.01	5.000	0.360	0.240	× 23.8	3 040	127	127	9.1	6.1
						1		l -			
W4 × 13	3.83	4.16	4.060	0.345	0.280	W100 × 19.3	2 470	106	103	8.8	7.1

A Actual flange and web thicknesses vary due to mill rolling practices; however, permitted variations for such dimensions are not addressed.


TABLE A2.2 "S" Shapes



Designation (Nominal			Flan	ige	Web	Designation [Nominal			Fla	inge	Web
Depth in Inches and Weight in Pounds per Linear Foot)	Area A, in.²	Depth d, in.	Width b_{f_i} in.	Thick- ness t _f , in. ^A	Thick- ness <i>t_w</i> , in. ^A	Depth in Milli- metres and Mass in Kilo- grams per Metre]	Area <i>A</i> , mm²	Depth d, mm	Width b _f , mm	Thick- ness, $t_{\mathfrak{f}}$ mm ^A	Thick- ness t _w , mm ^A
S 24 × 121	35.6	24.50	8.050	1.090	0.800	S 610 × 180	23 000	622	204	27.7	20.3
× 106	31.2	24.50	7.870	1.090	0.620	× 158	20 100	622	200	27.7	15.7
S 24 × 100	29.3	24.00	7.245	0.870	0.745	S 610 × 149	18 900	610	184	22.1	18.9
× 90	26.5	24.00	7.125	0.870	0.625	× 134	17 100	610	181	22.1	15.9
× 80	23.5	24.00	7.000	0.870	0.500	× 119	15 200	610	178	22.1	12.7
S 20 × 96	28.2	20.30	7.200	0.920	0.800	S 510 × 143	18 200	516	183	23.4	20.3
× 86	25.3	20.30	7.060	0.920	0.660	× 128	16 300	516	179	23.4	16.8
S 20 × 75	22.0	20.00	6.385	0.795	0.635	S 510 × 112	14 200	508	162	20.2	16.1
× 66	19.4	20.00	6.255	0.795	0.505	× 98	12 500	508	159	20.2	12.8
S 18 × 70	20.6	18.00	6.251	0.691	0.711	S 460 × 104	13 300	457	159	17.6	18.1
× 54.7	16.1	18.00	6.001	0.691	0.461	× 81.4	10 400	457	152	17.6	11.7
S 15 × 50	14.7	15.00	5.640	0.622	0.550	S 380 × 74	9 480	381	143	15.8	14.0
× 42.9	12.6	15.00	5.501	0.622	0.411	× 64	8 130	381	140	15.8	10.4
S 12 × 50	14.7	12.00	5.477	0.659	0.687	S 310 × 74	9 480	305	139	16.7	17.4
× 40.8	12.0	12.00	5.252	0.659	0.462	× 60.7	7 740	305	133	16.7	11.7
S 12 × 35	10.3	12.00	5.078	0.544	0.428	S 310 × 52	6 650	305	129	13.8	10.9
× 31.8	9.35	12.00	5.000	0.544	0.350	× 47.3	6 030	305	127	13.8	8.9
S 10 × 35	10.3	10.00	4.944	0.491	0.594	S 250 × 52	6 650	254	126	12.5	15.1
× 25.4	7.46	10.00	4.661	0.491	0.311	× 37.8	4 810	254	118	12.5	7.9
S 8 × 23	6.77	8.00	4.171	0.425	0.441	S 200 × 34	4 370	203	106	10.8	11.2
× 18.4	5.41	8.00	4.001	0.425	0.271	× 27.4	3 480	203	102	10.8	6.9
S 6 × 17.25	5.07	6.00	3.565	0.359	0.465	S 150 × 25.7	3 270	152	91	9.1	11.8
× 12.5	3.67	6.00	3.332	0.359	0.232	× 18.6	2 360	152	85	9.1	5.9
S 5 × 10	2.94	5.00	3.004	0.326	0.214	S 130 × 15	1 880	127	76	8.3	5.4
S 4 × 9.5	2.79	4.00	2.796	0.293	0.326	S 100 × 14.1	1 800	102	71	7.4	8.3
× 7.7	2.26	4.00	2.663	0.293	0.193	× 11.5	1 450	102	68	7.4	4.9
S 3 × 7.5	2.21	3.00	2.509	0.260	0.349	S 75 × 11.2	1 430	76	64	6.6	8.9
× 5.7	1.67	3.00	2.330	0.260	0.170	× 8.5	1 080	76	59	6.6	4.3

A Actual flange and web thicknesses vary due to mill rolling practices; however, permitted variations for such dimensions are not addressed.


TABLE A2.3 "M" Shapes



Designation (Nominal			Flan	ge	Web	Designation [Nominal			Fla	nge	Web
Depth in Inches and Weight in Pounds per Linear Foot)	Area <i>A</i> , in. ²	Depth d, in.	Width b_6 in.	Thick- ness t _f , in. ^A	Thick- ness t _w , in. ^A	Depth in Milli- metres and Mass in Kilo- grams per Metre]	Area <i>A</i> , mm²	Depth d, mm	Width b _f , mm	Thick- ness, t _f , mm ^A	Thick- ness t _w , mm ^A
M 12.5 × 12.4	3.66	12.534	3.750	0.228	0.155	M 318 × 18.5	2 361	318	95	5.8	3.9
× 11.6	3.43	12.500	3.500	0.211	0.155	× 17.3	2 213	317	89	5.4	3.9
M 12 × 11.8	3.47	12.00	3.065	0.225	0.177	M 310 × 17.6	2 240	305	78	5.7	4.5
× 10.8	3.18	11.97	3.065	0.210	0.160	× 16.1	2 050	304	78	5.3	4.1
× 10.0	2.94	11.97	3.250	0.180	0.149	× 14.9	1 900	304	83	4.6	3.8
M 10 × 9.0	2.65	10.00	2.690	0.206	0.157	M 250 × 13.4	1 710	254	68	4.6	3.6
× 8.0	2.35	9.95	2.690	0.182	0.141	× 11.9	1 520	253	68	5.2	4.0
× 7.5	2.21	9.99	2.688	0.173	0.130	× 11.2	1 430	253	68	4.4	3.3
M 8 × 6.5	1.92	8.00	2.281	0.189	0.135	M 200 × 9.7	1 240	203	57	4.8	3.4
× 6.2	1.81	8.00	2.281	0.177	0.129	× 9.2	1 170	203	58	4.5	3.3
M 6 × 4.4	1.29	6.00	1.844	0.171	0.114	M 150 × 6.6	832	152	47	4.3	2.9
× 3.7	1.09	5.92	2.000	0.129	0.098	× 5.5	703	150	51	3.3	2.5
M 5 × 18.9	5.55	5.00	5.003	0.416	0.316	M 130 × 28.1	3 580	127	127	10.6	8.0
M 4 × 6.0	1.78	3.80	3.80	0.160	0.130	M 100 × 8.9	1 150	97	97	4.1	3.3
× 4.08	1.20	4.00	2.250	0.170	0.115	× 6.1	775	102	57	4.3	2.9
M 3 × 2.9	0.853	3.00	2.250	0.130	0.090	M 75 × 4.3	550	76	57	3.3	2.3

A Actual flange and web thicknesses vary due to mill rolling practices; however, permitted variations for such dimensions are not addressed.


TABLE A2.4 "HP" Shapes



Designation (Nominal Depth in			Flange Web Designation [Nominal Depth in Milli-			Fla	ange	Web			
Inches and Weight in Pounds per Linear Foot)	Area <i>A</i> , in. ²	Depth <i>d</i> , in.	Width b_f , in.	Thick- ness t _f , in. ^A	Thick- ness t_w , in. ^A	metres and Mass in Kilo- grams per Metre]	Area <i>A</i> , mm²	Depth d, mm	Width <i>b_f</i> ,	Thickness,	Thick- ness t _w , mm ^A
HP18 × 204	60.0	18.25	18.125	1.125	1.125	HP460 × 304	38 700	464	460	28.6	28.6
× 181	53.2	18.00	18.000	1.000	1.000	× 269	34 300	457	457	25.4	25.4
× 157	46.2	17.74	17.870	0.870	0.870	× 234	29 800	451	454	22.1	22.1
× 135	39.8	17.50	17.750	0.750	0.750	× 202	25 700	445	451	19.1	19.1
HP16 × 183	53.8	16.50	16.250	1.125	1.125	HP410 × 272	34 700	419	413	28.6	28.6
× 162	47.7	16.25	16.125	1.000	1.000	× 242	30 800	413	410	25.4	25.4
× 141	41.7	16.00	16.000	0.875	0.875	× 211	26 900	406	406	22.2	22.2
× 121	35.7	15.75	15.875	0.750	0.750	× 181	23 000	400	403	19.1	19.1
× 101	29.8	15.50	15.750	0.625	0.625	× 151	19 200	394	400	15.9	15.9
× 88	25.8	15.33	15.665	0.540	0.540	× 131	16 700	389	398	13.7	13.7
HP14 × 117	34.4	14.21	14.885	0.805	0.805	HP360 × 174	22 200	361	378	20.4	20.4
× 102	30.0	14.01	14.785	0.705	0.705	× 152	19 400	356	376	17.9	17.9
× 89	26.1	13.83	14.695	0.615	0.615	× 132	16 800	351	373	15.6	15.6
× 73	21.4	13.61	14.585	0.505	0.505	× 108	13 800	346	370	12.8	12.8
HP12 × 89	26.2	12.35	12.330	0.720	0.720	HP310 × 132	16 900	314	313	18.3	18.3
× 84	24.6	12.28	12.295	0.685	0.685	× 125	15 900	312	312	17.4	17.4
× 74	21.8	12.13	12.215	0.610	0.605	× 110	14 100	308	310	15.5	15.4
× 63	18.4	11.94	12.125	0.515	0.515	× 93	11 900	303	308	13.1	13.1
× 53	15.5	11.78	12.045	0.435	0.435	× 79	10 000	299	306	11.0	11.0
HP10 × 57	16.8	9.99	10.225	0.565	0.565	HP250 × 85	10 800	254	260	14.4	14.4
× 42	12.4	9.70	10.075	0.420	0.415	× 62	8 000	246	256	10.7	10.5
HP8 × 36	10.6	8.02	8.155	0.445	0.445	HP200 × 53	6 840	204	207	11.3	11.3

A Actual flange and web thicknesses vary due to mill rolling practices; however, permitted variations for such dimensions are not addressed.


TABLE A2.5 "C" Shapes



Designation (Nominal			Flar	ige	Web	Designation [Nominal			Fla	ınge	Web
Depth in Inches and Weight in Pounds per Linear Foot)	Area <i>A</i> , in. ²	Depth d, in.	Width b_{fi} in.	Thick- ness t _f , in. ^A	Thick- ness t _w , in. ^A	Depth in Milli- metres in Mass in Kilograms per Metre]	Area <i>A</i> , mm²	Depth d, mm	Width b _f , mm	Thick- ness t _f , mm ^A	Thick- ness t _w , mm ^A
C 15 × 50	14.7	15.00	3.716	0.650	0.716	C 380 × 74	9 480	381	94	16.5	18.2
× 40	11.8	15.00	3.520	0.650	0.520	× 60	7 610	381	89	16.5	13.2
× 33.9	9.96	15.00	3.400	0.650	0.400	× 50.4	6 430	381	86	16.5	10.2
C 12 × 30	8.82	12.00	3.170	0.501	0.510	C 310 × 45	5 690	305	80	12.7	13.0
× 25	7.35	12.00	3.047	0.501	0.387	× 37	4 740	305	77	12.7	9.8
× 20.7	6.09	12.00	2.942	0.501	0.282	× 30.8	3 930	305	74	12.7	7.2
C 10 × 30	8.82	10.00	3.033	0.436	0.673	C 250 × 45	5 690	254	76	11.1	17.1
× 25	7.35	10.00	2.886	0.436	0.526	× 37	4 740	254	73	11.1	13.4
× 20	5.88	10.00	2.739	0.436	0.379	× 30	3 790	254	69	11.1	9.6
× 15.3	4.49	10.00	2.600	0.436	0.240	× 22.8	2 900	254	65	11.1	6.1
C 9 × 20	5.88	9.00	2.648	0.413	0.448	C 230 × 30	3 790	229	67	10.5	11.4
× 15	4.41	9.00	2.485	0.413	0.285	× 22	2 850	229	63	10.5	7.2
× 13.4	3.94	9.00	2.433	0.413	0.233	× 19.9	2 540	229	61	10.5	5.9
C 8 × 18.75	5.51	8.00	2.527	0.390	0.487	C 200 × 27.9	3 550	203	64	9.9	12.4
× 13.75	4.04	8.00	2.343	0.390	0.303	× 20.5	2 610	203	59	9.9	7.7
× 11.5	3.38	8.00	2.260	0.390	0.220	× 17.1	2 180	203	57	9.9	5.6
C 7 × 14.75	4.33	7.00	2.299	0.366	0.419	C 180 × 22	2 790	178	58	9.3	10.6
× 12.25	3.60	7.00	2.194	0.366	0.314	× 18.2	2 320	178	55	9.3	8.0
× 9.8	2.87	7.00	2.090	0.366	0.210	× 14.6	1 850	178	53	9.3	5.3
C 6 × 13	3.83	6.00	2.157	0.343	0.437	C 150 × 19.3	2 470	152	54	8.7	11.1
× 10.5	3.09	6.00	2.034	0.343	0.314	× 15.6	1 990	152	51	8.7	8.0
× 8.2	2.40	6.00	1.920	0.343	0.200	× 12.2	1 550	152	48	8.7	5.1
C 5 × 9	2.64	5.00	1.885	0.320	0.325	C 130 × 13	1 700	127	47	0.4	
× 6.7	1.97	5.00	1.885	0.320	0.325	× 10.4	1 700 1 270	127	47	8.1 8.1	8.3 4.8
X 0.7	1.97	3.00	1.750	0.320	0.190	X 10.4	1 270	127	44	0.1	4.0
C 4 × 7.25	2.13	4.00	1.721	0.296	0.321	C 100 × 10.8	1 370	102	43	7.5	8.2
× 6.25	1.84	4.00	1.647	0.296	0.247	× 9.3	1 187	102	42	7.5	6.3
× 5.4	1.59	4.00	1.584	0.296	0.184	× 8	1 030	102	40	7.5	4.7
× 4.5	1.32	4.00	1.520	0.296	0.125	× 6.7	852	102	39	7.5	3.2
C 3 × 6	1.76	3.00	1.596	0.273	0.356	C 75 × 8.9	1 130	76	40	6.9	9.0
× 5	1.47	3.00	1.498	0.273	0.258	× 7.4	948	76	37	6.9	6.6
× 4.1	1.21	3.00	1.410	0.273	0.170	× 6.1	781	76	35	6.9	4.3
× 3.5	1.03	3.00	1.372	0.273	0.132	× 5.2	665	76	35	6.9	3.4

A Actual flange and web thicknesses vary due to mill rolling practices; however, permitted variations for such dimensions are not addressed.

TABLE A2.6 "MC" Shapes




Designation (Nominal			Flar	nge	Web	Designation [Nominal Depth			F	lange	Web
Depth in Inches and Weight in Pounds per Linear Foot)	Area A, in. ²	Depth d, in.	Width $b_{\mathfrak{f}}$ in.	Thick- ness t _f , in. ^A	Thick- ness t _w , in. ^A	in Millimetres and Mass in Kilo- grams per Metre]	Area <i>A</i> , mm²	Depth d, mm	Width b _f , mm	Thickness $t_{\it f}$, mm $^{\it A}$	Thick- ness t _w , mm ^A
MC 18 × 58	17.1	18.00	4.200	0.625	0.700	MC 460 × 86	11 000	457	107	15.9	17.8
× 51.9	15.3	18.00	4.100	0.625	0.600	× 77.2	9 870	457	104	15.9	15.2
× 45.8	13.5	18.00	4.000	0.625	0.500	× 68.2	8 710	457	102	15.9	12 .7
× 42.7	12.6	18.00	3.950	0.625	0.450	× 63.5	8 130	457	100	15.9	11.4
MC 13 × 50	14.7	13.00	4.412	0.610	0.787	MC 330 × 74	9 480	330	112	15.5	20.0
× 40	11.8	13.00	4.185	0.610	0.560	× 60	7 610	330	106	15.5	14.2
× 35	10.3	13.00	4.072	0.610	0.447	× 52	6 640	330	103	15.5	11.4
× 31.8	9.35	13.00	4.000	0.610	0.375	× 47.3	6 030	330	102	15.5	9.5
MC 12 × 50	14.7	12.00	4.135	0.700	0.835	MC 310 × 74	9 480	305	105	17.8	21.2
× 45	13.2	12.00	4.010	0.700	0.710	× 67	8 502	305	102	17.8	18.0
× 40	11.8	12.00	3.890	0.700	0.590	× 60	7 610	305	98	17.8	15.0
× 35	10.3	12.00	3.765	0.700	0.465	× 52	6 620	305	96	17.8	11.8
× 31	9.12	12.00	3.670	0.700	0.370	× 46	5 890	305	93	17.8	9.4
MC 12 × 14.3	4.19	12.00	2.125	0.313	0.250	MC 310 × 21.3	2 700	305	54	8.0	6.4
× 10.6	3.10	12.00	1.500	0.309	0.190	× 15.8	2 000	305	38	7.8	4.8
MC 10 × 41.1	12.1	10.00	4.321	0.575	0.796	MC 250 × 61.2	7 810	254	110	14.6	20.2
× 33.6	9.87	10.00	4.100	0.575	0.575	× 50	6 370	254	104	14.6	14.6
× 28.5	8.37	10.00	3.950	0.575	0.425	× 42.4	5 400	254	100	14.6	10.8
MC 10 × 25	7.35	10.00	3.405	0.575	0.380	MC 250 × 37	4 740	254	86	14.6	9.7
× 22	6.45	10.00	3.315	0.575	0.290	× 33	4 160	254	84	14.6	7.4
MC 10 × 8.4	2.46	10.00	1.500	0.280	0.170	MC 250 × 12.5	1 590	254	38	7.1	4.3
× 6.5	1.91	10.00	1.17	0.202	0.152	× 9.7	1240	254	28	5.1	3.9
MC 9 × 25.4	7.47	9.00	3.500	0.550	0.450	MC 230 × 37.8	4 820	229	88	14.0	11.4
× 23.9	7.02	9.00	3.450	0.550	0.400	× 35.6	4 530	229	87	14.0	10.2
MC 8 × 22.8	6.70	8.00	3.502	0.525	0.427	MC 200 × 33.9	4 320	203	88	13.3	10.8
× 21.4	6.28	8.00	3.450	0.525	0.375	× 31.8	4 050	203	87	13.3	9.5
MC 8 × 20	5.88	8.00	3.025	0.500	0.400	MC 200 × 29.8	3 790	203	76	12.7	10.2
× 18.7	5.50	8.00	2.978	0.500	0.353	× 27.8	3 550	203	75	12.7	9.0
MC 8 × 8.5	2.50	8.00	1.874	0.311	0.179	MC 200 × 12.6	1 610	203	47	7.9	4.5
MC 7 × 22.7	6.67	7.00	3.603	0.500	0.503	MC 180 × 33.8	4 300	178	91	12.7	12.8
× 19.1	5.61	7.00	3.452	0.500	0.352	× 28.4	3 620	178	87	12.7	8.9
MC 6 × ×18	5.29	6.00	3.504	0.475	0.379	MC 150 × 26.8	3 410	152	88	12.1	9.6
× 15.3	4.50	6.00	3.500	0.385	0.340	× 22.8	2 900	152	88	9.8	8.6
MC 6 × 16.3	4.79	6.00	3.000	0.475	0.375	MC 150 × 24.3	3 090	152	76	12.1	9.5
× 15.1	4.79	6.00	2.941	0.475	0.375	× 22.5	2 860	152	74	12.1	8.0
MC 6 × 12	3.53	6.00	2.497	0.375	0.310	MC 150 × 17.9	2 280	152	63	9.5	7.9
	0.00	0.00		0.0.0	""				"	0.0	

TABLE A2.6 Continued

Designation (Nominal	ŭ		Flange		Designation Web Nominal Depth				F	lange	Web
Depth in Inches and Weight in Pounds per Linear Foot)	Area <i>A</i> , in.²	Depth d, in.	Width $b_{\mathfrak{f}}$ in.	Thick- ness t_{f_i} in. ^A	Thick- ness t_w , in. ^A	in Millimetres and Mass in Kilo- grams per Metre]	Area A, mm²	Depth d, mm	Width b _f , mm	Thickness $t_{\mathfrak{f}}$ mm A	Thick- ness t _w , mm ^A
MC 6 × 7.0	2.07	6.00	1.875	0.291	0.179	MC 150 × 10.4	1 341	152	48	7.4	4.5
× 6.5	1.93	6.00	1.850	0.291	0.155	× 9.7	1 250	152	47	7.4	3.9
MC 4 × 13.8	4.02	4.00	2.500	0.500	0.500	MC 100 × 20.5	2 594	102	64	13	13
MC 3 × 7.1	2.09	3.00	1.938	0.351	0.312	MC 75 × 10.6	1 348	76	49	8.9	7.9

A Actual flange and web thicknesses vary due to mill rolling practices; however, permitted variations for such dimensions are not addressed.

TABLE A2.7 "L" Shapes (Equal Legs) A




Size and Thickness, in.	Weight per Foot, lb	Area, in. ²	Size and Thickness, mm	Mass per Metre, kg	Area, mm²
L12 × 12 × 1%	105	30.9	L305 × 305 × 34.9	157	19 900
L12 × 12 × 11/4	96.4	28.3	L305 × 305 × 31.8	143	18 300
L12 × 12 × 11/8	87.2	25.6	L305 × 305 × 28.6	130	16 500
L12 × 12 × 1	77.8	22.9	L305 × 305 × 25.4	116	14 700
L10 × 10 × 13/8	87.1	25.6	L254 × 254 × 34.9	130	16 500
L10 × 10 × 11/4	79.9	23.5	L254 × 254 × 31.8	119	15 100
L10 × 10 × 11/8	72.3	21.2	L254 × 254 × 28.6	108	13 700
L10 × 10 × 1	64.7	19.0	L254 × 254 × 25.4	96.2	12 300
L10 × 10 × 7/8	56.9	16.7	L254 × 254 × 22.2	84.6	10 800
L10 × 10 × ¾	49.1	14.4	L254 × 254 × 19.1	73.1	9 310
L8 × 8 × 11/8	56.9	16.7	L203 × 203 × 28.6	84.7	10 800
L8 × 8 × 1	51.0	15.0	L203 × 203 × 25.4	75.9	9 680
L8 × 8 × 7/8	45.0	13.2	L203 × 203 × 22.2	67.0	8 500
L8 × 8 × ¾	38.9	11.4	L203 × 203 × 19.0	57.9	7 360
L8 × 8 × 5/8	32.7	9.61	L203 × 203 × 15.9	48.7	6 200
L8 × 8 × 9/16	29.6	8.68	L203 × 203 × 14.3	44.0	5 600
L8 × 8 × ½	26.4	7.75	L203 × 203 × 12.7	39.3	5 000
L6 × 6 × 1	37.4	11.0	L152 × 152 × 25.4	55.7	7 100
L6 × 6 × 7/8	33.1	9.73	L152 × 152 × 22.2	49.3	6 280
L6 × 6 × ¾	28.7	8.44	L152 × 152 × 19.0	42.7	5 450
L6 × 6 × 5%	24.2	7.11	L152 × 152 × 15.9	36.0	4 590
L6 × 6 × 9/16	21.9	6.43	L152 × 152 × 14.3	32.6	4 150
L6 × 6 × ½	19.6	5.75	L152 × 152 × 12.7	29.2	3 710
L6 × 6 × ½	17.2	5.06	L152 × 152 × 11.1	25.6	3 270
L6 × 6 × 3/8	14.9	4.36	L152 × 152 × 9.5	22.2	2 810
L6 × 6 × ⁵ ⁄ ₁₆	12.4	3.65	L152 × 152 × 7.9	18.5	2 360
L5 × 5 × 1/8	27.2	7.98	L127 × 127 × 22.2	40.5	5 150
L5 × 5 × ¾	23.6	6.94	L127 × 127 × 19.0	35.1	4 480
L5 × 5 × 5%	20.0	5.86	L127 × 127 × 15.9	29.8	3 780
L5 × 5 × ½	16.2	4.75	L127 × 127 × 12.7	24.1	3 070
L5 × 5 × ½ L5 × 5 × ½	14.3	4.18	L127 × 127 × 11.1	21.3	2 700
L5 × 5 × %	12.3	3.61	L127 × 127 × 9.5	18.3	2 330
L5 × 5 × 5/16	10.3	3.03	L127 × 127 × 7.9	15.3	1 960
L4 × 4 × ¾	18.5	5.44	L102 × 102 × 19.0	27.5	3 510
L4 × 4 × ⁵ / ₈	15.7	4.61	L102 × 102 × 19.0	23.4	2 970
L4 × 4 × ½	12.8	3.75	L102 × 102 × 13.9	19.0	2 420
L4 × 4 × ½ L4 × 4 × ½	11.3	3.31	L102 × 102 × 12.7	16.8	2 140
L4 × 4 × 3/8	9.80	2.86	L102 × 102 × 11.1	14.6	1 850
L4 × 4 × 5/16	8.20	2.40	L102 × 102 × 7.9	12.2	1 550
L4 × 4 × ½	6.60	1.94	L102 × 102 × 7.3	9.8	1 250
L3½ × 3½ × ½	11.1	3.25	L89 × 89 × 12.7	16.5	2 100
L3½ × 3½ × ½ L3½ × 3½ × 1/16	9.80	2.87	L89 × 89 × 11.1	14.6	1 850
L3½ × 3½ × ¾	8.50	2.48	L89 × 89 × 9.5	12.6	1 600
L3½ x 3½ x ¾ L3½ x 3½ x 5/16	7.20	2.09	L89 × 89 × 7.9	10.7	1 350
L3½ × 3½ × ¾ L3½ × 3½ × ¼	5.80	1.69	L89 × 89 × 6.4	8.6	1 090
L3 × 3 × ½	9.40	2.75	L76 × 76 × 12.7	14.0	1 770
L3 × 3 × ½ L3 × 3 × ¾6	8.30	2.43	L76 × 76 × 12.7	12.4	1 570
L3 × 3 × ^{7/16}	7.20	2.43	L76 × 76 × 11.1 L76 × 76 × 9.5	10.7	1 360
L3 × 3 × ⁵ / ₁₆	6.10	1.78	L76 × 76 × 9.5	9.1	1 150
L3 × 3 × ¹ / ₄	4.90	1.44	L76 × 76 × 7.9 L76 × 76 × 6.4	7.3	929
L3 × 3 × ³ / ₁₆	3.71	1.09	L76 × 76 × 0.4 L76 × 76 × 4.8	5.5	703

TABLE A2.7 Continued

Size and Thickness, in.	Weight per Foot, lb	Area, in. ²	Size and Thickness, mm	Mass per Metre, kg	Area, mm ²
L2½ × 2½ × ½	7.70	2.25	L64 × 64 × 12.7	11.4	1 450
L2½ × 2½ × 3/8	5.90	1.73	L64 × 64 × 9.5	8.7	1 120
L2½ × 2½ × 5/16	5.00	1.46	L64 × 64 × 7.9	7.4	942
L2½ × 2½ × ¼	4.10	1.19	L64 × 64 × 6.4	6.1	768
$L2\frac{1}{2} \times 2\frac{1}{2} \times \frac{3}{16}$	3.07	0.90	L64 × 64 × 4.8	4.6	581
L2 × 2 × 3/8	4.70	1.36	L51 × 51 × 9.5	7.0	877
L2 × 2 × 5/16	3.92	1.15	L51 × 51 × 7.9	5.8	742
L2 × 2 × ½	3.19	0.938	L51 × 51 × 6.4	4.7	605
L2 × 2 × ¾16	2.44	0.715	L51 × 51 × 4.8	3.6	461
L2 × 2 × 1/8	1.65	0.484	L51 × 51 × 3.2	2.4	312
L13/4 × 13/4 × 1/4	2.77	0.813	L44 × 44 × 6.4	4.1	525
L13/4 × 13/4 × 3/16	2.12	0.621	L44 × 44 × 4.8	3.1	401
L1 ³ / ₄ × 1 ³ / ₄ × ¹ / ₈	1.44	0.422	L44 × 44 × 3.2	2.1	272
L1½ × 1½ × ¼	2.34	0.688	L38 × 38 × 6.4	3.4	444
L1½ × 1½ × ¾6	1.80	0.527	L38 × 38 × 4.8	2.7	340
L1½ × 1½ × 5/32	1.52	0.444	L38 × 38 × 4.0	2.2	286
L1½ × 1½ × 1/8	1.23	0.359	L38 × 38 × 3.2	1.8	232
L1½ × 1½ × ½	1.92	0.563	L32 × 32 × 6.4	2.8	363
L11/4 × 11/4 × 3/16	1.48	0.434	L32 × 32 × 4.8	2.2	280
L1 ¹ / ₄ × 1 ¹ / ₄ × ¹ / ₈	1.01	0.297	L32 × 32 × 3.2	1.5	192
L1 × 1 × ½	1.49	0.438	L25 × 25 × 6.4	2.2	283
L1 × 1 × ³ / ₁₆	1.16	0.340	L25 × 25 × 4.8	1.8	219
L1 × 1 × ½	0.80	0.234	L25 × 25 × 3.2	1.2	151
L ³ / ₄ × ³ / ₄ × ¹ / ₈	0.59	0.172	L19 × 19 × 3.2	0.9	111

^A The heel of 12 and 10-in. angles may have a rounded outside corner.

TABLE A2.8 "L" Shapes (Unequal Legs)



Size and Thickness, in.	Weight per Foot, lb	Area, in. ²	Size and Thickness, mm	Mass per Metre, kg	Area, mm ²
-8 × 6 × 1	44.2	13.0	L203 × 152 × 25.4	65.5	8 390
$-8 \times 6 \times \frac{7}{8}$	39.1	11.5	L203 × 152 × 22.2	57.9	7 420
$.8 \times 6 \times \frac{3}{4}$	33.8	9.94	L203 × 152 × 19.0	50.1	6 410
.8 × 6 × ⁵ / ₈	28.5	8.36	L203 × 152 × 15.9	42.2	5 390
8 × 6 × 9/16	25.7	7.56	L203 × 152 × 14.3	38.1	4 880
8 × 6 × ½	23.0	6.75	L203 × 152 × 12.7	34.1	4 350
$.8 \times 6 \times \frac{7}{16}$	20.2	5.93	L203 × 152 × 11.1	29.9	3 830
8 × 4 × 1	37.4	11.0	L203 × 102 × 25.4	55.4	7 100
8 × 4 × ⁷ / ₈	33.1	9.73	L203 × 102 × 22.2	49.3	6 280
$8 \times 4 \times \frac{3}{4}$	28.7	8.44	L203 × 102 × 19.0	42.5	5 450
8 × 4 × 5/8	24.2	7.11	L203 × 102 × 15.9	36.0	4 590
8 × 4 × ⁹ / ₁₆	21.9	6.43	L203 × 102 × 14.3	32.4	4 150
8 × 4 × ½	19.6	5.75	L203 × 102 × 12.7	29.0	3 710
8 × 4 × ⁷ / ₁₆	17.2	5.06	L203 × 102 × 11.1	25.6	3 260
7 × 4 × ¾	26.2	7.69	L178 × 102 × 19.0	38.8	4 960
7 × 4 × 5/8	22.1	6.48	L178 × 102 × 15.9	32.7	4 180
7 × 4 × ½	17.9	5.25	L178 × 102 × 12.7	26.5	3 390
$7 \times 4 \times \frac{7}{2}$	15.7	4.62	L176 × 102 × 12.7 L178 × 102 × 11.1	23.4	2 980
./ × 4 × ½16 7 × 4 × 3/8	15.7 13.6	4.62 3.98	L178 × 102 × 11.1 L178 × 102 × 9.5	23.4	2 980 2 570
.7 × 4 × 98	13.0	3.90	L176 × 102 × 9.5	20.2	2 570
6 × 4 × ⁷ / ₈	27.2	7.98	L152 × 102 × 22.2	40.3	5 150
$6 \times 4 \times \frac{3}{4}$	23.6	6.94	L152 × 102 × 19.0	35.0	4 480
6 × 4 × 5/8	20.0	5.86	L152 × 102 × 15.9	29.6	3 780
6 × 4 × ⁹ / ₁₆	18.1	5.31	L152 × 102 × 14.3	26.8	3 430
$.6 \times 4 \times \frac{1}{2}$	16.2	4.75	L152 × 102 × 12.7	24.0	3 060
$6 \times 4 \times \frac{7}{16}$	14.3	4.18	L152 × 102 × 11.1	21.2	2 700
$.6 \times 4 \times \frac{3}{8}$	12.3	3.61	L152 × 102 × 9.5	18.2	2 330
$6 \times 4 \times \frac{5}{16}$	10.3	3.03	L152 × 102 × 7.9	15.3	1 950
0 01/ 1/	45.0	4.50	1450 00 407	00.7	0.000
.6 × 3½ × ½	15.3	4.50	L152 × 89 × 12.7	22.7	2 900
$6 \times 3\frac{1}{2} \times \frac{3}{8}$	11.7	3.42	L152 × 89 × 9.5	17.3	2 210
6 × 3½ × 5/16	9.80	2.87	L152 × 89 × 7.9	14.5	1 850
$5 \times 3\frac{1}{2} \times \frac{3}{4}$	19.8	5.81	L127 × 89 × 19.0	29.3	3 750
$5 \times 3\frac{1}{2} \times \frac{5}{8}$	16.8	4.92	L127 × 89 × 15.9	24.9	3 170
$.5 \times 3\frac{1}{2} \times \frac{1}{2}$	13.6	4.00	L127 × 89 × 12.7	20.2	2 580
5 × 3½ × ¾	10.4	3.05	L127 × 89 × 9.5	15.4	1 970
5 × 3½ × 5/16	8.70	2.56	L127 × 89 × 7.9	12.9	1 650
5 × 3½ × ¼	7.00	2.06	L127 × 89 × 6.4	10.4	1 330
5 O 1/	40.0	0.75	1407 70 40 7	40.0	0.400
.5 × 3 × ½ .5 × 3 × ½	12.8 11.3	3.75 3.31	L127 × 76 × 12.7 L127 × 76 × 11.1	19.0 16.7	2 420 2 140
/. /.0		3.51			2 110
5 × 3 × ³ / ₈	9.80	2.86	L127 × 76 × 9.5	14.5	1 850
5 × 3 × ⁵ / ₁₆	8.20	2.40	L127 × 76 × 7.9	12.1	1 550
$5 \times 3 \times \frac{1}{4}$	6.60	1.94	L127 × 76 × 6.4	9.8	1 250
4 × 3½ × ½	11.9	3.50	L102 × 89 × 12.7	17.6	2 260
.4 × 3½ × 3/8	9.10	2.67	L102 × 89 × 9.5	13.5	1 720
4 × 3½ × 5/16	7.70	2.25	L102 × 89 × 7.9	11.4	1 450
4 × 3½ × ¼	6.20	1.81	L102 × 89 × 6.4	9.2	1 170

TABLE A2.8 Continued

Size and Thickness, in.	Weight per Foot, lb	Area, in. ²	Size and Thickness, mm	Mass per Metre, kg	Area, mm ²
L4 × 3 × 5/8	13.6	3.98	L102 × 76 × 15.9	20.2	2 570
$-4 \times 3 \times \frac{1}{2}$	11.1	3.25	L102 × 76 × 12.7	16.4	2 100
_4 × 3 × 3/8	8.50	2.48	L102 × 76 × 9.5	12.6	1 600
$-4 \times 3 \times \frac{5}{16}$	7.20	2.09	L102 × 76 × 7.9	10.7	1 350
$-4 \times 3 \times \frac{1}{4}$	5.80	1.69	L102 × 76 × 6.4	8.6	1 090
_3½ × 3 × ½	10.2	3.00	L89 × 76 × 12.7	15.1	1 940
$-3\frac{1}{2} \times 3 \times \frac{7}{16}$	9.10	2.65	L89 × 76 × 11.1	13.5	1 710
.3½ × 3 × 3/8	7.90	2.30	L89 × 76 × 9.5	11.7	1 480
.3½ × 3 × 5/16	6.60	1.93	L89 × 76 × 7.9	9.8	1 250
$-3\frac{1}{2} \times 3 \times \frac{1}{4}$	5.40	1.56	L89 × 76 × 6.4	8.0	1 010
_3½ × 2½ × ½	9.40	2.75	L89 × 64 × 12.7	13.9	1 770
.3½ × 2½ × 3/8	7.20	2.11	L89 × 64 × 9.5	10.7	1 360
_3½ × 2½ × 5/16	6.10	1.78	L89 × 64 × 7.9	9.0	1 150
$-3\frac{1}{2} \times 2\frac{1}{2} \times \frac{1}{4}$	4.90	1.44	L89 × 64 × 6.4	7.3	929
3 × 2½ × ½	8.50	2.50	L76 × 64 × 12.7	12.6	1 610
$3 \times 2\frac{1}{2} \times \frac{7}{16}$	7.60	2.21	L76 × 64 × 11.1	11.3	1 430
.3 × 2½ × 3/8	6.60	1.92	L76 × 64 × 9.5	9.8	1 240
.3 × 2½ × 5/16	5.60	1.62	L76 × 64 × 7.9	8.3	1 050
$3 \times 2\frac{1}{2} \times \frac{1}{4}$	4.50	1.31	L76 × 64 × 6.4	6.7	845
.3 × 2½ × ¾16	3.39	0.996	L76 × 64 × 4.8	5.1	643
.3 × 2 × ½	7.70	2.25	L76 × 51 × 12.7	11.5	1 450
3 × 2 × 3/8	5.90	1.73	L76 × 51 × 9.5	8.8	1 120
3 × 2 × ⁵ / ₁₆	5.00	1.46	L76 × 51 × 7.9	7.4	942
$.3 \times 2 \times \frac{1}{4}$	4.10	1.19	L76 × 51 × 6.4	6.1	768
.3 × 2 × ³ / ₁₆	3.07	0.902	L76 × 51 × 4.8	4.6	582
2½ × 2 × ¾	5.30	1.55	L64 × 51 × 9.5	7.9	1 000
.2½ × 2 × 5/16	4.50	1.31	L64 × 51 × 7.9	6.7	845
$2^{1/2} \times 2 \times {}^{1/4}$	3.62	1.06	L64 × 51 × 6.4	5.4	684
2½ × 2 × ¾16	2.75	0.809	L64 × 51 × 4.8	4.2	522
2½ × 1½ × ¼	3.19	0.938	L64 × 38 × 6.4	4.8	605
.2½ × 1½ × ¾6	2.44	0.715	L64 × 38 × 4.8	3.6	461
.2 × 1½ × ¼	2.77	0.813	L51 × 38 × 6.4	4.2	525
.2 × 1½ × ¾16	2.12	0.621	L51 × 38 × 4.8	3.1	401
$2 \times 1\frac{1}{2} \times \frac{1}{8}$	1.44	0.422	L51 × 38 × 3.2	2.1	272

APPENDIXES

(Nonmandatory Information)

X1. COIL AS A SOURCE OF STRUCTURAL PRODUCTS

X1.1 Continuous wide hot strip rolling mills are normally equipped with coilers. Regardless of the different types of systems employed during or following the rolling operations, it is common for the steel to be reeled into the coiler at temperatures in the stress-relieving range. In general, such temperatures are higher as the steel thickness increases. The coils subsequently cool to ambient temperature with outer and inner laps cooling more rapidly than central laps. The differ-

ence in cooling rate can result in measurable differences in the mechanical properties throughout a coil. Data confirm reduced yield and tensile strength with increased percent elongation for the steel with slower cooling rates from the coiling temperature to ambient. Such differences are in addition to the effects on mechanical properties caused by differences in heat analysis and chemical segregation.

X2. VARIATION OF TENSILE PROPERTIES IN PLATES AND SHAPES

- X2.1 The tension testing requirements of this specification are intended only to characterize the tensile properties of a heat of steel for determination of conformance to the requirements of the applicable product specification. Such testing procedures are not intended to define the upper or lower limits of tensile properties at all possible test locations within a heat of steel. It is well known and documented that tensile properties will vary within a heat or individual piece of steel as a function of chemical composition, processing, testing procedure and other factors. It is, therefore, incumbent on designers and engineers to use sound engineering judgement when using tension test results shown on mill test reports. The testing procedures of this specification have been found to provide structural products adequate for normal structural design criteria.
- X2.2 A survey of the variation to be expected in tensile properties obtained from plates and structural shapes was conducted by the American Iron and Steel Institute (AISI). The results of this survey are contained in a *Contributions to the Metallurgy of Steel* entitled "The Variation of Product Analysis and Tensile Properties—Carbon Steel Plates and Wide Flange Shapes" (SU/18, SU/19 and SU/20), published in September 1974. The data are presented in tables of probability that tensile properties at other than the official location may differ from those of the reported test location. Another survey sponsored by the AISI entitled "Statistical Analysis of Structural Plate Mechanical Properties" was published in January

- 2003. That survey analyzed the results of variability testing on more modern as-rolled steels that were generally of higher minimum yield strength steels and also compared those results statistically to the previous surveys.
- X2.3 This specification contains no requirements applicable to product tension tests; conformance to the applicable product specification is determined on the basis of tests performed at the place of manufacture or processing prior to shipment, unless otherwise specified.
- X2.4 A task group of ASTM Subcommittee A01.02 has determined, based on review of the earlier AISI data, that the variation in tensile properties of plates and structural shapes can be expressed as a function of specified requirements: one standard deviation equals approximately 4 % of required tensile strength, 8 % of required yield strength, and 3 percentage points of required elongation. The January 2003 survey resulted in similar findings.
- X2.5 Acceptance criteria for product testing based upon these values, either below the minimum or above the maximum allowed by the applicable product specification, are generally acceptable to manufacturers. Such tolerances could be considered by users of structural products as a reasonable basis for acceptance of structural products that, due to their inherent variability, deviate from the applicable product specification requirements when subjected to product tension testing.

X3. WELDABILITY OF STEEL

- X3.1 Weldability is a term that usually refers to the relative ease with which a metal can be welded using conventional practice. Difficulties arise in steel when the cooling rates associated with weld thermal cycles produce microstructures (for example, martensite) that are susceptible to brittle fracture or, more commonly, hydrogen-induced (or cold) cracking. (Solidification or hot cracking is a relatively rare phenomenon that will not be addressed here. See Randall for further information.)
- X3.2 The relative sensitivity of steels to forming cold cracking microstructures is called hardenability and can be measured in a number of ways. Perhaps the most popular method of assessing this is by the carbon equivalent (CE) formula, which attempts to equate the relative hardening contributions of a steel's constituent elements (for example,
- manganese, vanadium) to an equivalent amount of carbon, which is the most significant hardening agent. The most popular formula is the International Institute of Welding (IIW) equation presented in S31.2, which has been found suitable for predicting hardenability in a wide range of commonly used carbon-manganese and low alloy steels.
- X3.3 It should be noted, however, that for the current generation of low carbon (<0.10 %) low alloy steels that derive strength from a combination of microalloys and thermal processing methods the use of other formulae may more accurately assess hardenability and cold cracking sensitivity.
- $X3.4\,$ For a vast number of common structural applications it is unnecessary to specify the use of CE limits. However, in

order to obtain a higher level of confidence in avoiding cold cracking, the chemistry controls in S31 are available. A purchaser who specifies the use of S31 should be aware that there are several factors involved in the judicious selection of a maximum CE value, such as the following:

- X3.4.1 Actual production joint restraint/base metal thickness(es),
 - X3.4.2 Filler metal and base metal strength compatibility,
 - X3.4.3 Deposited weld metal diffusible hydrogen content,
 - X3.4.4 Preheat and interpass temperatures,
 - X3.4.5 Filler metal and base metal cleanliness, and

X3.4.6 Heat input.

X3.5 Though it is widely believed that low CE steels are immune to weld cracking problems, failure to consider these factors and others have resulted in weld or base metal HAZ (heat affected zone) cracks in such steels.¹¹

X3.6 It is important to note that carbon equivalence is only a qualitative assessment of potential welding problems, and should never be solely relied on to ensure weld integrity. The proper use of welding specifications, coupled with the knowledge of actual construction conditions, must also be used.

X4. RADIUS FOR COLD BENDING

X4.1 Suggested minimum inside bend radii for cold forming are referenced to Group Designations A to F inclusive as defined in Table X4.1. The suggested radii listed in Table X4.2 should be used as minimums in typical shop fabrication. Material that does not form satisfactorily when fabricated in accordance with Table X4.2 may be subject to rejection pending negotiation with the steel supplier. When tighter bends are required, the manufacturer should be consulted.

X4.2 The bend radius and the radius of the male die should be as liberal as the finished part will permit. The width across the shoulders of the female die should be at least eight times the plate thickness. Higher strength steels require larger die openings. The surface of the dies in the area of radius should be smooth.

X4.2.1 Since cracks in cold bending commonly originate from the outside edges, shear burrs and gas cut edges should be removed by grinding. Sharp corners on edges and on punched or gas cut holes should be removed by chamfering or grinding to a radius.

X4.2.2 If possible, parts should be formed such that the bend line is perpendicular to the direction of final rolling. If it is necessary to bend with the bend line parallel to the direction of final rolling, a more generous radius is suggested ($1\frac{1}{2}$ times applicable value given in Table X4.2 for bend lines perpendicular to the direction of rolling).

X4.3 References

X4.3.1 Holt, G.E., et al., "Minimum Cold Bend Radii Project—Final Report," Concurrent Technologies Corporation, January 27, 1997.

X4.3.2 Brockenbrough, R.L., "Fabrication Guidelines for Cold Bending," R.L. Brockenbrough & Associates, June 28, 1998.

TABLE X4.1 Group Designations for Cold Bending

Specification	Grade	Group Designation ^A
A36/A36M	В	В
A131/A131M	A, B, D, CS and E	В
	A, B, D, CS and E (all cold flanging)	В
	AH32, DH32, EH32 and FH32	С
	AH36, DH36, EH36 and FH36	С
	AH40, DH40, EH40 and FH40	С
A242/A242M	В	С
A283/A283M	A or B	Α
	C or D	В
A514/A514M	any	F
A529/A529M	50 [345] or 55 [380]	С
A572/A572M	42 [290]	В
	50 [345]	С
	55 [380]	D
	60 [415] or 65 [450]	E
A573/A573M	58 [400] or 65 [450]	В
	70 [485]	С
A588/A588M	any	С
A633/A633M	any	В
A656/A656M	50 [345]	В
	60 [415]	D
	70 [485]	E
	80 [550] or 100 [690]	F
A678/A678M	A or B	С
	C or D	D
A709/A709M	36 [250]	В
	50 [345], 50W [345W] or HPS 50W [HPS 345W]	С
	HPS 70W [HPS 485W]	D
	HPS 100W [HPS 690W]	F
A710/A710M	A	F
A808/A808M	В	С
A852/A852M	В	D
A871/A871M	60 [415] or 65 [450]	E
A945/A945M	50 [345] or 65 [450]	В

^A Steels having a ratio of specified minimum tensile strength to specified minimum yield strength of 1.15 or less are in Group F; other steels are in Groups A to E inclusive, which are grouped on the basis of their having similar specified values for minimum elongation in 2 in. [50 mm].

^B Grade designations are not applicable for this specification.

TABLE X4.2 Suggested Minimum Inside Radii for Cold Bending^A

	Thickness (t), in. [mm]							
Group Designation ^B	Up to ¾ in. [20 mm]	Over 3/4 in. [20 mm] To 1 [25 mm, incl]	Over 1 in. [25 mm] To 2 in. [50 mm], incl	Over 2 in. [50 mm]				
Α	1.5t	1.5t	1.5t	1.5t				
В	1.5t	1.5t	1.5t	2.0t				
С	1.5t	1.5t	2.0t	2.5t				
D	1.5t	1.5t	2.5t	3.0t				
E	1.5t	1.5t	3.0t	3.5t				
F	1.75t	2.25t	4.5t	5.5t				

^A Values are for bend lines perpendicular to the direction of final rolling. These radii apply when the precautions listed in X4.2 are followed. If bend lines are parallel to the direction of final rolling, multiply values by 1.5.

^B Steel specifications included in the group designations may not include the entire thickness range shown in this table.

SPECIFICATION FOR GENERAL REQUIREMENTS FOR STEEL PLATES FOR PRESSURE VESSELS



SA-20/SA-20M

(23)

(Identical with ASTM Specification A20/A20M-20 except for revision in para. 11.5.3.)

Specification for General Requirements for Steel Plates for Pressure Vessels

1. Scope

1.1 This general requirements specification covers a group of common requirements that, unless otherwise specified in the applicable product specification, apply to rolled steel plates for pressure vessels covered by each of the following product specifications issued by ASTM:

	3	
	Title of Specification	ASTM Designation
	essel Plates, Alloy Steel, Nickel	A203/A203M
Pressure V	essel Plates, Alloy Steel, Molybdenum	A204/A204M
Pressure V Vanadiur	essel Plates, Alloy Steel, Manganese- n-Nickel	A225/A225M
Stainless C	Chromium Steel-Clad Plate	A263
Stainless C	Chromium-Nickel Steel-Clad Plate	A264
Nickel and	Nickel-Base Alloy-Clad Steel Plate	A265
	essel Plates, Carbon Steel, Low- and iate-Tensile Strength	A285/A285M
	essel Plates, Carbon Steel, Manganese-Silicon	A299/A299M
Pressure V	essel Plates, Alloy Steel, Manganese- num and Manganese-Molybdenum-Nickel	A302/A302M
Pressure V	essel Plates, Alloy Steel, Double- ed and Tempered 9 % Nickel	A353/A353M
	essel Plates, Alloy Steel, Chromium-	A387/A387M
Pressure V Mangane	essel Plates, Carbon Steel, High Strength	A455/A455M
Pressure V	essel Plates, Carbon Steel, for Intermediate- er-Temperature Service	A515/A515M
Pressure V	essel Plates, Carbon Steel, Moderate- and emperature Service	A516/A516M
Pressure V	lessel Plates, Alloy Steel, High-Strength, and Tempered	A517/A517M
Pressure V Tempere	essel Plates, Alloy Steel, Quenched and d, Manganese-Molybdenum and Manganese- num-Nickel	A533/A533M

TH 10 17 11	40T4 D : .: 4
Title of Specification Pressure Vessel Plates, Heat-Treated, Carbon-	ASTM Designation ^A A537/A537M
Manganese-Silicon Steel Pressure Vessel Plates, Alloy Steel, Quenched-and- Tempered, Chromium-Molybdenum, and Chromium- Molybdenum-Vanadium	A542/A542M
Pressure Vessel Plates, Alloy Steel, Quenched and Tempered Nickel-Chromium-Molybdenum	A543/A543M
Pressure Vessel Plates, Alloy Steel, Quenched and Tempered 7, 8, and 9 % Nickel	A553/A553M
Pressure Vessel Plates, Carbon Steel, Manganese- Titanium for Glass or Diffused Metallic Coatings	A562/A562M
Pressure Vessel Plates, Carbon Steel, High Strength, for Moderate and Lower Temperature Service	A612/A612M
Pressure Vessel Plates, 5 % and 5½ % Nickel Alloy Steels, Specially Heat Treated	A645/A645M
Pressure Vessel Plates, Carbon-Manganese-Silicon Steel, for Moderate and Lower Temperature Service	A662/A662M
Pressure Vessel Plates, Carbon-Manganese-Silicon Steel, Quenched and Tempered, for Welded Pressure Vessels	A724/A724M
Pressure Vessel Plates, Low-Carbon Age-Hardening Nickel-Copper-Chromium-Molybdenum-Columbium (Niobium) Alloy Steel	A736/A736M
Pressure Vessel Plates, High-Strength Low-Alloy Steel	A737/A737M
Pressure Vessel Plates, Heat-Treated, Carbon- Manganese-Silicon Steel, for Moderate and Lower Temperature Service	A738/A738M
Pressure Vessel Plates, Alloy Steel, Chromium- Molybdenum-Vanadium	A832/A832M
Steel Plates for Pressure Vessels, Produced by Thermo-Mechanical Control Process (TMCP)	A841/A841M
Steel Plates, 9 % Nickel Alloy, for Pressure Vessels, Produced by the Direct-Quenching Process	A844/A844M
Pressure Vessel Plates, Alloy Steel, Chromium- Molybdenum-Tungsten	A1017/A1017M

- ^A These designations refer to the latest issue of the respective specification which appears in the *Annual Book of ASTM Standards*, Vol 01.04.
- 1.1.1 This general requirements specification also covers a group of supplementary requirements that are applicable to several of the above product specifications as indicated therein. Such requirements are provided for use if additional testing or additional restrictions are required by the purchaser, and apply only if specified individually in the purchase order.
- 1.2 Appendix X1 provides information on coil as a source of plates for pressure vessels.
- 1.3 Appendix X2 provides information on the variability of tensile properties in plates for pressure vessels.
- 1.4 Appendix X3 provides information on the variability of Charpy-V-Notch impact test properties in plates for pressure vessels.

- 1.5 Appendix X4 provides information on cold bending of plates, including suggested minimum inside radii for cold bending.
- 1.6 These materials are intended to be suitable for fusion welding. When the steel is to be welded, it is presupposed that a welding procedure suitable for the grade of steel and intended use or service will be utilized.
- 1.7 In case of any conflict in requirements, the requirements of the applicable product specification prevail over those of this general requirements specification.
- 1.8 Additional requirements that are specified in the purchase order and accepted by the supplier are permitted, provided that such requirements do not negate any of the requirements of this general requirements specification or the applicable product specification.
- 1.9 For purposes of determining conformance with this general requirements specification and the applicable product specification, values are to be rounded to the nearest unit in the right-hand place of figures used in expressing the limiting values in accordance with the rounding method of Practice E29.
- 1.10 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.11 This general requirements specification and the applicable product specification are expressed in both inch-pound units and SI units; unless the order specifies the applicable "M" specification designation (SI units), the plates are to be furnished to inch-pound units.
- 1.12 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A203/A203M Specification for Pressure Vessel Plates, Alloy Steel, Nickel
- A204/A204M Specification for Pressure Vessel Plates, Alloy Steel, Molybdenum
- A225/A225M Specification for Pressure Vessel Plates, Alloy Steel, Manganese-Vanadium-Nickel
- A263 Specification for Stainless Chromium Steel-Clad Plate A264 Specification for Stainless Chromium-Nickel Steel-Clad Plate
- A265 Specification for Nickel and Nickel-Base Alloy-Clad Steel Plate

- A285/A285M Specification for Pressure Vessel Plates, Carbon Steel, Low- and Intermediate-Tensile Strength
- A299/A299M Specification for Pressure Vessel Plates, Carbon Steel, Manganese-Silicon
- A302/A302M Specification for Pressure Vessel Plates, Alloy Steel, Manganese-Molybdenum and Manganese-Molybdenum-Nickel
- A353/A353M Specification for Pressure Vessel Plates, Alloy Steel, Double-Normalized and Tempered 9 % Nickel
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A387/A387M Specification for Pressure Vessel Plates, Alloy Steel, Chromium-Molybdenum
- A435/A435M Specification for Straight-Beam Ultrasonic Examination of Steel Plates
- A455/A455M Specification for Pressure Vessel Plates, Carbon Steel, High-Strength Manganese
- A515/A515M Specification for Pressure Vessel Plates, Carbon Steel, for Intermediate- and Higher-Temperature Service
- A516/A516M Specification for Pressure Vessel Plates, Carbon Steel, for Moderate- and Lower-Temperature Service
- A517/A517M Specification for Pressure Vessel Plates, Alloy Steel, High-Strength, Quenched and Tempered
- A533/A533M Specification for Pressure Vessel Plates, Alloy Steel, Quenched and Tempered, Manganese-Molybdenum and Manganese-Molybdenum-Nickel
- A537/A537M Specification for Pressure Vessel Plates, Heat-Treated, Carbon-Manganese-Silicon Steel
- A542/A542M Specification for Pressure Vessel Plates, Alloy Steel, Quenched-and-Tempered, Chromium-Molybdenum, and Chromium-Molybdenum-Vanadium
- A543/A543M Specification for Pressure Vessel Plates, Alloy Steel, Quenched and Tempered Nickel-Chromium-Molybdenum
- A553/A553M Specification for Pressure Vessel Plates, Alloy Steel, Quenched and Tempered 7, 8, and 9 % Nickel
- A562/A562M Specification for Pressure Vessel Plates, Carbon Steel, Manganese-Titanium for Glass or Diffused Metallic Coatings
- A577/A577M Specification for Ultrasonic Angle-Beam Examination of Steel Plates
- A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applications
- A612/A612M Specification for Pressure Vessel Plates, Carbon Steel, High Strength, for Moderate and Lower Temperature Service
- A645/A645M Specification for Pressure Vessel Plates, 5 % and 5½ % Nickel Alloy Steels, Specially Heat Treated
- A662/A662M Specification for Pressure Vessel Plates, Carbon-Manganese-Silicon Steel, for Moderate and Lower Temperature Service
- A700 Guide for Packaging, Marking, and Loading Methods for Steel Products for Shipment
- A724/A724M Specification for Pressure Vessel Plates, Carbon-Manganese-Silicon Steel, Quenched and Tempered, for Welded Pressure Vessels

- A736/A736M Specification for Pressure Vessel Plates, Low-Carbon Age-Hardening Nickel-Copper-Chromium-Molybdenum-Columbium (Niobium) Alloy Steel
- A737/A737M Specification for Pressure Vessel Plates, High-Strength, Low-Alloy Steel
- A738/A738M Specification for Pressure Vessel Plates, Heat-Treated, Carbon-Manganese-Silicon Steel, for Moderate and Lower Temperature Service
- A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- A770/A770M Specification for Through-Thickness Tension Testing of Steel Plates for Special Applications
- A832/A832M Specification for Pressure Vessel Plates, Alloy Steel, Chromium-Molybdenum-Vanadium
- A841/A841M Specification for Steel Plates for Pressure Vessels, Produced by Thermo-Mechanical Control Process (TMCP)
- A844/A844M Specification for Steel Plates, 9 % Nickel Alloy, for Pressure Vessels, Produced by the Direct-Quenching Process
- A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys
- A1017/A1017M Specification for Pressure Vessel Plates, Alloy Steel, Chromium-Molybdenum-Tungsten
- E21 Test Methods for Elevated Temperature Tension Tests of Metallic Materials
- E29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications
- E112 Test Methods for Determining Average Grain Size
- E208 Test Method for Conducting Drop-Weight Test to Determine Nil-Ductility Transition Temperature of Ferritic Steels
- E709 Guide for Magnetic Particle Testing
- 2.2 American Society of Mechanical Engineers Code:
- ASME Boiler and Pressure Vessel Code, Section IX
- 2.3 U.S. Federal Standard:
- Fed. Std. No. 123 Marking for Shipment (Civil Agencies)
- 2.4 Automotive Industry Action Group Standard:
- B 1 Bar Code Symbology Standard

3. Terminology

- 3.1 Definitions of Terms Specific to This Standard:
- 3.1.1 *as-rolled—for plates*, the condition of a plate that has been hot-rolled and will not be or has not yet been heat treated.
- 3.1.1.1 Discussion—The term as-rolled by itself is not meant to refer to plates that have been hot-rolled using control-rolling (CR), direct quench (DQT), thermo-mechanical control rolling (TMCP), recrystalization control rolling (RCR), or any similar methods that are intended to produce a set of properties that are not normally achievable were they not employed. The term as-rolled is to be distinguished from the established term

- plate-as-rolled that does not define the actual condition of a plate, but defines the singular product of a slab or ingot that has been hot-rolled
- 3.1.2 *coil*—hot-rolled steel in coil form for processing into finished plates.
- 3.1.3 *exclusive*—when used in relation to ranges, as for ranges of thicknesses in the tables of permissible variations in dimensions, the term is intended to exclude only the greater value of the range. Thus, a range from 60 to 72 in. [1500 to 1800 mm] *exclusive* includes 60 in. [1500 mm], but does not include 72 in. [1800 mm].
- 3.1.4 heat treatment terms—see 3.1.11, and Terminology A941.
- 3.1.5 *hot forming*—a forming operation producing permanent deformation, performed after the plate has been heated to the temperature required to produce grain refinement.
- 3.1.6 hot-rolled (hot rolling)—for plates, the process described for a plate that has been rolled from a slab or ingot whose starting temperature is suitably above the recrystallization temperature of the metal to be rolled.
- 3.1.6.1 *Discussion*—Hot-rolled may be used in conjunction with any rolling process to more effectively describe a specific condition, for example; hot-rolled as-rolled; hot-rolled control-rolled, etc.
- 3.1.7 manufacturer—the organization that directly controls the conversion of steel ingots or slabs, by hot rolling, into plate-as-rolled or into coil; and for plates produced from plate-as-rolled, the organization that directly controls, or is responsible for, one or more of the operations involved in finishing the plates. Such finishing operations include leveling, cutting to length, testing, inspection, conditioning, heat treatment (if applicable), packaging, marking, loading for shipment, and certification.
- 3.1.7.1 *Discussion*—The finishing operations need not be done by the organization that did the hot rolling of the plate. For plates produced from coil, see also 3.1.2.
- 3.1.8 *mill edge*—the normal edge produced by rolling between horizontal finishing rolls. A mill edge does not conform to any definite contour. Mill edge plates have two mill edges and two trimmed edges.
- 3.1.8.1 *Discussion*—Mill edge plates may at times be sidetrimmed on one or both sides at the discretion of the manufacturer.
- 3.1.9 *plate identifier*—the alpha, numeric, or alphanumeric designation used to identify the plate.
- 3.1.10 *plates*—flat hot-rolled steel, ordered to thickness or weight and typically to width and length, commonly available by size as follows:

 Width, in. [mm]
 Thickness, in. [mm]

 Over 8 [200]
 over 0.229 [6.0 mm and over]

 Over 48 [1200]
 over 0.179 [4.6 mm and over]

3.1.10.1 *Discussion*—Steel plates are available in various thickness, width, and length combinations dependent upon equipment and processing capabilities of various manufacturers and processors. Historic limitations of a plate based upon dimensions (thickness, width, and length) do not take into

account current production and processing capabilities. To qualify any plate to a particular product specification requires that all appropriate and necessary tests be performed and that the results meet the limits prescribed in that product specification. If the necessary tests required by a product specification can not be conducted, the plate can not be qualified to that specification. This general requirements specification contains permitted variations for the commonly available sizes. Permitted variations for other sizes are subject to agreement between the purchaser and the manufacturer or processor, whichever is applicable.

- 3.1.11 precipitation heat treatment—a subcritical temperature thermal treatment performed to cause precipitation of submicroscopic constituents, and so forth, to result in enhancement of some desirable property.
- 3.1.12 processor—the organization that directly controls, or is responsible for, operations involved in the processing of coil into finished plates. Such processing operations include decoiling, leveling, cutting to length, testing, inspection, conditioning, heat treatment (if applicable), packaging, marking, loading for shipment, and certification.
- 3.1.12.1 Discussion—The processing operations need not be done by the organization that did the hot rolling of the coil. If only one organization is involved in the hot rolling and processing operations, that organization is termed the *manufacturer* for the hot rolling operation and the *processor* for the processing operations. If more than one organization is involved in the hot rolling and processing operations, the organization that did the hot rolling is termed the *manufacturer* and the organization that does one or more processing operations is termed a *processor*.
- 3.2 Refer to Terminology A941 for additional terms used in this standard.

4. Ordering Information

- 4.1 Orders should include the following information, as necessary, to adequately describe the desired product.
 - 4.1.1 Quantity (weight [mass] or number of plates),
 - 4.1.2 Dimensions,
- 4.1.3 Name of product (for example, plates, carbon steel; plates, alloy steel),
- 4.1.4 Specification designation (including type, class, and grade as applicable) and year-date,
- 4.1.5 Condition (as-rolled, normalized, quenched and tempered, etc. If heat treatment of plate is to be performed by the fabricator, this is to be stated. Also, if purchaser specifies a heat-treatment cycle, this is to be stated),
- 4.1.6 Impact test requirements, if any (see Section 12). (For Charpy V-notch test, include test specimen orientation, testing temperature, and acceptance criteria. For drop-weight test, give testing temperature),
- 4.1.7 Exclusion of either plates produced from coil or plates produced from plate-as-rolled, if applicable. (See 5.4 and Appendix X1.)
- 4.1.8 Limits for grain refining elements other than aluminum, if applicable (see 8.3.2),
 - 4.1.9 Paint marking (see 13.2.1),

- 4.1.10 Supplementary requirements, if any (test specimen heat treatment, special impact test requirements, etc.),
- 4.1.11 Provisions for delivery with mill edges and any special permissible variations (see 14.4), and
 - 4.1.12 Additional requirements, if any.

5. Materials and Manufacture

- 5.1 The steel shall be made in an open-hearth, basic-oxygen, or electric-arc furnace, possibly followed by additional refining in a ladle metallurgy furnace (LMF), or by another method; or secondary melting by vacuum-arc remelting (VAR), electroslag remelting (ESR), or another method.
 - 5.2 The steel may be strand cast or cast in stationary molds.
 - 5.2.1 Strand Cast Slabs:
- 5.2.1.1 If heats of the same nominal chemical composition are consecutively strand cast at one time, the heat number assigned to the cast product (slab) may remain unchanged until all of the steel in the slab is from the following heat.
- 5.2.1.2 When two consecutively strand cast heats have different nominal chemical composition ranges, the manufacturer shall remove the transition material by any established procedure that positively separates the grades.
- 5.3 The ratio of reduction of thickness from a strand-cast slab to plate shall be at least 3.0:1, except that reduction ratios as low as 2.0:1 are permitted if all of the following limitations are met:
- 5.3.1 The purchaser agrees to the use of such reduction ratios.
- 5.3.2 The applicable product specification is A299/A299M, A515/A515M, A516/A516M, A537/A537M, A662/A662M, or A737/A737M.
- 5.3.3 The specified plate thickness is 3.0 in. [75 mm] or more
- 5.3.4 One or more of the following low hydrogen practices are used: vacuum degassing during steelmaking; controlled soaking of the slabs or plates; or controlled slow cooling of the slabs or plates.
- 5.3.5 The sulfur content is 0.004~% or less, based upon heat analysis.
- 5.3.6 One or more of the following practices are used: electromagnetic stirring during strand casting; soft reduction during strand casting; heavy pass reductions or other special practices during plate rolling; or combined forging and rolling during plate rolling.
- 5.3.7 The plates are ultrasonically examined in accordance with Specification A578/A578M, Level C based on continuous scanning over 100 % of the plate surface.
- 5.3.8 The plates are through-thickness tension tested in accordance with Specification A770/A770M.
- 5.4 Unless otherwise specified in the purchase order, plates shall be produced from plate-as-rolled or from coil.
- 5.5 Coils are excluded from qualification to the applicable product specification until they are decoiled, leveled, cut to length, and tested by the processor in accordance with the specified requirements (see Sections 9, 10, 11, 12, 13, 14, 15, 16, and 20.)

5.5.1 Plates produced from coil shall not contain splice welds, unless approved by the purchaser.

6. Heat Treatment

- 6.1 If plates are required to be heat treated, the heat treatment shall be performed by the manufacturer, the processor, or the fabricator, unless otherwise specified in the applicable product specification.
- 6.2 If the heat treatment required by the applicable product specification is to be performed by the purchaser or the purchaser's agent, and the plates are to be supplied by the manufacturer or processor in a condition other than that required by the applicable product specification, the order shall so state.
- 6.2.1 If plates are ordered without the heat treatment required by the applicable product specification, heat treatment of the plates to conform to the requirements of the applicable product specification shall be the responsibility of the purchaser.
- 6.3 If heat treatment is to be performed, the plates shall be heat treated as specified in the applicable product specification. The purchaser may specify the heat treatment to be used, provided it is not in conflict with the requirements of the applicable product specification.
- 6.4 If normalizing is to be performed by the fabricator, the plates shall be either normalized or heated uniformly for hot forming, provided that the temperature to which the plates are heated for hot forming does not significantly exceed the normalizing temperature.
- 6.5 If no heat treatment is required, the manufacturer or processor shall have the option of heat treating the plates by normalizing, stress relieving, or normalizing and then stress relieving to meet the requirements of the applicable product specification.
- 6.6 If approved by the purchaser, cooling rates faster than those obtained by cooling in air are permissible to achieve specified mechanical properties, provided that the plates are subsequently tempered in the temperature range from 1100 to 1300°F [595 to 705°C].

7. Chemical Composition

- 7.1 Heat Analysis:
- 7.1.1 Sampling for chemical analysis and methods of analysis shall be in accordance with Test Methods, Practices, and Terminology A751.
- 7.1.2 For each heat, the heat analysis shall include determination of the content of carbon, manganese, phosphorus, sulfur, silicon, nickel, chromium, molybdenum, copper, vanadium, columbium (niobium); any other element that is specified or restricted by the applicable product specification for the applicable grade, class, and type; aluminum, if the aluminum content is to be used in place of austenitic grain size testing of the heat (see 8.3.2.1); and any other austenitic grain refining element for which limits are specified in the purchase order (see 8.3.2).
- 7.1.3 Heat analyses shall conform to the heat analysis requirements of the applicable product specification for the

applicable grade, class, and type. In addition, for elements that are listed in Table 1 but are not specified or restricted in the applicable product specification for the applicable grade, class, and type, heat analyses shall conform to the applicable heat analysis limits given in Table 1.

7.2 Product Analysis:

- 7.2.1 Sampling for chemical analysis and methods of analysis shall be in accordance with Test Methods, Practices, and Terminology A751.
- 7.2.2 For each plate-as-rolled, the purchaser shall have the option of chemically analyzing a broken tension test specimen or a sample taken from the same relative location as that from which the tension test specimen was obtained.
- 7.2.3 For elements that are specified or restricted by the applicable product specification for the applicable grade, class, and type, product analyses shall conform to the product analysis requirements of the applicable product specification for the applicable grade, class, and type.
- 7.2.4 For elements that are listed in Table 1 but are not specified or restricted by the applicable product specification

TABLE 1 Limits on Elements (see 7.1.3 and 7.2.4)

	,	
Copper, max % ^A	Heat analysis Product analysis	0.40 0.43
Nickel, max % ^A	Heat analysis Product analysis	0.40 0.43
Chromium, max % ^{A,B}	Heat analysis Product analysis	0.30 0.34
Molybdenum, max % ^{A,B}	Heat analysis Product analysis	0.12 0.13
Vanadium, max % ^C	Heat analysis Product analysis	0.03 0.04
Columbium (Niobium), ^D max % ^E	Heat analysis Product analysis	0.02 0.03
Titanium, max % ^F	Heat analysis Product analysis	0.03 0.04
Boron, max %	Heat analysis Product analysis	0.0010 0.0015

^A In addition for each heat, based upon the heat analysis, the sum of copper, nickel, chromium, and molybdenum shall not exceed 1.00 %, unless one or more of those elements are specified or restricted by the applicable product specification for the applicable grade, class, and type.

^B In addition for each heat, based upon the heat analysis, the sum of chromium and molybdenum shall not exceed 0.32 %, unless one or both of those elements are specified or restricted by the applicable product specification for the applicable grade class and type

grade, class, and type. ^C By agreement between the purchaser and the supplier, the heat analysis limit for vanadium is permitted to be increased to a value not higher than 0.10 %, and the product analysis limit for vanadium is permitted to be increased to a value not higher than 0.11 %.

^D Columbium and niobium are interchangeable names for the same element and both names are acceptable for use in A01 specifications.

^E By agreement between the purchaser and the supplier, the heat analysis limit for columbium (niobium) is permitted to be increased to a value not higher that 0.05 %, and the product analysis limit for columbium (niobium) is permitted to be increased to a value not higher than 0.06 %.
^F By agreement between the purchaser and the supplier, the heat analysis limit for

F By agreement between the purchaser and the supplier, the heat analysis limit for titanium is permitted to be increased to a value not higher than 0.04 %, and the product analysis limit for titanium is permitted to be increased to a value not higher than 0.05 %.

for the applicable grade, class, and type, product analyses shall conform to the applicable product analysis limits given in Table 1.

7.3 Referee Analysis—For referee purposes, Test Methods, Practices, and Terminology A751 shall be used.

8. Metallurgical Structure

- 8.1 Where austenitic grain size testing is required, such testing shall be a McQuaid Ehn test in accordance with Test Methods E112 and at least 70 % of the grains in the area examined shall meet the specified grain size requirement.
- 8.2 Coarse Austenitic Grain Size—Where coarse austenitic grain size is specified one austenitic grain size test per heat shall be made and the grain size number so determined shall be in the range of 1 to 5 inclusive.
 - 8.3 Fine Austenitic Grain Size:
- 8.3.1 Except as allowed in 8.3.2, and when fine austenitic grain size is specified, or when the producer elects to determine the grain size, one McQuaid Ehn test per heat shall be made and the austenitic grain size number so determined shall be 5 or higher, and the chemical requirements of 8.3.2 do not apply.
- Note 1—Such austenitic grain size numbers may be achieved with lower contents of austenitic grain refining elements than 8.3.2 requires for austenitic grain size testing to be waived.
- 8.3.2 Unless testing for fine austenitic grain size is specified in the purchase order or the producer elects to test for fine austenitic grain size, the austenitic grain size test need not be made for any heat that has, by heat analysis, one or more of the following:
 - $8.3.2.1\,$ A total aluminum content of $0.020\,\%$ or more.
- 8.3.2.2 An acid soluble aluminum content of 0.015 % or more.
- 8.3.2.3 A content for an austenitic grain refining element that exceeds the minimum value agreed to by the purchaser as being sufficient for austenitic grain size testing to be waived.
- 8.3.2.4 Contents for the combination of two or more austenitic grain refining elements that exceed the applicable minimum values agreed to by the purchaser as being sufficient for austenitic grain size testing to be waived.
- 8.3.2.5 The analysis for the elements mentioned in 8.3.2.1, 8.3.2.2, 8.3.2.3, or 8.3.2.4 shall be included in the test report.

9. Quality

- 9.1 *General*—Plates shall be free of injurious defects and shall have a workmanlike finish.
 - 9.2 Surface Imperfections:
- 9.2.1 For plates produced from plate-as-rolled, all injurious surface imperfections shall be removed by the manufacturer. For plates produced from coil, all injurious surface imperfections shall be removed by the processor.
- 9.2.1.1 Shallow imperfections shall be ground to sound metal; the ground area shall be well faired and the thickness of the ground plate shall not be reduced below the minimum thickness permitted.
- 9.2.1.2 All surface imperfections, the removal of which will reduce the plate thickness below the minimum thickness permitted, shall be cause for rejection of the plate, except that,

by agreement with the purchaser, the metal so removed may be replaced with weld metal (see 9.4).

- 9.3 Edge Imperfections:
- 9.3.1 Laminar-type discontinuities 1 in. [25 mm] and less in length visible to the unaided eye on an edge of a plate as prepared for shipment by the manufacturer or processor are acceptable and do not require exploration.
- 9.3.2 All larger discontinuities shall be explored to determine their depth and extent. Discontinuities shall be considered continuous when located in the same plane within 5 % of the plate thickness and separated by a distance less than the length of the smaller of two adjacent discontinuities.
- 9.3.3 Indications visible to the unaided eye on the cut edges of a plate as prepared for shipment by the manufacturer or processor shall not exceed the limits given in Columns 1 and 2 of Table A1.14 [A2.14].
- 9.3.4 Larger indications shall be removed by the manufacturer or processor by grinding, provided that the resultant cavity does not exceed the limits given in Columns 3 and 4 of Table A1.14 [A2.14].
- 9.3.5 Indications of greater magnitude shall be cause for rejection of the plate, except that, by agreement with the purchaser, the defects may be removed and replaced with weld metal (see 9.4).
- 9.3.6 Indications on the edges of a plate cut during the fabrication shall be cause for rejection of the plate at the discretion of the purchaser if the magnitude exceeds the limits given in Columns 5 and 6 of Table A1.14 [A2.14]. The defects may be removed and replaced with weld metal (see 9.4).
- 9.3.7 Fabricators should be aware that edge cracks may initiate upon bending a sheared or burned edge during the fabrication process. This is not considered to be a fault of the steel, but is rather a function of the induced cold work or heat affected zone.
 - 9.4 Repair by Welding:
- 9.4.1 Repair welding shall be permitted only with the approval of the purchaser.
- 9.4.2 Preparation for repair welding shall include inspection to confirm complete removal of the defect.
- 9.4.3 Repairs shall be made utilizing welding procedures qualified in accordance with Section IX of the ASME Boiler and Pressure Vessel Code and repair welding shall be done by welders or welding operators meeting the qualification requirements of Section IX.
- 9.4.4 The weld metal shall have the A-number analysis corresponding to the equivalent ASME P-number of the plate, except that A-1 or A-2 analysis weld metal may be employed for P-1 plates. Other weld metals may be employed that are compatible with the plate being repaired, if so approved by the purchaser. Such weld metals shall be qualified in accordance with the requirements of Section IX of the ASME Boiler and Pressure Vessel Code.
- 9.4.5 If Charpy impact tests of the plate are required, the welding procedure qualification tests shall also include Charpy impact tests of the weld, the heat-affected zone, and the plate, and the test results shall be reported to the purchaser.
- 9.4.6 If the plate is subjected to normalizing, quenching and tempering, hot forming, or post-weld heat treating, the welding

procedure qualification test plates and the weld repaired plate shall be subjected to the thermal heat treatment as specified by the purchaser.

9.4.7 In addition, repair welds shall meet the requirements of the construction code specified by the purchaser.

10. Test Methods

- 10.1 All tests shall be conducted in accordance with Test Methods and Definitions A370.
- 10.2 Yield strength shall be determined by either the 0.2% offset method or the 0.5% extension under load method, unless otherwise stated in the applicable product specification.
- 10.3 Rounding Procedures—For purposes of determining conformance with the applicable product specification, a calculated value shall be rounded to the nearest 1 ksi [5 MPa] for tensile and yield strengths, and to the nearest unit in the right-hand place of figures used in expressing the limiting value for other values, in accordance with the rounding method given in Practice E29.

11. Tension Tests

- 11.1 Number of Test Coupons:
- 11.1.1 Plates Produced from As-Rolled Plates—For other than quenched and tempered plates, one tension test coupon shall be taken from each plate-as-rolled. Two tension test coupons shall be taken from each quenched and tempered plate, as heat treated. If plates are furnished by the manufacturer or processor in accordance with 11.4.2 and qualified by using test specimens taken from heat-treated test coupons (including normalized, normalized and tempered, and quenched and tempered), one tension test coupon shall be taken from each plate-as-rolled (see Terminology A941 for the definition of plate-as-rolled).
- 11.1.2 Plates Produced from Coil and Furnished without Heat Treatment or with Stress Relieving Only—Except as allowed by 11.1.2.1 and 11.1.4, a minimum of three tension coupons shall be taken from each coil as follows:
- 11.1.2.1 The first test coupon shall be taken immediately prior to the first plate to be qualified to the applicable product specification, the second test coupon shall be taken from the approximate center lap, and the third test coupon shall be taken immediately after the last plate to be qualified to the applicable product specification. If, during decoiling, the amount of material decoiled is less than that required to reach the next standard test location, a test for qualification of that particular portion of the coil shall be made from a test coupon taken from a location adjacent to the innermost portion decoiled.
- 11.1.2.2 All plates between any two test locations that meet the requirements of the applicable product specification are acceptable.
- 11.1.2.3 All plates between a test location that fails to meet the requirements of the applicable product specification and an adjacent test location that meets the requirements of the applicable product specification are rejectable, except that the processor has the option to make other tests after cutting back the coil in either direction.
- 11.1.3 Plates Produced from Coil and Furnished Heat Treated by Other than Stress Relieving—For other than

- quenched and tempered plates, one tension test coupon shall be taken from each coil. Two tension test coupons shall be taken from each quenched and tempered plate, as heat treated.
- 11.1.4 Plates Produced from Coil and Qualified Using Test Specimens Taken from Test Coupons Heat Treated by Other than Stress Relieving—One tension test coupon shall be taken from each coil.
- 11.2 *Orientation of Test Specimens*—The longitudinal axis of the tension test specimens shall be transverse to the final rolling direction of the plate.
- 11.3 Location of Test Coupons—Tension test coupons shall be taken from a corner of the plate. For quenched and tempered plates, the two tension test coupons shall be taken from opposite ends of the plate.

11.4 Tests from Heat-Treated Plates:

- 11.4.1 If heat treatment is performed by the manufacturer or processor, the test specimens shall be taken from the plate in the heat-treated condition or from full-thickness coupons simultaneously heat treated with the plate.
- 11.4.2 If heat treatment is to be performed by the fabricator, the plates shall be accepted on the basis of tests made on test specimens taken from full-thickness coupons heat treated in accordance with the requirements specified in the applicable product specification or the purchase order. If the heat-treatment temperatures are not specified, the manufacturer or processor shall heat treat the coupons under conditions it considers appropriate. The purchaser shall be informed of the procedure followed in heat treating the specimens.
- 11.4.3 If approved by the purchaser, the procedures of 11.4.2 may be implemented on plates heat treated by the manufacturer or processor, except that for plates that are quenched and tempered, all testing required the specification or the purchase order must be performed after plate heat treatment, in accordance with 11.1.1 and 11.4.4, and the results reported.
- 11.4.4 For plates that are heat treated with a cooling rate faster than still-air cooling from the austenitizing temperature, one of the following shall apply in addition to other requirements specified herein:
- 11.4.4.1 The gage length of the tension test specimen shall be taken at least 1T from any as-heat treated edge, where T is the thickness of the plate, and shall be at least $\frac{1}{2}$ in. [12.5 mm] from flame-cut or heat-affected-zone surfaces.
- 11.4.4.2 A steel thermal buffer pad, 1 T by 1 T by at least 3 T, shall be joined to the plate edge by a partial penetration weld completely sealing the buffered edge prior to heat treatment.
- 11.4.4.3 Thermal insulation or other thermal barriers shall be used during the heat treatment adjacent to the plate edge where the test specimens are to be removed. It shall be demonstrated that the cooling rate of the tension test specimen is no faster than, and not substantially slower than, that attained by the method described in 11.4.4.2.
- 11.4.4.4 When test coupons cut from the plate but heat treated separately are used, the coupon dimensions shall be not less than 3T by 3T by T and each tension test specimen cut from it shall meet the requirements of 11.4.4.1.

11.4.4.5 If cooling rate data for the plate and cooling rate control devices for the test coupons are available, the test coupons may be heat treated separately in the device, provided that this method is approved by the purchaser.

11.5 Test Specimen Preparation:

- 11.5.1 Tension test specimens for plates ¾ in. [20 mm] and under in thickness shall be the full thickness of the plates. The test specimens shall conform to the requirements for either the 1½-in. [40-mm] wide or the ½-in. [12.5-mm] wide rectangular tension test specimen of Test Methods and Definitions A370. The 1½-in. [40-mm] wide test specimen may have both edges parallel. The ½-in. [12.5-mm] wide specimen may have a maximum nominal thickness of ¾ in. [20 mm].
- 11.5.2 For plates up to 4 in. [100 mm], inclusive, in thickness, tension test specimens may be the full thickness of the plate and conform to the requirements for the 1½-in. [40-mm] wide rectangular tension test specimen of Test Methods and Definitions A370 if adequate testing machine capacity is available.
- 11.5.3 For plates over $\frac{3}{4}$ in. [20 mm] in thickness, except as permitted in 11.5.2, tension test specimens shall conform to the requirements for the 0.500-in. [12.5-mm] diameter test specimen of Test Methods and Definitions A370. For plates between $\frac{3}{4}$ in. [20 mm] and $\frac{1-1}{2}$ in. [40 mm] inclusive in thickness, the axis of the test specimen shall be located at $\frac{1}{2}$ T, the center of the thickness. For plates over $\frac{1-1}{2}$ in. [40 mm], the axis of the test specimen shall be located at $\frac{1}{4}$ T, midway between the center of the thickness and the top or the bottom surface of the plate.

11.6 Elongation Requirement Adjustments:

11.6.1 Due to the specimen geometry effect encountered when using the rectangular tension test specimen for testing thin plate, adjustments in elongation requirements must be provided for thicknesses under 0.312 in. [8 mm]. Accordingly, the following deductions shall be made from the base elongation requirements in the applicable product specification:

Plate Nominal Thickness Range, in. [mm]	Elongation Deduction, %
0.299-0.311 [7.60-7.89]	0.5
0.286-0.298 [7.30-7.59]	1.0
0.273-0.285 [7.00-7.29]	1.5
0.259-0.272 [6.60-6.99]	2.0
0.246-0.258 [6.20-6.59]	2.5
0.233-0.245 [5.90-6.19]	3.0
0.219-0.232 [5.50-5.89]	3.5
0.206-0.218 [5.20-5.49]	4.0
0.193-0.205 [4.90-5.19]	4.5
less than 0.193 [4.90]	5.0

11.6.2 Due to the inherently lower elongation that is obtainable in thicker plate, adjustments in elongation requirements in 2-in. [50-mm] gage length shall be provided for thicknesses over 3.5 in. [90 mm]. Accordingly, the following deductions shall be made from the base elongation requirements in 2 in. [50 mm] prescribed in the applicable product specification:

Plate Nominal Thickness Range, in. [mm]	Elongation Deduction, %
3.501-3.999 [90.00-102.49]	0.5
4.000-4.499 [102.50-114.99]	1.0
4.500-4.999 [115.00-127.49]	1.5
5.000-5.499 [127.50-139.99]	2.0
5.500-5.999 [140.0-152.49]	2.5
6.000 and thicker [152.50 and thicker]	3.0

11.6.3 A characteristic of certain types of alloy steels is a local disproportionate increase in the degree of necking down or contraction of the test specimens during the tension test, resulting in a decrease in the percentage of elongation as the

gage length is increased. The effect is not so pronounced in thicker plates. For such material, if so stated in the applicable product specification for plates up to 3/4 in. [20 mm], inclusive, in thickness, if the percentage of elongation of an 8-in. [200-mm] gage length test specimen falls not more than 3 percentage points below the amount prescribed, the elongation shall be considered satisfactory if the percentage of elongation in 2 in. [50 mm] across the break is not less than 25 %.

11.6.4 The tensile requirements tables in many of the product specifications covered by this general requirements specification specify elongation requirements in both 8-in. [200-mm] and 2-in. [50-mm] gage lengths. Unless otherwise provided in the applicable product specification, both requirements are not required to be applied simultaneously, and the elongation need only be determined in the gage length appropriate for the test specimen used. After selection of the appropriate gage length, the elongation requirement for the alternative gage length shall be deemed not applicable.

11.7 This specification does not provide requirements for product tension testing subsequent to shipment (see 15.1). Therefore, the requirements of 11.1 through 11.6 and Section 16 apply only for tests conducted at the place of manufacture prior to shipment. Compliance to Specification A20/20M and the applicable product specification does not preclude the possibility that product tension test results may vary outside specified ranges. The tensile properties will vary within the same plate-as-rolled or piece, be it as-rolled, control-rolled, or heat-treated. The purchaser should, therefore, be aware that tension testing in accordance with the requirements of Specification A20/A20M does not provide assurance that all products of a plate-as-rolled will be identical in tensile properties with the products tested. If the purchaser wishes to have more confidence than that provided by Specification A20/A20M testing procedures, additional testing or requirements, such as Supplementary Requirement S4, should be imposed.

11.8 Appendix X2 provides additional information on the variability of tensile properties in plates for pressure vessels.

12. Notch-Toughness Tests

12.1 Charpy V-Notch Tests:

- 12.1.1 Number of Tests—If Charpy V-Notch tests are specified, except for quenched and tempered plates, and except as allowed by 12.1.1.1 and 12.1.1.2, one impact test (3 specimens) for each specified orientation (see 12.1.2) shall be made from each plate-as-rolled. For quenched and tempered plates, one impact test shall be made from each plate, as heat treated.
- 12.1.1.1 Plates Ordered Without the Heat Treatment Specified by the Applicable Product Specification—Coupons for Charpy V-notch tests shall be taken in accordance with the same requirements as given for tensile test coupons in 11.4.2 and 11.4.3.
- 12.1.1.2 Plates Produced from Coil—If Charpy V-notch tests are specified, the number of impact tests required shall be the same as the number specified for tension tests in 11.1.2 or 11.1.3, whichever is applicable. The test coupons shall be taken from the material after decoiling and leveling.

- 12.1.2 *Orientation of Test Specimens*—The long axis of the test specimens shall be oriented either longitudinal (parallel to the final direction of rolling) or transverse (transverse to the final direction of rolling), as specified in the applicable product specification or the purchase order.
- 12.1.3 Location of Test Coupons—The impact test coupons shall be taken adjacent to the tension test coupons. The impact test coupons shall be subject to the same requirements as those specified for tension tests in 11.4, except that the provisions of 11.4.4.1 apply to the area under the notch of the impact test specimen instead of to the gage length of the tension test specimen.
- 12.1.4 *Test Method*—Impact testing shall be performed in accordance with Test Methods and Definitions A370 using Charpy V-notch (Type A) specimens as shown in Test Methods and Definitions A370. Except as allowed by 12.1.4.1, full-size specimens (0.394 by 0.394 in. [10 by 10 mm]) shall be used if the plate thickness permits, and their central axis shall correspond as near as practical to the ½ t plane in the plate thickness t. If the plate thickness is insufficient to obtain full-size specimens, the largest possible subsize specimens shall be used.
- 12.1.4.1 For plates that normally have absorbed energy values in excess of 180 ft·lbf [245 J] if tested using full-size specimens at the specified testing temperature, subsize 0.394 by 0.264 in. [10 by 6.7 mm] specimens may be used in lieu of full-size specimens; however, if this option is used, the acceptance value shall be 75 ft·lbf [100 J] minimum for each test specimen and the lateral expansion in mils [micrometres] shall be reported.
- 12.1.5 *Test Temperature*—The test temperature shall be as specified by the product specification, if applicable, or by the purchaser, except that the manufacturer or processor shall have the option of using a lower test temperature. The actual test temperature used shall be reported with the test results.
- 12.1.6 Acceptance Criteria—The acceptance criteria shall be as specified by the product specification, if applicable, or the purchaser.
- 12.1.6.1 If the acceptance criteria is based upon energy absorption of a full-size specimen, the acceptance criteria for the various subsize specimens shall be as given in Table A1.16 [A2.16], except as otherwise provided in 12.1.4.1.
- 12.1.6.2 If the acceptance criterion is based upon lateral expansion opposite the notch, the acceptance value shall be the same for all sizes of test specimens.
- 12.1.7 Marking—The letters "LTV" shall be stenciled or stamped on each plate following the class number, grade, etc.
- 12.1.8 Variability—The impact properties of steel can vary within the same plate-as-rolled or piece, be it as-rolled, control-rolled, or heat-treated. The purchaser should, therefore, be aware that testing of one plate-as-rolled does not provide assurance that all locations within a plate-as-rolled will be identical in toughness with the location tested. Normalizing or quenching and tempering the product will reduce the degree of variation.
- 12.1.8.1 Appendix X3 provides additional information on the variability of Charpy V-notch test properties in plates for pressure vessels.

- 12.2 Drop-Weight Tests:
- 12.2.1 Where specified, one drop-weight test, consisting of a set of two test specimens, shall be made to the same frequency stated in 12.1.1 in accordance with Test Method E208.
- 12.2.2 The test coupons shall be obtained adjacent to a tension test coupon. For plates produced from coil, the test coupon locations shall be the same as for Charpy V-notch tests. (See 12.1.) The provisions of 12.1.3 shall also apply.
- 12.2.3 The testing temperature shall be as specified in the applicable product specification or the purchase order.
- 12.2.4 Acceptance shall be on the basis of *no-break* performance of both test specimens at the specified testing temperature.
- 12.2.5 The plates shall be marked as required in 12.1.7, except that the letters "LTD" shall be used instead of "LTV."

13. Identification of Plates

- 13.1 Required Markings:
- 13.1.1 Except as allowed by 13.4, plates shall be legibly marked with the following information: applicable ASTM designation (see 1.1) (year of issue not required); "G" or" MT" if applicable (see 13.1.2); applicable grade, type, and class; heat number; plate identifier; and name, brand, or trademark of the manufacturer (for plates produced in discrete cut lengths of flat product) or the processor (for plates produced from coil and for subdivided plates (see 13.4)).
- 13.1.2 Plates that are required to be heat treated, but have not been so heat treated, shall be marked, by the manufacturer or processor, with the letter "G" (denoting green) following the required ASTM designation mark, except that "G" marking is not necessary if such plates are for shipment, for the purpose of obtaining the required heat treatment, to an organization under the manufacturer's control. Plates that are required to be heat treated, and have been so heat treated, shall be marked, by the party that performed the heat treatment, with the letters "MT" (denoting material treated) following the required ASTM designation mark.

Note 2—Any stress relief of test specimens intended to simulate post-weld heat treatment is not included in the above heat treatment.

13.2 Types of Marking:

- 13.2.1 Except as allowed by 13.4, the required markings for plates over ½ in. [6 mm] in thickness shall be by steel die stamping, unless paint marking is specified in the purchase order.
- 13.2.2 Except as allowed by 13.4, the required markings for plates ½ in. [6 mm] and under in thickness shall be by paint marking or by steel die stamping using low-stress (either round-nose or interrupted-dot) impressions.
 - 13.3 Location of Markings:
- 13.3.1 Except as allowed by 13.4, the required markings for plates with a maximum lengthwise or crosswise dimension more than 72 in. [1800 mm] shall be in at least two places on each finished plate, at least 12 in. [300 mm] from the edges of the plate.
- 13.3.2 Except as allowed by 13.4, the required markings for plates with a maximum lengthwise and crosswise dimension of

72 in. [1800 mm] or less shall be in at least one place on each finished plate, approximately midway between the center and an edge of the plate.

13.4 Subdivided Plates:

- 13.4.1 By agreement between the purchaser and the manufacturer or processor, each subdivided plate (a plate separated from a master plate) shall be legibly marked with the name, brand, or trademark of the organization that subdivided the plate plus a code traceable to the required markings, provided that the information required in 13.1, cross referenced to that code, is furnished with the plates.
- 13.4.2 By agreement between the purchaser and the manufacturer or processor, subdivided plates that are from the same master plate and placed in secured lifts shall have the information required in 13.1 paint marked on the top piece of each lift or shown on a substantial tag attached to each lift.
- 13.5 *Bar Coding*—In addition to the requirements of 13.1 to 13.4 inclusive, the manufacturer or processor shall have the option of using bar coding as a supplementary identification method.

Note 3—Bar coding should be consistent with AIAG Standard B 1.

14. Permissible Variations in Dimensions or Mass

- 14.1 One cubic foot of rolled steel shall be assumed to weigh 490 lb, unless otherwise stated in the applicable product specification. One cubic metre of rolled steel is assumed to have a mass of 7850 kg, unless otherwise stated in the applicable product specification.
- 14.2 For carbon steel plates the permissible variations for dimensions shall not exceed the applicable limits stated in Annex A1, Table A1.1 to Table A1.9, and Table A1.13 [Annex A2, Table A2.1 to Table A2.9, and Table A2.13].
- 14.3 For alloy steel plates the permissible variations for dimensions shall not exceed the applicable limits stated in Annex 1, Table A1.1 to Table A1.4, Table A1.8, and Table A1.10 to Table A1.13 [Annex 2, Table A2.1 to Table A2.4, Table A2.8 and Table A2.10 to Table A2.13].
- 14.4 Permitted variations on length and width for plates supplied on other than strip mills as mill edge shall be at the discretion of the manufacturer unless otherwise agreed to with the purchaser. For mill edge carbon steel, high-strength low-alloy, and alloy plates produced on strip mills, the permitted variation in width shall not exceed the applicable limit stated in Table A1.17 [A2.16]. For mill edge carbon steel, high-strength low-alloy, and alloy plates produced on mill other than strip mills the permitted variation in width stated in Table A1.17 [A2.16] may be specified only upon agreement between the manufacturer and the purchaser. Mill edge plates as delivered shall be capable of being trimmed by the purchaser to the required final rectangular size ordered.
- 14.5 Conversions of Permitted Variations from Fractions of an Inch to Decimals—Permitted variations in dimensions for products covered by this specification are generally given as fractions of inch and these remain the official permitted variations, where so stated. If the material is to be measured by equipment reporting dimensions as decimals, conversion of

permitted variations from fractions of an inch to decimals shall be made to three decimal places; using the rounding method prescribed in Practice E29.

15. Inspection and Testing

- 15.1 The inspector representing the purchaser shall have entry at all times while work on the contract of the purchaser is being performed, to all parts of the manufacturer's works that concern the manufacture of the plate ordered. The manufacturer shall afford the inspector all reasonable facilities to be satisfied that the plate is being furnished in accordance with this general requirements specification, the applicable product specification, and the purchase order. All tests (except product analysis) and inspection shall be made at the place of manufacture prior to shipment, unless otherwise specified, and shall be so conducted as not to interfere unnecessarily with the operation of the manufacturer's works.
- 15.2 If plates are produced from coil, 15.1 shall apply to the "processor" instead of to the "manufacturer" and the "place of process" shall apply instead of the "place of manufacture." If plates are produced from coil and the processor is different from the manufacturer, the inspector representing the purchaser shall have free entry, at all times while work on the contract of the purchaser is being performed, to all parts of the manufacturer's works that concern the manufacture of the plate ordered.

16. Retests

- 16.1 *Tension Test*—In addition to the provisions of Test Methods and Definitions A370, the following retest provisions shall apply:
- 16.1.1 If any test specimen shows defective machining, or develops flaws, it may be discarded and another test specimen substituted.
- 16.1.2 If the percentage of elongation of any tension test specimen is less than that specified, and any part of the fracture is more than ¾ in. [20 mm] from the center of the gage length of a 2-in. [50-mm] test specimen or is outside the middle half of the gage length of an 8-in. [200-mm] test specimen as indicated by scribe marks on the test specimen before testing, one retest shall be allowed.
- 16.1.3 If the results from an original tension test specimen fail to meet the specified requirements but are within 2 ksi [10 MPa] of the required tensile strength or within 1 ksi [5 MPa] of the required yield strength or yield point, or within 2 percentage points of the required elongation or reduction of area, one retest shall be permitted to replace the failing test.
- 16.1.4 The results of the retest shall meet the specified requirements.
 - 16.2 Charpy V-Notch Tests:
- 16.2.1 The retest provisions of Test Methods and Definitions A370 shall apply, except that the 5 ft·lbf [7 J] absolute minimum for an individual specimen shall not apply if two thirds of the specified minimum average is less than 5 ft·lbf [7 J].
- 16.2.2 If Charpy V-notch impact test lateral expansion values are specified, if the value of one specimen falls below the specified minimum value and not below ½ of the specified

minimum value, and if the average of the three specimens equals or exceeds the specified minimum value, a retest of three additional specimens may be made. Each of the three retest specimens shall equal or exceed the specified minimum value.

16.2.3 If the required values are not obtained on Charpy V-notch retests as specified in 16.2.1 and 16.2.2, or if the values in the initial test are below the values required for retest, no further retests are permitted unless the plate is heat treated or reheat treated. After heat treatment or reheat treatment, a set of three specimens shall be tested and each shall equal or exceed the specified minimum value.

16.2.4 If the option of 12.1.4.1 is used and the test result falls below the 75 ft·lbf [100 J] minimum specified, another test may be made using full-size test specimens.

17. Retreatment

17.1 If any heat-treated plate fails to meet the mechanical requirements of the applicable product specification, the manufacturer or processor shall have have the option of heat treating the plate again. All mechanical-property tests shall be repeated and the plate surface shall be reexamined for surface defects when it is resubmitted for inspection.

18. Rejection

- 18.1 Any rejection based upon product analysis made in accordance with the applicable product specification shall be reported to the supplier and samples that represent the rejected plate shall be preserved for 2 weeks from the date of notification of such rejection. In case of dissatisfaction with the results of the tests, the supplier shall have the option of making claim for a rehearing within that time.
- 18.2 Plates that show injurious defects subsequent to their acceptance at the manufacturer's or processor's works may be rejected. In such cases, the manufacturer or processor shall be notified.

19. Test Reports

- 19.1 The manufacturer or processor shall report the results of all tests required by the applicable product specification, the applicable supplementary requirements, and the purchase order. The heat number, the plate identifier of the plate tested, and the nominal plate thickness shall be shown on the test report. The year-date of the specification to which the plates are furnished shall be included in the test report.
- 19.1.1 In reporting elongation values, both the percentage increase and the original gage length shall be stated.
- 19.2 For plates rolled from a strand-cast slab with a reduction ratio in the range from 2.0:1 to 3.0:1, exclusive, the specific practices (see 5.3.4 and 5.3.6) that were used by the manufacturer shall be reported, and the test reports shall state that the limitations of 5.3 have been met.
- 19.3 All heat treatment, exclusive of subcritical heating to soften thermally cut edges, shall be reported, including temperature ranges and times at temperature. This exclusion does not apply to those plates with specified minimum tensile strengths of 95 ksi [655 MPa] or higher, unless such subcritical

heating is accomplished at temperatures at least 75°F [40°C] below the minimum tempering temperature. The reports shall state whether the plates only, the test coupons only, or both plates and test coupons were heat treated.

- 19.4 If Charpy V-notch tests are specified, the test specimen size used shall be reported.
- 19.5 If so specified in the purchaser order, the manufacturer shall also furnish a certificate of compliance stating that the plates have been manufactured, inspected, and tested in accordance with the requirements of the applicable product specification. For plates produced from coil, the processor shall furnish the required certification.
- 19.6 For plates produced from coil and furnished without heat treatment or with stress relieving only, the results of all tests required by 11.1.2 shall be reported for each qualifying coil
- 19.7 Plates that are required to be heat treated, but have not been so heat treated, shall be certified by the responsible manufacturer on the basis of tests made on heat treated coupons and such tests shall be made and reported. For plates where the heat treatment of the coupons consists of quench and tempering, the manufacturer or processor responsible for the heat treatment of the plate shall repeat any required mechanical tests after plate heat treatment and they shall be the basis for final certification of the plate.
- 19.8 A signature is not required on the test report; however, the document shall clearly identify the organization submitting the report. Notwithstanding the absence of a signature, the organization submitting the report is responsible for the content of the report.
- 19.9 Copies of the original manufacturer's test report shall be included with any subsequent test report.
- 19.10 A test report, certificate of compliance, or similar document printed from or used in electronic form from an electronic data interchange (EDI) transmission shall be regarded as having the same validity as a counterpart printed in the certifier's facility. The content of the EDI transmitted document must meet the requirements of the invoked ASTM standard(s) and conform to any existing EDI agreement between the purchaser and the supplier. Notwithstanding the absence of a signature, the organization submitting the EDI transmission is responsible for the content of the report.

20. Packaging, Marking, and Loading for Shipment

- 20.1 Packaging, marking, and loading for shipment shall be in accordance with those procedures recommended by Guide A700.
- 20.2 For USA Government Procurement—Marking for shipment of material for civil agencies shall be in accordance with Fed. Std. No. 123.

21. Keywords

21.1 general delivery requirement; pressure containing parts; pressure vessel steels; steel plates; steel plates for pressure vessel applications

SUPPLEMENTARY REQUIREMENTS

The following standardized supplementary requirements are for use if desired by the purchaser. Those that are considered suitable for use with a product specification are listed in the product specification. Other tests may be performed by agreement between the manufacturer or processor and the purchaser. These supplementary requirements shall apply only if specified in the purchase order, in which event the specified tests shall be made by the manufacturer or processor before shipment of the plates.

S1. Vacuum Treatment

S1.1 The steel shall be made by a process that includes vacuum degassing while molten. Unless otherwise agreed upon with the purchaser, it is the responsibility of the manufacturer to select suitable process procedures.

S2. Product Analysis

S2.1 A product analysis shall be made of each plate as rolled. The specimens for analysis shall be taken adjacent to or from a broken tension test specimen.

S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons

S3.1 Prior to testing, the test coupons representing the plate for acceptance purposes for mechanical properties shall be thermally treated to simulate a post-weld heat treatment below the critical temperature (Ac₃), using the heat treatment parameters (such as temperature range, time, and cooling rates) specified in the purchase order. For tests using specimens taken from such heat treated test coupons, the test results shall meet the requirements of the applicable product specification. Testing need only be performed and reported in the simulated post-weld heat treated condition.

S4. Additional Tension Test

S4.1 Other Than Quenched-and-Tempered Plates—In addition to the required single tension test, a second tension test shall be made using a test specimen taken from a test coupon taken from a corner of the plate-as-rolled on the end opposite the single test specimen and in a direction parallel to the single test specimen. The results obtained using this second test specimen shall meet the requirements of the applicable product specification.

S4.2 Quenched-and-Tempered Plates 2 in. [50 mm] or Greater in Thickness—In addition to the required tension tests, two additional test coupons shall be taken from the bottom corner of the plate. One shall be taken at the center of the plate thickness and the other immediately beneath the surface. Mandatory conformance of these additional tests with the specified properties shall be a matter of agreement between the manufacturer and the purchaser.

S5. Charpy V-Notch Impact Test

S5.1 Charpy V-notch impact tests shall be conducted in accordance with 12.1.

S5.2 The orientation of the test specimens, whether longitudinal or transverse to the direction of rolling, shall be as specified in the purchase order.

S5.3 The test temperature and the required acceptance criteria, if other than those required in 12.1, shall be as specified in the purchase order.

S5.4 The recorded results shall include test specimen orientation, test specimen size, test temperature, absorbed energy values, and, if specified in the purchase order for other than Class VI plates, lateral expansion opposite the notch. The percent shear fracture appearance shall also be recorded if specified in the purchase order.

S6. Drop-Weight Test (for Plates 0.625 in. [16 mm] and Over in Thickness)

S6.1 Drop-weight tests shall be made in accordance with the requirements of Test Method E208. The specimens shall represent the plates in the final condition of heat treatment. Agreement shall be reached between the purchaser and the manufacturer or processor as to the number of plates to be tested and whether a maximum NDT temperature is mandatory or if the test results are for information only.

S7. High-Temperature Tension Tests

S7.1 A short-time elevated temperature tension test shall be made to represent each plate or each heat of steel as indicated by the purchaser. The specimens for testing shall be obtained as required for the room temperature tension tests specified in the body of this general requirements specification. The high-temperature tests shall be made in accordance with the requirements of Test Methods E21. Mandatory conformance of such additional tests with the specified properties shall be a matter for agreement between the manufacturer or processor and the purchaser.

S8. Ultrasonic Examination in Accordance with A435/A435M

S8.1 All plates shall be ultrasonically examined in accordance with the requirements of Specification A435/A435M.

S9. Magnetic Particle Examination

S9.1 All plate edges shall be examined by magnetic particles in accordance with the procedures covered in Guide E709. The acceptability of defects revealed by this examination shall be judged in accordance with the requirements for quality in 9.3.

S10. Charpy V-Notch Impact Transition Curve

S10.1 Sufficient impact tests of the same specimen size shall be made from the plate test material to establish a transition curve. The test temperature range shall be wide enough to establish the upper and lower shelf energies, with sufficient testing at intermediate temperatures to permit plotting a reasonable smooth curve. A plot of the data is not required. The manufacturer shall report the specimen orientation, test temperature, and absorbed energy for each specimen tested. Lateral expansion and percent shear shall also be reported when specified in the purchase order. The number of plates tested and the specimen orientation shall be the same as in 12.1 unless otherwise specified in the purchase order.

S11. Ultrasonic Examination in Accordance with A577/ A577M

S11.1 All plates shall be ultrasonically examined in accordance with the requirements of Specification A577/A577M.

S12. Ultrasonic Examination in Accordance with A578/A578M

S12.1 All plates shall be ultrasonically examined in accordance with the requirements of Specification A578/A578M. The acceptance level shall be as specified in the purchase order.

S13. NDT Temperature Determination

S13.1 The NDT temperature shall be established in accordance with Test Method E208 using coupons from a single plate. The number of plates to be so tested shall be subject to agreement between the purchaser and the manufacturer or processor.

S15. Reduction of Area Measurement

S15.1 A reduction of area measurement shall be taken while making the required tension test. Reduction of area shall be determined only on the 0.500-in. [12.5-mm] round specimen as shown in Fig. 5 of Test Methods and Definitions A370. The minimum acceptance limit shall be 40 %.

S16. Thermal Stress Relief of Mechanical Test Coupons

S16.1 Test coupons representing the plates shall be thermally stress relieved by gradually and uniformly heating them to a temperature between 1100 and 1200°F [595 and 650°C], or a temperature range otherwise agreed upon between the manufacturer or processor and the purchaser, holding at temperature for at least 1 h/in. [2.4 min/mm] of thickness and cooling in still air to a temperature not exceeding 600°F [315°C].

S17. Vacuum Carbon-Deoxidized Steel

S17.1 Material shall be vacuum carbon-deoxidized, in which case the silicon content at the time of vacuum deoxidizing shall be 0.12 % maximum, and the content of deoxidizers such as aluminum, zirconium, and titanium should be kept low enough to allow deoxidation by carbon. The test report shall indicate that the steel was vacuum carbon-deoxidized. The minimum heat analysis and product analysis requirements for silicon do not apply to vacuum carbon-deoxidized steel.

S19. Restricted Chemical Requirements

S19.1 Restricted heat analysis and product analysis limits are applicable, as specified in the purchase order.

S20. Maximum Carbon Equivalent for Weldability

S20.1 Plates shall be supplied with a specific maximum carbon equivalent value. This value shall be based upon the heat analysis. The required chemical analysis as well as the carbon equivalent shall be reported.

S20.2 The carbon equivalent shall be calculated using the following formula:

$$CE = C + Mn/6 + (Cr + Mo + V)/5 + (Ni + Cu)/15$$

S20.3 The maximum value of the carbon equivalent for carbon steels (including C-Mn, C-Mn-Si, C-Mn-Si-Al steels), are given in Table S20.1.

S21. Restricted Limits on Elements

For each heat, based upon the heat analysis, the content shall not exceed 0.35 % for copper, 0.25 % for nickel, 0.25 % for chromium, 0.08 % for molybdenum, or 0.70 % for the sum of those four elements.

S22. Through-Thickness Tension Tests

S22.1 Through-thickness tension tests shall be made in accordance with the requirements of Specification A770/A770M. (See Ordering Information in Specification A770/A770M for the additional information that may be needed.)

S24. Strain Age Test

S24.1 Test coupons shall be given a strain age treatment designated by the purchaser. Charpy V-notch tests shall be conducted on the strain aged specimens. Heat treatment, strain aging, test temperature, and acceptance criteria shall be as agreed upon between the manufacturer or processor and the purchaser.

S25. Weldability

S25.1 Weldability tests shall

be conducted. The type of test and the acceptance criteria shall be as agreed upon between the manufacturer or processor and the purchaser.

TABLE S20.1 Maximum Carbon Equivalent for Weldability

Specified Minimum UTS	Equivalent Value	
ksi [MPa]	Thickness up to 2 in.	Thickness over 2 in.
	[50 mm] incl	[50 mm]
60 ≤ UTS < 70	0.45	0.46
[415 ≤ UTS < 485]		
70 ≤ UTS < 80	0.47	0.48 ^A
[485 ≤ UTS < 550]		
UTS ≥ 80	0.48 ^{A,B}	
[UTS ≥ 550]		

A If simulated PWHT of the test coupons is specified (S3), the maximum carbon equivalent value may be increased up to 0.50 upon agreement between purchaser and supplier.
B Applicable to quenched-and-tempered material; for other conditions, maximum

^B Applicable to quenched-and-tempered material; for other conditions, maximum carbon equivalent shall be by agreement between purchaser and supplier.

S26. Low-Sulfur Steels

S26.1 The steel shall be made to 0.010 % sulfur maximum. Lower sulfur levels and sulfide shape control practices can be specified by agreement between the manufacturer or processor and the purchaser.

S27. Restrictive Plate Flatness

S27.1 Carbon steel plates, as-rolled or normalized, shall conform to the permissible restrictive variations from flatness given in Table S27.1 or Table S27.2.

S27.2 High-strength low-alloy steel plates, as-rolled or normalized, shall conform to the permissible restrictive variations from flatness given in Table S27.3 or Table S27.4.

S28. Heat Treatment in the Working Zone of a Surveyed Furnace

S28.1 Plates shall be heat treated in the working zone of a furnace that has been surveyed in accordance with Test Method A991/A991M, provided that such working zone was established using a variation of 25°F [15°C] or less from the furnace set point.

S28.2 The test report shall indicate that S28 applies.

TABLE S27.1 Permissible Variations from Flatness for Carbon Steel Plates As-Rolled or Normalized Ordered to Restrictive Flatness

Note 1—Flatness Variations for Length—The longer dimension specified is considered the length, and variation in flatness along the length shall not exceed the tabular amount for the specified width in plates up to 12 ft in length, or in any 12 ft of longer plates.

Note 2-Flatness Variations for Width-The flatness variation across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 36 in., the variation in flatness along the length and across the width shall not exceed ¼ in. in each direction. When the longer dimension is from 36 to 72 in., inclusive, the permissible flatness variation shall not exceed 75 % of the tabular amount for the specified width, but in no case less than ¼ in.

Note 4—The variations given in this table apply to plates that have a minimum specified tensile strength not over 60 ksi or comparable chemistry or hardness. For plates specified to a higher minimum tensile strength or comparable chemistry or hardness, the permissible variations are 1½ times the amounts shown in the table below.

Note 5—This table and these notes cover the flatness variations of circular and sketch plates based on the maximum dimensions of those plates.

Note 6—Waviness tolerances for rectangular plates, universal mill plates, and circular and sketch plates do not apply.

Note 7—A "Z" indicates that there is no published restricted value for the size.

Note 8—Plates shall be in a horizontal position on a flat surface when flatness is measured.

Specified	Permissible Variations from a Flat Surface for Specified Widths, in.									
Thickness, in.	48 to 60, excl	60 to 72, excl	72 to 84, excl	84 to 96, excl	96 to 108, excl	108 to 120, incl				
To 1/4, excl	3/4	15/16	Z	Z	Z	Z				
1/4 to 3/8, excl	9/16	3/4	7/8	15/16	1-1/16	1-1/8				
3/8 to 1/2, excl	5/16	5/16	3/8	7/16	1/2	9/16				
1/2 to 3/4, excl	5/16	5/16	5/16	3/8	1/2	1/2				
3/4 to 1, excl	5/16	5/16	5/16	5/16	3/8	7/16				
1 to 2, incl	1/4	5/16	5/16	5/16	5/16	3/8				

TABLE S27.2 Permissible Variations from Flatness for Carbon Steel Plates As-Rolled or Normalized Ordered to Restrictive Flatness

Note 1—Flatness Variations for Length—The longer dimension specified is considered the length, and variation in flatness along the length shall not exceed the tabular amount for the specified width in plates up to 3700 mm in length, or in any 3700 mm of longer plates.

Note 2-Flatness Variations for Width-The flatness variation across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 900 mm, the variation in flatness along the length and across the width shall not exceed 6 mm in each direction. When the longer dimension is from 900 to 1800 mm, inclusive, the permissible flatness variation shall not exceed 75 % of the tabular amount for the specified width, but in no case less than 6 mm.

Note 4—The variations given in this table apply to plates that have a minimum specified tensile strength not over 415 MPa or comparable chemistry or hardness. For plates specified to a higher minimum tensile strength or comparable chemistry or hardness, the permissible variations are 1½ times the amounts shown in the table below.

Note 5—This table and these notes cover the flatness variations of circular and sketch plates based on the maximum dimensions of those plates.

Note 6—Waviness tolerances for rectangular plates, universal mill plates, and circular and sketch plates do not apply.

Note 7—A "Z" indicates that there is no published restricted value for the size.

Note 8—Plates shall be in horizontal position on a flat surface when flatness is measured.

Specified	Permissible Variations from a Flat Surface for Specified Widths, mm								
Thickness, mm	1200 to 1500, excl	1500 to 1800, excl	1800 to 2100, excl	2100 to 2400, excl	2400 to 2700, excl	2700 to 3000, incl			
To 6, excl	18	24	Z	Z	Z	Z			
6 to 10, excl	15	18	22	24	27	29			
10 to 12, excl	8	8	10	11	13	15			
12 to 20, excl	7	8	8	10	13	13			
20 to 25, excl	7	8	8	8	10	11			
25 to 50, excl	7	7	7	8	8	8			

TABLE S27.3 Permissible Variations from Flatness for High-Strength Low-Alloy Steel Plates As-Rolled or Normalized Ordered to Restrictive Flatness

Note 1—Flatness Variations for Length—The longer dimension specified is considered the length, and variation in flatness along the length shall not exceed the tabular amount for the specified width in plates up to 12 ft in length, or in any 12 ft of longer plates.

Note 2—Flatness Variations for Width—The flatness variation across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 36 in., the variation in flatness along the length and across the width shall not exceed 3/8 in. in each direction. When the larger dimension is from 36 to 72 in., inclusive, the permissible flatness variation shall not exceed 75 % of the tabular amount for the specified width but in no case less than 3/8 in.

Note 4—This table and these notes cover the flatness variations of circular and sketch plates based on the maximum dimensions of those plates.

NOTE 5—Waviness tolerances for rectangular plates, universal mill plates, and circular and sketch plates do not apply.

Note 6—A "Z" indicates that there is no published restricted value for the size.

Note 7—Plates shall be in horizontal position on a flat surface when flatness is measured.

Specified	Permissible Variations from a Flat Surface for Specified Widths, in.								
Thickness, in.	48 to 60, excl	60 to 72, excl	72 to 84, excl	84 to 96, excl	96 to 108, excl	108 to 120, incl			
To 1/4, excl	4 , excl 1½16 17/16		Z	Z	Z	Z			
1/4 to 3/8, excl	7/8	11/16	15/16 17/16		11/2	111/16			
% to 1/2, excl	1/2	1/2	9/16	11/16	3/4	13/16			
1/2 to 3/4, excl	7/16	7/16	1/2	9/16	5/8	11/16			
3/4 to 1, excl	7/16	7/16	1/2	1/2	9/16	11/16			
1 to 2, incl	3/8	7/16	7/16	1/2	1/2	1/2			

TABLE S27.4 Permissible Variations from Flatness for High-Strength Low-Alloy Steel Plates As-Rolled or Normalized Ordered to Restrictive Flatness

Note 1—Flatness Variations for Length—The longer dimension specified is considered the length, and variation in flatness along the length shall not exceed the tabular amount for the specified width in plates up to 3700 mm in length, or in any 3700 mm of longer plates.

Note 2—Flatness Variations for Width—The flatness variation across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 900 mm, the variation in flatness along the length and across the width shall not exceed 10 mm in each direction. When the larger dimension is from 900 to 1800 mm, inclusive, the permissible flatness variation shall not exceed 75 % of the tabular amount for the specified width, but in no case less than 10 mm.

Note 4—This table and these notes cover the variations for flatness of circular and sketch plates based on the maximum dimensions of those plates.

Note 5—Waviness tolerances for rectangular plates, universal mill plates, and circular and sketch plates do not apply.

Note 6—A "Z" indicates that there is no published restricted value for the size.

Note 7—Plates shall in a horizontal position on a flat surface when flatness is measured.

Specified	Permissible Variations from a Flat Surface for Specified Widths, mm								
Thickness, mm	1200 to 1500, excl	1500 to 1800, excl	1800 to 2100, excl	2100 to 2400, excl	2400 to 2700, excl	2700 to 3000, incl			
To 6, excl	27	36	Z	Z	Z	Z			
6 to 10, excl	22	27	33	36	39	43			
10 to 12, excl	12	12	15	17	19	21			
12 to 20, excl	11	11	13	15	16	18			
20 to 25, excl	11	11	12	13	15	17			
25 to 50, excl	10	11	11	12	13	13			

ANNEXES

(Mandatory Information)

A1. PERMISSIBLE VARIATIONS IN DIMENSIONS, ETC.—INCH-POUND UNITS

A1.1 Listed below are permissible variations in dimensions, and notch toughness information, expressed in inch-pound units of measurement.

TABLE A1.1 Permissible Variations in Thickness for Rectangular Plates

Note 1—Permissible variation under specified thickness, 0.01 in. When so specified, these permitted variations may be taken all over, in which case the sum of these permitted variations applies.

Note 2—Thickness to be measured at $\frac{3}{8}$ to $\frac{3}{4}$ in. from the longitudinal edge.

Note 3—For thickness measured at any location other than that specified in Note 2, the permissible maximum over-tolerance shall be increased by 75 %, rounded to the nearest 0.01 in.

Specified				Tole	rance Over	Specified Th	ickness for \	Nidths Giver	n, in.			
Thickness, in.	48 and under	Over 48 to 60,	60 to 72,	72 to 84,	84 to 96,	96 to 108,	108 to 120,	120 to 132,	132 to 144,	144 to 168,	168 to 182,	182 and
		excl	excl	excl	excl	excl	excl	excl	excl	excl	excl	over
To 1/4, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.04			
1/4 to 5/16, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04			
5/16 to 3/8, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.05		
3/8 to 7/16, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.05	0.06	0.06	
7/16 to 1/2, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.05	0.06	0.06	
1/2 to 5/8, excl	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.05	0.06	0.07	
5/8 to 3/4, excl	0.03	0.03	0.03	0.03	0.03	0.04	0.04	0.04	0.05	0.06	0.07	0.07
3/4 to 1, excl	0.03	0.03	0.03	0.03	0.04	0.04	0.05	0.05	0.06	0.07	0.08	0.09
1 to 2, excl	0.06	0.06	0.06	0.06	0.06	0.07	0.08	0.10	0.10	0.11	0.13	0.16
2 to 3, excl	0.09	0.09	0.09	0.10	0.10	0.11	0.12	0.13	0.14	0.15	0.15	
3 to 4, excl	0.11	0.11	0.11	0.11	0.11	0.13	0.14	0.14	0.14	0.15	0.17	
4 to 6, excl	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.20	0.20	
6 to 10, excl	0.23	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.27	0.28	
10 to 12, excl	0.29	0.29	0.33	0.33	0.33	0.33	0.33	0.33	0.33	0.33	0.35	
12 to 15, incl	0.29	0.29	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	

TABLE A1.2 Permissible Variations in Width and Length for Sheared Plates 11/2 in. and Under in Thickness; Length Only for Universal Mill Plates 21/2 in. and Under in Thickness

Specifie	ed Dimensions, in.	Pern	nissible Varia	tions over Sp	pecified Width	and Length ^A	for Thickness	es Given in i	nches, in.
		To 3/	s,excl	3/8 to 5	5⁄8 , excl	5% to 1, excl		1 1	o 2, incl ^B
Length	Width	Width	Length	Width	Length	Width	Length	Width	Length
To 120, excl	over 8 to 60, excl	3/8	1/2	7/16	5/8	1/2	3/4	5/8	1
	60 to 84, excl	7/16	5/8	1/2	11/16	5/8	7/8	3/4	1
	84 to 108, excl	1/2	3/4	5/8	7/8	3/4	1	1	11/8
	108 and over	5/8	7/8	3/4	1	7/8	11/8	11/8	11/4
20 to 240, excl	over 8 to 60, excl	3/8	3/4	1/2	7/8	5/8	1	3/4	11/8
	60 to 84, excl	1/2	3/4	5/8	7/8	3/4	1	7/8	11/4
	84 to 108, excl	9/16	7/8	11/16	15/16	13/16	11/8	1	13/8
	108 and over	5/8	1	3/4	1 ½	7/8	11/4	11/8	13/8
240 to 360, excl	over 8 to 60, excl	3/8	1	1/2	11/8	5/8	11/4	3/4	11/2
	60 to 84, excl	1/2	1	5/8	11/8	3/4	11/4	7/8	11/2
	84 to 108, excl	9/16	1	11/16	1 ½	7/8	13/8	1	11/2
	108 and over	11/16	11/8	7/8	11/4	1	13/8	11/4	13/4
360 to 480, excl	over 8 to 60, excl	7/16	11/8	1/2	11/4	5/8	13/8	3/4	15/8
	60 to 84, excl	1/2	11/4	5/8	13/8	3/4	11/2	7/8	15/8
	84 to 108, excl	9/16	11/4	3/4	13/8	7/8	11/2	1	17/8
	108 and over	3/4	13/8	7/8	11/2	1	15/8	11/4	17/8
180 to 600, excl	over 8 to 60, excl	7/16	11/4	1/2	11/2	5/8	15/8	3/4	17/8
	60 to 84, excl	1/2	13/8	5/8	11/2	3/4	15/8	7/8	17/8
	84 to 108, excl	5/8	13/8	3/4	11/2	7/8	15/8	1	17/8
	108 and over	3/4	11/2	7/8	15/8	1	13/4	11/4	17/8
600 to 720, excl	over 8 to 60, excl	1/2	13/4	5/8	1 7/8	3/4	17/8	7/8	21/4
	60 to 84, excl	5/8	13/4	3/4	1 7/8	7/8	17/8	1	21/4
	84 to 108, excl	5/8	13/4	3/4	1 7/8	7/8	17/8	11/8	21/4
	108 and over	7/8	13/4	1	2	1 1/8	21/4	11/4	21/2
'20 and over	over 8 to 60, excl	9/16	2	3/4	21/8	7/8	21/4	1	23/4
	60 to 84, excl	3/4	2	7/8	21/8	1	21/4	1 ½	23/4
	84 to 108, excl	3/4	2	7/8	21/8	1	21/4	11/4	23/4
	108 and over	1	2	11/8	23/8	11/4	21/2	13/8	3

A Permissible variation under specified width and length: ¼ in. By agreement, these permitted variations may be taken all over, in which case the sum of these permitted variations applies.

B Permissible variations in length apply also to Universal Mill plates up to 12 in. in width for thicknesses over 2 to 2½ in., incl, except for alloy steel up to 2 in. thick.

TABLE A1.3 Permissible Variations in Rolled Width for Universal Mill Carbon Steel, High-Strength Low-Alloy Steel, and Alloy-Steel Plates 15 in. and under in Thickness

Note 1—Permissible variation under specified width shall be 1/8 in.

		Variations Over Specified Width for Thicknesses Given, in.							
Specified Width, in.	To 3/8 , excl	3/8 to 5/8, excl	5% to 1, excl	1 to 2, incl	Over 2 to 10, incl	Over 10 to 15, incl			
Over 8 to 20, excl 20 to 36, excl 36 and over	1/8 3/16 5/16	1/8 1/4 3/8	3/16 5/16 7/16	1/4 3/8 1/2	³ / ₈ ⁷ / ₁₆ ⁹ / ₁₆	1/2 9/16 5/8			

TABLE A1.4 Permissible Variations in Diameter for Sheared Circular Carbon Steel, High-Strength Low-Alloy Steel, and Alloy Steel Plates 1 in. and under in Thickness

Note 1—No permissible variations under specified diameter.

Specified		Permissible Variations Over Specified Diameter for Thicknesses Given, in.						
Specified Diameter, in.	To 3/8 , excl	hicknesses Given, in.	5% to 1, incl					
To 32, excl	1/4	3/8	1/2					
32 to 84, excl	5/16	7/16	9/16					
84 to 108, excl	3/8	1/2	5/8					
108 to 130, incl	7/16	9/16	11/16					

TABLE A1.5 Permissible Variations in Width and Length for Rectangular Carbon Steel and High-Strength Low-Alloy Steel Plates when Gas Cutting is Specified or Required

Note 1—These variations may be taken all under or divided over and under, if so specified.

Note 2—Plates with universal rolled edges will be gas cut to length only.

Specified Thickness, in.	Variations Over for All Specified Widths or Lengths, in.
To 2, excl	1/2
2 to 4, excl	5/8
4 to 6, excl	3/4
6 to 8, excl	7/8
8 to 15, incl	1

TABLE A1.6 Permissible Variations in Diameter for Gas-Cut Circular Carbon Steel and High-Strength Low-Alloy Steel Plates

Note 1-No permissible variations under specified diameter

Specified	Variations Over Specified Diameter for Thicknesses Given, in.								
Diameter, in.	To 1, excl	1 to 2, excl	2 to 4, excl	4 to 6, excl	6 to 8, excl	8 to 15, incl			
To 32, excl	3/8	3/8	1/2	1/2	5/8	3/4			
32 to 84, excl	3/8	1/2	1/2	5/8	3/4	7/8			
84 to 108, excl	1/2	9/16	5/8	3/4	7/8	1			
108 to 130, excl	1/2	9/16	11/16	7/8	1	11/8			
130 and over	5/8	3/4	7/8	1	1 ½	11/4			

TABLE A1.7 Permissible Camber for Carbon Steel Sheared or Gas-Cut Rectangular Plates all Thicknesses

Note 1—Camber, as it relates to plates, is the horizontal edge curvature in the length, measured over the entire length of the plate in the flat position.

Maximum permissible camber, in. = $\frac{1}{8}$ in. \times (number of feet of length/5)

TABLE A1.8 Permissible Camber for Carbon Steel, High-Strength Low-Alloy Steel, and Alloy Steel Universal Mill Plates and High-Strength Low-Alloy Steel and Alloy Steel Sheared or Gas-Cut Rectangular Plates

Dimensi	on, in.	Camber for Thickness
Thickness	Width	and Widths Given
To 2, incl	all	1/8 in. × (number of feet of length/5)
Over 2 to 15, incl Over 2 to 15, incl	to 30, incl over 30	$\frac{3}{16}$ in. \times (number of feet of length/5) $\frac{1}{4}$ in. \times (number of feet of length/5)

TABLE A1.9 Permissible Variations from Flatness for Carbon Steel Plates

Note 1—Flatness Variations for Length—The longer dimension specified is considered the length, and variation in flatness along the length shall not exceed the tabular amount for the specified width in plates up to 12 ft in length, or in any 12 ft of longer plates.

Note 2—Flatness Variations for Width—The flatness variation across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 36 in., the variation in flatness along the length and across the width shall not exceed ½ in. in each direction. When the longer dimension is from 36 to 72 in., inclusive, the flatness variation shall not exceed 75 % of the tabular amount for the specified width, but in no case less than ¼ in.

Note 4—The tolerances given in this table apply to plates that have a minimum specified tensile strength not over 60 ksi or comparable chemistry or hardness. For plates specified to a higher minimum tensile strength or comparable chemistry or hardness, the limits given in the table are increased to 1½ times the amounts in the above table.

Note 5—This table and notes cover the flatness tolerances of circular and sketch plates, based on the maximum dimensions of those plates.

Note 6—Plates shall be in a horizontal position on a flat surface when flatness is measured.

				Variations	from a Flat S	urface for Spe	cified Widths,	in.			
Specified Thickness, in.	Over 8 to 36, excl	36 to 48, excl	48 to 60, excl	60 to 72, excl	72 to 84, excl	84 to 96, excl	96 to 108, excl	108 to 120, excl	120 to 144, excl	144 to 168, excl	168 and over
To 1/4, excl	9/16	3/4	¹⁵ / ₁₆	11/4	13/8	1½	15/8	13/4	17/s		
1/4 to 3/8, excl	1/2	5/8	3/4	15/16	11/8	11/4	13/8	11/2	15/8		
3/8 to 1/2, excl	1/2	9/16	5/8	5/8	3/4	7/8	1	11/8	11/4	17/8	21/8
½ to ¾, excl	7/16	1/2	9/16	5/8	5/8	3/4	1	1	11/8	11/2	2
3/4 to 1, excl	7/16	1/2	9/16	5/8	5/8	5/8	3/4	7/8	1	13/8	13/4
1 to 2, excl	3/8	1/2	1/2	9/16	9/16	5/8	5/8	5/8	11/16	11/8	11/2
2 to 4 excl	5/16	3/8	7/16	1/2	1/2	1/2	1/2	9/16	5/8	7/8	11/8
4 to 6, excl	3/8	7/16	1/2	1/2	9/16	9/16	5/8	3/4	7/8	7/8	1
6 to 8, excl	7/16	1/2	1/2	5/8	11/16	3/4	7/8	7/8	1	1	1
8 to 10 excl	1/2	1/2	5/8	11/16	3/4	13/16	7/8	15/16	1	1	1
10 to 12, excl	1/2	5/8	3/4	13/16	7/8	15/16	1	1	1	1	1
12 to 15, incl	5/8	3/4	13/16	7/8	15/16	1	1	1	1	1	

TABLE A1.10 Permissible Variations in Width and Length for Rectangular Alloy Steel Plates when Gas Cutting is Specified or Required

Note 1—These variations may be taken all under or divided over and under, if so specified.

Note 2— Plates with universal rolled edges will be gas cut to length only.

Specified Thickness, in.	Variations Over for All Specified Widths and Lengths, in.
To 2, excl	3/4
2 to 4, excl	1
4 to 6, excl	11/8
6 to 8, excl	15/16
8 to 15, incl	1½

TABLE A1.11 Permissible Variations in Diameter for Gas-Cut Circular Alloy Steel Plates

Note 1—No permissible variations under specified diameter.

	Variation	Variations Over Specified Diameter for Thicknesses Given, in.								
Specified Diameter, in.	To 1, excl	1 to 2, excl	2 to 4, excl	4 to 6, excl	6 to 8, excl	8 to 15 incl				
To 32, excl	1/2	3/4	3/4	3/4	1	1				
32 to 84, excl	1/2	5/8	7/8	1	11/8	11/4				
84 to 108, excl	5/8	3/4	1	11/8	11/4	13/8				
108 to 130, incl	7/8	1	11/8	11/4	13/8	11/2				

TABLE A1.12 Permissible Variations from Flatness for High-Strength Low-Alloy Steel and Alloy Steel Plates

Note 1—Flatness Tolerances for Length—The longer dimension specified is considered the length and variations from a flat surface along the length shall not exceed the tabular amount for the specified width in plates up to 12 ft in length, or in any 12 ft of longer plates.

Note 2—Flatness Tolerances for Width—The flatness variation across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 36 in., the variation shall not exceed $\frac{3}{8}$ in. When the larger dimension is from 36 to 72 in., incl, the variation shall not exceed $\frac{7}{8}$ of the tabular amount for the specified width.

Note 4—This table and notes cover the tolerances for flatness of circular and sketch plates, based on the maximum dimensions of those plates.

Note 5—Plates shall be in a horizontal position on a flat surface when flatness is measured.

				Variatio	ns from a Fla	t Surface for	Specified Wi	dths, in.			
Specified Thickness, in.	Over 8 to 36, excl	36 to 48, excl	48 to 60, excl	60 to 72, excl	72 to 84, excl	84 to 96, excl	96 to 108, excl	108 to 120, excl	120 to 144, excl	144 to 168, excl	168 and Over
To 1/4, excl	13/16	11/8	13/8	17/8	2	21/4	23/8	25/8	23/4		
1/4 to 3/8, excl	3/4	15/16	11/8	13/8	13/4	17/8	2	21/4	23/8		
3/8 to 1/2, excl	3/4	7/8	15/16	15/16	11/8	15/16	11/2	15/8	17/8	23/4	31/8
½ to ¾, excl	5/8	3/4	13/16	7/8	1	11/8	11/4	13/8	15/8	21/4	3
3/4 to 1, excl	5/8	3/4	7/8	7/8	15/16	1	11/8	1 5⁄16	11/2	2	25/8
1 to 2, excl	9/16	5/8	3/4	13/16	7/8	15/16	1	1	1	15/8	21/4
2 to 4, excl	1/2	9/16	11/16	3/4	3/4	3/4	3/4	7/8	1	11/4	15⁄8
4 to 6, excl	9/16	11/16	3/4	3/4	7/8	7/8	¹⁵ / ₁₆	11/8	11/4	11/4	11/2
6 to 8, excl	5/8	3/4	3/4	15/16	1	11/8	11/4	15/16	11/2	11/2	11/2
8 to 10, excl	3/4	13/16	15/16	1	11/8	11/4	1 5⁄16	13/8	11/2	11/2	11/2
10 to 12, excl	3/4	15/16	11/8	11/4	1 5/16	13/8	11/2	11/2	11/2	11/2	11/2
12 to 15, incl	7/8	1	1 3/ ₁₆	15/16	13/8	11/2	11/2	11/2	11/2	11/2	11/2

TABLE A1.13 Waviness Tolerances for Rectangular Plates, Universal Mill Plates, Circular Plates, and Sketch Plates

Note 1—Waviness denotes the deviation of the top or bottom surface from a horizontal line, when the plate is resting on a flat surface, as measured in an increment of less than 12 ft of length. The waviness tolerance is a function of the flatness tolerance as obtained from Tables A1.9 and A1.12.

Flatness Tolerance from Tables	When Number of Waves in 12 ft is:										
A1.9 and A1.12	1	2	3	4	5	6	7				
5/16	5/16	1/4	3/16	1/8	1/8	1/16	1/16				
3/8	3/8	5/16	3/16	3/16	1/8	1/16	1/16				
7/16	7/16	5/16	1/4	3/16	1/8	1/8	1/16				
1/2	1/2	3/8	5/16	3/16	3/16	1/8	1/16				
9/16	9/16	7/16	5/16	1/4	3/16	1/8	1/8				
5/8	5/8	1/2	3/8	1/4	3/16	1/8	1/8				
11/16	11/16	1/2	3/8	5/16	3/16	3/16	1/8				
3/4	3/4	9/16	7/16	5/16	1/4	3/16	1/8				
13/16	13/16	5/8	7/16	5/16	1/4	3/16	1/8				
7/8	7/8	11/16	1/2	3/8	1/4	3/16	1/8				
15/16	15/16	11/16	1/2	3/8	5/16	1/4	3/16				
1	1	3/4	9/16	7/16	5/16	1/4	3/16				
11/8	11/8	7/8	5/8	1/2	3/8	1/4	3/16				
11/4	11/4	15/16	11/16	1/2	3/8	5/16	1/4				
13/8	13/8	11/16	3/4	9/16	7/16	5/16	1/4				
11/2	11/2	11/8	7/8	5/8	1/2	3/8	1/4				
15⁄8	15/8	11/4	15/16	11/16	1/2	3/8	5/16				
13/4	13/4	15/16	1	3/4	9/16	7/16	5/16				
17/8	17/8	17/16	11/16	13/16	9/16	7/16	5/16				
2	2	11/2	11/8	7/8	5/8	1/2	3/8				
21/8	21/8	15/8	1 3/ ₁₆	7/8	11/16	1/2	3/8				
21/4	21/4	111/16	11/4	15/16	11/16	9/16	3/8				
23/8	23/8	1 ¹³ / ₁₆	1 5/16	1	3/4	9/16	7/16				
21/2	21/2	17/8	17/16	11/16	13/16	9/16	7/16				
25/8	25/8	2	1½	11/8	13/16	5/8	7/16				
23/4	23/4	21/16	19/16	11/8	7/8	5/8	1/2				
27/8	27/8	23/16	15/8	13/16	15/16	11/16	1/2				
3	3	21/4	111/16	11/4	15/16	11/16	9/16				
31/8	31/8	23/8	13/4	15/16	1	3/4	9/16				

TABLE A1.14 Visible Edge Indications Extending Approximately Parallel to Rolled Surfaces

Plate Specification and Thickness	Accepta	able	Remove by Grinding	Acceptable on Edges Cut in Fabrication		
and mickness –	Depth	Length ^A	Depth	Length ^A	Depth	Length ^A
Column	1	2	3	4	5	6
Other than killed, ^B to 2 in., incl	1/8 in. max	any	over 1/8 in. to 1/4 in., incl	over 1 in.	1/4 in. max	any
Killed, c to 6 in., incl	1/16 in. max	any	over 1/16 in. to 1/8 in., incl	over 1 in.	¹⁄ ₈ in. max	any
Killed, ^C over 6 in.	¹⁄ ₈ in. max	any	over 1/8 in. to 1/2 in., incl	over 1 in.	½ in. max	any

^A Laminar-type discontinuities 1 in. and less in length are acceptable and do not require exploration. ^B Specifications: A285; A433; A442 in thicknesses to 1 in., incl; or A455. ^C The specification in 1.1 of this standard, other than those listed in the above Footnote *B*.

TABLE A1.15 Generally Available Grade-Thickness-Minimum Test Temperature Combinations Meeting Charpy V-Notch Requirements Indicated (Normalized or Quenched and Tempered Condition)

Note 1—The minimum temperatures listed are for longitudinal tests. For transverse tests, the available minimum temperature may be somewhat higher.

Acceptance Criteria	a Charpy V-Notch		Tesi	Temperature, °F for Otherwise A	Plate Thicknesses (U greed Upon)	Inless
Energy Ab (based on full-siz		Specification and Grade				
Minimum Average For 3 Specimens ft-lbf	Minimum For 1 Specimen ft-lbf		1 in. and Under	Over 1 in. to 2 in., incl.	Over 2 in. to 3 in., incl.	Over 3 in. to 5 in., incl.
13	10	A203 Grade A	-90	-90	-75	
		A203 Grade D	-150	-150	-125	
		A516 Grade 55	-60	-60	-50	-50
		A516 Grade 60	-60	-50	-50	-50
		A516 Grade 65	-60	-50	-40	-25
		A537 Class 1 (Over 2½ -4 in.)			-75	-50
		A662 Grade A	-75	-75		
		A662 Grade B	-60	-60		
15	12	A203 Grade B	-90	-90	-75	
		A203 Grade E	-150	-150	-125	
		A203 Grade F (4 in. max)			-160	-160
		A299 Grade A	-50	-40	-30	-20
		A299 Grade B	-10	0	+10	+20
		A516 Grade 70	-50	-40	-30	-20
		A537 Class 1 (21/2 in. max)	-80	-75	-75	
		A537 Class 2 (Over 21/2 -4 in.)			-75	-50
		A662 Grade C	-50	-50		
20	15	A203 Grade F	-160	-160		
		A537 Class 2 (21/2 in. max)	-90	-90	-90	
		A612	-50			
		A724 Grade A, B, and C	-50			

TABLE A1.16 Charpy V-Notch Test Acceptance Criteria for Various Subsize Specimens^A

									•		
	e, 10 by mm		e, 10 by mm		e, 10 by mm		10 by 5 nm		e, 10 by mm		e, 10 by mm
ft∙lbf	[J]	ft⋅lbf	[J]	ft⋅lbf	[J]	ft⋅lbf	[J]	ft⋅lbf	[J]	ft⋅lbf	[J]
40	[54]	30	[41]	27	[37]	20	[27]	13	[18]	10	[14]
35	[48]	26	[35]	23	[31]	18	[24]	12	[16]	9	[12]
30	[41]	22	[30]	20	[27]	15	[20]	10	[14]	8	[11]
25	[34]	19	[26]	17	[23]	12	[16]	8	[11]	6	[8]
20	[27]	15	[20]	13	[18]	10	[14]	7	[10]	5	[7]
16	[22]	12	[16]	11	[15]	8	[11]	5	[7]	4	[5]
15	[20]	11	[15]	10	[14]	8	[11]	5	[7]	4	[5]
13	[18]	10	[14]	9	[12]	6	[8]	4	[5]	3	[4]
12	[16]	9	[12]	8	[11]	6	[8]	4	[5]	3	[4]
10	[14]	8	[11]	7	[10]	5	[7]	3	[4]	2	[3]
7	[10]	5	[7]	5	[7]	4	[5]	2	[3]	2	[3]

^A Interpolation shall be made for specimens with widths intermediate of those listed. Interpolated values shall be rounded to the nearest whole number as prescribed in Practice E29.

TABLE A1.17 Permissible Variations in Width for Mill Edge Carbon Steel and High-Strength Low-Alloy Steel Plates Produced on Strip Mills

 $\ensuremath{\text{Note }1-\hspace{-0.5em}}\xspace - Applies to plates produced from coil and plates produced from plate-as-rolled.}$

Specified Width, in.	Variations over SpecifiedWidth, in ^A
To 14, excl	7/16
14 to 17, excl	1/2
17 to 19, excl	9/16
19 to 21, excl	5/8
21 to 24, excl	11/16
24 to 26, excl	13/16
26 to 28, excl	15/16
28 to 35, excl	11/8
35 to 50, excl	11/4
50 to 60, excl	1½
60 to 65, excl	15%
65 to 70, excl	13/4
70 to 80, excl	17/8
80 and over	2

A No permissible variation under specified width.

A2. PERMISSIBLE VARIATIONS IN DIMENSIONS, ETC.—SI UNITS

A2.1 Listed herein are permissible variations in dimensions, and notch toughness information, expressed in SI units.

TABLE A2.1 Permissible Variations in Thickness for Rectangular Plates

Note 1—Permissible variation under specified thickness, 0.3 mm. When so specified, these permitted variations may be taken all over, in which case the sum of these permitted variations applies.

Note 2—Thickness shall be measured 10 to 20 mm from the longitudinal edge.

Note 3—For specified thicknesses other than those shown, the tolerances for the next higher thickness shall apply.

Note 4—For thickness measured at any location other than that specified in Note 2, the permissible maximum over tolerance shall be increased by 75%, rounded to the nearest 0.1 mm.

Specified			To	lerance Over	Specified Thi	ckness for Wi	dths Given in	Millimetres, r	nm		
Thickness, mm	1200 and Under	Over 1200 to 1500, excl	1500 to 1800, excl	1800 to 2100, excl	2100 to 2400, excl	2400 to 2700, excl	2700 to 3000, excl	3000 to 3300, excl	3300 to 3600, excl	3600 to 4200, excl	4200 and Over
5.0	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.9	1.0		
5.5	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.9	1.0		
6.0	0.8	8.0	8.0	8.0	0.8	0.8	0.9	1.0	1.1		
7.0	0.8	8.0	8.0	8.0	0.8	0.8	0.9	1.0	1.2	1.4	
8.0	0.8	8.0	8.0	8.0	0.8	0.8	0.9	1.0	1.2	1.4	
9.0	0.8	8.0	8.0	8.0	0.8	0.8	1.0	1.0	1.3	1.5	
10.0	0.8	8.0	8.0	8.0	0.8	0.8	1.0	1.0	1.3	1.5	1.7
11.0	0.8	8.0	8.0	8.0	0.8	0.8	1.0	1.0	1.3	1.5	1.7
12.0	0.8	0.8	0.8	0.8	0.8	0.9	1.0	1.0	1.3	1.5	1.8
14.0	0.8	0.8	0.8	0.8	0.9	0.9	1.0	1.1	1.3	1.5	1.8
16.0	0.8	0.8	0.8	0.8	0.9	0.9	1.0	1.1	1.3	1.5	1.8
18.0	0.8	0.8	0.8	0.8	0.9	1.0	1.1	1.2	1.4	1.6	2.0
20.0	0.8	0.8	0.8	0.8	0.9	1.0	1.2	1.2	1.4	1.6	2.0
22.0	0.8	0.9	0.9	0.9	1.0	1.1	1.3	1.3	1.5	1.8	2.0
25.0	0.9	0.9	1.0	1.0	1.0	1.2	1.3	1.5	1.5	1.8	2.2
28.0	1.0	1.0	1.1	1.1	1.1	1.3	1.4	1.8	1.8	2.0	2.2
30.0	1.1	1.1	1.2	1.2	1.2	1.4	1.5	1.8	1.8	2.1	2.4
32.0	1.2	1.2	1.3	1.3	1.3	1.5	1.6	2.0	2.0	2.3	2.6
35.0	1.3	1.3	1.4	1.4	1.4	1.6	1.7	2.3	2.3	2.5	2.8
38.0	1.4	1.4	1.5	1.5	1.5	1.7	1.8	2.3	2.3	2.7	3.0
40.0	1.5	1.5	1.6	1.6	1.6	1.8	2.0	2.5	2.5	2.8	3.3
45.0	1.6	1.6	1.7	1.8	1.8	2.0	2.3	2.8	2.8	3.0	3.5
50.0	1.8	1.8	1.8	2.0	2.0	2.3	2.5	3.0	3.0	3.3	3.8
55.0	2.0	2.0	2.0	2.2	2.2	2.5	2.8	3.3	3.3	3.5	3.8
60.0	2.3	2.3	2.3	2.4	2.4	2.8	3.0	3.4	3.4	3.8	4.0
70.0	2.5	2.5	2.5	2.6	2.6	3.0	3.3	3.5	3.6	4.0	4.0
80.0	2.8	2.8	2.8	2.8	2.8	3.3	3.5	3.5	3.6	4.0	4.0
90.0	3.0	3.0	3.0	3.0	3.0	3.5	3.5	3.5	3.6	4.0	4.4
100.0	3.3	3.3	3.3	3.3	3.5	3.8	3.8	3.8	3.8	4.4	4.4
110.0	3.5	3.5	3.5	3.5	3.5	3.8	3.8	3.8	3.8	4.4	4.4
120.0	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	4.8	4.8
130.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	5.2	5.2
140.0	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	5.6	5.6
150.0	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	5.6	5.6
160.0	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8	5.6	5.6
180.0	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	6.3	6.3
200.0	5.8	5.8	6.0	6.0	6.0	6.0	6.0	6.0	6.0	7.0	7.0
250.0	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	8.8
300.0	7.5	7.5	9.0	9.0	9.0	9.0	9.0	9.0	9.0	9.0	9.0

TABLE A2.2 Permissible Variations in Width and Length for Sheared Plates 40 mm and Under in Thickness; Length only for Universal Mill Plates 65 mm and Under in Thickness

Specified	Dimensions, mm		Pern		ions over Spe esses Given ir			or	
Length	Width	To 10	0, excl	10 to 1	I6, excl	16 to 2	16 to 25, excl		50, incl ^B
		Width	Length	Width	Length	Width	Length	Width	Length
To 3 000 excl	to 1500 excl	10	13	11	16	13	19	16	25
	1500 to 2100 excl	11	16	13	17	16	22	19	25
	2100 to 2700 excl	13	19	16	22	19	25	25	29
	2700 and over	16	22	19	25	22	29	29	32
3 000 to 6 000 excl	to 1500 excl	10	19	13	22	16	25	19	29
	1500 to 2100 excl	13	19	16	22	19	25	22	32
	2100 to 2700 excl	14	22	17	24	21	29	25	35
	2700 and over	16	25	19	29	22	32	29	35
6 000 to 9 000 excl	to 1500 excl	10	25	13	29	16	32	19	38
	1500 to 2100 excl	13	25	16	29	19	32	22	38
	2100 to 2700 excl	14	25	17	32	22	35	25	38
	2700 and over	17	29	22	32	25	35	32	44
9 000 to 12 000 excl	to 1500 excl	11	29	13	32	16	35	19	41
	1500 to 2100 excl	13	32	16	35	19	38	22	41
	2100 to 2700 excl	14	32	19	35	22	38	25	48
	2700 and over	19	35	22	38	25	41	32	48
12 000 to 15 000 excl	to 1500 excl	11	32	13	38	16	41	19	48
	1500 to 2100 excl	13	35	16	38	19	41	22	48
	2100 to 2700 excl	16	35	19	38	22	41	25	48
	2700 and over	19	38	22	41	25	44	32	48
15 000 to 18 000 excl	to 1500 excl	13	44	16	48	19	48	22	57
	1500 to 2100 excl	16	44	19	48	22	48	25	57
	2100 to 2700 excl	16	44	19	48	22	48	29	57
	2700 and over	22	44	25	51	29	57	32	64
18 000 and over	to 1500 excl	14	51	19	54	22	57	25	70
	1500 to 2100 excl	19	51	22	54	25	57	29	70
	2100 to 2700 excl	19	51	22	54	25	57	32	70
	2700 and over	25	51	29	60	32	64	35	76

A Permissible variation under specified width and length: 6 mm. By agreement, these permitted variations may be taken all over, in which case the sum of these permitted

TABLE A2.3 Permissible Variations in Rolled Width for Universal Mill Carbon Steel, High-Strength Low-Alloy Steel Plates, and Alloy Steel Plates 400 mm and under in Thickness

Note 1—Permissible variation under specified width shall be 3 mm.

	Variation	Variations Over Specified Width for Thickness Given, mm									
Specified Width, mm	To 10, excl	10 to 16, excl	16 to 25, excl	25 to 50, excl	Over 50 to 250, incl	Over 250 to 400, incl					
Over 200 to 500, excl	3	3	5	6	10	13					
500 to 900, excl 900 and over	5 8	6 10	8 11	10 13	11 14	14 16					

variations applies.

B Permissible variations in length apply also to Universal Mill plates up to 300 mm in width for thicknesses over 50 to 65 mm, incl, except for alloy steel up to 50 mm thick.

TABLE A2.4 Permissible Variations in Diameter for Sheared Circular Carbon Steel, High-Strength Low-Alloy Steel, and Alloy Steel Plates 25 mm and under in Thickness

Note 1-No permissible variations under specified diameter.

Specified Diameters, mm	Permissible Variations Over Specified Diameter for Thicknesses Given, mm						
Diameters, min	To 10, excl	10 to 16, excl	16 to 25, incl				
To 800, excl	6	10	13				
800 to 2100, excl	8	11	14				
2100 to 2700, excl	10	13	16				
2700 to 3300, excl	11	14	17				
3300 and over	13	16	19				

TABLE A2.5 Permissible Variations in Width and Length for Rectangular Carbon Steel and High-Strength Low-Alloy Steel Plates when Gas Cutting is Specified or Required

Note 1—These variations may be taken all under or divided over and under, if so specified.

 ${\it Note}$ 2—Plates with universal rolled edges will be gas cut to length only.

Specified Thickness, mm	Variations Over for All Specified Widths or Lengths, mm
To 50, excl	13
50 to 100, excl	16
100 to 150, excl	19
150 to 200, excl	22
200 to 400, incl	25

TABLE A2.6 Permissible Variations in Diameter for Gas-Cut Circular Carbon Steel and High-Strength Low-Alloy Steel Plates

Note 1—No permissible variations under specified diameter.

Specified	Variations	Variations Over Specified Diameter for Thicknesses Given, mm								
Diameters, mm	To 25, excl	25 to 50, excl	50 to 100, excl	100 to 150, excl	150 to 200, excl	200 to 400, excl				
To 800, excl 800 to 2100, excl	10 10	10 13	13 13	13 16	16 19	19 22				
2100 to 2700, excl	13	14	16	19	22	25				
2700 to 3300, excl	13	14	17	22	25	29				
3300 and over	16	19	22	25	29	32				

TABLE A2.7 Permissible Camber for Carbon Steel Sheared or Gas-Cut Rectangular Plates all Thicknesses

Note 1—Camber, as it relates to plates, is the horizontal edge curvature in the length, measured over the entire length of the plate in the flat position.

Maximum permissible camber, mm = length in millimetres/500

TABLE A2.8 Permissible Camber for Carbon Steel, High-Strength Low-Alloy Steel, and Alloy Steel Universal Mill Plates and High-Strength Low-Alloy Steel and Alloy Steel Sheared or Gas-Cut Rectangular Plates

Note 1—Camber, as it relates to plates, is the horizontal edge curvature in the length, measured over the entire length of the plate in the flat position.

Width, mm	Camber for Width Given, mm
To 750, incl	Length/300
Over 750 to 1500	Length/250

TABLE A2.9 Permissible Variations from Flatness for Carbon Steel Plates

Note 1—Flatness Variations for Length—The longer dimension specified is considered the length, and variation in flatness along the length shall not exceed the tabular amount for the specified width in plates up to 4000 mm in length, or in any 4000 mm of longer plates.

Note 2—Flatness Variations for Width—The flatness variation across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 900 mm, the variation in flatness along the length and across the width shall not exceed 6 mm in each direction. When the longer dimension is from 900 to 1800 mm, inclusive, the flatness variation shall not exceed 75 % of the tabular amount for the specified width, but in no case less than 6 mm.

Note 4—The tolerances given in this table apply to plates that have a minimum specified tensile strength not over 415 MPa or comparable chemistry or hardness. For plates specified to a higher minimum tensile strength or comparable chemistry or hardness, the limits given in the table are increased to 1½ times the amounts in the above table.

Note 5—This table and notes cover the flatness tolerances of circular and sketch plates, based on the maximum dimensions of those plates.

Note 6—Plates shall be in a horizontal position on a flat surface when flatness is measured.

Specified Thickness,			Pe	rmissible Va	riations from	a Flat Surfa	ce for Speci	fied Widths,	mm		
mm	To 900, excl	900 to 1200	1200 to 1500	1500 to 1800	1800 to 2100	2100 to 2400	2400 to 2700	2700 to 3000	3000 to 3600	3600 to 4200	4200 and 0ver
To 6, excl	14	19	24	32	35	38	41	44	48		
6 to 10, excl	13	16	19	24	29	32	35	38	41		
10 to 12, excl	13	14	16	16	19	22	25	29	32	48	54
12 to 20, excl	11	13	14	16	16	19	25	25	29	38	51
20 to 25, excl	11	13	14	16	16	16	19	22	25	35	44
25 to 50, excl	10	13	13	14	14	16	16	16	18	29	38
50 to 100, excl	8	10	11	13	13	13	13	14	16	22	29
100 to 150, excl	10	11	13	13	14	14	16	19	22	22	25
150 to 200, excl	11	13	13	16	18	19	22	22	25	25	25
200 to 250, excl	13	13	16	18	19	21	22	24	25	25	25
250 to 300, excl	13	16	19	21	22	24	25	25	25	25	25
300 to 400, incl	16	19	21	22	24	25	25	25	25	25	

TABLE A2.10 Permissible Variations in Width and Length for Rectangular Alloy Steel Plates when Gas Cutting is Specified or Required

Note 1—These variations may be taken all under or divided over and under, if so specified.

Note 2—Plates with universal rolled edges will be gas cut to length only.

Specified Thickness, mm	Variations Over for All Specified Widths and Lengths, mm
To 50, excl	19
50 to 100, excl	25
100 to 150, excl	29
150 to 200, excl	33
200 to 400, incl	38

TABLE A2.11 Permissible Variations in Diameter for Gas Cut Circular Alloy Steel Plates

Note 1—No permissible variations under specified diameter.

Specified	Variations Over Specified Diameter for Thicknesses Given, mm						
Specified Diameter, mm	To 25, excl	25 to 50, excl	50 to 100, excl	100 to 150, excl	150 to 200, excl	200 to 400, incl	
To 800, excl	13	13	19	19	25	25	
800 to 2100, excl	13	16	22	25	29	32	
2100 to 2700, excl	16	19	25	29	32	35	
2700 to 3300, incl	22	25	29	32	35	38	

TABLE A2.12 Permissible Variations from Flatness for High-Strength Low-Alloy Steel and Alloy Steel Plates

Note 1—Flatness Tolerances for Length—The longer dimension specified is considered the length and variations from a flat surface along the length shall not exceed the tabular amount for the specified width in plates up to 4000 mm in length, or in any 4000 mm of longer plates.

Note 2-Flatness Tolerances for Width-The flatness variation across the width shall not exceed the tabular amount for the specified width.

Note 3—When the longer dimension is under 900 mm, the variation shall not exceed 10 mm. When the larger dimension is from 900 to 1800 mm, incl, the variation shall not exceed 75 % of the tabular amount for the specified width.

Note 4—This table and notes cover the tolerances for flatness of circular and sketch plates, based on the maximum dimensions of those plates.

Note 5—Plates shall be in a horizontal position on a flat surface when flatness is measured.

	Flatness Tolerances for Specified Widths, mm										
Specified Thickness, mm	To 900, excl	900 to 1200	1200 to 1500	1500 to 1800	1800 to 2100	2100 to 2400	2400 to 2700	2700 to 3000	3000 to 3600	3600 to 4200	4200 and over
To 6, excl	21	29	35	48	51	57	60	67	70		
6 to 10, excl	19	24	29	35	44	48	51	57	60		
10 to 12, excl	19	22	24	24	29	33	38	41	48	70	79
12 to 20, excl	16	19	21	22	25	29	32	35	41	57	76
20 to 25, excl	16	19	22	22	24	25	29	33	38	51	67
25 to 50, excl	14	16	19	21	22	24	25	25	25	41	57
50 to 100, excl	13	14	18	19	19	19	19	22	25	32	41
100 to 150, excl	14	18	19	19	22	22	24	29	32	32	38
150 to 200, excl	16	19	19	24	25	29	32	33	38	38	38
200 to 250, excl	19	21	24	25	29	32	33	35	38	38	38
250 to 300, excl	19	24	29	32	33	35	38	38	38	38	38
300 to 400, incl	22	25	30	33	35	38	38	38	38	38	38

TABLE A2.13 Waviness Tolerances for Rectangular Plates, Universal Mill Plates, Circular Plates, and Sketch Plates

Note 1—Waviness denotes the deviation of the top or bottom surface from a horizontal line, when the plate is resting on a flat surface, as measured in an increment of less than 4000 mm of length. The waviness tolerance is a function of the flatness tolerance as obtained from Tables A 2.9 and A 2.12.

Flatness Tolerance	When Number of Waves in 4000 mm is:						
from Tables A2.9 and A2.12	1	2	3	4	5	6	7
8	8	6	5	3	3	2	2
10	10	8	5	5	3	2	2
11	11	8	6	5	3	3	2
13	13	10	8	5	5	3	2
14	14	11	8	6	5	3	2
16	16	13	10	6	5	3	2
17	17	13	10	8	5	5	2
19	19	14	11	8	6	5	2
21	21	16	11	8	6	5	2
22	22	17	13	10	6	5	2
24	24	17	13	10	8	6	5
25	25	19	14	11	8	6	5
29	29	22	16	13	10	6	5
32	32	24	17	13	10	8	6
35	35	27	19	14	11	8	6
38	38	29	22	16	13	10	6
41	41	32	24	17	13	10	8
44	44	33	25	19	14	11	8
48	48	37	27	21	14	11	8
51	51	38	29	22	16	13	10
54	54	41	30	22	17	13	10
57	57	43	32	24	17	14	10
60	60	46	33	25	19	14	11
64	64	48	37	27	21	14	11
67	67	51	38	29	21	16	11
70	70	52	40	29	22	16	13
73	73	56	41	30	24	17	13
76	76	57	43	32	24	17	14
79	79	60	44	33	25	19	14

TABLE A2.14 Visible Edge Indications Extending Approximately Parallel to Rolled Surfaces

Plate Specification and Thickness	Acceptab	le	Remove by Grinding			Acceptable on Edges Cut in Fabrication	
	Depth	Length ^A	Depth	Length ^A	Depth	Length ^A	
Column	1	2	3	4	5	6	
Other than killed, ^B to 50 mm, incl	3 mm, max	any	over 3 to 6 mm, incl	over 25 mm	6 mm max	any	
Killed, c to 150 mm, incl	2 mm, max	any	over 2 to 3 mm, incl	over 25 mm	3 mm max	any	
Killed, ^C over 150 mm	3 mm, max	any	over 3 to 13 mm, incl	over 25 mm	13 mm max	any	

^A Laminar-type discontinuities 25 mm and less in length are acceptable and do not require exploration. ^B Specifications: A285; A433; A442 in thicknesses to 25 mm, incl; or A455. ^C The specifications in 1.1 of this standard, other than those listed in the above Table Footnote *B*.

TABLE A2.15 Generally Available Grade-Thickness-Minimum Test Temperature Combinations Meeting Charpy V-Notch Requirements Indicated (Normalized or Quenched and Tempered Condition)

Note 1—The minimum temperatures listed are for longitudinal tests. For transverse tests, the available minimum temperature may be somewhat higher.

Acceptance Criteria Charpy V-Notch Energy Absorption (based on full-size specimens)			Test Temperature, °C for Plate Thicknesses (Unless Otherwise Agreed Upon)			
Minimum Average For 3 Specimens, J	Minimum For 1 Specimen, J	Specification and Grade	25 mm and Under	Over 25 mm to 50 mm, incl.	Over 50 mm to 75 mm, incl.	Over 75 mm to 125 mm, incl.
18	14	A203 Grade A	-68	-68	-60	
		A203 Grade D	-101	-101	-87	
		A516 Grade 55	-51	-51	-46	-46
		A516 Grade 60	-51	-46	-46	-46
		A516 Grade 65	-51	-46	-40	-32
		A537 Class 1 (Over 64-100 mm)			-60	-46
		A662 Grade A	-60	-60		
		A662 Grade B	– 51	– 51		
20	16	A203 Grade B	-68	-68	-60	
		A203 Grade E	-101	-101	-87	
		A203 Grade F (100 mm max)			-107	-107
		A299 Grade A	-46	-40	-40	-29
		A299 Grade B	-23	-18	-12	-6
		A516 Grade 70	-46	-40	-35	-29
		A537 Class 1 (64 mm max)	-62	-60	-60	
		A537 Class 2 (Over 64-100 mm)			-60	-46
		A662 Grade C	-46	-46		
27	20	A203 Grade F	-107	-107		
		A537 Class 2 (64 mm max)	-68	-68	-68	
		A612	-46			
		A724 Grade A, B, and C	-46			

TABLE A2.16 Permissible Variations in Width for Mill Edge Carbon Steel and High-Strength Low-Alloy Steel Plates Produced on Strip Mills

Note 1—Applies to plates produced from coil and plates produced from plate-as-rolled.

Specified Width, mm	Variations Over Specified Width, mm ^A
To 360, excl	11
360 to 430, excl	13
430 to 480, excl	14
480 to 530, excl	16
530 to 610, excl	17
610 to 660, excl	21
660 to 710, excl	24
710 to 890, excl	29
890 to 1270, excl	32
1270 to 1520, excl	38
1520 to 1650, excl	41
1650 to 1780, excl	44
1780 to 2030, excl	47
2030 and over	51

^A No permissible variation under specified width.

A3. REQUIREMENTS FOR THE INTRODUCTION OF NEW MATERIALS

- A3.1 Proposals for the introduction of new plate materials to be covered by the general requirements in this specification, either by the addition of new grades within existing specifications, or by the creation of a new specification shall be subject to the following conditions:
- A3.1.1 The application for the addition of a new grade to a specification or a new specification shall be made to the chair of the subcommittee. Applications for new specifications remain subject to the approval of Committee A01. Revisions to existing specifications for such reasons as chemistry or thickness limitation are not subject to this annex.
- A3.1.2 The application shall contain documentation citing the requisite need for the new material and its intended use as outlined in *Form and Style for ASTM Standards*, B5. Scope.³ That documentation may be in the form of a letter from a user, fabricator, another standards development organization, or producer stating the purpose and intended use for said new material. The Subcommittee may consider other evidence of need for the proposal. Additional background information as may be pertinent to the introduction of the new material may also be presented with the proposal.
- A3.1.3 The application shall be accompanied by test data as required by the applicable specification. Test data from a minimum of three test lots, as defined by the specification, each from a different heat, shall be furnished and shall include:

- A3.1.3.1 Chemical data reflecting a suitable representation of the required chemistry range requested.
- A3.1.3.2 Mechanical property data representing the proposed requirements in the delivered condition from each of the heats supplied.
- Note A3.1—To assist the balloting process, data from plates representing the maximum proposed thickness should be provided recognizing that in some cases the standard may be "limited only by the capacity of the composition to meet the specified mechanical property requirements."
- A3.1.3.3 Mechanical property data in the simulated Post-Weld Heat Treatment (PWHT) condition if the product specification lists Supplementary Requirement S3.
- A3.1.3.4 Evidence of weldability if the material is intended for welded construction as may be referenced in the Scope section of the new or existing standard.
- Note A3.2—Such evidence is at the discretion of the submitter. Common methodology may include but not be limited to a single ASME Section IX qualification such as is referenced in 9.4 of this specification.
- A3.1.4 Other properties that are not specification requirements that further describe the material, including physical properties, are not mandatory. However, to the extent that such information may assist the Subcommittee in evaluating the proposal they may be included. Omission of such non-essential documentation shall not be a cause for rejection of the application by the subcommittee.
- A3.1.5 The application shall state whether or not a patent covers the new material.

APPENDIXES

(Nonmandatory Information)

X1. COILED STEEL

X1.1 Continuous wide hot strip rolling mills are normally equipped with coilers. Regardless of the different types of systems employed during or following the rolling operations, it is common for the steel to be reeled into the coiler at temperatures in the stress-relieving range. In general, such temperatures are higher as the steel thickness increases. The coils subsequently cool to ambient temperature with outer and inner laps cooling more rapidly than central laps. The differ-

ence in cooling rate can result in measurable differences in the mechanical properties throughout a coil. Data confirm reduced yield and tensile strength, and increased percent elongation, for the product with slower cooling rates from the coiling temperature to ambient. Such differences are in addition to the effects on mechanical properties caused by differences in heat analysis and chemical segregation.

X2. VARIATION OF TENSILE PROPERTIES IN PLATE-AS-ROLLED

- X2.1 The tension requirements of this general requirements specification are intended only to characterize the tensile properties of a plate-as-rolled for determination of conformance to the requirements of the applicable product specifications. Such testing procedures are not intended to define the upper or lower limits of tensile properties at all possible test locations within a plate-as-rolled. It is well known and documented that tensile properties vary within a plate-as-rolled or individual piece of steel as a function of chemical composition, processing, testing procedure, and other factors. It is, therefore, incumbent on designers and engineers to use sound engineering judgement when using tension test results shown on mill test reports. The testing procedures of this general requirements specification have been found to provide plate adequate for normal pressure vessel design criteria.
- X2.2 A survey of the variation to be expected in tensile properties obtained from plates and structural shapes was conducted by the American Iron and Steel Institute (AISI).

- The results of this survey are contained in a *Contributions to the Metallurgy of Steel* entitled "The Variation of Product Analysis and Tensile Properties—Carbon Steel Plates, and Wide Flange Shapes" (SU/18, SU/19, and SU/20), published in September 1974. The data are presented in tables of probability that tensile properties at other than the official location may differ from those of the reported test location.
- X2.3 This general requirements specification contains no requirements applicable to product tension tests; conformance to the applicable product specification is determined on the basis of tests performed at the place of manufacture or processing prior to shipment, unless otherwise specified.
- X2.4 A Task Group of ASTM Subcommittee A01.11 has determined, based on review of the AISI data (SU20), that the variation in tensile properties within a plate-as-rolled can be expressed as a function of specified requirements; one standard deviation equals approximately 3% of required tensile strength, 5% of required yield strength, and 3 percentage points of required elongation.

X3. VARIATION IN CHARPY V-NOTCH TESTS

X3.1 A survey of the variation to be expected in Charpy V-Notch test results obtained from three common fine grain plate steels was conducted by the American Iron and Steel Institute (AISI).⁷ The results of the survey are contained in a Contributions to the Metallurgy of Steel entitled, "The Variations of Charpy V-Notch Impact Test Properties in Steel Plates," (SU/24), published January 1979. The survey data consists of test values obtained from six locations in addition to the locations specified in 12.1.3 of this specification. The plate

conditions tested involved as-rolled, normalized, and quench and tempered. Sufficient full-size specimens were taken from each sample so that three longitudinal and three transverse specimens could be broken at three test temperatures defined for each grade. The data is presented in tables of probability that impact properties at other than the official location which may differ from those of the reported test location. Additional data of the same type, but utilizing samples from thicker plates, was published by AISI as SU/27.

X4. RADIUS FOR COLD BENDING

- X4.1 Suggested minimum inside bend radii for cold forming are referenced to group Designations A through F as defined in Table X4.1. The suggested radii listed in Table X4.2 should be used as minimums in typical shop fabrication. Material that does not form satisfactorily when fabricated in accordance with Table X4.2 may be subject to rejection pending negotiation with the steel supplier. When tighter bends are required, the manufacturer should be consulted.
- X4.2 The bend radius and the radius of the male die should be as liberal as the finished part will permit. The width across the shoulders of the female die should be at least 8 times the plate thickness. Higher strength steels require larger die openings. The surface of the dies in the area of radius should be smooth.
- X4.3 Since cracks in cold bending commonly originate from the outside edges, shear burrs and gas cut edges should be removed by grinding. Sharp corners on edges and on punched or gas cut holes should be removed by chamfering or grinding to a radius.
- X4.4 If possible, parts should be formed such that the bend line is perpendicular to the direction of final rolling. If it is necessary to bend with the bend line parallel to the direction of final rolling, a more generous radius is suggested (1½ times applicable value given in Table X4.2 for bend lines perpendicular to the direction of rolling).

X4.5 References

X4.5.1 Both of these references are available from American Iron and Steel Institute (AISI):

TABLE X4.1 Group Designations for Cold Bending

Specification	Class Where Applicable	Grade Where Applicable	Group Designation ^A
A203/A203M		A, D	В
		В, Е	С
		F	D
A204/A204M		A	В
		В	С
		С	D
A225/A225M		C, D	D
A285/A285M		A, B, C	Α
A299/A299M		A, B	D
A302/A302M		A, C, D	D
		В	E
A353/A353M		_	D
A387/A387M	1, 2	2, 11, 12	C
,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	1	5, 9, 21, 21L, 22, 22L	Ē
	2	5, 9, 21, 22, 91	Ē
A455/A455M	-	0, 0, 11, 11, 01	C
A515/A515M		60 or 65	В
A313/A313W		70	C
A516/A516M		55	A
A310/A310W		60, 65	В
		70	C
A517/A517M		A, B, E, F, H, P, Q, S	F
A533/A533M	1, 2, 3	A, B, C, D, E	E
	1, 2 ^B , 3 ^B	A, B, C, D, E	C
A537/A537M	1, 2 , 3 2 ^C , 3 ^C		D
A542/A542M ^D	1, 2		F
A342/A342IVI			-
	3, 4		D
A E 40/A E 40M	4a	В С	E F
A543/A543M	1, 2, 3	B, C	
A553/A553M ^D			D
A562/A562M			A
A612/A612M			С
A645/A645M			D
A662/A662M		A, B	В
		C	С
A724/A724M		A, C	D
		В	E
A736/A736M	1, 2, 3	A, C	D
A737/A737M		B, C	В
A738/A738M		A,_B	D
		C ^B	С
		C^{C}	D
A832/A832M		21V, 22V, 23V	E
A841/A841M	1, 2	A, B, C	С
	3	D	F
A844/A844M			D
A1017/A1017M		23, 122	D
		92, 911	E

A Steels in Groups A to E inclusive are grouped on the basis of similar specified values for minimum elongation in 2 in. [50 mm]; Group F includes steels that have a specified minimum elongation in 2 in. [50 mm] of 16 or less, and steels that have a ratio of specified minimum tensile strength to specified minimum yield strength of 1.15 or less.

B For thicknesses of 4 in. [100 mm] and less.

TABLE X4.2 Suggested Minimum Inside Radii for Cold Bending^A

	Thickness (t), in. [mm]						
Group Designation ^B	Up to ¾ in. [20 mm]	Over ¾ in. [20 mm] to 1 in. [25 mm], incl		Over 2 in. [50 mm]			
Α	1.5 <i>t</i>	1.5 <i>t</i>	1.5 <i>t</i>	1.5 <i>t</i>			
В	1.5 <i>t</i>	1.5 <i>t</i>	1.5 <i>t</i>	2.0 <i>t</i>			
С	1.5 <i>t</i>	1.5 <i>t</i>	2.0 <i>t</i>	2.5t			
D	1.5 <i>t</i>	1.5 <i>t</i>	2.5 <i>t</i>	3.0 <i>t</i>			
E	1.5 <i>t</i>	1.5 <i>t</i>	3.0 <i>t</i>	3.5 <i>t</i>			
F	1.75 <i>t</i>	2.25t	4.5 <i>t</i>	5.5 <i>t</i>			

A Values are for bend lines perpendicular to the direction of final rolling. These radii apply when the precautions listed in X4.2 are followed. If bend lines are parallel to

Holt, G. E., et al. "Minimum Cold Bend Radii Project - Final Report," Concurrent Technologies Corporation, January 27, 1997.

Brockenbrough, R. L., "Fabrication Guidelines for Cold Bending," R. L. Brockenbrough & Associates, June 28, 1998.

^C For thicknesses over 4 in. [100 mm]. ^D For any type.

the direction of final rolling, multiply values by 1.5. $^{\it B}$ Steels specifications included in the group designations may not include the entire thickness range shown in this table.

SPECIFICATION FOR GENERAL REQUIREMENTS FOR STEEL BARS, CARBON AND ALLOY, HOT-WROUGHT



SA-29/SA-29M



(23)

(Identical with ASTM Specification A29/A29M-20.)

Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought

1. Scope

1.1 This specification covers a group of common requirements which, unless otherwise specified in the purchase order or in an individual specification, shall apply to carbon and alloy steel bars under each of the following ASTM specifications (or under any other ASTM specification which invokes this specification or portions thereof):

Title of Specification Hot-Rolled Carbon Steel Bars: Steel Bars, Carbon, Quenched and Tempered Steel Bars and Shapes, Carbon Rolled from "T" Rails Steel Bars, Carbon, Merchant Quality, M-Grades Steel Bars, Carbon, Merchant Quality, M-Grades Steel Bars, Carbon, Hot-Wrought, Special Quality Steel Bars, Carbon, Merchant Quality, Mechanical Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars for Springs, Carbon and Alloy Cold-Finished Carbon Steel Bars: Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	-F	
Hot-Rolled Carbon Steel Bars: Steel Bars, Carbon, Quenched and Tempered Steel Bars and Shapes, Carbon Rolled from "T" Rails Steel Bars, Carbon, Merchant Quality, M-Grades Steel Bars, Carbon, Hot-Wrought, Special Quality A576 Steel Bars, Carbon, Merchant Quality, Mechanical Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars for Springs, Carbon and Alloy Cold-Finished Carbon Steel Bars: Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	Title of Specification	
Steel Bars, Carbon, Quenched and Tempered Steel Bars and Shapes, Carbon Rolled from "T" Rails Steel Bars, Carbon, Merchant Quality, M-Grades Steel Bars, Carbon, Hot-Wrought, Special Quality Steel Bars, Carbon, Merchant Quality, Mechanical Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars for Springs, Carbon and Alloy Cold-Finished Carbon Steel Bars: Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M A434/A434M	Hot Pollad Carbon Stool Parce	Designation
Steel Bars and Shapes, Carbon Rolled from "T" Rails Steel Bars, Carbon, Merchant Quality, M-Grades Steel Bars, Carbon, Hot-Wrought, Special Quality Steel Bars, Carbon, Merchant Quality, Mechanical Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars for Springs, Carbon and Alloy Cold-Finished Carbon Steel Bars: Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M		A 221
Steel Bars, Carbon, Merchant Quality, M-Grades Steel Bars, Carbon, Hot-Wrought, Special Quality Steel Bars, Carbon, Merchant Quality, Mechanical Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars for Springs, Carbon and Alloy Cold-Finished Carbon Steel Bars: Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M		
Steel Bars, Carbon, Hot-Wrought, Special Quality Steel Bars, Carbon, Merchant Quality, Mechanical Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars for Springs, Carbon and Alloy Cold-Finished Carbon Steel Bars: Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M		
Steel Bars, Carbon, Merchant Quality, Mechanical Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars for Springs, Carbon and Alloy Cold-Finished Carbon Steel Bars: Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M		
Properties Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties Steel Bars for Springs, Carbon and Alloy Cold-Finished Carbon Steel Bars: Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M		
chanical Properties Steel Bars for Springs, Carbon and Alloy Cold-Finished Carbon Steel Bars: Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M		A663/A663M
Steel Bars for Springs, Carbon and Alloy Cold-Finished Carbon Steel Bars: Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M		A675/A675M
Cold-Finished Carbon Steel Bars: Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M		
Steel Bars, Carbon and Alloy, Cold-Finished Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M		A689
Cold-Drawn Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	Cold-Finished Carbon Steel Bars:	
ject to Mechanical Property Requirements Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	Steel Bars, Carbon and Alloy, Cold-Finished	A108
Hot-Rolled Alloy Steel Bars: Steel Bars, Alloy, Standard Grades Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	Cold-Drawn Stress-Relieved Carbon Steel Bars Sub-	A311/A311M
Steel Bars, Alloy, Standard Grades A322 Carbon and Alloy Steel Bars Subject to End-Quench A304 Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	ject to Mechanical Property Requirements	
Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	Hot-Rolled Alloy Steel Bars:	
Hardenability Requirements Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	Steel Bars, Alloy, Standard Grades	A322
Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	Carbon and Alloy Steel Bars Subject to End-Quench	A304
Quenched and Tempered Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	Hardenability Requirements	
Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both *Cold-Finished Alloy Steel Bars:* Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	Steel Bars, Alloy, Hot-Wrought or Cold-Finished,	A434/A434M
ture or Pressure-Containing Parts, or Both Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	Quenched and Tempered	
Cold-Finished Alloy Steel Bars: Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	Steel Bars, Alloy, Hot-Wrought, for Elevated Tempera-	A739
Steel Bars, Alloy, Hot-Rolled or Cold-Finished, A434/A434M	ture or Pressure-Containing Parts, or Both	
	Cold-Finished Alloy Steel Bars:	
	Steel Bars, Allov, Hot-Rolled or Cold-Finished.	A434/A434M
Quenched and Tempered	Quenched and Tempered	
Steel Bars, Carbon, Hot-Wrought or Cold-Finished, A696		A696
Special Quality, for Pressure Piping Components		

^A These designations refer to the latest issue of the respective specifications, which appear either in the *Annual Book of ASTM Standards*, Vol 01.05, or as reprints obtainable from ASTM.

- 1.2 In case of any conflict in requirements, the requirements of the purchase order, the individual material specification, and this general specification shall prevail in the sequence named.
- 1.3 The values stated in either inch-pound units or SI units are to be regarded separately as standard. The values stated in each system are not necessarily exact equivalents; therefore, to ensure conformance with the standard, each system shall used independently of the other, and values from the two systems shall not be combined.
- 1.4 For purposes of determining conformance to this specification and the various material specifications referenced in 1.1, dimensional values shall be rounded to the nearest unit in the right-hand place of figures used in expressing the limiting values in accordance with the rounding method of Practice E29.

Note 1—Specification A29/A29M previously listed dimensional tolerances for cold-finished bars; these are now found in Specification A108.

- 1.5 This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.
- 1.6 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A108 Specification for Steel Bar, Carbon and Alloy, Cold-Finished

A304 Specification for Carbon and Alloy Steel Bars Subject to End-Quench Hardenability Requirements

- A311/A311M Specification for Cold-Drawn, Stress-Relieved Carbon Steel Bars Subject to Mechanical Property Requirements
- A321 Specification for Steel Bars, Carbon, Quenched and Tempered (Withdrawn 2007)
- A322 Specification for Steel Bars, Alloy, Standard Grades A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A434/A434M Specification for Steel Bars, Alloy, Hot-Wrought or Cold-Finished, Quenched and Tempered
- A499 Specification for Steel Bars and Shapes, Carbon Rolled from "T" Rails
- A575 Specification for Steel Bars, Carbon, Merchant Quality, M-Grades
- A576 Specification for Steel Bars, Carbon, Hot-Wrought, Special Quality
- A663/A663M Specification for Steel Bars, Carbon, Merchant Quality, Mechanical Properties
- A675/A675M Specification for Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties
- A689 Specification for Carbon and Alloy Steel Bars for Springs
- A696 Specification for Steel Bars, Carbon, Hot-Wrought or Cold-Finished, Special Quality, for Pressure Piping Components
- A700 Guide for Packaging, Marking, and Loading Methods for Steel Products for Shipment
- A739 Specification for Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both
- A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- E29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications
- E112 Test Methods for Determining Average Grain Size 2.2 ASME Code:
- ASME Boiler and Pressure Vessel Code
- 2.3 Federal Standards:
- Fed. Std. No. 123 Marking for Shipment (Civil Agencies)Fed. Std. No. 183 Continuous Identification Marking of Iron and Steel Products
- 2.4 Military Standard:
- MIL-STD-163 Steel Mill Products—Preparation for Shipment and Storage
- 2.5 Other Standards:
- AIAG B-1 Bar Code Symbology Standard for 3-of-9 Bar Codes

AIAG B-5 02.00 Primary Metals Tag Application Standard

3. Terminology

- 3.1 Definitions of Terms Specific to This Standard:
- 3.1.1 cold-finished steel bars—steel bars produced by cold finishing previously hot-wrought bars by means of cold drawing, cold forming, turning, grinding, or polishing (singly or in combination) to yield straight lengths or coils in sections that are uniform throughout their length and in the following sections and sizes:
 - 3.1.1.1 rounds—9 in. [230 mm] and under in diameter,
- 3.1.1.2 *squares*—6 in. [150 mm] and under between parallel surfaces.
- 3.1.1.3 hexagons—4 in. [100 mm] and under between parallel surfaces,
- 3.1.1.4 flats— $\frac{1}{8}$ in. [3 mm] and over in thickness and not over 12 in. [300 mm] in width, and
 - 3.1.1.5 special bar sections.
- 3.1.2 hot-wrought steel bars—steel bars produced by hot forming ingots, blooms, billets, or other semifinished forms to yield straight lengths (or coils, depending upon size, section, and mill equipment) in sections that are uniform throughout their length, and in the following sections and sizes:
- 3.1.2.1 rounds— $\frac{7}{32}$ in. to 10.0 in. [5.5 mm to 250 mm], inclusive;
- 3.1.2.2 squares— $\frac{7}{32}$ in. to 6.0 in. [6 mm to 160 mm], inclusive;
- 3.1.2.3 *round-cornered squares*—7/32 in. to 8.0 in. [6 mm to 200 mm], inclusive;
- 3.1.2.4 *flats*—1/4 in. to 8 in. inclusive, in width: ¹³/₆₄ in. in minimum thickness up to 6 in. in width; and 0.230 in. in minimum thickness for over 6 in. to 8 in. in width, inclusive [over 5 mm in thickness up to 150 mm in width; and over 6 mm in thickness for over 150 mm through 200 mm in width]. Maximum thickness for all widths is 4 in. [100 mm];
- 3.1.2.5 hexagons and octagons—1/4 in. to 41/16 in. [6 mm to 103 mm], inclusive, between parallel surfaces;
- 3.1.2.6 bar size shapes—Angles, channels, tees, zees, when their greatest cross-sectional dimension is under 3 in. [75 mm]; and
- 3.1.2.7 *special bar sections*—Half-rounds, ovals, half-ovals, other special bar size sections.
- 3.1.3 *lot*—unless otherwise specified in the contract or order, a lot shall consist of all bars submitted for inspection at the same time of the same heat, condition, finish, size, or shape. For bars specified in the quenched and tempered condition, when heat treated in batch-type furnaces, a lot shall consist of all bars from the same heat, of the same prior condition, the same size, and subjected to the same heat treatment in one tempering charge. For bars specified in the quenched and tempered condition, when heat treated without interruption in a continuous-type furnace, a lot shall consist of all bars from the same heat, of the same prior condition, of the same size, and subjected to the same heat treatment.

4. Chemical Composition

- 4.1 Limits:
- 4.1.1 The chemical composition shall conform to the requirements specified in the purchase order or the individual product specifications. For convenience, the grades commonly specified for carbon steel bars are shown in Table 1 and for alloy steel bars in Table 2. Bars may be ordered to these grade designations and when so ordered shall conform to the specified limits by heat analysis.
- 4.1.2 When compositions other than those shown in Tables 1 and 2 are required, the composition limits shall be prepared using the ranges and limits shown in Table 3 for carbon steel and Table 4 for alloy steel.
 - 4.2 Heat or Cast Analysis:
- 4.2.1 The chemical composition of each heat or cast shall be determined by the manufacturer in accordance with Test Methods, Practices, and Terminology A751.
- 4.2.2 The heat or cast analysis shall conform to the requirements specified in the product specification or purchase order. These can be the heat chemical range and limit for a grade designated in Tables 1 and 2, or another range and limit in accordance with 4.1.2, or with requirements of the product specification.
- Note 2—Heat analysis for lead is not determinable since lead is added to the ladle stream while each ingot is poured. When specified as an added element to a standard steel, the percentage of lead is reported as 0.15 to 0.35 incl, which is the range commonly specified for this element.
- 4.2.3 If requested or required, the heat analysis shall be reported to the purchaser or his representative.
- 4.2.4 Reporting of significant figures and rounding shall be in accordance with Test Methods, Practices, and Terminology A751.
 - 4.3 Product Analysis:
- 4.3.1 Merchant quality carbon bar steel is not subject to rejection for product analysis unless misapplication of a heat is clearly indicated.
- 4.3.2 Analyses may be made by the purchaser from finished bars other than merchant quality representing each heat of open-hearth, basic-oxygen, or electric-furnace steel. The chemical composition thus determined shall not vary from the limits specified in the applicable specification by more than the amounts prescribed in Table 5 and Table 6, but the several determinations of any element, excluding lead, in a heat may not vary both above and below the specified range. Rimmed or capped steel is characterized by a lack of homogeneity in its composition, especially for the elements carbon, phosphorus, and sulfur; therefore, when rimmed or capped steel is specified or required, the limitations for these elements shall not be applicable. Because of the degree to which phosphorus and sulfur segregate, the limitations for these elements shall not be applicable to rephosphorized or resulfurized steels.
- 4.3.3 Samples for product analysis shall be taken by one of the following methods:
- 4.3.3.1 Applicable to small sections whose cross-sectional area does not exceed 0.75 in.² [500 mm²] such as rounds,

- squares, hexagons, and the like. Chips are taken by milling or machining the full cross section of the piece. Drilling is not a feasible method for sampling sizes 0.75 in.² and smaller.
- 4.3.3.2 Applicable to products where the width of the cross section greatly exceeds the thickness, such as bar size shapes and light flat bars. Chips are taken by drilling entirely through the steel at a point midway between the edge and the middle of the section, or by milling or machining the entire cross section.
- 4.3.3.3 Applicable to large rounds, squares semifinished, etc. Chips are taken at any point midway between the outside and the center of the piece by drilling parallel to the axis or by milling or machining the full cross section. In cases where these methods are not practicable, the piece may be drilled on the side, but chips are not taken until they represent the portion midway between the outside and the center.
- 4.3.3.4 When the steel is subject to tension test requirements, the tension test specimen can also be used for product analysis. In that case, chips for product analysis can be taken by drilling entirely through the tension test specimens or by the method described in 4.3.3.1.
- 4.3.4 When chips are taken by drilling, the diameter of the drill used shall conform to the following:

Area of Sample Cross Section,	Approximate Drill Diameter,
in.2 [cm2]	in. [mm]
16 [100] or less	1/2 [12.5]
Over 16 [100]	1 [25.0]

4.3.5 The minimum number of samples to be taken from material representing the same heat or lot before rejection by the purchaser shall be as follows:

Minimum Number
of Samples
15 tons [15 Mg] and under 4
Over 15 tons [15 Mg] 6

- 4.3.6 In case the number of pieces in a heat is less than the number of samples required, one sample from each piece shall be considered sufficient.
- 4.3.7 In the event that product analysis determinations are outside the permissible limits as prescribed in 4.3.2, additional samples shall be analyzed and the acceptability of the heat negotiated between the purchaser and the producer.
- 4.4 Referee Analysis—In case a referee analysis is required and agreed upon to resolve a dispute concerning the results of a chemical analysis, the referee analysis shall be performed in accordance with the latest issue of Test Methods, Practices, and Terminology A751, unless otherwise agreed upon between the manufacturer and the purchaser.

5. Grain Size Requirement

- 5.1 Austenitic Grain Size—All requirements for austenitic grain size control in Section 5 refer to the size of the austenite grain which forms during a subsequent bar reheating operation at or above the recrystallization temperature. These requirements do not apply to, nor do they in any way control, the prior austenite grain size or the ferrite grain size of the bar in the as-rolled condition.
- 5.1.1 When a coarse austenitic grain size is specified, the steel shall have a grain size number of 1 to 5 exclusive as

TABLE 1 Grade Designations and Chemical Compositions of Carbon Steel Bars

Grade Designation		Heat Chemica	Il Ranges and Limits, %	
Grado Booignation	Carbon	Manganese	Phosphorus, max	Sulfur, max ^A
	Nonre	sulfurized Carbon Steels ^{B,}	C, D, E, F	
1005	0.06 max	0.35 max	0.040	0.050
1006	0.08 max	0.25-0.40	0.040	0.050
1008	0.10 max	0.30-0.50	0.040	0.050
1010	0.08-0.13	0.30-0.60	0.040	0.050
1011	0.08-0.13	0.60-0.90	0.040	0.050
1012	0.10-0.15	0.30-0.60	0.040	0.050
1013	0.11-0.16	0.50-0.80	0.040	0.050
1015	0.13–0.18	0.30-0.60	0.040	0.050
1016	0.13-0.18	0.60-0.90	0.040	0.050
1017	0.15-0.20	0.30-0.60	0.040	0.050
1018	0.15-0.20	0.60-0.90	0.040	0.050
1019	0.15-0.20	0.70-1.00	0.040	0.050
1020	0.18-0.23	0.30-0.60	0.040	0.050
1021	0.18-0.23	0.60-0.90	0.040	0.050
1022	0.18-0.23	0.70-1.00	0.040	0.050
1023	0.20-0.25	0.30-0.60	0.040	0.050
1025	0.22-0.28	0.30-0.60	0.040	0.050
1026	0.22-0.28	0.60-0.90	0.040	0.050
1029	0.25-0.31	0.60-0.90	0.040	0.050
1030	0.28-0.34	0.60-0.90	0.040	0.050
1034	0.32-0.38	0.50-0.80	0.040	0.050
1035	0.32-0.38	0.60-0.90	0.040	0.050
1037	0.32-0.38	0.70-1.00	0.040	0.050
1038	0.35-0.42	0.60-0.90	0.040	0.050
1039	0.37-0.44	0.70-1.00	0.040	0.050
1040	0.37–0.44	0.60-0.90	0.040	0.050
1042	0.40–0.47	0.60-0.90	0.040	0.050
1042			0.040	
	0.40-0.47	0.70–1.00		0.050
1044	0.43-0.50	0.30-0.60	0.040	0.050
1045	0.43-0.50	0.60-0.90	0.040	0.050
1046	0.43-0.50	0.70-1.00	0.040	0.050
1049	0.46-0.53	0.60-0.90	0.040	0.050
1050	0.48-0.55	0.60-0.90	0.040	0.050
1053	0.48-0.55	0.70-1.00	0.040	0.050
1055	0.50-0.60	0.60-0.90	0.040	0.050
1059	0.55-0.65	0.50-0.80	0.040	0.050
1060	0.55-0.65	0.60-0.90	0.040	0.050
1064	0.60-0.70	0.50-0.80	0.040	0.050
1065	0.60-0.70		0.040	0.050
		0.60-0.90		
1069	0.65–0.75	0.40-0.70	0.040	0.050
1070	0.65-0.75	0.60-0.90	0.040	0.050
1071	0.65-0.70	0.75–1.05	0.040	0.050
1074	0.70-0.80	0.50-0.80	0.040	0.050
1075	0.70-0.80	0.40-0.70	0.040	0.050
1078	0.72-0.85	0.30-0.60	0.040	0.050
1080	0.75–0.88	0.60-0.90	0.040	0.050
1084	0.80-0.93	0.60-0.90	0.040	0.050
1086	0.80-0.93	0.30-0.50	0.040	0.050
1090	0.85-0.98	0.60-0.90	0.040	0.050
1095	0.90-1.03	0.30-0.50	0.040	0.050
4400		esulfurized Carbon Steels		
1108	0.08-0.13	0.60-0.80	0.040	0.08-0.13
1109	0.08-0.13	0.60-0.90	0.040	0.08-0.13
1110	0.08-0.13	0.30-0.60	0.040	0.08-0.13
1116	0.14-0.20	1.10-1.40	0.040	0.16-0.23
1117	0.14-0.20	1.00-1.30	0.040	0.08-0.13
1118	0.14–0.20	1.30–1.60	0.040	0.08-0.13
1119	0.14-0.20	1.00-1.30	0.040	0.24-0.33
1132	0.27-0.34	1.35–1.65	0.040	0.08-0.13
1137	0.32-0.39	1.35–1.65	0.040	0.08-0.13
1139	0.35-0.43	1.35–1.65	0.040	0.13-0.20
1140	0.37-0.44	0.70-1.00	0.040	0.08-0.13
1141	0.37-0.45	1.35-1.65	0.040	0.08-0.13
1144	0.40-0.48	1.35-1.65	0.040	0.24-0.33
1145	0.42-0.49	0.70-1.00	0.040	0.04-0.07
1146	0.42–0.49	0.70-1.00	0.040	0.08-0.13
1151	0.48-0.55	0.70-1.00	0.040	0.08-0.13
1101		rized and Resulfurized Ca		0.00 0.10
Grade Designation		Manganese	Phosphorous	Sulfur Lead
			<u> </u>	0.10.0.15
	0.13 max	0.60-0.90	0.07-0.12	0.10-0.15
1211 1212	0.13 max	0.70-1.00	0.07-0.12	0.16–0.23

TABLE 1 Continued

	Перпоэрпо	rized and Resulfurized Ca	albori diccis		
Grade Designation	Carbon	Manganese	Phosphorous	Sulfur	Lead
1213	0.13 max	0.70-1.00	0.07-0.12	0.24-0.33	
1215	0.09 max	0.75-1.05	0.04-0.09	0.26-0.35	
12L13	0.13 max	0.70-1.00	0.07-0.12	0.24-0.33	0.15-0.3
12L14	0.15 max	0.85-1.15	0.04-0.09	0.26-0.35	0.15-0.3
12L15	0.09 max	0.75-1.05	0.04-0.09	0.26-0.35	0.15-0.3

		i iigii-ivid	inganese Carbon Steels		
Grade Designation	Former Designation	Carbon	Manganese	Phosphorous, max	Sulfur, max
1513		0.10-0.16	1.10–1.40	0.040	0.050
1518		0.15-0.21	1.10-1.40	0.040	0.050
1522		0.18-0.24	1.10-1.40	0.040	0.050
1524	1024	0.19-0.25	1.35-1.65	0.040	0.050
1525		0.23-0.29	0.80-1.10	0.040	0.050
1526		0.22-0.29	1.10-1.40	0.040	0.050
1527	1027	0.22-0.29	1.20-1.50	0.040	0.050
1536	1036	0.30-0.37	1.20-1.50	0.040	0.050
1541	1041	0.36-0.44	1.35-1.65	0.040	0.050
1547		0.43-0.51	1.35-1.65	0.040	0.050
1548	1048	0.44-0.52	1.10-1.40	0.040	0.050
1551	1051	0.45-0.56	0.85-1.15	0.040	0.050
1552	1052	0.47-0.55	1.20-1.50	0.040	0.050
1561	1061	0.55-0.65	0.75-1.05	0.040	0.050
1566	1066	0.60-0.71	0.85-1.15	0.040	0.050
1572	1072	0.65-0.76	1.00-1.30	0.040	0.050

Heat Chemical Ranges and Limits, percent

		· ·	7 I				
Grade Designation	Merchant Quality M Series Carbon Steel Bars						
	Carbon	Manganese ^G	Phosphorous, max	Sulfur, max			
M 1008	0.10 max	0.25-0.60	0.04	0.05			
M 1010	0.07-0.14	0.25-0.60	0.04	0.05			
M 1012	0.09-0.16	0.25-0.60	0.04	0.05			
M 1015	0.12-0.19	0.25-0.60	0.04	0.05			
M 1017	0.14-0.21	0.25-0.60	0.04	0.05			
M 1020	0.17-0.24	0.25-0.60	0.04	0.05			
M 1023	0.19-0.27	0.25-0.60	0.04	0.05			
M 1025	0.20-0.30	0.25-0.60	0.04	0.05			
M 1031	0.26-0.36	0.25-0.60	0.04	0.05			
M 1044	0.40-0.50	0.25-0.60	0.04	0.05			

^A Maximum unless otherwise indicated.

determined in accordance with Test Methods E112. Conformance to this grain size of 70 % of the grains in the area examined shall constitute the basis of acceptance. One test per heat shall be made.

5.1.2 When a fine austenitic grain size is specified, the steel shall have a grain size number of 5 or higher as determined in accordance with Test Methods E112. Conformance to this grain size of 70 % of the area examined shall constitute the basis of acceptance. One test per heat shall be made unless the provisions of 5.1.2.1 or 5.1.2.2 are exercised.

5.1.2.1 When aluminum is used as the grain refining element, the fine austenitic grain size requirement shall be deemed to be fulfilled if, on heat analysis, the aluminum content is not less than 0.020 % total aluminum or, alternately, 0.015 % acid soluble aluminum. The aluminum content shall be reported. The grain size test specified in 5.1.2 shall be the referee test.

5.1.2.2 By agreement between purchaser and supplier, columbium or vanadium, or both, may be used for grain refining instead of or with aluminum. When columbium or vanadium is used as a grain refining element, the fine austenitic grain size requirement shall be deemed to be fulfilled if, on heat analysis, the columbium or vanadium content is as follows (the content of the elements shall be reported with the heat analysis):

B When silicon is required, the following ranges and limits are commonly specified: 0.10 %, max, 0.10 % to 0.20 %, 0.15 % to 0.35 %, 0.20 % to 0.40 %, or 0.30 % to 0.60 %

^C Copper can be specified when required as 0.20 % minimum.

D When lead is required as an added element to a standard steel, a range of 0.15 to 0.35 % inclusive is specified. Such a steel is identified by inserting the letter "L" between the second and third numerals of the grade designation, for example, 10 L 45. A cast or heat analysis is not determinable when lead is added to the ladle stream.

EWhen boron treatment for killed steels is specified, the steels can be expected to contain 0.0005 to 0.003 % boron. If the usual titanium additive is not permitted, the steels can be expected to contain up to 0.005 % boron.

F The elements bismuth, calcium, selenium, or tellurium may be added as agreed upon between purchaser and supplier.

^G Unless prohibited by the purchaser, the manganese content may exceed 0.60 % on heat analysis to a maximum of 0.75 %, provided the carbon range on heat analysis has the minimum and maximum reduced by 0.01 % for each 0.05 % manganese over 0.60 %.

TABLE 2 Grade Designations and Chemical Compositions of Alloy Steel Bars

Note 1—Small quantities of certain elements are present in alloy steels, which are not specified or required. These elements are considered as incidental and may be present to the following maximum amounts: copper, 0.35%; nickel, 0.25%; chromium, 0.20% and molybdenum, 0.06%.

Note 2—Where minimum and maximum sulfur content is shown it is indicative of resulfurized steel.

Note 3—The chemical ranges and limits shown in Table 2 are produced to product analysis tolerances shown in Table 6.

Note 4—Standard alloy steels can be produced with a lead range of 0.15 to 0.35 %. Such steels are identified by inserting the letter "L" between the second and third numerals of the AISI number, for example, 41 L 40. A cast or heat analysis is not determinable when lead is added to the ladle stream.

Grade -			Phosphorus,	Sulfur,					
Designation	Carbon	Manganese	max	max	Silicon ^A	Nickel	Chromium	Molybdenum	Vanadium
1330	0.28-0.33	1.60-1.90	0.035	0.040	0.15-0.35				
1335	0.33-0.38	1.60-1.90	0.035	0.040	0.15-0.35				
1340	0.38-0.43	1.60-1.90	0.035	0.040	0.15-0.35				
1345	0.43-0.48	1.60-1.90	0.035	0.040	0.15-0.35				
4040	0.00.044	0.75 4.00	0.005	0.040	0.45, 0.05			0.45.0.05	
4012 4023	0.09-0.14 0.20-0.25	0.75-1.00 0.70-0.90	0.035 0.035	0.040 0.040	0.15-0.35 0.15-0.35			0.15-0.25 0.20-0.30	
						•••	•••		
4024	0.20-0.25	0.70-0.90	0.035	0.035-0.050	0.15-0.35	•••		0.20-0.30	
4027	0.25-0.30	0.70-0.90	0.035	0.040	0.15-0.35	•••	•••	0.20-0.30	
4028	0.25-0.30	0.70-0.90	0.035	0.035-0.050	0.15-0.35	•••		0.20-0.30	
4032	0.30-0.35	0.70-0.90	0.035	0.040	0.15-0.35			0.20-0.30	
4037	0.35-0.40	0.70-0.90	0.035	0.040	0.15-0.35			0.20-0.30	
4042	0.40-0.45	0.70-0.90	0.035	0.040	0.15-0.35			0.20-0.30	
4047	0.45-0.50	0.70-0.90	0.035	0.040	0.15–0.35	•••		0.20-0.30	
4118	0.18-0.23	0.70-0.90	0.035	0.040	0.15-0.35		0.40-0.60	0.08-0.15	
4120	0.18-0.23	0.90-1.20	0.035	0.040	0.15-0.35		0.40-0.60	0.13-0.20	
4121	0.18-0.23	0.75-1.00	0.035	0.040	0.15-0.35		0.45-0.65	0.20-0.30	
4130	0.28-0.33	0.40-0.60	0.035	0.040	0.15-0.35		0.80-1.10	0.15-0.25	
4135	0.33-0.38	0.70-0.90	0.035	0.040	0.15-0.35		0.80-1.10	0.15-0.25	
4137	0.35-0.40	0.70-0.90	0.035	0.040	0.15-0.35		0.80-1.10	0.15-0.25	
4140	0.38-0.43	0.75-1.00	0.035	0.040	0.15-0.35		0.80-1.10	0.15-0.25	
4142	0.40-0.45	0.75-1.00	0.035	0.040	0.15-0.35	•••		0.15-0.25	
						•••	0.80-1.10		
4145	0.43-0.48	0.75-1.00	0.035	0.040	0.15-0.35		0.80-1.10	0.15-0.25	
4147	0.45-0.50	0.75–1.00	0.035	0.040	0.15-0.35		0.80-1.10	0.15-0.25	
4150	0.48-0.53	0.75-1.00	0.035	0.040	0.15-0.35		0.80-1.10	0.15-0.25	
4161	0.56–0.64	0.75–1.00	0.035	0.040	0.15-0.35		0.70-0.90	0.25-0.35	
4320	0.17-0.22	0.45-0.65	0.035	0.040	0.15-0.35	1.65-2.00	0.40-0.60	0.20-0.30	
4340	0.38-0.43	0.60-0.80	0.035	0.040	0.15-0.35	1.65-2.00	0.70-0.90	0.20-0.30	
E4340	0.38-0.43	0.65-0.85	0.025	0.025	0.15-0.35	1.65-2.00	0.70-0.90	0.20-0.30	
4419	0.18-0.23	0.45-0.65	0.035	0.040	0.15-0.35			0.45-0.60	
4422	0.20-0.25	0.70-0.90	0.035	0.040	0.15-0.35	•••		0.35-0.45	
4427	0.24-0.29	0.70-0.90	0.035	0.040	0.15-0.35	•••		0.35-0.45	
4421	0.24-0.29	0.70-0.90	0.033	0.040	0.15-0.33			0.35-0.45	
4615	0.13-0.18	0.45-0.65	0.035	0.040	0.15-0.35	1.65-2.00		0.20-0.30	
4620	0.17-0.22	0.45-0.65	0.035	0.040	0.15-0.35	1.65-2.00		0.20-0.30	
4621	0.18-0.23	0.70-0.90	0.035	0.040	0.15-0.35	1.65-2.00		0.20-0.30	
4626	0.24-0.29	0.45-0.65	0.035	0.040	0.15-0.35	0.70-1.00		0.15-0.25	
4715	0.13-0.18	0.70-0.90	0.035	0.040	0.15-0.35	0.70-1.00	0.45-0.65	0.45-0.60	
4718 4720	0.16-0.21	0.70-0.90	0.035	0.040	0.15-0.35 0.15-0.35	0.90-1.20	0.35-0.55 0.35-0.55	0.30-0.40 0.15-0.25	
4720	0.17–0.22	0.50-0.70	0.035	0.040	0.15-0.35	0.90–1.20	0.35-0.55	0.15-0.25	
4815	0.13-0.18	0.40-0.60	0.035	0.040	0.15-0.35	3.25-3.75		0.20-0.30	
4817	0.15-0.20	0.40-0.60	0.035	0.040	0.15-0.35	3.25-3.75		0.20-0.30	
4820	0.18-0.23	0.50-0.70	0.035	0.040	0.15-0.35	3.25-3.75		0.20-0.30	
5015	0.12-0.17	0.30-0.50	0.035	0.040	0.15-0.35		0.30-0.50		
5046	0.43-0.48	0.75-1.00	0.035	0.040	0.15-0.35		0.20-0.35		
5115	0.13-0.18	0.70-0.90	0.035	0.040	0.15-0.35		0.70-0.90		
5115	0.13-0.18	0.70-0.90	0.035	0.040	0.15-0.35		0.70-0.90		
5130	0.28-0.33	0.70-0.90	0.035	0.040	0.15-0.35	•••	0.80–1.10		
5132	0.30-0.35	0.60-0.80	0.035	0.040	0.15-0.35		0.75–1.00		
5135	0.33-0.38	0.60-0.80	0.035	0.040	0.15-0.35		0.80-1.05		
5140	0.38-0.43	0.70-0.90	0.035	0.040	0.15-0.35	•••	0.70-0.90	•••	•••
5145	0.43-0.48	0.70-0.90	0.035	0.040	0.15-0.35		0.70-0.90		
5147	0.46-0.51	0.70-0.95	0.035	0.040	0.15-0.35		0.85-1.15		
5150	0.48-0.53	0.70-0.90	0.035	0.040	0.15-0.35		0.70-0.90		
5155	0.51-0.59	0.70-0.90	0.035	0.040	0.15-0.35		0.70-0.90		
5160	0.56-0.64	0.75-1.00	0.035	0.040	0.15-0.35		0.70-0.90		

TABLE 2 Continued

Grade Heat Chemical Ranges and Limits, %									
Designation	Carbon	Manganese	Phosphorus, max	Sulfur, max	Silicon ^A	Nickel	Chromium	Molybdenum	Vanadium
E50100	0.98–1.10	0.25-0.45	0.025	0.025	0.15-0.35		0.40-0.60		
E51100	0.98-1.10	0.25-0.45	0.025	0.025	0.15-0.35		0.90-1.15		
E52100	0.98-1.10	0.25-0.45	0.025	0.025	0.15-0.35		1.30-1.60		
52100 ^B	0.93-1.05	0.25-0.45	0.025	0.015	0.15-0.35		1.35-1.60		
6118	0.16-0.21	0.50-0.70	0.035	0.040	0.15-0.35		0.50-0.70		0.10-0.15
6150	0.48-0.53	0.70-0.90	0.035	0.040	0.15-0.35		0.80-1.10		0.15 min
8115	0.13-0.18	0.70-0.90	0.035	0.040	0.15-0.35	0.20-0.40	0.30-0.50	0.08-0.15	
8615	0.13-0.18	0.70-0.90	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8617	0.15-0.20	0.70-0.90	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8620	0.18-0.23	0.70-0.90	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8622	0.20-0.25	0.70-0.90	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8625	0.23-0.28	0.70-0.90	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8627	0.25-0.20	0.70-0.90	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8630	0.28-0.33	0.70-0.90	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	•••
8637	0.35-0.40	0.75-1.00	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8640	0.38-0.43	0.75-1.00	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8642	0.40-0.45	0.75-1.00	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8645	0.43 - 0.48	0.75-1.00	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8650	0.48-0.53	0.75-1.00	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8655	0.51-0.59	0.75-1.00	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	
8660	0.56-0.64	0.75-1.00	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.15-0.25	•••
8720	0.18-0.23	0.70-0.90	0.035	0.040	0.15-0.35	0.40-0.7	0.40-0.60	0.20-0.30	
8740	0.38-0.43	0.75-1.00	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.20-0.30	
8822	0.20-0.25	0.75-1.00	0.035	0.040	0.15-0.35	0.40-0.70	0.40-0.60	0.30-0.40	
9254	0.51-0.59	0.60-0.80	0.035	0.040	1.20-1.60		0.60-0.80		
9255	0.51-0.59	0.70-0.95	0.035	0.040	1.80-2.20		0.00 0.00		•••
9259	0.56-0.64	0.75-1.00	0.035	0.040	0.70-1.10		0.45-0.65		•••
9260	0.56-0.64	0.75-1.00	0.035	0.040	1.80–2.20				
E9310	0.08-0.13	0.45-0.65	0.025	0.025	0.15-0.30	3.00-3.50	1.00-1.40	0.08-0.15	
				tandard Boror					
50B44	0.43-0.48	0.75-1.00	0.035	0.040	0.15-0.35		0.20-0.60		
50B46	0.44-0.49	0.75-1.00	0.035	0.040	0.15-0.35		0.20-0.35		
50B50	0.48-0.53	0.75-1.00	0.035	0.040	0.15-0.35		0.40-0.60		
50B60	0.56-0.64	0.75–1.00	0.035	0.040	0.15–0.35		0.40-0.60		
51B60	0.56-0.64	0.75-1.00	0.035	0.040	0.15-0.35		0.70-0.90		
81B45	0.43-0.48	0.75-1.00	0.035	0.040	0.15-0.35	0.20-0.40	0.35-0.55	0.08-0.15	
94B17	0.15-0.20	0.75-1.00	0.035	0.040	0.15-0.35	0.30-0.60	0.30-0.50	0.08-0.15	
94B30	0.28-0.33	0.75-1.00	0.035	0.040	0.15-0.35	0.30-0.60	0.30-0.50	0.08-0.15	

A Silicon may be specified by the purchaser as 0.10 % maximum. The need for 0.10 % maximum generally relates to severe cold-formed parts.

5.1.2.3 When provisions of 5.1.2.1 or 5.1.2.2 are exercised, a grain size test is not required unless specified by the purchaser. Unless otherwise specified, fine austenitic grain size shall be certified using the analysis of grain refining element(s).

5.1.2.4 *Referee Test*—In the event that the chemical analysis of columbium⁸ or vanadium does not meet the requirements of

5.1.2.2, the grain size test shown in 5.1.2 shall be the referee test unless an alternative test method is agreed upon between the manufacturer and the purchaser.

^B The purchaser may also require the following maximums: copper 0.30 %; aluminum 0.050 %; oxygen 0.0015 %.

These steels can be expected to contain 0.0005 to 0.003 % boron. If the usual titanium additive is not permitted, the steels can be expected to contain up to 0.005 % boron.

TABLE 3 Heat Analysis Chemical Ranges and Limits of Carbon Steel Bars

	Chemical Ranges a	nd Limits, %	•
Element	When Maximum of Specified Elements is:	Range	Lowest Maximum
Carbon ^A			0.06
	to 0.12, incl		
	over 0.12 to 0.25, incl	0.05	
	over 0.25 to 0.40, incl	0.06	
	over 0.40 to 0.55, incl	0.07	
	over 0.55 to 0.80, incl	0.10	
	over 0.80	0.13	
Manganese			0.35
	to 0.40, incl	0.15	
	over 0.40 to 0.50, incl	0.20	
	over 0.50 to 1.65, incl	0.30	•••
Phosphorus	to 0.040, incl		0.040 ^B
·	over 0.040 to 0.08, incl	0.03	
	over 0.08 to 0.13, incl	0.05	
Sulfur	to 0.050, incl		0.050 ^B
	over 0.050 to 0.09, incl	0.03	
	over 0.09 to 0.15, incl	0.05	
	over 0.15 to 0.23, incl	0.07	
	over 0.23 to 0.50, incl	0.09	
Silicon ^C			0.10
	to 0.10, incl		
	over 0.10 to 0.15, incl	0.08	
	over 0.15 to 0.20, incl	0.10	
	over 0.20 to 0.30, incl	0.15	
	over 0.30 to 0.60, incl	0.20	
Copper	When copper is required 0.20		
	min is generally used		
Lead ^D	When lead is required, a range of 0.15 to 0.35 is specified		
Bismuth ^E Calcium ^E Selenium ^E Tellurium ^E			

 $^{^{\}rm A}$ The carbon ranges shown in the column headed "Range" apply when the specified maximum limit for manganese does not exceed 1.10 %. When the maximum manganese limit exceeds 1.10 %, add 0.01 to the carbon ranges shown above.

6. Mechanical Property Requirements

6.1 Test Specimens:

- 6.1.1 Selection—Test specimens shall be selected in accordance with the requirements of the applicable product specification or in accordance with Supplement I of the latest issue of Test Methods and Definitions A370, in the sequence named.
- 6.1.2 *Preparation*—Unless otherwise specified in the applicable product specification, test specimens shall be prepared in accordance with the latest issue of Test Methods and Definitions A370, and especially Supplement I thereof.
- 6.2 Methods of Mechanical Testing—All mechanical tests shall be conducted in accordance with the latest issue of Test

Methods and Definitions A370, and especially Supplement I thereof, on steel bar products.

6.3 Retests:

- 6.3.1 If any test specimen shows defective machining or develops flaws, the specimen may be discarded and another substituted.
- 6.3.2 If the percentage elongation of any tension specimen is less than that specified and any part of the fracture is more than ³/₄ in. [20 mm] from the center of a 2 in. [50 mm] specimen, or is outside the middle half of the gage length of an 8 in. [200 mm] specimen as indicated by scribe scratches marked on the specimen before testing, a retest shall be allowed.
- 6.3.3 For "as-wrought" material, if the results for any original tension specimen are within 2000 psi [14 MPa] of the required tensile strength, within 1000 psi [7 MPa] of the required yield point, or within 2 % of the required elongation, retesting shall be permitted. If the original testing required only one test, the retest shall consist of two random tests from the heat or lot involved. If the original testing required two tests of which one failed by the amounts listed in this paragraph, the retest shall be made on one random test from the heat or lot. If the results on the retest specimen or specimens meet the specified requirements, the heat or test lot will be accepted. If the results of one retest specimen do not meet the specified requirements, the material is subject to rejection.
- 6.3.4 For thermally treated bars, if the results of the mechanical tests do not conform to the requirements specified, two more tests may be selected for each bar failing, and each of these retests shall conform to the requirements of the product specification.
- 6.3.5 If a bend specimen fails, due to conditions of bending more severe than required by the specification, a retest shall be permitted from the heat or test lot involved for which one random specimen for each original specimen showing failure shall be used. If the results on the retest specimen meet the requirements of the specification, the heat or test lot will be accepted.

7. Dimensions, Mass, and Permissible Variations

7.1 *Hot-Wrought Bars*—The permissible variations for dimensions of hot-wrought carbon and alloy steel bars shall not exceed the applicable limits stated in Annex A1 for inch-pound values and Annex A2 for metric values.

8. Workmanship, Finish, and Appearance

8.1 The material shall be free of injurious defects and shall have a workmanlike finish.

9. Rework and Retreatment

9.1 For thermally treated bars only, the manufacturer may retreat a lot one or more times, and retests shall be made in the same manner as the original tests. Each such retest shall conform to the requirements specified.

10. Inspection

10.1 The inspector representing the purchaser shall have entry, at all times while work on the contract of the purchaser

 $^{^{\}it B}$ For steels produced in merchant quality the phosphorus maximum is 0.04 % and the sulfur maximum is 0.05 %.

^C It is not common practice to produce a rephosphorized and resulfurized carbon steel to specified limits for silicon because of its adverse effect on machinability. D A cast or heat analysis is not determinable when lead is added to the ladle stream.

^E Element specification range as agreed upon between purchaser and supplier.

TABLE 4 Heat Analysis Chemical Ranges and Limits of Alloy Steel Bars

Note 1—Boron steels can be expected to have 0.0005~% minimum boron content.

Note 2—Alloy steels can be produced with a lead range of 0.15 to 0.35 %. A cast or heat analysis is not determinable when lead is added to the ladle stream.

	Chemical Ranges and Limits, %							
Element	When Maximum of Specified Element is:	Open-Hearth or Basic-Oxygen Steel	Electric Furnace Steel	Maximum Limit, % ^A				
Carbon	To 0.55, incl	0.05	0.05					
	Over 0.55–0.70, incl	0.08	0.07					
	Over 0.70 to 0.80, incl	0.10	0.09					
	Over 0.80–0.95, incl	0.12	0.11					
	Over 0.95-1.35, incl	0.13	0.12					
Manganese	To 0.60, incl	0.20	0.15					
J	Over 0.60-0.90, incl	0.20	0.20					
	Over 0.90-1.05, incl	0.25	0.25					
	Over 1.05–1.90, incl	0.30	0.30					
	Over 1.90–2.10, incl	0.40	0.35					
Phosphorus	Basic open-hearth or basic-							
	oxygen steel			0.035				
	Acid open-hearth steel			0.050				
	Basic electric-furnace steel			0.025				
	Acid electric-furnace steel			0.050				
Bulfur	To 0.050, incl	0.015	0.015					
	Over 0.050–0.07, incl	0.02	0.02					
	Over 0.07–0.10, incl	0.04	0.04					
	Over 0.10–0.14, incl	0.05	0.05					
	Basic open-hearth or basic-							
	oxygen steel			0.040				
	Acid open-hearth steel			0.050				
	Basic electric-furnace steel			0.025				
	Acid electric-furnace steel			0.050				
Silicon	To 0.20, incl	0.08	0.08					
	Over 0.20–0.30, incl	0.15	0.15					
	Over 0.30–0.60, incl	0.20	0.20					
	Over 0.60–1.00, incl	0.30	0.30					
	Over 1.00–2.20, incl	0.40	0.35					
	Acid steels ^B							
Nickel	To 0.50, incl	0.20	0.20					
	Over 0.50–1.50, incl	0.30	0.30					
	Over 1.50–2.00, incl	0.35	0.35					
	Over 2.00–3.00, incl	0.40	0.40					
	Over 3.00–5.30, incl	0.50	0.50					
	Over 5.30–10.00, incl	1.00	1.00					
Chromium	To 0.40, incl	0.15	0.15					
	Over 0.40–0.90, incl	0.20	0.20					
	Over 0.90–1.05, incl	0.25	0.25					
	Over 1.05–1.60, incl	0.30	0.30					
	Over 1.60–1.75, incl	C	0.35					
	Over 1.75–2.10, incl	C	0.40					
	Over 2.10–3.99, incl	C	0.50					
/lolybdenum	To 0.10, incl	0.05	0.05					
	Over 0.10-0.20, incl	0.07	0.07					
	Over 0.20-0.50, incl	0.10	0.10					
	Over 0.50–0.80, incl	0.15	0.15					
	Over 0.80–1.15, incl	0.20	0.20					
ungsten	To 0.50, incl	0.20	0.20					
	Over 0.50–1.00, incl	0.30	0.30					
	Over 1.00-2.00, incl	0.50	0.50					
	Over 2.00–4.00, incl	0.60	0.60					
anadium/	To 0.25, incl	0.05	0.05					
	Over 0.25-0.50, incl	0.10	0.10					
Aluminum	Up to 0.10, incl	0.05	0.05					
	Over 0.10–0.20, incl	0.10	0.10					
	Over 0.20-0.30, incl	0.15	0.15					
	Over 0.30-0.80, incl	0.25	0.25					
	Over 0.80–1.30, incl	0.35	0.35					
	Over 1.30–1.80, incl	0.45	0.45					
Copper	To 0.60, incl	0.20	0.20					
	Over 0.60–1.50, incl	0.30	0.30					
	Over 1.50-2.00, incl	0.35	0.35					

 $^{^{}A}$ Applies to only nonrephosphorized and nonresulfurized steels. $^{\mathcal{B}}$ Minimum silicon limit for acid open-hearth or acid electric-furnace alloy steels is 0.15 %. $^{\mathcal{C}}$ Not normally produced in open-hearth.

TABLE 5 Permissible Variations for Product Analysis of Carbon Steel

Element	Limit, or Maximum of Specified Range, %	Over Maximum Limit, %	Under Minimum Limit, %
Carbon ^A	0.25 and under	0.02	0.02
	over 0.25 to 0.55, incl	0.03	0.03
	over 0.55	0.04	0.04
Manganese	0.90 and under	0.03	0.03
	over 0.90 to 1.65, incl	0.06	0.06
Phosphorus ^{A,B}	basic steels	0.008	
	acid bessemer steel	0.01	0.01
Sulfur ^{A,B}		0.008	
Silicon	0.35 and under	0.02	0.02
	over 0.35 to 0.60, incl	0.05	0.05
Copper	under minimum only		0.02
Lead ^C	0.15 to 0.35, incl	0.03	0.03

^A Rimmed and capped steels are not subject to rejection on product analysis unless misapplication is clearly indicated.

TABLE 6 Permissible Variations for Product Analysis of Alloy Steel

		
Elements	Limit, or Maximum of Specified Range, %	Permissible Variations Over Maximum Limit or Under Minimum Limit, %
Carbon	0.30 and under	0.01
	over 0.30 to 0.75, incl	0.02
	over 0.75	0.03
Manganese	0.90 and under	0.03
Ü	over 0.90 to 2.10, incl	0.04
Phosphorus	over maximum only	0.005
Sulfur	0.060 and under	0.005
Silicon	0.40 and under	0.02
	over 0.40 to 2.20, incl	0.05
Nickel	1.00 and under	0.03
	over 1.00 to 2.00, incl	0.05
	over 2.00 to 5.30, incl	0.07
	over 5.30 to 10.00, incl	0.10
Chromium	0.90 and under	0.03
	over 0.90 to 2.10, incl	0.05
	over 2.10 to 3.99, incl	0.10
Molybdenum	0.20 and under	0.01
•	over 0.20 to 0.40, incl	0.02
	over 0.40 to 1.15, incl	0.03
Vanadium	0.10 and under	0.01
	over 0.10 to 0.25, incl	0.02
	over 0.25 to 0.50, incl	0.03
	minimum value specified, under minimum limit only	0.01
Tungsten	1.00 and under	0.04
rungoton	over 1.00 to 4.00, incl	0.08
Aluminum	0.10 and under	0.03
,	over 0.10 to 0.20, incl	0.04
	over 0.20 to 0.30, incl	0.05
	over 0.30 to 0.80, incl	0.07
	over 0.80 to 1.80, incl	0.10
Lead ^A	0.15 to 0.35, incl	0.03
Copper	to 1.00 incl	0.03
	over 1.00 to 2.00, incl	0.05
	2.31 1.00 to 2.00, 11101	0.00

 $^{^{\}rm A}$ Product analysis tolerance for lead applies both over and under to a specified range of 0.15 to 0.35 %.

is being performed, to all parts of the manufacturer's works that concern the manufacture of the material ordered. The manufacturer shall afford the inspector all reasonable facilities to satisfy him that the material is being furnished in accordance with this specification. All tests (except product analysis) and inspection shall be made at the place of manufacture prior to shipment, unless otherwise specified, and shall be so conducted as not to interfere unnecessarily with the operation of the works.

10.2 All required tests and inspection shall be made by the manufacturer prior to shipment.

11. Rejection

- 11.1 Unless otherwise specified, any rejection because of noncompliance to the requirements of the specification shall be reported by the purchaser to the manufacturer within 30 working days after receipt of samples.
- 11.2 Material that shows imperfections capable of adversely affecting processibility subsequent to its acceptance at the purchaser's works will be rejected, and the manufacturer shall be notified.

12. Rehearing

12.1 Samples that represent rejected material shall be preserved for two weeks from the date rejection is reported to the manufacturer. In case of dissatisfaction with the results of the tests, the manufacturer may make claim for a rehearing within that time.

13. Product Marking

- 13.1 Civilian Procurement—Bars of all sizes, when loaded for shipment, shall be properly identified with the name or brand of manufacturer, purchaser's name and order number, the ASTM designation (year date is not required), grade number where appropriate, size and length, weight of lift, and the heat number for identification. Unless otherwise specified, the method of marking is at the manufacturer's option and may be made by hot stamping, cold stamping, painting, or marking tags attached to the lifts of bars.
- 13.1.1 Bar code marking may be used as an auxiliary method of identification. Such bar-code markings shall be of the 3-of-9 type and shall conform to AIAG B1. When barcoded tags are used, they shall conform to AIAG B5.
 - 13.2 Government Procurement:
- 13.2.1 Marking for shipment shall be in accordance with the requirements specified in the contract or order and shall be in accordance with MIL-STD-163 for military agencies and in accordance with Fed. Std. No. 123 for civil agencies.
- 13.2.2 For government procurement by the Defense Supply Agency, the bars shall be continuously marked for identification in accordance with Fed. Std. No. 183.

14. Packaging

- 14.1 *Civilian Procurement*—Unless otherwise specified, the bars shall be packaged and loaded in accordance with Guide A700.
- 14.2 Government Procurement—MIL-STD-163 shall apply when packaging is specified in the contract or order, or when Level A for preservation, packaging, and packing is specified for direct procurement by or direct shipment to the government.

unless misapplication is clearly indicated. $^{\mathcal{B}}$ Resulfurized or rephosphorized steels are not subject to rejection on product analysis for these elements unless misapplication is clearly indicated.

analysis for these elements unless misapplication is clearly indicated. $^{\it C}$ Product analysis tolerance for lead applies both over and under to a specified range of 0.15 to 0.35 %.

15. Keywords

15.1 alloy steel bars; carbon steel bars; cold finished steel bars; general delivery requirements; hot wrought steel bars; steel bars

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall apply only when specified by the purchaser in the contract or order.

S1. Flat Bar Thickness Tolerances

S1.1 When flat bars are specified in metric units to a thickness under tolerance of 0.3 mm, the thickness tolerance of Table S1.1 shall apply.

TABLE S1.1 Thickness and Width Tolerances for Hot-Wrought Square-Edge and Round-Edge Flat Bars Ordered to 0.3 mm Under Tolerance^A

Note 1—Tolerance under specified thickness 0.3 mm.

Specified Width, mm	Tol	Tolerance from Specified Width, mm					
	Over 6 to 12, incl	Over 12 to 25, incl	Over 25 to 50, incl	Over 50 to 75, incl	Over 75	Over	Under
To 25, incl						0.5	0.5
Over 25 to 50, incl		0.5	1.3			1.0	1.0
Over 50 to 100, incl	0.5	0.7	1.3	2.1	2.1	1.5	1.0
Over 100 to 150, incl	0.5	0.7	1.3	2.1	2.1	2.5	1.5
Over 150 to 200, incl	0.5	1.0	1.3	2.1	2.9	3.0	2.5

A When a square is held against a face and an edge of a square-edge flat bar, the edge shall not deviate by more than 3° or 5 % of the thickness.

ANNEXES

(Mandatory Information)

A1. PERMISSIBLE VARIATIONS IN DIMENSIONS, ETC.—INCH-POUND UNITS

A1.1 Listed below are permissible variations in dimensions expressed in inch-pound units of measurement.

TABLE A1.1 Permissible Variations in Cross Section for Hot-Wrought Round, Square, and Round-Cornered Square Bars of Steel

Specified Size, in.	Permissibl from Specifi	Out-of-Round or Out-of-Square, in. ^B	
	Over	Under	Out-oi-Square, in.
To 5/16, incl	0.005	0.005	0.008
Over 5/16 to 7/16, incl	0.006	0.006	0.009
Over 7/16 to 5/8, incl	0.007	0.007	0.010
Over 5/8 to 7/8, incl	0.008	0.008	0.012
Over % to 1, incl	0.009	0.009	0.013
Over 1 to 11/8, incl	0.010	0.010	0.015
Over 11/8 to 11/4, incl	0.011	0.011	0.016
Over 11/4 to 13/8, incl	0.012	0.012	0.018
Over 1% to 1½, incl	0.014	0.014	0.021
Over 11/2 to 2, incl	1/64	1/64	0.023
Over 2 to 21/2, incl	1/32	0	0.023
Over 21/2 to 31/2, incl	3/64	0	0.035
Over 31/2 to 41/2, incl	1/16	0	0.046
Over 41/2 to 51/2, incl	5/64	0	0.058
Over 51/2 to 61/2, incl	1/8	0	0.070
Over 61/2 to 81/4, incl	5/32	0	0.085
Over 81/4 to 91/2, incl	3/16	0	0.100
Over 91/2 to 10, incl	1/4	0	0.120

^A Steel bars are regularly cut to length by shearing or hot sawing, which can cause end distortion resulting in those portions of the bar being outside the applicable size tolerance. When this end condition is objectionable, a machine cut end should be considered.

TABLE A1.2 Permissible Variations in Cross Section for Hot-Wrought Hexagonal Bars of Steel

Specified Sizes Between Opposite Sides, in.		e Variations ied Size, in. ^A	Out-of-Hexagon (Carbon Steel and Alloy Steel) or Out-	
Opposite Sides, III.	Over	Under	of-Octagon (Alloy Steel), in. ^B	
To ½, incl	0.007	0.007	0.011	
Over ½ to 1, incl	0.010	0.010	0.015	
Over 1 to 11/2, incl	0.021	0.013	0.025	
Over 11/2 to 2, incl	1/32	1/64	1/32	
Over 2 to 21/2, incl	3/64	1/64	3/64	
Over 21/2 to 31/2, incl	1/16	1/64	1/16	
Over 31/2 to 41/16, incl	5/64	1/64	5/64	

^A Steel bars are regularly cut to length by shearing or hot sawing, which can cause end distortion resulting in those portions of the bar being outside the applicable size tolerance. When this end condition is objectionable, a machine cut end should be considered.

TABLE A1.3 Permissible Variations in Thickness and Width for Hot-Wrought Square Edge and Round Edge Flat Bars^A

Specified Width, in.	Per	Permissible Variations in Thickness, for Thickness Given, Over and Under, in. ^B							
	0.203 to 0.230, excl	0.230 to 1/4, excl	1/4 to 1/2, incl	Over ½ to 1, incl	Over 1 to 2, incl	Over 2 to 3, incl	Over 3	Over	Under
To 1, incl	0.007	0.007	0.008	0.010				1/64	1/64
Over 1 to 2, incl	0.007	0.007	0.012	0.015	1/32			1/32	1/32
Over 2 to 4, incl	0.008	0.008	0.015	0.020	1/32	3/64	3/64	1/16	1/32
Over 4 to 6, incl	0.009	0.009	0.015	0.020	1/32	3/64	3/64	3/32	1/16
Over 6 to 8, incl	С	0.015	0.016	0.025	1/32	3/64	1/16	1/8	3/32

A When a square is held against a face and an edge of a square edge flat bar, the edge shall not deviate by more than 3° or 5 % of the thickness.

^B Out-of-round is the difference between the maximum and minimum diameters of the bar, measured at the same cross section. Out-of-square is the difference in the two dimensions at the same cross section of a square bar between opposite faces.

 $^{^{\}mathcal{B}}$ Out-of-hexagon or out-of-octagon is the greatest difference between any two dimensions at the same cross section between opposite faces.

^B Steel bars are regularly cut to length by shearing or hot sawing, which can cause end distortion resulting in those portions of the bar being outside the applicable size tolerance. When this end condition is objectionable, a machine cut end should be considered.

 $^{^{}C}$ Flats over 6 to 8 in., incl, in width, are not available as hot-wrought steel bars in thickness under 0.230 in.

TABLE A1.4 Permissible Variations in Thickness, Length, and Out-of-Square for Hot-Wrought Bar Size Angles of Carbon Steel

Specified Length of Leg, in. ^A	fo	sible Variations in T or Thicknesses Giv Over and Under, i	Permissible Variations for Length of Leg,	
Leg, III.	To 3/16,	Over 3/16 to 3/8,	Over 3/8	Over and
	incl	incl		Under, in.
To 1, incl	0.008	0.010		1/32
Over 1 to 2, incl	0.010	0.010	0.012	3/64
Over 2 to 3, excl	0.012	0.015	0.015	1/16

 $^{^{}A}$ The longer leg of an unequal angle determines the size for tolerance. The out-of-square tolerance in either direction is 1½ $^{\circ}$.

TABLE A1.5 Permissible Variations in Dimensions for Hot-Wrought Bar Size Channels of Carbon Steel

Specified	Permissible	Out-of- Square ^A if			
Size of Channel,	Depth of Width of Section ^B Flanges ^B		Thickness Thicknes	Either Flange, in./in. of	
in.			To 3/16, incl	Over 3/16	Flange Width
To 11/2, incl	1/32	1/32	0.010	0.015	1/32
Over 1½	1/16	1/16	0.015	0.020	1/32
to 3, excl					

A For channels % in. and under in depth, the out-of-square tolerance is %4 in. /in.

TABLE A1.6 Permissible Variations in Dimensions for Hot-Wrought Bar Size Tees of Carbon Steel

Consisted Circ of			Permi	ssible Variations in S	ize, in.		
Specified Size of - Tee, in. ^A -	Width or Depth ^B		Thickness	Thickness of Flange		Thickness of Stem	
ree, in	Over	Under	Over	Under	Over	Under	Square ^C
To 11/4, incl	3/64	3/64	0.010	0.010	0.005	0.020	1/32
Over 11/4 to 2, incl	1/16	1/16	0.012	0.012	0.010	0.020	1/16
Over 2 to 3, excl	3/32	3/32	0.015	0.015	0.015	0.020	3/32

A The longer member of the unequal tee determines the size for tolerances.

TABLE A1.7 Permissible Variations in Dimensions for Half-Rounds, Ovals, Half-Ovals, and Other Special Bar Size Sections

Due to mill facilities, tolerances on half-rounds, ovals, half-ovals, and other special bar size sections vary among the manufacturers and such tolerances should be negotiated between the manufacturer and the purchaser.

^B Measurements for depth of section and width of flanges are overall.

B Measurements for both width and depth are overall.

^C Stem out-of-square is the variation from its true position of the center line of the stem measured at the point.

TABLE A1.8 Permissible Variations in Length for Hot-Wrought Rounds, Squares, Hexagons, Flats, and Bar Size Sections of Steel

Specified Size of Rounds, Squares,	Specified Siz	e of Flats, in.		Permissible Variations Over Specified Length, in. ^A				
and Hexagons, in.	Thickness	Width	5 to 10 ft, excl	10 to 20 ft, excl	20 to 30 ft, excl	30 to 40 ft, excl	40 to 60 ft, excl	
			Mill St	nearing				
To 1, incl	to 1, incl	to 3, incl	1/2	3/4	11/4	13/4	21/4	
Over 1 to 2, incl	over 1	to 3, incl	5/8	1	11/2	2	21/2	
	to 1, incl	over 3 to 6, incl	5/8	1	11/2	2	21/2	
Over 2 to 5, incl	over 1	over 3 to 6, incl	1	11/2	13/4	21/4	23/4	
Over 5 to 10, incl			2	21/2	23/4	3	31/4	
	0.230 to 1, incl	over 6 to 8, incl	3/4	11/4	13/4	31/2	4	
	over 1 to 3, incl	over 6 to 8, incl	11/4	13/4	2	31/2	4	
Bar Size Sections			5/8	1	11/2	2	21/2	
			Hot S	Sawing				
To 3½, incl	1 and over	3 and over	В	1½	13/4	21/4	23/4	
Over 31/2 to 5, incl				2	21/4	25/8	3	
Over 5 to 10, incl			В	21/2	23/4	3	31/4	

^A No permissible variations under.

TABLE A1.9 Permissible Variations in Length for Recutting of Bars Meeting Special Straightness Tolerances

Sizes of Rounds, Squares, Hexagons, Width of Flats and Maximum Dimension of Other	Tolerances Over Specified Length, in. ^A				
Sections, in. ^A	To 12 ft, incl	Over 12 ft			
To 3, incl	1/4	5/16			
Over 3 to 6, incl	5/16	7/16			
Over 6 to 8, incl	7/16	9/16			
Rounds over 8 to 10, incl.	9/16	11/16			

A No tolerance under.

TABLE A1.10 Permissible Variations in Straightness for Hot-Wrought Bars and Bar Size Sections of Steel^A

Standard tolerances	1/4 in. in any 5 ft and (1/4 in. x length in ft)/5
Special tolerances	1/8 in. in any 5 ft and (1/8 in. x length in ft)/5

 $[\]overline{\ ^{A}}$ Because of warpage, straightness tolerances do not apply to bars if any subsequent heating operation or controlled cooling has been performed.

A2. DIMENSIONAL TOLERANCES—SI UNITS

A2.1 Listed below are permissible variations in dimensions expressed in SI units of measurement.

TABLE A2.1 Tolerances in Sectional Dimensions for Round and Square Bars and Round-Cornered Square Bars

Size, mm	Tolerance from Specified Size, Over and Under, mm or % ^A	Out-of-Round, or Out-of-Square Section, ^B mm or % ^A
To 7, incl	0.13 mm	0.20 mm
Over 7 to 11, incl	0.15 mm	0.22 mm
Over 11 to 15, incl	0.18 mm	0.27 mm
Over 15 to 19, incl	0.20 mm	0.30 mm
Over 19 to 250, incl	1 %	1.5 %

 $^{^{\}it A}$ The tolerance shall be rounded to the nearest tenth of a millimetre after calculation.

^B Shorter lengths are not hot sawed.

^B Out-of-round is the difference between the maximum and the minimum diameters of the bar, measured at the same cross section. Out-of-square is the difference in the two dimensions at the same cross section of a square bar between opposite faces.

TABLE A2.2 Tolerances in Cross Section for Hot-Wrought Hexagonal and Octagonal Steel Bars

Specified Size Between	Tolerance from S	Out of Hexagon or	
Opposite Sides, mm	Over	Under	— Out of Octagon, mm ^A
To 13, incl	0.18	0.18	0.3
Over 13 to 25, incl	0.25	0.25	0.4
Over 25 to 40, incl	0.55	0.35	0.6
Over 40 to 50, incl	0.8	0.40	0.8
Over 50 to 65, incl	1.2	0.40	1.2
Over 65 to 80, incl	1.6	0.40	1.6
Over 80 to 100, incl	2.0	0.40	2.0

A Out of hexagon or out of octagon is the greatest difference between any two dimensions at the cross section between opposite faces.

TABLE A2.3 Thickness and Width Tolerances for Hot-Wrought Square-Edge and Round-Edge Flat Bars^{A,B}

Specified Width, mm	Tolerances from Specified Thickness for Thickness Given Over and Under, mm							Tolerances from Specified Width, mm	
	Over 5 to 6, incl	Over 6 to 12, incl	Over 12, to 25, incl	Over 25 to 50, incl	Over 50 to 75	Over 75	Over	Under	
To 25, incl	0.18	0.20	0.25				0.5	0.5	
Over 25 to 50, incl	0.18	0.30	0.40	0.8			1.0	1.0	
Over 50 to 100, incl	0.20	0.40	0.50	0.8	1.2	1.2	1.5	1.0	
Over 100 to 150, incl	0.25	0.40	0.50	0.8	1.2	1.2	2.5	1.5	
Over 150 to 200, incl	Α	0.40	0.65	0.8	1.2	1.6	3.0	2.5	

^A When a square is held against a face and an edge of a square edge flat bar, the edge shall not deviate by more than 3° or 5 % of the thickness. ^B Flats over 150 to 200 mm, incl in width are not available as hot-wrought bars in thickness 6 mm and under.

TABLE A2.4 Thickness, Length, and Out-of-Square Tolerances for Hot-Wrought Bar Size Angles

Specified Length of Leg, mm ^{A,B}	Tolerances in Thic	Tolerances in Thickness for Thickness Given, Over and Under, mm				
	To 5, incl	Over 5 to 10, incl	Over 10	Leg Over and Under, mm		
To 50, incl	0.2	0.2	0.3	1		
Over 50 to 75, excl	0.3	0.4	0.4	2		

 $[^]A$ The longer leg of an unequal angle determines the size for tolerance. $^{\cal B}$ Out of square tolerances in either direction is 1½ $^{\rm o}$ = 0.026 mm/mm.

TABLE A2.5 Dimensional Tolerances for Hot-Wrought Bar Size Channels

	Tolerances in Size, Over and Under, mm						
Specified Size of Channel, mm	Depth of Section ^A	Width of Flanges ^A	Thickness of Web E		Out of Square of Either Flange per mm of Flange Width, ^B mm		
		_	To 5, incl	Over 5			
To 40, incl	1	1	0.2	0.4	0.03		
Over 40 to 75, excl	2	2	0.4	0.5	0.03		

^A Measurements for depth of section and width of flanges are overall.
^B For channels 16 mm and under in depth, out of square tolerance is 0.05 mm/mm.

TABLE A2.6 Dimensional Tolerances for Hot-Wrought Bar Size Tees

Specified Size -		·	7	olerances in Size, mr	n	·	
of Tee, ^A mm -	Width or Depth, ^B		Thickness	Thickness of Flange		Thickness of Stem	
or ree, min -	Over	Under	Over	Ünder	Over	Under	Square ^C
To 30, incl	1	1	0.2	0.2	0.1	0.5	1
Over 30 to 50, incl	2	2	0.3	0.3	0.2	0.5	2
Over 50 to 75, excl	2	2	0.4	0.4	0.4	0.5	2

^A The longer member of the unequal tee determines the size for tolerances.

TABLE A2.7 Permissible Variations in Dimensions for Half-Rounds, Ovals, Half-Ovals, and Other Special Bar Size Sections

Due to mill facilities, tolerances on half-rounds, ovals, and other special bar size sections vary among the manufacturers and such tolerances should be negotiated between the manufacturer and the purchaser.

TABLE A2.8 Length Tolerances for Hot-Wrought Rounds, Squares, Hexagons, Octagons, Flats, and Bar Size Sections

	Specified Size	ze of Flats, mm		Tolerances over Specified Length, mm ^A			
Specified Size of Rounds, Squares, Hexagons and	Thickness	Width	1500	3000	6000	9000	12 000
Octagons, mm			to	to	to	to	to
Octagons, mm			3000, excl	6000, excl	9000, excl	12 000, excl	18 000, excl
		Hot Shearing					
To 25, incl	to 25, incl	to 75, incl	15	20	35	45	60
Over 25 to 50, incl	over 25	to 75, incl	15	25	40	50	65
	to 25, incl	over 75 to 150, incl	15	25	40	50	65
Over 50 to 125, incl	over 25	over 75 to 150, incl	25	40	45	60	70
Over 125 to 250, incl			50	65	70	75	85
Bar Size Sections	over 6 to 25, incl	over 150 to 200, incl	20	30	45	90	100
	over 25 to 75, incl	over 150 to 200, incl	30	45	50	90	100
	• • •	• • •	15	25	40	50	65
		Hot Sawing					
To 90, incl	25 and over	75 and over	В	40	45	60	70
Over 90 to 125, incl				50	60	65	75
Over 125 to 250, incl			В	65	70	75	85

TABLE A2.9 Length Tolerances for Recutting of Bars Meeting Special Straightness Tolerances

Sizes of Rounds, Squares, Hexagons,	Tolerances over Specified Length, mm ^A		
Octagons, Widths of Flats and Maximum Dimensions of Other Sections, mm	To 3700 mm, incl	Over 3700 mm	
To 75, incl	6	8	
Over 75 to 150, incl	8	11	
Over 150 to 200, incl	11	14	
Rounds over 200 to 250, incl	14	18	

^A No tolerance under.

TABLE A2.10 Straightness Tolerances for Hot-Wrought Bars and Bar Size Sections^A

Standard Tolerances	6 mm in any 1500 mm and (length in mm/250) ^B
Special Tolerances	3 mm in any 1500 mm and (length in mm/500) ^B

A Because of warpage, straightness tolerances do not apply to bars if any subsequent heating operation or controlled cooling has been performed.

^B Measurements for width and depth are over all.

^C Stem out of square is the tolerance from its true position of the center line of the stem measured at the point.

A No tolerance under.
B Shorter lengths are not hot sawed.

^B Round to the nearest whole millimetre.

A3. REQUIREMENTS FOR THE INTRODUCTION OF NEW MATERIALS

- A3.1 New materials may be proposed for inclusion in specifications referencing this specification of general requirements subject to the following conditions:
- A3.1.1 Application for the addition of a new grade to a specification shall be made to the chair of the subcommittee that has jurisdiction over that specification.
- A3.1.2 The application shall be accompanied by a statement from at least one user indicating that there is a need for the new grade to be included in the applicable specification.
- A3.1.3 The application shall be accompanied by test data as required by the applicable specification. Test data from a minimum of three test lots, as defined by the specification, each from a different heat, shall be furnished.
- A3.1.4 The application shall provide recommendations for all requirements appearing in the applicable specification.
- A3.1.5 The application shall state whether or not the new grade is covered by patent.

SPECIFICATION FOR STEEL RIVETS AND BARS FOR RIVETS, PRESSURE VESSELS



SA-31

(Identical with ASTM Specification A31-14 except that 3.1.7 has been deleted, Note 1 has been revised for ASME and certification is mandatory in 14.)

SPECIFICATION FOR STEEL RIVETS AND BARS FOR RIVETS, PRESSURE VESSELS



SA-31

1. Scope

- **1.1** This specification covers steel rivets for use in boilers and pressure vessels and steel bars for use in the manufacture of rivets.
 - **1.2** Two grades are covered:
- **1.2.1** *Grade A* Bars having a yield point of 23 000 psi (160 MPa) minimum with no controls on carbon content.
- **1.2.2** *Grade B* Bars having a yield point of 29 000 psi (200 MPa) minimum with carbon 0.28% maximum.
- **1.2.3** Rivets are manufactured from the applicable bar grade.
- **1.3** The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are for information only.

2. Referenced Documents

- **2.1** ASTM Standards:
- A 29/A 29M Specification for Steel Bars, Carbon and Alloy, Hot-Wrought, General Requirements for
- A 370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A 751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- F 1470 Guide for Fastener Sampling for Specified Mechanical Properties and Performance Inspection
 - **2.2** ASME Standards:
- B18.1.1 Small Solid Rivets $\frac{7}{16}$ Inch Nominal Diameter and Smaller
- B18.1.2 Large Rivets ½ Inch Nominal Diameter and Larger B18.24 Part Identifying Number (PIN) Code System Standard for B18 Fastener Products

3. Ordering Information

- **3.1** Orders for rivets and bars under this specification shall include:
 - **3.1.1** Specification designation and date of issue,
- **3.1.2** *Quantity* Number of pieces for rivets and weight for bars,
 - **3.1.3** Name of product and grade (A or B),
 - **3.1.4** Size (diameter and length),
 - 3.1.5 Rivet head type,
- **3.1.6** If inspection at point of manufacture is required,

3.1.7 DELETED

- **3.1.8** Additional testing or special requirements, if required.
- **3.1.9** For establishment of a part identifying system, see ASME B18.24.

NOTE 1 — A typical ordering description is: ASME SA-31, 2015 edition, 10 000 pieces, steel rivets Grade A, button head.

4. Materials and Manufacture

- **4.1** The steel shall be made by any of the following processes: open-hearth, electric-furnace, or basic-oxygen.
- **4.2** Rivets shall be manufactured from rivet bars conforming to the applicable grade ordered.
- **4.3** Rivets shall be manufactured by hot- or coldheading.
- **4.4** Bars shall be furnished as rolled and not pickled, blast cleaned, or oiled. At producer's option, bars may be cleaned for inspection or cold drawn.

5. Chemical Composition

5.1 The steel shall conform to chemical composition prescribed in Table 1.

- **5.2** Heat Analysis An analysis of each heat of steel shall be made by the bar manufacturer to determine for Grades A and B the percentages of carbon, manganese, phosphorus, and sulfur. This analysis shall be made from a test ingot taken during the pouring of the heat. The chemical composition thus determined shall be reported to the purchaser or his representative and shall conform to the requirements for heat analysis in accordance with Table 1.
- **5.3** *Product Analysis* An analysis may be made by the purchaser from finished materials representing each heat. The chemical composition thus determined shall conform to the requirements for product analysis prescribed in Table 1.
- **5.4** Application of heats of steel to which bismuth, selenium, tellurium, or lead has been intentionally added shall not be permitted.
- **5.5** Chemical analyses shall be performed in accordance with Test Methods, Practices, and Terminology A 751.

6. Mechanical Properties

6.1 Rivet Bend Tests:

- **6.1.1** The rivet shank of Grade A steel shall stand being bent cold through 180° flat on itself, as shown in Fig. 1, without cracking on the outside of the bent portion.
- **6.1.2** The rivet shank of Grade B steel shall stand being bent cold through 180° without cracking on the outside of the bent portion in accordance with Table 2.
- **6.2** Rivet Flattening Tests The rivet head shall stand being flattened, while hot, to a diameter $2\frac{1}{2}$ times the diameter of the shank, as shown in Fig. 2, without cracking at the edges.
- **6.3** Bar Tensile Properties Bars shall conform to the tensile requirements in accordance with Table 3.

6.4 Bar Bend Tests:

- **6.4.1** The test specimen for Grade A steel bars shall stand being bent cold through 180° flat on itself without cracking on the outside of the bent portion.
- **6.4.2** The test specimen for Grade B steel bars shall stand being bent cold through 180° without cracking on the outside of the bent portion to an inside diameter which shall have a relation to the diameter of the specimen in accordance with Table 4.

7. Dimensions, Mass, and Permissible Variations

7.1 *Rivets:*

7.1.1 The dimensions of rivets shall conform to B18.1.2 for nominal diameters in. and larger and B18.1.1 for nominal diameters $\frac{7}{16}$ in. and less.

- **7.1.2** Snap gage measurement shall be made at the point of minimum diameter, but it is not required that the rivet shall turn completely in the gage. Measurements of the maximum tolerance shall be made with a ring gage, all rivets to slip full to the head in the gage of the required size for the various diameters.
- **7.2** *Bars* The diameter of hot-finished rivet bars shall not vary from the size specified by more than the amounts in accordance with Table 5.

8. Workmanship, Finish, and Appearance

8.1 *Rivets* — The finished rivets shall be true to form, concentric, and free of injurious defects.

8.2 *Bars:*

- **8.2.1** Bars shall be free of visible pipe, undue segregation, and injurious surface imperfections.
- **8.2.2** *Surface Finish* The bars shall have a commercial hot-wrought finish obtained by conventional hot rolling. See 4.4 for producer's descaling option.

9. Number of Tests and Retests

9.1 *Rivets* — Sampling for rivet bend and rivet flattening tests shall be in accordance with Guide F 1470, detection process.

9.2 *Bars:*

- 9.2.1 Two tension tests shall be made from each heat, unless the finished material from a heat is less than 50 tons (45 Mg), when one tension test will be sufficient. However, for material 2 in. (51 mm) and under in thickness, when the material from one heat differs $\frac{3}{8}$ in. (9.5 mm) or more in thickness, one tension test shall be made from both the thickest and the thinnest material rolled regardless of the weight represented. Each test shall conform to the specified requirements.
- **9.2.2** Retests on bars may be made in accordance with Specification A 29/A 29M.

10. Specimen Preparation

10.1 *Rivets* — Rivets shall be tested in their full-size finished condition.

10.2 *Bars:*

- **10.2.1** Test specimen selection and preparation shall be in accordance with Specification A 29/A 29M and Test Methods and Definitions A 370.
- **10.2.2** Tension and bend test specimens for rivet bars which have been cold drawn shall be normalized before testing.

11. Test Methods

- **11.1** *Rivets* Rivet bend and flattening tests shall be in accordance with the manufacturers standard test procedures.
- 11.2 Bars Tension and bend tests shall be conducted in accordance with Test Methods and Definitions A 370, and especially Supplement I thereof, on steel bar products.

12. Inspection

- **12.1** If the testing described in Section 9 is required by the purchaser, it shall be specified in the inquiry and contract or order.
- 12.2 The inspector representing the purchaser shall have free entry at all times, while work on the contract of the purchaser is being performed, to all parts of the manufacturer's works that concern the manufacture of the material ordered. The manufacturer shall afford the inspector all reasonable facilities, without charge, to satisfy him that the material is being furnished in accordance with this specification. All tests (except product analysis) and inspection shall be made at the place of manufacture prior to shipment, unless otherwise specified, and shall be so conducted as not to interfere unnecessarily with the operation of the works.

13. Rejection and Rehearing

- **13.1** *Rivets* Rivets that fail to conform to the requirements of this specification may be rejected. Rejection should be reported to the producer or supplier promptly and in writing. In case of dissatisfaction with the results of the test, the producer or supplier may make claim for a rehearing.
- **13.2** *Bars* Rejection and rehearing shall be in accordance with Specification A 29/A 29M.

14. Certification

14.1 The manufacturer shall furnish certification that the material was manufactured and tested in accordance with this specification together with a report of the heat analysis (5.2) and mechanical property test results (Section 6) as applicable to the product ordered. The report shall include the manufacturer's name, ASTM designation, grade, heat number (bars only), and authorized signature.

15. Responsibility

15.1 The party responsible for the fastener shall be the organization that supplies the fastener to the purchaser.

16. Packaging and Package Marking

- **16.1** *Rivets* Rivets shall be properly packed and marked to prevent damage and loss during shipment.
- **16.2** *Bars* Bars shall be packed and marked in accordance with Specification A 29/A 29M.

17. Keywords

17.1 bars; carbon steel; pressure vessel rivets; rivets; steel




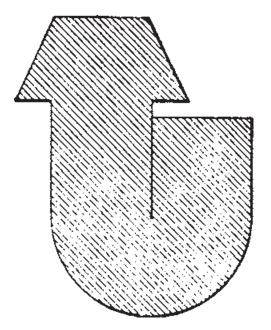


FIG. 2 FLATTENING TEST OF RIVET

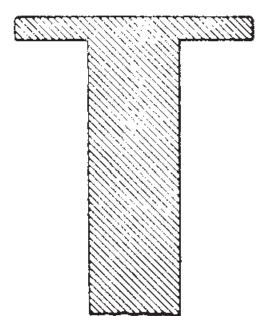

TENSILE REQUIREMENTS, BARS

TABLE 3

	Grade A	Grade B
Tensile strength, psi (MPa)	45 000-55 000	58 000-68 000
3.,,,	(310-380)	(400-470)
Yield point, min., psi (MPa)	23 000 (160)	29 000 (200)
Elongation in 8 in. or	27	22
200 mm, min., %		
Elongation in 2 in. or	33	25
50 mm, min., %		

TABLE 4 BEND REQUIREMENTS, BARS

Specimen	Ratio of Bend Diameter to Diameter of Specimen		
Diameter, in.	Grade A	Grade B	
3/4 and under	flat	1/2	
Over 3/4	flat	1	

TABLE 1 CHEMICAL REQUIREMENTS

	Grade A		Grade B		
	Heat Analysis	Product Analysis	Heat Analysis	Product Analysis	
Carbon, max., %			0.28	0.31	
Manganese, %	0.30-0.60	0.27-0.63	0.30-0.80	0.27-0.83	
Phosphorus, max., %	0.040	0.048	0.040	0.048	
Sulfur, max., %	0.050	0.058	0.050	0.058	

TABLE 2 BEND REQUIREMENTS, RIVETS

Diameter of	Ratio of Bend Diameter to Diameter of Rivet Shank		
Rivet Shank, in.	Grade A	Grade B	
$^{3}\!/_{\!\!4}$ and under Over $^{3}\!/_{\!\!4}$	flat flat	1 1½	

TABLE 5 PERMISSIBLE VARIATIONS IN THE SIZE OF HOT-ROLLED ROUNDS

	Variatio Size	Out-of-	
Specified Size, in.	0ver	Under	Round, ^A in.
5/16 and under	0.005	0.005	0.008
Over $\frac{5}{16}$ to $\frac{7}{16}$, incl	0.006	0.006	0.009
Over $\frac{7}{16}$ to $\frac{5}{8}$, incl	0.007	0.007	0.010
Over $\frac{5}{8}$ to $\frac{7}{8}$, incl	0.008	0.008	0.012
Over $\frac{7}{8}$ to 1, incl	0.009	0.009	0.013
Over 1 to $1\frac{1}{8}$, incl	0.010	0.010	0.015
Over $1\frac{1}{8}$ to $1\frac{1}{4}$, incl	0.011	0.011	0.016
Over $1\frac{1}{4}$ to $1\frac{3}{8}$, incl	0.012	0.012	0.018
Over $1\frac{3}{8}$ to $1\frac{1}{2}$, incl	0.014	0.014	0.021

 $^{^{\}it A}$ Out-of-round is the difference between the maximum and minimum diameters of the bar, measured at the same cross-section.



SPECIFICATION FOR CARBON STRUCTURAL STEEL



SA-36/SA-36M



(23)

(Identical with ASTM Specification A36/A36M-19.)

Specification for Carbon Structural Steel

1. Scope

- 1.1 This specification covers carbon steel shapes, plates, and bars of structural quality for use in riveted, bolted, or welded construction of bridges and buildings, and for general structural purposes.
- 1.2 Supplementary requirements are provided for use where additional testing or additional restrictions are required by the purchaser. Such requirements apply only when specified in the purchase order.
- 1.3 When the steel is to be welded, a welding procedure suitable for the grade of steel and intended use or service is to be utilized. See Appendix X3 of Specification A6/A6M for information on weldability.
- 1.4 The text of this specification contains notes or footnotes, or both, that provide explanatory material. Such notes and footnotes, excluding those in tables and figures, do not contain any mandatory requirements.
- 1.5 For structural products produced from coil and furnished without heat treatment or with stress relieving only, the additional requirements, including additional testing requirements and the reporting of additional test results, of Specification A6/A6M apply.
- 1.6 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system is to be used independently of the other, without combining values in any way.
- 1.7 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the

Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A6/A6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
- A27/A27M Specification for Steel Castings, Carbon, for General Application
- A307 Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 PSI Tensile Strength
- A500 Specification for Cold-Formed Welded and Seamless Carbon Steel Structural Tubing in Rounds and Shapes
- A501 Specification for Hot-Formed Welded and Seamless Carbon Steel Structural Tubing
- A502 Specification for Rivets, Steel, Structural
- A563 Specification for Carbon and Alloy Steel Nuts
- A563M Specification for Carbon and Alloy Steel Nuts (Metric)
- A668/A668M Specification for Steel Forgings, Carbon and Alloy, for General Industrial Use
- A1011/A1011M Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength
- A1018/A1018M Specification for Steel, Sheet and Strip, Heavy-Thickness Coils, Hot-Rolled, Carbon, Commercial, Drawing, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength
- F568M Specification for Carbon and Alloy Steel Externally Threaded Metric Fasteners (Metric) (Withdrawn 2012)
- F1554 Specification for Anchor Bolts, Steel, 36, 55, and 105-ksi Yield Strength

TABLE 1 Appurtenant Material Specifications

Note 1—The specifier should be satisfied of the suitability of these materials for the intended application. Chemical composition or mechanical properties, or both, may be different than specified in A36/A36M.

	AOTHA D
Material	ASTM Designation
Steel rivets	A502, Grade 1
Bolts	A307, Grade A or F568M, Class 4.6
High-strength bolts	F3125/F3125M, Grade A325 or A325M
Steel nuts	A563 or A563M
Cast steel	A27/A27M, Grade 65-35 [450-240]
Forgings (carbon steel)	A668/A668M, Class D
Hot-rolled sheets and strip	A1011/A1011M, SS Grade 36 [250] Type 1 or Type 2 or A1018/A1018M, SS Grade 36 [250] Type 1 or Type 2
Cold-formed tubing	A500, Grade B
Hot-formed tubing	A501
Anchor bolts	F1554, Grade 36

F3125/F3125M Specification for High Strength Structural Bolts and Assemblies, Steel and Alloy Steel, Heat Treated, Inch Dimensions 120 ksi and 150 ksi Minimum Tensile Strength, and Metric Dimensions 830 MPa and 1040 MPa Minimum Tensile Strength

3. Appurtenant Materials

3.1 When components of a steel structure are identified with this ASTM designation but the product form is not listed in the scope of this specification, the material shall conform to one of the standards listed in Table 1 unless otherwise specified by the purchaser.

4. General Requirements for Delivery

- 4.1 Structural products furnished under this specification shall conform to the requirements of the current edition of Specification A6/A6M, for the specific structural product ordered, unless a conflict exists in which case this specification shall prevail.
- 4.2 Coils are excluded from qualification to this specification until they are processed into a finished structural product. Structural products produced from coil means structural products that have been cut to individual lengths from a coil. The processor directly controls, or is responsible for, the operations involved in the processing of a coil into a finished structural product. Such operations include decoiling, leveling or straightening, hot-forming or cold-forming (if applicable), cutting to length, testing, inspection, conditioning, heat treatment (if applicable), packaging, marking, loading for shipment, and certification.

Note 1-For structural products produced from coil and furnished without heat treatment or with stress relieving only, two test results are to be reported for each qualifying coil. Additional requirements regarding structural products produced from coil are described in Specification A6/A6M.

TABLE 2 Tensile Requirements^A

Plates, Shapes, ^B and Bars:		
Tensile strength, ksi [MPa]	58-80 [400-550]	
Yield point, min, ksi [MPa]	36 [250] ^C	
Plates and Bars: D,E		
Elongation in 8 in. [200 mm], min, %	20	
Elongation in 2 in. [50 mm], min, %	23	
Shapes:		
Elongation in 8 in. [200 mm], min, %	20	
Elongation in 2 in. [50 mm], min, %	21 ^B	

A See the Orientation subsection in the Tension Tests section of Specification A6/A6M.

5. Bearing Plates

- 5.1 Unless otherwise specified, plates used as bearing plates for bridges shall be subjected to mechanical tests and shall conform to the tensile requirements of Section 8.
- 5.2 Unless otherwise specified, mechanical tests shall not be required for plates over 1½ in. [40 mm] in thickness used as bearing plates in structures other than bridges, subject to the requirement that they shall contain 0.20 to 0.33 % carbon by heat analysis, that the chemical composition shall conform to the requirements of Table 3 in phosphorus and sulfur content, and that a sufficient discard shall be made to secure sound plates.

6. Materials and Manufacture

6.1 The steel shall be killed.

7. Chemical Composition

- 7.1 The heat analysis shall conform to the requirements prescribed in Table 3, except as specified in 5.2.
- 7.2 The steel shall conform on product analysis to the requirements prescribed in Table 3, subject to the product analysis tolerances in Specification A6/A6M.

8. Tension Test

- 8.1 The material as represented by the test specimen, except as specified in 5.2 and 8.2, shall conform to the requirements as to the tensile properties prescribed in Table 2.
- 8.2 Shapes less than 1 in.² [645 mm²] in cross section and bars, other than flats, less than ½ in. [12.5 mm] in thickness or diameter need not be subjected to tension tests by the manufacturer, provided that the chemical composition used is appropriate for obtaining the tensile properties in Table 2.

9. Keywords

9.1 bars; bolted construction; bridges; buildings; carbon; plates; riveted construction; shapes; steel; structural steel; welded construction

^B For wide flange shapes with flange thickness over 3 in. [75 mm], the 80 ksi [550 MPa] maximum tensile strength does not apply and a minimum elongation in 2 in. [50 mm] of 19 % applies

Yield point 32 ksi [220 MPa] for plates over 8 in. [200 mm] in thickness.

^D Elongation not required to be determined for floor plate.

^E For plates wider than 24 in. [600 mm], the elongation requirement is reduced two percentage points. See the Elongation Requirement Adjustments subsection under the Tension Tests section of Specification A6/A6M.

TABLE 3 Chemical Requirements

Note 1—Where "..." appears in this table, there is no requirement. The heat analysis for manganese shall be determined and reported as described in the heat analysis section of Specification A6/A6M.

Product	Shapes ^A		Plates > 15-in. [380 mm] Width ^B			Bars; Plates ≤ 15-in. [380 mm]			Width ^B	
Thickness, in. [mm]	All	To ¾ [20], incl	Over 3/4 to 11/2 [20 to 40], incl	Over 1½ to 2½ [40 to 65], incl	Over 2½ to 4 [65 to 100], incl	Over 4 [100]	To ¾ [20], incl	Over ¾ to 1½ [20 to 40], incl	Over 1½ to 4 [100], incl	Over 4 [100]
Carbon, max, %	0.26	0.25	0.25	0.26	0.27	0.29	0.26	0.27	0.28	0.29
Manganese, %			0.80 - 1.20	0.80 - 1.20	0.85 - 1.20	0.85-1.20		0.60-0.90	0.60-0.90	0.60-0.90
Phosphorus, max, %	0.04	0.030	0.030	0.030	0.030	0.030	0.04	0.04	0.04	0.04
Sulfur, max, %	0.05	0.030	0.030	0.030	0.030	0.030	0.05	0.05	0.05	0.05
Silicon, %	0.40 max	0.40 max	0.40 max	0.15-0.40	0.15-0.40	0.15-0.40	0.40 max	0.40 max	0.40 max	0.40 max
Copper, min, % when copper steel is specified	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20

A Manganese content of 0.85-1.35 % and silicon content of 0.15-0.40 % is required for shapes with flange thickness over 3 in. [75 mm].

SUPPLEMENTARY REQUIREMENTS

These requirements shall not apply unless specified in the order.

Standardized supplementary requirements for use at the option of the purchaser are listed in Specification A6/A6M. Those that are considered suitable for use with this specification are listed by title:

S5. Charpy V-Notch Impact Test

S30. Charpy V-Notch Impact Test for Structural Shapes: Alternate Core Location

S32. Single Heat Bundles

S32.1 Bundles containing shapes or bars shall be from a single heat of steel.

^B For each reduction of 0.01 percentage point below the specified carbon maximum, an increase of 0.06 percentage point manganese above the specified maximum will be permitted, up to the maximum of 1.35 %.

SPECIFICATION FOR FERRITIC MALLEABLE IRON CASTINGS



SA-47/SA-47M

(Identical with ASTM Specification A47/A47M-99(2018) $^{\epsilon 1}$ except for the deletion of welded repair references in 11.2 and 11.3, and mandatory certification in 14.1.)

SPECIFICATION FOR FERRITIC MALLEABLE IRON CASTINGS



SA-47/SA-47M

[Identical with ASTM Specification A 47/A 47M-99(2018) $^{\epsilon l}$, except for the deletion of welded repair references in 11.2 and 11.3, and mandatory certification in 14.1.]

1. Scope

- **1.1** This specification covers ferritic malleable castings for general engineering usage at temperatures from normal ambient to approximately 400°C (750°F).
- **1.2** No precise quantitative relationship can be stated between the properties of the iron in various locations of the same casting and those of a test specimen cast from the same iron (see Appendix X1).
- 1.3 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in nonconformance with the specification.

2. Referenced Documents

- **2.1** ASTM Standards:
- A 153 Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
- A 247 Test Method for Evaluating the Microstructure of Graphite in Iron Castings
- A 644 Terminology Relating to Iron Castings
- E 8 Test Methods for Tension Testing of Metallic Materials
- E 10 Test Method for Brinell Hardness of Metallic Materials
- E 18 Test Methods for Rockwell Hardness and Rockwell Superficial Hardness of Metallic Materials
- E 140 Hardness Conversion Tables for Metals
 - **2.2** Military Standard:
- MIL-STD-129 Marking for Shipment and Storage
 - 2.3 Federal Standard:
- Fed. Std. No. 123 Marking for Domestic Shipment (Civilian Agencies)

3. Terminology

3.1 *Definitions* — Definitions for many terms common to iron are found in Terminology A 644.

4. Classification

- **4.1** Castings ordered and produced under this specification are classified under the following grades based on tests on separately cast test bars. Separately cast test bars shall be poured from the same lot of iron as the castings they represent and shall be heat treated with those castings except as provided in 7.2.3.
 - **4.1.1** *Grade 32510 [Grade 22010]:*
- **4.1.1.1** The first three digits of the grade designation indicate the minimum yield strength ($\times 100 \text{ psi [MPa]}$) and the last two digits indicate the minimum elongation (% in 2 in. [50 mm]).

5. Ordering Information

5.1 The purchase order for castings ordered under this specification shall state the specification designation, the year in which the specification was issued, and the grade of malleable iron to be supplied. Any option or special additions to the basic requirements of this specification shall be clearly and fully stipulated.

6. Chemical Composition

6.1 The chemical composition of the iron shall be such as to produce the structural and mechanical properties required by this specification.

7. Mechanical Properties

7.1 Factors influencing the properties of castings and their relationship to those of test specimens and separate test castings are discussed in Appendix X1.

7.2 Tension Test Specimens:

- **7.2.1** The tension test specimens shall be cast to the form and dimensions shown in Fig. 1 or Fig. 2, in the same kind of molding material used for the production castings. At least three such specimens shall be cast from a representative ladle of iron either from each batch-melted heat or, in continuous melting, from each 4 h pour period during which the purchaser's castings were poured, or as otherwise agreed upon between manufacturer and purchaser.
- **7.2.2** All test specimens shall be suitably identified with the designation of either the batch-melted heat or the pour period of a continuous heat.
- **7.2.3** All test specimens shall be heat treated in the same production furnaces and in the same cycles as the castings they represent. However, in those instances wherein the critical sections of the production castings differ appreciably from that of the central portion of the test specimens, the time cycle for tempering the test specimens may be altered from that of the production lot in order to obtain similar microstructures or hardness, or both, in both specimen and castings. In such cases the hardness of the specimens shall be tested and reported along with the tensile test results.
- **7.2.4** The tension test is usually performed on unmachined specimens. However, for referee work, the specimen may be machined from the standard cast bar to the dimensions shown in Fig. 3.

7.3 Tension Test Method:

- **7.3.1** The gage length of the standard tension specimen shall be 2.00 ± 0.01 in. $[50.0 \pm 0.3 \text{ mm}]$.
- **7.3.2** The diameter used to compute the cross-sectional area shall be the average between the largest and smallest diameters in that section of the 2 in. [50 mm] gage length having the smallest diameter and shall be measured to the nearest 0.001 in. [0.2 mm]. No cast bar having a mean diameter less than 0.590 in. [15.0 mm] shall be accepted for test.
- **7.3.3** After reaching a stress equivalent to approximately half of the anticipated yield stress, the speed of the moving head of the testing machine shall not exceed 0.50 in./min [12.5 mm/min] through the breaking load.
- **7.3.4** While the values for yield point and yield strength are not identical, they are sufficiently close for most applications of ferritic malleable irons to be used interchangeably. They may be determined by any of the approved techniques described in the paragraphs on Determination of Yield Strength and Yield Point of Test Methods E 8. If determined as yield strength, that stress producing an extension under load of 0.01 in. [0.25 mm] over the 2 in. [50 mm] gage length (for example, 0.5% extension) or an offset of 0.2% shall be taken as the yield stress, which shall be converted to yield strength by dividing by

the original cross-sectional area of the gage length found in accordance with 7.3.2. It shall be reported to the nearest 100 psi [MPa]. In referee work, yield strength shall be determined as the stress that produces an extension under load of 0.5% of the gage length.

- **7.3.5** The tensile strength shall be the maximum load carried by the specimen during the test divided by the original cross-sectional area of the gage length, as found in accordance with 7.3.2. It shall be reported to the nearest 100 psi [MPa].
- **7.3.6** The elongation is the increase in gage length after fracture of a tensile specimen, measured to the nearest 0.01 in. [0.25 mm], expressed as a percentage of the original gage length. It shall be reported to the nearest 0.5%.

7.4 Retesting:

- **7.4.1** If, after testing, a specimen shows evidence of a defect, another tension test may be made on a companion specimen. Also, a retest shall be permitted whenever fracture occurs outside the central 50% of the gage length.
- **7.4.2** If the results of a valid test fail to conform to the requirements of this specification, two retests shall be made. If either retest fails to meet the specification, the castings represented by these test specimens shall be rejected. A valid test is one wherein the test specimen has been properly prepared and appears to be sound and on which the approved test procedure has been followed.
- **7.4.3** If sufficient companion test bars are unavailable, the manufacturer shall have the option of testing a specimen cut from a representative casting. Therefore, as stated in X1.3, the mechanical properties of such tension test specimen removed from a production casting will not necessarily correspond to those of a standard separately cast test specimen, the values in Table 1 do not apply. Instead, the mechanical properties of the test specimen from the casting must equal or exceed the average of those from similar test specimens removed from the same location from two castings of the same design where separately cast test bars meet the requirements of Table 1.
- **7.4.4** If the first test results indicate that a reheat treatment is needed to meet the test requirements, the entire lot of castings and the representative test specimens shall be reheat treated together. Testing shall then be repeated in accordance with 7.4.1–7.4.3.
- **7.4.5** The results of all tests, including retests, shall be posted in permanent record, which shall state any abnormalities observed during the test and in the fractured ends. Such records shall be kept for at least 1 year after shipment of the production castings and shall be available for examination by the purchaser or by his authorized representative.
- **7.4.6** If not covered in the purchase agreement, the frequency of tension testing shall be in accordance with 7.2.1 and sufficiently often to ensure uniformity of product and compliance with minimum test requirements.

- **7.4.7** Tension test results, obtained in accordance with the above subsections, must conform to the values of Table 1 for acceptance under this specification except as provided in 7.4.3.
- **7.4.8** When agreed upon between manufacturer and purchaser, tested specimens or unbroken test bars shall be preserved by the manufacturer for a period of three months after the date of the test report.
- **7.5** Hardness Test If the purchase agreement requires hardness testing, the acceptable hardness range shall be stated and a test location clearly shown on the covering drawing(s).
- **7.5.1** *Hardness Test Method* The Brinell method of hardness testing in accordance with Test Method E 10 shall be employed whenever possible.
- **7.5.2** For castings of such size or shape that do not permit Brinell testing with the standard 3000-kgf load, the 500 kgf may be employed, the hardness number being reported as HB 10/500/15. In very unusual cases where it is impossible to use the Brinell method, the Rockwell test may be substituted, using Test Methods E 18 with an appropriate Rockwell scale. Conversions of hardness values from one method to another according to Standard E 140, which does not specifically cover cast irons, are approximate only and, therefore, are generally inadvisable.
- **7.5.3** Sufficient material shall be removed from the cast surface to ensure that the measured surface is representative.
- **7.5.4** Sampling procedures and the frequency of hardness testing shall be fully detailed on the purchase agreement. Otherwise, hardness tests shall be performed at the discretion of the producer.
- **7.5.5** Castings failing to conform to the required hardness range may be reheat treated and retested. If after reheat treating they still fail the hardness requirements, they shall be rejected.
- **7.5.6** Typical hardness maximums for this grade of malleable iron are listed in Table 2.

8. Microstructure Requirements

- **8.1** The microstructure of the malleable iron shall consist of temper carbon nodules distributed through a ferritic matrix and shall be free of excessive pearlite, massive carbides, and primary graphite.
- **8.2** When agreed upon by the purchaser and producer, the maximum decarburization at any as-cast surface after heat treatment may be stipulated in writing, as measured by visual depletion of combined carbon after polishing, etching in nital, and viewing at 100×.

8.3 In reference work, the metallographic practice recommended in Test Method A 247 shall be followed.

9. Soundness Requirements

- **9.1** All castings, on visual examination, shall be sound and free of obvious shrinkage and porosity.
- **9.2** If the purchaser requires soundness tests to be performed, it shall be so stated in the purchase agreement, and the method and soundness requirements shall be detailed.

10. Dimensional Requirements

10.1 The castings shall conform to the dimensions given on drawings furnished by the purchaser, or to the dimensions established by the pattern equipment supplied by the purchaser, or as agreed upon in specific cases to gages supplied by the purchaser. Variations in any solid dimensions will be permitted, as shown in Table 3, unless otherwise agreed upon by the foundry and purchaser.

11. Workmanship, Finish and Appearance

- 11.1 The surface of the casting shall be inspected visually, particularly in critical areas, for such surface defects as cracks, hot tears, adhering sand and scale, cold shuts, and gas holes.
- 11.2 No repairing or plugging of any kind shall be permitted unless written permission is granted by the purchaser. Welding or brazing is not permitted under any circumstances.

11.3 DELETED

12. Responsibility for Inspection

- 12.1 Unless otherwise specified in the contract or purchase order, the manufacturer shall be responsible for carrying out all the tests and inspections required by this specification, using his own or other reliable facilities, and he shall maintain complete records of all such tests and inspections. Such records shall be available for review by the purchaser.
- **12.2** The purchaser reserves the right to perform any inspection set forth in the specification where such inspections are deemed necessary to ensure that supplies and services conform to the prescribed requirements.

13. Rejection and Rehearing

13.1 Any casting or lot of castings failing to comply with the requirements of this specification may, where possible, be reprocessed, retested, and reinspected. If the

tests and inspections on the reprocessed casting(s) show compliance with this specification, the castings shall be acceptable; if they do not, they shall be rejected.

13.2 If the purchaser should find that a casting or lot of castings fails to comply with this specification subsequent to receipt at his facility, he shall so notify the manufacturer promptly and in no case later than six weeks after receipt of the shipment, stating clearly his basis for rejection. In case of dissatisfaction with the purchaser's claim, the manufacturer may apply for a hearing before final rejection of the shipment.

14. Certification

14.1 A manufacturer's certification or compliance statement that the casting or lot of castings was made, sampled, tested, and inspected in accordance with this specification, including a report of test results signed by an authorized agent of the manufacturer, shall be furnished at the time of shipment, and such certification or compliance statement shall be the basis for acceptance of the casting or lot of castings.

TABLE 1
TENSION TEST REQUIREMENTS

Inch-Pound Grades

English Grade	Tensile Strength, min, psi	Yield Strength, min, psi	Elongation in 2 in., min, %
32510	50 000	32 500	10
	M	etric Grades	
Metric Grade	Tensile Strength, min, MPa	Yield Strength, min, MPa	Elongation in 50 mm, min, %
22010	340	220	10

15. Product Marking

15.1 When the size of the casting permits, each casting shall bear the identifying mark of the manufacturer and the part or pattern number at a location shown on the covering drawing and, if not shown on the drawing, at such a location at the discretion of the producer that the identification will not interfere with subsequent processing and service of the casting.

16. Packaging and Package Marking

16.1 Unless otherwise stated in the contract or order, the cleaning, preservation, and packing of castings for shipment shall be in accordance with the manufacturer's commercial practice. Packaging and marking shall also be adequate to identify the contents and to ensure acceptance and safe delivery by the carrier for the mode of transportation employed.

16.2 *U.S. Government Procurement* — When specified in the contract or purchase order, marking for shipment shall be in accordance with the requirements of Fed. Std. No. 123 and MIL-STD-129.

TABLE 2 TYPICAL HARDNESS

Inch-Pound Grade [Metric Grade]	Hardness, Maximum HB	Indentation Value Diameters, mm
325 10 [22010]	156	4.8

TABLE 3
PERMISSIBLE VARIATION IN ANY
SOLID DIMENSION

Size, in. [mm]	Tolerance, ± in. [mm]
Up to 1 [Up to 25]	0.03 [0.8]
1 to 6 [25 to 150]	0.06 [1.6]
6 to 12 [151 to 300]	0.12 [3.2]
12 to 18 [301 to 460]	0.15 [3.8]
18 to 24 [461 to 600]	0.19 [4.8]
24 to 36 [601 to 900]	0.22 [5.6]

FIG. 1 TENSION TEST SPECIMEN


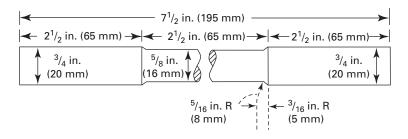



FIG. 2 ALTERNATIVE UNMACHINED TENSION TEST SPECIMEN

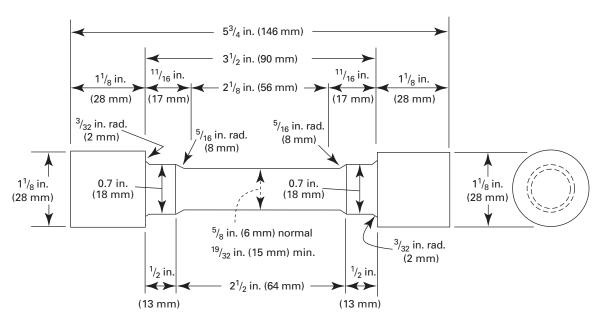

NOTE 1 - Modifications may be made in the dimensions indicated above for those details of the specimen outside of the gage length as required by testing procedure and equipment.

FIG. 3 MACHINED TENSION TEST SPECIMEN

Minimum radius recommended $^{3}/_{8}$ in. (10 mm), but not less than $^{1}/_{8}$ in. (3 mm) permitted.

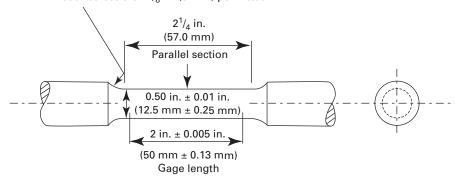

NOTE 1 — The gage length and fillets shall be as shown, but the ends may be of any shape to fit the holders of the testing machine in such a way that the load shall be axial. The reduced section shall have a gradual taper from the ends toward the center, with the ends 0.003 to 0.005 in. [0.08 to 0.13 mm] larger in diameter than the center.

SUPPLEMENTARY REQUIREMENTS

S1. Special Conditions

S1.1 If agreed upon in writing by the foundry and purchaser, the malleable iron castings may be required to meet special conditions, hardness or other property dimensions, surface quality, or a combination of conditions.

S2. Test Lugs

S2.1 If requested in writing or if included on the pattern(s) or pattern drawing(s), test lugs may be cast on all castings of sufficient size to permit their incorporation. The size of such lugs shall be proportional to the thickness of the casting. On castings over 24 in. [600 mm] in length, a test lug shall be cast near each end such as not to interfere with any subsequent processing of the castings. The purchase order shall stipulate whether the foundry's inspector or the purchaser's inspector shall break, inspect, and pass judgment on the fracture quality of these test lugs.

S3. Destructive Tests

S3.1 At the option of the purchaser or his representative, a casting of each design ordered may be tested to destruction, or otherwise broken up, to determine the presence of any manufacturing condition that might be detrimental to the serviceability of the casting.

S4. Special Tension Specimens

S4.1 If tension specimens are to be machined from castings, their location in the casting, the specimen dimensions, and the required properties shall be agreed upon in writing by the foundry and purchaser.

S5. Zinc-Coated Castings

S5.1 When specified in the contract or purchase order, castings shall be zinc-coated by the hot-dip process in accordance with Specification A 153. Castings shall be of a composition that will preclude the possibility of galvanizing embrittlement, or shall be either cooled from the anneal or subsequently heat treated so as to be immunized against such embrittlement. If regalvanizing is required, procedures for regalvanizing castings and determining the effect on the casting performance must be agreed upon between the purchaser and the seller.

S6. Marking of Casting for Government Procurement

S6.1 When castings are specified for government procurement, the location of the permanent markings specified in 15.1, as well as any special marking for mechanical or physical properties (either permanent or temporary), shall be as indicated on the government drawings or sketches.

APPENDIX

(Nonmandatory Information)

X1. MECHANICAL PROPERTIES OF CASTINGS

- **X1.1** The mechanical properties of malleable iron castings are influenced by a number of factors, including the cooling rate during solidification, chemical composition, the heat treatment, the design of the casting, section thickness, and the location and effectiveness of gates, risers, and chills.
- **X1.2** Because of the complexity of these factors in influencing the properties of the final product, no precise quantitative relationship can be stated between the properties of the iron in various locations of the same casting or between the properties of a casting and those of a test specimen cast from the same iron. When such a relationship is important and must be known for a specific application, it may be determined by appropriate experimentation.
- **X1.3** The specimen specified in 7.2.1 as the standard tensile test bar for malleable iron has a $\frac{5}{8}$ in. [16 mm] diameter test section that reasonably represents a typical

section of the general run of malleable iron castings. Furthermore, the initial freezing of malleable irons as homogeneous white iron, together with the heat treatment that is inherent in the manufacture of malleable iron, tends to reduce the section-sensitivity effect. Therefore, where experimentation into precise properties within a given casting would be infeasible, this standard test bar, made like any typical casting, should provide a practical approximation of the properties that can be expected in average sound malleable iron casting.

X1.4 If malleable iron castings are welded, the microstructure of the iron is markedly affected, particularly in the heat-affected zone. Therefore, since this may adversely affect the properties of the casting, the welding of malleable iron castings should be done under strict metallurgical control, followed by appropriate post-weld heat treatment, to minimize the substantial reductions in ductility, impact resistance, and machinability that could result, particularly in the vicinity of the weldment. Nevertheless, it is generally considered inadvisable to join castings to similar castings or to other materials, by fusion welding out in the field, or in manufactured assemblies, without fully testing the entire completed part.



SPECIFICATION FOR PIPE, STEEL, BLACK AND HOT-DIPPED, ZINC-COATED, WELDED AND SEAMLESS



SA-53/SA-53M



(23)

(Identical with ASTM Specification A53/A53M-20.)

Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless

1. Scope

1.1 This specification covers seamless and welded black and hot-dipped galvanized steel pipe in NPS ½ to NPS 26 [DN 6 to DN 650] (Note 1), inclusive, with nominal wall thickness (Note 2) as given in Table X2.2 and Table X2.3. It shall be permissible to furnish pipe having other dimensions provided that such pipe complies with all other requirements of this specification. Supplementary requirements of an optional nature are provided and shall apply only when specified by the purchaser.

Note 1—The dimensionless designators NPS (nominal pipe size) [DN (diameter nominal)] have been substituted in this specification for such traditional terms as "nominal diameter," "size," and "nominal size." Note 2—The term nominal wall thickness has been assigned for the

Note 2—The term nominal wall thickness has been assigned for the purpose of convenient designation, existing in name only, and is used to distinguish it from the actual wall thickness, which may vary over or under the nominal wall thickness.

- 1.2 This specification covers the following types and grades:
- 1.2.1 *Type F*—Furnace-butt-welded, continuous welded Grade A.
- 1.2.2 Type E—Electric-resistance-welded, Grades A and B, and
 - 1.2.3 Type S—Seamless, Grades A and B.

Note 3—See Appendix X1 for definitions of types of pipe.

- 1.3 Pipe ordered under this specification is intended for mechanical and pressure applications and is also acceptable for ordinary uses in steam, water, gas, and air lines. It is suitable for welding, and suitable for forming operations involving coiling, bending, and flanging, subject to the following qualifications:
 - 1.3.1 Type F is not intended for flanging.

- 1.3.2 If Type S or Type E is required for close coiling or cold bending, Grade A is the preferred grade; however, this is not intended to prohibit the cold bending of Grade B pipe.
- 1.3.3 Type E is furnished either nonexpanded or cold expanded at the option of the manufacturer.
- 1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.5 The following precautionary caveat pertains only to the test method portion, Sections 7, 8, 9, 13, 14, and 15 of this specification: This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory requirements prior to use.
- 1.6 The text of this specification contains notes or footnotes, or both, that provide explanatory material. Such notes and footnotes, excluding those in tables and figures, do not contain any mandatory requirements.
- 1.7 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A90/A90M Test Method for Weight [Mass] of Coating on Iron and Steel Articles with Zinc or Zinc-Alloy Coatings A370 Test Methods and Definitions for Mechanical Testing of Steel Products

- A530/A530M Specification for General Requirements for Specialized Carbon and Alloy Steel Pipe
- A700 Guide for Packaging, Marking, and Loading Methods for Steel Products for Shipment
- A751 Test Methods and Practices for Chemical Analysis of Steel Products
- A865/A865M Specification for Threaded Couplings, Steel, Black or Zinc-Coated (Galvanized) Welded or Seamless, for Use in Steel Pipe Joints

B6 Specification for Zinc

- E29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications
- E213 Practice for Ultrasonic Testing of Metal Pipe and Tubing
- E273 Practice for Ultrasonic Testing of the Weld Zone of Welded Pipe and Tubing
- E309 Practice for Eddy Current Examination of Steel Tubular Products Using Magnetic Saturation
- E570 Practice for Flux Leakage Examination of Ferromagnetic Steel Tubular Products
- E1806 Practice for Sampling Steel and Iron for Determination of Chemical Composition
- 2.2 ANSI Standards:

ASC X12

- B1.20.1 Pipe Threads, General Purpose
- 2.3 ASME Standard:
- B36.10M Welded and Seamless Wrought Steel Pipe
- 2.4 Military Standards:
- MIL-STD-129 Marking for Shipment and Storage
- MIL-STD-163 Steel Mill Products Preparation for Shipment and Storage
- 2.5 Federal Standards:
- Fed. Std. No. 123 Marking for Shipment (Civil Agencies)Fed. Std. No. 183 Continuous Identification Marking of Iron and Steel Products
- 2.6 API Standard:
- 5B Specification for Threading, Gauging, and Thread Inspection of Casing, Tubing, and Line Pipe Threads

3. Ordering Information

- 3.1 Information items to be considered, if appropriate, for inclusion in the purchase order are as follows:
- 3.1.1 Specification designation (A53 or A53M, including year-date),
 - 3.1.2 Quantity (feet, metres, or number of lengths),
 - 3.1.3 Grade (A or B),
 - 3.1.4 Type (F, E, or S; see 1.2),
 - 3.1.5 Finish (black or galvanized),

- 3.1.6 Size (either nominal (NPS) [DN] and weight class or schedule number, or both; or outside diameter and wall thickness, see Table X2.2 and Table X2.3),
 - 3.1.7 Length (specific or random, see Section 16),
 - 3.1.8 End finish (plain end or threaded, Section 11),
 - 3.1.8.1 Threaded and coupled, if desired,
 - 3.1.8.2 Threads only (no couplings), if desired,
 - 3.1.8.3 Plain end, if desired,
 - 3.1.8.4 Couplings power tight, if desired,
- 3.1.8.5 Taper-tapped couplings for NPS 2 [DN 50] and smaller, if desired,
 - 3.1.9 Close coiling, if desired (see 7.2.2),
- 3.1.10 Nondestructive electric test for seamless pipe (see 9.2).
 - 3.1.11 Certification (see Section 20),
- 3.1.12 Report of the length of the end effect, if desired (see 9.2.7).
 - 3.1.13 Marking (see Section 21),
 - 3.1.14 End use of pipe,
 - 3.1.15 Special requirements,
 - 3.1.16 Supplementary requirements, if any,
- 3.1.17 Selection of applicable level of preservation and packaging and level of packing required, if other than as specified or if MIL-STD-163 applies (see 22.1), and
- 3.1.18 Packaging and package marking, if desired (see 23.1).

4. Materials and Manufacture

- 4.1 The steel for both seamless and welded pipe shall be made by one or more of the following processes: open-hearth, electric-furnace, or basic-oxygen.
- 4.2 If steels of different grades are sequentially strand cast, identification of the resultant transition material is required. The steel producer shall remove the transition material by any established procedure that positively separates the grades.
- 4.3 The weld seam of electric-resistance welded pipe in Grade B shall be heat treated after welding to a minimum of 1000 °F [540 °C] so that no untempered martensite remains, or otherwise processed in such a manner that no untempered martensite remains.
- 4.4 When pipe is cold expanded, the amount of expansion shall not exceed $1\frac{1}{2}$ % of the specified outside diameter of the pipe.

5. Chemical Composition

5.1 The steel shall conform to the requirements as to chemical composition given in Table 1 and the chemical analysis shall be in accordance with Test Methods, Practices, and Terminology A751.

6. Product Analysis

6.1 The purchaser is permitted to perform an analysis of two pipes from each lot of 500 lengths, or fraction thereof. Samples for chemical analysis, except for spectrographic analysis, shall be taken in accordance with Practice E1806. The chemical composition thus determined shall conform to the requirements given in Table 1.

TABLE 1 Chemical Requirements

					Composition, n	nax, %			
	Carbon	Manganese	Phosphorus	Sulfur	Copper ^A	Nickel ^A	Chromium ^A	Molybdenum ^A	Vanadium ^A
			Туре	S (seamles	s pipe)				
Grade A	0.25 ^B	0.95	0.05	0.045	0.40	0.40	0.40	0.15	0.08
Grade B	0.30 ^C	1.20	0.05	0.045	0.40	0.40	0.40	0.15	0.08
			Type E (e	lectric-resista	ince-welded)				
Grade A	0.25 ^B	0.95	0.05	0.045	0.40	0.40	0.40	0.15	0.08
Grade B	0.30 ^C	1.20	0.05	0.045	0.40	0.40	0.40	0.15	0.08
Type F (furnace-welded pipe)									
Grade A	0.30 ^B	1.20	0.05	0.045	0.40	0.40	0.40	0.15	0.08

^A The total composition for these five elements shall not exceed 1.00 %.

6.2 If the analysis of either pipe does not conform to the requirements given in Table 1, analyses shall be made on additional pipes of double the original number from the same lot, each of which shall conform to the specified requirements.

7. Mechanical Properties

7.1 Tension Test:

7.1.1 For tension tests other than transverse weld tension tests, the yield strength corresponding to a permanent offset of 0.2% of the gage length or to an extension of 0.5% of the gage length under load, the tensile strength, and the elongation in 2 in. or 50 mm shall be determined, and the tension test results shall conform to the applicable tensile property requirements given in Table 2.

7.1.2 For transverse weld tension tests, the tensile strength shall be determined, and the tension test results shall conform to the applicable tensile strength requirement given in Table 2.

7.1.3 Electric-resistance-welded pipe NPS 8 [DN 200] or larger shall be tested using two transverse test specimens, one taken across the weld and one taken opposite the weld.

7.1.4 Transverse tension test specimens shall be approximately $1\frac{1}{2}$ in. [38 mm] wide in the gage length and shall represent the full wall thickness of the pipe from which the test specimens were cut.

TABLE 2 Tensile Requirements

	Grade A	Grade B
Tensile strength, min, psi [MPa]	48 000 [330]	60 000 [415]
Yield strength, min, psi [MPa]	30 000 [205]	35 000 [240]
Elongation in 2 in, or 50 mm	A,B	A,B

 $^{^{\}rm A}\,{\rm The}$ minimum elongation in 2 in. [50 mm] shall be that determined by the following equation:

 $e = 625000 [1940] A^{0.2}/U^{0.9}$

where:

e = minimum elongation in 2 in. or 50 mm in percent, rounded to the nearest percent,

A = the lesser of 0.75 in.² [500 mm²] and the cross-sectional area of the tension test specimen, calculated using the specified outside diameter of the pipe, or the nominal width of the tension test specimen and the specified wall thickness of the pipe, with the calculated value rounded to the nearest 0.01 in.² [1 mm²], and

U = specified minimum tensile strength, psi [MPa].

^BSee Table X4.1 or Table X4.2, whichever is applicable, for the minimum elongation values that are required for various combinations of tension test specimen size and specified minimum tensile strength.

7.2 Bend Test:

7.2.1 For pipe NPS 2 [DN 50] or smaller, a sufficient length of pipe shall be capable of being bent cold through 90° around a cylindrical mandrel, the diameter of which is twelve times the specified outside diameter of the pipe, without developing cracks at any portion and without opening the weld.

7.2.2 If ordered for close coiling, the pipe shall stand being bent cold through 180° around a cylindrical mandrel, the diameter of which is eight times the specified outside diameter of the pipe, without failure.

7.2.3 Double-extra-strong pipe over NPS 1½ [DN 32] need not be subjected to the bend test.

7.3 Flattening Test:

7.3.1 The flattening test shall be made on welded pipe over NPS 2 [DN 50] in extra-strong weight or lighter.

7.3.2 Seamless Pipe:

7.3.2.1 Although testing is not required, pipe shall be capable of meeting the flattening test requirements of Supplementary Requirement S1, if tested.

7.3.3 Electric-Resistance-Welded Pipe:

7.3.3.1 A test specimen at least 4 in. [100 mm] in length shall be flattened cold between parallel plates in three steps, with the weld located either 0° or 90° from the line of direction of force as required by 7.3.3.2 or 7.3.3.3, whichever is applicable. During the first step, which is a test for ductility of the weld, except as allowed by 7.3.5, 7.3.6, and 7.3.7, no cracks or breaks on the inside or outside surface at the weld shall be present before the distance between the plates is less than two thirds of the specified outside diameter of the pipe. As a second step, the flattening shall be continued as a test for ductility away from the weld. During the second step, except as allowed by 7.3.6 and 7.3.7, no cracks or breaks on the inside or outside surface away from the weld shall be present before the distance between the plates is less than one third of the specified outside diameter of the pipe but is not less than five times the specified wall thickness of the pipe. During the third step, which is a test for soundness, the flattening shall be continued until the test specimen breaks or the opposite walls of the test specimen meet. Evidence of laminated or unsound material or of incomplete weld that is revealed by the flattening test shall be cause for rejection.

7.3.3.2 For pipe produced in single lengths, the flattening test specified in 7.3.3.1 shall be made using a test specimen

^BFor each reduction of 0.01 % below the specified carbon maximum, an increase of 0.06 % manganese above the specified maximum will be permitted up to a maximum of 1.35 %.

^CFor each reduction of 0.01 % below the specified carbon maximum, an increase of 0.06 % manganese above the specified maximum will be permitted up to a maximum of 1.65 %.

taken from each end of each length of pipe. The tests from each end shall be made alternately with the weld at 0° and at 90° from the line of direction of force.

- 7.3.3.3 For pipe produced in multiple lengths, the flattening test specified in 7.3.3.1 shall be made as follows:
- (1) Test specimens taken from, and representative of, the front end of the first pipe intended to be supplied from each coil, the back end of the last pipe intended to be supplied from each coil, and each side of any intermediate weld stop location shall be flattened with the weld located at 90° from the line of direction of force.
- (2) Test specimens taken from pipe at any two locations intermediate to the front end of the first pipe and the back end of the last pipe intended to be supplied from each coil shall be flattened with the weld located at 0° from the line of direction of force.
- 7.3.3.4 For pipe that is to be subsequently reheated throughout its cross section and hot formed by a reducing process, the manufacturer shall have the option of obtaining the flattening test specimens required by 7.3.3.2 or 7.3.3.3, whichever is applicable, either prior to or after such hot reducing.
- 7.3.4 Continuous-Welded Pipe—A test specimen at least 4 in. [100 mm] in length shall be flattened cold between parallel plates in three steps. The weld shall be located at 90° from the line of direction of force. During the first step, which is a test for ductility of the weld, except as allowed by 7.3.5, 7.3.6, and 7.3.7, no cracks or breaks on the inside, outside, or end surfaces at the weld shall be present before the distance between the plates is less than three fourths of the specified outside diameter of the pipe. As a second step, the flattening shall be continued as a test for ductility away from the weld. During the second step, except as allowed by 7.3.6 and 7.3.7, no cracks or breaks on the inside, outside, or end surfaces away from the weld shall be present before the distance between the plates is less than 60 % of the specified outside diameter of the pipe. During the third step, which is a test for soundness, the flattening shall be continued until the test specimen breaks or the opposite walls of the test specimen meet. Evidence of laminated or unsound material or of incomplete weld that is revealed by the flattening test shall be cause for rejection.
- 7.3.5 Surface imperfections in the test specimen before flattening, but revealed during the first step of the flattening test, shall be judged in accordance with the finish requirements in Section 12.
- 7.3.6 Superficial ruptures as a result of surface imperfections shall not be cause for rejection.
- 7.3.7 For pipe with a *D*-to-*t* ratio less than 10, because the strain imposed due to geometry is unreasonably high on the inside surface at the 6 and 12 o'clock locations, cracks at such locations shall not be cause for rejection.

8. Hydrostatic Test

- 8.1 The hydrostatic test shall be applied, without leakage through the weld seam or the pipe body.
- 8.2 Plain-end pipe shall be hydrostatically tested to the applicable pressure given in Table X2.2, and threaded-and-coupled pipe shall be hydrostatically tested to the applicable pressure given in Table X2.3. It shall be permissible, at the

discretion of the manufacturer, to perform the hydrostatic test on pipe with plain ends, with threads only, or with threads and couplings; and it shall also be permissible to test pipe in either single lengths or multiple lengths.

Note 4—The hydrostatic test pressures given herein are inspection test pressures, are not intended as a basis for design, and do not have any direct relationship to working pressures.

8.3 The minimum hydrostatic test pressure required to satisfy the requirements specified in 8.2 need not exceed 2500 psi [17 200 kPa] for pipe NPS 3 [DN 80] or smaller, or 2800 psi [19 300 kPa] for pipe larger than NPS 3 [DN 80]; however, the manufacturer has the option of using higher test pressures. For all sizes of seamless pipe and electric-resistance-welded pipe, the hydrostatic test pressure shall be maintained for at least 5 s.

9. Nondestructive Electric Test

- 9.1 Type E Pipe:
- 9.1.1 Except for pipe produced on a hot-stretch reducing mill, the weld seam of each length of electric-resistance-welded pipe NPS 2 [DN 50] or larger shall be tested with a nondestructive electric test in accordance with Practices E213, E273, E309, or E570. Each length of electric-resistance-welded pipe NPS 2 [DN 50] or larger and produced on a hot-stretch-reducing mill shall be tested with a nondestructive electric test that inpsects the full volume of the pipe in accordance with Practices E213, E309, or E570.
- 9.1.2 Ultrasonic and Electromagnetic Inspection—Any equipment utilizing the ultrasonic or electromagnetic principles and capable of continuous and uninterrupted inspection of the weld seam shall be used. The equipment shall be checked with an applicable reference standard as described in 9.1.3 at least once every working turn or not more than 8 h to demonstrate its effectiveness and the inspection procedures. The equipment shall be adjusted to produce well-defined indications when the reference standard is scanned by the inspection unit in a manner simulating the inspection of the product.
- 9.1.3 Reference Standards—The length of the reference standards shall be determined by the pipe manufacturer, and they shall have the same specified diameter and thickness as the product being inspected. Reference standards shall contain machined notches, one on the inside surface and one on the outside surface, or a drilled hole, as shown in Fig. 1, at the option of the pipe manufacturer. The notches shall be parallel to the weld seam, and shall be separated by a distance sufficient to produce two separate and distinguishable signals. The ½-in. [3.2-mm] hole shall be drilled through the wall and perpendicular to the surface of the reference standard as shown in Fig. 1. Care shall be taken in the preparation of the reference standard to ensure freedom from fins or other edge roughness, or distortion of the pipe.
- Note 5—The calibration standards shown in Fig. 1 are convenient standards for calibration of nondestructive testing equipment. The dimensions of such standards are not to be construed as the minimum sizes of imperfections detectable by such equipment.
- 9.1.4 Acceptance Limits—Table 3 gives the height of acceptance limit signals in percent of the height of signals produced by reference standards. Imperfections in the weld seam that

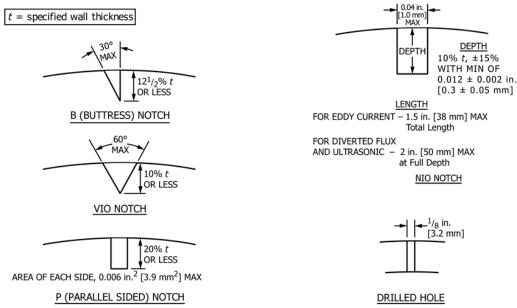


FIG. 1 Calibration Standards

TABLE 3 Acceptance Limits

Type Notch	Size	Acceptance		
	in.	mm	Limit Signal, %	
N10, V10	1/8	3.2	100	
B, P			80	

produce a signal greater than the acceptance limit signal given in Table 3 shall be considered a defect unless the pipe manufacturer can demonstrate that the imperfection does not reduce the effective wall thickness beyond 12.5 % of the specified wall thickness.

- 9.2 Type S Pipe—As an alternative to the hydrostatic test at the option of the manufacturer or if specified in the purchase order, the full body of each seamless pipe shall be tested with a nondestructive electric test in accordance with Practice E213, E309, or E570. In such cases, each length so furnished shall include the mandatory marking of the letters "NDE." Except as allowed by 9.2.6.2, it is the intent of this nondestructive electric test to reject pipe with imperfections that produce test signals equal to or greater than those produced by the applicable calibration standards.
- 9.2.1 If the nondestructive electric test has been performed, the lengths shall be marked with the letters "NDE." The certification, if required, shall state Nondestructive Electric Tested and shall indicate which of the tests was applied. Also, the letters NDE shall be appended to the product specification number and grade shown on the certification.
- 9.2.2 The following information is intended to facilitate the use of this specification:
- 9.2.2.1 The calibration standards defined in 9.2.3 through 9.2.5 are convenient standards for calibration of nondestructive testing equipment. The dimensions of such standards are not to be construed as the minimum sizes of imperfections detectable by such equipment.

- 9.2.2.2 The ultrasonic testing referred to in this specification is capable of detecting the presence and location of significant longitudinally or circumferentially oriented imperfections; however, different techniques need to be employed for the detection of differently oriented imperfections. Ultrasonic testing is not necessarily capable of detecting short, deep imperfections.
- 9.2.2.3 The eddy current examination referenced in this specification has the capability of detecting significant discontinuities, especially of the short abrupt type.
- 9.2.2.4 The flux leakage examination referred to in this specification is capable of detecting the presence and location of significant longitudinally or transversely oriented discontinuities. The provisions of this specification only require longitudinal calibration for flux leakage. Different techniques need to be employed for the detection of differently oriented imperfections.
- 9.2.2.5 The hydrostatic test referred to in 8.2 has the capability of finding imperfections of a size permitting the test fluid to leak through the tube wall and may be either visually seen or detected by a loss of pressure. Hydrostatic testing is not necessarily capable of detecting very tight through-the-wall imperfections or imperfections that extend an appreciable distance into the wall without complete penetration.
- 9.2.2.6 A purchaser interested in ascertaining the nature (type, size, location, and orientation) of imperfections that are capable of being detected in the specific application of these examinations is directed to discuss this with the manufacturer of the tubular product.
- 9.2.3 For ultrasonic testing, the calibration reference notches shall be at the option of the manufacturer, and shall be any one of the three common notch shapes shown in Practice E213. The depth of notch shall not exceed 12.5 % of the specified wall thickness of the pipe or 0.004 in. [0.1 mm], whichever is the greater.

- 9.2.4 For eddy current testing, the calibration pipe shall contain, at the option of the manufacturer, any one of the following calibration standards to establish a minimum sensitivity level for rejection.
- 9.2.4.1 *Drilled Hole*—The calibration pipe shall contain three holes spaced 120° apart or four holes spaced 90° apart, sufficiently separated longitudinally to ensure separately distinguishable responses. The holes shall be drilled radially and completely through the pipe wall, care being taken to avoid distortion of the pipe while drilling. Dependent upon the nominal pipe size, the calibration pipe shall contain the following hole:

NPS	DN	Diameter of Drilled Hole
≤ ½	≤ 15	0.039 in. [1.0 mm]
> ½ ≤ 1¼	> 15 ≤ 32	0.055 in. [1.4 mm]
> 1½ ≤ 2	> 32 ≤ 50	0.071 in. [1.8 mm]
> 2 ≤ 5	> 50 ≤ 125	0.087 in. [2.2 mm]
> 5	> 125	0.106 in. [2.7 mm]

- 9.2.4.2 *Transverse Tangential Notch*—Using a round tool or file with a ½ in. [6 mm] diameter, a notch shall be filed or milled tangential to the surface and transverse to the longitudinal axis of the pipe. The notch shall have a depth not exceeding 12.5 % of the specified wall thickness of the pipe or 0.012 in. [0.3 mm], whichever is the greater.
- 9.2.4.3 Longitudinal Notch—A notch 0.031 in. [0.8 mm] or less in width shall be machined in a radial plane parallel to the pipe axis on the outside surface of the pipe, to a depth not exceeding 12.5 % of the specified wall thickness of the pipe or 0.012 in. [0.3 mm], whichever is the greater. The length of the notch shall be compatible with the testing method.
- 9.2.4.4 *Compatibility*—The calibration standards in the calibration pipe shall be compatible with the testing equipment and the method being used.
- 9.2.5 For flux leakage testing, the longitudinal calibration reference notches shall be straight-sided notches machined in a radial plane parallel to the pipe axis. For specified wall thicknesses less than 0.500 in. [12.7 mm], outside and inside notches shall be used. For specified wall thicknesses equal to or greater than 0.500 in. [12.7 mm], only an outside notch shall be used. The notch depth shall not exceed 12.5 % of the specified wall thickness, or 0.012 in. [0.3 mm], whichever is the greater. The notch length shall not exceed 1 in. [25 mm], and the notch width shall not exceed the notch depth. Outside diameter and inside diameter notches shall be located sufficiently apart to allow separation and identification of the signals.
- 9.2.6 Pipe containing one or more imperfections that produce a signal equal to or greater than the signal produced by the calibration standard shall be rejected or the area producing the signal shall be rejected.
- 9.2.6.1 Test signals produced by imperfections that cannot be identified, or produced by cracks or crack-like imperfections, shall result in rejection of the pipe, unless it is repaired and retested. To be accepted, the pipe shall pass the same specification test to which it was originally subjected and the remaining wall thickness shall not have been decreased below that permitted by the specification. It shall be permissible to reduce the outside diameter at the point of grinding by the amount so removed.

- 9.2.6.2 It shall be permissible to evaluate test signals produced by visual imperfections in accordance with the provisions of Section 12. A few examples of such imperfections are straightener marks, cutting chips, scratches, steel die stamps, stop marks, or pipe reducer ripple.
- 9.2.7 The test methods described in Section 9 are not necessarily capable of inspecting the end portion of pipes. This condition is referred to as end effect. The length of the end effect shall be determined by the manufacturer and, if specified in the purchase order, reported to the purchaser.

10. Permissible Variations in Weight (Mass) and Dimensions

10.1 Weight (Mass)—The weight (mass) of the pipe shall not vary more than \pm 10 % from its specified weight (mass), as derived by multiplying its measured length by its specified weight (mass) per unit length, as given in Table X2.2 or Table X2.3, or as calculated using the relevant equation in ASME B36.10M.

Note 6—For pipe NPS 4 [DN 100] or smaller, the weight (mass) tolerance is applicable to the weights (masses) of the customary lifts of pipe as produced for shipment by the mill. For pipe larger than NPS 4 [DN 100], where individual lengths are weighed, the weight (mass) tolerance is applicable to the individual lengths.

- 10.2 Diameter—For pipe NPS $1\frac{1}{2}$ [DN 40] or smaller, the outside diameter at any point shall not vary more than $\pm \frac{1}{64}$ in. [0.4 mm] from the specified outside diameter. For pipe NPS 2 [DN 50] or larger, the outside diameter shall not vary more than $\pm 1\%$ from the specified outside diameter.
- 10.3 *Thickness*—The minimum wall thickness at any point shall be not more than 12.5 % under the specified wall thickness. The minimum wall thickness on inspection shall conform to the requirements given in Table X2.4.

11. End Finish

- 11.1 If ordered with plain ends, the pipe shall be furnished to the following practice, unless otherwise specified.
- 11.1.1 NPS $1^{1/2}$ [DN 40] or Smaller—Unless otherwise specified in the purchase order, end finish shall be at the option of the manufacturer.
 - 11.1.2 Larger than NPS 11/2 [DN 40]:
- 11.1.2.1 Pipe of standard-weight or extra-strong weight, or in wall thickness less than 0.500 in. [12.7 mm], other than double extra-strong weight pipe, shall be plain-end beveled with ends beveled to an angle of 30° , $+5^{\circ}$, -0° , measured from a line drawn perpendicular to the axis of the pipe, and with a root face of $\frac{1}{16}$ in. $\pm \frac{1}{32}$ in. [1.6 mm ± 0.8 mm].
- 11.1.2.2 Pipe with a specified wall thickness greater than 0.500 in. [12.7 mm], and all double extra-strong weight pipe, shall be plain-end square cut.
- 11.2 If ordered with threaded ends, the pipe ends shall be provided with a thread in accordance with the gaging practice and tolerances of ANSI B1.20.1. For standard-weight pipe NPS 6 [DN 150] or smaller, refer to Table X3.1 for threading data. For standard-weight pipe NPS 8 [DN 200] or larger and all sizes of extra-strong weight pipe and double extra-strong weight pipe, refer to Table X3.2 for threading data. Threaded

pipe NPS 4 [DN 100] or larger shall have thread protectors on the ends not protected by a coupling.

11.3 If ordered with couplings, one end of each length of pipe shall be provided with a coupling manufactured in accordance with Specification A865/A865M. The coupling threads shall be in accordance with the gaging practice of ANSI B1.20.1. The coupling shall be applied handling-tight, unless power-tight is specified in the purchase order. Couplings are to be made of steel. Taper-tapped couplings shall be furnished on all threaded pipe NPS 21/2 [DN 65] or larger. For pipe smaller than NPS 21/2 [DN 65], it is regular practice to furnish straight-tapped couplings for standard-weight pipe and tapertapped couplings for extra-strong and double extra-strong weight pipe. If taper-tapped couplings are required for standard-weight pipe smaller than NPS 2½ [DN 65], it is recommended that line pipe threads in accordance with API Specification 5B be ordered. The taper-tapped couplings provided on line pipe in such sizes may be used on mill-threaded standard-weight pipe of the same size.

12. Workmanship, Finish, and Appearance

- 12.1 The pipe manufacturer shall explore a sufficient number of visual surface imperfections to provide reasonable assurance that they have been properly evaluated with respect to depth.
- 12.2 Surface imperfections that penetrate more than 12.5 % of the specified wall thickness or encroach on the minimum wall thickness shall be considered defects. Pipe with defects shall be given one or more of the following dispositions:
- 12.2.1 The defect shall be removed by grinding, provided that the remaining wall thickness is within specified limits,
- 12.2.2 Type S pipe and the parent metal of Type E pipe, except within ½ in. [13 mm] of the fusion line of the electric-resistance-weld seam, are permitted to be repaired in accordance with the welding provisions of 12.5. Repair welding of Type F pipe and the weld seam of Type E pipe is prohibited.
- 12.2.3 The section of pipe containing the defect shall be cut off within the limits of requirement on length, or rejected.
- 12.3 At the purchaser's discretion, pipe shall be subjected to rejection if surface defects repaired in accordance with 12.2 are not scattered, but appear over a large area in excess of what is considered a workmanlike finish. Disposition of such pipe shall be a matter of agreement between the manufacturer and the purchaser.
- 12.4 For the removal of imperfections and defects by grinding, a smooth curved surface shall be maintained, and the wall thickness shall not be decreased below that permitted by this specification. It shall be permissible to reduce the outside diameter at the point of grinding by the amount so removed.
- 12.5 Weld repair shall only be permitted with the approval of the purchaser and in accordance with Specification A530/A530M.
 - 12.6 The finished pipe shall be reasonably straight.
- 12.7 The pipe shall contain no dents greater than 10 % of the pipe diameter or ½ in. [6 mm], whichever is smaller,

measured as the gap between the lowest point of the dent and a prolongation of the original contour of the pipe. Cold-formed dents deeper than ½ in. [3 mm] shall be free of sharp-bottomed gouges; it shall be permissible to remove the gouges by grinding, provided that the remaining wall thickness is within specified limits. The length of the dent in any direction shall not exceed one half the specified outside diameter of the pipe.

13. Number of Tests

- 13.1 Except as required by 13.2, one of each of the tests specified in Section 7 shall be made on test specimens taken from one length of pipe from each lot of each pipe size. For continuous-welded pipe, each lot shall contain no more than 25 tons [23 Mg] of pipe for pipe sizes NPS 1½ [DN 40] and smaller, and no more than 50 tons [45 Mg] of pipe for pipe sizes larger than NPS 1½ [DN 40]. For seamless and electric-resistance-welded pipe, a lot shall contain no more than one heat, and at the option of the manufacturer shall contain no more than 500 lengths of pipe (as initially cut after the final pipe-forming operation, prior to any further cutting to the required ordered lengths) or 50 tons [45 Mg] of pipe.
- 13.2 The number of flattening tests for electric-resistance-welded pipe shall be in accordance with 7.3.3.2 or 7.3.3.3, whichever is applicable.
- 13.3 Except as allowed by 9.2, each length of pipe shall be subjected to the hydrostatic test (see Section 8).

14. Retests

- 14.1 Except for flattening tests of electric-resistance-welded pipe, if the results of a mechanical test for a lot fail to conform to the applicable requirements specified in Section 7, the lot shall be rejected unless tests of additional pipe from the affected lot of double the number originally tested are subsequently made and each such test conforms to the specified requirements. Only one retest of any lot will be permitted. Any individual length of pipe that conforms to the test requirements is acceptable. Any individual length of pipe that does not conform to the test requirements may be resubmitted for test and will be considered acceptable if tests taken from each pipe end conform to the specified requirements.
- 14.2 Electric-Resistance-Welded Pipe Produced in Single Lengths—If any flattening test result fails to conform to the requirements specified in 7.3.3, the affected single length shall be rejected unless the failed end is subsequently retested using the same weld orientation as the failed test and a satisfactory test result is obtained before the pipe's length is reduced by such testing to less than 80 % of its length after the initial cropping.
- 14.3 Electric-Resistance-Welded Pipe Produced in Multiple Lengths—If any flattening test result fails to conform to the requirements specified in 7.3.3, the affected multiple length shall be rejected or flattening tests shall be made using a test specimen taken from each end of each individual length in the failed multiple length. For each pipe end, such tests shall be made with the weld alternately at 0° and 90° from the line of direction of force. Individual lengths are considered acceptable if the test results for both pipe ends conform to the specified requirements.

15. Test Methods

- 15.1 The test specimens and the tests required by this specification shall conform to those described in the latest issue of Test Methods and Definitions A370.
- 15.2 Each longitudinal tension test specimen shall be taken from a pipe end and shall not be flattened between the gage marks.
- 15.3 Test specimens for bend tests and flattening tests shall be taken from pipe. Test specimens for flattening tests shall be smooth on the ends and free from burrs.
 - 15.4 Tests shall be conducted at room temperature.

16. Lengths

- 16.1 Unless otherwise specified, pipe lengths shall be in accordance with the following regular practices:
- 16.1.1 Except as allowed by 16.1.2 and 16.1.4, pipe lighter than extra-strong weight shall be in single-random lengths of 16 to 22 ft [4.88 to 6.71 m], with not more than 5 % of the total number of threaded lengths furnished being jointers (two pieces coupled together).
- 16.1.2 For plain-end pipe lighter than extra-strong weight, it shall be permissible for not more than 5 % of the total number of pipe to be in lengths of 12 to 16 ft [3.66 to 4.88 m].
- 16.1.3 Pipe of extra-strong weight or heavier shall be in random lengths of 12 to 22 ft [3.66 to 6.71 m], except that it shall be permissible for not more than 5 % of the total of pipe to be in lengths of 6 to 12 ft [1.83 to 3.66 m].
- 16.1.4 For extra-strong weight or lighter pipe ordered in double-random lengths, the minimum lengths shall be not less than 22 ft [6.71 m] and the minimum average length for the order shall be not less than 35 ft [10.67 m].
- 16.1.5 For pipe heavier than extra-strong weight ordered in lengths longer than single random, the lengths shall be as agreed upon between the manufacturer and the purchaser.
- 16.1.6 If pipe is furnished threaded and coupled, the length shall be measured to the outer face of the coupling.

17. Galvanized Pipe

- 17.1 Galvanized pipe ordered under this specification shall be coated with zinc inside and outside by the hot-dip process. The zinc used for the coating shall be any grade of zinc conforming to Specification B6. The galvanized pipe shall be free from uncoated areas, blisters, flux deposits, and gross dross inclusions. Lumps, projections, globules, or heavy deposits of zinc which will interfere with the intended use of the material will not be permitted.
- 17.2 Weight (Mass) per Unit Area of Coating—The weight (mass) per unit area of zinc coating shall be not less than 1.8 oz/ft² [0.55 kg/m²] as determined from the average results of the two specimens taken for test in the manner prescribed in 17.5 and not less than 1.6 oz/ft² [0.49 kg/m²] for each of these specimens. The weight (mass) per unit area of coating, expressed in ounces per square foot [kilograms per square metre] shall be calculated by dividing the total weight (mass) of zinc, inside plus outside, by the total area, inside plus outside, of the surface coated. Each specimen shall have not less than 1.3 oz/ft² [0.40 kg/m²] of zinc coating on each surface, calculated

- by dividing the total weight (mass) of zinc on the given surface (outside or inside) by the area of the surface coated (outside or inside).
- 17.3 Weight (Mass) per Unit Area of Coating Test—The weight (mass) per unit area of zinc coating shall be determined by stripping tests in accordance with Test Method A90/A90M.
- 17.4 *Test Specimens*—Test specimens for determination of weight (mass) per unit area of coating shall be cut approximately 4 in. [100 mm] in length.
- 17.5 Number of Tests—Two test specimens for the determination of weight (mass) per unit area of coating shall be taken, one from each end of one length of galvanized pipe selected at random from each lot of 500 lengths, or fraction thereof, of each size.
- 17.6 *Retests*—If the weight (mass) per unit area of coating of any lot does not conform to the requirements specified in 17.2, retests of two additional pipes from the same lot shall be made, each of which shall conform to the specified requirements.
- 17.7 If pipe ordered under this specification is to be galvanized, the tension, flattening, and bend tests shall be made on the base material before galvanizing, if practicable. If specified, results of the mechanical tests on the base material shall be reported to the purchaser. If it is impracticable to make the mechanical tests on the base material before galvanizing, it shall be permissible to make such tests on galvanized samples, and any flaking or cracking of the zinc coating shall not be considered cause for rejection. If galvanized pipe is bent or otherwise fabricated to a degree that causes the zinc coating to stretch or compress beyond the limit of elasticity, some flaking of the coating is acceptable.

18. Inspection

18.1 The inspector representing the purchaser shall have entry, at all times while work on the contract of the purchaser is being performed, to all parts of the manufacturer's works that concern the manufacture of the pipe ordered. The manufacturer shall afford the inspector all reasonable facilities to be satisfied that the pipe is being furnished in accordance with this specification. All tests (except product analysis) and inspection shall be made at the place of manufacture prior to shipment, unless otherwise specified, and shall be so conducted as not to interfere unnecessarily with the operation of the works.

19. Rejection

- 19.1 The purchaser is permitted to inspect each length of pipe received from the manufacturer and, if it does not meet the requirements of this specification based upon the inspection and test method as outlined in the specification, the length shall be rejected and the manufacturer shall be notified. Disposition of rejected pipe shall be a matter of agreement between the manufacturer and the purchaser.
- 19.2 Pipe found in fabrication or in installation to be unsuitable for the intended use, under the scope and requirements of this specification, shall be set aside and the manufacturer notified. Such pipe shall be subject to mutual investigation as to the nature and severity of the deficiency and the

forming or installation, or both, conditions involved. Disposition shall be a matter for agreement.

20. Certification

- 20.1 The manufacturer or supplier shall, upon request, furnish to the purchaser a certificate of compliance stating that the material has been manufactured, sampled, tested, and inspected in accordance with this specification (including year-date), and has been found to meet the requirements.
- 20.2 *Test Report*—For Types E and S, the manufacturer or supplier shall furnish to the purchaser a chemical analysis report for the elements given in Table 1.
- 20.3 *EDI*—A certificate of compliance or test report printed from, or used in, electronic form from an electronic data interchange (EDI) transmission shall be regarded as having the same validity as a counterpart printed in the certifier's facility. The use and format of the EDI document are subject to agreement between the purchaser and the manufacturer or supplier.
- Note 7—EDI is the computer to computer exchange of business information in a standard format such as ANSI ASC X12.
- 20.4 Notwithstanding the absence of a signature, the organization submitting the certificate of compliance or test report is responsible for its content.

21. Product Marking

- 21.1 Except as allowed by 21.5 and 21.6, each length of pipe shall be legibly marked in the following sequence to show:
 - 21.1.1 Manufacturer's name or mark,
 - 21.1.2 Specification number (year-date not required),

Note 8—Pipe that complies with multiple compatible specifications may be marked with the appropriate designation for each specification.

- 21.1.3 Size (NPS and weight class, schedule number, or specified wall thickness; or specified outside diameter and specified wall thickness),
 - 21.1.4 Grade (A or B),
 - 21.1.5 Type of pipe (F, E, or S),
- 21.1.6 Test pressure, seamless pipe only (if applicable, in accordance with Table 4),
- 21.1.7 Nondestructive electric test, seamless pipe only (if applicable, in accordance with Table 4),
- 21.2 Unless another marking format is specified in the purchase order, length shall be marked in feet and tenths of a foot, or metres to two decimal places, dependent upon the units to which the pipe was ordered. The location of such marking shall be at the option of the manufacturer.

TABLE 4 Marking of Seamless Pipe

			-	
	Hydro	NDE	Marking	
_	Yes	No	Test pressure	-
	No	Yes	NDE	
	Yes	Yes	Test Pressure/NDE	

- 21.3 Heat number, lot number, run number, or a combination thereof shall be marked at the option of the manufacturer, unless specific marking is specified in the purchase order. The location of such marking shall be at the option of the manufacturer.
- 21.4 Any additional information desired by the manufacturer or specified in the purchase order.
- 21.5 For pipe NPS $1\frac{1}{2}$ [DN 40] and smaller that is bundled, it shall be permissible to mark the required information on a tag securely attached to each bundle.
- 21.6 If pipe sections are cut into shorter lengths by a processor for resale as pipe, the processor shall transfer the complete identification, including the name or brand of the manufacturer, to each unmarked cut length, or to metal tags securely attached to unmarked pipe bundled in accordance with the requirements of 21.5. The same material designation shall be included with the information transferred, and the processor's name, trademark, or brand shall be added.
- 21.7 Bar Coding—In addition to the requirements in 21.1, 21.5, and 21.6, bar coding is acceptable as a supplementary identification method. It is recommended that bar coding be consistent with the Automotive Industry Action Group (AIAG) standard prepared by the Primary Metals Subcommittee of the AIAG Bar Code Project Team.

22. Government Procurement

- 22.1 If specified in the contract, the pipe shall be preserved, packaged, and packed in accordance with the requirements of MIL-STD-163. The applicable levels shall be as specified in the contract. Marking for shipment of such pipe shall be in accordance with Fed. Std. No. 123 for civil agencies and MIL-STD-129 or Fed. Std. No. 183 if continuous marking is required, for military agencies.
- 22.2 Inspection—Unless otherwise specified in the contract, the manufacturer is responsible for the performance of all inspection and test requirements specified herein. Except as otherwise specified in the contract, the manufacturer shall use its own or any other suitable facilities for performing the inspection and test requirements specified herein, unless otherwise disapproved by the purchaser in the contract or purchase order. The purchaser shall have the right to perform any of the inspections and tests set forth in this specification where deemed necessary to ensure that the pipe conforms to the specified requirements.

23. Packaging and Package Marking

23.1 If specified in the purchase order, packaging, marking, and loading for shipment shall be in accordance with those procedures recommended by Practices A700.

24. Keywords

24.1 black steel pipe; seamless steel pipe; steel pipe; welded steel pipe; zinc coated steel pipe

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall apply only when specified in the purchase order. The purchaser may specify a different frequency of test than is provided in the supplementary requirement. Subject to agreement between the purchaser and manufacturer, retest and retreatment provisions of these supplementary requirements may also be modified.

S1. Flattening Test, Seamless Pipe

S1.1 A test specimen at least $2\frac{1}{2}$ in. [60 mm] in length shall be flattened cold between parallel plates in two steps. During the first step, which is a test for ductility, except as allowed by S1.3, S1.4, and S1.5, no cracks or breaks on the inside, outside, or end surfaces shall be present before the distance between the plates is less than the value of H calculated as follows:

$$H = (1+e)t/(e+t/D)$$

where:

H = distance between flattening plates, in. [mm],

 e = deformation per unit length (constant for a given grade of steel, 0.09 for Grade A, and 0.07 for Grade B),

t =specified wall thickness, in. [mm], and

D =specified outside diameter, in. [mm]

The H values have been calculated for standard-weight and extra-heavy weight pipe from NPS $2\frac{1}{2}$ to NPS 24 [DN 65 to DN 600], inclusive, and are given in Table X2.1.

S1.2 During the second step, which is a test for soundness, the flattening shall be continued until the test specimen breaks or the opposite sides of the test specimen meet. Evidence of laminated or unsound material that is revealed during the entire flattening test shall be cause for rejection.

S1.3 Surface imperfections in the test specimen before flattening, but revealed during the first step of the flattening test, shall be judged in accordance with the finish requirements in Section 12.

S1.4 Superficial ruptures as a result of surface imperfections shall not be cause for rejection.

S1.5 For pipe with a *D*-to-*t* ratio less than 10, because the strain imposed due to geometry is unreasonably high on the inside surface at the 6 and 12 o'clock locations, cracks at such locations shall not be cause for rejection.

S1.6 One test shall be made on test specimens taken from one length of pipe from each lot of each pipe size. A lot shall contain no more than one heat, and at the option of the manufacturer shall contain no more than 500 lengths of pipe (as initially cut after the final pipe-forming operation, prior to any further cutting to the required ordered lengths) or 50 tons [45 Mg] of pipe.

S1.7 If the results of a test for a lot fail to conform to the applicable requirements, the lot shall be rejected unless tests of additional pipe from the affected lot of double the number originally tested are subsequently made and each such test conforms to the specified requirements. Only one retest of any lot will be permitted. Any individual length of pipe that conforms to the test requirements is acceptable. Any individual length of pipe that does not conform to the test requirements may be resubmitted for test and will be considered acceptable if tests taken from each pipe end conform to the specified requirements.

APPENDIXES

 $(Nonmandatory\ Information)$

X1. DEFINITIONS OF TYPES OF PIPE

X1.1 Type F, Furnace-Butt-Welded Pipe, Continuous-Welded Pipe—Pipe produced in multiple lengths from coiled skelp and subsequently cut into individual lengths, having its longitudinal butt joint forge welded by the mechanical pressure developed in rolling the hot-formed skelp through a set of round pass welding rolls.

X1.2 Type E, Electric-Resistance-Welded Pipe—Pipe produced in single lengths, or in multiple lengths from coiled skelp and subsequently cut into individual lengths, having a

longitudinal butt joint wherein coalescence is produced by the heat obtained from resistance of the pipe to the flow of electric current in a circuit of which the pipe is a part, and by the application of pressure.

X1.3 *Type S, Seamless Pipe*—Pipe made without a welded seam. It is manufactured by hot working steel and, if necessary, by subsequently cold finishing the hot-worked tubular product to produce the desired shape, dimensions, and properties.

X2. TABLES FOR DIMENSIONAL AND CERTAIN MECHANICAL REQUIREMENTS

 $X2.1\ Tables\ X2.1\mbox{-}X2.4$ address dimensional and certain mechanical requirements.

TABLE X2.1 Calculated H Values for Seamless Pipe

NPS Designator	DN Designator	Specified Outside Diameter, in. [mm]	Specified Wall Thickness, in. [mm]		in. [mm], ates " <i>H</i> " by I + <i>e</i>) <i>t</i> /(<i>e</i> + <i>t</i> / <i>D</i>)
				Grade A	Grade B
21/2	65	2.875 [73.0]	0.203 [5.16] 0.276 [7.01]	1.378 [35.0] 1.618 [41.1]	1.545 [39.2] 1.779 [45.2]
3	80	3.500 [88.9]	0.216 [5.49] 0.300 [7.62]	1.552 [39.4] 1.861 [47.3]	1.755 [44.6] 2.062 [52.4]
3½	90	4.000 [101.6]	0.226 [5.74] 0.318 [8.08]	1.682 [42.7] 2.045 [51.9]	1.912 [48.6] 2.276 [57.8]
4	100	4.500 [114.3]	0.237 [6.02] 0.337 [8.56]	1.811 [46.0] 2.228 [56.6]	2.067 [52.5] 2.489 [63.2]
5	125	5.563 [141.3]	0.258 [6.55] 0.375 [9.52]	2.062 [52.4] 2.597 [66.0]	2.372 [60.2] 2.920 [74.2]
6	150	6.625 [168.3]	0.280 [7.11] 0.432 [10.97]	2.308 [58.6] 3.034 [77.1]	2.669 [67.8] 3.419 [86.8]
8	200	8.625 [219.1]	0.277 [7.04] 0.322 [8.18] 0.500 [12.70]	2.473 [62.8] 2.757 [70.0] 3.683 [93.5]	2.902 [73.7] 3.210 [81.5] 4.181 [106.2]
10	250	10.750 [273.0]	0.279 [7.09] ^A 0.307 [7.80] 0.365 [9.27] 0.500 [12.70]	2.623 [66.6] 2.823 [71.7] 3.210 [81.5] 3.993 [101.4]	3.111 [79.0] 3.333 [84.7] 3.757 [95.4] 4.592 [116.6]
12	300	12.750 [323.8]	0.300 [7.62] 0.375 [9.52] 0.500 [12.70]	3.105 [78.9] 3.423 [86.9] 4.218 [107.1]	3.683 [93.5] 4.037 [102.5] 4.899 [124.4]
14	350	14.000 [355.6]	0.375 [9.52] 0.500 [12.70]	3.500 [88.9] 4.336 [110.1]	4.146 [105.3] 5.061 [128.5]
16	400	16.000 [406.4]	0.375 [9.52] 0.500 [12.70]	3.603 [91.5] 4.494 [114.1]	4.294 [109.1] 5.284 [134.2]
18	450	18.000 [457]	0.375 [9.52] 0.500 [12.70]	3.688 [93.7] 4.628 [117.6]	4.417 [112.2] 5.472 [139.0]
20	500	20.000 [508]	0.375 [9.52] 0.500 [12.70]	3.758 [95.5] 4.740 [120.4]	4.521 [114.8] 5.632 [143.1]
24	600	24.000 [610]	0.375 [9.52] 0.500 [12.70]	3.869 [98.3] 4.918 [124.9]	4.686 [119.0] 5.890 [149.6]

A Special order only.

TABLE X2.2 Dimensions, Weights (Masses) per Unit Length, and Test Pressures for Plain-End Pipe

NPS Designator	DN Designator	Specified Outside Diameter, in. [mm]	Specified Wall Thickness, in. [mm]	Nominal Weight (Mass) per Unit Length, Plain End, lb/ft [kg/m]	Weight Class	Schedule No.	Test Pressure, ^A psi [kPa]		
		. ,					Grade A	Grade B	
1/8	6	0.405 [10.3]	0.068 [1.73]	0.24 [0.37]	STD	40	700 [4800]	700 [4800]	
			0.095 [2.41]	0.31 [0.47]	XS	80	850 [5900]	850 [5900]	
1/4	8	0.540 [13.7]	0.088 [2.24]	0.43 [0.63]	STD	40	700 [4800]	700 [4800]	
			0.119 [3.02]	0.54 [0.80]	XS	80	850 [5900]	850 [5900]	
3/8	10	0.675 [17.1]	0.091 [2.31] 0.126 [3.20]	0.57 [0.84] 0.74 [1.10]	STD XS	40 80	700 [4800] 850 [5900]	700 [4800] 850 [5900]	
1/2	15	0.840 [21.3]	0.109 [2.77] 0.147 [3.73]	0.85 [1.27]	STD XS	40 80	700 [4800] 850 [5900]	700 [4800] 850 [5900]	
			0.147 [3.73]	1.09 [1.62] 1.31 [1.95]		160	900 [6200]	900 [6200]	
			0.294 [7.47]	1.72 [2.55]	XXS		1000 [6900]	1000 [6900]	
3/4	20	1.050 [26.7]	0.113 [2.87]	1.13 [1.69]	STD	40	700 [4800]	700 [4800]	
			0.154 [3.91]	1.48 [2.20]	XS	80	850 [5900]	850 [5900]	
			0.219 [5.56]	1.95 [2.90]		160	950 [6500]	950 [6500]	
			0.308 [7.82]	2.44 [3.64]	XXS		1000 [6900]	1000 [6900]	
1	25	1.315 [33.4]	0.133 [3.38]	1.68 [2.50]	STD	40	700 [4800]	700 [4800]	
			0.179 [4.55]	2.17 [3.24] 2.85 [4.24]	XS	80 160	850 [5900] 950 [6500]	850 [5900] 950 [6500]	
			0.250 [6.35] 0.358 [9.09]	3.66 [5.45]	XXS		1000 [6900]	1000 [6900]	
11/4	32	1.660 [42.2]	0.140 [3.56]	2.27 [3.39]	STD	40	1200 [8300]	1300 [9000]	
.,.			0.191 [4.85]	3.00 [4.47]	XS	80	1800 [12 400]	1900 [13 100]	
			0.250 [6.35]	3.77 [5.61]		160	1900 [13 100]	2000 [13 800]	
			0.382 [9.70]	5.22 [7.77]	XXS		2200 [15 200]	2300 [15 900]	
11/2	40	1.900 [48.3]	0.145 [3.68]	2.72 [4.05]	STD	40	1200 [8300]	1300 [9000]	
			0.200 [5.08]	3.63 [5.41]	XS	80	1800 [12 400]	1900 [13 100]	
			0.281 [7.14] 0.400 [10.16]	4.86 [7.25] 6.41 [9.56]	XXS	160 	1950 [13 400] 2200 [15 200]	2050 [14 100] 2300 [15 900]	
2	50	2.375 [60.3]	0.154 [3.91]	3.66 [5.44]	STD	40	2300 [15 900]	2500 [17 200]	
			0.218 [5.54]	5.03 [7.48]	XS	80	2500 [17 200]	2500 [17 200]	
			0.344 [8.74]	7.47 [11.11]		160	2500 [17 200]	2500 [17 200]	
			0.436 [11.07]	9.04 [13.44]	XXS		2500 [17 200]	2500 [17 200]	
21/2	65	2.875 [73.0]	0.203 [5.16]	5.80 [8.63]	STD	40	2500 [17 200]	2500 [17 200]	
			0.276 [7.01]	7.67 [11.41]	XS	80	2500 [17 200]	2500 [17 200]	
			0.375 [9.52] 0.552 [14.02]	10.02 [14.90] 13.71 [20.39]	XXS	160 	2500 [17 200] 2500 [17 200]	2500 [17 200] 2500 [17 200]	
3	80	3.500 [88.9]	0.125 [3.18]	4.51 [6.72]			1290 [8900]	1500 [1000]	
			0.156 [3.96]	5.58 [8.29]			1600 [11 000]	1870 [12 900]	
			0.188 [4.78]	6.66 [9.92]			1930 [13 330]	2260 [15 600]	
			0.216 [5.49]	7.58 [11.29]	STD	40	2220 [15 300]	2500 [17 200]	
			0.250 [6.35] 0.281 [7.14]	8.69 [12.93] 9.67 [14.40]			2500 [17 200] 2500 [17 200]	2500 [17 200] 2500 [17 200]	
			0.300 [7.62]	10.26 [15.27]	XS	80	2500 [17 200]	2500 [17 200]	
			0.438 [11.13]	14.34 [21.35]		160	2500 [17 200]	2500 [17 200]	
			0.600 [15.24]	18.60 [27.68]	XXS		2500 [17 200]	2500 [17 200]	
31/2	90	4.000 [101.6]	0.125 [3.18]	5.18 [7.72]			1120 [7700]	1310 [19 000]	
			0.156 [3.96] 0.188 [4.78]	6.41 [9.53] 7.66 [11.41]			1400 [6700] 1690 [11 700]	1640 [11 300] 1970 [13 600]	
			0.186 [4.76]	9.12 [13.57]	STD	40	2030 [14 000]	2370 [16 300]	
			0.250 [6.35]	10.02 [14.92]			2250 [15 500]	2500 [17 200]	
			0.281 [7.14]	11.17 [16.63]			2500 [17 200]	2500 [17 200]	
			0.318 [8.08]	12.52 [18.63]	XS	80	2800 [19 300]	2800 [19 300]	
4	100	4.500 [114.3]	0.125 [3.18]	5.85 [8.71]			1000 [6900]	1170 [8100]	
			0.156 [3.96] 0.188 [4.78]	7.24 [10.78] 8.67 [12.91]			1250 [8600] 1500 [10 300]	1460 [10 100] 1750 [12 100]	
			0.219 [5.56]	10.02 [14.91]			1750 [12 100]	2040 [14 100]	
			0.237 [6.02]	10.80 [16.07]	STD	40	1900 [13 100]	2210 [15 200]	
			0.250 [6.35]	11.36 [16.90]			2000 [13 800]	2330 [16 100]	
			0.281 [7.14] 0.312 [7.92]	12.67 [18.87] 13.97 [20.78]			2250 [15 100] 2500 [17 200]	2620 [18 100] 2800 [19 300]	
			0.312 [7.92]	15.00 [22.32]	XS	 80	2700 [18 600]	2800 [19 300]	

TABLE X2.2 Continued

NPS Designato	DN r Designator	Specified Outside Diameter, in. [mm]	Specified Wall Thickness, in. [mm]	Nominal Weight (Mass) per Unit Length, Plain End, lb/ft [kg/m]	Weight Class	Schedule No.	Test Pressure, ^A psi [kPa]		
							Grade A	Grade B	
			0.438 [11.13]	19.02 [28.32]		120	2800 [19 300]	2800 [19 300]	
			0.531 [13.49]	22.53 [33.54]		160	2800 [19 300]	2800 [19 300]	
			0.674 [17.12]	27.57 [41.03]	XXS		2800 [19 300]	2800 [19 300]	
5	125	5.563 [141.3]	0.156 [3.96]	9.02 [13.41]			1010 [7000]	1180 [8100]	
			0.188 [4.78]	10.80 [16.09]			1220 [8400]	1420 [9800]	
			0.219 [5.56]	12.51 [18.61]			1420 [9800]	1650 [11 400]	
			0.258 [6.55]	14.63 [21.77]	STD	40	1670 [11 500]	1950 [13 400]	
			0.281 [7.14]	15.87 [23.62]	•••		1820 [12 500]	2120 [14 600]	
			0.312 [7.92] 0.344 [8.74]	17.51 [26.05] 19.19 [28.57]			2020 [13 900] 2230 [15 400]	2360 [16 300] 2600 [17 900]	
			0.375 [9.52]	20.80 [30.94]	XS	80	2430 [16 800]	2800 [19 300]	
			0.500 [12.70]	27.06 [40.28]		120	2800 [19 300]	2800 [19 300]	
			0.625 [15.88]	32.99 [49.11]		160	2800 [19 300]	2800 [19 300]	
			0.750 [19.05]	38.59 [57.43]	XXS		2800 [19 300]	2800 [19 300]	
6	150	6.625 [168.3]	0.188 [4.78]	12.94 [19.27]			1020 [7000]	1190 [8200]	
			0.219 [5.56]	15.00 [22.31]			1190 [8200]	1390 [9600]	
			0.250 [6.35] 0.280 [7.11]	17.04 [25.36] 18.99 [28.26]	STD	40	1360 [9400] 1520 [10 500]	1580 [10 900] 1780 [12 300]	
			0.260 [7.11]	21.06 [31.32]		40	1700 [11 700]	1980 [13 700]	
			0.344 [8.74]	23.10 [34.39]			1870 [12 900]	2180 [15 000]	
			0.375 [9.52]	25.05 [37.28]			2040 [14 100]	2380 [16 400]	
			0.432 [10.97]	28.60 [42.56]	XS	80	2350 [16 200]	2740 [18 900]	
			0.562 [14.27]	36.43 [54.20]		120	2800 [19 300]	2800 [19 300]	
			0.719 [18.26] 0.864 [21.95]	45.39 [67.56] 53.21 [79.22]	XXS	160 	2800 [19 300] 2800 [19 300]	2800 [19 300] 2800 [19 300]	
0	000	0.005 [040.4]							
8	200	8.625 [219.1]	0.188 [4.78] 0.203 [5.16]	16.96 [25.26] 18.28 [27.22]			780 [5400] 850 [5900]	920 [6300] 1000 [6900]	
			0.219 [5.56]	19.68 [29.28]			910 [6300]	1070 [7400]	
			0.250 [6.35]	22.38 [33.31]		20	1040 [7200]	1220 [8400]	
			0.277 [7.04]	24.72 [36.31]		30	1160 [7800]	1350 [9300]	
			0.312 [7.92]	27.73 [41.24]			1300 [9000]	1520 [10 500]	
			0.322 [8.18]	28.58 [42.55]	STD	40	1340 [9200]	1570 [10 800]	
			0.344 [8.74]	30.45 [45.34]	•••		1440 [9900]	1680 [11 600]	
			0.375 [9.52] 0.406 [10.31]	33.07 [49.20] 35.67 [53.08]		60	1570 [10 800] 1700 [11 700]	1830 [12 600] 2000 [13 800]	
			0.438 [11.13]	38.33 [57.08]			1830 [12 600]	2130 [14 700]	
			0.500 [12.70]	43.43 [64.64]	XS	80	2090 [14 400]	2430 [16 800]	
			0.594 [15.09]	51.00 [75.92]		100	2500 [17 200]	2800 [19 300]	
			0.719 [18.26]	60.77 [90.44]		120	2800 [19 300]	2800 [19 300]	
			0.812 [20.62]	67.82 [100.92]		140	2800 [19 300]	2800 [19 300]	
			0.875 [22.22] 0.906 [23.01]	72.49 [107.88] 74.76 [111.27]	XXS 	 160	2800 [19 300] 2800 [19 300]	2800 [19 300] 2800 [19 300]	
10	250	10.750 [273.0]	0.188 [4.78]	21.23 [31.62]			630 [4300]	730 [5000]	
10	230	10.750 [275.0]	0.203 [5.16]	22.89 [34.08]			680 [4700]	800 [5500]	
			0.219 [5.56]	24.65 [36.67]			730 [5000]	860 [5900]	
			0.250 [6.35]	28.06 [41.75]		20	840 [5800]	980 [6800]	
			0.279 [7.09]	31.23 [46.49]			930 [6400]	1090 [7500]	
			0.307 [7.80]	34.27 [51.01]		30	1030 [7100]	1200 [8300]	
			0.344 [8.74]	38.27 [56.96]			1150 [7900]	1340 [9200]	
			0.365 [9.27]	40.52 [60.29]	STD	40	1220 [8400] 1470 [10 100]	1430 [9900]	
			0.438 [11.13] 0.500 [12.70]	48.28 [71.87] 54.79 [81.52]	XS	60	1670 [11 500]	1710 [11 800] 1950 [13 400]	
			0.594 [15.09]	64.49 [95.97]		80	1990 [13 700]	2320 [16 000]	
			0.719 [18.26]	77.10 [114.70]		100	2410 [16 600]	2800 [19 300]	
			0.844 [21.44]	89.38 [133.00]		120	2800 [19 300]	2800 [19 300]	
			1.000 [25.40] 1.125 [28.57]	104.23 [155.09] 115.75 [172.21]	XXS	140 160	2800 [19 300] 2800 [19 300]	2800 [19 300] 2800 [19 300]	
10	300	10 750 [000 0]			•••				
12	300	12.750 [323.8]	0.203 [5.16] 0.219 [5.56]	27.23 [40.55] 29.34 [43.63]			570 [3900] 620 [4300]	670 [4600] 720 [5000]	
			0.250 [6.35]	33.41 [49.71]		20	710 [4900]	820 [5700]	
			0.281 [7.14]	37.46 [55.75]			790 [5400]	930 [6400]	
			0.312 [7.92]	41.48 [61.69]			880 [6100]	1030 [7100]	
			0.330 [8.38]	43.81 [65.18]		30	930 [6400]	1090 [7500]	
			0.344 [8.74]	45.62 [67.90]			970 [6700]	1130 [7800]	
			0.375 [9.52]	49.61 [73.78]	STD		1060 [7300]	1240 [8500]	
			0.406 [10.31]	53.57 [79.70]		40	1150 [7900]	1340 [9200]	

ASME BPVC.II.A-2023

TABLE X2.2 Continued

		0		TABLE X2.2 Contin	lueu			
NPS Designato	DN r Designator	Specified Outside Diameter, in. [mm]	Specified Wall Thickness, in. [mm]	Nominal Weight (Mass) per Unit Length, Plain End, lb/ft [kg/m]	Weight Class	Schedule No.	Test Pressure	e, ^A psi [kPa]
							Grade A	Grade B
			0.438 [11.13]	57.65 [85.82]			1240 [8500]	1440 [9900]
			0.500 [12.70]	65.48 [97.43]	XS		1410 [9700]	1650 [11 400]
			0.562 [14.27]	73.22 [108.92]		60	1590 [11 000]	1850 [12 800]
			0.688 [17.48]	88.71 [132.04]		80	1940 [13 400]	2270 [15 700]
			0.844 [21.44]	107.42 [159.86]		100	2390 [16 500]	2780 [19 200]
			1.000 [25.40]	125.61 [186.91]	XXS	120	2800 [19 300]	2800 [19 300]
			1.125 [28.57]	139.81 [208.00]		140	2800 [19 300]	2800 [19 300]
			1.312 [33.32]	160.42 [238.68]		160	2800 [19 300]	2800 [19 300]
14	350	14.000 [355.6]	0.210 [5.33]	30.96 [46.04]			540 [3700]	630 [4300]
			0.219 [5.56]	32.26 [47.99]	•••		560 [3900]	660 [4500]
			0.250 [6.35]	36.75 [54.69]		10	640 [4400]	750 [5200] 840 [5800]
			0.281 [7.14] 0.312 [7.92]	41.21 [61.35] 45.65 [67.90]	•••	20	720 [5000] 800 [5500]	940 [6500]
			0.344 [8.74]	50.22 [74.76]			880 [6100]	1030 [7100]
			0.375 [9.52]	54.62 [81.25]	STD	30	960 [6600]	1120 [7700]
			0.438 [11.13]	63.50 [94.55]		40	1130 [7800]	1310 [9000]
			0.469 [11.91]	67.84 [100.94]			1210 [8300]	1410 [9700]
			0.500 [12.70]	72.16 [107.39]	XS		1290 [8900]	1500 [10 300]
			0.594 [15.09]	85.13 [126.71]		60	1530 [10 500]	1790 [12 300]
			0.750 [19.05]	106.23 [158.10]		80	1930 [13 300]	2250 [15 500]
			0.938 [23.83]	130.98 [194.96]		100	2410 [16 600]	2800 [19 300]
			1.094 [27.79]	150.93 [224.65]		120	2800 [19 300]	2800 [19 300]
			1.250 [31.75]	170.37 [253.56]		140	2800 [19 300]	2800 [19 300]
			1.406 [35.71]	189.29 [281.70]	•••	160	2800 [19 300]	2800 [19 300]
			2.000 [50.80]	256.56 [381.83]			2800 [19 300]	2800 [19 300]
			2.125 [53.97] 2.200 [55.88]	269.76 [401.44] 277.51 [413.01]			2800 [19 300] 2800 [19 300]	2800 [19 300] 2800 [19 300]
			2.500 [63.50]	307.34 [457.40]			2800 [19 300]	2800 [19 300]
16	400	16.000 [406.4]	0.219 [5.56]	36.95 [54.96]			490 [3400]	570 [3900]
10	400	10.000 [400.4]	0.250 [6.35]	42.09 [62.64]	•••	 10	560 [3900]	660 [4500]
			0.281 [7.14]	47.22 [70.30]			630 [4300]	740 [5100]
			0.312 [7.92]	52.32 [77.83]		20	700 [4800]	820 [5700]
			0.344 [8.74]	57.57 [85.71]			770 [5300]	900 [6200]
			0.375 [9.52]	62.64 [93.17]	STD	30	840 [5800]	980 [6800]
			0.438 [11.13]	72.86 [108.49]			990 [6800]	1150 [7900]
			0.469 [11.91]	77.87 [115.86]			1060 [7300]	1230 [8500]
			0.500 [12.70]	82.85 [123.30]	XS	40	1120 [7700]	1310 [9000]
			0.656 [16.66]	107.60 [160.12]		60	1480 [10 200]	1720 [11 900]
			0.844 [21.44]	136.74 [203.53]	•••	80	1900 [13 100]	2220 [15 300]
			1.031 [26.19]	164.98 [245.56]	•••	100	2320 [16 000]	2710 [18 700]
			1.219 [30.96]	192.61 [286.64]		120 140	2740 [18 900] 2800 [19 300]	2800 [19 300] 2800 [19 300]
			1.438 [36.53] 1.594 [40.49]	223.85 [333.19] 245.48 [365.35]		160	2800 [19 300]	2800 [19 300]
18	450	18.000 [457]	0.250 [6.35]	47.44 [70.60]		10	500 [3400]	580 [4000]
			0.281 [7.14]	53.23 [79.24]			560 [3900]	660 [4500]
			0.312 [7.92]	58.99 [87.75]		20	620 [4300]	730 [5000]
			0.344 [8.74]	64.93 [96.66]			690 [4800]	800 [5500]
			0.375 [9.52]	70.65 [105.10]	STD		750 [5200]	880 [6100]
			0.406 [10.31]	76.36 [113.62]			810 [5600]	950 [6500]
			0.438 [11.13]	82.23 [122.43]		30	880 [6100]	1020 [7000]
			0.469 [11.91]	87.89 [130.78]	•••		940 [6500]	1090 [7500]
			0.500 [12.70]	93.54 [139.20]	XS		1000 [6900]	1170 [8100]
			0.562 [14.27]	104.76 [155.87]		40	1120 [7700]	1310 [9000]
			0.750 [19.05]	138.30 [205.83]		60	1500 [10 300]	1750 [12 100]
			0.938 [23.83]	171.08 [254.67]		80 100	1880 [13 000] 2310 [15 900]	2190 [15 100]
			1.156 [29.36]	208.15 [309.76]	•••	120		2700 [18 600]
			1.375 [34.92] 1.562 [39.67]	244.37 [363.64] 274.48 [408.45]	•••	140	2750 [19 000] 2800 [19 300]	2800 [19 300] 2800 [19 300]
			1.781 [45.24]	308.79 [459.59]		160	2800 [19 300]	2800 [19 300]
20	500	20.000 [508]	0.250 [6.35]	52.78 [78.55]		10	450 [3100]	520 [3600]
20	300	20.000 [000]	0.281 [7.14]	59.23 [88.19]	···		510 [3500]	590 [4100]
			0.312 [7.92]	65.66 [97.67]			560 [3900]	660 [4500]
			0.344 [8.74]	72.28 [107.60]			620 [4300]	720 [5000]
			0.375 [9.52]	78.67 [117.02]	STD	20	680 [4700]	790 [5400]
			0.406 [10.31]	84.04 [126.53]			730 [5000]	850 [5900]
			0.438 [11.13]	91.59 [136.37]			790 [5400]	920 [6300]
			0.469 [11.91]	97.92 [145.70]			850 [5900]	950 [6500]

ASME BPVC.II.A-2023

TABLE X2.2 Continued

				TABLE AZ.Z COTILI	iueu				
NPS Designator	DN Designator	Specified Outside Diameter, in. [mm]	Specified Wall Thickness, in. [mm]	Nominal Weight (Mass) per Unit Length, Plain End, lb/ft [kg/m]	Weight Class	Schedule No.	Test Pressure, ^A psi [kPa]		
							Grade A	Grade B	
			0.500 [12.70]	104.23 [155.12]	XS	30	900 [6200]	1050 [7200]	
			0.594 [15.09]	123.23 [183.42]		40	1170 [8100]	1250 [8600]	
			0.812 [20.62]	166.56 [247.83]		60	1460 [10 100]	1710 [11 800]	
			1.031 [26.19]	209.06 [311.17]		80	1860 [12 800]	2170 [15 000]	
			1.281 [32.54]	256.34 [381.53]		100	2310 [15 900]	2690 [18 500]	
			1.500 [38.10]	296.65 [441.49]		120	2700 [18 600]	2800 [19 300]	
			1.750 [44.45]	341.41 [508.11]	•••	140	2800 [19 300]	2800 [19 300]	
			1.969 [50.01]	379.53 [564.81]		160	2800 [19 300]	2800 [19 300]	
24	600	24.000 [610]	0.250 [6.35]	63.47 [94.46]		10	380 [2600]	440 [3000]	
			0.281 [7.14]	71.25 [106.08]			420 [2900]	490 [3400]	
			0.312 [7.92]	79.01 [117.51]			470 [3200]	550 [3800]	
			0.344 [8.74]	86.99 [129.50]			520 [3600]	600 [4100]	
			0.375 [9.52]	94.71 [140.88]	STD	20	560 [3900]	660 [4500]	
			0.406 [10.31]	102.40 [152.37]			610 [4200]	710 [4900]	
			0.438 [11.13]	110.32 [164.26]			660 [4500]	770 [5300]	
			0.469 [11.91]	117.98 [175.54]			700 [4800]	820 [5700]	
			0.500 [12.70]	125.61 [186.94]	XS		750 [5200]	880 [6100]	
			0.562 [14.27]	140.81 [209.50]		30	840 [5800]	980 [6800]	
			0.688 [17.48]	171.45 [255.24]		40	1030 [7100]	1200 [8300]	
			0.938 [23.83]	231.25 [344.23]			1410 [9700]	1640 [11 300]	
			0.969 [24.61]	238.57 [355.02]		60	1450 [10 000]	1700 [11 700]	
			1.219 [30.96]	296.86 [441.78]		80	1830 [12 600]	2130 [14 700]	
			1.531 [38.89]	367.74 [547.33]		100	2300 [15 900]	2680 [18 500]	
			1.812 [46.02]	429.79 [639.58]		120	2720 [18 800]	2800 [19 300]	
			2.062 [52.37]	483.57 [719.63]		140	2800 [19 300]	2800 [19 300]	
			2.344 [59.54]	542.64 [807.63]		160	2800 [19 300]	2800 [19 300]	
26	650	26.000 [660]	0.250 [6.35]	68.82 [102.42]			350 [2400]	400 [2800]	
20	650	26.000 [660]		77.26 [115.02]			390 [2700]	450 [3100]	
			0.281 [7.14]			 10			
			0.312 [7.92]	85.68 [127.43]			430 [3000]	500 [3400]	
			0.344 [8.74]	94.35 [140.45]	 CTD		480 [3300]	560 [3900]	
			0.375 [9.52]	102.72 [152.80]	STD		520 [3600]	610 [4200]	
			0.406 [10.31]	111.08 [165.28]			560 [3900]	660 [4500]	
			0.438 [11.13]	119.69 [178.20]	***	•••	610 [4200]	710 [4900]	
			0.469 [11.91]	128.00 [190.46]			650 [4500]	760 [5200]	
			0.500 [12.70]	136.30 [202.85]	XS	20	690 [4800]	810 [5600]	
			0.562 [14.27]	152.83 [227.37]	•••	•••	780 [5400]	910 [6300]	

⁴ The minimum test pressure for outside diameters and wall thicknesses not listed shall be computed by the formula given below. The computed test pressure shall be used in all cases, except as follows:

where:

P = minimum hydrostatic test pressure, psi [kPa],

S = 0.60 times the specified minimum yield strength, psi [kPa],

t = specified wall thickness, in. [mm], and

D = specified outside diameter, in. [mm].

⁽¹⁾ For specified wall thicknesses greater than the heaviest specified wall thickness listed in this table for the applicable specified outside diameter, the test pressure shall be the highest value listed for the applicable specified outside diameter and grade.

⁽²⁾ For pipe smaller than NPS 2 [DN 50] with a specified wall thickness less than the lightest specified wall thickness listed in this table for the applicable specified outside diameter and grade.

⁽³⁾ For all sizes of Grade A and B pipe smaller than NPS 2 [DN 50], the test pressures were assigned arbitrarily. Test pressures for intermediate specified outside diameters need not exceed those given in this table for the next larger listed size.

P=25t/D

TABLE X2.3 Dimensions, Weights (Masses) per Unit Length, and Test Pressures for Threaded and Coupled Pipe

NPS Designator	DN Designator	Specified Outside Diameter, in. [mm]	Specified Wall Thickness, in. [mm]	Nominal Weight (Mass) per Unit Length, Threaded and Coupled, lb/ft [kg/m]	Weight Class	Schedule No.	Test Pressure,	psi [kPa]
						_	Grade A	Grade B
1/8	6	0.405 [10.3]	0.068 [1.73] 0.095 [2.41]	0.25 [0.37] 0.32 [0.46]	STD XS	40 80	700 [4800] 850 [5900]	700 [4800] 850 [5900]
1/4	8	0.540 [13.7]	0.088 [2.24] 0.119 [3.02]	0.43 [0.63] 0.54 [0.80]	STD XS	40 80	700 [4800] 850 [5900]	700 [4800] 850 [5900]
3/8	10	0.675 [17.1]	0.091 [2.31] 0.126 [3.20]	0.57 [0.84] 0.74 [1.10]	STD XS	40 80	700 [4800] 850 [5900]	700 [4800] 850 [5900]
1/2	15	0.840 [21.3]	0.109 [2.77] 0.147 [3.73] 0.294 [7.47]	0.86 [1.27] 1.09 [1.62] 1.72 [2.54]	STD XS XXS	40 80 	700 [4800] 850 [5900] 1000 [6900]	700 [4800] 850 [5900] 1000 [6900]
3/4	20	1.050 [26.7]	0.113 [2.87] 0.154 [3.91] 0.308 [7.82]	1.14 [1.69] 1.48 [2.21] 2.45 [3.64]	STD XS XXS	40 80 	700 [4800] 850 [5900] 1000 [6900]	700 [4800] 850 [5900] 1000 [6900]
1	25	1.315 [33.4]	0.133 [3.38] 0.179 [4.55] 0.358 [9.09]	1.69 [2.50] 2.19 [3.25] 3.66 [5.45]	STD XS XXS	40 80 	700 [4800] 850 [5900] 1000 [6900]	700 [4800] 850 [5900] 1000 [6900]
11/4	32	1.660 [42.2]	0.140 [3.56] 0.191 [4.85] 0.382 [9.70]	2.28 [3.40] 3.03 [4.49] 5.23 [7.76]	STD XS XXS	40 80 	1000 [6900] 1500 [10 300] 1800 [12 400]	1100 [7600] 1600 [11 000] 1900 [13 100]
1½	40	1.900 [48.3]	0.145 [3.68] 0.200 [5.08] 0.400 [10.16]	2.74 [4.04] 3.65 [5.39] 6.41 [9.56]	STD XS XXS	40 80 	1000 [6900] 1500 [10 300] 1800 [12 400]	1100 [7600] 1600 [11 000] 1900 [13 100]
2	50	2.375 [60.3]	0.154 [3.91] 0.218 [5.54] 0.436 [11.07]	3.68 [5.46] 5.08 [7.55] 9.06 [13.44]	STD XS XXS	40 80 	2300 [15 900] 2500 [17 200] 2500 [17 200]	2500 [17 200] 2500 [17 200] 2500 [17 200]
21/2	65	2.875 [73.0]	0.203 [5.16] 0.276 [7.01] 0.552 [14.02]	5.85 [8.67] 7.75 [11.52] 13.72 [20.39]	STD XS XXS	40 80 	2500 [17 200] 2500 [17 200] 2500 [17 200]	2500 [17 200] 2500 [17 200] 2500 [17 200]
3	80	3.500 [88.9]	0.216 [5.49] 0.300 [7.62] 0.600 [15.24]	7.68 [11.35] 10.35 [15.39] 18.60 [27.66]	STD XS XXS	40 80 	2200 [15 200] 2500 [17 200] 2500 [17 200]	2500 [17 200] 2500 [17 200] 2500 [17 200]
31/2	90	4.000 [101.6]	0.226 [5.74] 0.318 [8.08]	9.27 [13.71] 12.67 [18.82]	STD XS	40 80	2000 [13 800] 2800 [19 300]	2400 [16 500] 2800 [19 300]
4	100	4.500 [114.3]	0.237 [6.02] 0.337 [8.56] 0.674 [17.12]	10.92 [16.23] 15.20 [22.60] 27.62 [41.09]	STD XS XXS	40 80 	1900 [13 100] 2700 [18 600] 2800 [19 300]	2200 [15 200] 2800 [19 300] 2800 [19 300]
5	125	5.563 [141.3]	0.258 [6.55] 0.375 [9.52] 0.750 [19.05]	14.90 [22.07] 21.04 [31.42] 38.63 [57.53]	STD XS XXS	40 80 	1700 [11 700] 2400 [16 500] 2800 [19 300]	1900 [13 100] 2800 [19 300] 2800 [19 300]
6	150	6.625 [168.3]	0.280 [7.11] 0.432 [10.97] 0.864 [21.95]	19.34 [28.58] 28.88 [43.05] 53.19 [79.18]	STD XS XXS	40 80 	1500 [10 300] 2300 [15 900] 2800 [19 300]	1800 [12 400] 2700 [18 600] 2800 [19 300]
8	200	8.625 [219.1]	0.277 [7.04] 0.322 [8.18] 0.500 [12.70] 0.875 [22.22]	25.53 [38.07] 29.35 [43.73] 44.00 [65.41] 72.69 [107.94]	STD XS XXS	30 40 80 	1200 [8300] 1300 [9000] 2100 [14 500] 2800 [19 300]	1300 [9000] 1600 [11 000] 2400 [16 500] 2800 [19 300]
10	250	10.750 [273.0]	0.279 [7.09] 0.307 [7.80] 0.365 [9.27] 0.500 [12.70]	32.33 [48.80] 35.33 [53.27] 41.49 [63.36] 55.55 [83.17]	 STD XS	 30 40 60	950 [6500] 1000 [6900] 1200 [8300] 1700 [11 700]	1100 [7600] 1200 [8300] 1400 [9700] 2000 [13 800]
12	300	12.750 [323.8]	0.330 [8.38] 0.375 [9.52] 0.500 [12.70]	45.47 [67.72] 51.28 [76.21] 66.91 [99.4]	 STD XS	30 	950 [6500] 1100 [7600] 1400 [9700]	1100 [7600] 1200 [8300] 1600 [11 000]

TABLE X2.4 Table of Minimum Permissible Wall Thicknesses on Inspection for Pipe Specified Wall Thicknesses

Note 1—The following equation, upon which this table is based, shall be applied to calculate minimum permissible wall thickness from specified wall thickness:

 $t_s \times 0.875 = t_m$ where:

 t_s = specified wall thickness, in. [mm], and

 t_{m} = minimum permissible wall thickness, in. [mm]. The wall thickness is expressed to three [two] decimal places, the fourth [third] decimal place being carried forward or dropped in accordance with Practice E29.

Note 2—This table is a master table covering wall thicknesses available in the purchase of different classifications of pipe, but it is not meant to imply that all of the walls listed therein are obtainable under this specification.

Specified Wall	Minimum	Specified Wall	Minimum	Specified Wall	Minimum
Thickness (t_s) ,	Permissible Wall	Thickness (t _s),	Permissible Wall	Thickness (t_s) ,	Permissible Wall
in. [mm]	Thickness on	in. [mm]	Thickness on	in. [mm]	Thickness on
ni. Įiiniij	Inspection (t_m) ,	III. [IIIIII]	Inspection (t_m) ,	[111111]	Inspection (t_m) ,
	in. [mm]		in. [mm]		in. [mm]
	mi. Įiimiij		mi. [mini]		[]
0.068 [1.73]	0.060 [1.52]	0.294 [7.47]	0.257 [6.53]	0.750 [19.05]	0.656 [16.66]
0.088 [2.24]	0.077 [1.96]	0.300 [7.62]	0.262 [6.65]	0.812 [20.62]	0.710 [18.03]
0.091 [2.31]	0.080 [2.03]	0.307 [7.80]	0.269 [6.83]	0.844 [21.44]	0.739 [18.77]
0.095 [2.41]	0.083 [2.11]	0.308 [7.82]	0.270 [6.86]	0.864 [21.94]	0.756 [19.20]
0.109 [2.77]	0.095 [2.41]	0.312 [7.92]	0.273 [6.93]	0.875 [22.22]	0.766 [19.46]
0.113 [2.87]	0.099 [2.51]	0.318 [8.08]	0.278 [7.06]	0.906 [23.01]	0.793 [20.14]
0.119 [3.02]	0.104 [2.64]	0.322 [8.18]	0.282 [7.16)	0.938 [23.82]	0.821 [20.85]
0.125 [3.18]	0.109 [2.77]	0.330 [8.38]	0.289 [7.34]	0.968 [24.59]	0.847 [21.51]
0.126 [3.20]	0.110 [2.79]	0.337 [8.56]	0.295 [7.49]	1.000 [25.40]	0.875 [22.22]
0.133 [3.38]	0.116 [2.95]	0.343 [8.71]	0.300 [7.62]	1.031 [26.19]	0.902 [22.91]
0.140 [3.56]	0.122 [3.10]	0.344 [8.74]	0.301 [7.65]	1.062 [26.97]	0.929 [26.30]
0.145 [3.68]	0.127 [3.23]	0.358 [9.09]	0.313 [7.95]	1.094 [27.79]	0.957 [24.31]
0.147 [3.73]	0.129 [3.28]	0.365 [9.27]	0.319 [8.10]	1.125 [28.58]	0.984 [24.99]
0.154 [3.91]	0.135 [3.43]	0.375 [9.52]	0.328 [8.33]	1.156 [29.36]	1.012 [25.70]
0.156 [3.96]	0.136 [3.45]	0.382 [9.70]	0.334 [8.48]	1.219 [30.96]	1.067 [27.08]
0.179 [4.55]	0.157 [3.99]	0.400 [10.16]	0.350 [8.89]	1.250 [31.75]	1.094 [27.79]
0.187 [4.75]	0.164 [4.17]	0.406 [10.31]	0.355 [9.02]	1.281 [32.54]	1.121 [28.47]
0.188 [4.78]	0.164 [4.17]	0.432 [10.97]	0.378 [9.60]	1.312 [33.32]	1.148 [29.16]
0.191 [4.85]	0.167 [4.24]	0.436 [11.07]	0.382 [9.70]	1.343 [34.11]	1.175 [29.85]
0.200 [5.08]	0.175 [4.44]	0.437 [11.10]	0.382 [9.70]	1.375 [34.92]	1.203 [30.56]
0.203 [5.16]	0.178 [4.52]	0.438 [11.13]	0.383 [9.73]	1.406 [35.71]	1.230 [31.24]
0.216 [5.49]	0.189 [4.80]	0.500 [12.70]	0.438 [11.13]	1.438 [36.53]	1.258 [31.95]
0.218 [5.54]	0.191 [4.85]	0.531 [13.49]	0.465 [11.81]	1.500 [38.10]	1.312 [33.32]
0.219 [5.56]	0.192 [4.88]	0.552 [14.02]	0.483 [12.27]	1.531 [38.89]	1.340 [34.04]
0.226 [5.74]	0.198 [5.03]	0.562 [14.27]	0.492 [12.50]	1.562 [39.67]	1.367 [34.72]
0.237 [6.02]	0.207 [5.26]	0.594 [15.09]	0.520 [13.21]	1.594 [40.49]	1.395 [35.43]
0.250 [6.35]	0.219 [5.56]	0.600 [15.24]	0.525 [13.34]	1.750 [44.45]	1.531 [38.89]
0.258 [6.55]	0.226 [5.74]	0.625 [15.88]	0.547 [13.89]	1.781 [45.24]	1.558 [39.57]
0.276 [7.01]	0.242 [6.15]	0.656 [16.66]	0.574 [14.58]	1.812 [46.02]	1.586 [40.28]
0.277 [7.04]	0.242 [6.15]	0.674 [17.12]	0.590 [14.99]	1.968 [49.99]	1.722 [43.74]
0.279 [7.09]	0.244 [6.20]	0.688 [17.48]	0.602 [15.29]	2.062 [52.37]	1.804 [45.82]
0.280 [7.11]	0.245 [6.22]	0.719 [18.26]	0.629 [15.98]	2.344 [59.54]	2.051 [52.10]
0.281 [7.14]	0.246 [6.25]				

X3. BASIC THREADING DATA

X3.1 Fig. X3.1 is to be used with Table X3.1. Fig. X3.2 is to be used with Table X3.2.




FIG. X3.1 Dimensions of Hand Tight Assembly for Use with Table X3.1

TABLE X3.1 Basic Threading Data for Standard-Weight Pipe, NPS 6 [DN 150] or Smaller

Note 1—All dimensions in this table are nominal and subject to mill tolerances.

Note 2—The taper of threads is $^{3}\!\!/_{\!4}$ in./ft [62.5 mm/m] on the diameter.

	Pipe				Threads				Coupling	
NPS Designator	DN Designator	Specified Outside Diameter, in. [mm]	Number pe inch	er End of Pipe to Hand Tight Plane, in. [mm]	Effective Length, in. [mm]	Total Length, in. [mm]	Pitch Diameter at Hand Tight Plane, in. [mm]	Specified Outside Diameter, in. [mm]	Length, min., in. [mm]	Hand Tight Stand-Off (Number of Threads)
		D		L ₁	L_2	L_4	E_1	W	N _L	Α
1/8	6	0.405 [10.3]	27	0.1615 [4.1021]	0.2638 [6.7005]	0.3924 [9.9670]	0.37360 [9.48944]	0.563 [14.3]	3/4 [19]	4
1/4	8	0.540 [13.7]	18	0.2278 [5.7861]	0.4018	0.5946 [15.1028]	0.49163 [12.48740]	0.719 [18.3]	11/8 [29]	51/2
3/8	10	0.675 [17.1]	18	0.240 [6.096]	0.4078 [10.3581]	0.6006 [15.2552]	0.62701 [15.92605]	0.875 [22.2]	11/8 [29]	5
1/2	15	0.840 [21.3]	14	0.320 [8.128]	0.5337 [13.5560]	0.7815 [19.8501]	0.77843 [19.77212]	1.063 [27.0]	1½ [38]	5
3/4	20	1.050 [26.7]	14	0.339 [8.611]	0.5457 [13.8608]	0.7935 [20.1549]	0.98887 [25.11730]	1.313 [33.4]	19/16 [40]	5
1	25	1.315 [33.4]	11½	0.400 [10.160]	0.6828 [17.3431]	0.9845 [25.0063]	1.23863 [31.46120]	1.576 [40.0]	115/16 [49]	5
11/4	32	1.660 [42.2]	11 ½	0.420 [10.668]	0.7068 [17.9527]	1.0085 [25.6159]	1.58338 [40.21785]	1.900 [48.3]	2 [50]	5
11/2	40	1.900 [48.3]	11½	0.420 [10.668]	0.7235 [18.3769]	1.0252 [26.0401]	1.82234 [46.28744]	2.200 [55.9]	2 [50]	5½
2	50	2.375 [60.3]	11½	0.436 [11.074]	0.7565 [19.2151]	1.0582 [26.8783]	2.29627 [58.32526]	2.750 [69.8]	21/16 [52]	5½
21/2	65	2.875 [73.0]	8	0.682 [17.323]	1.1376 [28.8950]	1.5712 [39.9085]	2.76216 [70.15886]	3.250 [82.5]	31/16 [78]	5½
3	80	3.500 [88.9]	8	0.766 [19.456]	1.2000 [30.4800]	1.6337 [41.4960]	3.38850 [86.06790]	4.000 [101.6]	33/16 [81]	5½
31/2	90	4.000 [101.6]	8	0.821 [20.853]	1.2500 [31.7500]	1.6837 [42.7660]	3.88881 [98.77577]	4.625 [117.5]	35/16 [84]	5½
4	100	4.500 [114.3]	8	0.844 [21.438]	1.3000 [33.0200]	1.7337 [44.0360]	4.38713 [111.43310]	5.000 [127.0]	37/16 [87]	5
5	125	5.563 [141.3]	8	0.937 [23.800]	1.4063 [35.7200]	1.8400 [46.7360]	5.44929 [138.41200]	6.296 [159.9]	311/16 [94]	5
6	150	6.625 [168.3]	8	0.958 [24.333]	1.5125 [38.4175]	1.9462 [49.4335]	6.50597 [165.25164]	7.390 [187.7]	315/16 [100]	6




FIG. X3.2 Dimensions of Hand Tight Assembly for Use with Table X3.2

TABLE X3.2 Basic Threading Data for Standard-Weight Pipe, NPS 8 [DN 200] or Larger, and all Sizes of Extra-Strong and Double-Extra-Strong Weight Pipe

Note 1—The taper of threads is $\frac{3}{4}$ in./ft [62.5 mm/m] on the diameter.

	Pipe						Thre	ads							Coupling	9	
NPS Desig- nator	DN Desig- nator	Specified Outside Diameter, in.	[mm]	Num- ber per Inch	End of Pipe to Hand Tight Plane,		Effective Length, in.	[mm]	Total Length, in.	[mm]	Pitch Diameter at Hand Tight Plane,		Specified Outside Diameter, in.	[mm]	Length, min, in.	[mm]	Hand Tight Stand-Off (Number of
					in.	[mm]	,		,		in.	[mm]	147		Α./		Threads)
		D			L ₁		L ₂		L ₄		E ₁		W		N _L		
1/8	6	0.405	[10.3]	27	0.1615	[4.1021]	0.2638	[6.7005]	0.3924	[9.9670]	0.37360	[9.48944]	0.563	[14.3]	11/16	[27]	3
1/4	8	0.540	[13.7]	18	0.2278	[5.7861]	0.4018	[10.2057]	0.5946	[15.1028]	0.49163	[12.48740]	0.719	[18.3]	1 5⁄8	[41]	3
3/8	10	0.675	[17.1]	18	0.240	[6.096]	0.4078	[10.3581]	0.6006	[15.2552]	0.62701	[15.92605]	0.875	[22.2]	15⁄8	[41]	3
1/2	15	0.840	[21.3]	14	0.320	[8.128]	0.5337	[13.5560]	0.7815	[19.8501]	0.77843	[19.77212]	1.063	[27.0]	21/8	[54]	3
3/4	20	1.050	[26.7]	141/2	0.339	[8.611]	0.5457	[13.8608]	0.7935	[20.1549]	0.98887	[25.11730]	1.313	[33.4]	21/8	[54]	3
1	25	1.315	[33.4]	11	0.400	[10.160]	0.6828	[17.3431]	0.9845	[25.0063]	1.23863	[31.46120]	1.576	[40.0]	25/8	[67]	3
1 1/4	32	1.660	[42.2]	111/2	0.420	[10.668]	0.7068	[17.9527]	1.0085	[25.6159]	1.58338	[40.21785]	2.054	[52.2]	23/4	[70]	3
11/2	40	1.900	[48.3]	111/2	0.420	[10.668]	0.7235	[18.3769]	1.0252	[26.0401]	1.82234	[46.28744]	2.200	[55.9]	23/4	[70]	3
2	50	2.375	[60.3]	11½	0.436	[11.074]	0.7565	[19.2151]	1.0582	[26.8783]	2.29627	[58.32526]	2.875	[73.0]	27/8	[73]	3
21/2	65	2.875	[73.0]	8	0.682	[17.323]	1.1375	[28.8950]	1.5712	[39.9085]	2.76216	[70.15886]	3.375	[85.7]	41/8	[105]	2
3	80	3.500	[88.9]	8	0.766	[19.456]	1.2000	[30.4800]	1.6337	[41.4960]	3.38850	[86.06790]	4.000	[101.6]	41/4	[108]	2
31/2	90	4.000	[101.6]	8	0.821	[20.853]	1.2500	[31.7500]	1.6837	[42.7660]	3.88881	[98.77577]	4.625	[117.5]	43/8	[111]	2
4	100	4.500	[114.3]	8	0.844	[21.438]	1.3000	[33.0200]	1.7337	[44.0360]	4.38713	[111.43310]	5.200	[132.1]	41/2	[114]	2
5	125	5.563	[141.3]	8	0.937	[23.800]	1.4063	[35.7200]	1.8400	[46.7360]	5.44929	[138.41200]	6.296	[159.9]	45/8	[117]	2
8	150 200	6.625 8.625	[168.3]	8 8	0.958 1.063	[24.333]	1.5125 1.7125	[38.4175]	1.9462 2.1462	[49.4335]	6.50597 8.50003	[165.25164]	7.390 9.625	[187.7]	47/8 51/4	[124]	2 2
-	250	10.750	[219.1] [273.0]	8	1.210	[27.000]	1.7125	[43.4975]	2.1462	[54.5135] [59.9110]	10.62094	[215.90076] [269.77188]	11.750	[244.5] [298.4]	5 ³ / ₄	[133]	2
10 12	300	12.750	[323.8]	8	1.360	[30.734] [34.544]	2.1250	[48.8950] [53.9750]	2.5587	[64.9910]	12.61781	[320.49237]	14.000	[355.6]	5% 61/8	[146] [156]	2
14	350	14.000	[355.6]	8	1.562	[39.675]	2.1250	[55.9750]	2.6837	[68.1660]	13.87263	[352.36480]	15.000	[381.0]	63/8	[162]	2
16	400	16.000	[406.4]	8	1.812	[46.025]	2.4500	[62.2300]	2.8837	[73.2460]	15.87575	[403.24405]	17.000	[432]	63/4	[171]	2
18	450	18.000	[457]	8	2.000	[50.800]	2.4500	[67.3100]	3.0837	[78.3260]	17.87500	[454.02500]	19.000	[483]	7½ 7½	[181]	2
20	500	20.000	[508]	8	2.125	[53.975]	2.8500	[72.3900]	3.2837	[83.4060]	19.87031	[504.70587]	21.000	[533]	7 /8 75/8	[194]	2

X4. ELONGATION VALUES

X4.1 Tabulated in Table X4.1 are the minimum elongation values in inch-pound units, calculated using the equation given in Table 2.

TABLE X4.1 Elongation Values

		Specified Wall Thickness, in.	Elongation in 2 in., min, %			
- A :- 2		Tension Test Specimen		Specified Minimum Te		
Area, A, in. ²	3/4-in.	1-in.	1½-in.	•		
	Specimen	Specimen	Specimen	48 000	60 000	
0.75 and	0.994 and	0.746 and	0.497 and	36	30	
greater	greater	greater	greater			
0.74	0.980-0.993	0.735-0.745	0.490-0.496	36	29	
0.73	0.967–0.979	0.726-0.734	0.484-0.489	36	29	
0.72	0.954-0.966	0.715–0.725	0.477-0.483	36	29	
0.71	0.941-0.953	0.706-0.714	0.471-0.476	36	29	
0.70	0.927-0.940	0.695-0.705	0.464-0.470	36	29	
0.69	0.914-0.926	0.686-0.694	0.457-0.463	36	29	
0.68	0.900-0.913	0.675-0.685	0.450-0.456	35	29	
0.67	0.887-0.899	0.666-0.674	0.444-0.449	35	29	
0.66	0.874-0.886	0.655-0.665	0.437-0.443	35	29	
0.65	0.861-0.873	0.646-0.654	0.431-0.436	35	29	
0.64	0.847-0.860	0.635-0.645	0.424-0.430	35	29	
0.63	0.834-0.846	0.626-0.634	0.417-0.423	35	29	
0.62	0.820-0.833	0.615-0.625	0.410-0.416	35	28	
0.61	0.807-0.819	0.606-0.614	0.404-0.409	35	28	
0.60	0.794-0.806	0.595-0.605	0.397-0.403	35	28	
0.59	0.781-0.793	0.586-0.594	0.391-0.396	34	28	
0.58	0.767-0.780	0.575-0.585	0.384-0.390	34	28	
0.57	0.754-0.766	0.566-0.574	0.377-0.383	34	28	
0.56	0.740-0.753	0.555-0.565	0.370-0.376	34	28	
0.55	0.727-0.739	0.546-0.554	0.364-0.369	34	28	
0.54	0.714-0.726	0.535-0.545	0.357-0.363	34	28	
0.53	0.701-0.713	0.526-0.534	0.351-0.356	34	28	
0.52	0.687-0.700	0.515-0.525	0.344-0.350	34	27	
0.51	0.674-0.686	0.506-0.514	0.337-0.343	33	27	
0.50	0.660-0.673	0.495-0.505	0.330-0.336	33	27	
0.49	0.647-0.659	0.486-0.494	0.324-0.329	33	27	
0.48	0.634-0.646	0.475-0.485	0.317-0.323	33	27	
0.47	0.621-0.633	0.466-0.474	0.311-0.316	33	27	
0.46	0.607-0.620	0.455-0.465	0.304-0.310	33	27	
0.45	0.594-0.606	0.446-0.454	0.297-0.303	33	27	
0.44	0.580-0.593	0.435-0.445	0.290-0.296	32	27	
0.43	0.567-0.579	0.426-0.434	0.284-0.289	32	26	
0.42	0.554-0.566	0.415-0.425	0.277-0.283	32	26	
0.41	0.541-0.553	0.406-0.414	0.271-0.276	32	26	
0.40	0.527-0.540	0.395-0.405	0.264-0.270	32	26	
0.39	0.514-0.526	0.386-0.394	0.257-0.263	32	26	
0.38	0.500-0.513	0.375-0.385	0.250-0.256	32	26	
0.37	0.487-0.499	0.366-0.374	0.244-0.249	31	26	
0.36	0.474-0.486	0.355-0.365	0.237-0.243	31	26	
0.35	0.461-0.473	0.346-0.354	0.231-0.236	31	25	
0.34	0.447-0.460	0.335-0.345	0.224-0.230	31	25	
0.33	0.434-0.446	0.326-0.334	0.217-0.223	31	25	
0.32	0.420-0.433	0.315-0.325	0.210-0.216	30	25	
0.31	0.407-0.419	0.306-0.314	0.204-0.209	30	25	
0.30	0.394-0.406	0.295-0.305	0.197-0.203	30	25	
0.29	0.381-0.393	0.286-0.294	0.191-0.196	30	24	
0.28	0.367-0.380	0.275-0.285	0.184-0.190	30	24	
0.27	0.354-0.366	0.266-0.274	0.177-0.183	29	24	
0.26	0.340-0.353	0.255-0.265	0.170-0.176	29	24	
0.25	0.327-0.339	0.246-0.254	0.164-0.169	29	24	
0.24	0.314-0.326	0.235-0.245	0.157-0.163	29	24	
0.23	0.301-0.313	0.226-0.234	0.151-0.156	29	23	
0.22	0.287-0.300	0.215-0.225	0.144-0.150	28	23	
0.21	0.274-0.286	0.260-0.214	0.137-0.143	28	23	
0.20	0.260-0.273	0.195-0.205	0.130-0.136	28	23	
0.19	0.247-0.259	0.186-0.194	0.124-0.129	27	22	
0.18	0.234-0.246	0.175-0.185	0.117-0.123	27	22	
0.47	0.221-0.233	0.166-0.174	0.111-0.116	27	22	
0.17 0.16	0.207-0.220	0.155-0.165	0.104-0.110	27	22	

TABLE X4.1 Continued

	5	Specified Wall Thickness, in.		Elongation in 2	2 in., min, %	
Area, A, in. ²		Tension Test Specimen			Specified Minimum Tensile Strength, ps	
7.1.00, 7.1, 11.1	³⁄₄-in. Specimen	1-in. Specimen	1½-in. Specimen	48 000	60 000	
0.14	0.180-0.193	0.135-0.145	0.091-0.096	26	21	
0.13	0.167-0.179	0.126-0.134	0.084-0.090	25	21	
0.12	0.154-0.166	0.115-0.125	0.077-0.083	25	20	
0.11	0.141-0.153	0.106-0.114	0.071-0.076	25	20	
0.10	0.127-0.140	0.095-0.105	0.064-0.070	24	20	
0.09	0.114-0.126	0.086-0.094	0.057-0.063	24	19	
0.08	0.100-0.113	0.075-0.085	0.050-0.056	23	19	
0.07	0.087-0.099	0.066-0.074	0.044-0.049	22	18	
0.06	0.074-0.086	0.055-0.065	0.037-0.043	22	18	
0.05	0.061-0.073	0.046-0.054	0.031-0.036	21	17	
0.04	0.047-0.060	0.035-0.045	0.024-0.030	20	16	
0.03	0.034-0.046	0.026-0.034	0.017-0.023	19	16	
0.02	0.020-0.033	0.015-0.025	0.010-0.016	17	14	
0.01 and	0.019 and	0.014 and	0.009 and	15	12	
less	less	less	less			

X4.2 Tabulated in Table X4.2 are the minimum elongation values in SI units, calculated using the equation given in Table 2.

TABLE X4.2 Elongation Values

_	S	pecified Wall Thickness, mm	1	Elongation in 50	mm, min, %
Area, A, mm ²		Tension Test Specimen		Specified Minimum Te	nsile Strength, MP
Alca, A, IIIII –	19-mm	25-mm	38-mm		
	Specimen	Specimen	Specimen	330	415
500 and	26.3 and	20.0 and	13.2 and	36	30
greater	greater	greater	greater		
480-499	25.3-26.2	19.2-19.9	12.7-13.1	36	30
460-479	24.2-25.2	18.4-19.1	12.1-12.6	36	29
440-459	23.2-24.1	17.6-18.3	11.6-12.0	36	29
420-439	22.1-23.1	16.8-17.5	11.1-11.5	35	29
400-419	21.1-22.0	16.0-16.7	10.6-11.0	35	29
380-399	20.0-21.0	15.2-15.9	10.0-10.5	35	28
360-379	19.0-19.9	14.4-15.0	9.5-9.9	34	28
340-359	17.9-18.9	13.6-14.3	9.0-9.4	34	28
320-339	16.9-17.8	12.8-13.5	8.5-8.9	34	27
300-319	15.8-16.8	12.0-12.7	7.9-8.4	33	27
280-299	14.8-15.7	11.2-11.9	7.4-7.8	33	27
260-279	13.7-14.7	10.4-11.1	6.9-7.3	32	26
240-259	12.7-13.6	9.6-10.3	6.4-6.8	32	26
220-239	11.6-12.6	8.8-9.5	5.8-6.3	31	26
200-219	10.5-11.5	8.0-8.7	5.3-5.7	31	25
190-199	10.0-10.4	7.6-7.9	5.0-5.2	30	25
180-189	9.5-9.9	7.2-7.5	4.8-4.9	30	24
170-179	9.0-9.4	6.8-7.1	4.5-4.7	30	24
160-169	8.4-8.9	6.4-6.7	4.2-4.4	29	24
150-159	7.9-8.3	6.0-6.3	4.0-4.1	29	24
140-149	7.4-7.8	5.6-5.9	3.7-3.9	29	23
130-139	6.9-7.3	5.2-5.5	3.5-3.6	28	23
120-129	6.3-6.8	4.8-5.1	3.2-3.4	28	23
110-119	5.8-6.2	4.4-4.7	2.9-3.1	27	22
100-109	5.3-5.7	4.0-4.3	2.7-2.8	27	22
90-99	4.8-5.2	3.6-3.9	2.4-2.6	26	21
80-89	4.2-4.7	3.2-3.5	2.1-2.3	26	21
70-79	3.7-4.1	2.8-3.1	1.9-2.0	25	21
60-69	3.2-3.6	2.4-2.7	1.6-1.8	24	20
50-59	2.7-3.1	2.0-2.3		24	19
40-49	2.1-2.6	1.6-1.9		23	19
30-39	1.6-2.0			22	18



SPECIFICATION FOR CARBON STEEL FORGINGS FOR PIPING APPLICATIONS



SA-105/SA-105M

(23)

(Identical with ASTM Specification A105/A105M-21 except for addition of Footnote A call out next to vanadium composition limit in Table 1 and deletion of (mm) from the thickness variable (*T*) in Table 3 Note minimum elongation formula..)

Specification for Carbon Steel Forgings for Piping Applications

1. Scope

- 1.1 This specification covers forged carbon steel piping components for ambient- and higher-temperature service in pressure systems. Included are flanges, fittings, valves, and similar parts ordered either to dimensions specified by the purchaser or to dimensional standards such as the MSS, ASME, and API specifications referenced in Section 2. Forgings made to this specification are limited to a maximum weight of 10 000 lb [4540 kg]. Larger forgings may be ordered to Specification A266/A266M. Tubesheets and hollow cylindrical forgings for pressure vessel shells are not included within the scope of this specification. Although this specification covers some piping components machined from rolled bar and seamless tubular products (see 5.2), it does not cover raw material produced in these product forms.
- 1.2 Supplementary requirements are provided for use when additional testing or inspection is desired. These shall apply only when specified individually by the purchaser in the order.
- 1.3 Specification A266/A266M covers other steel forgings and Specifications A675/A675M and A696 cover other steel bars.
- 1.4 This specification is expressed in both inch-pound units and SI units. However, unless the order specifies the applicable "M" specification designation (SI units), the material shall be furnished to inch-pound units. The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other.

Combining values from the two systems may result in non-conformance with the standard.

Note 1—The dimensionless designator NPS (nominal pipe size) has been substituted in this standard for such traditional terms as "nominal diameter," "size," and "nominal size."

1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 In addition to those reference documents listed in Specification A961/A961M, the following list of standards apply to this specification:
 - 2.2 ASTM Standards:
 - A266/A266M Specification for Carbon Steel Forgings for Pressure Vessel Components
 - A675/A675M Specification for Steel Bars, Carbon, Hot-Wrought, Special Quality, Mechanical Properties
 - A696 Specification for Steel Bars, Carbon, Hot-Wrought or Cold-Finished, Special Quality, for Pressure Piping Components
 - A788/A788M Specification for Steel Forgings, General Requirements
 - A961/A961M Specification for Common Requirements for Steel Flanges, Forged Fittings, Valves, and Parts for Piping Applications
 - 2.3 MSS Standards:
 - SP 44 Standard for Steel Pipe Line Flanges

2.4 ASME Standards:

B16.5 Dimensional Standards for Steel Pipe Flanges and Flanged Fittings

B16.9 Wrought Steel Buttwelding Fittings

B16.10 Face-to-Face and End-to-End Dimensions of Ferrous Valves

B16.11 Forged Steel Fittings, Socket Weld, and Threaded

B16.34 Valves-Flanged, Threaded and Welding End

B16.47 Large Diameter Steel Flanges

2.5 ASME Boiler and Pressure Vessel Code: Section IX

2.6 API Standards:

API-600 Flanged and Butt-Welding-End Steel Gate Valves API-602 Compact Design Carbon Steel Gate Valves for Refinery Use

3. Terminology

- 3.1 *Definitions*—For definitions of other terms used in this specification, refer to Specification A961/A961M.
 - 3.2 Definitions of Terms Specific to This Standard:
- 3.2.1 *heaviest cross-section, n*—maximum heat treated thickness of the production forging.

4. Ordering Information

- 4.1 See Specification A961/A961M.
- 4.1.1 Additional requirements (see 14.2).

5. General Requirements

- 5.1 Product furnished to this specification shall conform to the requirements of Specification A961/A961M, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the requirements of Specification A961/A961M constitutes nonconformance with this specification. In case of a conflict between the requirements of this specification and Specification A961/A961M, this specification shall prevail.
- 5.2 Except as permitted by Section 6 in Specification A961/A961M, the finished product shall be a forging as defined in the Terminology Section of Specification A788/A788M.

6. Heat Treatment

- 6.1 Heat treatment is not a mandatory requirement of this specification except for the following piping components:
 - 6.1.1 Flanges above Class 300,
- 6.1.2 Flanges of special design where the design pressure at the design temperature exceeds the pressure-temperature ratings of Class 300, Group 1.1,
- 6.1.3 Flanges of special design where the design pressure or design temperature are not known,

TABLE 1 Chemical Requirements

Note 1—For each reduction of 0.01 % below the specified carbon maximum (0.35 %), an increase of 0.06 % manganese above the specified maximum (1.05 %) will be permitted up to a maximum of 1.65 %.

maximum (1.03 %) win be permitted up to a maximum of 1.03 %.			
Element	Composition, %		
Carbon	0.35 max		
Manganese	0.60-1.05		
Phosphorus	0.035 max		
Sulfur	0.040 max		
Silicon	0.10-0.35		
Copper	0.40 max ^A		
Nickel	0.40 max ^A		
Chromium	0.30 max ^{A,B}		
Molybdenum	0.12 max ^{A,B}		
Vanadium	0.08 max ^A		

 $^{^{}A}$ The sum of copper, nickel, chromium, molybdenum and vanadium shall not exceed 1.00 %.

- 6.1.4 Piping components other than flanges which meet both of the following criteria: (*I*) over NPS 4 and (2) above Class 300, and
- 6.1.5 Piping components of Special Class other than flanges which meet both of the following criteria: (1) over NPS 4 and (2) when the working pressure at the operating temperature exceeds the tabulated values for Special Class 300, Group 1.1.
- 6.2 Heat treatment, when required by 6.1 shall be annealing, normalizing, or normalizing and tempering or quenching and tempering in accordance with Specification A961/A961M. After hot working and before reheating for heat treatment, the forging shall be allowed to cool substantially below the transformation range.
- 6.2.1 Quenching shall consist of either (1) fully austenitizing the forgings followed by quenching in a suitable liquid medium or (2) using a multiple stage procedure whereby the forgings are first fully austenitized and rapidly cooled, then reheated to partially reaustenitize, followed by quenching in a suitable liquid medium. All quenched forgings shall be tempered as prescribed in Specification A961/A961M.

7. Chemical Composition

- 7.1 The steel shall conform to the chemical requirements specified in Table 1.
 - 7.2 Steels to which lead has been added shall not be used.

8. Mechanical Properties

- 8.1 The material shall conform to the mechanical property requirements prescribed in Table 2 and Table 3.
- 8.2 For normalized, normalized and tempered, or quenched and tempered forgings, the central axis of the test specimen shall be taken at least $\frac{1}{4}$ T from the nearest surface as-heat-treated, where T is the maximum heat-treated thickness of the represented forging. In addition, for quenched and tempered forgings, the midlength of the test specimen shall be at least T from all other surfaces as-heat-treated, exclusive of the T dimension surfaces. When section thickness does not permit

^B The sum of chromium and molybdenum shall not exceed 0.32 %.

TABLE 2 Mechanical Requirements^A

Tensile strength, min, ksi [MPa] 7	0 [485]
Yield strength, min, ksi [MPa] ^B 3	6 [250]
Elongation in 2 in. or 50 mm, min, %:	
Basic minimum elongation for walls 5/16 in. [7.9 mm]	30
and over in thickness, strip tests.	
When standard round 2-in. or 50-mm gauge length or	22
smaller proportionally sized specimen with the gauge	
length equal to 4D is used	
	1.50 ^C
decrease in wall thickness below 5/16 in. [7.9 mm]	
from the basic minimum elongation	
of the percentage points of Table 3	
Reduction of area, min, % ^D	30
Hardness, HBW, max	197

A For small forgings, see 8.3.4.

TABLE 3 Computed Minimum Values

	•		
Wall Thickne	Wall Thickness		
in.	mm	mm, min, %	
5/16 (0.312)	7.9	30.00	
%2 (0.281)	7.1	28.50	
1/4 (0.250)	6.4	27.00	
7/32 (0.219)	5.6	25.50	
3/16 (0.188)	4.8	24.00	
5/32 (0.156)	4.0	22.50	
1/8 (0.125)	3.2	21.00	
3/32 (0.094)	2.4	19.50	
1/16 (0.062)	1.6	18.00	

Note—The above table gives the computed minimum elongation values for each $\frac{1}{32}$ -in. [0.8-mm] decrease in wall thickness. Where the wall thickness lies between two values shown above, the minimum elongation value is determined by the following equation:

$$E = 48T + 15.00$$

where:

E = elongation in 2 in. or 50 mm, %, and

T =actual thickness of specimen, in.

this positioning, the test specimen shall be positioned as near as possible to the prescribed location.

- 8.3 Tension Tests:
- 8.3.1 One tension test shall be made for each heat of as-forged components.
- 8.3.2 One tension test shall be made from each heat-treating charge. If more than one heat is included in such a charge, each heat shall be tested.
- 8.3.2.1 When forgings of different shapes are included in the same heat-treating charge, the test specimen shall be obtained from the heaviest cross-section of the thickest forging, except for hubbed flanges (see 8.3.3). The test specimen shall represent all forgings from the same heat and heat-treating charge whose maximum thicknesses do not exceed the thickness of the test forging.
- 8.3.2.2 When the heat-treating temperatures are the same and the furnaces (either batch or continuous type), are controlled within ± 25 °F [± 14 °C] and equipped with recording pyrometers so that complete records of heat treatment are available, then one tension test from each heat is required

instead of one test from each heat in each heat-treatment charge. The test specimen material shall be included with a furnace charge.

8.3.3 Testing shall be performed as specified in Specification A961/A961M. The largest feasible round specimen shall be used except when hollow cylindrically shaped parts are machined from seamless tubulars. When hollow cylindrically shaped parts are machined from seamless tubular materials, strip tests may be used. The tension test specimen shall be obtained from a production forging, or from an integral prolongation representative of the hub location of a flange, or the heaviest cross section of a fitting, valve, or other part within the scope of this specification.

8.3.4 Forgings too small to permit obtaining a subsize specimen of 0.250 in. [6.35 mm] diameter or larger parallel to the dimension of maximum working, and produced in equipment unsuitable for the production of a separately forged test bar such as an automatic or semi-automatic press, may be accepted on the basis of hardness only. One percent of the forgings per lot, where a lot is the product from a heat, or, if heat treated, the product of a heat per furnace charge, or ten forgings, whichever is the lesser number, shall be selected at random, prepared, and tested using the standard Brinell test. The locations of the indentations shall be at the option of the manufacturer but shall be selected to be representative of the forging as a whole. One indentation per forging shall be required but additional indentations may be made to establish the representative hardness. The hardness of all forgings so tested shall be 137 to 197 HBW inclusive.

8.4 Hardness Tests:

- 8.4.1 Two hardness tests shall be made for each heat of as-forged components. When more than one forging is produced from each heat, a minimum of two forgings shall be tested with one reading from each forging. When only one forging is produced, it shall be tested in two locations.
- 8.4.2 Except when only one forging is produced, a minimum of two forgings shall be hardness tested per batch or continuous run as defined in 8.3.2.2 to ensure that forgings are within the hardness limits given in Table 2. When only one forging is produced, it shall be hardness tested in two locations to ensure it is within the hardness limits given in Table 2.
- 8.4.3 Testing shall be as specified in Specification A961/A961M. The purchaser may verify that the requirement has been met by testing at any location on the forging, provided such testing does not render the forging useless.

9. Hydrostatic Tests

9.1 Such tests shall be conducted by the forging manufacturer only when Supplementary Requirement S57 in Specification A961/A961M is specified.

10. Retreatment

10.1 If the results of the mechanical tests do not conform to the requirement specified, the manufacturer may heat treat or reheat treat the forgings as applicable and repeat the test specified in Section 8.

 $^{^{\}it B}$ Determined by either the 0.2 % offset method or the 0.5 % extension-under-load method.

^C See Table 3 for computed minimum values.

^D For round specimens only.

11. Surface Finish, Appearance, and Corrosion Protection

11.1 The requirements of Specification A961/A961M apply to forgings and finished parts.

12. Repair by Welding

- 12.1 Repair of defects by the manufacturer is permissible for forgings made to dimensional standards such as those of ASME or for other parts made for stock by the manufacturer. Prior approval of the purchaser is required to repair-weld special forgings made to the purchaser's requirements.
- 12.2 Weld repairs shall be made by a process that does not produce undesirably high levels of hydrogen in the welded areas.
- 12.3 All forgings repaired by welding shall be post-weld heat treated between 1100 °F [593 °C] and the lower transformation temperature for a minimum of ½ h/in. [½ h/25.4 mm] of maximum section thickness, or alternatively annealed, normalized and tempered, or quenched and tempered. If the forging was not previously heat treated, the original tempering temperature was exceeded, or the forging was fully heat treated in the post weld cycle, then the forging shall be tested in accordance with Section 8 on completion of the cycle.
- 12.4 The mechanical properties of the procedurequalification weldment shall, when tested in accordance with Section IX of the ASME Boiler and Pressure Vessel Code, conform with the requirements listed in Table 2 for the thermal condition of repair-welded forgings.

13. Rejection and Rehearing

13.1 Each forging that develops injurious defects during shop working or application shall be rejected and the manufacturer notified.

14. Certification

- 14.1 *Identification Marking*—For forgings made to specified dimensions, when agreed upon by the purchaser, and for forgings made to dimensional standards, application of identification marks as required in Specification A961/A961M shall be the certification that the forgings have been furnished in accordance with the requirements of this specification.
- 14.2 *Test Reports*—The manufacturer shall also provide the following, where applicable:
 - 14.2.1 Type heat treatment, Section 6,

- 14.2.2 Tensile property results, Section 8 (Table 2), report the yield strength and tensile strength, in ksi [MPa], elongation and reduction in area, in percent; and, if longitudinal strip tension specimens are used, report the width of the gauge length,
- 14.2.3 Chemical analysis results, Section 7 (Table 1), reported results shall be to the same number of significant figures as the limits specified in Table 1 for that element.
- 14.2.4 Hardness results, Section 8 (Table 2), a minimum of two readings, and
- 14.2.5 Any supplementary testing required by the purchase order.

15. Product Marking

- 15.1 In addition to marking requirements of Specification A961/A961M, the following additional marking requirements shall apply:
- 15.1.1 If the forgings have been quenched and tempered, the letters "QT" shall be stamped on the forgings following this specification number.
- 15.1.2 Forgings repaired by welding shall be marked with the letter "W" following this specification number.
- 15.1.3 Plugs and bushings furnished to ASME B16.11 requirements are not required to be marked. Other parts ordered with no marking are by agreement between the purchaser and manufacturer.
- 15.1.4 When agreed upon between the purchaser and manufacturer and specified in the order, the markings shall be painted or stenciled on the fitting or stamped on a metal or plastic tag which shall be securely attached to the fitting.
- 15.2 Bar Coding—In addition to the requirements in Specification A961/A961M, bar coding is acceptable as a supplemental identification method. The purchaser may specify in the order a specific bar coding system to be used. The bar coding system, if applied at the discretion of the supplier, should be consistent with one of the published industry standards for bar coding. If used on small parts, the bar code may be applied to the box or a substantially applied tag.

16. Keywords

16.1 pipe fittings, steel; piping applications; pressure containing parts; steel flanges; steel forgings, carbon; steel valves; temperature service applications, elevated; temperature service applications, high

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall apply only when specified by the purchaser in the inquiry, contract, and order.

S1. Hardness

S1.1 The purchaser may check the hardness of any or all forgings supplied at any location on the forging and the hardness shall be 137 to 197 HBW. All forgings not within the specified hardness range shall be rejected.

S2. Heat Treatment

- S2.1 All forgings shall be heat treated as specified by the purchaser.
- S2.2 When forgings not requiring heat treatment by 6.1 are supplied heat treated by purchaser request, the basis for determining conformance with Table 2 and Table 3 shall be hardness testing per 8.4 and either (1) tensile testing of heat treated forgings per 8.2, or (2) tensile tests from as-forged forgings or separately forged test blanks, as agreed upon between the supplier and purchaser.
- S2.3 When test reports are required, and tensile test results were obtained from as-forged forgings or as-forged test blanks, it shall be so indicated on the test report.
- S2.4 In addition to the marking required by Section 15, this specification shall be followed by the letter: A for annealed, N for normalized, NT for normalized and tempered, or QT for quenched and tempered, as appropriate.

S3. Marking Small Forgings

- S3.1 For small products where the space for marking is less than 1 in. [25 mm] in any direction, test reports are mandatory and marking may be restricted to only such symbols or codes as are necessary to identify the parts with test reports.
- S3.2 When the configuration or size does not permit marking directly on the forging, the marking method shall be a matter of agreement between the manufacturer and the purchaser.

S4. Carbon Equivalent

- S4.1 The maximum carbon equivalent, based on heat analysis, shall be 0.47 for forgings with a maximum section thickness of 2 in. or less, and 0.48 for forgings with a maximum section thickness of greater than 2 in.
 - S4.2 Determine the carbon equivalent (CE) as follows:

$$CE = C + Mn/6 + (Cr + Mo + V)/5 + (Ni + Cu)/15$$

S4.3 A lower maximum carbon equivalent may be agreed upon between the supplier and the purchaser.

SPECIFICATION FOR SEAMLESS CARBON STEEL PIPE FOR HIGH-TEMPERATURE SERVICE



SA-106/SA-106M



(23)

(Identical with ASTM Specification A106/A106M-19a.)

Specification for Seamless Carbon Steel Pipe for High-Temperature Service

1. Scope

1.1 This specification covers seamless carbon steel pipe for high-temperature service (Note 1) in NPS ½ to NPS 48 [DN 6 to DN 1200] (Note 2) inclusive, with nominal (average) wall thickness as given in ASME B 36.10M. It shall be permissible to furnish pipe having other dimensions provided such pipe complies with all other requirements of this specification. Pipe ordered under this specification shall be suitable for bending, flanging, and similar forming operations, and for welding. When the steel is to be welded, it is presupposed that a welding procedure suitable to the grade of steel and intended use or service will be utilized.

Note 1—It is suggested, consideration be given to possible graphitization.

Note 2—The dimensionless designator NPS (nominal pipe size) [DN (diameter nominal)] has been substituted in this standard for such traditional terms as "nominal diameter," "size," and "nominal size."

- 1.2 Supplementary requirements of an optional nature are provided for seamless pipe intended for use in applications where a superior grade of pipe is required. These supplementary requirements call for additional tests to be made and when desired shall be so stated in the order.
- 1.3 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.4 The following precautionary caveat pertains only to the test method portion, Sections 11, 12, and 13 of this specification: This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.

1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A530/A530M Specification for General Requirements for Specialized Carbon and Alloy Steel Pipe

E213 Practice for Ultrasonic Testing of Metal Pipe and Tubing

E309 Practice for Eddy Current Examination of Steel Tubular Products Using Magnetic Saturation

E381 Method of Macroetch Testing Steel Bars, Billets, Blooms, and Forgings

E570 Practice for Flux Leakage Examination of Ferromagnetic Steel Tubular Products

2.2 ASME Standard:

ASME B 36.10M Welded and Seamless Wrought Steel Pipe

2.3 Military Standards:

MIL-STD-129 Marking for Shipment and Storage

MIL-STD-163 Steel Mill Products, Preparation for Shipment and Storage

2.4 Federal Standard:

Fed. Std. No. 123 Marking for Shipments (Civil Agencies)Fed. Std. No. 183 Continuous Identification Marking of Iron and Steel Products

2.5 Other Standards:

SSPC-SP 6 Surface Preparation Specification No. 6

3. Ordering Information

- 3.1 The inclusion of the following, as required will describe the desired material adequately, when ordered under this specification:
 - 3.1.1 Quantity (feet, metres, or number of lengths),
 - 3.1.2 Name of material (seamless carbon steel pipe),
 - 3.1.3 Grade (Table 1),
 - 3.1.4 Manufacture (hot-finished or cold-drawn),
- 3.1.5 Size (NPS [DN] and weight class or schedule number, or both; outside diameter and nominal wall thickness; or inside diameter and nominal wall thickness),
 - 3.1.6 Special outside diameter tolerance pipe (16.2.2),
- 3.1.7 Inside diameter tolerance pipe, over 10 in. [250 mm] ID (16.2.3),
 - 3.1.8 Length (specific or random, Section 17),
 - 3.1.9 Optional requirements (S1 to S9),
- 3.1.10 Test report required (Section on Certification of Specification A530/A530M),
- 3.1.11 Specification designation (A106 or A106M, including year-date),
 - 3.1.12 End use of material,
- 3.1.13 Hydrostatic test in accordance with Specification A530/A530M or 13.3 of this specification, or NDE in accordance with Section 14 of this specification.
 - 3.1.14 Special requirements.

4. Process

- 4.1 The steel shall be killed steel, with the primary melting process being open-hearth, basic-oxygen, or electric-furnace, possibly combined with separate degassing or refining. If secondary melting, using electroslag remelting or vacuum-arc remelting is subsequently employed, the heat shall be defined as all of the ingots remelted from a single primary heat.
- 4.2 Steel cast in ingots or strand cast is permissible. When steels of different grades are sequentially strand cast, identification of the resultant transition material is required. The producer shall remove the transition material by any established procedure that positively separates the grades.

TABLE 1 Chemical Requirements

		Composition, %	_
	Grade A	Grade B	Grade C
Carbon, max	0.25 ^A	0.30 ^B	0.35 ^B
Manganese	0.27-0.93	0.29-1.06	0.29-1.06
Phosphorus, max	0.035	0.035	0.035
Sulfur, max	0.035	0.035	0.035
Silicon, min	0.10	0.10	0.10
Chromium, max ^C	0.40	0.40	0.40
Copper, max ^C	0.40	0.40	0.40
Molybdenum, max ^C	0.15	0.15	0.15
Nickel, max ^C	0.40	0.40	0.40
Vanadium, max ^C	0.08	0.08	0.08

 $^{^{\}rm A}$ For each reduction of 0.01 % below the specified carbon maximum, an increase of 0.06 % manganese above the specified maximum will be permitted up to a maximum of 1.35 %.

- 4.3 For pipe NPS 1½ [DN 40] and under, it shall be permissible to furnish hot finished or cold drawn.
- 4.4 Unless otherwise specified, pipe NPS 2 [DN 50] and over shall be furnished hot finished. When agreed upon between the manufacturer and the purchaser, it is permissible to furnish cold-drawn pipe.

5. Heat Treatment

- 5.1 Hot-finished pipe need not be heat treated. When hot-finished pipe is heat treated, it shall be heat treated at a temperature of 1200 °F [650 °C] or higher.
- 5.2 Cold-drawn pipe shall be heat treated after the final cold draw pass at a temperature of 1200 °F [650 °C] or higher.

6. General Requirements

6.1 Material furnished to this specification shall conform to the applicable requirements of the current edition of Specification A530/A530M unless otherwise provided herein.

7. Chemical Composition

7.1 The steel shall conform to the requirements as to chemical composition prescribed in Table 1.

8. Heat Analysis

8.1 An analysis of each heat of steel shall be made by the steel manufacturer to determine the percentages of the elements specified in Section 7. If the secondary melting processes of 5.1 are employed, the heat analysis shall be obtained from one remelted ingot or the product of one remelted ingot of each primary melt. The chemical composition thus determined, or that determined from a product analysis made by the manufacturer, if the latter has not manufactured the steel, shall be reported to the purchaser or the purchaser's representative, and shall conform to the requirements specified in Section 7.

9. Product Analysis

- 9.1 At the request of the purchaser, analyses of two pipes from each lot (see 20.1) shall be made by the manufacturer from the finished pipe. The results of these analyses shall be reported to the purchaser or the purchaser's representative and shall conform to the requirements specified in Section 7.
- 9.2 If the analysis of one of the tests specified in 9.1 does not conform to the requirements specified in Section 7, analyses shall be made on additional pipes of double the original number from the same lot, each of which shall conform to requirements specified.

10. Tensile Requirements

10.1 The material shall conform to the requirements as to tensile properties given in Table 2.

11. Bending Requirements

11.1 For pipe NPS 2 [DN 50] and under, a sufficient length of pipe shall stand being bent cold through 90° around a cylindrical mandrel, the diameter of which is twelve times the outside diameter (as shown in ASME B 36.10M) of the pipe,

^BUnless otherwise specified by the purchaser, for each reduction of 0.01 % below the specified carbon maximum, an increase of 0.06 % manganese above the specified maximum will be permitted up to a maximum of 1.65 %.

^C These five elements combined shall not exceed 1 %.

TABLE 2 Tensile Requirements

	Gra	ade A	Gra	ade B	Gra	ade C
Tensile strength, min, psi [MPa]	48 00	00 [330]	60 00	00 [415]	70 00	00 [485]
Yield strength, min, psi [MPa]	30 00	00 [205]	35 000 [240]		40 000 [275]	
	Longitu-	Transverse	Longitu-	Transverse	Longitu-	Transverse
	dinal		dinal		dinal	
Elongation in 2 in. [50 mm], min, %:						
Basic minimum elongation transverse strip tests, and for all small sizes tested in full section	35	25	30	16.5	30	16.5
When standard round 2-in. [50-mm] gauge length test specimen is used	28	20	22	12	20	12
For longitudinal strip tests	Α		Α		A	
For transverse strip tests, a deduction for each ½2-in. [0.8-mm] decrease in wall thickness below 5¼6 in. [7.9 mm] from the basic minimum elongation of the following percentage shall be made		1.25		1.00		1.00

 $^{^{\}it A}$ The minimum elongation in 2 in. [50 mm] shall be determined by the following equation:

 $e = 625000A^{0.2}/U^{0.9}$

for inch-pound units, and

 $e = 1940A^{0.2}/U^{0.9}$

for SI units,

where:

e = minimum elongation in 2 in. [50 mm], %, rounded to the nearest 0.5 %,

A = cross-sectional area of the tension test specimen, in.² [mm²], based upon specified outside diameter or nominal specimen width and specified wall thickness, rounded to the nearest 0.01 in.² [1 mm²]. (If the area thus calculated is equal to or greater than 0.75 in.² [500 mm²], then the value 0.75 in.² [500 mm²] shall be used.), and

U = specified tensile strength, psi [MPa].

without developing cracks. When ordered for close coiling, the pipe shall stand being bent cold through 180° around a cylindrical mandrel, the diameter of which is eight times the outside diameter (as shown in ASME B 36.10M) of the pipe, without failure.

11.2 For pipe whose diameter exceeds 25 in. [635 mm] and whose diameter to wall thickness ratio, where the diameter to wall thickness ratio is the specified outside diameter divided by the nominal wall thickness, is 7.0 or less, the bend test shall be conducted. The bend test specimens shall be bent at room temperature through 180° with the inside diameter of the bend being 1 in. [25 mm] without cracking on the outside portion of the bent portion.

Example: For 28 in. [711 mm] diameter 5.000 in. [127 mm] thick pipe the diameter to wall thickness ratio = 28/5 = 5.6 [711/127 = 5.6].

12. Flattening Tests

12.1 Although testing is not required, pipe shall be capable of meeting the flattening test requirements of Supplementary Requirement S3, if tested.

13. Hydrostatic Test

- 13.1 Except as allowed by 13.2, 13.3, and 13.4, each length of pipe shall be subjected to the hydrostatic test without leakage through the pipe wall.
- 13.2 As an alternative to the hydrostatic test at the option of the manufacturer or where specified in the purchase order, it shall be permissible for the full body of each pipe to be tested with a nondestructive electric test described in Section 14.
- 13.3 Where specified in the purchase order, it shall be permissible for pipe to be furnished without the hydrostatic test and without the nondestructive electric test in Section 14; in

this case, each length so furnished shall include the mandatory marking of the letters "NH." It shall be permissible for pipe meeting the requirements of 13.1 or 13.2 to be furnished where pipe without either the hydrostatic or nondestructive electric test has been specified in the purchase order; in this case, such pipe need not be marked with the letters "NH." Pipe that has failed either the hydrostatic test of 13.1 or the nondestructive electric test of 13.2 shall not be furnished as "NH" pipe.

13.4 Where the hydrostatic test and the nondestructive electric test are omitted and the lengths marked with the letters "NH," the certification, where required, shall clearly state "Not Hydrostatically Tested," and the letters "NH" shall be appended to the product specification number and material grade shown on the certification.

14. Nondestructive Electric Test

- 14.1 As an alternative to the hydrostatic test at the option of the manufacturer or where specified in the purchase order as an alternative or addition to the hydrostatic test, the full body of each pipe shall be tested with a nondestructive electric test in accordance with Practice E213, E309, or E570. In such cases, the marking of each length of pipe so furnished shall include the letters "NDE." It is the intent of this nondestructive electric test to reject pipe with imperfections that produce test signals equal to or greater than that produced by the applicable calibration standard.
- 14.2 Where the nondestructive electric test is performed, the lengths shall be marked with the letters "NDE." The certification, where required, shall state "Nondestructive Electric Tested" and shall indicate which of the tests was applied. Also, the letters "NDE" shall be appended to the product specification number and material grade shown on the certification.

- 14.3 The following information is for the benefit of the user of this specification:
- 14.3.1 The reference standards defined in 14.4 through 14.6 are convenient standards for calibration of nondestructive testing equipment. The dimensions of such standards are not to be construed as the minimum sizes of imperfections detectable by such equipment.
- 14.3.2 The ultrasonic testing referred to in this specification is capable of detecting the presence and location of significant longitudinally or circumferentially oriented imperfections; however, different techniques need to be employed for the detection of such differently oriented imperfections. Ultrasonic testing is not necessarily capable of detecting short, deep imperfections.
- 14.3.3 The eddy current examination referenced in this specification has the capability of detecting significant imperfections, especially of the short abrupt type.
- 14.3.4 The flux leakage examination referred to in this specification is capable of detecting the presence and location of significant longitudinally or transversely oriented imperfections; however, different techniques need to be employed for the detection of such differently oriented imperfections.
- 14.3.5 The hydrostatic test referred to in Section 13 has the capability of finding defects of a size permitting the test fluid to leak through the tube wall and may be either visually seen or detected by a loss of pressure. Hydrostatic testing is not necessarily capable of detecting very tight, through-the-wall imperfections or imperfections that extend an appreciable distance into the wall without complete penetration.
- 14.3.6 A purchaser interested in ascertaining the nature (type, size, location, and orientation) of discontinuities that can be detected in the specific applications of these examinations is directed to discuss this with the manufacturer of the tubular product.
- 14.4 For ultrasonic testing, the calibration reference notches shall be, at the option of the producer, any one of the three common notch shapes shown in Practice E213. The depth of notch shall not exceed $12\frac{1}{2}$ % of the specified wall thickness of the pipe or 0.004 in. [0.1 mm], whichever is greater.
- 14.5 For eddy current testing, the calibration pipe shall contain, at the option of the producer, any one of the following discontinuities to establish a minimum sensitivity level for rejection:
- 14.5.1 *Drilled Hole*—The calibration pipe shall contain depending upon the pipe diameter three holes spaced 120° apart or four holes spaced 90° apart and sufficiently separated longitudinally to ensure separately distinguishable responses. The holes shall be drilled radially and completely through the pipe wall, care being taken to avoid distortion of the pipe while drilling. Depending upon the pipe diameter the calibration pipe shall contain the following hole:

NPS	DN	Diameter of Drilled Hole
≤ 1/2	≤ 15	0.039 in. [1 mm]
> ½ ≤ 1¼	> 15 ≤ 32	0.055 in. [1.4 mm]
> 11/4 ≤ 2	> 32 ≤ 50	0.071 in. [1.8 mm]
> 2 ≤ 5	> 50 ≤ 125	0.087 in. [2.2 mm]
>5	> 125	0.106 in. [2.7 mm]

14.5.2 Transverse Tangential Notch—Using a round tool or file with a ½-in. [6-mm] diameter, a notch shall be filed or

milled tangential to the surface and transverse to the longitudinal axis of the pipe. The notch shall have a depth not exceeding $12 \frac{1}{2} \%$ of the specified wall thickness of the pipe or 0.004 in. [0.1 mm], whichever is greater.

14.5.3 Longitudinal Notch—A notch 0.031 in. [0.8 mm] or less in width shall be machined in a radial plane parallel to the tube axis on the outside surface of the pipe, to have a depth not exceeding $12 \frac{1}{2} \%$ of the specified wall thickness of the tube or 0.004 in. [0.1 mm], whichever is greater. The length of the notch shall be compatible with the testing method.

14.5.4 *Compatibility*—The discontinuity in the calibration pipe shall be compatible with the testing equipment and the method being used.

14.6 For flux leakage testing, the longitudinal calibration reference notches shall be straight-sided notches machined in a radial plane parallel to the pipe axis. For wall thicknesses under ½ in. [12.7 mm], outside and inside notches shall be used; for wall thicknesses equal to and above ½ in. [12.7 mm], only an outside notch shall be used. Notch depth shall not exceed 12½% of the specified wall thickness, or 0.004 in. [0.1 mm], whichever is greater. Notch length shall not exceed 1 in. [25 mm], and the width shall not exceed the depth. Outside diameter and inside diameter notches shall be located sufficiently apart to allow separation and identification of the signals.

14.7 Pipe containing one or more imperfections that produce a signal equal to or greater than the signal produced by the calibration standard shall be rejected or the area producing the signal shall be reexamined.

14.7.1 Test signals produced by imperfections which cannot be identified, or produced by cracks or crack-like imperfections shall result in rejection of the pipe, unless it is repaired and retested. To be accepted, the pipe must pass the same specification test to which it was originally subjected, provided that the remaining wall thickness is not decreased below that permitted by this specification. The OD at the point of grinding may be reduced by the amount so reduced.

14.7.2 Test signals produced by visual imperfections such as those listed below may be evaluated in accordance with the provisions of Section 18:

14.7.2.1 Dinges,

14.7.2.2 Straightener marks,

14.7.2.3 Cutting chips,

14.7.2.4 Scratches,

14.7.2.5 Steel die stamps,

14.7.2.6 Stop marks, or

14.7.2.7 Pipe reducer ripple.

14.8 The test methods described in this section are not necessarily capable of inspecting the end portion of pipes, a condition referred to as "end effect." The length of such end effect shall be determined by the manufacturer and, when specified in the purchase order, reported to the purchaser.

15. Nipples

15.1 Nipples shall be cut from pipe of the same dimensions and quality described in this specification.

16. Dimensions, Mass, and Permissible Variations

- 16.1 Mass—The mass of any length of pipe shall not vary more than 10 % over and 3.5 % under that specified. Unless otherwise agreed upon between the manufacturer and the purchaser, pipe in NPS 4 [DN 100] and smaller may be weighed in convenient lots; pipe larger than NPS 4 [DN 100] shall be weighed separately.
- 16.2 *Diameter*—Except as provided for thin-wall pipe in paragraph 12.2 of Specification A530/A530M, the tolerances for diameter shall be in accordance with the following:
- 16.2.1 Except for pipe ordered as special outside diameter tolerance pipe or as inside diameter tolerance pipe, variations in outside diameter shall not exceed those given in Table 3.
- 16.2.2 For pipe over 10 in. [250 mm] OD ordered as special outside diameter tolerance pipe, the outside diameter shall not vary more than 1 % over or 1 % under the specified outside diameter.
- 16.2.3 For pipe over 10 in. [250 mm] ID ordered as inside diameter tolerance pipe, the inside diameter shall not vary more than 1 % over or 1 % under the specified inside diameter.
- 16.3 *Thickness*—The minimum wall thickness at any point shall not be more than $12.5\,\%$ under the specified wall thickness.

17. Lengths

- 17.1 Pipe lengths shall be in accordance with the following regular practice:
- 17.1.1 The lengths required shall be specified in the order, and
 - 17.1.2 No jointers are permitted unless otherwise specified.
- 17.1.3 If definite lengths are not required, pipe may be ordered in single random lengths or in double random lengths meeting the following requirements:
- 17.1.3.1 Single random lengths shall be 16 to 22 ft [4.8 to 6.7 m] in length, except that 5 % shall be permitted to be less than 16 ft [4.8 m] and none shall be less than 12 ft [3.7 m].
- 17.1.3.2 Double random lengths shall have a minimum average length of 35 ft [10.7 m] and shall have a minimum length of 22 ft [6.7 m], except that 5 % shall be permitted to be less than 22 ft [6.7 m] and none shall be less than 16 ft [4.8 m].

TABLE 3 Variations in Outside Diameter

		Permissible Variations in Outside Diameter				
NPS [DN Designator]	Ove	Over		Under		
	in.	mm	in.	mm		
1/8 to 11/2 [6 to 40], incl	1/64 (0.015)	0.4	1/64 (0.015)	0.4		
Over 1½ to 4 [40 to 100], incl	1/32 (0.031)	8.0	1/32 (0.031)	8.0		
Over 4 to 8 [100 to 200], incl	1/16 (0.062)	1.6	1/32 (0.031)	8.0		
Over 8 to 18 [200 to 450], incl	3/32 (0.093)	2.4	1/32 (0.031)	8.0		
Over 18 to 26 [450 to 650], incl	1/8 (0.125)	3.2	1/32 (0.031)	0.8		
Over 26 to 34 [650 to 850], incl	5/32 (0.156)	4.0	1/32 (0.031)	0.8		
Over 34 to 48 [850 to 1200], incl	3/16 (0.187)	4.8	1/32 (0.031)	0.8		

18. Workmanship, Finish and Appearance

- 18.1 The pipe manufacturer shall explore a sufficient number of visual surface imperfections to provide reasonable assurance that they have been properly evaluated with respect to depth. Exploration of all surface imperfections is not required but consideration should be given to the necessity of exploring all surface imperfections to assure compliance with 18.2
- 18.2 Surface imperfections that penetrate more than $12\frac{1}{2}$ % of the nominal wall thickness or encroach on the minimum wall thickness shall be considered defects. Pipe with such defects shall be given one of the following dispositions:
- 18.2.1 The defect shall be removed by grinding, provided that the remaining wall thickness is within the limits specified in 16.3.
- 18.2.2 Repaired in accordance with the repair welding provisions of 18.6.
- 18.2.3 The section of pipe containing the defect may be cut off within the limits of requirements on length.
 - 18.2.4 Rejected.
- 18.3 To provide a workmanlike finish and basis for evaluating conformance with 18.2 the pipe manufacturer shall remove by grinding the following noninjurious imperfections:
- 18.3.1 Mechanical marks and abrasions—such as cable marks, dinges, guide marks, roll marks, ball scratches, scores, and die marks—and pits, any of which imperfections are deeper than ½ in. [1.6 mm].
- 18.3.2 Visual imperfections commonly referred to as scabs, seams, laps, tears, or slivers found by exploration in accordance with 18.1 to be deeper than $5\,\%$ of the nominal wall thickness.
- 18.4 At the purchaser's discretion, pipe shall be subjected to rejection if surface imperfections acceptable under 18.2 are not scattered, but appear over a large area in excess of what is considered a workmanlike finish. Disposition of such pipe shall be a matter of agreement between the manufacturer and the purchaser.
- 18.5 When imperfections or defects are removed by grinding, a smooth curved surface shall be maintained, and the wall thickness shall not be decreased below that permitted by this specification. The outside diameter at the point of grinding is permitted to be reduced by the amount so removed.
- 18.5.1 Wall thickness measurements shall be made with a mechanical caliper or with a properly calibrated nondestructive testing device of appropriate accuracy. In case of dispute, the measurement determined by use of the mechanical caliper shall govern.
- 18.6 Weld repair shall be permitted only subject to the approval of the purchaser and in accordance with Specification A530/A530M.
 - 18.7 The finished pipe shall be reasonably straight.

19. End Finish

19.1 The Pipe shall be furnished to the following practice, unless otherwise specified.

- 19.1.1 NPS 1½ [DN 40] and Smaller—All walls shall be either plain-end square cut, or plain-end beveled at the option of the manufacturer.
- 19.1.2 NPS 2 [DN 50] and Larger—Walls through extra strong weights, shall be plain-end-beveled.
- 19.1.3 NPS 2 [DN 50] and Larger—Walls over extra strong weights, shall be plain-end square cut.
- 19.2 Plain-end beveled pipe shall be plain-end pipe having a bevel angle of 30° , $+5^{\circ}$ or -0° , as measured from a line drawn perpendicular to the axis of the pipe with a root face of $\frac{1}{16} \pm \frac{1}{32}$ in. [1.6 \pm 0.8 mm]. Other bevel angles may be specified by agreement between the purchaser and the manufacturer.

20. Sampling

- 20.1 For product analysis (see 9.1) and tensile tests (see 21.1), a lot is the number of lengths of the same size and wall thickness from any one heat of steel; of 400 lengths or fraction thereof, of each size up to, but not including, NPS 6 [DN 150]; and of 200 lengths or fraction thereof of each size NPS 6 [DN 150] and over.
- 20.2 For bend tests (see 21.2), a lot is the number of lengths of the same size and wall thickness from any one heat of steel, of 400 lengths or fraction thereof, of each size.
- 20.3 For flattening tests, a lot is the number of lengths of the same size and wall thickness from any one heat of steel, of 400 lengths or fraction thereof of each size over NPS 2 [DN 50], up to but not including NPS 6 [DN 150], and of 200 lengths or fraction thereof, of each size NPS 6 [DN 150] and over.

21. Number of Tests

- 21.1 The tensile requirements specified in Section 10 shall be determined on one length of pipe from each lot (see 20.1).
- 21.2 For pipe NPS 2 [DN 50] and under, the bend test specified in 11.1 shall be made on one pipe from each lot (see 20.2). The bend test, where used as required by 11.2, shall be made on one end of 5% of the pipe from each lot. For small lots, at least one pipe shall be tested.
- 21.3 If any test specimen shows flaws or defective machining, it shall be permissible to discard it and substitute another test specimen.

22. Retests

22.1 If the percentage of elongation of any tension test specimen is less than that given in Table 1 and any part of the fracture is more than ³/₄ in. [19 mm] from the center of the gauge length of a 2-in. [50-mm] specimen as indicated by scribe scratches marked on the specimen before testing, a retest shall be allowed. If a specimen breaks in an inside or outside surface flaw, a retest shall be allowed.

23. Test Specimens and Test Methods

23.1 On NPS 8 [DN 200] and larger, specimens cut either longitudinally or transversely shall be acceptable for the tension test. On sizes smaller than NPS 8 [DN 200], the longitudinal test only shall be used.

- 23.2 When round tension test specimens are used for pipe wall thicknesses over 1.0 in. [25.4 mm], the mid–length of the longitudinal axis of such test specimens shall be from a location midway between the inside and outside surfaces of the pipe.
- 23.3 Test specimens for the bend test specified in Section 11 and for the flattening tests shall consist of sections cut from a pipe. Specimens for flattening tests shall be smooth on the ends and free from burrs, except when made on crop ends.
- 23.4 Test specimens for the bend test specified in 11.2 shall be cut from one end of the pipe and, unless otherwise specified, shall be taken in a transverse direction. One test specimen shall be taken as close to the outer surface as possible and another from as close to the inner surface as possible. The specimens shall be either ½ by ½ in. [12.5 by 12.5 mm] in section or 1 by ½ in. [25 by 12.5 mm] in section with the corners rounded to a radius not over ¼ in. [1.6 mm] and need not exceed 6 in. [150 mm] in length. The side of the samples placed in tension during the bend shall be the side closest to the inner and outer surface of the pipe respectively.
- 23.5 All routine check tests shall be made at room tempera-
- 23.6 All tests shall be performed after the heat treatments permitted by 5.1 or required by 5.2.

24. Certification

24.1 In the required test report(s), in addition to the requirements of Specification A530/A530M, the producer or supplier shall furnish to the purchaser a chemical analysis report for the elements specified in Table 1.

25. Product Marking

25.1 In addition to the marking prescribed in Specification A530/A530M, the marking shall include heat number, the information as per Table 4, an additional symbol "S" if one or more of the supplementary requirements apply; the length, OD 1 %, if ordered as special outside diameter tolerance pipe; ID 1 %, if ordered as special inside diameter tolerance pipe; the schedule number, weight class, or nominal wall thickness; and, for sizes larger than NPS 4 [DN 100], the weight. Length shall be marked in feet and tenths of a foot [metres to two decimal places], depending on the units to which the material was ordered, or other marking subject to agreement. For sizes NPS 1½, 1¼, 1, and ¾ [DN 40, 32, 25, and 20], each length shall be marked as prescribed in Specification A530/A530M. These sizes shall be bundled in accordance with standard mill practice and the total bundle footage marked on the bundle tag; individual lengths of pipe need not be marked with footage. For sizes less than NPS 3/4 [DN 20], all the required markings shall be on the bundle tag or on each length of pipe and shall

TABLE 4 Marking

Hydro	NDE	Marking
Yes	No	Test Pressure
No	Yes	NDE
No	No	NH
Yes	Yes	Test Pressure/NDE

include the total footage; individual lengths of pipe need not be marked with footage. If not marked on the bundle tag, all required marking shall be on each length.

- 25.2 When pipe sections are cut into shorter lengths by a subsequent processor for resale as material, the processor shall transfer complete identifying information, including the name or brand of the manufacturer to each unmarked cut length, or to metal tags securely attached to bundles of unmarked small diameter pipe. The same material designation shall be included with the information transferred, and the processor's name, trademark, or brand shall be added.
- 25.3 Bar Coding—In addition to the requirements in 25.1 and 25.2, bar coding is acceptable as a supplementary identification method. The purchaser may specify in the order a specific bar coding system to be used.

26. Government Procurement

26.1 When specified in the contract, material shall be preserved, packaged, and packed in accordance with the

requirements of MIL-STD-163. The applicable levels shall be as specified in the contract. Marking for the shipment of such material shall be in accordance with Fed. Std. No. 123 for civil agencies and MIL-STD-129 or Fed. Std. No. 183 if continuous marking is required for military agencies.

26.2 Inspection—Unless otherwise specified in the contract, the producer is responsible for the performance of all inspection and test requirements specified herein. Except as otherwise specified in the contract, the producer shall use his own, or any other suitable facilities for the performance of the inspection and test requirements specified herein, unless disapproved by the purchaser. The purchaser shall have the right to perform any of the inspections and tests set forth in this specification where such inspections are deemed necessary to ensure that the material conforms to the prescribed requirements.

27. Keywords

27.1 carbon steel pipe; seamless steel pipe; steel pipe

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall apply only when specified in the purchase order. The purchaser may specify a different frequency of test or analysis than is provided in the supplementary requirement. Subject to agreement between the purchaser and manufacturer, retest and retreatment provisions of these supplementary requirements may also be modified.

S1. Product Analysis

S1.1 Product analysis shall be made on each length of pipe. Individual lengths failing to conform to the chemical composition requirements shall be rejected.

S2. Transverse Tension Test

S2.1 A transverse tension test shall be made on a specimen from one end or both ends of each pipe NPS 8 [DN 200] and over. If this supplementary requirement is specified, the number of tests per pipe shall also be specified. If a specimen from any length fails to meet the required tensile properties (tensile, yield, and elongation), that length shall be rejected subject to retreatment in accordance with Specification A530/A530M and satisfactory retest.

S3. Flattening Test, Standard

S3.1 For pipe over NPS 2 [DN 50], a section of pipe not less than $2\frac{1}{2}$ in. [63.5 mm] in length shall be flattened cold between parallel plates until the opposite walls of the pipe meet. Flattening tests shall be in accordance with Specification A530/A530M, except that in the formula used to calculate the "H" value, the following "e" constants shall be used:

0.08 for Grade A

0.07 for Grades B and C

S3.2 When low *D*-to-*t* ratio tubulars are tested, because the strain imposed due to geometry is unreasonably high on the inside surface at the six and twelve o'clock locations, cracks at these locations shall not be cause for rejection if the *D*-to-*t* ratio is less than ten.

- S3.3 The flattening test shall be made on one length of pipe from each lot of 400 lengths or fraction thereof of each size over NPS 2 [DN 50], up to but not including NPS 6 [DN 150], and from each lot of 200 lengths or fraction thereof, of each size NPS 6 [DN 150] and over.
- S3.4 Should a crop end of a finished pipe fail in the flattening test, one retest is permitted to be made from the failed end. Pipe shall be normalized either before or after the first test, but pipe shall be subjected to only two normalizing treatments.

S4. Flattening Test, Enhanced

S4.1 The flattening test of Specification A530/A530M shall be made on a specimen from one end or both ends of each pipe. Crop ends may be used. If this supplementary requirement is specified, the number of tests per pipe shall also be specified. If a specimen from any length fails because of lack of ductility prior to satisfactory completion of the first step of the flattening test requirement, that pipe shall be rejected subject to retreatment in accordance with Specification A530/A530M and satisfactory retest. If a specimen from any length of pipe fails because of a lack of soundness, that length shall be rejected, unless subsequent retesting indicates that the remaining length is sound.

S5. Metal Structure and Etching Test

S5.1 The steel shall be homogeneous as shown by etching tests conducted in accordance with the appropriate sections of Method E381. Etching tests shall be made on a cross section from one end or both ends of each pipe and shall show sound

and reasonably uniform material free from injurious laminations, cracks, and similar objectionable defects. If this supplementary requirement is specified, the number of tests per pipe required shall also be specified. If a specimen from any length shows objectionable defects, the length shall be rejected, subject to removal of the defective end and subsequent retests indicating the remainder of the length to be sound and reasonably uniform material.

S6. Carbon Equivalent

S6.1 The steel shall conform to a carbon equivalent (CE) of 0.50 maximum as determined by the following formula:

$$CE = \%C + \frac{\%Mn}{6} + \frac{\%Cr + \%Mo + \%V}{5} + \frac{\%Ni + \%Cu}{15}$$

S6.2 A lower CE maximum may be agreed upon between the purchaser and the producer.

S6.3 The CE shall be reported on the test report.

S7. Heat Treated Test Specimens

S7.1 At the request of the purchaser, one tensile test shall be performed by the manufacturer on a test specimen from each heat of steel furnished which has been either stress relieved at 1250°F or normalized at 1650°F, as specified by the purchaser. Other stress relief or annealing temperatures, as appropriate to the analysis, may be specified by agreement between the purchaser and the manufacturer. The results of this test shall meet the requirements of Table 1.

S8. Internal Cleanliness-Government Orders

S8.1 The internal surface of hot finished ferritic steel pipe and tube shall be manufactured to a free of scale condition equivalent to the visual standard listed in SSPC-SP6. Cleaning shall be performed in accordance with a written procedure that has been shown to be effective. This procedure shall be available for audit.

S9. Requirements for Carbon Steel Pipe for Hydrofluoric Acid Alkylation Service

S9.1 The carbon equivalent (CE), based upon heat analysis, shall not exceed 0.43 % if the specified wall thickness is equal to or less than 1 in. [25.4 mm] or 0.45 % if the specified wall thickness is greater than 1 in. [25.4 mm].

S9.2 The carbon equivalent (CE) shall be determined using the following formula:

$$CE = C + Mn/6 + (Cr + Mo + V)/5 + (Ni + Cu)/15$$

S9.3 Based upon heat analysis in mass percent, the vanadium content shall not exceed 0.02 %, the niobium content shall not exceed 0.02 %, and the sum of the vanadium and niobium contents shall not exceed 0.03 %.

S9.4 Based upon heat analysis in mass percent, the sum of the nickel and copper contents shall not exceed 0.15 %.

S9.5 Based upon heat analysis in mass percent, the carbon content shall not be less than 0.18 %.

S9.6 Welding consumables of repair welds shall be of low hydrogen type. E60XX electrodes shall not be used and the resultant weld chemical composition shall meet the chemical composition requirements specified for the pipe.

S9.7 The designation "HF" shall be stamped or marked on each pipe to signify that the pipe complies with this supplementary requirement.



SPECIFICATION FOR PIPE, STEEL, ELECTRIC-FUSION (ARC)-WELDED (SIZES NPS 16 AND OVER)



SA-134/SA-134M



(Identical with ASTM Specification A134/A134M-19. For products ordered to Section III, Division 1, Supplementary Requirement S1 is mandatory.)

Specification for Pipe, Steel, Electric-Fusion (Arc)-Welded (Sizes NPS 16 and Over)

1. Scope

1.1 This specification covers electric-fusion (arc)-welded straight seam or spiral seam steel pipe NPS 16 and over in diameter (inside or outside as specified by purchaser), with wall thicknesses up to ¾ in. [19 mm], inclusive. Pipe having other dimensions may be furnished provided such pipe complies with all other requirements of this specification. The pipe is available in various grades based on the ASTM specification ordered (Section 4).

Note 1—Acceptability for many services may be controlled by codes or standards such as those published by the American National Standards Institute and American Society of Mechanical Engineers.

Note 2—For testing methods not specifically covered in this specification, reference can be made to Test Methods and Definitions A370, with particular reference to Annex A2 on Steel Tubular Products.

Note 3—A comprehensive listing of standardized pipe dimensions is contained in ANSI B 36.10.

1.2 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order. In this specification hard or rationalized conversions apply to diameter, lengths, and tensile properties. Soft conversion applies to other SI measurements.

Note 4—The dimensionless designator NPS (nominal pipe size) has been substituted in this standard for such traditional terms as "nominal diameter," "size," and "nominal size."

1.3 The following caveat pertains specifically to Section 5 of this specification. This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish

appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.

1.4 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A36/A36M Specification for Carbon Structural Steel

A283/A283M Specification for Low and Intermediate Tensile Strength Carbon Steel Plates

A285/A285M Specification for Pressure Vessel Plates, Carbon Steel, Low- and Intermediate-Tensile Strength

A370 Test Methods and Definitions for Mechanical Testing of Steel Products

A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys

A1011/A1011M Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength

A1018/A1018M Specification for Steel, Sheet and Strip, Heavy-Thickness Coils, Hot-Rolled, Carbon, Commercial, Drawing, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength

A1058 Test Methods for Mechanical Testing of Steel Products—Metric

2.2 ASME Boiler and Pressure Vessel Code:

Section III

Section IX

- 2.3 American National Standards Institute Standard:
- B 16.25 Buttwelding Ends
- B 36.10 Welded and Seamless Wrought Steel Pipe

3. Ordering Information

- 3.1 Orders for electric-fusion arc-welded pipe under this specification shall contain information concerning as many of the following items as are required, to describe the desired pipe adequately:
 - 3.1.1 Quantity (feet, metres, or number of lengths),
 - 3.1.2 Name of material (electric-fusion (arc)-welded pipe),
 - 3.1.3 ASTM Specification A134 or A134M and year date,
- 3.1.4 Grade (if applicable) of steel from which the pipe shall be made (Section 4),
- 3.1.5 Size (inside or outside diameter and nominal wall thickness), and
 - 3.1.6 Length (specified or random).
- 3.2 The purchaser shall have the option to order additional requirements, including, but not limited to the following:
 - 3.2.1 Specific straightness requirements (see 12.3),
 - 3.2.2 End finish (Section 14),
 - 3.2.3 Hydrostatic Test Pressure (Section 11),
 - 3.2.4 Protective coating (Section 20),
 - 3.2.5 End use of pipe, and
 - 3.2.6 Other special or supplementary requirements, if any.

4. Material

4.1 The steel from which the pipe is made shall conform to Specifications A36/A36M, A283/A283M, A285/A285M, A1011/A1011M, A1018/A1018M, or to other ASTM specifications for equally suitable weldable material, as specified. For purposes of marking and certification, when required, the pipe grade of material shall be established by the Axxx plate specification designation and plate grade, when applicable.

5. Manufacture

- 5.1 The longitudinal edges of the steel shall be shaped to give the most satisfactory results by the particular welding process employed. The steel shall then be properly formed and may be tacked preparatory to welding. The weld shall be made by automatic means (except tack welds) and shall be of reasonably uniform width and height for the entire length of the pipe. By agreement between the purchaser and the manufacturer, manual welding by qualified procedure and welders may be used as an equal alternate under this specification.
- 5.2 All longitudinal seams, spiral seams, and shop girth seams shall be butt-welded.

6. Number of Production Weld Tests

6.1 One weld test specimen specified in Section 8 shall be made from each lot of 3000 ft [900 m] of pipe or fraction thereof of each size and wall thickness.

- 6.2 If any test specimen shows defective machining or develops flaws not associated with the welding, it may be discarded and another specimen substituted.
- 6.3 Each length of pipe shall be subjected to the hydrostatic test specified in Section 11, unless otherwise specified in 11.3.

7. Retests

7.1 If any specimen tested in accordance with Section 10 fails to meet the requirements, retests of two additional specimens from the same lot of pipe shall be made, each of which shall meet the requirements specified. If any of the retests fail to conform to the requirements, test specimens may be taken from each untested pipe length at the manufacturer's option. Each specimen shall meet the requirements specified, or that pipe shall be rejected.

8. Test Specimens of Production Welds

- 8.1 The weld-test specimens for the reduced-section tension test shall be taken perpendicularly across the weld and from the end of the pipe or, alternatively, from flat test pieces of material conforming to the requirements in the specifications used in the manufacture of the pipe. The alternative weld-test specimens shall be welded with the same procedure and by the same operator and equipment, and in sequence with the welding of the longitudinal joints in the pipe. The test pieces shall have the weld approximately in the middle of the specimen. The specimens shall be straightened cold, and shall be tested at room temperature.
- 8.2 Reduced-section tension-test specimens shall be prepared in accordance with Fig. A2.3 of Test Methods and Definitions A370, Annex A2 Steel Tubular Products.

9. Qualification of Welding Procedure

- 9.1 The welding procedure shall be qualified in accordance with the American Welding Society Standard Qualification Procedure⁵ or ASME Section IX of the Boiler and Pressure Vessel Code as agreed to between the manufacturer and the purchaser using the tests and test values specified in 9.2 and 9.3. Thicknesses less than 3/8 in. [10 mm] shall be qualified for each wall thickness of pipe manufactured. Thicknesses 3/8 to 3/4 in. [10 mm to 19 mm], inclusive, shall be qualified in 3/8-in. [10-mm] thickness.
- 9.2 Two reduced-section tension specimens (transverse weld) made in accordance with Fig. A2.3 of Test Methods and Definitions A370, with the weld reinforcement removed, shall show a tensile strength not less than 100 % of the minimum specified tensile strength of the base material used.
- 9.3 Two face-bend test specimens shall be prepared in accordance with Section A2.5.1.7 of Test Methods and Definitions A370 and shall withstand being bent 180° in a jig substantially in accordance with Fig. A2.15.3 of Test Methods and Definitions A370. The bend test shall be acceptable if no cracks or other defects exceeding ½ in. [3 mm] in any direction be present in the weld metal or between the weld and the pipe

metal after bending. Cracks that originate along the edges of the specimens during testing and that are less than ½ in. [6 mm] in any direction, shall not be considered.

10. Tensile Properties of Production Welds

10.1 Reduced-section tension test specimens required in Section 8, taken perpendicularly across the weld with the weld reinforcement removed, shall show a tensile strength not less than 95 % of the specified minimum strength of the steel. At the manufacturer's option, the test may be made without removing the weld reinforcement, in which case the tensile strength shall be not less than the specified minimum tensile strength for the grade of steel used.

11. Hydrostatic Test (Note 5)

11.1 Each length of pipe shall be tested by the manufacturer to a hydrostatic pressure that will produce in the pipe wall a stress of 60% of the specified minimum yield point of the steel used at room temperature. The pressure shall be determined by the following equation:

$$P = 2St/D$$

where:

- P = minimum hydrostatic test pressure, psi (Note 6) (not to exceed 2800 psi [19 MPa]),
- S = 0.60 times the minimum specified yield point of the steel used, psi [MPa],
- t =specified wall thickness, in. [mm], and
- D = specified outside diameter, in. [mm].

Note 5—A hydrostatic sizing operation is not to be considered a hydrostatic test or a substitute for it.

Note 6—When the diameter and wall thickness of pipe are such that the capacity limits of testing equipment are exceeded by these requirements, the test pressures may be reduced by agreement between the purchaser and the manufacturer.

- 11.2 Test pressure shall be held for not less than 5 s, or for a longer time as agreed upon between the purchaser and the manufacturer.
- Note 7—When agreed upon between the purchaser and the manufacturer and so stated on the order, pipe may be tested to one and one half times the specified working pressure, except that the maximum test pressure shall not exceed 2800 psi [19 MPa] nor shall the maximum fiber stress exceed 85 % of specified minimum yield point of steel or to a fiber stress that does not exceed 85 % of the specified minimum yield point of the steel or 2800-psi [19-MPa] test pressure.
- 11.3 When specified in the order, pipe may be furnished without hydrostatic testing and each length so furnished shall include the mandatory marking of the letters "NH." Additionally, the certification, when required, shall state "Not Hydrostatically Tested" and the specification number and material grade, as shown on the certification, shall be followed by the letters "NH."

12. Permissible Variations in Weights and Dimensions

12.1 *Thickness and Weight*—The wall thickness and weight for welded pipe under this specification shall be governed by the requirements of the specifications to which the steel was ordered.

- 12.2 Circumference—The outside circumference of the pipe shall not vary more than ± 0.5 % from the nominal outside circumference based upon the diameter specified, except that the circumference at ends shall be sized, if necessary, to meet the requirements of Section 14.
- 12.3 *Straightness*—Finished pipe shall be commercially straight. When specific straightness requirements are desired, the order should so state, and the tolerances shall be a matter of agreement between the purchaser and the manufacturer.
- 12.4 Ovality—Out-of-roundness—The difference between major and minor outside diameter shall not exceed 1 %. Closer tolerances may be established by agreement between the manufacturer and the purchaser. Where the *D/T* (outside diameter/wall thickness) is over 120, internal bracing should be utilized to achieve sizing of ends and ovality shall be by agreement between the manufacturer and purchaser.

13. Lengths

- 13.1 Pipe lengths shall be supplied in accordance with the following regular practice:
- 13.1.1 The lengths shall be as specified on the order with a tolerance of $\pm \frac{1}{2}$ in. [13 mm], except that the shorter lengths from which test coupons have been cut may also be shipped.
- 13.1.2 When random lengths are specified, pipe shall be furnished in lengths having a minimum average of 29 ft [9 m] with a minimum length of 20 ft [6 m], but not more than 5 % may be under 25 ft [8 m].
- 13.2 Pipe lengths containing circumferentially welded joints (Note 8) shall be permitted by agreement between the manufacturer and the purchaser. Tests of these welded joints shall be made in accordance with the procedure tests specified in Section 9 and the production weld tests specified in Section 10. The number of production weld tests shall be one per each lot of 100 joints or fraction thereof, but not less than one for each welder or welding operator.

Note 8—Joints are defined for the purpose of this specification as a circumferential welded seam lying in one plane, used to join lengths of straight pipe.

14. Ends

- 14.1 Pipe shall be furnished with a plain right-angle cut or with bevel ends as specified. All burrs at the ends of pipe shall be removed.
- 14.1.1 Unless otherwise specified, pipe with beveled ends shall meet the requirements of ANSI B 16.25.
- 14.2 Unless otherwise specified, the outside circumference of pipe ends for a distance of not less than 4 in. [100 mm] shall not vary more than ± 60 % of the nominal wall thickness of the pipe from the nominal outside circumference based on the diameter specified, except that the tolerance shall not be less than $\pm \frac{3}{16}$ in. [5 mm].
- 14.3 By agreement between the manufacturer and the purchaser the ends of the pipe may be sized within agreed-upon tolerances if necessary to meet the requirements of special installations.

15. Finish

15.1 Repair by Welding—The welding of injurious defects in the pipe wall, provided their depth does not exceed one third the specified wall thickness, will be permitted. Defects in the welds, such as sweats or leaks, shall be repaired or the piece rejected at the option of the manufacturer. Repairs of this nature shall be made by completely removing the defect, cleaning the cavity, and then welding.

15.2 All repaired pipe shall be tested hydrostatically in accordance with Section 11, unless otherwise specified in 11.3.

16. Inspection

16.1 The inspector representing the purchaser shall have entry at all times while work on the contract of the purchaser is being performed, to all parts of the manufacturer's works that concern the manufacture of the material ordered. The manufacturer shall afford the inspector all reasonable facilities to satisfy him that the material is being furnished in accordance with this specification. All tests and inspection shall be made at the place of manufacture prior to shipment and unless otherwise specified, shall be so conducted as not to interfere unnecessarily with the operation of the works. If agreed upon, the manufacturer shall notify the purchaser in time so that he may have his inspector present to witness any part of the manufacture or tests that may be desired. The certification shall include reference to this specification and the pipe grade (ASTM plate specification designation and plate grade, when applicable).

16.2 Certification—Upon request of the purchaser in the contract or order, a manufacturer's certification that the material was manufactured and tested in accordance with this specification together with a report of the chemical and tensile tests shall be furnished. When hydrostatic test is omitted, the certificate shall include the letters "NH."

17. Rejection

17.1 Each length of pipe received from the manufacturer may be inspected by the purchaser and, if it does not meet the

requirements of this specification based on the inspection and test method as outlined in the specification, the length may be rejected, and the manufacturer shall be notified. Disposition of rejected pipe shall be a matter of agreement between the manufacturer and the purchaser.

17.2 Pipe found in fabrication or in installation to be unsuitable for the intended use, under the scope and requirements of this specification, may be set aside and the manufacturer notified. Such pipe shall be subject to mutual investigation as to the nature and severity of the deficiency and the forming or installation, or both, conditions involved. Disposition shall be a matter of agreement between the purchaser and the manufacturer.

18. Certification

18.1 Upon request of the purchaser in the contract or order, a manufacturer's certification that the material was manufactured and tested in accordance with this specification, including year date, together with a report of the chemical and tensile tests shall be furnished. The pipe grade shall be identified by the plate specification designation (year date not required) and the plate grade (where applicable).

19. Product Marking

19.1 Each section of pipe shall be marked with the manufacturer's distinguishing marking, this specification number, and the pipe grade. The marking need not include the year date of the pipe or plate specification.

19.2 Bar Coding—In addition to the requirements in 19.1, bar coding is acceptable as a supplemental identification method. The purchaser may specify in the order a specific bar coding system to be used.

20. Protective Coating

20.1 If agreed upon between the purchaser and the manufacturer, the pipe shall be given a protective coating of the kind and in the manner specified by the purchaser.

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall be applied only when specified by the purchaser in the inquiry, contract, or order. Details of these supplementary requirements shall be agreed upon in writing by the manufacturer and purchaser. Supplementary requirements shall in no way negate any requirement of the specification itself.

S1. ASME Section III Construction

S1.1 Products furnished under this specification that are intended for application under the rules of the ASME Boiler and Pressure Vessel Code Section III, Class 3 Piping, shall be manufactured by holders of the appropriate ASME Certificate of Authorization and Certification Mark. The product is subject to all applicable requirements of Section III, Class 3 Piping,

including welding, heat treatment, nondestructive examination, authorized inspection at the point of manufacture, and application of the Certification Mark.

S1.2 The applicable ASME Partial Data Report Form, signed by an Authorized Nuclear Inspector, and a material test report shall be furnished for each lot of pipe.



SPECIFICATION FOR ELECTRIC-RESISTANCE-WELDED STEEL PIPE



SA-135/SA-135M

(Identical with ASTM Specification A135/A135M-19 except certification has been made mandatory.)

Specification for Electric-Resistance-Welded Steel Pipe

1. Scope

1.1 This specification covers two grades of electricresistance-welded steel pipe in NPS 2 to NPS 30 [DN 50 to DN 750] inclusive, with nominal (average) wall thickness up to 0.500 in. [12.70 mm], inclusive, and in nominal sizes NPS 3/4 to NPS 5 [DN 20 to DN 125] inclusive with nominal (average) wall thickness 0.083 in. [2.11 mm] to 0.134 in. [3.40 mm], depending on size. Pipe having other dimensions (Note 1) may be furnished provided such pipe complies with all other requirements of this specification. The pipe is intended for conveying gas, vapor, water or other liquid; only Grade A is adapted for flanging and bending (Note 2). The suitability of pipe for various purposes is somewhat dependent upon its dimensions, properties, and conditions of service, so that the purpose for which the pipe is intended should be stated in the order. The pipe may be furnished either nonexpanded or cold expanded at the option of the manufacturer. When pipe is cold expanded, the amount of expansion shall not exceed 1.5 % of the outside diameter pipe size.

Note 1—A comprehensive listing of standardized pipe dimensions is contained in ASME B36.10M.

Note 2—This provision is not intended to prohibit the cold bending of Grade B pipe.

- 1.2 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.3 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A370 Test Methods and Definitions for Mechanical Testing of Steel Products

A700 Guide for Packaging, Marking, and Loading Methods for Steel Products for Shipment

A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products

A865/A865M Specification for Threaded Couplings, Steel, Black or Zinc-Coated (Galvanized) Welded or Seamless, for Use in Steel Pipe Joints

A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys

E6 Terminology Relating to Methods of Mechanical Testing E29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications

E213 Practice for Ultrasonic Testing of Metal Pipe and Tubing

E273 Practice for Ultrasonic Testing of the Weld Zone of Welded Pipe and Tubing

E309 Practice for Eddy Current Examination of Steel Tubular Products Using Magnetic Saturation

E570 Practice for Flux Leakage Examination of Ferromagnetic Steel Tubular Products

E1806 Practice for Sampling Steel and Iron for Determination of Chemical Composition

2.2 ASME Standard:

B1.20.1 Pipe Threads, General Purpose B36.10M Welded and Seamless Wrought Steel Pipe

2.3 Federal Standards:

Fed. STD No. 123 Marking for Shipments (Civil Agencies)Fed. STD No. 183 Continuous Identification Marking of Iron and Steel Products 2.4 Military Standards:

MIL-STD-129 Marking for Shipment and Storage

3. Terminology

- 3.1 For definitions of terms relating to steel manufacturing and properties, refer to Terminology A941.
- 3.2 For definitions of terms relating to mechanical testing, refer to Terminology E6.
 - 3.3 Definitions of Terms Specific to This Standard:
- 3.3.1 *burr*, *n*—a rough or sharp edge left on pipe ends by cutting or sawing.
- 3.3.2 *lot*, *n*—all pipe of the same size, wall thickness and rolled length that is produced from the same heat of steel and subject to the same heat treatment.
- 3.3.3 *black thread*, *n*—a thread crease exhibiting the original pipe surface after machining.

4. Ordering Information

- 4.1 Orders for material under this specification should include the following, as required, to describe the desired material adequately:
 - 4.1.1 Quantity (feet, metres, or number of lengths),
 - 4.1.2 Name of product (electric-resistance-welded pipe),
 - 4.1.3 Specification designation and year of issue,
 - 4.1.4 Grade (see Table 1),
- 4.1.5 Size (nominal size, NPS [DN], or outside diameter; and nominal wall thickness),
 - 4.1.6 Length (specific or random, see 12.4),
 - 4.1.7 End finish (plain or threaded, see 13.2),
 - 4.1.7.1 Threaded and coupled, if specified,

- 4.1.7.2 Threads only, if specified,
- 4.1.7.3 Plain end, if specified,
- 4.1.8 Alternative electric test (see Section 11),
- 4.1.9 Tension test specimen (see Section 15),
- 4.1.10 Heat analysis, if required (see 6.1),
- **4.1.11 DELETED**
- 4.1.12 Special requirements.

5. Manufacture

- 5.1 The steel shall be made by either or both of the following processes: basic-oxygen or electric-furnace.
- 5.2 Steel may be cast in ingots or may be strand cast. When steels of different grades are sequentially strand cast, identification of the resultant transition material is required. The producer shall remove the transition material by any established procedure that positively separates the grades.
- 5.3 The pipe shall be manufactured from flat rolled steel in individual lengths or in continuous length by electric-resistance or electric-induction welding without the addition of extraneous material.
- 5.4 The weld seam of electric-resistance welded pipe to Grade B pipe shall be heat treated after welding to a minimum temperature of 1000 °F [540 °C] or processed in such a manner that no untempered martensite remains.

6. Chemical Composition

6.1 The steel shall conform to the requirements prescribed in Table 2, based on the heat analysis. When specified in the order, the heat analyses shall be reported to the purchaser or a representative of the purchaser.

TABLE 1 Tensile Requirements

	Grade A	Grade B
Tensile strength, min, ksi [MPa]	48 [330]	60 [415]
Yield strength, min, ksi [MPa]	30 [205]	35 [240]
Elongation in 2 in. or [50 mm], min, %:		
For pipe having a specified wall thickness of 5/16 in. [7.9 mm] or more, if tested using a longitudinal strip test specimen.	35	30
For pipe having a specified wall thickness of less than 5/16 in. [7.9 mm], if tested using a longitudinal strip test specimen.	А	В
For pipe of any size, if tested using a full-size longitudinal test specimen.	35	30

A The minimum elongation shall be determined by the following equation, with the calculated value rounded to the nearest percent:

E = 56t + 16.5[E = 2.2t + 16.5]

where:

E = elongation in 2 in. or [50 mm], minimum, %, and

t = specified wall thickness, in. [mm].

^BThe minimum elongation shall be determined by the following equation, with the calculated value rounded to the nearest percent:

E = 48t + 14[E = 1.9t + 14]

where:

E = elongation in 2 in. or [50 mm], minimum, %, and

t = specified wall thickness, in. [mm].

TABLE 2 Chemical Requirements

	Composition, max, %		
Element	Grade A	Grade B	
Carbon	0.25	0.30	
Manganese	0.95	1.20	
Phosphorus	0.035	0.035	
Sulfur	0.035	0.035	

7. Product Analysis

7.1 An analysis may be made by the purchaser on samples of pipe selected at random and shall conform to the requirements specified in Table 2. Methods and Practices relating to chemical analysis shall be in accordance with Test Method, Practices, and Terminology A751.

8. Mechanical Properties Requirements

- 8.1 *Tensile Properties:*
- 8.1.1 The material shall conform to the requirements as to tensile properties prescribed in Table 1.
- 8.1.2 The yield strength shall be determined by the offset method utilizing 0.2% of the gauge length or by the total extension under load method using 0.5% of the gauge length.
- 8.1.3 Longitudinal test specimens shall be full-size longitudinal test specimens (see Figure A2.1 of Test Methods and Definitions A370) or longitudinal strip test specimens (see Specimen No. 4 in Fig. A2.3 of Test Methods and Definitions A370).
- 8.2 The test specimen taken across the weld shall show a tensile strength not less than the minimum tensile strength specified for the grade of pipe ordered. This test will not be required for pipe under NPS 8 [DN 200].

9. Flattening Test

- 9.1 A specimen at least 4 in. [100 mm] in length shall be flattened cold between parallel plates in three steps with the weld located either 0° or 90° from the line of direction of force as required in 9.2. During the first step, which is a test for ductility of the weld, no cracks or breaks on the inside or outside surfaces shall occur before the distance between the plates is less than two thirds of the original outside diameter of the pipe. As a second step, the flattening shall be continued. During the second step, which is a test for ductility exclusive of the weld, no cracks or breaks on the inside or outside surfaces shall occur before the distance between the plates is less than one third of the original outside diameter of the pipe but is not less than five times the wall thickness of the pipe. During the third step, which is a test for soundness, the flattening shall be continued until the specimen breaks or the opposite walls of the pipe meet. Evidence of laminated or unsound material or of incomplete weld that is revealed during the entire flattening test shall be cause for rejection.
- 9.2 For pipe produced in single lengths, the flattening test specified in 9.1 shall be made on both crop ends cut from each length of pipe. The tests from each end shall be made alternately with the weld at 0° and at 90° from the line of direction of force. For pipe produced in multiple lengths, the flattening test shall be made on crop ends representing the front and back of each coil with the weld at 90° from the line of

direction of force, and on two intermediate rings representing each coil with the weld 0° from the line of direction of force.

- 9.3 Surface imperfections in the test specimen before flattening, but revealed during the first step of the flattening test, shall be judged in accordance with the finish requirements in Section 13.
- 9.4 Superficial cracks as a result of surface imperfections shall not be cause for rejection.

10. Hydrostatic Test

10.1 Except as provided for in 10.3, each length of pipe shall be hydrostatically tested at the mill, without leakage through the wall, to a pressure calculated from the following equation:

$$P = 2St/D$$

where:

P = minimum hydrostatic test pressure, psi, [kPa]. The test pressure need not exceed 2500 psi [17 200 kPa],

S = allowable fiber stress 18 000 psi [124 000 kPa] for Grade A and 21 000 psi [145 000 kPa] for Grade B. This does not prohibit testing at higher pressure at the manufacturer's option,

t = specified wall thickness, in. [mm], and

D = specified outside diameter, in. [mm].

Plain end pipe may be tested at the discretion of the manufacturer in single lengths or in multiple lengths.

- 10.2 The hydrostatic pressure shall be maintained for not less than 5 s.
- 10.3 When specified in the order, pipe may be furnished without hydrostatic testing, and each length so furnished shall include with the mandatory marking the letters "NH."

Note 3—This provision is not intended to apply to light wall (Schedule 10) pipe listed in Table X1.1.

10.4 When the hydrostatic test has been omitted, the certification shall clearly state "Not Hydrostatically Tested." The specification number and material grade, as shown on the certification, shall be followed by the letters "NH."

11. Nondestructive Examination Requirements

- 11.1 As an alternate to the hydrostatic test, and when accepted by the purchaser, each pipe shall be tested with a nondestructive electric test. Except for pipe produced on a hot-stretch reducing mill, the weld seam of each length of pipe shall be tested with a nondestructive test in accordance with Practices E213, E273, E309, or E570. Each length of pipe produced on a hot-stretch-reducing mill shall be tested with a nondestructive electric test that inspects the full volume of the pipe in accordance with Practices E213, E309, or E570.
- 11.2 Recognized methods for meeting this test are electromagnetic (eddy current) or ultrasonic.
- 11.3 The following information is for the benefit of the user of this specification:
- 11.3.1 The ultrasonic examination referred to in this specification is intended to detect longitudinal imperfections having

a reflective area similar to or larger than the reference notch. The examination may not detect circumferentially oriented imperfections of short, deep imperfections.

- 11.3.2 The eddy-current examination referenced in this specification has the capability of detecting significant imperfections, especially of the short, abrupt type.
- 11.3.3 The hydrostatic test referred to in Section 10 is a test method provided for in many product specifications. This test has the capability of finding imperfections of a size permitting the test fluid to leak through the tube wall and may be either visually seen or detected by a loss of pressure. This test may not detect very tight, through-the-wall imperfections or imperfections that extend an appreciable distance into the wall without complete penetration.
- 11.3.4 A purchaser interested in ascertaining the nature (type, size, location, and orientation) of imperfections that can be detected in the specific application of these examinations should discuss this with the manufacturer of the tubular product.
- 11.4 In order to accommodate the various types of nondestructive electric testing equipment and techniques in use, the calibration pipe shall contain, at the option of the producer, any one or more of the following discontinuities to establish a minimum sensitivity level for rejection:
- 11.4.1 *Drilled Hole*—A hole not larger than 0.031-in. [0.8-mm] diameter shall be drilled radially and completely through pipe wall, preferably in the weld area, care being taken to avoid distortion of the pipe while drilling.
- 11.4.2 Transverse Tangential Notch—A notch shall be filed or milled tangential to the surface and transverse to the longitudinal axis of the pipe preferably in the weld area. Said notch shall have a depth not exceeding 12.5 % of the nominal wall thickness of the pipe or 0.004 in., [0.10 mm], whichever is greater.
- 11.4.3 Longitudinal Notch—A notch 0.031 in. [0.8 mm] or less in width shall be machined in a radial plane parallel to the pipe axis on the outside surface of the pipe preferably in the weld area, to have a depth not exceeding 12.5 % of the nominal wall thickness of the pipe or 0.004 in. [0.10 mm], whichever is greater.
- 11.5 Pipe producing a signal equal to or greater than the calibration imperfection shall be rejected.

12. Dimensions, Weight (Mass), and Permissible Variations

12.1 Weight (Mass)—The weight (mass) of any length of pipe other than Schedule 10 shall not vary more than 3.5 % under or 10 % over that specified, but the carload weight (mass) shall be not more than 1.75 % under the nominal weight (mass). The weight (mass) of pipe furnished to Schedule 10 shall not vary more than ± 10 % from that calculated using the weight (mass) per unit length prescribed in Appendix Table X1.1. The weight (mass) of the pipe shall be calculated from the relevant equation in ASME B36.10M.

Note 4—A system of standard pipe sizes has been approved by the American National Standards Institute as American National Standard for Welded and Seamless Wrought Steel Pipe (ASME B36.10M).

- 12.2 *Diameter*—The outside diameter shall not vary more than ± 1 % from the nominal size specified.
- 12.3 *Minimum Wall Thickness*—The minimum wall thickness at any point shall be not more than 12.5 % under the specified wall thickness.

Note 5—The minimum wall thickness on inspection is shown in Table X1.2 of the Appendix.

12.4 Lengths:

- 12.4.1 Except as allowed in 12.4.2, pipe shall be furnished in lengths averaging 38 ft [11.6 m] or over, with a minimum length of 20 ft [6.1 m], but no more than 5 % may be under 32 ft [9.8 m]. Jointers made by welding are permissible. When threaded pipe is ordered, jointers shall be made by threaded connections and shall not exceed 5 % of the order.
- 12.4.2 Unless otherwise specified, Schedule 10 pipe shall be between 16 and 22 ft [4.9 and 6.7 m] for a minimum of 90 % of the footage furnished, with any balance being shorter lengths at least 8 ft [2.4 m] long.

13. Workmanship, Finish, and Appearance

13.1 The finished pipe shall be reasonably straight and free of defects. Surface imperfections in excess of 12.5 % of the nominal wall thickness shall be considered defects.

13.2 End Finish:

13.2.1 *Schedule 10 Pipe*—Pipe furnished to Schedule 10 shall be plain end only. All inside and outside cutting burrs shall be removed. This generally involves breaking the corners.

13.2.2 Ends, Plain End Pipe—Unless otherwise specified, plain end pipe for use with the Dresser or Dayton type coupling shall be reamed both outside and inside sufficiently to remove all burrs. Plain end pipe for welding shall be beveled on the outside to an angle of 30° with a tolerance of + 5° and – 0° and with a width of flat at the end of the pipe of $\frac{1}{16} \pm \frac{1}{32}$ in. [1.6 \pm 0.8 mm]. When material is ordered beveled to any other than a 30° angle, it should be understood that the angle is to be measured from a line drawn perpendicular to the axis of the pipe. This means that a greater amount of material is removed with a 60° angle than with a 30° angle. Pipe shall be sufficiently free from indentations, projections, or roll marks for a distance of 8 in. [200 mm] from the end of the pipe to make a tight joint with the rubber gasket type of coupling. All plain end pipe intended for Dresser or Dayton type joints or for welding, sizes NPS 10 [DN 250] and smaller in outside diameter specified, shall be not more than ½2 in. [0.8 mm] smaller than the outside diameter specified for a distance of 8 in. [200 mm] from the ends of the pipe and shall permit the passing for a distance of 8 in. [200 mm] of a ring gauge that has a bore ½6 in. [1.6 mm] larger than the outside diameter specified of the pipe. Sizes larger than NPS 10 [DN 250] shall be not more than 1/32 in. [0.8 mm] smaller than the nominal outside diameter for a distance of 8 in. [200 mm] from the end of the pipe and shall permit the passing for a distance of 8 in. [200 mm] of a ring gauge which has a bore ³/₃₂ in. [2.4 mm] larger than the nominal outside diameter of the pipe.

13.2.3 Ends, Threaded Pipe—Each end of threaded pipe shall be reamed to remove all burrs. All threads shall be in accordance with the American National Standard Pipe Threads

(Note 6) and cut so as to make a tight joint when the pipe is tested at the mill to the specified internal hydrostatic pressure. The variation from the standard, when tested with the standard working gauge, shall not exceed one and one-half turns either way. Pipe shall not be rounded by hammering in order to get a full thread. There shall be not more than two black threads for ³/₄-in. [19.0-mm] taper among the perfect threads. Black threads should not be confused with imperfect threads, such as those torn, shaven, or broken.

Note 6—A complete description of the American National Standard Pipe Threads applicable to pipe, valves, and fittings is contained in ASME B1.20.1; also "Screw-Thread Standards for Federal Services, 1942," National Bureau of Standards *Handbook H 28*, January, 1942, the pertinent data in both sources being identical.

13.3 Couplings—Each length of threaded pipe shall be provided with one coupling manufactured in accordance with Specification A865/A865M except that the coupling may be wrought iron (Note 7). Threads shall be cut so as to make a tight joint. Taper-tapped couplings shall be furnished on all weights (masses) of threaded pipe NPS 2½ [DN 65] and larger.

Note 7—For sizes NPS 2 [DN 50] and smaller, it is commercial practice to furnish straight-tapped couplings for standard-weight (mass) (Schedule 40) pipe and taper-tapped couplings for extra-strong (Schedule 80) and double-extra-strong pipe. If taper-tapped couplings are required for sizes NPS 2 [DN 50] and smaller on standard weight (mass) (Schedule 40) pipe, line pipe in accordance with Specification 5L of the American Petroleum Institute should be ordered, thread lengths to be in accordance with ASME B1.20.1. Taper-tapped couplings for sizes NPS 2 [DN 50] and smaller in standard weight (mass) may be used on mill-threaded standard weight (mass) type of the same size.

13.4 Protective Coating:

13.4.1 After the pipe has been subjected to the hydrostatic test, and if required by the purchaser, it shall be thoroughly cleaned of all dirt, oil, grease, loose scale, and rust; then dried, and given a protective coating of the kind and in the manner specified by the purchaser. Pipe furnished to Schedule 10 shall be normally shipped with a light coating of processing oil. If so specified, the pipe can be given a mill coating or a special coating.

14. Weld Repair

- 14.1 Welding Repair:
- 14.2 Defects in the pipe wall, provided their depth does not exceed one third the specified wall thickness, shall be repaired by electric welding. Defects in the welds such as sweats or leaks, unless otherwise specified, shall be repaired or the piece rejected at the option of the manufacturer. Repairs of this nature shall be made by completely removing the defect, cleaning the cavity, and then electric welding.
- 14.3 All repaired pipe shall be retested hydrostatically in accordance with Section 10.

15. Sampling

- 15.1 Chemical Analysis:
- 15.1.1 Samples for chemical analysis, except for spectrochemical analysis, shall be taken in accordance with Practice E1806. The number of samples shall be determined as follows:

NPS Under 6 [DN 150]

6 [DN 150] to 20 [DN 500], incl Over 20 [DN 500] to 30 [DN 750], incl Numbers of Samples Selected
2 from each lot of 400 pipes or fraction
thereof
2 from each lot of 200 pipes or fraction
thereof
2 from each lot of 100 pipes or fraction
thereof

15.2 Tension Test:

15.2.1 One longitudinal tension test shall be made on one length (Note 8) from each lot of 400 lengths or fraction thereof of each size under NPS 8 [DN 200] and one transverse body and one transverse weld tension test on one length from each lot of 200 lengths or fraction thereof of each size NPS 8 to NPS 20 [DN 200 to DN 500] and on one length from each lot of 100 lengths or fraction thereof of each size over NPS 20 to NPS 30 [DN 500 to DN 750]. When taken from the skelp, the number of tests shall be determined in the same manner as when taken from the finished pipe.

NOTE 8—Length is defined as the length as ordered, except that in the case of orders for cut lengths shorter than double random, which is defined as the length as rolled, prior to cutting to the required short lengths.

- 15.3 Flattening Test:
- 15.3.1 When pipe is produced in single length, the flattening test specified in 9.1 shall be made on both crop ends cut from each length of pipe. When pipe is produced in multiple lengths, flattening tests are required on the crop ends from the front and back ends of each coil and on two intermediate rings representing each coil.
 - 15.4 Hydrostatic Test:
- 15.4.1 Each length of pipe shall be subjected to the hydrostatic test specified in Section 10.

16. Test, Retest, and Resampling

- 16.1 Chemical Analysis:
- 16.1.1 If the results of the analysis of either length of pipe does not conform to the requirements specified in Section 7, analyses of two additional lengths from the same lot shall be made, each of which shall conform to the requirements specified.
 - 16.2 Tension Test:
- 16.2.1 The test specimens and the tests required by this specification shall conform to those described in Test Methods and Definitions A370, except that all specimens shall be tested at room temperature.
- 16.2.2 The longitudinal tension test specimen shall be taken from the end of the pipe, or by agreement between the manufacturer and the purchaser may be taken from the skelp, at a point approximately 90° from the weld, and shall not be flattened between gauge marks. The sides of each specimen shall be parallel between gauge marks. At the manufacturer option, the tension test may be made on full section of pipe.
- 16.2.3 Transverse weld test specimens shall be taken with the weld at the center of the specimen. Transverse body test specimens shall be taken opposite to the weld. All transverse test specimens shall be approximately 1½ in. [38 mm] wide in the gauge length and shall represent the full wall thickness of the pipe from which the specimen was cut.

- 16.2.4 If any test specimen shows defective machining or develops flaws not associated with the quality of the steel or the welding, it may be discarded and another specimen substituted.
- 16.2.5 If the results of the tension tests of any lot do not conform to the requirements specified in 9.1, retests of two additional lengths from the same lot shall be made, each of which shall conform to the requirements specified.
- 16.2.6 If the percentage of elongation of any tension test specimen is less than that specified in 8.1, and any part of the fracture is more than ³/₄-in. [19.0-mm] from the center of the gauge length as indicated by scribe scratches marked on the specimen before testing, the specimen may be discarded and another substituted.
 - 16.3 Flattening Test:
- 16.3.1 Specimens for flattening tests shall be smooth at the ends and free from burrs.
- 16.3.2 If any section of the pipe fails to comply with the requirements of 9.1, for pipe produced in single lengths, other sections may be cut from the same end of the same length until satisfactory tests are obtained, except that the finished pipe shall not be shorter than 80 % of its length after the initial cropping; otherwise, the length shall be rejected. For pipe produced in multiple lengths, retests may be cut from each end of each individual length in the multiple; such tests shall be made with the weld alternately 0° and 90° from the line of direction of force.
 - 16.4 All specimens shall be tested at room temperature.

17. Inspection

17.1 The inspector representing the purchaser shall have free entry, at all times while work on the contract of the purchaser is being performed, to all parts of the manufacturer's works that concern the manufacture of the material ordered. The manufacturer shall afford the inspector, without charge, all reasonable facilities to satisfy him that the material is being furnished in accordance with this specification. All tests (except check analysis) and inspection shall be made at the place of manufacture prior to shipment, unless otherwise specified, and shall be so conducted as not to interfere unnecessarily with the manufacturer's operation.

18. Rejection

18.1 Each length of pipe received from the manufacturer may be inspected by the purchaser and, if it does not meet the requirements of this specification based on the inspection and

test method as outlined in the specification, the length may be rejected and the manufacturer shall be notified. Disposition of rejected pipe shall be a matter of agreement between the manufacturer and the purchaser.

18.2 Pipe found in fabrication or in installation to be unsuitable for the intended use, under the scope and requirements of this specification, may be set aside and the manufacturer notified. Such pipe shall be subject to mutual investigation as to the nature and severity of the deficiency and the forming or installation, or both, conditions involved. Disposition shall be a matter for agreement.

19. Certification

19.1 A manufacturer's certification shall be furnished to the purchaser stating that material has been manufactured, tested, and inspected in accordance with this specification, and that the test results on representative samples meet specification requirements. A report of the test results shall be furnished.

20. Identification of Material

- 20.1 Each length of pipe shall be legibly marked with appropriate symbols by stenciling, stamping, or rolling to show the manufacturer's name, the size, the specification designation, the grade, and the hydrostatic test pressure when tested, or the letters "NH" when not tested.
- 20.2 In addition to the requirements in 20.1, bar coding is acceptable as a supplemental identification method. The purchaser may specify in the order a specific bar coding system to be used.

21. Packaging, Marking, and Loading for Shipment

- 21.1 When specified on the purchase order, packaging, marking, and loading for shipment shall be in accordance with Practices A700.
- 21.2 The applicable levels shall be as specified in the contract. Marking for shipment of such material shall be in accordance with Fed. Std. No. 123 for civil agencies and MIL-STD-129 or Fed. Std. No. 183 if continuous marking is required for military agencies.

22. Keywords

22.1 eddy current testing; electric resistance welded pipe; hydrostatic testing; plain end pipe; Schedule 10 pipe; threaded pipe

APPENDIX

(Nonmandatory Information)

X1. ADDITIONAL DATA

X1.1 Additional data on dimensions nominal weights (masses) and test pressures is provided in Table X1.1.

X1.2 Additional data on wall thicknesses are provided in Table X1.2.

TABLE X1.1 Dimensions, Nominal Weights (Masses), and Test Pressures for Light Wall Steel Pipe

	DN	Outside Diameter, in. [mm]	Schedule 10		Test Pressure, psi [MPa] ^A	
NPS			Specified Wall Thickness ^A in. [mm]	Weight (Mass) Per Unit Length lb/ft [kg/m]	Grade A	Grade B
3/4	20	1.050 [26.7]	0.083 [2.11]	0.86 [1.28]	2500	2500
1	25	1.315 [33.4]	0.109 [2.77]	1.41 [2.09]	[17 200] 2500 [17 200]	[17 200] 2500 [17 200]
11/4	32	1.660 [42.2]	0.109 [2.77]	1.81 [2.69]	2400	2500
11/2	40	1.900 [48.3]	0.109 [2.77]	2.09 [3.11]	[16 500] 2100 [14 500]	[17 200] 2400 [16 500]
2	50	2.375 [60.3]	0.109 [2.77]	2.64 [3.93]	1700	1900
21/2	65	2.875 [73.0]	0.120 [3.05]	3.53 [5.26]	[11 700] 1500 [10 300]	[13 100] 1700 [11 700]
3	80	3.500 [88.9]	0.120 [3.05]	4.34 [6.46]	1200	1400
31/2	90	4.000 [101.6]	0.120 [3.05]	4.98 [7.41]	[8 200] 1000	[9 600] 1200
4	100	4.500 [114.3]	0.120 [3.05]	5.62 [8.37]	[6 900] 900 [6 200]	[8 200] 1100 [7 600]
5	125	5.563 [141.3]	0.134 [3.40]	7.78 [11.58]	850 [5 900]	1000 [6 900]

^A The test pressures are calculated by the following equation (but need not exceed 2500 psi or [17 200 KPa]):

P = 2 St/D

where:

P = pressure, psi [kPa], S = fiber stress 60 % of the specified minimum yield strength, psi [kPa], t = specified wall thickness, in. [mm], and D = specified outside diameter, in. [mm].

TABLE X1.2 Minimum Permissible Wall Thickness on Inspection

Note 1—The following equation, upon which this table is based, is used to derive the minimum permissible wall thickness values from the specified wall thickness values, with the calculated values rounded to three decimal places in accordance with the rounding method of Practice E29:

 $t_m \times 0.875 = t$

where:

 $t_m = \text{minimum permissible wall thickness, in. [mm], and}$

t''' = specified wall thickness, in. [mm].

Note 2—This table is a master table covering wall thicknesses available in the purchase of different classifications of pipe, but it is not meant to imply that all of the walls listed therein are obtainable under this specification.

Specified Wall Thickness (t),	Minimum Permissible Wall Thickness (t_m) ,	Specified Wall Thickness (t),	Minimum Permissible Wall Thickness (t_m) ,	Specified Wall Thickness (t),	Minimum Permissible Wall Thickness (t_m) ,
in. [mm]	in. [mm]	in. [mm]	in. [mm]	in. [mm]	in. [mm]
0.068 [1.73]	0.060 [1.52]	0.294 [7.47]	0.257 [6.53]	0.750 [19.05]	0.656 [16.66]
0.088 [2.24]	0.077 [1.96]	0.300 [7.62]	0.262 [6.65]	0.812 [20.62]	0.710 [18.03]
0.091 [2.31]	0.080 [2.03]	0.307 [7.80]	0.269 [6.83]	0.844 [21.44]	0.738 [18.75]
0.095 [2.41]	0.083 [2.11]	0.308 [7.82]	0.270 [6.86]	0.864 [21.94]	0.756 [19.20]
0.113 [2.87]	0.099 [2.51]	0.312 [7.92]	0.273 [6.93]	0.875 [22.22]	0.766 [19.46]
0.119 [3.02]	0.104 [2.64]	0.318 [8.08]	0.278 [7.06]	0.906 [23.01]	0.793 [20.14]
0.125 [3.18]	0.109 [2.77]	0.322 [8.18]	0.282 [7.16]	0.937 [23.82]	0.820 [20.85]
0.126 [3.20]	0.110 [2.79]	0.330 [8.38]	0.289 [7.34]	0.968 [24.59]	0.847 [21.51]
0.133 [3.38]	0.116 [2.95]	0.337 [8.56]	0.295 [7.49]	1.000 [25.40]	0.875 [22.22]
0.140 [3.56]	0.122 [3.10]	0.343 [8.71]	0.300 [7.62]	1.031 [26.19]	0.902 [22.91]
0.145 [3.68]	0.127 [3.23]	0.344 [8.74]	0.301 [7.65]	1.062 [26.97]	0.929 [23.60]
0.147 [3.73]	0.129 [3.28]	0.358 [9.09]	0.313 [7.95]	1.094 [27.79]	0.957 [24.31]
0.154 [3.91]	0.135 [3.43]	0.365 [9.27]	0.319 [8.10]	1.125 [28.58]	0.984 [24.99]
0.156 [3.96]	0.136 [3.45]	0.375 [9.52]	0.328 [8.33]	1.156 [29.36]	1.012 [25.70]
0.179 [4.55]	0.157 [3.99]	0.382 [9.70]	0.334 [8.48]	1.219 [30.96]	1.066 [27.08]
0.187 [4.75]	0.164 [4.17]	0.400 [10.16]	0.350 [8.89]	1.250 [31.75]	1.094 [27.79]
0.188 [4.78]	0.164 [4.17]	0.406 [10.31]	0.355 [9.02]	1.281 [32.54]	1.121 [28.47]
0.191 [4.85]	0.167 [4.24]	0.432 [10.97]	0.378 [9.60]	1.312 [33.32]	1.148 [29.16]
0.200 [5.08]	0.175 [4.44]	0.436 [11.07]		1.343 [34.11]	1.175 [29.85]
0.203 [5.16]	0.178 [4.52]	0.437 [11.10]	0.382 [9.70]	1.375 [34.92]	1.203 [30.56]
0.216 [5.49]	0.189 [4.80]	0.438 [11.13]	0.383 [9.73]	1.406 [35.71]	1.230 [31.24]
0.218 [5.54]	0.191 [4.85]	0.500 [12.70]	0.438 [11.13]	1.437 [36.53]	1.258 [31.95]
0.219 [5.56]	0.192 [4.88]	0.531 [13.49]	0.465 [11.81]	1.500 [38.10]	1.312 [33.32]
0.226 [5.74]	0.198 [5.03]	0.552 [14.02]	0.483 [12.27]	1.531 [38.89]	1.340 [34.04]
0.237 [6.02]	0.207 [5.26]	0.562 [14.27]	0.492 [12.50]	1.562 [39.67]	1.367 [34.72]
0.250 [6.35]	0.219 [5.56]	0.593 [15.06]	0.520 [13.21]	1.594 [40.69]	1.394 [35.43]
0.258 [6.55]	0.226 [5.74]	0.600 [15.24]	0.525 [13.34]	1.750 [44.45]	1.531 [38.89]
0.276 [7.01]	0.242 [6.15]	0.625 [15.88]	0.547 [13.89]	1.781 [45.24]	1.558 [39.57]
0.277 [7.04]	0.242 [6.15]	0.656 [16.66]	0.574 [14.58]	1.812 [46.02]	1.586 [40.28]
0.279 [7.09]	0.244 [6.20]				
0.280 [7.11]	0.245 [6.22]	0.687 [17.48]	0.602 [15.29]	2.062 [52.37]	1.804 [45.82]
0.281 [7.14]	0.246 [6.25]	0.719 [18.26]	0.629 [15.96]	2.343 [59.54]	2.050 [52.10]

SPECIFICATION FOR ELECTRIC-RESISTANCE-WELDED CARBON STEEL AND CARBON-MANGANESE STEEL BOILER AND SUPERHEATER TUBES



SA-178/SA-178M



(Identical with ASTM Specification A178/A178M-95.)

SPECIFICATION FOR ELECTRIC-RESISTANCE-WELDED CARBON STEEL AND CARBON-MANGANESE STEEL BOILER AND SUPERHEATER TUBES



SA-178/SA-178M



(Identical with ASTM Specification A 178/A 178M-95.)

1. Scope

1.1 This specification covers minimum-wall-thickness, electric-resistance-welded tubes made of carbon steel and carbon-manganese steel intended for use as boiler tubes, boiler flues, superheater flues, and safe ends.

NOTE 1 — Type C and D tubes are not suitable for safe-ending for forge welding.

- 1.2 The tubing sizes and thicknesses usually furnished to this specification are $\frac{1}{2}$ to 5 in. [12.7 to 127 mm] in outside diameter and 0.035 to 0.320 in. [0.9 to 9.1 mm], inclusive, in minimum wall thickness. Tubing having other dimensions may be furnished, provided such tubes comply with all other requirements of this specification.
- 1.3 Mechanical property requirements do not apply to tubing smaller than $\frac{1}{8}$ in. [3.2 mm] in inside diameter or 0.015 in. [0.4 mm] in thickness.
- **1.4** When these products are to be used in applications conforming to ISO Recommendations for Boiler Construction, the requirements of Specification A 520 shall supplement and supersede the requirements of this specification.
- 1.5 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.

2. Referenced Documents

2.1 ASTM Standards:

- A 226/A 226M Specification for Electric-Resistance-Welded Carbon Steel Boiler and Superheater Tubes for High-Pressure Service
- A 450/A 450M Specification for General Requirements for Carbon, Ferritic Alloy, and Austenitic Alloy Steel Tubes
- A 520 Specification for Supplementary Requirements for Seamless and Electric-Resistance-Welded Carbon Steel Tubular Products for High-Temperature Service Conforming to ISO Recommendations for Boiler Construction.
- E 213 Practice for Ultrasonic Examination of Metal Pipe and Tubing
- E 273 Practice for Ultrasonic Examination of Longitudinal Welded Pipe and Tubing

3. Ordering Information

- **3.1** Orders for material under this specification should include the following, as required, to describe the desired material adequately:
 - **3.1.1** Quantity (feet, metres, or number of lengths),
- **3.1.2** Name of material (electric-resistance-welded tubes),
 - **3.1.3** Grade (A, C, or D, Table 1),
- **3.1.4** Size (outside diameter and minimum wall thickness),
 - **3.1.5** Length (specific or random),
- **3.1.6** Optional requirements (product analysis, Section 7; crush test, Section 10; hydrostatic or nondestructive electric test, 11.6),
- **3.1.7** Test report required (Certification Section of Specification A 450/A 450M),
 - **3.1.8** Specification, and designation,

- **3.1.9** Individual supplementary requirements, if required, and
 - **3.1.10** Special requirements.

4. Manufacture

- **4.1** The steel for Grade D shall be killed.
- **4.2** Tubes shall be made by electric-resistance welding.

5. Heat Treatment

5.1 After welding, all tubes shall be heat treated at a temperature of 1650°F [900°C] or higher and followed by cooling in air or in the cooling chamber of a controlled-atmosphere furnace. Cold-drawn tubes shall be heat treated after the final cold-draw pass at a temperature of 1200° [650°C] or higher.

6. Chemical Composition

- **6.1** The steel shall conform to the requirements as to chemical composition prescribed in Table 1.
- **6.2** When a grade is ordered under this specification, supplying an alloy grade that specifically requires the addition of any element other than those listed in Table 1 is not permitted.

7. Product Analysis

- **7.1** When requested on the purchase order, a product analysis shall be made by the manufacturer or supplier from one tube per 100 pieces for sizes over 3 in. [76.2 mm] and one tube per 250 pieces for sizes 3 in. [76.2 mm] and under; or when tubes are identified by heat, one tube per heat shall be analyzed. The chemical composition thus determined shall conform to the requirements specified.
- 7.2 If the original test for product analysis fails, retests of two additional lengths of flat-rolled stock or tubes shall be made. Both retests, for the elements in question, shall meet the requirements of the specification; otherwise all remaining material in the heat or lot (Note 2) shall be rejected or, at the option of the producer, each length of flat-rolled stock or tube may be individually tested for acceptance. Lengths of flat-rolled stock or tubes which do not meet the requirements of the specifications shall be rejected.

NOTE 2 — A lot consists of 250 tubes for sizes 3 in. [76.2 mm] and under and of 100 tubes for sizes over 3 in. [76.2 mm], prior to cutting to length.

8. General Requirements

8.1 Material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A 450/A 450M unless otherwise provided herein.

9. Tensile Requirements

9.1 Grade C and D tubes shall conform to the requirements as to tensile properties prescribed in Table 2.

NOTE 3: Explanatory Note — For purposes of design the following tensile properties may be assumed for Grade A tubes:

Tensile strength, min, ksi [MPa]	47 [325]
Yield Strength, min, ksi [MPa]	26 [180]
Elongation in 2 in. or 50 mm, min, %	35

10. Crush Test

10.1 When required by the purchaser, crushing tests shall be made on sections of tube $2\frac{1}{2}$ in. [63 mm] in length which shall stand crushing longitudinally without cracking, splitting, or opening at the weld, as follows:

Wall Thickness	Height of Crushed Section, in. [mm]				
of Tubes, in. [mm]	Grade A Tubes	Grade C and D Tubes			
0.135 [3.43] and under	³ / ₄ [19] or until outside folds are in contact	Crush tests not required			
Over 0.135 [3.43]	$1\frac{1}{4}$ [32]				

10.2 Table 3 gives the computed minimum elongation values for each $\frac{1}{32}$ in. [0.8 mm] decrease in wall thickness. Where the wall thickness lies between two values shown above, the minimum elongation value shall be determined by the following equation:

$$E = 48t + 15.00 [E = 1.87t + 15.00]$$

where:

E =elongation in 2 in. or 50 mm, %, and,

t = actual thickness of specimen, in. [mm].

10.3 For tubing less than 1 in. [25.4 mm] in outside diameter, the length of the specimen shall be $2\frac{1}{2}$ times the outside diameter of the tube. Slight surface checks shall not be cause for rejection.

11. Mechanical Tests Required

- **11.1** Flattening Test:
- **11.1.1** For Grade A, one flattening test shall be made on specimens from each of two tubes from each lot (Note 2)

or fraction thereof, and from each 2000 ft [600 m] or fraction thereof of safe-end material.

11.1.2 For Grades C and D, one flattening test shall be made on specimens from each of two tubes from each lot (Note 2) or fraction thereof.

11.2 Flange Test:

- 11.2.1 For Grade A, one flange test shall be made on specimens from each of two tubes from each lot (Note 2) or fraction thereof, and from each 2000 ft [600 m] or fraction thereof of safe-end material.
- 11.2.2 For Grades C and D, one flange test shall be made on specimens from each of two tubes from each lot (Note 2) or fraction thereof. The width of the flange shall not be less than 75% of that specified in Specification A 450/A 450M.
- 11.3 Crush Test For Grade A, when required by the purchaser, one crush test shall be made on specimens from each of two tubes from each lot (Note 2) or fraction thereof, and from each 2000 ft [600 m] or fraction thereof of safeend material.
- 11.4 Tension Test For Grades C and D, one tension test shall be made on specimens from each of two tubes from each lot. The term *lot* for tension test requirements applies to all tubes prior to cutting, of the same nominal diameter and wall thickness, which are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and the same heat which are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, a lot shall include all tubes of the same size and heat, heat treated in the same furnace, at the same temperature, time at heat, and furnace speed.

- **11.5** Reverse Flattening Test One reverse flattening test shall be made on each 1500 ft [450 m] of finished tubing.
- 11.6 Hydrostatic or Nondestructive Electric Test Each tube shall be subjected to either the hydrostatic or the nondestructive electric test. The purchaser may specify which test is to be used.

12. Forming Operations

12.1 When inserted in the boiler, tubes shall withstand expanding and beading without showing cracks or flaws, or opening at the weld. When properly manipulated, superheater tubes shall withstand all forging, welding, and bending operations necessary for application without developing defects.

13. Product Marking

- **13.1** In addition to the marking prescribed in Specification A 450/A 450M, the letters "ERW" shall be legibly stenciled on each tube, or marked on a tag attached to the bundle or box in which the tubes are shipped.
- 13.2 The manufacturer's name or symbol may be placed permanently on each tube by rolling or light stamping before normalizing. If a single stamp is placed on the tube by hand, this mark should not be less than 8 in. [200 mm] from one end of the tube.

14. Keywords

14.1 boiler tube; resistance welded steel tube; steel tube, carbon; welded steel tube

TABLE 1
CHEMICAL REQUIREMENTS

		Composition	, %		
Element	Grade A, Low-Carbon Steel	Grade C, Grade D,			
Carbon	0.06-0.18	0.35 max	0.27 max		
Manganese	0.27-0.63	0.80 max	1.00-1.50		
Phosphorus, max	0.035	0.035	0.030		
Sulfur, max	0.035	0.035	0.015		
Silicon			0.10 min		

TABLE 2
TENSILE REQUIREMENTS

	Grade C	Grade D
Tensile strength, min, ksi [MPa] Yield strength, min, ksi [MPa] Elongation in 2 in. or 50 mm, min, % For longitudinal strip tests a deduction for each $^1/_{32}$ in. [0.8 mm] decrease in wall thickness below $^5/_{16}$ in. [8 mm] from the basic minimum elongation of the following percentage points shall be made.	60 [415] 37 [255] 30 1.50 ⁴	70 [485] 40 [275] 30 1.50 ⁴

 $^{^{\}it A}$ See Table 3 for the computed minimum values:

TABLE 3
MINIMUM ELONGATION VALUES

Wall Thick	ness	Elongation in 2 in. or 50
in.	mm	mm, min, % ^A
⁵ / ₁₆ (0.312)	8	30
⁹ / ₃₂ (0.281)	7.2	29
¹ / ₄ (0.250)	6.4	27
⁷ / ₃₂ (0.219)	5.6	26
³ / ₁₆ (0.188)	4.8	24
⁵ / ₃₂ (0.156)	4	22
$\frac{1}{8}$ (0.125)	3.2	21
³ / ₃₂ (0.094)	2.4	20
¹ / ₁₆ (0.062)	1.6	18

 $^{^{\}it A}$ Calculated elongation requirements shall be rounded to the nearest whole number.

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements may become a part of the specification when specified in the inquiry or invitation to bid, and production order or contract. These requirements shall not be considered, unless specified in the order and the necessary tests shall be made at the mill.

S1. Additional Testing of Welded Tubing for ASME Requirements

- **S1.1** The weld seam of each tube shall be subjected to an ultrasonic inspection employing Practices E 273 or E 213 with the rejection criteria referenced in Specification A 450/A 450M.
- **S1.2** If Practice E 273 is employed, a 100% volumetric inspection of the entire length of each tube shall also be performed using one of the nondestructive electric tests

permitted by Specification A 450/A 450M.

- **S1.3** The test methods described in the supplement may not be capable of inspecting the end portions of tubes. This condition is referred to as end effect. This portion, as determined by the manufacturer, shall be removed and discarded.
- **S1.4** In addition to the marking prescribed in Specification A 450/A 450M, "S1" shall be added after the grade designation.

SPECIFICATION FOR SEAMLESS COLD-DRAWN LOW-CARBON STEEL HEAT-EXCHANGER AND CONDENSER TUBES



SA-179/SA-179M



(23)

(Identical with ASTM Specification A179/A179M-19.)

Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes

1. Scope

- 1.1 This specification covers minimum-wall-thickness, seamless cold-drawn low-carbon steel tubes for tubular heat exchangers, condensers, and similar heat transfer apparatus.
- 1.2 This specification covers tubes $\frac{1}{8}$ to 3 in. [3.2 to 76.2 mm], inclusive, in outside diameter.

Note 1—Tubing smaller in outside diameter and having a thinner wall than indicated in this specification is available. Mechanical property requirements do not apply to tubing smaller than $\frac{1}{8}$ in. [3.2 mm] in outside diameter or with a wall thickness under 0.015 in. [0.4 mm].

- 1.3 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.
- 1.4 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A450/A450M Specification for General Requirements for Carbon and Low Alloy Steel Tubes

3. Ordering Information

- 3.1 Orders for material under this specification should include the following, as required, to describe the desired material adequately:
 - 3.1.1 Quantity (feet, metres, or number of lengths),
 - 3.1.2 Name of material (seamless tubes),
 - 3.1.3 Manufacture (cold-drawn),
 - 3.1.4 Size (outside diameter and minimum wall thickness),
 - 3.1.5 Length (specific or random),
- 3.1.6 Optional requirements (product analysis, Section 9, flange test, 11.3),
- 3.1.7 Test report required (Certification Section of Specification A450/A450M),
 - 3.1.8 Specification number, and
 - 3.1.9 Special requirements.

4. General Requirements

4.1 Material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A450/A450M, unless otherwise provided herein.

5. Manufacture

5.1 Tubes shall be made by the seamless process and shall be cold drawn.

6. Heat Treatment

6.1 Tubes shall be heat treated after the final cold draw pass at a temperature of 1200°F [650°C] or higher.

7. Surface Condition

7.1 Finished tubes shall be free of scale. A slight amount of oxidation will not be considered as scale.

8. Chemical Composition

8.1 The steel shall conform to the following requirements as to chemical composition:

 Carbon, %
 0.06–0.18

 Manganese, %
 0.27–0.63

 Phosphorus, max, %
 0.035

 Sulfur, max, %
 0.035

8.2 Supplying an alloy grade that specifically requires the addition of any element other than those listed in 8.1 is not permitted.

9. Product Analysis

- 9.1 When requested on the purchase order, a product analysis shall be made by the supplier from 1 tube per 250 pieces or when tubes are identified by heat, one tube per heat shall be analyzed. The chemical composition thus determined shall conform to the requirements specified.
- 9.2 If the original test for product analysis fails, retests of two additional billets or tubes shall be made. Both retests, for the elements in question, shall meet the requirements of the specification; otherwise all remaining material in the heat or lot (Note 2) shall be rejected or, at the option of the producer, each billet or tube may be individually tested for acceptance. Billets or tubes which do not meet the requirements of the specification shall be rejected.

Note 2—A lot consists of 250 tubes.

10. Hardness Requirements

10.1 The tubes shall have a hardness number not exceeding 72 HRBW.

11. Mechanical Tests Required

- 11.1 Flattening Test—One flattening test shall be made on specimens from each of two tubes from each lot (Note 2) or fraction thereof.
- 11.2 Flaring Test—One flaring test shall be made on specimens from each of two tubes from each lot (Note 2) or fraction thereof.

- 11.3 Flange Test—When specified as a substitute for the flaring test, for tubes having a wall thickness (actual mean wall) less than 10 % of the outside diameter, one test shall be made on specimens from each of two tubes from each lot (Note 2) or fraction thereof. For tubes other than specified above, the flange test shall not be required.
- 11.4 Hardness Test—Rockwell hardness tests shall be made on specimens from two tubes from each lot. The term *lot* applies to all tubes, prior to cutting, of the same nominal diameter and wall thickness which are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and the same heat which are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, a lot shall include all tubes of the same size and heat, heat treated in the same furnace at the same temperature, time at heat, and furnace speed.
- 11.5 *Hydrostatic Test*—Each tube shall be subjected to the hydrostatic test, or, instead of this test, a nondestructive electric test may be used when specified by the purchaser.

12. Product Marking

12.1 In addition to the marking prescribed in Specification A450/A450M, the marking shall include the name and order number of the purchaser.

13. Keywords

13.1 cold drawn tube; condenser tubes; heat exchanger tubes; low carbon steel; seamless tube

EXPLANATORY NOTES

Note 1—For purposes of design, the following tensile properties may be assumed:

Tensile strength, min, ksi [MPa] 47 [325] Yield strength, min, ksi [MPa] 26 [180] Elongation in 2 in. or 50 mm, min, % 35



SPECIFICATION FOR CARBON STEEL FORGINGS, FOR GENERAL-PURPOSE PIPING



SA-181/SA-181M



(Identical with ASTM Specification A181/A181M-06.)

SPECIFICATION FOR CARBON STEEL FORGINGS, FOR GENERAL-PURPOSE PIPING



SA-181/SA-181M



(Identical with ASTM Specification A 181/A 181M-06)

1. Scope

- 1.1 This specification covers nonstandard as-forged fittings, valve components, and parts for general service. Forgings made to this specification are limited to a maximum weight of 10 000 lb [4540 kg]. Larger forgings may be ordered to Specification A 266/A 266M.
- **1.2** Two classes of material are covered, designated as Classes 60 and 70, respectively, and are classified in accordance with their mechanical properties as specified in 6.1.
- 1.3 This specification is expressed in both inch-pound units and SI units. However, unless the order specifies the applicable "M" specification designation (SI units), the material shall be furnished to inch-pound units.
- 1.4 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification.

2. Referenced Documents

- **2.1** ASTM Standards:
- A 266/A 266M Specification for Carbon Steel Forgings for Pressure Vessel Components
- A 788/A 788M Specification for Steel Forgings, General Requirements
- A 961/A 961M Specification for Common Requirements for Steel Flanges, Forged Fittings, Valves, and Parts for Piping Applications

3. General Requirements and Ordering Information

3.1 Product furnished to this specification shall conform to the requirements of Specification A 961/A 961M,

- including any supplementary requirements that are indicated in the purchase order. Failure to comply with the requirements of Specification A 961/A 961M constitutes non-conformance with this specification.
- **3.2** It is the purchaser's responsibility to specify in the purchase order all ordering information necessary to purchase the needed material. Examples of such information include but are not limited to the ordering information in Specification A 961/A 961M and the following:
 - 3.2.1 Supplementary requirements, and
- **3.2.2** Additional requirements (See 4.3, 9.1, 10.2, 12.1, and 12.2).
- **3.3** If the requirements of this specification are in conflict with the requirements of Specification A 961/A 961M, the requirements of this specification shall prevail.

4. Materials and Manufacture

- **4.1** Except for flanges of all types, hollow, cylindrically shaped parts may be machined from hot-rolled or forged bar, provided that the axial length of the part is approximately parallel to the metal flow lines of the stock. Other parts, excluding flanges of all types, up to and including NPS 4 may be machined from hot-rolled or forged bar. Elbows, return bends, tees, and header tees shall not be machined directly from bar stock.
- **4.2** Except as permitted in 4.1, the finished product shall be a forging as defined in the Terminology section (exclusively) of Specification A 788/A 788M.
- **4.3** When specified in the order, the manufacturer shall submit for approval of the purchaser a sketch showing the shape of the rough forging before machining.
- **4.4** Forgings shall be protected against sudden or too rapid cooling from the rolling or forging while passing through the critical range.

4.5 Heat treatment is neither required nor prohibited, but when applied, heat treatment shall consist of tempering, annealing, normalizing, or normalizing and tempering.

5. Chemical Composition

5.1 An analysis of each heat shall be made by the manufacturer to determine the percentages of the elements specified in Table 1. The chemical composition thus determined shall conform to the requirements in Table 1.

6. Mechanical Properties

6.1 The material shall conform to the requirements as to tensile properties prescribed in Table 2.

7. Number of Tests

- 7.1 One tension test shall be made from each heat.
- **7.2** If any test specimen is defectively machined, it may be discarded and another specimen substituted.

8. Retests

8.1 When one or more representative test specimens do not conform to specification requirements for the tested characteristic, only a single retest for each nonconforming characteristic may be performed to establish product acceptability. Retests shall be performed on twice the number of representative specimens that were originally nonconforming. When any retest specimen does not conform to specification requirements for the characteristic in question, the lot represented by that specimen shall be rejected, heat-treated or reheat-treated in accordance with 4.5, and tested in accordance with Sections 6 and 7.

9. Reports of Testing

9.1 Upon request of the purchaser in the contract or order, a report of the test results and chemical analyses shall be furnished. The specification designation included on reports of testing shall include year of issue and revision letter, if any.

10. Repair by Welding

10.1 Repair welding, by the manufacturer, is permissible for parts made to dimensional standards such as those of ANSI or equivalent standards.

- **10.2** Prior approval of the purchaser shall be required to weld repair special parts made to the purchaser's requirements.
- 10.3 The composition of the weld deposits shall be similar to the base metal and in accordance with the procedure qualification for the applicable material. Welding shall be accomplished with a weld procedure designed to produce low hydrogen in the weldment. Short-circuit gas metal arc welding is permissible only with the approval of the purchaser.

11. Marking of Forgings

- 11.1 Identification marks consisting of the manufacturer's symbol or name, designation of service rating, Specification number, class, and size shall be legibly forged or stamped on each forging, and in such a position as not to injure the usefulness of the forgings.
- 11.2 Bar Coding In addition to the requirements in 11.1, bar coding is acceptable as a supplementary identification method. The purchaser may specify in the order a specific bar coding system to be used. The bar coding system, if applied at the discretion of the supplier, should be consistent with one of the published industry standards for bar coding. If used on small parts the bar code may be applied to the box or a substantially applied tag.

12. Certificate of Compliance

- 12.1 When specified in the purchase order or contract, a producer's or supplier's certification shall be furnished to the purchaser that the material was manufactured, sampled, tested, and inspected in accordance with this specification and has been found to meet the requirements. The specification designation included on certificates of compliance shall include year of issue and revision letter, if any.
- **12.2** When specified in the purchase order or contract, a report of the test results shall be furnished.

13. Keywords

13.1 pipe fittings, steel; piping applications; pressure containing parts; steel forgings, carbon; steel valves

TABLE 1 CHEMICAL REQUIREMENTS

Element	Composition, % Classes 60 and 70
Carbon, max.	0.35
Manganese, max.	1.10 ^A
Phosphorus, max.	0.05
Silicon	0.10-0.35
Sulfur, max.	0.05

 $^{^{\}it A}$ Manganese may be increased to 1.35% max. provided the carbon is reduced 0.01% for each 0.06% increase in manganese over the limit shown in the table.

TABLE 2
TENSILE REQUIREMENTS

	Class 60	Class 70
Tensile strength, min., ksi [MPa]	60 [415]	70 [485]
Yield strength, min., ksi [MPa]	30 [205]	36 [250]
Elongation in 2 in. [50 mm], min., %	22	18
Reduction of area, min., %	35	24

 $^{^{\}it A}$ Determined by either the 0.2% offset method or the 0.5% extension-under-load method.

SUPPLEMENTARY REQUIREMENTS

S1. Carbon Equivalent

S1.1 The maximum carbon equivalent based on heat analysis shall be as follows:

	Maximum Carbon	Equivalent Value
Class	Maximum Section Thickness Less Than or Equal to 2 in.	Maximum Section Thickness Greater Than 2 in.
60	0.45	0.46
70	0.47	0.48

S1.2 Determine the carbon equivalent (CE) as follows:

$$CE = C + Mn/6 + (Cr + Mo + V)/5 + (Ni + Cu)/15$$

- **S1.3** A lower maximum carbon equivalent may be agreed upon between the supplier and the purchaser.
- **S1.4** When this Supplementary Requirement is invoked, all elements in the carbon equivalent formula shall be analyzed and the amounts reported.



SPECIFICATION FOR FORGED OR ROLLED ALLOY AND STAINLESS STEEL PIPE FLANGES, FORGED FITTINGS, AND VALVES AND PARTS FOR HIGH-TEMPERATURE SERVICE



SA-182/SA-182M

(23)

(Identical with ASTM Specification A182/A182M-21 except for the inclusion of Grade F316Ti in para. 7.3.1, the removal of reduced strength levels for thicker sections of Grade F53 in Table 3, the removal of Grade F53 Classes in Table 3, the removal of Note (G) in Table 3, the increase of minimum yield strength for Grade F60 in Table 3 and clarification of requirements for parts machined from bar or hollow bar in 6.4, and para. 7.2.1 revised to include F12, Classes 1 and 2.)

Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Forged Fittings, and Valves and Parts for High-Temperature Service

1. Scope

- 1.1 This specification covers forged low alloy and stainless steel piping components for use in pressure systems. Included are flanges, fittings, valves, and similar parts to specified dimensions or to dimensional standards, such as the ASME specifications that are referenced in Section 2.
- 1.2 For bars and products machined directly from bar or hollow bar (other than those directly addressed by this specification; see 6.4), refer to Specifications A479/A479M, A739, or A511/A511M for the similar grades available in those specifications.
- 1.3 Products made to this specification are limited to a maximum weight of 10 000 lb [4540 kg]. For larger products and products for other applications, refer to Specifications A336/A336M and A965/A965M for the similar ferritic and austenitic grades, respectively, available in those specifications.
- 1.4 Several grades of low alloy steels and ferritic, martensitic, austenitic, and ferritic-austenitic stainless steels are included in this specification. Selection will depend upon design and service requirements. Several of the ferritic/austenitic (duplex) grades are also found in Specification A1049/A1049M.
- 1.5 Supplementary requirements are provided for use when additional testing or inspection is desired. These shall apply only when specified individually by the purchaser in the order.
- 1.6 This specification is expressed in both inch-pound units and in SI units. However, unless the order specifies the

applicable "M" specification designation (SI units), the material shall be furnished to inch-pound units.

- 1.7 The values stated in either SI units or inch-pound units are to be regarded separately as the standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.8 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 In addition to the referenced documents listed in Specification A961/A961M, the following list of standards apply to this specification.
 - 2.2 ASTM Standards:
 - A262 Practices for Detecting Susceptibility to Intergranular Attack in Austenitic Stainless Steels
 - A275/A275M Practice for Magnetic Particle Examination of Steel Forgings
 - A336/A336M Specification for Alloy Steel Forgings for Pressure and High-Temperature Parts
 - A388/A388M Practice for Ultrasonic Examination of Steel Forgings
 - A479/A479M Specification for Stainless Steel Bars and Shapes for Use in Boilers and Other Pressure Vessels
 - A484/A484M Specification for General Requirements for Stainless Steel Bars, Billets, and Forgings

- A511/A511M Specification for Seamless Stainless Steel Mechanical Tubing and Hollow Bar
- A739 Specification for Steel Bars, Alloy, Hot-Wrought, for Elevated Temperature or Pressure-Containing Parts, or Both
- A763 Practices for Detecting Susceptibility to Intergranular Attack in Ferritic Stainless Steels
- A788/A788M Specification for Steel Forgings, General Requirements
- A923 Test Methods for Detecting Detrimental Intermetallic Phase in Duplex Austenitic/Ferritic Stainless Steels
- A961/A961M Specification for Common Requirements for Steel Flanges, Forged Fittings, Valves, and Parts for Piping Applications
- A965/A965M Specification for Steel Forgings, Austenitic, for Pressure and High Temperature Parts
- A1049/A1049M Specification for Stainless Steel Forgings, Ferritic/Austenitic (Duplex), for Pressure Vessels and Related Components
- A1084 Test Method for Detecting Detrimental Phases in Lean Duplex Austenitic/Ferritic Stainless Steels
- E92 Test Methods for Vickers Hardness and Knoop Hardness of Metallic Materials
- E112 Test Methods for Determining Average Grain Size E165/E165M Practice for Liquid Penetrant Testing for Gen-
- eral Industry
 E340 Practice for Macroetching Metals and Alloys
- 2.3 ASME Standards:
- B16.11 Forged Steel Fittings, Socket Welding, and Threaded
- 2.4 ASME Boiler and Pressure Vessel Code:

Section IX

- 2.5 AWS Specifications
- A5.4/A5.4M Specification for Stainless Steel Electrodes for Shielded Metal Arc Welding
- A5.5/A5.5M Specification for Low-Alloy Steel Electrodes for Shielded Metal Arc Welding
- A5.9/A5.9M Specification for Bare Stainless Steel Welding Electrodes and Rods
- A5.11/A5.11M Specification for Nickel and Nickel-Alloy Welding Electrodes for Shielded Metal Arc Welding
- A5.14/A5.14M Specification for Nickel and Nickel-Alloy Bare Welding Electrodes and Rods
- A5.23/A5.23M Specification for Low-Alloy Steel Electrodes and Fluxes for Submerged Arc Welding
- A5.28/A5.28M Specification for Low-Alloy Steel Electrodes for Gas Shielded Arc Welding
- A5.29/A5.29M Low-Alloy Steel Electrodes for Flux Cored Arc Welding

3. Terminology

- 3.1 *Definitions*—For definitions of terms used in this specification, refer to Specification A961/A961M.
 - 3.2 Definitions of Terms Specific to This Standard:
- 3.2.1 hardened condition, n—for F 23, the metallurgical condition achieved after normalizing and cooling to room temperature but prior to tempering.

4. Ordering Information

- 4.1 It is the purchaser's responsibility to specify in the purchase order information necessary to purchase the needed material. In addition to the ordering information guidelines in Specification A961/A961M, orders should include the following information:
- 4.1.1 Additional requirements (see 7.2.1, Table 2 footnotes, 9.3, and 19.2), and
- 4.1.2 Requirement, if any, that manufacturer shall submit drawings for approval showing the shape of the rough forging before machining and the exact location of test specimen material (see 9.3.1).

5. General Requirements

5.1 Product furnished to this specification shall conform to the requirements of Specification A961/A961M, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A961/A961M constitutes nonconformance with this specification. In case of conflict between the requirements of this specification and Specification A961/A961M, this specification shall prevail.

6. Manufacture

- 6.1 The low-alloy ferritic steels shall be made by the open-hearth, electric-furnace, or basic-oxygen process with the option of separate degassing and refining processes in each case.
- 6.2 The stainless steels shall be melted by one of the following processes: (a) electric-furnace (with the option of separate degassing and refining processes); (b) vacuum-furnace; or (c) one of the former followed by vacuum or electroslag-consumable remelting. Grade F XM-27Cb may be produced by electron-beam melting.
- 6.3 A sufficient discard shall be made to secure freedom from injurious piping and undue segregation.
- 6.4 Except as permitted in 6.4.2 and 6.4.3, the material shall be forged as close as practicable to the specified shape and size.
- 6.4.1 Parts whose longitudinal axis is not parallel to the longitudinal axis of the bar (such as elbows, return bends, tees, and header tees), and flanges of any type shall be machined directly from the bar.
- 6.4.2 Parts may be machined from hollow bar or forged or rolled solution-annealed austenitic stainless seel bar without additional hot working, provided the longitudinal axis of the part is parallel to the longitudinal axis of the bar.
- 6.4.3 Low alloy, martensitic stainless, ferritic stainless, and ferritic-austenitic stainless steel parts, NPS 4 [DN 100] and under, may be machined from hollow bar or forged or rolled bar, without additional hot working, provided the longitudinal axis of the part is parallel to the longitudinal axis of the bar.
- 6.5 Except as provided for in 6.4, the finished product shall be a forging as defined in the Terminology section of Specification A788/A788M.

7. Heat Treatment

- 7.1 After hot working, forgings shall be cooled to a temperature below 1000 °F [538 °C] prior to heat treating in accordance with the requirements of Table 1.
- 7.2 Low Alloy Steels and Ferritic and Martensitic Stainless Steels—The low alloy steels and ferritic and martensitic stainless steels shall be heat treated in accordance with the requirements of 7.1 and Table 1. When more than one heat treatment option is listed for a Grade in Table 1, any one of the heat treatments listed shall be performed. The selection of the heat treatment shall be at the manufacturer's option, unless otherwise stated in the purchase order.
- 7.2.1 Liquid Quenching—Except as permitted in 7.2.2, for F 1, F 2, and F 12, Classes 1 and 2, and when agreed to by the purchaser, liquid quenching followed by tempering shall be permitted provided the temperatures in Table 1 for each grade are used.
- 7.2.1.1 *Marking*—Parts that are liquid quenched and tempered shall be marked "QT."
- 7.2.2 Alternatively, Grade F 1, F 2, and F 12, Classes 1 and 2 may be given a heat treatment of 1200 °F [650 °C] minimum after final hot or cold forming.
- 7.3 Austenitic and Ferritic-Austenitic Stainless Steels—Except as permitted by 7.5, the austenitic and ferritic-austenitic stainless steels shall be heat treated and liquid-quenched in accordance with the requirements of 7.1 and Table 1.
- 7.3.1 Alternatively, immediately following hot working, while the temperature of the forging is not less than the minimum solution annealing temperature specified in Table 1, forgings made from austenitic grades (except grades F 304H, F 309H, F 310H, F 316H, F 316Ti, F 321, F 321H, F 347, F 347H, F 348, F 348H, F 45, and F 56) may be individually rapidly quenched in accordance with the requirements of Table 1. Ferritic-austenitic grades may be solution annealed without cooling below 1000 °F by being re-heated to the soulutionannealing temperature required in Table 1, held for a time sufficient to dissolve phases and precipitates which may cause a reduction in corrosion or mechanical properties, and quenched in accordance with Table 1.
- 7.3.2 See Supplementary Requirement S8 if a particular heat treatment method is to be employed.
- 7.4 *Time of Heat Treatment*—Heat treatment of forgings may be performed before machining.
- 7.5 Forged or Rolled Bar—Forged or rolled austenitic stainless bar from which cylindrically shaped parts are to be machined, as permitted by 6.4, and the parts machined from such bar, without heat treatment after machining, shall be furnished to the annealing and quenching or rapid-cooling requirements of Specification A484/A484M or this specification, with subsequent light cold drawing and straightening permitted (see Supplementary Requirement S3 if annealing must be the final operation).

7.6 Hollow Bar—Austenitic stainless hollow bar from which cylindrically shaped parts are to be machined, as permitted by 6.4, and the parts machined from such hollow bar, without heat treatment after machining, shall be furnished to the annealing and quenching or rapid-cooling requirements of Specification A511/A511M, or this specification, with subsequent light cold drawing and straightening permitted (see Supplementary Requirement S3 if annealing must be the final operation).

8. Chemical Composition

- 8.1 A chemical heat analysis in accordance with Specification A961/A961M shall be made and conform to the chemical composition prescribed in Table 2.
- 8.2 Grades to which lead, selenium, or other elements are added for the purpose of rendering the material free-machining shall not be used.
- 8.3 Starting material produced to a specification that specifically requires the addition of any element beyond those listed in Table 2 for the applicable grade of material is not permitted.
- 8.4 Steel grades covered in this specification shall not contain an unspecified element, other than nitrogen in stainless steels, for the ordered grade to the extent that the steel conforms to the requirements of another grade for which that element is a specified element having a required minimum content. For this requirement, a grade is defined as an alloy described individually and identified by its own UNS designation or Grade designation and identification symbol in Table 2.
- 8.5 *Product Analysis*—The purchaser may make a product analysis on products supplied to this specification in accordance with Specification A961/A961M.

9. Mechanical Properties

- 9.1 The material shall conform to the requirements as to mechanical properties for the grade ordered as listed in Table 3.
- 9.2 Mechanical test specimens shall be obtained from production forgings, or from separately forged test blanks prepared from the stock used to make the finished product. In either case, mechanical test specimens shall not be removed until after all heat treatment is complete. If repair welding is required, test specimens shall not be removed until after post-weld heat treatment is complete, except for ferritic grades when the post-weld heat treatment is conducted at least 50 °F [30 °C] below the actual tempering temperature. When test blanks are used, they shall receive approximately the same working as the finished product. The test blanks shall be heat treated with the finished product and shall approximate the maximum cross section of the forgings they represent.
- 9.3 For normalized and tempered, or quenched and tempered forgings, the central axis of the test specimen shall be taken at least ${}^{1}\!\!/4\,T$ from the nearest surface as-heat-treated, where T is the maximum heat-treated thickness of the represented forging. In addition, for quenched and tempered forgings, the mid-length of the test specimen shall be at least T from all other surfaces as-heat-treated, exclusive of the T

TABLE 1 Heat Treating Requirements

		TABLE 1 Heat Treating Requirements									
Grade	Heat Treat Type	Austenitizing/Solutioning Temperature, Minimum or Range, °F [°C] ^A	Quenching Cool Below °F [°C]	Tempering Temperature, Minimum or Range, °F [°C]							
			loy Steels		3-7 [-1						
F 1	anneal	1650 [900]	furnace cool	В	В						
	normalize and temper	1650 [900]	air cool	В	1150 [620]						
F 2	anneal	1650 [900]	furnace cool	В	В						
	normalize and temper	1650 [900]	air cool	В	1150 [620]						
F 5, F 5a	anneal	1750 [955]	furnace cool	В	В						
	normalize and temper	1750 [955]	air cool	В В	1250 [675]						
F 9	anneal	1750 [955]	furnace cool	В	1050 [075]						
F 10	normalize and temper	1750 [955]	air cool	500 [260]	1250 [675]						
F 91 Types 1 and 2	solution treat and quench normalize and temper or	1900 [1040] 1900–1975 [1040–1080]	liquid air cool, accelerated air	500 [260] B	1350–1470 [730–800]						
- 91 Types Tanu 2	quench and temper	1900–1975 [1040–1080]	cool, or liquid		1330–1470 [730–800]						
F 92	normalize and temper	1900–1975 [1040–1080]	air cool	В	1350-1470 [730-800]						
= 93	normalize and temper	1960–2140 [1070–1170]	air cool	385 [200]	1380–1455 [750–790]						
= 115	normalize and temper	1920–2010 [1050–1100]	air cool, accelerated air	B	1380–1455 [750–790]						
	·		cool, or liquid								
122	normalize and temper	1900-1975 [1040-1080]	air cool	В	1350-1470 [730-800]						
911	normalize and temper	1900-1975 [1040-1080]	air cool or liquid	В	1365-1435 [740-780]						
11, Class 1, 2, 3	anneal	1650 [900]	furnace cool	В	В						
	normalize and temper	1650 [900]	air cool	В	1150 [620]						
12, Class 1, 2	anneal	1650 [900]	furnace cool	В В	4450 [000]						
- 0.4 - 5.01	normalize and temper	1650 [900]	air cool	В	1150 [620]						
F 21, F 3V, and F BVCb	anneal	1750 [955]	furnace cool	-	-						
SVCD	normalize and temper	1750 [955]	air cool	В	1250 [675]						
22, Class 1, 3	normalize and temper anneal	1650 [900]	furnace cool	В	1250 [675] в						
22, Class 1, 3	normalize and temper	1650 [900]	air cool	В	1250 [675]						
= 22V	normalize and temper or	1650 [900]	air cool or liquid	В	1250 [675]						
	quench and temper	. 555 [555]	an occi oi iiqaia		.200 [0.0]						
23	normalize and temper	1900-1975 [1040-1080]	air cool	В	1350-1470 [730-800]						
		-	accelerated cool								
- 24	normalize and temper	1800-1975 [980-1080]	air cool	В	1350-1470 [730-800]						
			or liquid								
R	anneal	1750 [955]	furnace cool	В	<i>B</i>						
	normalize	1750 [955]	air cool	В В	В						
	normalize and temper	1750 [955]	air cool	В	1250 [675]						
36, Class 1	normalize and temper	1650 [900]	air cool	В	1100 [595]						
36, Class 2	normalize and temper or	1650 [900]	air cool,	_	1100 [595]						
	quench and temper	1650 [900]	accelerated air cool, or liquid		1100 [595]						
		Martensitic	Stainless Steels								
6a Class 1	anneal	not specified	furnace cool	В	В						
	normalize and temper	not specified	air cool	400 [205]	1325 [725]						
	temper	not required	В	В	1325 [725]						
6a Class 2	anneal	not specified	furnace cool	В	В						
	normalize and temper	not specified	air cool	400 [205]	1250 [675]						
	temper	not required	В	В	1250 [675]						
6a Class 3	anneal	not specified	furnace cool	В	В						
	normalize and temper	not specified	air cool	400 [205]	1100 [595]						
6a Class 4	anneal	not specified	furnace cool	_	=						
- Ch	normalize and temper	not specified	air cool	400 [205] B	1000 [540] _B						
6b	anneal	1750 [955]	furnace cool								
= 6NM	normalize and temper normalize and temper	1750 [955] 1850 [1010]	air cool air cool	400 [205] 200 [95]	1150 [620] 1040–1120 [560–600]						
OINIVI	normalize and temper		ainless Steels	200 [95]	1040-1120 [560-600]						
XM-27 Cb	anneal	1850 [1010]	furnace cool	В	В						
= 429	anneal	1850 [1010]	furnace cool	В	В						
430	anneal	not specified	furnace cool	В	В						
			Stainless Steels								
304	solution treat and quench	1900 [1040]	liquid ^E	500 [260]	В						
304H	solution treat and quench	1900 [1040]	liquid ^E	500 [260]	В						
304L	solution treat and quench	1900 [1040]	liquid ^E	500 [260]	В						
304N	solution treat and quench	1900 [1040]	liquid ^E	500 [260]	В						
304LN	solution treat and quench	1900 [1040]	liquid ^E	500 [260]	В						
309H	solution treat and quench	1900 [1040]	liquid ^E	500 [260]	В						
310	solution treat and quench	1900 [1040]	liquid ^E	500 [260]	В						
310H	solution treat and quench	1900 [1040]	liquid ^E	500 [260]	B						
310MoLN	solution treat and quench	1900–2010 [1050–1100]	liquid ^E	500 [260]	B B						
316	solution treat and quench	1900 [1040]	liquid ^E	500 [260]	В						
316H	solution treat and quench	1900 [1040]	liquid ^E	500 [260]	В						
= 316L	solution treat and quench	1900 [1040]	liquid ^E	500 [260]	В						
F 316N	solution treat and quench	1900 [1040]	liquid ^E liquid ^E	500 [260] 500 [260]	В						
F 316LN	solution treat and quench	1900 [1040]									

TABLE 1 Continued

F 316Ti solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317 solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317L solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317LNCb solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317LNCb solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 72 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] B F 73 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] B F 347 solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 347H solution treat and quench 2000 [1095] liquid ^E 500 [260] B	mpering Temperature, Minimum or Range, °F [°C]
or Range, °F [°C] ^A F 316Ti solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317 solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317L solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317LNCb solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317LNCb solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 72 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] B F 73 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] B F 347 solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 347H solution treat and quench 2000 [1095] liquid ^E 500 [260] B	
F 316Ti solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317 solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317L solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317LNCb solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 72 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] B F 73 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] B F 347 solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 347 solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 347 solution treat and quench 2000 [1095] liquid ^E 500 [260] B	Range, °F [°C]
F 317 Solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317L solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317LNCb solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 72 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] B F 73 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] B F 347 solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 347 solution treat and quench 2000 [1095] liquid ^E 500 [260] B	
F 317 solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317L solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 317LNCb solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 72 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] B F 73 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] B F 347 solution treat and quench 1900 [1040] liquid ^E 500 [260] B F 347H solution treat and quench 2000 [1095] liquid ^E 500 [260] B	
F 317L solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B F 317LNCb solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B F 72 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] ^B F 73 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] ^B F 347 solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B F 347H solution treat and quench 2000 [1095] liquid ^E 500 [260] ^B F 347H	
F317LNCb solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B F 72 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] ^B F 73 solution treat and quench 1975–2155 [1080–1180] liquid ^E 500 [260] ^B F 347 solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B F 347H solution treat and quench 2000 [1095] liquid ^E 500 [260] ^B	
F 72 solution treat and quench 1975–2155 [1080–1180] liquid [£] 500 [260] ^B F 73 solution treat and quench 1975–2155 [1080–1180] liquid [£] 500 [260] ^B F 347 solution treat and quench 1900 [1040] liquid [£] 500 [260] ^B F 347H solution treat and quench 2000 [1095] liquid [£] 500 [260] ^B	
F 72 Solution treat and quench 1975–2155 [1080–1180] liquid [£] 500 [260] B F 347 solution treat and quench 1900 [1040] liquid [£] 500 [260] B F 347H solution treat and quench 2000 [1095] liquid [£] 500 [260] B	
F 347 solution treat and quench 1975–2135 [1080–1180] liquid 500 [260] B F 347 solution treat and quench 1900 [1040] liquid 500 [260] B F 347H solution treat and quench 2000 [1095] liquid 500 [260] B	
F 347H solution treat and quench 2000 [1095] liquid 500 [200] B	
300 and the art and quentin 2000 [1000] inquid 500 [200]	
F 347LN solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B	
F 347LNCuB solution treat and quench 1940–2140 liquid ^E 500 [260] ^B	
[1060–1170]	
F 348 solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B	
F 348H solution treat and quench 2000 [1095] liquid ^E 500 [260] ^B	
F 321 solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B	
F 321H solution treat and quench 2000 [1095] liquid ^E 500 [260] ^B	
F XM-11 solution treat and quench 1900 [1040] liquid 500 [260] ^B	
F ANI-TI Solution freat and quench 1900 [1040] liquid 500 [200]	
1 XW 15 Solution treat and quench 1500 [1040] liquid 500 [200]	
1 20 Solution fleat and quench 1700-1000 [325-1010] liquid 500 [200]	
500 [200]	
F 45 solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B	
F 46 solution treat and quench 2010-2140 [1100-1140] liquid ^E 500 [260] ^B	
F 47 solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B	
F 48 solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B	
F 49 solution treat and quench 2050 [1120] liquid ^E 500 [260] ^B	
F 56 solution treat and quench 2050-2160 [1120-1180] liquid ^E 500 [260] ^B	
F 58 solution treat and quench 2085 [1140] liquid ^E 500 [260] ^B	
F 62 solution treat and quench 2025 [1105] liquid ^E 500 [260] ^B	
F 63 solution treat and quench 1900 [1040] liquid ^E 500 [260] ^B	
F 64 solution treat and quench 2010-2140 [1100-1170] liquid ^E 500 [260] ^B	
F 904L solution treat and quench 1920-2100 [1050-1150] liquid ^E 500 [260]	
F 70 solution treat and quench 1900 [1040] liquid ^D 500 [260] ^B	
F700 solution treat and quench 2025-2100 [1107 -1149] liquid/rapid cool 500 [260]	
1700 Solution treat and quench 2025-2100 [1107-1149] Inquitable cool 300 [200]	
Find Solution fleat and querion 1600-1900 [965-1056] inquidrapid cool 500 [200]	
Solution treat and quench 2100-2130 [1143-1177] Inquid/tapid cool 300 [200]	
Finic 11 Solution fleat and querich 2100-2130 [1149-1177] iliquidrapid cool 300 [200]	
1 1925 Solution freat and quench 1000-1900 [905-1000] liquid/tapid cool 500 [200]	
F1925N solution treat and quench 2150 [1177] liquid/rapid cool 500 [260] ^B	
Ferritic-Austenitic Stainless Steels	
F 50 solution treat and quench 1925 [1050] liquid 500 [260] B	
F 51 solution treat and quench 1870 [1020] liquid 500 [260] ^B	
F 52 ^C liquid 500 [260] ^B	
F 53 solution treat and quench 1880 [1025] liquid 500 [260] ^B	
F 54 solution treat and quench 1920-2060 [1050-1125] liquid 500 [260] ^B	
F 55 solution treat and quench 2010-2085 [1100-1140] liquid 500 [260] ^B	
F 57 solution treat and quench 1940 [1060] liquid 175 [80]	
F 59 solution treat and quench 1975-2050 [1080-1120] liquid 500 [260] B	
F 60 solution treat and quench 1870 [1020] liquid 500 [260] B	
F 61 solution treat and quench 1920-2060 [1050-1125] liquid 500 [260]	
Fig. Solution fleat and quench 1920-2000 [1030-1125] liquid 500 [200]	
F 65 Solution treat and quench 1830-2100 [1000-1150] IIquid- 500 [260] -	
300 200]	
500 [200]	
F 68 solution treat and quench 1700–1920 [925–1050] liquid 500 [260] B	
F 69 solution treat and quench 1870 [1020] liquid 500 [260] ^B	
F 71 solution treat and quench 1925–2100 [1050–1150] liquid 500 [260] ⁸	

^A Minimum unless temperature range is listed.

dimension surfaces. When the section thickness does not permit this positioning, the test specimen shall be positioned as near as possible to the prescribed location, as agreed to by the purchaser and the supplier.

9.3.1 With prior purchase approval, the test specimen for ferritic steel forgings may be taken at a depth (t) corresponding to the distance from the area of significant stress to the nearest heat-treated surface and at least twice this distance $(2\ t)$ from any second surface. However, the test depth shall not be nearer

to one treated surface than 3/4 in. [19 mm] and to the second treated surface than 11/2 in. [38 mm]. This method of test specimen location would normally apply to contour-forged parts, or parts with thick cross-sectional areas where 1/4 $T \times T$ testing (see 9.3) is not practical. Sketches showing the exact test locations shall be approved by the purchaser when this method is used.

9.3.2 Metal Buffers—The required distances from heattreated surfaces may be obtained with metal buffers instead of

^B Not applicable

Grade F 52 shall be solution treated at 1825 to 1875 °F [995 to 1025 °C] 30 min/in. of thickness and water quenched.

^D The cooling media for Grades F 65 and F 70 shall be quenching in water or rapidly cooling by other means.

Forged or rolled bar meeting the requirements of 7.5 shall be liquid quenched or rapid-cooled by other means in accordance with Specification A484/A484M.

TABLE 2 Chemical Requirements^A

Grade/Identifi-	UNS						nposition, %	1				
cation Symbol	Desig- nation	Carbon	Manga- nese	Phos- phorus	Sulfur	Silicon	Nickel	Chromium	Molybde- num	Niobium ^B	Titan- ium	Other Elements
						Alloy Steels						
F 1	K12822	0.28	0.60-0.90	0.045	0.045	0.15-0.35			0.44–0.65			
F 2 ^C	K12122	0.05-0.21	0.30-0.80	0.040	0.040	0.10-0.60		0.50-0.81	0.44-0.65			
F 5 ^D	K41545	0.15	0.30-0.60	0.030	0.030	0.50	0.50	4.0-6.0	0.44-0.65			
- 5a ^D	K42544	0.25	0.60	0.040	0.030	0.50	0.50	4.0-6.0	0.44-0.65			
= 9	K90941	0.15	0.30-0.60		0.030	0.50-1.00		8.0–10.0	0.90-1.10			
= 10 = 01 Type 1	S33100 K90901	0.10-0.20 0.08-0.12	0.50-0.80 0.30-0.60		0.030 0.010	1.00-1.40 0.20-0.50	19.0–22.0 0.40	7.0–9.0 8.0–9.5	 0.85–1.05	0.06–0.10		 N 0.03–0.07
F 91 Type 1	N90901	0.00-0.12	0.30-0.00	0.020	0.010	0.20-0.50	0.40	6.0-9.5	0.65-1.05	0.00-0.10	•••	Al 0.02 ^E V 0.18–0.25 Ti 0.01 ^E Zr 0.01 ^E
F 91 Type 2	K90901	0.08-0.12	0.30-0.50 ^E	0.020 ^E	0.005 ^E	0.20-0.40 ^E	0.20 ^E	8.0–9.5 ^{<i>E</i>}	0.85–1.05	0.06–0.10	0.01 ^E	N 0.035-0.070 ^E Al 0.020 ^E N/Al ratio, min 4.0 V 0.18-0.25 Zr 0.01 ^E
F 92	K92460	0.07-0.13	0.30-0.60	0.020	0.010	0.50	0.40	8.50-9.50	0.30-0.60	0.04-0.09		B 0.001 ^E Cu 0.10 ^E W 0.05 ^E Sn 0.010 ^E As 0.010 ^E Sb 0.003 ^E V 0.15–0.25
												N 0.030-0.070 Al 0.02 ^E W 1.50-2.00 B 0.001-0.006 Ti 0.01 ^E
F 93	K91350	0.05–0.10	0.20-0.70	0.020	0.008	0.05-0.50	0.20	8.50–9.50				Zr 0.01 ^E V 0.15–0.30 B 0.007–0.015 Al 0.030 W 2.5–3.5 Co 2.5–3.5 N 0.005–0.015 Nb 0.05–0.12 Nd 0.010–0.06
F 115	K91060	0.08-0.13	0.20-0.50	0.020	0.005	0.15-0.45	0.25	10.0–11.0	0.40-0.60	0.02-0.06	0.01	O 0.0050 V 0.18-0.25 B 0.001 Cu 0.10 Al 0.02 W 0.05 N 0.030-0.070 Zr 0.01 As 0.010 Sn 0.010 Sb 0.003 N/Al ratio 4.0 min
F 122	K91271	0.07–0.14	0.70	0.020	0.010	0.50	0.50	10.00–11.50	0.25–0.60	0.04– 0.10		CNB ^P 10.5 V 0.15–0.30 B 0.005 N 0.040–0.100 Al 0.02 ^E Cu 0.30–1.70 W 1.50–2.50 Ti 0.01 ^E
F 911	K91061	0.09–0.13	0.30-0.60	0.020	0.010	0.10-0.50	0.40	8.5–9.5	0.90-1.10	0.060-0.10		Zr 0.01 [£] W 0.90-1.10 Al 0.02 [£] N 0.04-0.09 V 0.18-0.25 B 0.0003- 0.006 Ti 0.01 [£] Zr 0.01 [£]
F 11	K11597	0.05-0.15	0.30-0.60	0.030	0.030	0.50-1.00		1.00-1.50	0.44-0.65			
Class 1	1/44 = = 0	0.40.000	0.00 0.55	0.010	0.646	0.50 1.05		100 150	0.44.00=			
F 11 Class 2	K11572	0.10-0.20	0.30-0.80	0.040	0.040	0.50–1.00		1.00–1.50	0.44–0.65			

TABLE 2 Continued

Grade/Identifi-	UNS					Col	mposition, %					
cation	Desig- nation	Carbon	Manga- nese	Phos- phorus	Sulfur	Silicon	Nickel	Chromium	Molybde- num	Niobium ^B	Titan- ium	Other Elements
F 11	K11572	0.10-0.20	0.30-0.80	0.040	0.040	0.50-1.00		1.00-1.50	0.44-0.65			
Class 3 F 12 Class 1	K11562	0.05-0.15	0.30-0.60	0.045	0.045	0.50 max		0.80-1.25	0.44-0.65			
F 12 Class 2	K11564	0.10-0.20	0.30-0.80	0.040	0.040	0.10-0.60		0.80-1.25	0.44-0.65			
F 21 F 3V	K31545 K31830	0.05–0.15 0.05–0.18	0.30-0.60 0.30-0.60	0.040 0.020	0.040 0.020	0.50 max 0.10		2.7–3.3 2.8–3.2	0.80-1.06 0.90-1.10		0.015– 0.035	V 0.20-0.30 B 0.001-0.003
F 3VCb	K31390	0.10-0.15	0.30-0.60	0.020	0.010	0.10	0.25	2.7–3.3	0.90-1.10	0.015–0.0	0700.015	V 0.20-0.30 Cu 0.25 Ca 0.0005- 0.0150
F 22 Class 1	K21590	0.05-0.15	0.30-0.60	0.040	0.040	0.50		2.00-2.50	0.87–1.13			
F 22 Class 3	K21590	0.05-0.15	0.30-0.60	0.040	0.040	0.50		2.00-2.50	0.87–1.13			
F 22V	K31835	0.11-0.15	0.30-0.60	0.015	0.010	0.10	0.25	2.00-2.50	0.90-1.10	0.07	0.030	Cu 0.20 V 0.25–0.35 B 0.002 Ca 0.015 ^F
F 23	K40712	0.04-0.10	0.10-0.60	0.030	0.010	0.50	0.40	1.90–2.60	0.05-0.30	0.02- 0.08	0.005– 0.060 ^G	V 0.20–0.30 B 0.0010– 0.006 N 0.015 ^G Al 0.030
F 24	K30736	0.05–0.10	0.30-0.70	0.020	0.010	0.15-0.45		2.20–2.60	0.90–1.10		0.06-0.10	W 1.45–1.75 V 0.20–0.30 N 0.12 AI 0.020 B 0.0015–
FR F 36	K22035 K21001	0.20 0.10–0.17	0.40-1.06 0.80-1.20		0.050 0.025		1.60–2.24 1.00–1.30	0.30	 0.25–0.50	 0.015–0.0	 045	0.0070 Cu 0.75–1.25 N 0.020 Al 0.050 Cu 0.50–0.80 V 0.02
F 6a	S41000	0.15	1.00	0.040	0.030	c Stainless S 1.00	0.50	11.5–13.5				
F 6b F 6NM	S41026 S41500	0.15 0.05	1.00 0.50–1.00	0.020	0.020 0.030	1.00 0.60	1.00–2.00 3.5–5.5	11.5–13.5 11.5–14.0	0.40-0.60 0.50-1.00			Cu 0.50
F XM-	S44627	0.010 ^H	0.40	0.020	Ferritic : 0.020	Stainless Ste 0.40	els 0.50 ^H	25.0–27.5	0.75–1.50	0.05-0.20	1	N 0.015 ^H
27Cb										0.05-0.20	0	Cu 0.20 ^H
F 429 F 430	S42900 S43000	0.12 0.12	1.00 1.00	0.040 0.040	0.030	0.75 0.75	0.50 0.50	14.0–16.0 16.0–18.0				
F 304	S30400	0.08	2.00	0.045	0.030	Stainless Stainl	eeis 8.0–11.0	18.0–20.0				N 0.10
F 304H	S30409	0.04-0.10	2.00	0.045	0.030	1.00	8.0–11.0	18.0–20.0				
F 304L	S30403	0.030	2.00	0.045	0.030	1.00	8.0-13.0	18.0-20.0				N 0.10
F 304N	S30451	0.08	2.00	0.045	0.030	1.00	8.0-10.5	18.0–20.0				N 0.10-0.16
F 304LN	S30453	0.030	2.00	0.045	0.030	1.00	8.0–10.5	18.0–20.0				N 0.10-0.16
F 309H F 310	S30909	0.04–0.10 0.25	2.00 2.00	0.045 0.045	0.030	1.00	12.0–15.0 19.0–22.0	22.0–24.0 24.0–26.0				•••
F 310H	S31000 S31009	0.04-0.10	2.00	0.045	0.030 0.030	1.00 1.00	19.0-22.0	24.0–26.0			•••	
F 310MoLN	S31050	0.030	2.00	0.030	0.015	0.40	21.0–23.0	24.0–26.0	2.00–3.00			 N 0.10–0.16
F 316	S31600	0.08	2.00	0.045	0.030	1.00	10.0–14.0	16.0–18.0	2.00-3.00			N 0.10
F 316H	S31609	0.04-0.10	2.00	0.045	0.030	1.00	10.0–14.0	16.0–18.0	2.00-3.00			
F 316L	S31603	0.030	2.00	0.045	0.030	1.00	10.0-15.0	16.0-18.0	2.00-3.00			N 0.10
F 316N	S31651	80.0	2.00	0.045	0.030	1.00	11.0-14.0	16.0-18.0	2.00-3.00			N 0.10-0.16
F 316LN	S31653	0.030	2.00	0.045	0.030	1.00	11.0-14.0	16.0-18.0	2.00-3.00			N 0.10-0.16
F 316Ti	S31635	0.08	2.00	0.045	0.030	1.00	10.0–14.0	16.0–18.0	2.00-3.00		1	N 0.10 max
F 317	S31700	0.08	2.00	0.045	0.030	1.00	11.0–15.0	18.0–20.0	3.0-4.0			
F 317L	S31703	0.030	2.00	0.045	0.030	1.00	11.0–15.0	18.0–20.0	3.0-4.0	 0.20–0.50 ^N	•••	
F 317LNCb F 72	S31740 S31727	0.005-0.020 0.030	2.00 1.00	0.045 0.030	0.030 0.030	1.00 1.00	11.0–15.0 14.5–16.5	17.0–19.0 17.5–19.0	3.0–4.5 3.8–4.5			 Cu 2.8–4.0
F 70	S31727	0.030	2.00	0.030	0.030	1.00	15–16.5	17.0–19.0	3.0–4.0			N 0.15-0.21 Cu 4.0-5.0
												N 0.045
F 73 F 321	S32053 S32100	0.030 0.08	1.00 2.00	0.030 0.045	0.010 0.030	1.00 1.00	24.0–28.0 9.0–12.0	22.0–24.0 17.0–19.0	5.0–6.0	•••	 J	N 0.17–0.22
F 321H	S32100	0.04-0.10	2.00	0.045	0.030	1.00	9.0–12.0	17.0–19.0			K	
	002100	0.0.0		0.0 10	0.000		J.U 12.0	10.0				

TABLE 2 Continued

						IADLL 2	Continued					
Grade/Identifi- cation	UNS Desig-			Di	0.11		mposition, %	OI :		No. 1. B	- .	
Symbol	nation	Carbon	Manga- nese	Phos- phorus	Sulfur	Silicon	Nickel	Chromium	Molybde- num	Niobium ^B	Titan- ium	Other Elements
F 347	S34700	0.08	2.00	0.045	0.030	1.00	9.0-13.0	17.0-20.0		L		
F 347H	S34709	0.04-0.10	2.00	0.045	0.030	1.00	9.0–13.0	17.0–20.0		M		
F347LN	S34751	0.005-0.020	2.00	0.045	0.030	1.00	9.0–13.0	17.0–19.0		0.20-0.50 ^N		N 0.06-0.10
F347LNCuB	S34752	0.005-0.020	2.00	0.035	0.010	0.60	10.0-13.0	17.0-19.0	0.20-1.20	0.20-0.50 ^N		Cu 2.50-3.50 B 0.001-0.005 N 0.06-0.12
F 348	S34800	0.08	2.00	0.045	0.030	1.00	9.0-13.0	17.0–20.0		L		Co 0.20 Ta 0.10
F 348H	S34809	0.04-0.10	2.00	0.045	0.030	1.00	9.0–13.0	17.0–20.0		М		Co 0.20 Ta 0.10
F XM-11	S21904	0.040	8.0-10.0	0.060	0.030	1.00	5.5-7.5	19.0-21.5				N 0.15-0.40
F XM-19	S20910	0.06	4.0–6.0	0.040	0.030	1.00	11.5–13.5	20.5–23.5	1.50–3.00	0.10- 0.30		N 0.20-0.40 V 0.10-0.30
F 20	N08020	.07	2.00	0.045	0.035	1.00	32.0–38.0	19.0–21.0	2.00-3.00	8xCmin -1.00		Cu 3.0-4.0
F 44	S31254	0.020	1.00	0.030	0.010	0.80	17.5–18.5	19.5–20.5	6.0–6.5			Cu 0.50-1.00 N 0.18-0.25
F 45	S30815	0.05-0.10	0.80	0.040	0.030	1.40-2.00	10.0–12.0	20.0–22.0				N 0.14-0.20 Ce 0.03-0.08
F 46	S30600	0.018	2.00	0.020	0.020	3.7-4.3	14.0-15.5	17.0-18.5	0.20			Cu 0.50
F 47	S31725	0.030	2.00	0.045	0.030	0.75	13.0-17.5	18.0-20.0	4.0-5.0			N 0.10
F 48	S31726	0.030	2.00	0.045	0.030	0.75	13.5-17.5	17.0-20.0	4.0-5.0			N 0.10-0.20
F 49	S34565	0.030	5.0-7.0	0.030	0.010	1.00	16.0–18.0	23.0–25.0	4.0-5.0	0.10		N 0.40-0.60
F 56	S33228	0.04-0.08	1.00	0.020	0.015	0.30	31.0–33.0	26.0–28.0		0.6–1.0		Ce 0.05-0.10 Al 0.025
F 58	S31266	0.030	2.0-4.0	0.035	0.020	1.00	21.0–24.0	23.0–25.0	5.2-6.2			N 0.35-0.60 Cu 1.00-2.50 W 1.50-2.50
F 62	N08367	0.030	2.00	0.040	0.030	1.00	23.5–25.5	20.0–22.0	6.0-7.0			N 0.18–0.25 Cu 0.75
F 63	S32615	0.07	2.00	0.045	0.030	4.8-6.0	19.0-22.0	16.5-19.5	0.30-1.50			Cu 1.50-2.50
F 64	S30601	0.015	0.50-0.80	0.030	0.013	5.0-5.6	17.0-18.0	17.0-18.0	0.20			Cu 0.35, N 0.05
F 904L	N08904	0.020	2.0	0.040	0.030	1.00	23.0-28.0	19.0-23.0	4.0-5.0			Cu 1.00-2.00
F700	N08700	0.04	2.00	0.040	0.030	1.00	24.0-26.0	19.0-23.0	4.3-5.0	8XC Min 0.40		N 0.10 Cu 0.50
FNIC	N08800	0.10	1.50	0.045	0.015	1.00	30.0-35.0	19.0-23.0		Max	0.15-0.60	AI 0.15-0.60
												Cu 0.75 Fe 39.5 min
FNIC10	N08810	0.05-0.10	1.50	0.045	0.015	1.00	30.0-35.0	19.0-23.0			0.15-0.60	Al 0.15-0.60 Cu 0.75 Fe 39.5 min
FNIC11	N08811	0.06-0.10	1.50	0.040	0.015	1.00	30.0-35.0	19.0-23.0			0.25- 0.60 ^Q	Cu 0.75 Al 0.25-0.60 ^Q Fe 39.5 min
F1925	N08925	0.020	1.00	0.045	0.030	0.50	24.0-26.0	19.0-21.0	6.0-7.0			N ₂ 0.10-0.20 ^R Cu 0.80-1.50
F1925N	N08926	0.020	2.00	0.030	0.010	0.50	24.0-26.0	19.0-21.0	6.0-7.0			N ₂ 0.15-0.25 ^R Cu 0.50-1.50
						nitic Stainles						
F 50	S31200	0.030	2.00	0.045	0.030	1.00	5.5-6.5	24.0-26.0	1.20-2.00			N 0.14-0.20
F 51	S31803	0.030	2.00	0.030	0.020	1.00	4.5-6.5	21.0-23.0	2.5–3.5			N 0.08-0.20
F 69	S32101	0.040	4.00–6.00	0.040	0.030	1.00	1.35–1.70	21.0–22.0	0.10–0.80	***	•••	N 0.20-0.25 Cu 0.10-0.80
F 52	S32950	0.030	2.00	0.035	0.010	0.60	3.5-5.2	26.0-29.0	1.00-2.50			N 0.15-0.35
F 53	S32750	0.030	1.20	0.035	0.020	0.80	6.0–8.0	24.0–26.0	3.0-5.0			N 0.24-0.32 Cu 0.50
F 54	S39274	0.030	1.00	0.030	0.020	0.80	6.0–8.0	24.0–26.0	2.5–3.5			N 0.24-0.32 Cu 0.20-0.80 W 1.50-2.50
F 55	S32760	0.030	1.00	0.030	0.010	1.00	6.0–8.0	24.0–26.0	3.0-4.0			N 0.20-0.30 Cu 0.50-1.00
F 57	S39277	0.025	0.80	0.025	0.002	0.80	6.5–8.0	24.0–26.0	3.0-4.0			W 0.50–1.00° Cu 1.20–2.00 W 0.80–1.20
F 59	S32520	0.030	1.50	0.035	0.020	0.80	5.5–8.0	24.0–26.0	3.0-5.0			N 0.23-0.33 N 0.20-0.35 Cu 0.50-3.00
F 60	S32205	0.030	2.00	0.030	0.020	1.00	4.5-6.5	22.0-23.0	3.0-3.5			N 0.14-0.20
					-							

TABLE 2 Continued

Grade/Identifi-	UNS					Co	omposition, %					
cation Symbol	Desig- nation	Carbon	Manga- nese	Phos- phorus	Sulfur	Silicon	Nickel	Chromium	Molybde- num	Niobium ^B	Titan- ium	Other Elements
F 61	S32550	0.040	1.50	0.040	0.030	1.00	4.5–6.5	24.0–27.0	2.9–3.9			Cu 1.50–2.50 N 0.10–0.25
F 65	S32906	0.030	0.80-1.50	0.030	0.030	0.80	5.8–7.5	28.0–30.0	1.5–2.6			Cu 0.80 N 0.30-0.40
F 66	S32202	0.030	2.00	0.040	0.010	1.00	1.00-2.80	21.5-24.0	0.45			N 0.18-0.26
F 67	S32506	0.030	1.00	0.040	0.015	0.90	5.5–7.2	24.0–26.0	3.0–3.5	•••		N 0.08-0.20 W 0.05-0.30
F 68	S32304	0.030	2.50	0.040	0.030	1.00	3.0-5.5	21.5–24.5	0.05-0.60			N 0.05-0.20 Cu 0.05-0.60
F 71	S32808	0.030	1.10	0.030	0.010	0.50	7.0-8.2	27.0–27.9	0.80-1.2			N 0.30-0.40 W 2.10-2.50

All values are maximum unless otherwise stated. Where ellipses (...) appear in this table, there is no requirement and analysis for the element need not be determined or reported.

integral extensions. Buffer material may be carbon or low-alloy steel, and shall be joined to the forging with a partial penetration weld that seals the buffered surface. Specimens shall be located at ½-in. [13-mm] minimum from the buffered surface of the forging. Buffers shall be removed and the welded areas subjected to magnetic particle test to ensure freedom from cracks unless the welded areas are completely removed by subsequent machining.

9.4 For annealed low alloy steels, ferritic stainless steels, and martensitic stainless steels, and also for austenitic and ferritic-austenitic stainless steels, the test specimen may be taken from any convenient location.

9.5 Tension Tests:

9.5.1 Low Alloy Steels and Ferritic and Martensitic Stainless Steels—One tension test shall be made for each heat in each heat treatment charge.

9.5.1.1 When the heat-treating cycles are the same and the furnaces (either batch or continuous type) are controlled within ± 25 °F [± 14 °C] and equipped with recording pyrometers so that complete records of heat treatment are available, then only one tension test from each heat of each forging type (see Note 1) and section size is required, instead of one test from each heat in each heat-treatment charge.

Note 1—"Type" in this case is used to describe the forging shape such as a flange, ell, tee, and the like.

- 9.5.2 Austenitic and Ferritic-Austenitic Stainless Steel Grades—One tension test shall be made for each heat.
- 9.5.2.1 When heat treated in accordance with 7.1, the test blank or forging used to provide the test specimen shall be heat treated with a finished forged product.
- 9.5.2.2 When the alternative method in 7.3.1 is used, the test blank or forging used to provide the test specimen shall be forged and quenched under the same processing conditions as the forgings they represent.
- 9.5.3 Testing shall be performed as specified in Specification A961/A961M using the largest feasible of the round specimens.

9.6 Hardness Tests:

9.6.1 Except when only one forging is produced, a minimum of two pieces per batch or continuous run as defined in 9.6.2 shall be hardness tested as specified in Specification A961/A961M to ensure that the forgings are within the hardness limits given for each grade in Table 3. The purchaser may verify that the requirement has been met by testing at any location on the forging provided such testing does not render the forging useless.

9.6.2 When the reduced number of tension tests permitted by 9.5.1.1 is applied, additional hardness tests shall be made on forgings or samples, as defined in 9.2, scattered throughout the load (see Note 2). At least eight samples shall be checked from

⁸ Niobium and columbium are interchangeable names for the same element and both names are acceptable for use in A01.22 specifications.

^C Grade F 2 was formerly assigned to the 1 % chromium, 0.5 % molybdenum grade which is now Grade F 12.

^D The present grade F 5a (0.25 max carbon) previous to 1955 was assigned the identification symbol F 5. Identification symbol F 5 in 1955 was assigned to the 0.15 max carbon grade to be consistent with ASTM specifications for other products such as pipe, tubing, bolting, welding fittings, and the like. E Applies to both heat and product analyses.

For Grade F 22V, rare earth metals (REM) may be added in place of calcium, subject to agreement between the producer and the purchaser. In that case the total amount of REM shall be determined and reported.

^G The ratio of Titanium to Nitrogen shall be ≥ 3.5. Alternatively, in lieu of this ratio limit, Grade F 23 shall have a minimum hardness of 275 HV (26 HRC, 258 HBW) in the hardened condition (see 3.2.1). Hardness testing shall be performed in accordance with 9.6.3, and the hardness testing results shall be reported on the material test report (see 18.2.5)

H Grade F XM-27Cb shall have a nickel plus copper content of 0.50 max %. Product analysis tolerance over the maximum specified limit for carbon and nitrogen shall be 0.002 %

Grade F 316Ti shall have a titanium content not less than five times the carbon plus nitrogen content and not more than 0.70 %.

Grade F 321 shall have a titanium content of not less than five times the carbon plus nitrogen content and not more than 0.70 %.

K Grade F 321H shall have a titanium content of not less than four times the carbon plus nitrogen content and not more than 0.70 %.

^L Grades F 347 and F 348 shall have a niobium (columbium) content of not less than ten times the carbon content and not more than 1.10 %.

M Grades F 347H and F 348H shall have a niobium (columbium) content of not less than eight times the carbon content and not more than 1.10 %.

^N Grade F 347LN, Grade F 347LNCuB, and Grade F 317LNCb shall have a niobium (columbium) content of not less than 15 times the carbon content.

 $^{^{\}circ}$ % Cr + 3.3 × % (Mo + $^{1}/_{2}$ W) + 16 × % N = 41 min.

P Chromium Nickel Balance is defined as CNB = (Cr+6Si+4Mo+1.5W+11V+5Nb+9Ti+12Al) - (40C+30N+4Ni+2Mn+1Cu).

^Q Al + Ti shall be 0.85 % min: 1.20 % max

 $^{^{\}it R}$ The method of analysis for nitrogen shall be a matter of agreement between purchaser and manufacturer.

TABLE 3 Tensile and Hardness Requirements A

Grade Symbol	Tensile Strength, min, ksi [MPa]	Yield Strength, min, ksi [MPa] ^B	Elongation in 2 in. [50 mm] or 4 <i>D</i> , min, %	Reduction of Area, min, %	Brinell Hardnes Number, HBW, unless otherwis indicated
		Low Alloy St	eels		mulcated
F 1	70 [485]	40 [275]	20	30	143–192
F 2	70 [485]	40 [275]	20	30	143–192
F 5	70 [485]	40 [275]	20	35	143–217
F 5a	90 [620]	65 [450]	22	50	187–248
F 9	85 [585]	55 [380]	20	40	179–217
F 10	80 [550]	30 [205]	30	50	
F 91 Types 1 and 2	90 [620]	60 [415]	20	40	190-248
F 92	90 [620]	64 [440]	20	45	269 max
F 93	90 [620]	64 [440]	19	40	250 max
F 115	90 [620]	65 [450]	20	40	190-248
F 122	90 [620]	58 [400]	20	40	250 max
F 911	90 [620]	64 [440]	18	40	187-248
F 11 Class 1	60 [415]	30 [205]	20	45	121-174
F 11 Class 2	70 [485]	40 [275]	20	30	143-207
F 11 Class 3	75 [515]	45 [310]	20	30	156-207
F 12 Class 1	60 [415]	32 [220]	20	45	121-174
F 12 Class 2	70 [485]	40 [275]	20	30	143–207
F 21	75 [515]	45 [310]	20	30	156–207
F 3V, and F 3VCb	85–110 [585–760]	60 [415]	18	45	174–237
F 22 Class 1	60 [415]	30 [205]	20	35	170 max
F 22 Class 3	75 [515]	45 [310]	20	30	156–207
F 22V	85–110 [585–780]	60 [415]	18	45	174–237
F 23	74 [510]	58 [400]	20	40	220 max
F 24	85 [585]	60 [415]	20	40	248 max
FR	63 [435]	46 [315]	25	38	197 max
F 36, Class 1	90 [620]	64 [440]	15		252 max
F 36, Class 2	95.5 [660]	66.5 [460]	15		252 max
. 00, 0.000 2	00.0 [000]	Martensitic Stainle			LOL MAX
F 6a Class 1	70 [485]	40 [275]	18	35	143-207
F 6a Class 2	85 [585]	55 [380]	18	35	167-229
F 6a Class 3	110 [760]	85 [585]	15	35	235-302
F 6a Class 4	130 [895]	110 [760]	12	35	263-321
F 6b	110–135 [760–930]	90 [620]	16	45	235-285
F 6NM	115 [790]	90 [620]	15	45	295 max
= \/		Ferritic Stainless			
F XM-27Cb	60 [415]	35 [240]	20	45	190 max
F 429	60 [415]	35 [240]	20	45	190 max
F 430	60 [415]	35 [240] Austenitic Stainle	20	45	190 max
F 304	75 [515] ^C	30 [205]	ss steels 30	50	
F 304H	75 [515] ^C	30 [205]	30	50	
F 304L	70 [485] ^D	25 [170]	30	50	
F 304N	80 [550]	35 [240]	30 [€]	50 ^F	
F 304IN	75 [515] ^C	30 [205]	30	50	
F 309H	75 [515] ^C	30 [205]	30	50	• • •
F 310	75 [515] ^c	30 [205]	30	50	***
F 310MoLN	78 [540]	37 [255]	25	40	***
F 310H	75 [540] 75 [515] ^C	30 [205]	30	50	• • •
F 316	75 [515] ² 75 [515] ^C		30	50	• • • •
F 316H	75 [515] ^C	30 [205] 30 [205]	30	50	***
F 316L	75 [515] ² 70 [485] ^D	25 [170]	30	50	• • • •
F 316N			30 ^E	50 ^F	
F 316LN	80 [550] 75 [515] ^C	35 [240] 30 [205]	30-	50 ²	
F 316Ti			30	40	
	75 [515]	30 [205] 30 [205]			
F 317	75 [515] ^C	30 [205]	30	50 50	
F 317L	70 [485] ^D	25 [170]	30	50	
F 317LNCb	75 [515]	30 [205]	35	50	017
F 72	80 [550]	36 [245]	35	50	217
F 73	93 [640]	43 [295]	40	50	217
F 347	75 [515] ^C	30 [205]	30	50	
F 347H	75 [515] ^C	30 [205]	30	50	
F 347LN	75 [515]	30 [205]	30	50	
F 347LNCuB	75 [515]	30 [205]	30	50	
F 348	75 [515] ^C	30 [205]	30	50	
F 348H	75 [515] ^C	30 [205]	30	50	
F 321	75 [515] ^C	30 [205]	30	50	
F 321H	75 [515] ^C	30 [205]	30	50	
F XM-11	90 [620]	50 [345]	45	60	
F XM-19	100 [690]	55 [380]	35	55	
1 /(11/1 10					

TABLE 3 Continued

		IABLE 0 00	THIT I CO		
Grade Symbol	Tensile Strength, min, ksi [MPa]	Yield Strength, min, ksi [MPa] ^B	Elongation in 2 in. [50 mm] or 4 <i>D</i> , min, %	Reduction of Area, min, %	Brinell Hardnes Number, HBW unless otherwis indicated
F 44	94 [650]	44 [300]	35	50	
F 45	87 [600]	45 [310]	40	50	
F 46	78 [540]	35 [240]	40	50	
F 47	75 [525]	30 [205]	40	50	
F 48	80 [550]	35 [240]	40	50	
F 49	115 [795]	60 [415]	35	40	
F 56	73 [500]	27 [185]	30	35	
F 58	109 [750]	61 [420]	35	50	
F 62	95 [655]	45 [310]	30	50	
F 63	80 [550]		25		192 max
		32 [220]			
F 64 F70	90 [620]	40 [275]	35	50	217 max
	70 [480]	25 [175]	35		HRB 90 max
F 904L	71 [490]	31 [215]	35		
F700	80 [550]	35 [240]	30		192
FNIC	65 [450]	25 [170]	30		
FNIC10	65 [450]	25 [170]	30		
FNIC11	65 [450]	25 [170]	30		
F1925	87 [600]	43 [295]	30		
F1925N	94 [650]	43 [295]	35		
F 50	100 100	Ferritic-Austenitic Sta			
F 50	100–130 [690–900]	65 [450]	25	50	
F 51	90 [620]	65 [450]	25	45	
F 52	100 [690]	70 [485]	15	•••	
F 53	116 [800]	80 [550]	15		310 max
F 54 F 55	116 [800] 109–130	80 [550] 80 [550]	15 25	30 45	310 max
. 50	[750–895]	00 [000]	20	10	• • • •
F 57	118 [820]	85 [585]	25	50	
F 59	112 [770]	80 [550]	25	40	
F 60	95 [655]	70 [485]	25	45	
F 61	109 [750]	80 [550]	25	50	
F 65	109 [750]	80 [550]	25		
F 66	94 [650]	65 [450]	30		290 max
F 67	90 [620]	65 [450]	18		302
F 68	87 [600]	58 [400]	25	• • •	290 max
F 69	94 [650]	65 [450]	30	• • •	290 IIIax
F 71	101 [700]	72 [500]	15	• • • •	321
1 / 1	101 [/00]	12 [300]	10		321

A Where ellipses appear in this table, there is no requirement and the test for the value need neither be performed nor a value reported.

each batch load, and at least one check per hour shall be made from a continuous run. When the furnace batch is less than eight forgings, each forging shall be checked. If any check falls outside the prescribed limits, the entire lot of forgings shall be reheat treated and the requirements of 9.5.1 shall apply.

Note 2—The tension test required in 9.5.1 is used to determine material capability and conformance in addition to verifying the adequacy of the heat-treatment cycle. Additional hardness tests in accordance with 9.6.2 are required when 9.5.1.1 is applied to ensure the prescribed heat-treating cycle and uniformity throughout the load.

9.6.3 When the alternative to the Ti/N ratio limit for F 23 is applied, (see Note *P* in Table 2), a minimum of two pieces per

batch or continuous run as defined in 9.6.2 shall be hardness tested, in the hardened condition (see 3.2.1), to ensure that the forgings are within the hardness limit given for F 23 in Note *P* of Table 2. The test samples shall be taken at the mid thickness of the thickest section of the product. Testing shall be performed in accordance with the Test Method E92 or as specified in Specification A961/A961M.

9.7 Notch Toughness Requirements—Grades F 3V, F 3VCb, and F 22V.

^B Determined by the 0.2 % offset method. For ferritic steels only, the 0.5 % extension-under-load method may also be used.

^C For sections over 5 in. [130 mm] in thickness, the minimum tensile strength shall be 70 ksi [485 MPa].

^D For sections over 5 in. [130 mm] in thickness, the minimum tensile strength shall be 65 ksi [450 MPa].

E Longitudinal. The transverse elongation shall be 25 % in 2 in. or 50 mm, min.

 $^{^{\}it F}$ Longitudinal. The transverse reduction of area shall be 45 % min.

- 9.7.1 Impact test specimens shall be Charpy V-notch Type. The usage of subsize specimens due to material limitations must have prior purchaser approval.
- 9.7.2 The Charpy V-notch test specimens shall be obtained as required for tension tests in 9.2, 9.3, and 9.5. One set of three Charpy V-notch specimens shall be taken from each tensile specimen location.
- 9.7.3 The longitudinal axis and mid-length of impact specimen shall be located similarly to the longitudinal axis of the tension test specimens. The axis of the notch shall be normal to the nearest heat-treated surface of the forging.
- 9.7.4 The Charpy V-notch tests shall meet a minimum energy absorption value of 40 ft-lbf [54 J] average of three specimens. One specimen only in one set may be below 40 ft-lbf [54 J], and it shall meet a minimum value of 35 ft-lbf [48 J].
 - 9.7.5 The impact test temperature shall be 0 °F [-18 °C].

10. Grain Size for Austenitic Grades

- 10.1 All H grades and grade F 63 shall be tested for average grain size by Test Methods E112.
- 10.1.1 Grades F 304H, F 309H, F 310H, and F 316H shall have a grain size of ASTM No. 6 or coarser.
- 10.1.2 Grades F 321H, F 347H, and F 348H shall have a grain size of ASTM No. 7 or coarser.
- $10.1.3\,$ Grade F 63 shall have a grain size of ASTM No. 3 or finer.
- 10.1.4 Annealed Alloys UNS N08810 and UNS N08811 shall conform to an average grain size of ASTM No. 5 or coarser.

11. Corrosion Testing for Austenitic Grades and Detrimental Phase Detection in Austenitic/Ferritic Stainless Grades

- 11.1 Corrosion testing is not required by this specification nor is detrimental phase detection.
- 11.2 Austenitic grades shall be capable of meeting the intergranular corrosion test requirements described in Supplementary Requirement S4.
- 11.3 Austenitic/Ferritic Stainless grades shall be capable of meeting the requirements described in Supplementary Requirement S12 if the subject grade is included in the specifications listed in Supplementary Requirement S12.

12. Retreatment

12.1 If the results of the mechanical tests do not conform to the requirements specified, the manufacturer may reheat treat the forgings and repeat the tests specified in Section 9.

13. Nondestructive Test Requirements

13.1 Hollow forgings of Grades F 91 Types 1 and 2, F 92, F 115, F 122, and F 911, NPS 4 [DIN 100] and larger, whose finished internal surfaces are not accessible to magnetic particle or liquid penetrant examination, shall be examined by an ultrasonic test in accordance with Practice A388/A388M, after all forging, mechanical processing, and heat treatment operations have been completed.

- 13.2 Hollow forgings of Grades F 91 Types 1 and 2, F 92, F 115, F 122, and F 911, NPS 4 [DIN 100] and larger, whose finished internal surfaces are accessible to magnetic particle or liquid penetrant examination, shall be examined on their internal surfaces by either a magnetic particle test in accordance with Practice A275/A275M, or by a liquid penetrant examination in accordance with Test Method E165/E165M, as applicable, after all heat treatment, machining, and other mechanical processing operations are completed.
- 13.3 *Time of Examination*—Examination by one of the methods in 13.1 or 13.2, for specification acceptance, shall be performed as specified in 13.1 or 13.2. This requirement does not preclude additional testing at earlier stages in the processing.
- 13.4 Evaluation of Imperfections Found by Ultrasonic Examination:
- 13.4.1 Forgings producing a signal equal to or greater than the lowest signal produced by the reference discontinuities shall be identified and separated from the acceptable forgings. The area producing the signal may be reexamined.
- 13.4.2 Such forgings shall be rejected if the test signals were produced by imperfections that cannot be identified or were produced by cracks or crack-like imperfections. Such forgings may be repaired. To be accepted, a repaired forging shall pass the same nondestructive test by which it was rejected, and it shall meet the minimum wall thickness requirements of this specification and the purchase order.
- 13.4.3 If the test signals were produced by visual imperfections such as scratches, surface roughness, dings, tooling marks, cutting chips, steel die stamps, or stop marks, the forging is permitted to be accepted based upon visual examination provided that the depth of the imperfection is less than 0.004 in. [0.1 mm] or 12.5 % of the specified wall thickness, whichever is the greater.
- 13.5 Treatment of Imperfections Found by Magnetic Particle or Liquid Penetrant Examination:
- 13.5.1 Defects shall be completely removed prior to weld repair by chipping or grinding to sound metal. Removal of these defects shall be verified by magnetic particle inspection in accordance with Test Method A275/A275M or by liquid penetrant inspection in accordance with Test Method E165/E165M.
- 13.5.2 Rejected forgings may be reconditioned and retested, provided that the wall thickness is not decreased to less than that required by this specification and the purchase order. The outside diameter at the point of grinding may be reduced by the amount so removed. To be accepted, retested forgings shall meet the test requirement.
- 13.5.3 If the imperfection is explored to the extent that it can be identified as non-rejectable, the forging may be accepted without further test provided that the imperfection does not encroach on the minimum required wall thickness.

14. Surface Finish, Appearance, and Corrosion Protection

14.1 Forgings and finished parts shall conform to the requirements of Specification A961/A961M.

14.2 The forgings and finished parts shall be free of scale, machining burrs which might hinder fit-up, and other injurious imperfections as defined herein. The forgings and finished parts shall have a workmanlike finish, and machined surfaces (other than surfaces having special requirements) shall have a surface finish not to exceed 250 AA (arithmetic average) roughness height.

15. Repair by Welding

- 15.1 Weld repairs shall be permitted (see Supplementary Requirement S58 of Specification A961/A961M) at the discretion of the manufacturer with the following limitations and requirements:
- 15.1.1 The welding procedure and welders shall be qualified in accordance with Section IX of the ASME Boiler and Pressure Vessel Code.
- 15.1.2 The weld metal shall be deposited using the electrodes specified in Table 4 except as otherwise provided in Supplementary Requirement S5. The electrodes shall be purchased in accordance with AWS Specifications A5.4/A5.4M, A5.5/A5.5M, A5.9/A5.9M, A5.11/A5.11M, A5.14/A5.14M, A5.23/A5.23M, A5.28/A5.28M, or A5.29/A5.29M. The submerged arc process with neutral flux, the gas metal-arc process, the gas tungsten-arc process, and gas shielded processes using flux-core consumables, may be used. For weld deposits made on S20910, the deposited weld metal shall correspond to either the alloy content of the base metal or AWS A5.4 E209 or A5.9 ER209. For weld deposits made on N08367, N08700, N08925 or N08926, the deposited weld metal shall correspond to either the alloy content of the base metal or one of the following filler metals in AWS A5.11 ENiCrMo-3 or A5.14 ERNiCrMo-3, A5.11 ENiCrMo-4 or A5.14 ERNiCrMo-4, or A5.11 ENiCrMo-10 or A5.14 ERNiCrMo-10. For weld deposits made on N08020, the deposited weld metal shall correspond to either the alloy content of the base metal or AWS A5.4 E320/E320LR or A5.9 ER320/320LR. For weld deposits made on N08800, N08810 and N08811, the deposited weld metal shall correspond to either the alloy content of the base metal or AWS A5.11 ENiCr-3 or A5.14 ERNiCr-3. However, the fillers used on these alloys (as well as other listed above) may be dependent on the end service use and service temperature and shall be agreed upon between purchaser and manufacturer.
- 15.1.2.1 Weld deposits made on S20910, N08020, N08367, N08700, N08800, N08810, N08811, N08925, N08926 shall be made using filler metal with a composition conforming to the base material or the equivalent classification in the AWS Filler Metal Specification A5.11 and A5.14. It is possible that weld deposit chemistry will not meet the limits of either the base metal or the filler metal for some elements. The weld deposit chemistry shall meet the lowest minimum and highest maximum values for each specification element in either of the base metal or filler metal specification. Dilution of the base metal and filler metal must be considered when determining weld deposit criteria for over-alloyed filler metals. In either case, the weld deposit chemistry shall be tested and recorded on the Procedure Qualification Record.
- 15.1.3 Defects shall be completely removed prior to welding by chipping or grinding to sound metal as verified by

- magnetic-particle inspection in accordance with Test Method A275/A275M for the low alloy steels and ferritic, martensitic, or ferritic-austenitic stainless steels, or by liquid-penetrant inspection in accordance with Test Method E165/E165M for all grades.
- 15.1.4 After repair welding, the welded area shall be ground smooth to the original contour and shall be completely free of defects as verified by magnetic-particle or liquid-penetrant inspection, as applicable.
- 15.1.5 The preheat, interpass temperature, and post-weld heat treatment requirements given in Table 4 shall be met. Austenitic stainless steel forgings may be repair-welded without the post-weld heat treatment of Table 4, provided purchaser approval is obtained prior to repair.
- 15.1.6 Repair by welding shall not exceed 10 % of the surface area of the forging nor 33½ % of the wall thickness of the finished forging or 3½ in. [9.5 mm], whichever is less, without prior approval of the purchaser.
- 15.1.7 When approval of the purchaser is obtained, the limitations set forth in 15.1.6 may be exceeded, but all other requirements of Section 15 shall apply.
- 15.1.8 No weld repairs are permitted for F 6a Classes 3 and 4
- 15.1.9 Post-weld heat treatment times for F 36 are: for Class 1, up to 2 in. [50 mm] in thickness, 1 h per in. [25 mm], 15 minutes minimum, and over 2 in. [50 mm], 15 minutes for each additional in. of thickness or fraction thereof; for Class 2, 1 h per in. [25 mm], ½ h minimum.

16. Inspection

16.1 Inspection provisions of Specification A961/A961M apply.

17. Rejection and Rehearing

17.1 The purchaser shall comply with the provisions of Specification A961/A961M.

18. Certification

- 18.1 In addition to the certification requirements of Specification A961/A961M, test reports shall be furnished to the purchaser or his representative.
- 18.2 Test reports shall provide the following where applicable:
 - 18.2.1 Type heat treatment, Section 7,
- 18.2.2 Product analysis results, Section 8 of Specification A961/A961M.
- 18.2.3 Tensile property results, Section 9 (Table 3), report the yield strength and tensile strength, in ksi [MPa], elongation and reduction in area, in percent,
- 18.2.4 Chemical analysis results, Section 8 (Table 2), reported results shall be to the same number of significant figures as the limits specified in Table 2 for that element,
- 18.2.5 Hardness results, Section 9 (Table 3, and for F 23, Tables 2 and 3),
 - 18.2.6 Grain size results, Section 10, and
- 18.2.7 Any supplementary testing required by the purchase order.

TABLE 4 Repair Welding Requirements

	IABLE 4	Repair Weiding Requirements	
Grade Symbol	Electrodes ^A	Recommended Preheat and Interpass Temperature	Post Weld Heat-Treatment Temperature, Minimum or
		Range, °F [°C]	Range, °F [°C]
		Low Alloy Steels	5 , 1 ,
F 1	E 7018-A 1	200–400 [95–205]	1150 [620]
F 2	E 8018-B 1	300-600 [150-315]	1150 [620]
F 5	E80XX-B6, where XX can be	400–700 [205–370]	1250 [675]
	15, 16, or 18		
F 5a	E80XX-B6, where XX can be	400–700 [205–370]	1250 [675]
F 9	15, 16, or 18	400 700 [205 270]	1050 [675]
F 9	E80XX-B8, where XX can be 15, 16, or 18	400–700 [205–370]	1250 [675]
F 10 ^B			
F 91 Types 1 and 2	<i>c</i>	400–700 [205–370]	1350–1470 [730–800]
F 92	D	400–700 [205–370]	1350–1470 [730–800]
F 93	D	400–700 [205–370]	1350–1455 [730–790]
F 115	^D	400–700 [205–370]	1345–1435 [730–780]
F 122		400–700 [205–370]	1350–1470 [730–800]
F 911	^D	400–700 [205–370]	1365–1435 [740–780]
F 11, Class 1, 2,	E 8018-B 2	300–600 [150–315]	1150 [620]
and 3	E 0010 B 0	200 000 [450 045]	1150 [000]
F 12, Class 1 and 2 F 21	E 8018-B 2 E 9018-B 3	300–600 [150–315] 300–600 [150–315]	1150 [620] 1250 [675]
F 3V, and F 3VCb	3 % Cr, 1 % Mo, ¼ % V-Ti	300–600 [150–315]	1250 [675]
F 22 Class 1	E 9018-B 3	300–600 [150–315]	1250 [675]
F 22 Class 3	E 9018-B 3	300–600 [150–315]	1250 [675]
F 22V	2.25 % Cr, 1 % Mo, 0.25 %	300-600 [150-315]	1250 [675]
	V-Cb		
F 23	2.25 % Cr, 1.6 % W, 0.25 %	300-600 [150–315]	1350–1470 [730–800]
	V-Mo-Cb-B	_	_
F 24	2.25 % Cr, 1 % Mo, 0.25 % V	200–400 [95–205] ^E	1350–1470 [730–800] ^E
F 36, Class 1	1.15 Ni, 0.65 Cu, Mo, Cb	400–700 [205–370]	1100–1200 [595–650]
F 36, Class 2	1.15 Ni, 0.65 Cu, Mo, Cb	400–700 [205–370]	1000–1150 [540–620]
F 6a, Class 1	E 410-15 or 16	Martensitic Stainless Steels 400-700 [205-370]	1250 [675]
F 6a, Class 2	E 410-15 or 16	400-700 [205-370]	1250 [675]
F 6b	13 % Cr, 1½ % Ni, ½ % Mo	400-700 [205-370]	1150 [620]
F 6NM	13 % Cr, 4 % Ni	300–700 [150–370]	1050 [565]
-		Ferritic Stainless Steels	[]
F XM-27Cb	26 % Cr, 1 % Mo	NR^F	NR
F 429	E 430-16	400–700 [205–370]	1400 [760]
F 430	E 430-16	NR	1400 [760]
FR	E 8018-C2	NR Austenitic Stainless Steels	NR
F 304	E 308-15 or 16	NR	1900 [1040] + WQ ^G
F 304L	E 308L-15 or 16	NR	1900 [1040] + WQ
F 304H	E 308-15 or 16 ^H or E308H-XX	NR	1900 [1040] + WQ
F 304N	E 308-15 or 16	NR	1900 [1040] + WQ
F 304LN	E 308L-15 or 16	NR	1900 [1040] + WQ
F 309H	E 309-15 or 16 ^H or E309H-XX	NR	1900 [1040] + WQ
F 310	E 310-15 or 16	NR	1900 [1040] + WQ
F 310H	E 310-15 or 16 ^H	NR	1900 [1040] + WQ
F 310MoLN	E 310Mo-15 or 16	NR	1920–2010 [1050–1100] + WQ
F 316	E 316-15 or 16 E 316L-15 or 16	NR NR	1900 [1040] + WQ
F 316L F 316H	E 316L-15 or 16 E 316-15 or 16 ^H or E316H-XX	NR NR	1900 [1040] + WQ 1900 [1040] + WQ
F 316N	E 316-15 of 16 of E316H-AA	NR NR	1900 [1040] + WQ 1900 [1040] + WQ
F 316LN	E 316L-15 or 16	NR	1900 [1040] + WQ
F 316Ti	E 316-15 or 16	NR	1900 [1040] + WQ
F 317	E 317-15 or 16	NR	1900 [1040] + WQ
F 317L	E 317L-15 or 16	NR	1900 [1040] + WQ
F 317LNCb	E NiCrCoMo-1 or E NiCrMo-3	NR	1900 [1040] + WQ
F 72	• • •	NR 	
F 73	 E 047.45 av.40	NR	
F 321 ^B	E 347-15 or 16	NR NB	1900 [1040] + WQ
F 321H ^B F 347	E 347-15 or 16 ^H E 347-15 or 16	NR NR	1925 [1050] + WQ
F 347 F 347H	E 347-15 or 16 E 347-15 or 16 ^H	NR NR	1900 [1040] + WQ 1925 [1050] + WQ
	E 347-15 or 16	NR NR	
F 3471 NI		NR NR	• • • • • • • • • • • • • • • • • • • •
F 347LN ¹ F 347LNCuB ¹	E 347-15 or 16		
F 347LNCuB ¹	E 347-15 or 16 E 347-15 or 16		1900 [1040] + WO
	E 347-15 or 16 E 347-15 or 16 E 347-15 or 16 ^H	NR NR	1900 [1040] + WQ 1925 [1050] + WQ
F 347LNCuB ¹ E 348	E 347-15 or 16	NR	1900 [1040] + WQ 1925 [1050] + WQ NR
F 347LNCuB ¹ E 348 F 348H	E 347-15 or 16 E 347-15 or 16 ^H	NR NR NR NR	1925 [1050] + WQ
F 347LNCuB [/] E 348 F 348H F XM-11	E 347-15 or 16 E 347-15 or 16 ^H XM-10W	NR NR NR	1925 [1050] + WQ NR

TABLE 4 Continued

		LE 4 Continued	
Grade Symbol	Electrodes ^A	Recommended Preheat and Interpass Temperature Range, °F [°C]	Post Weld Heat-Treatment Temperature, Minimum or Range, °F [°C]
F 45 ^B			
F 46			
F 47	J		2100 [1150] + WQ
F 48	\dots^J		2100 [1150] + WQ
F 49	\dots J		2100 [1150] + WQ
F 58	E NiCrMo-10		2100 [1150] + WQ
F 62	E NiCrMo-3	NR	2025 [1105] + WQ
F 70	ERNiCr-3, or ERNiCrMo-3, or ERNiCrMo-4	NR	1900 [1040] + WQ
F 904L	E NiCrMo-3	NR	1920-2100 [1050-1150] + WQ
	Ferritic-A	ustenitic Stainless Steels	
F 50	25 % Cr, 6 % Ni, 1.7 % Mo	NR	NR
F 51	22 % Cr, 5.5 % Ni, 3 % Mo	NR	NR
F 52	26 % Cr, 8 % Ni, 2 % Mo	NR	NR
F 53	25 % Cr, 7 % Ni, 4 % Mo	NR	NR
F 54	25 % Cr, 7 % Ni, 3 % Mo, W	NR	NR
F 55	25 % Cr, 7 % Ni, 3.5 % Mo	NR	NR
F 57	25 % Cr, 7 % Ni, 3 % Mo, 1.5 % Cu, 1 % W	NR	NR
F 59	E Ni CrMo-10	NR	NR
F 60	22 % Cr, 5.5 % Ni, 3 % Mo	NR	NR
F 61	26 % Cr, 9 % Ni, 3.5 % Mo	NR	NR
F 65	29 % Cr, 6.5 % Ni, 2 % Mo	NR	NR
F 66	22 % Cr, 2 % Ni, 0.25 % Mo	NR	NR
F 67	•••	NR	NR
F 68		NR	NR
F 69		NR	NR
F 71	27.5 Cr, 7.6 Ni, 1 Mo, 2.3 W	NR	NR

^A Except for Grades F 91 Types 1 and 2, F 92, F 93, F 115, F 911, F 122, F 47, F 48, and F 49, electrodes shall comply with AWS Specifications A5.4/A5.4M, A5.5/A5.5M, A5.9/A5.9M, A5.11/A5.11M, A5.14/A5.14M, A5.23/A5.23M, or A5.28/A5.28M.

19. Product Marking

- 19.1 In addition to the marking requirements of Specification A961/A961M, the following additional marking requirements shall apply:
- 19.1.1 Quenched and tempered low alloy or martensitic stainless forgings shall be stamped with the letters QT following the specification designation.
- 19.1.2 Forgings repaired by welding shall be marked with the letter "W" following the Specification designation. When repair-welded austenitic stainless steel forgings have not been postweld heat treated in accordance with Table 4, the letters "WNS" shall be marked following the specification designation
- 19.1.3 Parts meeting all requirements for more than one class or grade may be marked with more than one class or grade designation such as F 304/F 304H, F 304/F 304L, and the like
- 19.1.4 Plugs and bushings furnished to ASME B16.11 requirements are not required to be marked.
- 19.1.5 When agreed upon between the purchaser and manufacturer, and specified in the order, the markings shall be

painted or stenciled on the fitting or stamped on a metal or plastic tag which shall be securely attached to the fitting.

- 19.1.6 Grade F 91 shall be additionally marked with the appropriate Type.
- 19.2 Bar Coding—In addition to the requirements in 19.1, bar coding is acceptable as a supplemental identification method. The purchaser may specify in the order a specific bar coding system to be used. The bar coding system, if applied at the discretion of the supplier, should be consistent with one of the published industry standards for bar coding. If used on small parts, the bar code may be applied to the box or a substantially applied tag.

20. Keywords

20.1 austenitic stainless steel; chromium alloy steel; chromium-molybdenum steel; ferritic/austenitic stainless steel; ferritic stainless steel; martensitic stainless steel; nickel alloy steel; notch toughness requirements; pipe fittings; piping applications; pressure containing parts; stainless steel fittings; stainless steel forgings; steel; steel flanges; steel forgings,

^B Purchaser approval required.

C All repairs in F 91 Types 1 and 2 shall be made with one of the following welding processes and consumables: SMAW, A5.5/A5.5M E90XX-B9; SAW, A5.23/A5.23M EB9 + flux; GTAW, A5.28/A5.28M ER90S-B9; and FCAW, A5.29/A5.29M E91T1-B9. In addition, the sum of the Ni+Mn content of all welding consumables shall not exceed

^{7.0} All repairs in F 92, F 93, F 115, F 911, and F 122, shall be made using welding consumables meeting the chemical requirements for the grade in Table 2.

E Preheat and PWHT are not required for this grade for forgings whose section thickness does not exceed 0.500 in. [12.7 mm].

FNR = not required.

^G WQ = water guench.

^H Filler metal shall additionally have 0.04 % minimum carbon.

¹ Matching filler metal is available

Match filler metal is available. Fabricators have also used AWS A5.14/A5.14M, Classification ERNiCrMo-3 and AWS A5.11/A5.11M, Class E, ENiCrMo-3 filler metals.

alloy; steel valves; temperature service applications, elevated; temperature service applications, high; wrought material

SUPPLEMENTARY REQUIREMENTS

In addition to any of the supplementary requirements of Specification A961/A961M, the following supplementary requirements shall apply only when specified by the purchaser in the order.

S1. Macroetch Test

S1.1 A sample forging shall be sectioned and etched to show flow lines and internal imperfections. The test shall be conducted according to Test Method E340. Details of the test shall be agreed upon between the manufacturer and the purchaser.

S2. Heat Treatment Details

S2.1 The manufacturer shall furnish a detailed test report containing the information required in 18.2 and shall include all pertinent details of the heat-treating cycle given the forgings.

S3. Material for Optimum Resistance to Stress-Corrosion Cracking

S3.1 Austenitic stainless steel shall be furnished in the solution-annealed condition as a final operation with no subsequent cold working permitted, except, unless specifically prohibited by the purchaser, straightening of bars from which parts are machined is permitted to meet the requirements of Specification A484/A484M.

S4. Corrosion Tests

- S4.1 All austenitic stainless steels shall pass intergranular corrosion tests performed in accordance with Practice E of Practices A262.
- S4.2 Intergranular corrosion tests shall be performed on specimens of ferritic stainless steels as described in Practices A763.
- S4.3 For both the austenitic and ferritic stainless steels, details concerning the number of specimens and their source and location are to be a matter of agreement between the manufacturer and the purchaser.

S5. Special Filler Metal

S5.1 In repair-welded F 316, F 316L, F 316H, and F 316N forgings, the deposited weld metal shall conform to E 308 composition wire. Forgings repair welded with E 308 weld metal shall be marked F _ W 308.

S6. Hardness Test

S6.1 Each forging shall be hardness tested and shall meet the requirements of Table 3.

S8. Heat Treatment of Austenitic Forgings

- S8.1 The purchaser shall specify the heat-treatment method (in 7.1 or in 7.3.1) that shall be employed.
- S8.2 The manufacturer shall provide a test report containing the information required in 18.2 and shall include a statement of the heat-treatment method employed.

S9. Grain Size for Austenitic Grades

S9.1 Forgings made from austenitic grades other than H grades shall be tested for average grain size by Test Method E112. Details of the test shall be agreed upon between the manufacturer and the purchaser.

S10. Stabilizing Treatment

S10.1 Subsequent to the solution anneal for Grades F 321, F 321H, F 347, F 347H, F 348, and F 348H, these grades shall be given a stabilizing treatment at 1500 to 1600 °F [815 to 870 °C] for a minimum of 2 h/in. [4.7 min/mm] of thickness and then cooling in the furnace or in air. In addition to the marking required in Section 19, the grade designation symbol shall be followed by the symbol "S10."

S11. Grain Size Requirements for Non-H-Grade Austenitic Steels Used Above 1000 °F [540 °C]

S11.1 Non-H grades of austenitic stainless steels shall have a grain size of No. 7 or coarser as determined in accordance with Test Methods E112. The grain size so determined shall be on a certified test report.

S12. Detection of Detrimental Phases in Austenitic/Ferritic Stainless Steels

- S12.1 All austenitic/ferritic stainless steels that are included in Test Methods A923 shall meet the requirements of those test methods
- S12.2 All austenitic/ferritic stainless steels that are included in Test Method A1084 shall meet the requirements of that test method.



SPECIFICATION FOR SEAMLESS CARBON STEEL BOILER TUBES FOR HIGH-PRESSURE SERVICE



SA-192/SA-192M



(23)

(Identical with ASTM Specification A192/A192M-17.)

Specification for Seamless Carbon Steel Boiler Tubes for High-Pressure Service

1. Scope

- 1.1 This specification covers minimum-wall-thickness, seamless carbon steel boiler and superheater tubes for high-pressure service.
- 1.2 The tubing sizes and thicknesses usually furnished to this specification are $\frac{1}{2}$ in. to 7 in. [12.7 to 177.8 mm] outside diameter and 0.085 to 1.000 in. [2.2 to 25.4 mm], inclusive, in minimum wall thickness. Tubing having other dimensions may be furnished, provided such tubes comply with all other requirements of this specification.
- 1.3 Mechanical property requirements do not apply to tubing smaller than $\frac{1}{8}$ in. [3.2 mm] inside diameter or 0.015 in. [0.4 mm] thickness.
- 1.4 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.
- 1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A450/A450M Specification for General Requirements for Carbon and Low Alloy Steel Tubes

3. Ordering Information

- 3.1 Orders for material under this specification should include the following, as required, to describe the desired material adequately:
 - 3.1.1 Quantity (feet, metres, or number of lengths),
 - 3.1.2 Name of material (seamless tubes),
 - 3.1.3 Manufacture (hot-finished or cold-finished).
 - 3.1.4 Size (outside diameter and minimum wall thickness),
 - 3.1.5 Length (specific or random),
 - 3.1.6 Optional requirements (Sections 8.1 and 10.4),
- 3.1.7 Test report required (see section on Certification of Specification A450/A450M),
 - 3.1.8 Specification designation, and
 - 3.1.9 Special requirements.

4. General Requirements

4.1 Material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A450/A450M, unless otherwise provided herein.

5. Manufacture

5.1 Tubes shall be made by the seamless process and shall be either hot-finished or cold-finished, as specified.

6. Heat Treatment

6.1 Hot-finished tubes need not be heat treated. Cold-finished tubes shall be heat treated after the final cold-finishing at a temperature of 1200° F [650° C] or higher.

7. Chemical Composition

7.1 The steel shall conform to the following requirements as to chemical composition:

Carbon, %	0.06-0.18
Manganese, %	0.27-0.63
Phosphorus, max, %	0.035
Sulfur, max, %	0.035
Silicon, max, %	0.25

7.2 Supplying an alloy grade of steel that specifically requires the addition of any element other than those listed in 7.1 is not permitted.

8. Product Analysis

- 8.1 When requested on the purchase order, a product analysis shall be made by the supplier from one tube per 100 pieces for sizes over 3 in. [76.2 mm] and one tube per 250 pieces for sizes 3 in. [76.2 mm] and under; or when tubes are identified by heat, one tube per heat shall be analyzed. The chemical composition thus determined shall conform to the requirements specified.
- 8.2 If the original test for product analysis fails, retests of two additional billets or tubes shall be made. Both retests, for the elements in question, shall meet the requirements of the specification; otherwise all remaining material in the heat or lot (see Note 1) shall be rejected or, at the option of the producer, each billet or tube may be individually tested for acceptance. Billets or tubes which do not meet the requirements of the specification shall be rejected.

Note 1—A lot consists of 250 tubes for sizes 3 in. [76.2 mm] and under and of 100 tubes for sizes over 3 in. [76.2 mm], prior to cutting to length.

9. Hardness Requirements

9.1 The tubes shall have a hardness number not exceeding the following:

Brinell Hardness Number (Tubes 0.200 in. [5.1 mm] and over in wall thickness)	Rockwell Hardness Number (Tubes less than 0.200 in. [5.1 mm] in wall thickness)
137 HBW	77 HRBW

10. Mechanical Tests Required

- 10.1 *Flattening Test*—One flattening test shall be made on specimens from each end of two tubes selected from each lot (see Note 1) or fraction thereof.
- 10.2 Flaring Test—One flaring test shall be made on specimens from each end of two tubes selected from each lot (see Note 1) or fraction thereof. These tubes shall be selected apart from those used for the flattening test.
- 10.3 Hardness Test—Brinell or Rockwell hardness tests shall be made on specimens from two tubes from each lot. The term lot applies to all tubes prior to cutting, of the same nominal diameter and wall thickness which are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and the same heat which are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, a lot shall include all tubes of the same size and heat, heat treated in the same furnace at the same temperature, time at heat, and furnace speed.
- 10.4 *Hydrostatic Test*—Each tube shall be subjected to the hydrostatic pressure test, or instead of this test, a nondestructive test may be used when specified by the purchaser.

11. Forming Operations

11.1 Tubes when inserted in the boiler shall stand expanding and beading without showing cracks or flaws. Superheater tubes when properly manipulated shall stand all forging, welding, and bending operations necessary for application without developing defects.

12. Product Marking

12.1 In addition to the marking prescribed in Specification A450/A450M, the marking shall indicate whether the tube is hot finished or cold finished.

13. Keywords

13.1 boiler tubes; seamless steel tube; steel tube-carbon

EXPLANATORY NOTES

Note 1—For purposes of design, the following tensile properties may be assumed:

Tensile strength, min, ksi [MPa]	47 [325]
Yield strength, min, ksi [MPa]	26 [180]
Elongation in 2 in. or 50 mm, min, %	35



SPECIFICATION FOR ALLOY-STEEL AND STAINLESS STEEL BOLTING FOR HIGH-TEMPERATURE OR HIGH PRESSURE SERVICE AND OTHER SPECIAL PURPOSE APPLICATIONS



SA-193/SA-193M



(23)

(Identical with ASTM Specification A193/A193M-20.)

Specification for Alloy-Steel and Stainless Steel Bolting for High Temperature or High Pressure Service and Other Special Purpose Applications

1. Scope

- 1.1 This specification covers alloy and stainless steel bolting materials and bolting components for pressure vessels, valves, flanges, and fittings for high temperature or high pressure service, or other special purpose applications. See Specification A962/A962M for the definition of bolting. Bars and wire shall be hot-wrought and may be further processed by centerless grinding or by cold drawing. Austenitic stainless steel may be carbide solution treated or carbide solution treated and strain-hardened. When strain hardened austenitic stainless steel is ordered, the purchaser should take special care to ensure that Appendix X1 is thoroughly understood.
- 1.2 Several grades are covered, including ferritic steels and austenitic stainless steels designated B5, B8, and so forth. Selection will depend upon design, service conditions, mechanical properties, and high temperature characteristics.
- 1.3 The following referenced general requirements are indispensable for application of this specification: Specification A962/A962M.
- Note 1—The committee formulating this specification has included several steel types that have been rather extensively used for the present purpose. Other compositions will be considered for inclusion by the committee from time to time as the need becomes apparent.
- Note 2—For grades of alloy-steel bolting suitable for use at the lower range of high temperature applications, reference should be made to Specification A354.
- Note 3—For grades of alloy-steel bolting suitable for use in low temperature applications, reference should be made to Specification A320/A320M.
 - 1.4 Nuts for use with bolting are covered in Section 13.

- 1.5 Supplementary Requirements are provided for use at the option of the purchaser. The supplementary requirements shall apply only when specified in the purchase order or contract.
- 1.6 This specification is expressed in both inch-pound units and in SI units; however, unless the purchase order or contract specifies the applicable *M* specification designation (SI units), the inch-pound units shall apply.
- 1.7 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.8 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A153/A153M Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
- A194/A194M Specification for Carbon Steel, Alloy Steel, and Stainless Steel Nuts for Bolts for High Pressure or High Temperature Service, or Both
- A320/A320M Specification for Alloy-Steel and Stainless Steel Bolting for Low-Temperature Service
- A354 Specification for Quenched and Tempered Alloy Steel Bolts, Studs, and Other Externally Threaded Fasteners
- A788/A788M Specification for Steel Forgings, General Requirements

A962/A962M Specification for Common Requirements for Bolting Intended for Use at Any Temperature from Cryogenic to the Creep Range

B633 Specification for Electrodeposited Coatings of Zinc on Iron and Steel

B695 Specification for Coatings of Zinc Mechanically Deposited on Iron and Steel

B696 Specification for Coatings of Cadmium Mechanically Deposited

B766 Specification for Electrodeposited Coatings of Cadmium

E18 Test Methods for Rockwell Hardness of Metallic Materials

E21 Test Methods for Elevated Temperature Tension Tests of Metallic Materials

E112 Test Methods for Determining Average Grain Size

E139 Test Methods for Conducting Creep, Creep-Rupture, and Stress-Rupture Tests of Metallic Materials

E150 Recommended Practice for Conducting Creep and Creep-Rupture Tension Tests of Metallic Materials Under Conditions of Rapid Heating and Short Times (Withdrawn 1984)

E151 Recommended Practice for Tension Tests of Metallic Materials at Elevated Temperatures with Rapid Heating and Conventional or Rapid Strain Rates (Withdrawn 1984)

E292 Test Methods for Conducting Time-for-Rupture Notch Tension Tests of Materials

E328 Test Methods for Stress Relaxation for Materials and Structures

E566 Practice for Electromagnetic (Eddy Current/Magnetic Induction) Sorting of Ferrous Metals

E709 Guide for Magnetic Particle Testing

F606/F606M Test Methods for Determining the Mechanical Properties of Externally and Internally Threaded Fasteners, Washers, Direct Tension Indicators, and Rivets

F1940 Test Method for Process Control Verification to Prevent Hydrogen Embrittlement in Plated or Coated Fasteners

F1941/F1941M Specification for Electrodeposited Coatings on Mechanical Fasteners, Inch and Metric

F2329/F2329M Specification for Zinc Coating, Hot-Dip, Requirements for Application to Carbon and Alloy Steel Bolts, Screws, Washers, Nuts, and Special Threaded Fasteners

2.2 ASME Standards:

B18.2.1 Square and Hex Bolts and Screws

B18.2.3.3M Metric Heavy Hex Screws

B18.3 Hexagon Socket and Spline Socket Screws

B18.3.1M Metric Socket Head Cap Screws

2.3 AIAG Standard:

AIAG B-5 02.00 Primary Metals Identification Tag Application Standard

3. General Requirements and Ordering Information

- 3.1 The inquiry and orders shall include the following, as required, to describe the desired bolting material or bolting components adequately:
- 3.1.1 Heat-treated condition (that is carbide solution treated (Class 1), carbide solution treated after finishing (Class 1A), and carbide solution treated and strain-hardened (Classes 2, 2B and 2C), for the austenitic stainless steels; Classes 1B and 1C apply to the carbide solution-treated nitrogen-bearing stainless steels; Class 1D applies to bolting material that is carbide solution treated by cooling rapidly from the rolling temperature),
- 3.1.2 Description of items required (that is, bars, bolts, screws, or studs),
- 3.1.3 Nuts, if required by purchaser, in accordance with 13.1.
 - 3.1.4 Supplementary requirements, if any, and
- 3.1.5 Special requirements, in accordance with 6.1.5.1, 6.2.6, 8.1, and 13.1.
- 3.2 Coatings—Coatings are prohibited unless specified by the purchaser (See Supplementary Requirements S13 and S14). When coated bolting components are ordered the purchaser should take special care to ensure that Appendix X2 is thoroughly understood.

4. Common Requirements

4.1 Bolting materials and bolting components supplied to this specification shall conform to the requirements of Specification A962/A962M. These requirements include test methods, finish, thread dimensions, macroetch (alloy steels only), marking, certification, optional supplementary requirements, and others. Failure to comply with the requirements of Specification A962/A962M constitutes nonconformance with this specification. In case of conflict between this specification and Specification A962/A962M, this specification shall prevail.

5. Manufacture (Process)

- 5.1 *Melting*—See Specification A962/A962M for requirements.
- 5.2 Quality—See Specification A962/A962M for requirements.

6. Heat Treatment

6.1 Ferritic Steels:

6.1.1 Ferritic steels shall be allowed to cool to a temperature below the cooling transformation range immediately after rolling or forging. Bolting materials shall then be uniformly reheated to the proper temperature to refine the grain (a group thus reheated being known as a *quenching charge*), quenched

					TABLE I	Cileilic		ic Steels	iipositioi	n, percent)						
	Description						remi	ic Steels								
Grade	and UNS Designation	Class	Carbon	Manganese	Phosphorus	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Cooper	Niobium ^F	Titanium	Vanadium	Aluminum	Nitrogen
B5	5 % Chromium	Olass	0.10 min	1.00	0.040	0.030	1.00	4.0–6.0		0.40-0.65				···		···
Product Analysis Variation ^B			0.01	0.03	0.005	0.005	0.05	0.10		0.05						
B6, B6X	12 % Chromium (410), S41000		0.08–0.15	1.00	0.040	0.030	1.00	11.5–13.5								
Product Analysis Variation ^B			0.01 over	0.03	0.005	0.005	0.05	0.15								
B7, B7M	Chromium- Molybdenum ^C		0.38-0.48 ^D	0.75-1.00	0.035	0.040	0.15-0.35	0.80-1.10		0.15-0.25						
Product Analysis Variation ^B			0.02	0.04	0.005	0.005	0.02	0.05		0.02						
B16	Chromium- Molybdenum- Vanadium		0.36-0.47	0.45-0.70	0.035	0.040	0.15-0.35	0.80-1.15		0.50-0.65				0.25-0.35	0.015 ^E	
Product Analysis Variation ^B			0.02	0.03	0.005	0.005	0.02	0.05		0.03				0.03		
							Austen	itic Steels								
Grade	Description and UNS Designation	Classes	Carbon	Manganese	Phosphorous	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Copper	Niobium ^F	Titanium	Vanadium	Aluminum	Nitrogen
B8, B8A	304, S30400	1, 1A, 1D, 2	0.08	2.00	0.045	0.030	1.00	18.0–20.0	8.0-11.0							
Product Analysis Variation ^B			0.01	0.04	0.010	0.005	0.05	0.20	0.15							
B8C, B8CA	347, S34700	1, 1A, 1D, 2	0.08	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0			10 × C to 1.10				
Product Analysis Variation ^B			0.01	0.04	0.010	0.005	0.05	0.20	0.15			0.05 under				
B8M, B8MA, B8M2, B8M3	316, S31600	1, 1A, 1D, 2	0.08	2.00	0.045	0.030	1.00	16.0–18.0	10.0–14.0	2.00–3.00						
Product Analysis Variation ^B			0.01	0.04	0.010	0.005	0.05	0.20	0.15	0.10						

ASME BPVC.II.A-2023

							TABLE 1	Continue	d						
B8P, B8PA	S30500	1, 1A, 1D, 2	0.12	2.00	0.045	0.030	1.00	17.0–19.0	11.0–13.0						
Product Analysis Variation ^B			0.01	0.04	0.010	0.005	0.05	0.20	0.15						
B8N, B8NA	304N, S30451	1A, 1B, 1D, 2	0.08	2.00	0.045	0.030	1.00	18.0–20.0	8.0-11.0						 0.10-0.16
Product Analysis Variation ^B			0.01	0.04	0.010	0.005	0.05	0.20	0.15						 0.01
B8MN, B8MNA	316N, S31651	1A, 1B, 1D, 2	0.08	2.00	0.045	0.030	1.00	16.0–18.0	10.0–13.0	2.00-3.00					 0.10-0.16
Product Analysis Variation ^B			0.01	0.04	0.010	0.005	0.05	0.20	0.15	0.10					 0.01
B8MLCuN, B8MLCuNA	S31254	1A, 1B, 1D, 2	0.020	1.00	0.030	0.010	0.80	19.5–20.5	17.5–18.5	6.0–6.5	0.50-1.00				 0.18-0.25
Product Analysis Variation ^B			0.005	0.03	0.005	0.002	0.05	0.20	0.15	0.10					 0.02
B8T, B8TA	321, S32100	1, 1A, 2	0.08	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0				5 × (C + N) to 0.70		 0.10
Product Analysis Variation ^B			0.01	0.04	0.010	0.005	0.05	0.20	0.15				0.05 under		
B8R, B8RA	S20910	1C, 1D	0.06	4.0-6.0	0.045	0.030	1.00	20.5–23.5	11.5–13.5	1.50-3.00		0.10-0.30		0.10-0.30	 0.20-0.40
Product Analysis Variation ^B			0.01	0.05	0.005	0.005	0.05	0.25	0.15	0.10		0.05		0.02	 0.02
B8S, B8SA	S21800	1C, 1D	0.10	7.0–9.0	0.060	0.030	3.5–4.5	16.0–18.0	8.0-9.0						 0.08-0.18
Product Analysis Variation ^B			0.01	0.06	0.005	0.005	0.15	0.20	0.10						 0.01
B8LN, B8LNA	S30453	1, 1A, 1D	0.030	2.00	0.045	0.030	1.00	18.0–20.0	8.0-11.0						 0.10-0.16
Product Analysis Variation ^B			0.005	0.04	0.010	0.005	0.05	0.20	0.15						 0.01

							TABLE 1	Continue	d					
B8MLN, B8MLNA	S31653	1, 1A, 1D	0.030	2.00	0.045	0.030	1.00	16.0–18.0	10.0–13.0	2.00-3.00			 	 0.10-0.16
Product Analysis Variation ^B			0.005	0.04	0.010	0.005	0.05	0.20	0.15	0.10			 	 0.01
B8CLN, B8CLNA	347LN, S34751	1, 1A, 1D	0.005- 0.020	2.00	0.045	0.030	1.00	17.0–19.0	9.0–13.0			0.20–0.50; 15 × carbon content, min	 	 0.06-0.10
Product Analysis Variation ^B			0.002 under, 0.005 over	0.04	0.01	0.005	0.05	0.20	0.15			0.05	 	 0.01
B8CLNCu B B8CLNCu BA	S34752 ^G	1,1A,1D	0.005- 0.02	2.00	0.035	0.010	0.60	17.0-19.0	10.0-13.0	0.20-1.20	2.50-3.50	0.20–0.50; 15 × carbon content, min	 	 0.06-0.12
Product Analysis Variation			0.002 under, 0.005 over	0.04	0.01	0.005	0.05	0.20	0.15		0.15	0.05	 	 0.01
B8ML4CuN, B8ML4CuNA	S31730	1, 1A, 1D	0.030	2.00	0.040	0.010	1.00	17.0–19.0	15.0–16.5	3.0-4.0	4.0-5.0		 	 0.045
Product Analysis Variation ^B			0.005	0.04	0.005	0.002	0.05	0.20	0.15	0.10	0.15		 	 0.01

^AValues are maximums unless a range or a minimum is indicated. Where ellipses appear in this table, there is no requirement and the element need not be determined or reported. The intentional addition of Bi, Se, Te, and Pb is not permitted.

^BProduct Analysis—Individual determinations sometimes vary from the specified limits as shown in the tables. The several determinations of any individual element in a heat may not vary both above and below the specified range. Product variation limits are over for maximums, over or under for ranges, and under for minimums, unless otherwise indicated.

^CTypical steel compositions used for this grade include 4140, 4142, 4145, 4140H, 4142H, and 4145H.

^DFor bar sizes over 3½ in. [90 mm], inclusive, the carbon content may be 0.50 % max. For the B7M grade, a minimum carbon of 0.28 % is permitted, provided that the required tensile properties are met in the section sizes involved, the use of AISI 4130 or 4130H is allowed.

ETotal of soluble and insoluble.

^FColumbium and Niobium are alternate names for element 41 in the Periodic Table of the Elements.

^GFor S34752 – Boron content shall be 0.001-0.005 for both heat and product analysis.

in a liquid medium under substantially uniform conditions for each quenching charge, and tempered. The minimum tempering temperature shall be as specified in Tables 2 and 3.

TABLE 2 Mechanical Requirements — Inch Products

Grade	Diameter, in.	Minimum Tempering Temperature, °F	Tensile Strength, min, ksi	Yield Strength, min, 0.2 % offset, ksi	Elongation in 4D, min, %	Reduction of Area min, %	, max
		Ferritic Steel	S				
B5 4 to 6 % chromium B6	up to 4, incl	1100	100	80	16	50	
3 % chromium	up to 4, incl	1100	110	85	15	50	
B6X 3 % chromium	up to 4, incl	1100	90	70	16	50	26 HRC
B7 Chromium-molybdenum	21/2 and under	1100	125	105	16	50	321 HBW or 35 HRC
	over 2½ to 4	1100	115	95	16	50	321 HBW or
	over 4 to 7	1100	100	75	18	50	35 HRC 321 HBW or 35 HRC
B7M ^A Chromium-molybdenum	n 4 and under	1150	100	80	18	50	235 HBW or 99 HRB
	over 4 to 7	1150	100	75	18	50	235 HBW or 99 HRB
B16 Chromium-molybdenum-vanadium	2½ and under	1200	125	105	18	50	321 HBW or
	over 2½ to 4	1200	110	95	17	45	35 HRC 321 HBW or 35 HRC
	over 4 to 8	1200	100	85	16	45	321 HBW or 35 HRC
Grade, Diameter, in.	Heat Treatment ^B	S	Tensile trength, nin, ksi	Yield Strength, min, 0.2 % offset, ksi		duction Area, nin %	Hardness, max
		Austenitic Stee					
Classes 1 and 1D; B8, B8M, B8P, of B8LN, B8MLN, B8CLN, all liameters	carbide solution treated		75	30	30	50	223 HBW or 96 HRB ^C
Classes 1 and 1D; B8, 08CLNCuB, all diameters	carbide solution treated		75	30	35	50	223 HBW or 96 HRB ^C
Classes 1 and 1D: B8ML4CuN, dill diameters	carbide solution treated		70	25	35	50	90 HRB
Class 1: B8C, B8T, all diameters	carbide solution treated		75	30	30	50	223 HBW or
	carbide solution treated in the finished condition		75	30	30	50	96HRB ^C 192 HBW or 90 HRB
Class 1A: B8ML4CuNA, all diameters	carbide solution treated		70	25	35	50	90 HRB
Classes 1B and 1D: B8N, B8MN, of B8MLCuN, all diameters	carbide solution treated		80	35	30	40	223 HBW or 96 HRB ^C
The state of the s	carbide solution treated		100	55	35	55	271 HBW or 28 HRC
Class 1C: B8RA, all diameters	carbide solution treated in the finished condition		100	55	35	55	271 HBW or 28 HRC
Classes 1C and 1D: B8S, all	carbide solution treated		95	50	35	55	271 HBW or 28 HRC
Classes 1C: B8SA, all diameters carbide solution treated in the finisher			95	50	35	55	271 HBW or 28
Class 2: B8, B8C, B8P, B8T,	condition carbide solution treated and strain		125	100	12	35	HRC 321 HBW or 3
B8N, D3/4 and under I by a 1, incl	nardened		115	80	15	35	HRC 321 HBW or 3! HRC

TABLE 2 Continued

	IADE	L Z Continued			
Grade, Diameter, in.	Heat Treatment ^B	Tensile Strength, min, ksi	Yield Strength, min, 0.2 % offset, ksi	Elongation Reduction in 4 D, of Area, min % min %	Hardness, max
	Au	stenitic Steels			
over 1 to 11/4, incl		105	65	20 35	321 HBW or 35 HRC
over 11/4 to 11/2, incl		100	50	28 45	321 HBW or 35 HRC
Class 2: B8M, B8MN, B8MLCuN ^D 3/4 and under	carbide solution treated and strain hardened	110	95	15 45	321 HBW or 35 HRC
over 3/4 to 1 incl		100	80	20 45	321 HBW or 35 HRC
Over 1 to 11/4, incl		95	65	25 45	321 HBW or 35 HRC
over 11/4 to 11/2, incl		90	50	30 45	321 HBW or 35 HRC
Class 2B: B8, B8M2 ^D 2 and under	carbide solution treated and strain hardened	95	75	25 40	321 HBW or 35 HRC
over 2 to 21/2 incl		90	65	30 40	321 HBW or 35 HRC
over 21/2 to 3 incl		80	55	30 40	321 HBW or 35 HRC
Class 2C: B8M3 ^D 2 and under	carbide solution treated and strain hardened	85	65	30 60	321 HBW or 35 HRC
over 2		85	60	30 60	321 HBW or 35 HRC

A To meet the tensile requirements, the Brinell hardness shall be over 200 HBW (93 HRB).

TABLE 3 Mechanical Requirements—Metric Products

	•					
Diameter, [mm]	Minimum Tempering Temperature,	Tensile Strength, min,	Yield Strength, min, 0.2 % offset,	Elongation in 4D, min, %		Hardness, max
			IVIFA			
	remilic Steets					
up to M100, incl	593	690	550	16	50	
up to M100, incl	593	760	585	15	50	
up to M100, incl	593	620	485	16	50	26 HRC
M64 and under	593	860	720	16	50	321 HBW or 35 HRC
over M64 to M100	593	795	655	16	50	321 HBW or 35 HRC
over M100 to M180	593	690	515	18	50	321 HBW or 35 HRC
M100 and under	620	690	550	18	50	235 HBW or 99 HRB
over M100 to M180	620	690	515	18	50	235 HBW or 99 HRB
M64 and under	650	860	725	18	50	321 HBW or 35 HRC
over M64 to M100	650	760	655	17	45	321 HBW or 35 HRC
over M100 to M200	650	690	585	16	45	321 HBW or 35 HRC
	up to M100, incl up to M100, incl up to M100, incl up to M100, incl M64 and under over M64 to M100 over M100 to M180 M100 and under over M100 to M180 M64 and under over M64 to M100	Diameter, [mm] Tempering Temperature, °C Ferritic Steels up to M100, incl 593 up to M100, incl 593 up to M100, incl 593 M64 and under 593 over M64 to M100 593 over M100 to M180 593 M100 and under 620 over M100 to M180 620 M64 and under 650 over M64 to M100 650	Diameter, [mm] Tempering Temperature, °C Strength, min, MPa Ferritic Steels up to M100, incl 593 690 up to M100, incl 593 760 up to M100, incl 593 620 M64 and under 593 860 over M64 to M100 593 795 over M100 to M180 593 690 M100 and under 620 690 over M100 to M180 620 690 M64 and under 650 860 over M64 to M100 650 760	Diameter, [mm] Tempering Temperature, °C Strength, min, MPa min, 0.2 % offset, MPa Ferritic Steels up to M100, incl 593 690 550 up to M100, incl 593 760 585 up to M100, incl 593 620 485 M64 and under 593 860 720 over M64 to M100 593 795 655 over M100 to M180 593 690 515 M100 and under 620 690 550 over M100 to M180 620 690 515 M64 and under 650 860 725 over M64 to M100 650 760 655	Diameter, [mm] Tempering Temperature, °C Strength, min, min, min, o.2 % offset, min,	Diameter, [mm] Tempering Temperature, °C Strength, min, offset, min, offset, min, % offset, min, min, % offset, min, % offset, min, min, % offset, min, min, % offset, min, mi

B Class 1 is solution treated. Class 1A is solution treated in the finished condition for corrosion resistance; heat treatment is critical due to physical property requirement. Class 2 is solution treated and strain hardened. Austenitic steels in the strain-hardened condition may not show uniform properties throughout the section particularly in sizes over % in. in diameter. C For sizes % in. in diameter and smaller, a maximum hardness of 241 HBW (100 HRB) is permitted.

^D For diameters 1½ and over, center (core) properties may be lower than indicated by test reports which are based on values determined at ½ radius.

Class Diameter, mm	Heat Treatment ^B	Tensile Strength, min, MPa	Yield Strength, min, 0.2 % offset, MPa	Elongation in 4 D, min %	Reduction of Area, min %	Hardness, max
	Austeniti	c Steels				
Classes 1 and 1D; B8, B8M, B8P, B8LN B8MLN, B8CLN, all diameters	, carbide solution treated	515	205	30	50	223 HBW or 96 HRB ^C
Classes 1,1A,1D, B8CLNCuB, all diameters 1	carbide solution treated	515	205	30	50	223 HBW or 96 HRB ^C
Classes 1 and 1D: B8ML4CuN, all	carbide solution treated	480	175	35	50	90 HRB
liameters Class 1: B8C, B8T, all diameters	carbide solution treated	515	205	30	50	223 HBW or 96HRB ^C
Class 1A: B8A, B8CA, B8CLNA, B8MA, B8PA, B8TA, B8LNA, B8MLNA, B8NA, BRA, BRA, BRA, BRA, BRA, BRA, BRA, BR	carbide solution treated in the finished condition	515	205	30	50	192 HBW or 90 HRB
38MNA, B8MLCuNA, all diameters Class 1A: B8ML4CuNA, all diameters	carbide solution treated	480	175	35	50	90 HRB
Classes 1B and 1D: B8N, B8MN, B8MLCuN, all diameters	carbide solution treated	550	240	30	40	223 HBW or 96 HRB ^C
Classes 1C and 1D: B8R, all diameters	carbide solution treated	690	380	35	55	271 HBW or 28 HRC
Class 1C: B8RA, all diameters	carbide solution treated in the finished condition	690	380	35	55	271 HBW or 28 HRC
classes 1C and 1D: B8S, all diameters	carbide solution treated	655	345	35	55	271 HBW or 28 HRC
classes 1C: B8SA, all diameters	carbide solution treated in the finished condition	655	345	35	55	271 HBW or 28
Class 2: B8, B8C, B8P, B8T, B8N, D M20 and under	carbide solution treated and strain hardened	860	690	12	35	321 HBW or 39 HRC
ver M20 to M24, incl		795	550	15	35	321 HBW or 3
ver M24 to M30, incl		725	450	20	35	321 HBW or 3
ver M30 to M36, incl		690	345	28	45	HRC 321 HBW or 3 HRC
Class 2: B8M, B8MN, B8MLCuN, ^D M20 and under	carbide solution treated and strain hardened	760	655	15	45	321 HBW or 35 HRC
ver M20 to M24, incl		690	550	20	45	321 HBW or 3
ver M24 to M30, incl		655	450	25	45	321 HBW or 3
ver M30 to M36, incl		620	345	30	45	321 HBW or 3! HRC
Class 2B: B8, B8M2, ^D M48 and under	carbide solution treated and strain hardened	655	515	25	40	321 HBW or 35 HRC
ver M48 to M64, incl		620	450	30	40	321 HBW or 35 HRC
over M64 to M72, incl		550	380	30	40	321 HBW or 3! HRC
Class 2C: B8M3, ^D //48 and under	carbide solution treated and strain hardened	585	450	30	60	321 HBW or 35 HRC
over M48		585	415	30	60	321 HBW or 35 HRC

A To meet the tensile requirements, the Brinell hardness shall be over 200 HBW (93 HRB).

B Class 1 is solution treated. Class 1A is solution treated in the finished condition for corrosion resistance; heat treatment is critical due to physical property requirement. Class 2 is solution treated and strain hardened. Austenitic steels in the strain-hardened condition may not show uniform properties throughout the section particularly in sizes over M20 mm in diameter.

C For sizes M20 mm in diameter and smaller, a maximum hardness of 241 HBW (100 HRB) is permitted.

For diameters M38 and over, center (core) properties may be lower than indicated by test reports which are based on values determined at ½ radius.

- 6.1.2 Use of water quenching is prohibited for any ferritic grade when heat treatment is performed after heading or threading.
- 6.1.3 Except as permitted below for B6X; bolting material that is subsequently cold drawn for dimensional control shall be stress-relieved after cold drawing. The minimum stress-relief temperature shall be within not more than 100 °F [55 °C] below the tempering temperature. Tests for mechanical properties shall be performed after stress relieving.
- 6.1.4 B6 and B6X shall be held at the tempering temperature for a minimum time of 1 h. B6X bolting material may be furnished in the as-rolled-and-tempered condition. Cold working after heat treatment is permitted for B6X material provided the final hardness meets the requirements of Tables 2 and 3.
- 6.1.5 B7 and B7M shall be heat treated by quenching in a liquid medium and tempering. For B7M bolting components, such as bolts, studs, or screws, the final heat treatment, which may be the tempering operation if conducted at 1150 °F [620 °C] minimum, shall be done after all machining and forming operations, including thread rolling and any type of cutting. Surface preparation for hardness testing, nondestructive evaluation, or ultrasonic bolt tensioning is permitted.
- 6.1.5.1 Unless otherwise specified, bolting material for Grade B7 may be heat treated by the Furnace, the Induction or the Electrical Resistance method.

Note 4—Stress-relaxation properties may vary from heat lot to heat lot or these properties may vary from one heat-treating method to another. The purchaser may specify Supplementary Requirement S8, when stress-relaxation testing is desired.

6.1.6 Bolting material Grade B16 shall be heated to a temperature range from 1700 to 1750 °F [925 to 955 °C] and oil quenched. The minimum tempering temperature shall be as specified in Tables 2 and 3.

6.2 Austenitic Stainless Steels:

- 6.2.1 All austenitic stainless steels shall receive a carbide solution treatment (see 6.2.2 6.2.5 for specific requirements for each class). Classes 1, 1B, 1C (Grades B8R and B8S only), 2, 2B, and 2C can apply to bar, wire, and finished bolting components. Class 1A (all grades) and Class 1C (grades B8RA and B8SA only) can apply to finished bolting components. Class 1D applies only to bar and wire and finished bolting components that are machined directly from Class 1D bar or wire without any subsequent hot or cold working.
- 6.2.2 Classes 1 and 1B, and Class 1C Grades B8R and B8S—After rolling of the bar, forging, or heading, whether done hot or cold, bolting material shall be heated from ambient temperature and held a sufficient time at a temperature at which the chromium carbide will go into solution and then shall be cooled at a rate sufficient to prevent the precipitation of the carbide.
- 6.2.3 Class 1D—Rolled or forged Grades B8, B8M, B8P, B8LN, B8MLN, B8CLNCuB, B8N, B8MN, B8R, and B8S bar shall be cooled rapidly immediately following hot working while the temperature is above 1750 °F [955 °C] so that grain boundary carbides remain in solution. Class 1D shall be restricted to applications at temperatures less than 850 °F [455 °C].

- 6.2.4 Class 1A and Class 1C Grades B8RA and B8SA—Finished bolting components shall be carbide solution treated after all rolling, forging, heading, and threading operations are complete. This designation does not apply to starting material such as bar. Components shall be heated from ambient temperature and held a sufficient time at a temperature at which the chromium carbide will go into solution and then shall be cooled at a rate sufficient to prevent the precipitation of the carbide.
- 6.2.5 Classes 2, 2B, and 2C—Bolting material shall be carbide solution treated by heating from ambient temperature and holding a sufficient time at a temperature at which the chromium carbide will go into solution and then cooling at a rate sufficient to prevent the precipitation of the carbide. Following this treatment the bolting material shall then be strain hardened to achieve the required properties.

Note 5—Heat treatment following operations performed on a limited portion of the product, such as heading, may result in non-uniform grain size and mechanical properties through the section affected.

6.2.6 If a scale-free bright finish is required; this shall be specified in the purchase order.

7. Chemical Composition

7.1 Each alloy shall conform to the chemical composition requirements prescribed in Table 1.

8. Heat Analysis

8.1 An analysis of each heat of steel shall be made by the manufacturer to determine the percentages of the elements specified in Section 7. The chemical composition thus determined shall be reported to the purchaser or the purchaser's representative, and shall conform to the requirements specified in Section 7. Should the purchaser deem it necessary to have the transition zone of two heats sequentially cast discarded, the purchaser shall invoke Supplementary Requirement S3 of Specification A788/A788M.

9. Mechanical Properties

- 9.1 Tensile Properties:
- 9.1.1 Requirements—Bolting material as represented by the tension specimens shall conform to the requirements prescribed in Tables 2 and 3 at room temperature after heat treatment. Stainless strain hardened bolting components (Class 2, 2B, and 2C) shall be tested full size after strain hardening to determine tensile strength and yield strength and shall conform to the requirements prescribed in Tables 2 and 3. In cases where tensile testing equipment of sufficient capacity is not available, stainless strain hardened bolting components greater than 1.500 in. diameter may be tested using machined specimen. Should the results of full size tests conflict with results of tension specimen tests, full size test results shall prevail.
- 9.1.2 Full Size Bolting Components, Wedge Tensile Testing—When applicable, see 12.1.3, headed components shall be wedge tested full size. The minimum full size load applied (lbf or kN) for individual sizes shall be as follows:

$$W = T_s \times A_t \tag{1}$$

where:

W = minimum wedge tensile load without fracture,

 T_s = tensile strength specified in ksi or MPa in Tables 2 and 3, and

A_t = stress area of the thread section, square inches or square millimetres, as shown in the Cone Proof Load Tables in Specification A962/A962M.

9.2 Hardness Requirements:

9.2.1 The hardness shall conform to the requirements prescribed in Tables 2 and 3. Hardness testing shall be performed in accordance with either Specification A962/A962M or with Test Methods F606/F606M.

9.2.2 Grade B7M—The maximum hardness of the grade shall be 235 HBW or 99 HRB. The minimum hardness shall not be less than 200 HBW or 93 HRB. Conformance to this hardness shall be ensured by testing the hardness of each stud or bolt by Brinell or Rockwell B methods in accordance with 9.2.1. The use of 100 % electromagnetic testing for hardness as an alternative to 100 % indentation hardness testing is permissible when qualified by sampling using indentation hardness testing. Each lot tested for hardness electromagnetically shall be 100 % examined in accordance with Practice E566. Following electromagnetic testing for hardness, a random sample of a minimum of 100 pieces of each heat of steel in each lot (as defined in 12.1.1) shall be tested by indentation hardness methods. All samples must meet hardness requirements to permit acceptance of the lot. If any one sample is outside of the specified maximum or minimum hardness, the lot shall be rejected and either reprocessed and resampled or tested 100 % by indentation hardness methods.

9.2.2.1 Surface preparation for indentation hardness testing shall be in accordance with Test Methods E18. Hardness tests shall be performed on the end of the bolt or stud. When this is impractical, the hardness test shall be performed elsewhere.

10. Workmanship, Finish, and Appearance

10.1 Bolts, screws, studs, and stud bolts shall be pointed and shall have a workmanlike finish. Points shall be flat and chamfered or rounded at option of the manufacturer. Length of point on studs and stud bolts shall be not less than one nor more than two complete threads as measured from the extreme end parallel to the axis. Length of studs and stud bolts shall be measured from first thread to first thread.

10.2 Unless otherwise specified in the purchase order, bolt heads shall be in accordance with the dimensions of ASME B18.2.1 or ASME B18.2.3.3M. Unless otherwise specified in the purchase order, the Heavy Hex Screws Series should be used for nominal body diameters of 1½ in. [30 mm] and less. For larger sizes, the Heavy Hex Screw Series should be used, except the maximum body diameter and radius of fillet may be the same as for the Heavy Hex Bolt Series. The body diameter and head fillet radius for sizes of Heavy Hex Cap Screws and Bolts that are not shown in their respective tables in ASME B18.2.1 or ASME B18.2.3.3M may be that shown in the corresponding Hex Cap Screw and Bolt Tables respectively. Socket head screws or bolts shall be in accordance with ASME B18.3 or ASME B18.3.1M.

11. Retests

11.1 If the results of the mechanical tests of any test lot do not conform to the requirements specified, the manufacturer may retreat such lot not more than twice, in which case two additional tension tests shall be made from such lot, all of which shall conform to the requirements specified.

12. Test Specimens

12.1 Number of Tests—For heat-treated bars, one tension test shall be made for each diameter of each heat represented in each tempering charge. When heat treated without interruption in continuous furnaces, the material in a lot shall be the same heat, same prior condition, same size, and subjected to the same heat treatment. Not fewer than two tension tests are required for each lot containing 20 000 lb [9000 kg] or less. Every additional 10 000 lb [4500 kg] or fraction thereof requires one additional test.

12.1.1 For studs, bolts, screws, and so forth, one tension test shall be made for each diameter of each heat involved in the lot. Each lot shall consist of the following:

Diameter, in. [mm]	Lot Size
11/8 [30] and under	1500 lb [680 kg] or fraction thereof
Over 11/8 [30] to 13/4 [42], incl	4500 lb [2000 kg] or fraction thereof
Over 1¾ [42] to 2½ [64], incl	6000 lb [2700 kg] or fraction thereof
Over 2½ [64]	100 pieces or fraction thereof

12.1.2 Tension tests are not required to be made on bolts, screws, studs, or stud bolts that are fabricated from heat-treated bars furnished in accordance with the requirements of this specification and tested in accordance with 12.1, provided they are not given a subsequent heat treatment.

12.1.3 Full Size Specimens, Headed Bolting Components—Headed bolts or screws 1½ in. in body diameter and smaller, with body length three times the diameter or longer, and that are produced by upsetting or forging (hot or cold) shall be subjected to full size testing in accordance with 9.1.2. This testing shall be in addition to tensile testing as specified in 9.1.1. Wedge tensile testing shall be limited to product with socket head cap screw, hexagon, square, hex flange, or twelve point flange heads. The lot size shall be as shown in 12.1.1. Failure shall occur in the body or threaded section with no failure, or indications of failure, such as cracks, at the junction of the head and shank. Wedge tensile testing is not required for flat countersunk head or socket button products.

13. Nuts

13.1 Bolts, studs, and stud bolts shall be furnished with nuts, when specified in the purchase order. Nuts shall conform to Specification A194/A194M.

14. Certification

14.1 Certification is required. In addition to the requirements of Specification A962/A962M the report shall include results of the chemical analysis, macroetch examination (Carbon and Alloy Steels Only), and mechanical tests, and state the method of heat treatment employed.

TABLE 4 Marking of Ferritic Steels

Grade	Grade Symbol
B5	B5
B6	B6
B6X	B6X
B7	B7
B7M	B7M or <u>B7M</u>
B16	B16
B16 +	B16R
Supplement S12	

15. Product Marking

15.1 See Specification A962/A962M. The grade symbol shall be as shown in Table 4 and Table 5. Grade B7M no longer requires a line under the grade symbol. However, a line is permitted.

16. Keywords

16.1 alloy steel bars; alloy steel bolting; bolting components; bolting materials; hardness; heat treatment; stainless steel bolting

TABLE 5 Marking of Austenitic Steels

Class	Grade	Grade Symbol
Class 1	B8	B8
Class .	B8C	B8C
	B8M	B8M
	B8P	B8P
	B8T	B8T
	B8LN	B8F or B8LN
	B8MLN	B8G or B8MLN
	B8CLN	B8Y or B8CLN
	B8CLNCuB	B8CLNCuB
	B8ML4CuN	B8YY or B8ML4CuN
Class 1A	B8A	B8A
	B8CA	B8B or B8CA
	B8MA	B8D or B8MA
	B8PA	B8H or B8PA
	B8TA	B8J or B8TA
	B8LNA	B8L or B8LNA
	B8MLNA	B8K or B8MLNA
	B8NA	B8V or B8MA
	B8MNA	B8W or B8MNA
	B8MLCuNA	B9K or B8MLCuNA
	B8CLNA	B8Z or B8CLNA
	B8CLNCuBA	B8ZA or B8CLNCuBA
	B8ML4CuNA	B8ZZ or B8MLCuNA
Class 1B	B8N	B8N
	B8MN	B8Y or B8MN
	B8MLCuN	B9J or B8MLCuN
Class 1C	B8R	B9A or B8R
	B8RA	B9B or B8RA
	B8S	B9D or B8S
	B8SA	B9F or B8SA
Class 1D	B8	B94
	B8M	B95
	B8P	B96
	B8LN	B97
	B8MLN	B98
	B8N	B99
	B8MN	B100
	B8R	B101
	B8S	B102
	B8CLN	B103
	B8ML4CuN	B104
	B8CLNCuB	B105
Class 2	B8	B8SH
	B8C	B8CSH
	B8P	B8PSH
	B8T	B8TSH
	B8N	B8NSH
	B8M	B8MSH
	B8MN	B8YSH
	B8MLCuN	B8JSH
Class 2B	B8M2	B9G or B8M2
	B8	<u>B9</u>
Class 2C	B8M3	B9H or B8M3

SUPPLEMENTARY REQUIREMENTS

These requirements shall not apply unless specified in the order and in the Ordering Information, in which event the specified tests shall be made before shipment of the product.

S1. High Temperature Tests

S1.1 Tests to determine high temperature properties shall be made in accordance with Test Methods E21, E139, and E292, and Practices E150 and E151.

S2. Charpy Impact Tests

S2.1 Charpy impact tests based on the requirements of Specification A320/A320M, Sections 6 and 7, shall be made as agreed between the manufacturer and the purchaser. When testing temperatures are as low as those specified in Specification A320/A320M, bolting should be ordered to that specification in preference to this specification.

S3. 100 % Hardness Testing of Grade B7M

S3.1 Each Grade B7M bolt or stud shall be tested for hardness by indentation method and shall meet the requirements specified in Tables 2 and 3.

S4. Hardness Testing of Grade B16

S4.1 For bolts or studs $2\frac{1}{2}$ in. [65 mm] or smaller, the hardness for Grade B16 shall be measured on or near the end of each bolt or stud using one of the methods prescribed in 9.2.1 for the Brinell or Rockwell C test. The hardness shall be in the range 253–319 HBW or 25–34 HRC.

S5. Product Marking

S5.1 Grade and manufacturer's identification symbols shall be applied to one end of studs and to the heads of bolts and screws of all sizes. (If the available area is inadequate, the grade symbol may be marked on one end and the manufacturer's identification symbol marked on the other end.) For bolts and screws smaller than ½ in. [6 mm] in diameter and studs smaller than ¾ in. [10 mm] in diameter and for ¼ in. [6 mm] in diameter studs requiring more than a total of three symbols, the marking shall be a matter of agreement between the purchaser and the manufacturer.

S6. Stress Relieving

S6.1 A stress-relieving operation shall follow straightening after heat treatment.

S6.2 The minimum stress-relieving temperature shall be 100 °F [55 °C] below the tempering temperature. Tests for mechanical properties shall be performed after stress relieving.

S7. Magnetic Particle Inspection

S7.1 Bars shall be magnetic particle examined in accordance with Guide E709. Bars with indications of cracks or seams are subject to rejection if the indications extend more than 3 % of the diameter into the bar.

S8. Stress-Relaxation Testing

S8.1 Stress-Relaxation Testing, when required, shall be done in accordance with Test Methods E328. The test shall be performed at 850 °F [454 °C] for a period of 100 h. The initial stress shall be 50 M psi [345 MPa]. The residual stress at 100 h shall be 17 M psi [117 MPa] minimum.

S9. Grain Size Requirements for Non H Grade Austenitic Steels Used Above 1000 $^{\circ}\mathrm{F}$

S9.1 For design metal temperatures above 1000 °F [540 °C], the material shall have a grain size of No. 7 or coarser as determined in accordance with Test Methods E112. The grain size so determined shall be reported on the Certificate of Test.

S10. Hardness Testing of Class 2 Bolting for ASME Applications

S10.1 The maximum hardness shall be Rockwell C35 immediately under the thread roots. The hardness shall be taken on a flat area at least $\frac{1}{8}$ in. [3 mm] across, prepared by removing threads, and no more material than necessary shall be removed to prepare the flat areas. Hardness determinations shall be made at the same frequency as tensile tests.

S11. Thread Forming

S11.1 Threads shall be formed after heat treatment. Application of this supplemental requirement to grade B7M or the grades listed in 6.2.4 is prohibited.

S12. Stress Rupture Testing of Grade B16

S12.1 One test shall be made for each heat treat lot. Testing shall be conducted using a combination test bar in accordance with Test Methods E292. Rupture shall occur in the smooth section of each test specimen. The test shall be conducted at 1100 °F [595 °C] and 20 ksi [140 MPa]. The test shall be continued until the sample ruptures. Rupture life shall be 25 h minimum. Testing is not required on material less than ½ in. [12 mm] thick.

S12.2 When a purchase order for bolting components invokes S12, the grade symbol applied shall be "B16R."

S13. Coatings on Bolting Components

S13.1 It is the purchaser's responsibility to specify in the purchase order all information required by the coating facility. Examples of such information may include but are not limited to the following:

S13.1.1 Reference to the appropriate coating specification and type, thickness, location, modification to dimensions, and hydrogen embrittlement relief.

S13.1.2 Reference to Specifications A153/A153M, B633, B695, B696, B766, or F1941/F1941M, F2329/F2329M, or Test Method F1940, or other standards.

S14. Marking Coated Bolting Components

S14.1 Bolting components coated with zinc shall have ZN marked after the grade symbol. Bolting components coated with cadmium shall have CD marked after the grade symbol. Note S14.1—As an example, the marking for zinc-coated B7 will now

NOTE S14.1—As an example, the marking for zinc-coated B7 will now be B7ZN rather than B7*.

S15. Requirements for Service Temperature Exceeding $1000^{\circ}F$

S15.1 For bolting of Class 1 Grades B8, B8C, B8M, and B8T, to be used in service at temperatures exceeding 1000°F, the following shall apply:

S15.1.1 The minimum carbon content shall be 0.04 %.

S15.1.2 Carbide solution treatment shall be between 1900°F and 1950°F followed by quenching in water or rapid cooling by other means.

APPENDIXES

(Nonmandatory Information)

X1. STRAIN HARDENING OF AUSTENITIC STEELS

X1.1 Strain hardening is the increase in strength and hardness that results from plastic deformation below the recrystal-lization temperature (cold work). This effect is produced in austenitic stainless steels by reducing oversized bars or wire to the desired final size by cold drawing or other process. The degree of strain hardening achievable in any alloy is limited by its strain hardening characteristics. In addition, the amount of strain hardening that can be produced is further limited by the variables of the process, such as the total amount of cross-section reduction, die angle, and bar size. In large diameter bars, for example, plastic deformation will occur principally in the outer regions of the bar so that the increased strength and hardness due to strain hardening is achieved predominantly near the surface of the bar. That is, the smaller the bar, the

greater the penetration of strain hardening.

- X1.2 Thus, the mechanical properties of a given strain hardened bolting component are dependent not just on the alloy, but also on the size of bar from which it is machined. The minimum bar size that can be used, however, is established by the configuration of the component so that the configuration can affect the strength of the component.
- X1.3 For example, a stud of a particular alloy and size may be machined from a smaller diameter bar than a bolt of the same alloy and size because a larger diameter bar is required to accommodate the head of the bolt. The stud, therefore, is likely to be stronger than the same size bolt in a given alloy.

X2. COATINGS AND APPLICATION LIMITS

X2.1 Use of coated bolting components at temperatures above approximately one-half the melting point (Fahrenheit or Celsius) of the coating is not recommended unless consideration is given to the potential for liquid and solid metal embrittlement, or both. The melting point of elemental zinc is approximately 780 °F [415 °C]. Therefore, application of

zinc-coated bolting components should be limited to temperatures less than 390 °F [210 °C]. The melting point of cadmium is approximately 600 °F [320 °C]. Therefore, application of cadmium-coated bolting components should be limited to temperatures less than 300 °F [160 °C].

SPECIFICATION FOR CARBON AND ALLOY STEEL NUTS FOR BOLTS FOR HIGH PRESSURE OR HIGH TEMPERATURE SERVICE, OR BOTH



SA-194/SA-194M



(23)

(Identical with ASTM Specification A194/A194M-22.)

Specification for Carbon Steel, Alloy Steel, and Stainless Steel Nuts for Bolts for High Pressure or High Temperature Service, or Both

1. Scope

- 1.1 This specification covers a variety of carbon, alloy, and martensitic stainless steel nuts in the size range ½ through 4 in. and metric M12 through M100 nominal. It also covers austenitic stainless steel nuts in the size range ¼ in. and M12 nominal and above. These nuts are intended for high-pressure or high-temperature service, or both. Grade substitutions without the purchaser's permission are not allowed.
- 1.2 Bars from which the nuts are made shall be hot-wrought. The material may be further processed by centerless grinding or by cold drawing. Austenitic stainless steel may be solution annealed or annealed and strain-hardened. When annealed and strain hardened austenitic stainless steel is ordered in accordance with Supplementary Requirement S1, the purchaser should take special care to ensure that 8.2.2, Supplementary Requirement S1, and Appendix X1 are thoroughly understood.
- 1.3 Supplementary requirements of an optional nature are provided. These shall apply only when specified in the inquiry, contract, and order.
- 1.4 This specification is expressed in both inch-pound units and in SI units. However, unless the order specifies the applicable "M" specification designation (SI units), the material shall be furnished to inch-pound units.
- 1.5 The values stated in either inch-pound units or SI units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. Within the text, the SI units are shown in brackets.

1.6 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A153/A153M Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
- A276/A276M Specification for Stainless Steel Bars and Shapes
- A320/A320M Specification for Alloy-Steel and Stainless Steel Bolting for Low-Temperature Service
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A962/A962M Specification for Common Requirements for Bolting Intended for Use at Any Temperature from Cryogenic to the Creep Range
- B633 Specification for Electrodeposited Coatings of Zinc on Iron and Steel
- B695 Specification for Coatings of Zinc Mechanically Deposited on Iron and Steel
- B696 Specification for Coatings of Cadmium Mechanically Deposited
- B766 Specification for Electrodeposited Coatings of Cadmium
- E112 Test Methods for Determining Average Grain Size
- E566 Practice for Electromagnetic (Eddy Current/Magnetic Induction) Sorting of Ferrous Metals
- F606/F606M Test Methods for Determining the Mechanical Properties of Externally and Internally Threaded Fasteners, Washers, Direct Tension Indicators, and Rivets

- F1940 Test Method for Process Control Verification to Prevent Hydrogen Embrittlement in Plated or Coated Easteners
- F1941/F1941M Specification for Electrodeposited Coatings on Mechanical Fasteners, Inch and Metric
- F2329/F2329M Specification for Zinc Coating, Hot-Dip, Requirements for Application to Carbon and Alloy Steel Bolts, Screws, Washers, Nuts, and Special Threaded Fasteners
- 2.2 ASME Standards:
- B 1.1 Unified Screw Threads
- B 1.2 Gages and Gaging for Unified Inch Screw Threads
- B 1.13M Metric Screw Threads
- B 18.2.2 Square and Hex Nuts
- B 18.2.4.6M Metric Heavy Hex Nuts

3. Terminology

- 3.1 Definitions of Terms Specific to This Standard:
- 3.1.1 Austenitic Grades—All grades with a prefix of "8" or "9."
- 3.1.2 Ferritic Grades—Grades 1, 2, 2H, 2HM, 3, 6, 6F, 7, 7M, 43, and 16.
- 3.1.3 *Lot*—Unless otherwise specified (see Discussion below), a lot is the quantity of nuts of a single nominal size and grade produced by the same manufacturing process.
- 3.1.3.1 *Discussion*—When Supplementary Requirement S5 is invoked on the purchase order, the following definitions of a lot shall apply:
- 3.1.3.2 For Grade 8 Nuts—The quantity of all the nuts of a single nominal diameter and grade made from the same heat of steel and made by the same manufacturing process.
- 3.1.3.3 For All Other Grade Nuts—(see 8.2 and 8.1.2.1)—All the nuts of a single nominal diameter and grade made from the same heat number and heat treated in the same batch if batch-type heat treating equipment is used or heat treated in the same continuous run of not more than 8 h under the same conditions if continuous-type heat treating equipment is used.
 - 3.1.4 *Type:*
- 3.1.4.1 For Grade 8 Nuts—Variations within the grade designated by a letter and differentiated by chemistry and by manufacturing process.
- 3.1.4.2 For Grade 6 Nuts—Variations within the grade designated by the letter F as differentiated by chemical additions made for machineability.
- 3.1.5 *Series*—The dimensional relationship and geometry of the nuts as described in ASME B 18.2.2 for inch nuts or ASME B 18.2.4.6M for metric nuts.

4. Ordering Information

4.1 The inquiry and order for bolting material and bolting components under this specification shall include the following as required to describe the items adequately:

- 4.1.1 Specification designation, year date, and grade, issue date and revision letter,
 - 4.1.2 Quantity, number of pieces,
 - 4.1.3 Dimensions (see Section 9),
- 4.1.4 Options in accordance with 8.2.2.1, 9.1, 9.2, 10.3, and 12, and
 - 4.1.5 Supplementary Requirements, if any.
- 4.2 Coatings—Coatings are prohibited unless specified by the purchaser (see Supplementary Requirements S7 and S8). When coated nuts are ordered, the purchaser should take special care to ensure that Appendix X2 is thoroughly understood.
- 4.3 See Supplementary Requirement S3 for nuts to be used in low temperature applications (Specification A320/A320M).
- 4.4 *Proof Load Testing*—See Supplementary Requirement S9 for proof load testing of nuts manufactured to dimensions and configurations other than those covered in Tables 3 and 4.

5. Common Requirements

5.1 Bolting material and bolting components supplied to this specification shall conform to the requirements of Specification A962/A962M, of which nuts are considered bolting components, as are bolts, studs, screws, and washers intended for use in special service applications. These requirements include test methods, finish, thread dimensions, marking, certification, optional supplementary requirements, and others. Failure to comply with the requirements of Specification A962/A962M constitutes nonconformance with this specification. In case of conflict between the requirements of this specification and Specification A962/A962M, this specification shall prevail.

6. Manufacture (Process)

- 6.1 Stainless steels for all types of Grade 6 and 8 nuts shall be made by one of the following processes:
- 6.1.1 Electric-furnace (with separate degassing and refining optional),
 - 6.1.2 Vacuum induction furnace, or
- 6.1.3 Either of the above followed by electroslag remelting, or consumable-arc remelting.
- 6.2 The steel producer shall exercise adequate control to eliminate excessive unhomogeneity, nonmetallics, pipe, porosity, and other defects.
- 6.3 Grades 1 and 2 nuts shall be hot or cold forged, or shall be machined from hot-forged, hot-rolled, or cold-drawn bars.
- 6.3.1 All Grade 1 and 2 nuts shall be stress-relieved at a temperature of at least 1000 °F [538 °C] after forming or machining from bar with the following exceptions:
 - 6.3.1.1 Nuts made by hot forging.
 - 6.3.1.2 Nuts machined from hot-forged or hot-rolled bar.
- 6.3.1.3 Nuts machined from hot-forged/hot-rolled and cold-finished (max 10 % reduction in area) bar.
- 6.3.1.4 Nuts machined from cold-drawn and annealed (min 1000 °F [538 °C]) bar.
- 6.3.2 Grade 1 and 2 nuts made by hot forging or by machining from hot-forged or hot-rolled bars need not be stress relieved.

TABLE 1 Chemical Requirements (Composition, percent)^{A,B,C,D,I}

	TABLE 1 Offennear frequirements (Composition, percent)															
Grade	Description and UNS Designation	Carbon	Manga- nese	Phospho- rus	Sulfur ^E	Silicon	Chromium	Nickel	Molyb- denum	Tita- nium	Niobium ^H	Nitrogen	Copper	Selenium	Vanadium	Aluminum
1 2, 2HM, and 2H	carbon carbon	0.15 min 0.40 min	1.00 1.00	0.040 0.040	0.050 0.050	0.40 0.40										
3	(501)	0.10 min	1.00	0.040	0.030	1.00	4.0-6.0		0.40-0.65							
6	S50100 (410) S41000	0.08–0.15	1.00	0.040	0.030	1.00	11.5–13.5									
6F	(416) S41600	0.15	1.25	0.060	0.15 min	1.00	12.0–14.0									
6F	(416Se) S41623	0.15	1.25	0.060	0.060	1.00	12.0–14.0							0.15 min		
7^G , $7M^G$	Chromium- Molybdenum ^G	0.38-0.48	0.75–1.0	0.035	0.04	0.15–0.35	0.80–1.10		0.15–0.25							
43	Nickel- Chromium	0.38-0.43	0.60-0.85	0.035	0.04	0.15–0.35	0.70-0.90	1.65–2.0	0.20-0.30							
8, 8A	Molybdenum (304) S30400	0.08	2.00	0.045	0.030	1.00	18.0–20.0	8.0–11.0								
8C, 8CA	(347) S34700	0.08	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0			10 x carbon					
8CLN, 8CLNA	(347LN) S34751	0.005- 0.020	2.00	0.045	0.030	1.00	17.0–19.0	9.0–13.0			content, min 1.10 0.20–0.50, 15 x carbon content,	0.06–0.10				
8CLNCuB, 8CLNCuBA	S34752 ^J	0.005- 0.020	2.00	0.035	0.010	0.60	17.0–19.0	10.0–13.0	0.20–1.20		min 0.20–0.50, 15 x carbon content,	0.06-0.12	2.50–3.50			
8M, 8MA	(316)	0.08	2.00	0.045	0.030	1.00	16.0–18.0	10.0–14.0	2.00-3.00		min 					
8T, 8TA	S31600 (321) S32100	0.08	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0		5 x (C+N) min - 0.70		0.10				
8F, 8FA	(303)	0.15	2.00	0.20	0.15 min	1.00	17.0–19.0	8.0–10.0		max						
8F, 8FA	S30300 (303Se) S30323	0.15	2.00	0.20	0.06	1.00	17.0–19.0	8.0–10.0						0.15 min		
8P, 8PA	(305) S30500	0.12	2.00	0.045	0.030	1.00	17.0–19.0	11.0–13.0								
8N, 8NA	(304N) S30451	0.08	2.00	0.045	0.030	1.00	18.0–20.0	8.0–11.0				0.10-0.16				
8LN, 8LNA	(304LN) S30453	0.030	2.00	0.045	0.030	1.00	18.0–20.0	8.0–11.0				0.10-0.16				
8MN, 8MNA	(316N) S31651	0.08	2.00	0.045	0.030	1.00	16.0–18.0	10.0–13.0	2.00–3.00			0.10-0.16				

TABLE 1	Continued
---------	-----------

														1		
Grade	Description and UNS Designation	Carbon	Manga- nese	Phospho- rus	Sulfur ^E	Silicon	Chromium	Nickel	Molyb- denum	Tita- nium	Niobium ^H	Nitrogen	Copper	Selenium	Vanadium	Aluminum
8MLN, 8MLNA	(316LN) S31653	0.030	2.00	0.045	0.030	1.00	16.0–18.0	10.0–13.0	2.00-3.00			0.10-0.16				
8R, 8RA ^F	(XM19) S20910	0.06	4.0-6.0	0.045	0.030	1.00	20.5–23.5	11.5–13.5	1.50–3.00		0.10-0.30	0.20-0.40			0.10-0.30	
8S, 8SA	(Nitronic 60) S21800	0.10	7.0–9.0	0.060	0.030	3.5–4.5	16.0–18.0	8.0–9.0				0.08–0.18				
8MLCuN, 8MLCuNA	(254) S31254	0.020	1.00	0.030	0.010	0.80	19.5–20.5	17.5–18.5	6.0–6.5			0.18-0.22	0.50-1.00			
B8ML4CuN	(317) S31730	0.030	2.00	0.040	0.010	1.00	17.0–19.0	15.0–16.5	3.0-4.0			0.045	4.0-5.0			
9C, 9CA	(AL-6XN) N08367	0.030	2.00	0.040	0.030	1.00	20.0-22.0	23.5- 25.5	6.0-7.0			0.18-0.25	0.75			
16	Chromium Molyb- denum Vanadium	0.36–0.47	0.45–0.70	0.035	0.040	0.15–0.35	0.80–1.15		0.50-0.65						0.25-0.35	0.15 ^B

A The intentional addition of Bi, Se, Te, and Pb is not permitted except for Grades 6F, 8F, and 8FA, in which Se is specified and required.

^B Total aluminum, soluble and insoluble.

^C Maximum, unless minimum or range is indicated.

^D Where ellipses (...) appear in this table there is no requirement and the element need not be determined or reported.

E Because of the degree to which sulfur segregates, product analysis for sulfur over 0.060 % max is not technologically appropriate.

^F As described in Specification A276/A276M.

^G Typical steel compositions used for this grade include 4140, 4142, 4145, 4140H, 4142H, and 4145H.

^H Niobium (Nb) and Columbium (Cb) are alternate names for element 41 in the Periodic Table of the Elements.

Product Analysis—Individual determinations sometimes vary from the specified limits as shown in the tables. The several determinations of any individual element in a heat may not vary both above and below the specified range. Product variation limits are over for maximums, over or under for ranges, and under for minimums, unless otherwise indicated.

^J Boron content shall be in the range 0.001–0.005.

TABLE 2 Hardness Requirements^A

		Completed Nu	Sample Nut after Treatment as in 8.1.5			
Grade and Type	Brinell	Rockwe	Brinell	Rockwell		
	Hardness —	C Scale	B Scale	— Hardness, min	Hardness B Scale, min	
1	121 min		70 min	121	70	
2	159 to 352	•••	84 min	159	84	
2H to 11/2 in. or M36, incl	248 to 327	24 to 35		179	89	
2H over 11/2 in. or M36	212 to 327	35 max	95 min	147	79	
2HM and 7M	159 to 235		84 to 99	159	84	
3, 7, 16, 43	248 to 327	24 to 35		201	94	
6 and 6F	228 to 271	20 to 28				
8, 8C, 8CLN, 8CLNCuB, 8M, 8T, 8F, 8P, 8N, 8MN, 8LN, 8MLN, 8MLCuN, 8ML4CuN, and 9C	126 to 300	32 max	60 min			
8A, 8CA, 8CLNA, 8CLNCUBA, 8MA, 8TA, 8FA, 8PA, 8NA, 8MNA, 8LNA, 8MLNA, 8MLCUNA, 8ML4CUNA, and 9CA	126 to 192		60 to 90			
8R, 8RA, 8S, and 8SA	183 to 271	25 max	88 min			

A Where ellipses (...) appear in this table there is no requirement.

6.4 Grades 2H, 2HM, 3, 6, 6F, 7, 7M, 43, and 16 nuts shall be hot- or cold-forged or shall be machined from hot-forged, hot-rolled, or cold-drawn bars and shall be heat treated to meet the required mechanical properties. These grades shall be uniformly reheated to the proper austenitizing temperature (a group thus reheated being known as a quenching charge) and quenched under substantially uniform conditions for each quenching charge and tempered as shown below. Grades 2H, 2HM, 3, 7, and 7M shall be liquid quenched. Grades 6 and 6F shall be quenched in liquid or inert gas. Grade 16 shall be heated to a temperature range from 1700 to 1750 °F (925 to 955 °C) and oil quenched.

	Minimum Tempering Temperature, °F
Grade	[°C]
2H	850 [455]
2HM	1150 [620]
3	1050 [565]
6 and 6F	1100 [595]
7	1100 [595]
7M	1150 [620]
43	1100 [595]
16	1200 [650]

Nuts machined from bar heat treated in accordance with this specification need not be reheat-treated. For Grade 2HM and 7M nuts, a final stress relief shall be done at or above the minimum tempering temperature after all forming, machining, and tapping operations. This final stress relief may be the tempering operation.

- 6.4.1 Grade 6 and 6F nuts shall be tempered for a minimum of 1 h at the temperature.
- 6.5 Grades 8, 8C, 8CLN, 8CLNCuB, 8M, 8T, 8F, 8P, 8N, 8MN, 8R, 8S, 8LN, 8MLN, 8MLCuN, 8ML4CuN, and 9C nuts shall be hot or cold forged, or shall be machined from hot-forged, hot-rolled or cold-drawn bars.
- 6.6 Grades 8A, 8CA, 8CLNA, 8CLNCuBA, 8MA, 8TA, 8FA, 8PA, 8NA, 8MNA, 8RA, 8SA, 8LNA, 8MLNA, 8MLCuNA, 8ML4CuNA, and 9CA nuts shall be hot- or

cold-forged or shall be machined from hot-forged, hot-rolled, or cold-drawn bars and the nuts shall subsequently be carbide-solution treated by heating them for a sufficient time at a temperature to dissolve chromium carbides followed by cooling at a rate sufficient to prevent reprecipitation of the carbides.

7. Chemical Composition

7.1 Each alloy shall conform to the chemical composition requirements prescribed in Table 1.

8. Mechanical Requirements

- 8.1 Hardness Test:
- 8.1.1 Requirements:
- 8.1.1.1 All nuts shall meet the hardness requirements specified in Table 2.
- 8.1.1.2 Sample nuts of Grades 1, 2, 2H, 2HM, 3, 7, 7M, 43, and 16 which have been given the treatment described in 8.1.5 shall meet the minimum hardness specified in Table 2.
- 8.1.2 *Number of Tests*—(Grades 1, 2, 2H, 3, 7, 43, and 16 and all types of Grade 6):
- 8.1.2.1 Tests on the number of sample nuts in accordance with the following table shall be performed by the manufacturer following all production heat treatments:

Lot Size	Samples
Up to 800	1
801 to 8000	2
8001 to 22 000	3
Over 22 000	5

- 8.1.2.2 In addition, a hardness test shall be performed by the manufacturer in accordance with 8.1.5 on one sample nut selected from each nominal diameter and series from each grade and heat number following completion of all production heat treatments.
 - 8.1.3 Number of Tests, Grades 2HM and 7M:
- 8.1.3.1 Each nut shall be tested in accordance with either Specification A962/A962M or with Test Methods F606/F606M

TABLE 3 Proof Load Using Threaded Mandrel — Inch Series

Note 1-Proof loads are not design loads.

Naminal	Thusada	Ot A	Proof Load, lbf ^A							
Nominal	Threads	Stress Area in. ²	G	rade 1	Grades 2,	2HM, 6, 6F, 7M	Grades 2H, 3, 7, 16, 43			
Size, in.	per Inch	ın	Heavy Hex ^B	Hex ^C	Heavy Hex ^D	Hex ^E	Heavy Hex ^F	Hex ^G		
/4	20	0.0316	4 130	3 820	4 770	4 300	5 570	4 770		
16	18	0.0524	6 810	6 290	7 860	7 070	9 170	7 860		
/8	16	0.0774	10 080	9 300	11 620	10 460	13 560	11 620		
/16	14	0.1063	13 820	12 760	15 940	14 350	18 600	15 940		
/2	13	0.1419	18 450	17 030	21 280	19 160	24 830	21 280		
, 16	12	0.182	23 660	21 840	27 300	24 570	31 850	27 300		
8	11	0.226	29 380	27 120	33 900	30 510	39 550	33 900		
4	10	0.334	43 420	40 080	50 100	45 090	58 450	50 100		
8	9	0.462	60 060	55 440	69 300	62 370	80 850	69 300		
	8	0.606	78 780	72 720	90 900	81 810	106 000	90 900		
1/8	8	0.790	102 700	94 800	118 500	106 700	138 200	118 500		
1/4	8	1.000	130 000	120 000	150 000	135 000	175 000	150 000		
3/8	8	1.233	160 200	148 000	185 000	166 500	215 800	185 000		
1/2	8	1.492	194 000	170 040	223 800	201 400	261 100	223 800		

			Heavy Hex ^H	Hex'	
1/4	20	0.0316	2 540	2 380	
5/16	18	0.0524	4 190	3 930	
3/8	16	0.0774	6 200	5 810	
7/16	14	0.1063	8 500	7 970	
1/2	13	0.1419	11 350	10 640	
9/16	12	0.182	14 560	13 650	
5/8	11	0.226	18 080	16 950	
3/4	10	0.334	26 720	25 050	
7/8	9	0.462	36 960	34 650	
1	8	0.606	48 480	45 450	
11/8	8	0.790	63 200	59 250	
11/4	8	1.000	80 000	75 000	
1%	8	1.233	98 640	92 450	
1½	8	1.492	119 360	111 900	

 $^{^{}A}$ See limit for proof load test in 8.2.2.1. The proof load for jam nuts shall be 46 % of the tabulated load. B Based on proof stress of 130 000 psi.

to ensure product conformance. The use of 100 % electromagnetic testing for hardness as an alternative to 100 % indentation hardness testing is permissible when qualified by sampling using indentation hardness testing. Each lot tested for hardness electromagnetically shall be 100 % examined in accordance with Practice E566. Following electromagnetic testing for hardness, a random sample of a minimum of 100 pieces in each purchase lot (as defined in 3.1.3) shall be tested by indentation hardness methods. All samples must meet hardness requirements to permit acceptance of the lot. If any one sample is outside of the specified maximum or minimum hardness, the

lot shall be rejected and either reprocessed and resampled, or tested 100 % by indentation hardness methods.

8.1.3.2 In addition, 8.1.2.2 shall be met.

8.1.4 *Number of Tests, All Types of Grade* 8—Tests on the number of sample nuts in accordance with 8.1.2.1 shall be performed by the manufacturer.

8.1.5 *Test 2*—In addition to the testing required by 8.1.2.1 the manufacturer shall also perform hardness tests on sample nuts after the following test heat treatment. After completion of

^C Based on proof stress of 120 000 psi.

^D Based on proof stress of 150 000 psi.

E Based on proof stress of 135 000 psi.

F Based on proof stress of 175 000 psi.

^G Based on proof stress of 150 000 psi.

H Based on proof stress of 80 000 psi.

¹Based on proof stress of 75 000 psi.

TABLE 4 Proof Load Using Threaded Mandrel — Metric

Note 1—Proof loads are not design loads.

Nominal	Threads	Stress Area			Proof Lo	ad, kN ^A		
Size,	Pitch	mm ²	Grad	e 1	Grades 2, 2H	M, 6, 6F, 7M	Grades 2H,	3, 7, 16, 43
mm	Pilch	mm-	Heavy Hex ^B	Hex ^C	Heavy Hex ^D	Hex ^E	Heavy Hex ^F	Hex ^G
M12	1.75	84.3	75.5	69.5	87.3	78.4	101.6	87.3
M14	2.0	115.0	102.9	94.9	119.0	107.0	138.6	119.0
M16	2.0	157.0	140.5	129.5	162.5	146.0	189.2	162.5
M20	2.5	245.0	219.3	202.1	253.6	227.8	295.2	253.6
M22	2.5	303.0	271.2	249.9	313.6	281.8	365.1	313.6
M24	3.0	353.0	315.9	291.2	365.4	328.3	425.4	365.4
M27	3.0	459.0	411.0	378.7	475.1	426.9	553.4	475.1
M30	3.5	561.0	502.1	462.8	580.6	521.7	676.0	580.6
M36	4.0	817.0	731.2	674.0	845.6	759.8	984.5	845.6

			s of Grade 8, and s 9C and 9CA		
Nominal Size, mm	Thread Pitch	Stress	Heavy Hex ^H	Hex'	
		Area, mm²			
M12	1.75	84.3	46.4	43.4	
M14	2.0	115.0	63.3	59.2	
M16	2.0	157.0	86.4	80.9	
M20	2.5	245.0	134.8	126.2	
M22	2.5	303.0	166.7	156.0	
M24	3.0	353.0	194.2	181.8	
M27	3.0	459.0	252.5	236.4	
M30	3.5	561.0	308.6	288.9	
M36	4.0	817.0	449.4	420.8	

^A See limit for proof load test in 8.2.2.1. The proof load for jam nuts shall be 46 % of the tabulated load.

all production heat treatments heat the specimen nuts to the temperatures indicated below for 24 h, then slow cool. Test at room temperature.

	remperature
Grade ^A	°F [°C]
1	850 [455]
2, 2H, 2HM	1000 [540]
3, 7, 7M, 43	1100 [590]
16	1200 [650]

^ANuts intended to be coated with zinc or cadmium (marked in accordance with the requirements of Supplementary Requirement S8) are not subjected to the requirements of 8.1.5 (See Appendix X2).

8.1.5.1 *Special Requirement, Grades 2HM and 7M*—Preparation of Grades 2HM and 7M nuts for hardness test and the hardness test itself shall be performed with consideration to (*I*) protect legibility of markings; (2) minimize exterior dimensional changes; and (*3*) maintain thread fit.

8.2 Proof Load Test:

8.2.1 Requirements—The nuts listed in Tables 3 and 4 shall be capable of withstanding the proof loads specified therein. Proof load testing of nuts manufactured to dimensions and configurations other than those covered in Table 3 or Table 4 is only required when S9 is specified in the order or inquiry otherwise the nuts shall be cross-sectional hardness tested per Annex A3 of Test Methods and Definitions A370. Nuts that would require a proof load in excess of 160 000 lbf or 705 kN

shall, unless Supplementary Requirements S1 or S4 are invoked in the purchase order or contract, be proof load tested per Section 8, or cross sectional hardness tested per Annex A3 of Test Methods and Definitions A370.

8.2.2 Number of Tests:

- 8.2.2.1 The manufacturer shall test the number of nuts specified in 8.1.2.1 following all production heat treatments. Proof Load tests prevail over hardness tests in the event a conflict exists relative to minimum strength.
- 8.2.3 *Test Method*—The test shall be run using a threaded mandrel or a test bolt in accordance with Specification A962/A962M.

8.3 Cone Proof Load Test:

8.3.1 Requirements—This test shall be performed only when visible surface discontinuities become a matter of issue between the manufacturer and the purchaser. Nuts in the size range ½ to 1½ in. inclusive and M12 to M36 inclusive shall be proof load tested. Nuts not in this size range and all types of Grade 8 nuts are not subject to this test. Nuts manufactured to dimensions and configurations other than those covered by Specification A962/A962M, ASME B 1.1, ASME B 1.13M, ASME B 18.2.2, or ASME B 18.2.4.6M are not subject to the cone proof load test. The cone proof load applied shall be determined in accordance with the Cone Proof Load requirements in Specification A962/A962M (tables or formulae or

^B Based on proof stress of 895 MPa.

^C Based on proof stress of 825 MPa.

^D Based on proof stress of 1035 MPa.

E Based on proof stress of 930 MPa.

F Based on proof stress of 1205 MPa.

^G Based on proof stress of 1035 MPa.

H Based on proof stress of 550 MPa.

Based on proof stress of 515 MPa.

both) based upon the proof stresses shown in Table 5 and Table 6 of Specification A194/A194M.

8.3.2 *Number of Tests*—The manufacturer shall sample and test the number of nuts specified in 8.1.2.1. The lot shall be considered acceptable if the sample nut(s) withstand(s) application of the cone proof load without failure.

9. Dimensions

- 9.1 Nuts shall be hexagonal in shape, and in accordance with the dimensions for the hex or heavy hex series, as required, in ASME B 18.2.2 (for inch nuts) or ASME B 18.2.4.6M (for metric nuts). Unless otherwise specified, the American National Standard Heavy Hex Series shall be used and nuts shall be either double chamfered or have a machined or forged washer face, at the option of the manufacturer, and, conform to the angularity requirements of ASME B 18.2.2 (for inch nuts) or ASME B 18.2.4.6M (for metric nuts).
- 9.2 Unless otherwise specified, threads shall be in accordance with ASME B 1.1 or ASME B 1.13M, and shall be gauged in accordance with ASME B 1.2 and ASME B 1.13M as described in 9.2.1 and 9.2.2.
- 9.2.1 Nuts up to and including 1 in. nominal size shall be UNC Series Class 2B fit. Metric nuts up to and including M24 nominal size shall be coarse thread series tolerance 6H.
- 9.2.2 Nuts over 1 in. nominal size shall be either UNC Series Class 2B fit or 8 UN Series Class 2B fit. Unless otherwise specified, the 8 UN series shall be furnished. Metric nuts over M24 nominal size shall be coarse thread series tolerance 6H.

Note 1—Modification of thread dimensions may result in loss of load carrying ability.

10. Workmanship, Finish, and Appearance

10.1 Nuts shall be free of defects and shall be good commercial finish.

- 10.2 If visible surface imperfections in size $\frac{1}{4}$ through $1\frac{1}{2}$ in. and M12 through M36 and in any grade other than Grade 8 become a matter of issue between the manufacturer and the purchaser, the cone proof load test described in 8.3 shall be employed.
- 10.3 If a scale-free bright finish is required, this shall be specified on the purchase order.

11. Retests

11.1 Provisions for retests by the purchaser and his representative are specified in Supplementary Requirement S2.

12. Certification

12.1 In addition to the requirements of Specification A962/A962M, the certification shall include the results of the chemical analysis, macroetch examination (Carbon and Alloy Steels Only), mechanical tests, and the minimum tempering temperature for nuts of Grades 2H, 2HM, 3, 6, 6F, 7, 7M, and 43.

13. Product Marking

13.1 In addition to the requirements of Specification A962/A962M, nuts shall be legibly marked on one face with marking representing the grade, type, and applicable manufacturing process shown in Table 7. Marking of wrench flats or bearing surfaces is not permitted unless agreed upon between manufacturer and purchaser.

14. Keywords

14.1 bolting; chemical analysis; coated; marking on bolting components; nuts; plated

TABLE 5 Proof Stress	Using 1	120° Hardened	Steel Cone — Inch
----------------------	---------	---------------	-------------------

	Proof Stress – psi, Minimum						
Type	Grade 1	Grades 2,	Grades 2H				
		2HM, 6,	3, 7, 43, & 16				
		6F & 7M					
Hex	120 000	135 000	150 000				
Heavy Hex	130 000	150 000	175 000				

TABLE 6 Proof Stress Using 120° Hardened Steel Cone — Metric

	Proof Stress – MPa, Minimum					
Type	Grade 1	Grades 2,	Grades 2H			
		2HM, 6,	3, 7, 43, & 16			
		6F & 7M				
Hex	825	930	1035			
Heavy Hex	895	1035	1205			

TABLE 7 Marking of Nuts^A

	TABLE 7 Marking of Nuts ^A							
Grade and	Nuts Hot- Forged or	Nuts Machined from Bar	Nuts Manu- factured in					
Type	Cold-	Stock	Accordance					
, , , , , , , , , , , , , , , , , , ,	Punched		with 6.6					
1	1	1B						
2	2	2B						
2H ^B	2H	2HB						
2HM ^{B,C}	2HM	2HMB						
3	3	3B						
6	6	6B						
6F	6F	6FB						
7 _	7	7B						
7L ^D	7L	7BL						
7M ^{B, C}	7M	7MB						
7ML ^{B,D}	7ML	7MLB						
43	43	43B						
43L ^D	43L	43LB						
8 8C	8 8C	8B 8CB	8A 8CA					
8CLNCuB	8CLNCuB	8CLNCuBB	8CLNCuBA					
8CLNCUB	8CLNCUB	8CLNB	8CLNA					
8M	8M	8MB	8MA					
8T	8T	8TB	8TA					
8F	8F	8FB	8FA					
8P	8P	8PB	8PA					
8N	8N	8NB	8NA					
8MN	8MN	8MNB	8MNA					
8R	8R	8RB	8RA					
8S	8S	8SB	8SA					
8LN	8LN	8LNB	8LNA					
8MLN	8MLN	8MLNB	8MLNA					
8MLCuN	8MLCuN	8MLCuNB	8MLCuNA					
8ML4CuN	8ML4CuN	8ML4CuNB	8ML4CuNA					
9C	9C	9CB	9CA					
16	16	16B						

^AWhere ellipses (...) appear in this table there is no requirement.

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall be applied only when specified by the purchaser in the inquiry, contract, or order. Details of these supplementary requirements shall be agreed upon in writing by the manufacturer and purchaser. Supplementary requirements shall in no way negate any requirement of the specification itself.

S1. Strain-Hardened Austenitic Steel Nuts

S1.1 Strain hardened Grades 8, 8C, 8T, 8M, 8F, 8P, 8N, or 8MN nuts may be specified. When Supplementary Requirement S1 is invoked in the order, nuts shall be machined from cold drawn bars or shall be cold forged to shape. No subsequent heat treatment shall be performed on the nuts. Nuts made

in accordance with this requirement shall be proof load tested in accordance with 8.2.2.1 and shall withstand the proof load specified in Table S1.1 and Table S1.2. Testing nuts requiring proof loads over 160 000 lbf or 705 kN is only required when Supplementary Requirement S4 is invoked. The hardness limits of Table 2 do not apply to strain hardened nuts. Nuts

^BThe letters H and M indicate heat-treated nuts (see Section 6).

 $^{^{}C}\!\mathrm{An}$ underline as a marking requirement for grades 2HM and 7M has been removed but is permitted.

^DSee Supplementary Requirement S3.

TABLE S1.1 Proof Load Testing of Strain Hardened Nuts Using Threaded Mandrel — Inch Series

Note 1-Proof loads are not design loads.

		Proof Load, lbf ^A		
Nominal Size, in.	Threads per in.	Stress Area, in. ²	All Types of Grade 8 (strain hardened)	All Types of Grade 8 (strain hardened)
			Heavy Hex ^C	Hex ^B
1/4	20	0.0316	3 950	3 480
5/16	18	0.0523	6 550	5 760
3/8	16	0.0774	9 675	8 510
7/16	14	0.1063	13 290	11 690
1/2	13	0.1419	17 740	15 610
9/16	12	0.182	22 750	20 020
5/8	11	0.226	28 250	24 860
3/4	10	0.334	41 750	36 740
7/8	9	0.462	53 130	46 200
1	8	0.606	69 690	60 600
11/8	8	0.790	82 950	75 050
11/4	8	1.000	105 000	95 000
13/8	8	1.233	123 300	110 970
11/2	8	1.492	149 200	134 280

^A The proof load for jam nuts shall be 46 % of the tabulated value.

TABLE S1.2 Proof Load Testing of Strain Hardened Nuts Using Threaded Mandrel—Metric

Note 1-Proof loads are not design loads.

	Proof Load, kN ^A						
Nominal Size, mm	Thread Pitch	Stress Area, mm ²	All Types of Grade 8 (strain hardened)	All Types of Grade 8 (strain hardened)			
			Heavy Hex ^C	Hex ^B			
M12	1.75	84.3	72.5	64.1			
M14	2.0	115.0	98.9	87.4			
M16	2.0	157.0	135.0	119.3			
M20	2.5	245.0	210.9	186.2			
M22	2.5	303.0	240.9	209.0			
M24	3.0	353.0	280.6	243.5			
M27	3.0	459.0	332.7	300.6			
M30	3.5	561.0	406.7	367.5			
M36	4.0	817.0	563.7	506.5			

A The proof load for jam nuts shall be 46 % of the tabulated value.

made in accordance with this requirement shall be marked with the Grade symbol underlined.

S2. Retests by Purchaser's Representative

S2.1 The purchaser's representative may select two nuts per keg (200-lb unit [90-kg]) for sizes $\frac{5}{8}$ in. and M16 and smaller, one nut per keg for sizes over $\frac{5}{8}$ in. and M16 up to and including $\frac{11}{2}$ in. and M36, and one nut per every two kegs for sizes larger than $\frac{11}{2}$ in. and M36, which shall be subjected to the tests specified in Section 8.

S3. Low-Temperature Requirements for Grade 7, Grade 7M, and Grade 43 Nuts

S3.1 When low-temperature requirements are specified for Grade 7 nuts, the Charpy test procedures and requirements as defined in Specification A320/A320M for Grade L7 shall apply. When low-temperature requirements are specified for Grade 7M nuts, the Charpy test procedures and requirements as

defined in Specification A320/A320M for Grade L7M shall apply. When low-temperature requirements are specified for Grade 43 nuts, the Charpy test procedures and requirements as defined in Specification A320/A320M for Grade L43 shall apply. Charpy specimens may be taken from a sample nut, nut blank, or may be taken from separate test samples of the same heat processed through heat treatment with the nuts for which the test is to apply. Impact testing is not required when the bar stock or nut is smaller than 5/8 in. [16 mm] in diameter.

S3.2 An "L" shall be added to the marking, as shown in Table 7, for nuts so tested.

S4. Proof Load Tests of Large Nuts

S4.1 Proof load testing of nuts requiring proof loads of over 160 000 lbf or 705 kN is required. Testing shall be performed in accordance with 8.2 to the loads required in Table S4.1 and Table S4.2. The maximum load will be based entirely on the equipment available.

^B Based on proof stress of 110 000 psi up to ¾ in.; 100 000 psi ½ to 1 in.; 95 000 psi 1½ to 1¼ in.; 90 000 psi 1¾ to 1½ in.

^C Based on proof stress of 125 000 psi up to ¾ in.; 115 000 psi ½ to 1 in.; 105 000 psi 1½ to 1¼ in.; 100 000 psi 1¾ to 1½ in.

Based on proof stress of 760 MPa up to M20 mm: 690 MPa M22 to M24 mm: 655 MPa M27 to M30: and 620 MPa for M36.

^C Based on proof stress of 860 MPa up to M20 mm; 795 MPa M22 to M24 mm; 725 MPa M27 to M30 mm; and 690 MPa for M36.

TABLE S4.1 Proof Load for Large Heavy Hex Nuts — Inch^A

Nominal	Threads	Stress Area,	Proof Load, lbf ^B			
Size. in.	per in.	in. ²	Grade 1 Heavy Hex	Grades 2, 2HM, 6, 6F, 7M	Grades 2H, 3, 7, 43, 16	
Size, III.	per III.	crini. Grade i ricavy ricx	Heavy Hex	Heavy Hex		
15/8	8	1.78	231 400	267 000	311 500	
13/4	8	2.08	270 400	312 000	364 000	
17/8	8	2.41	313 300	361 500	421 800	
2	8	2.77	360 100	415 500	484 800	
21/4	8	3.56	462 800	534 000	623 000	
21/2	8	4.44	577 200	666 000	777 000	
23/4	8	5.43	705 900	814 500	950 250	

^A ASME B18.2.2 in the size range over 1½ in. provides dimensions only for heavy hex nuts. Refer to 8.3.1.

TABLE S4.2 Proof Load for Large Heavy Hex Nuts — Metric^A

			9			
Nominal	Thread Stress Area.		Proof Load, kN ^B			
Size,	Pitch	Stress Area, mm ²	Grade 1 Heavy Hex	Grades 2, 2HM, 6, 6F, 7M	Grades 2H, 3, 7, 43, 16	
mm	1 ItCII	111111	Glade T Heavy Hex	Heavy Hex	Heavy Hex	
M42	4.5	1120	1002.4	1159.2	1349.6	
M48	5	1470	1315.7	1521.4	1771.4	
M56	5.5	2030	1816.9	2101.0	2446.2	
M64	6	2680	2398.6	2773.8	3229.4	
M72	6	3460	3096.7	3581.1	4169.3	

ASME B 18.2.4.6M in the size range over M36 provides dimensions only for heavy hex nuts. Refer to 7.3.1.

S5. Control of Product by Heat Number

S5.1 When control of nuts by actual heat analysis is required and this supplementary requirement is specified, the manufacturer shall identify the completed nuts in each shipment by the actual heat number. When this supplementary requirement is specified, a certificate including the results of the actual production tests of each test lot together with the heat chemical analysis shall be furnished by the manufacturer.

S6. Grain Size Requirements for Non H Grade Austenitic Steels Used Above 1000 $^{\circ}\mathrm{F}$

S6.1 For design metal temperatures above 1000 °F [540 °C], the material shall have a grain size of No. 7 or coarser as determined in accordance with Test Methods E112. The grain size so determined shall be reported on the Certificate of Test.

S7. Coating on Nuts

S7.1 It is the purchaser's responsibility to specify in the purchase order all information required by the coating facility. Examples of such information may include but are not limited to the following:

S7.1.1 Reference to the appropriate coating specification and type, thickness, location, modification to dimensions, and hydrogen embrittlement relief.

Note S7.1—Modification of thread dimensions may result in loss of load carrying ability.

S7.1.2 Reference to Specifications A153/A153M, B633, B695, B696, B766, F1941/F1941M, F2329/F2329M, or Test Method F1940, or other standards.

S8. Marking Coated Nuts

S8.1 Nuts coated with zinc shall have ZN marked after the grade symbol. Nuts coated with cadmium shall have CD marked after the grade symbol.

Note S8.1—As an example, the marking for zinc-coated 2H bolting components will now be 2HZN rather than 2H*.

S9. Proof Load Testing

S9.1 Proof load tests of nuts made to dimensions, thread pitch, and configurations other than those covered in Table 3 or Table 4 shall be made using loads agreed upon between the manufacturer and the purchaser.

S10. 100 % Hardness Testing of Grade 2HM and 7M

S10.1 Each nut shall be tested for hardness by indentation method and shall meet the requirements specified in Table 2.

^B Proof loads for nuts of larger dimensions or other thread series may be calculated by multiplying the thread stress area times the proof stress in the notes to Table 3 or Table S1.1. The proof load for jam nuts shall be 46 % of the tabulated load.

^B Proof loads for nuts of larger dimensions or other thread series may be calculated by multiplying the thread stress area times the proof stress in the notes to Table 4 or Table S1.2. The proof load for jam nuts shall be 46 % of the tabulated load.

APPENDIXES

(Nonmandatory Information)

X1. STRAIN HARDENING OF AUSTENITIC STEELS

X1.1 Strain hardening is the increase in strength and hardness that results from plastic deformation below the recrystal-lization temperature (cold work). This effect is produced in austenitic stainless steels by reducing oversized bars to the desired final size by cold drawing or other process. The degree of strain hardening achievable in any alloy is limited by its strain hardening characteristics. In addition, the amount of strain hardening that can be produced is further limited by the variables of the process, such as the total amount of cross-

section reduction, die angle and bar size. In large diameter bars, for example, plastic deformation will occur principally in the outer regions of the bar, so that the increased strength and hardness due to strain hardening is achieved predominantly near the surface of the bar. That is, the smaller the bar, the greater the penetration of strain hardening. Thus, the mechanical properties of a given strain hardened bolting component are dependent not just on the alloy, but also on the size of bar from which it is machined.

X2. COATINGS AND APPLICATION LIMITS

X2.1 Use of coated bolting components at temperatures above approximately one-half the melting point (Fahrenheit or Celsius) of the coating is not recommended unless consideration is given to the potential for liquid and solid metal embrittlement, or both. The melting point of elemental zinc is approximately 780 °F [415 °C]. Therefore, application of zinc

coated bolting components should be limited to temperatures less than 390 °F [210 °C]. The melting point of cadmium is approximately 600 °F [320 °C]. Therefore, application of cadmium coated bolting components should be limited to temperatures less than 300 °F [160 °C].



SPECIFICATION FOR PRESSURE VESSEL PLATES, ALLOY STEEL, NICKEL



SA-203/SA-203M



(Identical with ASTM Specification A203/A203M-17.)

Standard Specification for Pressure Vessel Plates, Alloy Steel, Nickel

1. Scope

- 1.1 This specification covers nickel-alloy steel plates intended primarily for welded pressure vessels.
- 1.2 Plates under this specification are available with four strength levels and two nickel compositions as follows:

Grade	Nominal Nickel	Yield Strength, min,	Tensile Strength,
Grade	Content %	ksi [MPa]	min, ksi [MPa]
Α	2.25	37 [255]	65 [450]
В	2.25	40 [275]	70 [485]
D	3.50	37 [255]	65 [450]
E	3.50	40 [275]	70 [485]
F	3.50		
2 in. [5	0 mm] and under	55 [380]	80 [550]
Over 2	in. [50 mm]	50 [345]	75 [515]

- 1.3 The maximum thickness of plates is limited only by the capacity of the composition to meet the specified mechanical property requirements.
- 1.4 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents. Therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with this specification.
- 1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A20/A20M Specification for General Requirements for Steel Plates for Pressure Vessels

A435/A435M Specification for Straight-Beam Ultrasonic Examination of Steel Plates

A577/A577M Specification for Ultrasonic Angle-Beam Examination of Steel Plates

A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applica-

3. General Requirements and Ordering Information

- 3.1 Material supplied to this material specification shall conform to Specification A20/A20M. These requirements outline the testing and retesting methods and procedures, permitted variations in dimensions, and mass, quality and repair of defects, marking, loading, and ordering information.
- 3.2 In addition to the basic requirements of this specification, certain supplementary requirements are available when additional control, testing, or examination is required to meet end use requirements. The purchaser is referred to the listed supplementary requirements in this specification and to the detailed requirements in Specification A20/A20M.
- 3.3 If the requirements of this specification are in conflict with the requirements of Specification A20/A20M, the requirements of this specification shall prevail.

4. Materials and Manufacture

4.1 Steelmaking Practice—The steel shall be killed and shall conform to the fine grain size requirement of Specification A20/A20M.

5. Heat Treatment

5.1 All plates shall be thermally treated as follows:

TABLE 1 Chemical Requirements

Elements			Composition, %	
Elements	Grade A	Grade B	Grade D	Grades E and F
Carbon, max: ^A				
Up to 2 in. [50 mm] in thickness	0.17	0.21	0.17	0.20
Over 2 in. to 4 in. [100 mm] incl. in thickness	0.20	0.24	0.20	0.23
Over 4 in. [100 mm] in thickness	0.23	0.25		
Manganese, max:				
Heat analysis:				
2 in. [50 mm] and under	0.70	0.70	0.70	0.70
Over 2 in. [50 mm]	0.80	0.80	0.80	0.80
Product analysis:				
2 in. [50 mm] and under	0.78	0.78	0.78	0.78
Over 2 in. [50 mm]	0.88	0.88	0.88	0.88
Phosphorus, max ^A	0.025	0.025	0.025	0.025
Sulfur, max ^A	0.025	0.025	0.025	0.025
Silicon:				
Heat analysis	0.15-0.40	0.15-0.40	0.15-0.40	0.15-0.40
Product analysis	0.13-0.45	0.13-0.45	0.13-0.45	0.13-0.45
Nickel:				
Heat analysis	2.10-2.50	2.10-2.50	3.25-3.75	3.25-3.75
Product analysis	2.03-2.57	2.03-2.57	3.18-3.82	3.18-3.82

^A Applies to both heat and product analyses.

TABLE 2 Tensile Requirements

	Grades A and D		Grades B and E		Grade F	
	ksi	[MPa]	ksi	[MPa]	ksi	[MPa]
Tensile strength						
2 in. [50 mm] and under	65-85	[450-585]	70–90	[485-620]	80-100	[550-690]
Over 2 in. [50 mm]	65-85	[450–585]	70-90	[485–620]	75–95	[515–655]
Yield strength, min						
2 in. [50 mm] and under	37	[255]	40	[275]	55	[380]
Over 2 in. [50 mm]	37	[255]	40	[275]	50	[345]
Elongation in 8 in. [200 mm] min, % ^A		19		17		
Elongation in 2 in. [50 mm] min, % ^{A,B}		23		21	2	20

^A See Specification A20/A20M for elongation adjustments.

- 5.1.1 All plates of Grades A, B, D, and E shall be normalized except as permitted by 5.1.1.1.
- 5.1.1.1 If approved by the purchaser for Grades A, B, D, and E, cooling rates faster than air cooling are permissible for improvement of the toughness, provided the plates are subsequently tempered at not less than 1100°F [595°C] for not less than ½ h.
- 5.1.2 All plates of Grade F shall be heat treated by heating into the austenitic range, quenching in water, and tempering at not less than 1100°F [595°C] for not less than ½ h.

6. Chemical Composition

6.1 The steel shall conform to the chemical requirements shown in Table 1 unless otherwise modified in accordance with Supplementary Requirement S17, Vacuum Carbon-Deoxidized Steel, in Specification A20/A20M.

7. Mechanical Properties

7.1 Tension Test Requirements—The material as represented by the tension test specimens shall conform to the requirements shown in Table 2.

- 7.1.1 For plates that have been heat treated in accordance with 5.1.1.1 or 5.1.2 and have a nominal thickness of $\frac{3}{4}$ in. [20 mm] and under, the $\frac{1}{2}$ -in. (40-mm) wide rectangular specimen may be used for the tension test, and the elongation may be determined in a 2-in. [50-mm] gage length that includes the fracture and that shows the greatest elongation. When this specimen is used, the elongation shall be not less than 23 %.
 - 7.2 Impact Test Requirements:
- 7.2.1 Plates of Grades A, B, D, and E that have been heat treated in accordance with 5.1.1.1 shall be Charpy V-notch impact tested. The impact test shall meet 20 ft · lbf [27 J]. The test temperature and orientation shall be a matter of agreement between the purchaser and supplier.
- 7.2.2 Grade F plates shall be impact tested in accordance with Supplementary Requirement S5 in Specification A20/A20M.

8. Keywords

8.1 alloy steel plate; nickel alloy steel; pressure containing parts; pressure vessel steels; steel plates; steel plates for pressure vessel applications

⁸ See 7.1.1.

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified in the order.

A list of standardized supplementary requirements for use at the option of the purchaser are included in Specification A20/A20M. Those which are considered suitable for use with this specification are listed below by title.

- S1. Vacuum Treatment,
- S2. Product Analysis,
- S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons,
 - S4.1 Additional Tension Test,
 - S5. Charpy V-Notch Impact Test,
- S6. Drop Weight Test (for Material 0.625 in. [16 mm] and over in Thickness),
 - S7. High-Temperature Tension Test,

- S8. Ultrasonic Examination in accordance with Specification A435/A435M,
 - S9. Magnetic Particle Examination,
- S11. Ultrasonic Examination in accordance with Specification A577/A577M,
- S12. Ultrasonic Examination in accordance with Specification A578/A578M, and
 - S17. Vacuum Carbon-Deoxidized Steel.

SPECIFICATION FOR PRESSURE VESSEL PLATES, ALLOY STEEL, MOLYBDENUM



SA-204/SA-204M



(Identical with ASTM Specification A204/A204M-18.)

Standard Specification for Pressure Vessel Plates, Alloy Steel, Molybdenum

1. Scope

- 1.1 This specification covers molybdenum-alloy steel plates, intended particularly for welded boilers and other pressure vessels.
- 1.2 Plates under this specification are available in three grades having different strength levels as follows:

(Pa
•

- 1.3 The maximum thickness of plates is limited only by the capacity of the composition to meet the specified mechanical property requirements.
- 1.4 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with this specification.
- 1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A20/A20M Specification for General Requirements for Steel Plates for Pressure Vessels

- A435/A435M Specification for Straight-Beam Ultrasonic Examination of Steel Plates
- A577/A577M Specification for Ultrasonic Angle-Beam Examination of Steel Plates
- A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applica-

3. General Requirements and Ordering Information

- 3.1 Material supplied to this material specification shall conform to Specification A20/A20M. These requirements outline the testing and retesting methods and procedures, permitted variations in dimensions, and mass, quality and repair of defects, marking, loading, and ordering information.
- 3.2 In addition to the basic requirements of this specification, certain supplementary requirements are available when additional control, testing, or examination is required to meet end use requirements. The purchaser is referred to the listed supplementary requirements in this specification and to the detailed requirements in Specification A20/A20M.
- 3.3 Coils are excluded from qualification to this specification until they are processed into finished plates. Plates produced from coil means plates that have been cut to individual lengths from coil. The processor directly controls, or is responsible for, the operations involved in the processing of coils into finished plates. Such operations include decoiling, leveling, cutting to length, testing, inspection, conditioning, heat treatment (if applicable), packaging, marking, loading for shipment, and certification.

Note 1—For plates produced from coil and furnished without heat treatment or with stress relieving only, three test results are reported for each qualifying coil. Additional requirements regarding plates from coil are described in Specification A20/A20M.

3.4 If the requirements of this specification are in conflict with the requirements of Specification A20/A20M, the requirements of this specification shall prevail.

4. Materials and Manufacture

4.1 Steelmaking Practice—The steel shall be killed.

TABLE 1 Chemical Requirements

Element		Composition, %		
Element	Grade A	Grade B	Grade C	
Carbon, max: ^A				
Up to 1 in. [25 mm]	0.18	0.20	0.23	
incl, in thickness				
Over 1 in. to 2 in. [50 mm]	0.21	0.23	0.26	
incl, in thickness				
Over 2 in. to 4 in. [100 mm]	0.23	0.25	0.28	
incl, in thickness				
Over 4 in. [100 mm]	0.25	0.27	0.28	
in thickness				
Manganese, max:				
Heat analysis	0.90	0.90	0.90	
Product analysis	0.98	0.98	0.98	
Phosphorous, max ^A	0.025	0.025	0.025	
Sulfur, max ^A	0.025	0.025	0.025	
Silicon:				
Heat analysis	0.15-0.40	0.15-0.40	0.15-0.40	
Product analysis	0.13-0.45	0.13-0.45	0.13-0.45	
Molybdenum:				
Heat analysis	0.45-0.60	0.45-0.60	0.45-0.60	
Product analysis	0.41-0.64	0.41-0.64	0.41-0.64	

^A Applies to both heat and product analyses.

TABLE 2 Tensile Requirements

	Grade A		Gra	Grade B		Grade C	
_	ksi	[MPa]	ksi	[MPa]	ksi	[MPa]	
Tensile strength	65–85	[450–585]	70–90	[485–620]	75–95	[515–655]	
Yield strength, min ^A	37	[255]	40	[275]	43	[295]	
Elongation in 8 in. [200 mm], min, % ^B		19		17		16	
Elongation in 2 in. [50 mm], min, % ^B	23		21		20		

^A Determined by either the 0.2 % offset method or the 0.5 % extension-under-load method.

5. Heat Treatment

- 5.1 Plates 1½ in. [40 mm] and under in thickness are normally supplied in the as-rolled condition. The plates may be ordered normalized, normalized and tempered, or stress relieved.
- 5.2 Plates over $1\frac{1}{2}$ in. [40 mm] in thickness shall be normalized or normalized and tempered.

6. Chemical Requirements

6.1 The steel shall conform to the chemical requirements given in Table 1 unless otherwise modified in accordance with

Supplementary Requirement S17, Vacuum Carbon-Deoxidized Steel, in Specification A20/A20M.

7. Mechanical Requirements

7.1 *Tension Test Requirements*—The plates, as represented by the tension-test specimens, shall conform to the requirements given in Table 2.

8. Keywords

8.1 alloy steel plate; molybdenum-alloy; pressure containing parts; pressure vessel steel plate

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified in the purchase order.

A list of standardized supplementary requirements for use at the option of the purchaser is included in Specification A20/A20M. Those that are considered suitable for use with this specification are listed in this section by title.

- S1. Vacuum Treatment,
- S2. Product Analysis,
- S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons,
- S4.1 Additional Tension Test,
- S5. Charpy V-Notch Impact Test,
- S6. Drop Weight Test (for Material 0.625 in. [16 mm] and over in Thickness),

^B See Specification A20/A20M for elongation adjustment.

- S7. High-Temperature Tension Test,
- S8. Ultrasonic Examination in accordance with Specification A435/A435M,
 - S9. Magnetic Particle Examination,
- S11. Ultrasonic Examination in accordance with Specification A577/A577M,
- S12. Ultrasonic Examination in accordance with Specification A578/A578M, and
 - S17. Vacuum Carbon-Deoxidized Steel.

SPECIFICATION FOR SEAMLESS CARBON-MOLYBDENUM ALLOY-STEEL BOILER AND SUPERHEATER TUBES



SA-209/SA-209M



(Identical with ASTM Specification A209/A209M-03(2017).)

Standard Specification for Seamless Carbon-Molybdenum Alloy-Steel Boiler and Superheater Tubes

1. Scope

- 1.1 This specification covers several grades of minimum-wall-thickness, seamless, carbon-molybdenum alloy-steel, boiler and superheater tubes.
- 1.2 This specification covers tubes $\frac{1}{2}$ to 5 in. [12.7 to 127 mm] inclusive, in outside diameter and 0.035 to 0.500 in. [0.9 to 12.7 mm], inclusive, in minimum wall thickness.
- 1.3 An optional supplementary requirement is provided and, when desired, shall be so stated in the order.
- 1.4 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.

2. Referenced Documents

2.1 ASTM Standards:

A1016/A1016M Specification for General Requirements for Ferritic Alloy Steel, Austenitic Alloy Steel, and Stainless Steel Tubes

3. General Requirements

3.1 Product furnished under this specification shall conform to the requirements of Specification A1016/A1016M, includ-

ing any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A1016/A1016M constitutes nonconformance with this specification. In case of conflict with the requirements of this specification and Specification A1016/A1016M, this specification shall prevail.

4. Materials and Manufacture

- 4.1 Steelmaking Practice—The steel shall be killed.
- 4.2 The tubes shall be made by the seamless process and shall be either hot-finished or cold-finished, as specified.
- 4.3 Heat Treatment—Hot-finished tubes shall be heat treated at a temperature of 1200 °F [650 °C] or higher. Cold-finished tubes shall, after the final cold finishing, be heat treated at a temperature of 1200 °F [650 °C] or higher, or tubing may be furnished in the full-annealed, isothermal annealed, or normalized and tempered condition. If furnished in the normalized and tempered condition, the minimum tempering temperature shall be 1200 °F [650 °C].

5. Chemical Composition

- 5.1 The steel shall conform to the requirements given in Table 1.
 - 5.2 Product Analysis
- 5.2.1 An analysis shall be made by the manufacturer of one billet or one tube from each heat. The chemical composition thus determined, shall conform to the requirements given in Table 1.
- 5.2.2 If the original test for product analysis fails, retests of two additional billets or tubes shall be made. Both retests for the elements in question shall meet the requirements of the specification; otherwise all remaining material in the heat or lot (See 7.1) shall be rejected or, at the option of the producer, each billet or tube may be individually tested for acceptance. Billets or tubes that do not meet the requirements of the specification shall be rejected.

TABLE 1 Chemical Composition Requirements

Element		Composition,	%
	Grade T1	Grade T1a	Grade T1b
Carbon	0.10-0.20	0.15-0.25	0.14 max
Manganese	0.30-0.80	0.30-0.80	0.30-0.80
Phosphorus, max	0.025	0.025	0.025
Sulfur, max	0.025	0.025	0.025
Silicon	0.10-0.50	0.10-0.50	0.10-0.50
Molybdenum	0.44-0.65	0.44-0.65	0.44-0.65

6. Mechanical Properties

- 6.1 Tensile Requirements
- 6.1.1 The material shall conform to the requirements given in Table 2.

6.1.2 Table 3 gives the computed minimum elongation values for each ½2-in. [0.8-mm] decrease in wall thickness. Where the wall thickness lies between two values shown above, the minimum elongation value shall be determined by the following equation:

$$E = 48t + 15.00 [E = 1.87t + 15.00]$$
 (1)

where:

E = elongation in 2 in. [50 mm], %, and,

t = actual thickness of specimen, in. [mm].

- 6.2 *Hardness Requirements*—The tubes shall have a hardness not exceeding the values given in Table 4.
 - 6.3 Number of Tests
- 6.3.1 *Tension Test*—One tension test shall be made on a specimen for lots of not more than 50 tubes. Tension tests shall be made on specimens from two tubes for lots of more than 50 tubes (See 7.2)
- 6.3.2 Flattening Test—One flattening test shall be made on specimens from each end of one finished tube, not the one used for the flaring test, from each lot (See 7.1)
- 6.3.3 Flaring Test—One flaring test shall be made on specimens from each end of one finished tube, not the one used for the flattening test, from each lot (See 7.1)
- 6.3.4 *Hardness Test*—Brinell or Rockwell hardness tests shall be made on specimens from two tubes from each lot (See 7.2)

TABLE 2 Tensile Requirements

	Grade	Grade	Grade
	T1	T1b	T1a
Tensile strength, min, ksi [MPa] Yield strength, min, ksi [MPa] Elongation in 2 in. or 50 mm, min, % For longitudinal strip tests a deduction shall be made for each 1/32-in. [0.8- mm] decrease in wall thickness below 5/16 in. [8 mm] from the basic minimum elongation of the following percentage	55 [380]	53 [365]	60 [415]
	30 [205]	28 [195]	32 [220]
	30	30	30
	1.50 ⁴	1.50 ^A	1.50 ^A
When standard round 2-in. or 50-mm gage length or smaller proportionally sized specimen with the gage length equal to 4D (four times the diameter) is used	22	22	22

^ATable 3 gives the computed minimum values.

TABLE 3 Computed Minimum Values

Wall Thick	ness	Elongation in 2 in. or 50
in.	mm	mm, min, % ^A
5/16 (0.312)	8	30
%2 (0.281)	7.2	29
1/4 (0.250)	6.4	27
7/32 (0.219)	5.6	26
3/16 (0.188)	4.8	24
5/32 (0.156)	4	22
½ (0.125)	3.2	21
3/32 (0.094)	2.4	20
1/16 (0.062)	1.6	18

^ACalculated elongation requirements shall be rounded to the nearest whole number

TABLE 4 Hardness Requirements

	Brinell Hardness Number (Tubes 0.200 in. [5.1 mm] and over in Wall Thickness), HBW	Rockwell Hardness Number (Tubes less than 0.200 in. [5.1 mm] in Wall Thickness), HRB
Grade T 1	146	80
Grade T 1a Grade T 1b	153 137	81 77

7. Sampling

7.1 Flattening, Flaring, and Product Analysis—For flattening, flaring, and product analysis requirements, the term lot applies to all tubes prior to cutting of the same nominal size and wall thickness that are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and from the same heat that are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, the number of tubes of the same size and from the same heat in a lot shall be determined from the size of the tubes given in Table 5.

7.2 Tension and Hardness Tests—For tension and hardness tests, the term lot applies to all tubes prior to cutting, of the same nominal diameter and wall thickness that are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and the same heat that are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, a lot shall include all tubes of the same size and heat, heat treated in the same furnace at the same temperature, time at heat, and furnace speed.

TABLE 5 Number of Tubes in a Lot Heat Treated by the Continuous Process

Size of Tube	Size of Lot
2 in. [50.8 mm] and over in outside diameter and 0.200 in. [5.1 mm] and over in wall thickness	not more than 50 tubes
2 in. [50.8 mm] and over in outside diameter and under 0.200 in. [5.1 mm] in wall thickness	not more than 75 tubes
Less than 2 in. [50.8 mm] but over 1 in. [25.4 mm] in outside diameter	not more than 75 tubes
1 in. [25.4 mm] or less in outside diameter	not more than 125 tubes

8. Forming Operations

8.1 Tubes when inserted in the boiler shall stand expanding and beading without showing cracks or flaws. Superheater tubes when properly manipulated shall stand all forging, welding, and bending operations necessary for application without developing defects.

9. Product Marking

9.1 In addition to the marking prescribed in Specification A1016/A1016M, the marking shall include whether the tube is hot-finished or cold-finished.

10. Keywords

10.1 boiler tubes; carbon-molybdenum; seamless steel tube; steel tube; superheater tubes

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirement shall apply only when specified by the purchaser in the inquiry, contract, or order.

S1. Surface Condition

S1.1 If pickling or shot blasting, or both, are required, this shall be specifically stated in the order. Details of this supplemental requirement shall be agreed upon between the manufacturer and the purchaser.

SPECIFICATION FOR SEAMLESS MEDIUM-CARBON STEEL BOILER AND SUPERHEATER TUBES



SA-210/SA-210M

(Identical with ASTM Specification A210/A210M-95 except for editorial differences in Table 2.)

SPECIFICATION FOR SEAMLESS MEDIUM-CARBON STEEL BOILER AND SUPERHEATER TUBES



SA-210/SA-210M

(Identical with ASTM Specification A 210/A 210M-95 except for editorial differences in Table 2.)

1. Scope

- 1.1 This specification covers minimum-wall-thickness, seamless medium-carbon steel, boiler tubes and boiler flues, including safe ends (Note 1), arch and stay tubes, and superheater tubes.
- NOTE 1 This type is not suitable for safe ending by forge welding.
- 1.2 The tubing sizes and thicknesses usually furnished to this specification are $\frac{1}{2}$ in. to 5 in. [12.7 to 127 mm] in outside diameter and 0.035 to 0.500 in. [0.9 to 12.7 mm], inclusive, in minimum wall thickness. Tubing having other dimensions may be furnished, provided such tubes comply with all other requirements of this specification.
- 1.3 Mechanical property requirements do not apply to tubing smaller than $\frac{1}{8}$ in. [3.2 mm] in inside diameter or 0.015 in. [0.4 mm] in thickness.
- **1.4** When these products are to be used in applications conforming to ISO Recommendations for Boiler Construction, the requirements of Specification A 520, shall supplement and supersede the requirements of this specification.
- 1.5 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.

2. Referenced Documents

- 2.1 ASTM Standards:
- A 450/A 450M Specification for General Requirements for Carbon, Ferritic Alloy, and Austenitic Alloy Steel Tubes

A 520 Specification for Supplementary Requirements for Seamless and Electric-Resistance-Welded Carbon Steel Tubular Products for High-Temperature Service Conforming to ISO Recommendations for Boiler Construction

3. Ordering Information

- **3.1** Orders for material under this specification should include the following, as required, to describe the desired material adequately:
 - **3.1.1** Quantity (feet, metres, or number of lengths),
 - **3.1.2** Name of material (seamless tubes),
 - 3.1.3 Grade,
 - **3.1.4** Manufacture (hot-finished or cold-finished),
- **3.1.5** Size (outside diameter and minimum wall thickness),
 - **3.1.6** Length (specific or random),
 - **3.1.7** Optional requirements (Sections 7 and 10),
- **3.1.8** Test report required (see Certification Specification of Specification A 450/A 450M),
 - 3.1.9 Specification designation, and
 - 3.1.10 Special requirements

4. General Requirements

4.1 Material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A 450/A 450M, unless otherwise provided herein.

5. Manufacture

- **5.1** *Steelmaking Practice* The steel shall be killed.
- **5.2** The tubes shall be made by the seamless process and shall be either hot-finished or cold-finished, as specified.

6. Heat Treatment

6.1 Hot-finished tubes need not be heat treated. Cold-finished tubes shall be given a subcritical anneal, a full anneal, or a normalizing heat treatment after the final cold-finishing process.

7. Surface Condition

7.1 If pickling or shot blasting or both are required, this shall be specifically stated in the order.

8. Chemical Composition

- **8.1** The steel shall conform to the requirements as to chemical composition prescribed in Table 1.
- **8.2** When a grade is ordered under this specification, supplying an alloy grade that specifically requires the addition of any element other than those listed for the ordered grade in Table 1 is not permitted.

9. Product Analysis

- **9.1** When requested on the purchase order, a product analysis shall be made by the supplier from one tube or billet per heat. The chemical composition thus determined shall conform to the requirements specified.
- **9.2** If the original test for product analysis fails, retests of two additional billets or tubes shall be made. Both retests for the elements in question shall meet the requirements of the specification; otherwise, all remaining material in the heat or lot (Note 2) shall be rejected or, at the option of the producer, each billet or tube may be individually tested for acceptance. Billets or tubes which do not meet the requirements of the specification shall be rejected.

NOTE 2 — For flattening and flaring requirements, the term "lot" applies to all tubes prior to cutting of the same nominal size and wall thickness which are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and from the same heat which are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, the number of tubes of the same size and from the same heat in a lot shall be determined from the size of the tubes as prescribed in Table 2.

NOTE 3 — For tensile and hardness test requirements, the term "lot" applies to all tubes prior to cutting, of the same nominal diameter and wall thickness which are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and the same heat which are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, a lot shall include all tubes of the same size and heat, heat treated in the same furnace at the same temperature, time at heat, and furnace speed.

10. Tensile Requiremnts

10.1 The material shall conform to the requirements as to tensile properties prescribed in Table 3.

10.2 Table 4 gives the computed minimum elongation values for each $\frac{1}{32}$ in. [0.8 mm] decrease in wall thickness. Where the wall thickness lies between two values shown above, the minimum elongation value shall be determined by the following equation:

$$E = 48t + 15.00 [E = 1.87t + 15.00]$$

where:

E = elongation in 2 in. or 50 mm, %, and t = actual thickness of specimen, in. [mm].

11. Hardness Requirements

11.1 The tubes shall have a hardness not exceeding the following: 79 HRB or 143 HB for Grade A-1, 89 HRB or 179 HB for Grade C.

12. Mechanical Tests Required

- **12.1** Tension Test One tension test shall be made on a specimen for lots of not more than 50 tubes. Tension tests shall be made on specimens from two tubes for lots of more than 50 tubes (Note 3).
- **12.2** Flattening Test One flattening test shall be made on specimens from each end of one finished tube from each lot (Note 2), but not the one used for the flaring test. Tears or breaks occurring at the 12 or 6 o'clock positions on Grade C tubing with sizes of 2.375 in. [60.3 mm] in outside diameter and smaller shall not be considered a basis for rejection.
- **12.3** Flaring Test One flaring test shall be made on specimens from each end of the one finished tube from each lot (Note 2,) but not the one used for the flattening test.
- **12.4** *Hardness Test* Brinell or Rockwell hardness test shall be made on specimens from two tubes from each lot (Note 3).
- **12.5** Hydrostatic or Nondestructive Electric Test Each tube shall be subjected to the hydrostatic, or, instead of this test, a nondestructive electric test may be used when specified by the purchaser.

13. Forming Operations

13.1 When inserted in the boiler, tubes shall stand expanding and beading without showing cracks or flaws. When properly manipulated, superheater tubes shall stand all forging, welding and bending operations necessary for application without developing defects.

14. Product Marking

14.1 In addition to the marking prescribed in Specification A 450/A 450M, the marking shall indicate whether the tube is hot-finished or cold-finished.

15. Keywords

15.1 boiler tubes; carbon; seamless steel tube; steel tube; superheater tubes

TABLE 1 CHEMICAL REQUIREMENTS

	Composition, %					
Element	Grade A-1	Grade C				
Carbon ^A , max	0.27	0.35				
Manganese	0.93 max	0.29-1.06				
Phosphorus, max	0.035	0.035				
Sulfur, max	0.035	0.035				
Silicon, min	0.10	0.10				

^A For each reduction of 0.01% below the specified carbon maximum, an increase of 0.06% manganese above the specified maximum will be permitted up to a maximum of 1.35%.

TABLE 2
NUMBER OF TUBES IN A LOT HEAT TREATED BY THE
CONTINUOUS PROCESS

Size of Tube	Size of Lot
2 in. (50.8 mm) and over in diameter and 0.200 in. (5.1 mm) and over in wall thickness	not more than 50 tubes
2 in. (50.8 mm) and over in outside diameter and under 0.200 in. (5.1 mm) in wall thickness	not more than 75 tubes
Less than 2 in. (50.8 mm) but over 1 in. (25.4 mm) in outside diameter or over 1 in. in outside diameter and under 0.200 in. (5.08 mm) in wall thickness	not more than 75 tubes
1 in. (25.4 mm) or less in outside diameter	not more than 125 tubes

TABLE 3
TENSILE REQUIREMENTS

	Grade A-1	Grade C
Tensile strength, min, ksi [MPa]	60 [415]	70 [485]
Yield strength, min, ksi [MPa]	37 [255]	40 [275]
Elongation in 2 in. or 50 mm, min, %	30	30
For longitudinal strip tests, a deduction shall be made for each $\frac{1}{2}$ in. [0.8 mm] decrease in wall thickness under $\frac{5}{16}$ in. [8 mm] from the basic minimum elongation of the following percentage points	1.50 ^A	1.50 ^A
When standard round 2 in. or 50 mm gage length or smaller proportionally sized specimen with the gage length equal to $4D$ (four times the diameter) is used	22	20

^A See Table 4 for the computed minimum values.

Wall Thickness, in. [mm]	Elongation in 2 in. or 50 mm, min, %
⁵ / ₁₆ (0.312) [8]	30
⁹ / ₃₂ (0.281) [7.2]	28
¹ / ₄ (0.250) [6.4]	27
⁷ / ₃₂ (0.219) [5.6]	26
³ / ₁₆ (0.188) [4.8]	24
⁵ / ₃₂ (0.156) [4]	22
¹ / ₈ (0.125) [3.2]	21
³ / ₃₂ (0.094) [2.4]	20
¹ / ₁₆ (0.062) [1.6]	18
0.062 to 0.035 [1.6 to 0.9], excl	17
0.035 to 0.022 [0.9 to 0.6], excl	16
0.022 to 0.015 [0.6 to 0.4], incl	16

 $^{^{\}it A}$ Calculated elongation requirements shall be rounded to the nearest whole number.



SPECIFICATION FOR SEAMLESS FERRITIC AND AUSTENITIC ALLOY-STEEL BOILER, SUPERHEATER, AND HEAT-EXCHANGER TUBES



SA-213/SA-213M

(23)

 $(Identical\ with\ ASTM\ Specification\ A213/A213M-22\ except\ for\ the\ additional\ H\ Grade\ requirements\ in\ para.\ 6.2\ and\ correction\ of\ UNS\ number\ for\ Grade\ T9\ in\ Table\ 3.)$

Specification for Seamless Ferritic and Austenitic Alloy-Steel Boiler, Superheater, and Heat-Exchanger Tubes

1. Scope

- 1.1 This specification covers seamless ferritic and austenitic steel boiler, superheater, and heat-exchanger tubes, designated Grades T5, TP304, etc. These steels are listed in Tables 1 and 2.
- 1.2 Grades containing the letter, H, in their designation, have requirements different from those of similar grades not containing the letter, H. These different requirements provide higher creep-rupture strength than normally achievable in similar grades without these different requirements.
- 1.3 The tubing sizes and thicknesses usually furnished to this specification are $\frac{1}{8}$ in. [3.2 mm] in inside diameter to 5 in. [127 mm] in outside diameter and 0.015 to 0.500 in. [0.4 to 12.7 mm], inclusive, in minimum wall thickness or, if specified in the order, average wall thickness. Tubing having other diameters may be furnished, provided such tubes comply with all other requirements of this specification.
- 1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.
- 1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A262 Practices for Detecting Susceptibility to Intergranular Attack in Austenitic Stainless Steels
- A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys
- A1016/A1016M Specification for General Requirements for Ferritic Alloy Steel, Austenitic Alloy Steel, and Stainless Steel Tubes
- E112 Test Methods for Determining Average Grain Size 2.2 AWS Specifications
- A5.5/A5.5M Specification for Low-Alloy Steel Electrodes for Shielded Metal Arc Welding
- A5.23/A5.23M Specification for Low-Alloy Steel Electrodes and Fluxes for Submerged Arc Welding
- A5.28/A5.28M Specification for Low-Alloy Steel Electrodes for Gas Shielded Arc Welding
- A5.29/A5.29M Low-Alloy Steel Electrodes for Flux Cored Arc Welding

3. Terminology

3.1 *Definitions*—For definitions of terms used in this specification, refer to Terminology A941.

4. Ordering Information

- 4.1 It shall be the responsibility of the purchaser to specify all requirements that are necessary for products under this specification. Such requirements to be considered include, but are not limited to, the following:
 - 4.1.1 Quantity (feet, metres, or number of lengths),
 - 4.1.2 Name of material (seamless tubes),
 - 4.1.3 Grade (Tables 1 and 2),
 - 4.1.4 Condition (hot finished or cold finished),
 - 4.1.5 Heat treatment type (Table 3).
 - 4.1.6 Controlled structural characteristics (see 6.3),

ASME BPVC.II.A-2023

TABLE 1 Chemical Composition Limits, %^A, for Low Alloy Steel

Grade	UNS Designation															
	-	Carbon	Manga- nese	Phospho- rus	Sul- fur	Silicon	Nickel	Chromium	Molybdenum	Vana- dium	Boron	Niobium ^E	Nitrogen	Aluminum	Tungsten	Other Elements
2	K11547	0.10-0.20	0.30-0.61	0.025	0.025 ^B	0.10-0.30		0.50-0.81	0.44-0.65							
5	K41545	0.15	0.30-0.60	0.025	0.025	0.50		4.00-6.00	0.45-0.65							
5b	K51545	0.15	0.30-0.60	0.025	0.025	1.00–2.00		4.00-6.00	0.45-0.65							
5c	K41245	0.12	0.30-0.60	0.025	0.025	0.50	•••	4.00-6.00	0.45-0.65	•••						Ti 4xC-0.70
9	K90941	0.15	0.30-0.60	0.025	0.025	0.25-1.00		8.00-10.00	0.90-1.10							
11	K11597	0.05-0.15		0.025	0.025	0.50-1.00		1.00-1.50	0.44-0.65							
2 7	K11562	0.05-0.15 0.15-0.25		0.025 0.025	0.025 ^B	0.50 0.15–0.35		0.80-1.25	0.44-0.65	 0.15		•••		•••	•••	
17 21	K12047 K31545	0.15-0.25		0.025	0.025 0.025	0.15-0.35		0.80-1.25 2.65-3.35	 0.80–1.06							
22	K21590	0.05-0.15		0.025	0.025	0.50-1.00		1.90-2.60	0.87-1.13							
22	K21590 K40712	0.05-0.15		0.025	0.025	0.50	0.40	1.90-2.60	0.87-1.13		0.0010-	0.02-0.08	0.015	0.030	 1.45–1.75	Ti 0.005–
23	K40712	0.04-0.10	0.10-0.00	0.030	0.010	0.50	0.40	1.90-2.00	0.05-0.50	J.20-0.30	0.006	0.02-0.06	0.015	0.030	1.45-1.75	0.060 Ti/N ≥ 3.5 ^C
24	K30736	0.05-0.10	0.30-0.70	0.020	0.010	0.15-0.45		2.20-2.60	0.90–1.10 (0.20-0.30	0.0015- 0.007		0.012	0.02		Ti 0.06–0.10
36	K21001	0.10-0.17	0.80-1.20	0.030	0.025	0.25-0.50	1.00-1.30	0.30	0.25-0.50	0.02		0.015-0.045	0.02	0.050		Cu 0.50–0.80
91 Type 1	K90901	0.07-0.14	0.30-0.60	0.020	0.010	0.20-0.50	0.40	8.0–9.5	0.85–1.05 (0.18–0.25		0.06–0.10	0.030– 0.070	0.02	•••	Ti 0.01 Zr 0.01
91 Type 2 eat	K90901	0.08-0.12	0.30-0.50 ^D	0.020 ^D	0.005 ^D	0.20-0.40 ^D	0.20 ^D	8.0–9.5 ^D	0.85–1.05 (0.18–0.25	0.001 ^D	0.06-0.10	0.035- 0.070 ^D	0.020 ^D	0.05 ^D	Ti 0.01 ^D Zr 0.01 ^D
roduct		0.07-0.13							0.80–1.05 (0.16–0.27		0.05-0.11				Cu 0.10 ^D Sb 0.003 ^D Sn 0.010 ^D As 0.010 ^D N/Al 4.0 min
92	K92460	0.07-0.13	0.30-0.60	0.020	0.010	0.50	0.40	8.5–9.5	0.30-0.60 (0.15–0.25	0.001- 0.006	0.04-0.09	0.030- 0.070	0.02	1.5–2.00	Ti 0.01 Zr 0.01
93	K91350	0.05-0.10	0.20-0.70	0.020	0.008	0.05-0.50	0.20	8.50-9.50	(0.15–0.30	0.007- 0.015	F	0.005- 0.015	0.030	2.5–3.5	Co 2.5–3.5 Nd 0.010– 0.060 O 0.0050
T115 Heat	K91060	0.08-0.13	0.20-0.50	0.020	0.005	0.15–0.45	0.25	10.0–11.0	0.40-0.60 (0.18-0.25	0.001	0.02-0.06	0.030- 0.070	0.02		Ti 0.01 Zr 0.01 Cu 0.10 As 0.010 Sn 0.010 Sb 0.003 W 0.05 N/Al 4.0 min CNB ^G 10.5 max

TABLE 1 Continued

Grade	UNS Designation	Composition %														
		Carbon	Manga- nese	Phospho- rus	Sul- fur	Silicon	Nickel	Chromium	Molybdenum	Vana- dium	Boron	Niobium ^E	Nitrogen	Aluminum	Tungsten	Other Elements
Product		0.07-0.14	0.20-0.50	0.020	0.005	0.15-0.45	0.25	10.0–11.0	0.37–0.63 0	.16–0.27	0.001	0.02-0.07	0.030- 0.070	0.02		Ti 0.01
																Zr 0.01 Cu 0.10 As 0.010 Sn 0.010 Sb 0.003 W 0.05
T122	K91271	0.07-0.14	0.70	0.020	0.010	0.50	0.50	10.0–11.5	0.25–0.60 0	0.15-0.30	0.0005- 0.005	0.04–0.10	0.040- 0.100	0.02	1.50–2.50	Cu 0.30–1.70 Ti 0.01 Zr 0.01
T128	K91421	0.12 - 0.17	0.30 - 0.80	0.02	0.01	0.20 - 0.60	0.10 - 0.40	10.50 – 12.00	0.20 - 0.60	0.15 – 0.30	0.008 - 0.015	0.02 - 0.06	0.002 - 0.020	0.02	1.50 – 2.20	Co 1.50 - 2.20 Cu 0.15
T911	K91061	0.09-0.13	0.30-0.60	0.020	0.010	0.10-0.50	0.40	8.5–9.5	0.90–1.10 0	.18–0.25	0.0003- 0.006	0.06-0.10	0.040- 0.090	0.02	0.90-1.10	
T921	K91201	0.08-0.12	0.5–0.7	0.03	0.02	1.6–2.2	0.8–1.4	8.0–9.5	0.8–1.1				0.02-0.05	0.04		Cu 0.8-1.4

A Maximum, unless range or minimum is indicated. Where ellipses (...) appear in this table, there is no requirement, and analysis for the element need not be determined or reported.

^B It is permissible to order T2 and T12 with a sulfur content of 0.045 max. See 16.3.

^CAlternatively, in lieu of this ratio minimum, the material shall have a minimum hardness of 275 HV in the hardened condition, defined as after austenitizing and cooling to room temperature but prior to tempering. Hardness testing shall be performed at mid-thickness of the product. Hardness test frequency shall be two samples of product per heat treatment lot and the hardness testing results shall be reported on the material test report.

^DApplies to both heat and product analyses.

EThe terms Niobium (Nb) and Columbium (Cb) are alternate names for the same element.

FGrade T93 shall have a Nb + Ta content of 0.05–0.12 %.

^GChromium-Nickel Balance is defined as CNB = (Cr + 6Si + 4Mo +1.5W + 11V + 5Nb + 9Ti + 12Al) – (40C + 30N + 4Ni + 2Mn + 1Cu).

ASME BPVC.II.A-2023

TABLE 2 Chemical Composition Limits. $\%^A$, for Austenitic and Ferritic Stainless Steel

			IABLE	2 Cnemical (ompositio	on Limits, % ^A	, τοr Austenii	ic and Fer	ritic Stainles	s Steel			
	UNS						Com	position					
Grade	Designation	Carbon	Manga- nese	Phospho- rus	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen ^B	Niobium ^N	Titanium	Other Elements
TP201	S20100	0.15	5.5–7.5	0.060	0.030	1.00	16.0–18.0	3.5–5.5		0.25			
TP202	S20200	0.15	7.5-10.0	0.060	0.030	1.00	17.0-19.0	4.0-6.0		0.25			
XM-19	S20910	0.06	4.0-6.0	0.045	0.030	1.00	20.5-23.5	11.5-13.5	1.50-3.00	0.20-0.40	0.10-0.30		V 0.10-0.30
С	S21500	0.06–0.15	5.5–7.0	0.045	0.030	0.20-1.00	14.0–16.0	9.0–11.0	0.80–1.20		0.75–1.25		B 0.003– 0.009, V 0.15–0.40
С	S25700	0.02	2.00	0.025	0.010	6.5-8.0	8.0-11.5	22.0-25.0	0.50				
TP304	S30400	0.08	2.00	0.045	0.030	1.00	18.0-20.0	8.0-11.0					
TP304L	S30403	0.035^{D}	2.00	0.045	0.030	1.00	18.0-20.0	8.0-12.0					
TP304H	S30409	0.04-0.10	2.00	0.045	0.030	1.00	18.0-20.0	8.0-11.0					
С	S30432	0.07–0.13	1.00	0.040	0.010	0.30	17.0–19.0	7.5–10.5		0.05-0.12	0.30-0.60		AI 0.003- 0.030, B 0.001- 0.010, Cu 2.5-3.5
С	S30434	0.07–0.14	2.00	0.040	0.010	1.00	17.5–19.5	9.0–12.0			0.10-0.40 ^E	0.10-0.25 ^E	B 0.001- 0.004 Cu 2.50- 3.50
TP304N	S30451	0.08	2.00	0.045	0.030	1.00	18.0-20.0	8.0-11.0		0.10-0.16			
TP304LN	S30453	0.035^{D}	2.00	0.045	0.030	1.00	18.0–20.0	8.0-11.0		0.10-0.16			
С	S30615	0.016-0.24	2.00	0.030	0.030	3.2-4.0	17.0-19.5	13.5-16.0					AI 0.8-1.5
C	S30815	0.05-0.10	0.80	0.040	0.030	1.40-2.00	20.0-22.0	10.0-12.0		0.14-0.20			Ce 0.03-0.08
TP309S	S30908	0.08	2.00	0.045	0.030	1.00	22.0-24.0	12.0-15.0					
TP309H	S30909	0.04-0.10	2.00	0.045	0.030	1.00	22.0-24.0	12.0-15.0					
TP309LMoN	S30925	0.025	2.00	0.040	0.030	0.70	23.0-26.0	13.0-16.0	0.5-1.2	0.25-0.40			
TP309Cb	S30940	0.08	2.00	0.045	0.030	1.00	22.0-24.0	12.0-16.0			10xC-1.10		
TP309HCb	S30941	0.04-0.10	2.00	0.045	0.030	1.00	22.0–24.0	12.0–16.0	•••		10xC-1.10		
	S30942	0.03-0.10	2.00	0.040	0.030	1.00	21.0-23.0	14.5–16.5		0.10-0.20	0.50-0.80		B=0.001-0.005
C	S31002	0.015	2.00	0.020	0.015	0.15	24.0-26.0	19.0-22.0	0.10	0.10			
TP310S	S31008	0.08	2.00	0.045	0.030	1.00	24.0-26.0	19.0-22.0					
TP310H	S31009	0.04-0.10	2.00	0.045	0.030	1.00	24.0-26.0	19.0-22.0					
TP310MoCbN	S31025	0.10	1.50	0.030	0.030	1.00	19.5–23.0	23.0–26.0		0.10-0.25	0.10-0.40	0.20	B 0.002- 0.010
	S31035	0.04–0.10	0.60	0.025	0.015	0.40	21.5–23.5	23.5–26.5		0.20-0.30	0.40-0.60		W 3.0–4.0 Co 1.0–2.0 Cu 2.5–3.5 B 0.002– 0.008
TP310Cb	S31040	0.08	2.00	0.045	0.030	1.00	24.0-26.0	19.0-22.0			10xC-1.10	•••	
TP310HCb	S31041	0.04-0.10	2.00	0.045	0.030	1.00	24.0-26.0	19.0-22.0			10xC-1.10	•••	
TP310HCbN	S31042	0.04-0.10	2.00	0.045	0.030	1.00	24.0-26.0	19.0-22.0		0.15-0.35	0.20-0.60		
С	S31043	0.04-0.10	2.00	0.045	0.030	1.00	24.0-26.0	19.0-22.0		0.15-0.35	0.20-0.50 ^O		Ta 0.20 min ^O
TP310MoLN	S31050	0.025	2.00	0.020	0.030	0.40	24.0-26.0	21.0-23.0	2.00-3.00	0.10-0.16			
С	S31060	0.05–0.10	1.00	0.040	0.030	0.50	22.0–24.0	10.0–12.5		0.18-0.25			Ce + La 0.025-0.070 B 0.001-0.010
С	S31254	0.020	1.00	0.030	0.010	0.80	19.5–20.5	17.5-18.5	6.0-6.5	0.18-0.25			Cu 0.50-1.00

TABLE 2 Continued

	UNS						Com	position					
Grade	Designation	Carbon	Manga- nese	Phospho- rus	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen ^B	Niobium ^N	Titanium	Other Elements
	S31266	0.030	2.00-4.00	0.035	0.020	1.00	23.0–25.0	21.0–24.0	5.2-6.2	0.35-0.60			Cu 1.00–2.00 W 1.50–2.50
С	S31272	0.08-0.12	1.50-2.00	0.030	0.015	0.30-0.70	14.0–16.0	14.0–16.0	1.00-1.40			0.30-0.60	B 0.004- 0.008
С	S31277	0.020	3.00	0.030	0.010	0.50	20.5-23.0	26.0-28.0	6.5-8.0	0.30-0.40			Cu 0.50-1.50
TP316	S31600	0.08	2.00	0.045	0.030	1.00	16.0-18.0	10.0-14.0					
TP316L	S31603	0.035 ^D	2.00	0.045	0.030	1.00	16.0-18.0	10.0–14.0					
TP316H	S31609	0.04-0.10	2.00	0.045	0.030	1.00	16.0–18.0	11.0–14.0					
TP316Ti	S31635	0.08	2.00	0.045	0.030	0.75	16.0–18.0	10.0–14.0	2.00–3.00	0.10		5X (C + N)– 0.70	
TP316N	S31651	0.08	2.00	0.045	0.030	1.00	16.0-18.0	10.0-13.0	2.00-3.00	0.10-0.16			
TP316LN	S31653	0.035 ^D	2.00	0.045	0.030	1.00	16.0-18.0	10.0-13.0	2.00-3.00	0.10-0.16			
TP317	S31700	0.08	2.00	0.045	0.030	1.00	18.0-20.0	11.0–15.0					
TP317L	S31703	0.035	2.00	0.045	0.030	1.00	18.0-20.0	11.0–15.0	3.0-4.0				
TP317LM	S31725	0.03	2.00	0.045	0.030	1.00	18.0-20.0	13.5–17.5	4.0-5.0	0.20			Cu 0.75
TP317LMN	S31726	0.03	2.00	0.045	0.030	1.00	17.0-20.0	13.5–17.5	4.0-5.0	0.10-0.20			Cu 0.75
С	S31730	0.030	2.00	0.040	0.010	1.00	17.0-19.0	15.0-16.5	3.0-4.0	0.045			Cu 4.0-5.0
С	S31740	$0.005-0.020^{P}$	2.00	0.045	0.030	1.00	17.0-19.0	11.0-15.0	3.0-4.5	0.06-0.15	0.20-0.50 ^P	•••	
С	S32050	0.030	1.50	0.035	0.020	1.00	22.0-24.0	20.0-23.0	6.0-6.8	0.21 - 0.32			Cu 0.40
TP321	S32100	0.08	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0				5(C + N)- 0.70	
TP321H	S32109	0.04–0.10	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0				4(C + N)- 0.70	
C	S32615	0.07	2.00	0.045	0.030	4.8–6.0	16.5–19.5	19.0–22.0					Cu 1.50– 2.50
С	S33228	0.04-0.08	1.00	0.020	0.015	0.30	26.0–28.0	31.0–33.0		•••	0.60-1.00		Ce 0.05- 0.10, Al 0.025
C	S34565	0.030	5.0-7.0	0.030	0.010	1.00	23.0-25.0	16.0-18.0	4.0-5.0	0.40-0.60	0.10		
TP347	S34700	0.08	2.00	0.045	0.030	1.00	17.0-20.0	9.0-13.0			10xC-1.10		
TP347W	S34705	0.05	2.00	0.040	0.030	1.00	17.0–20.0	8.00-11.0		0.10-0.25	0.25-0.50		V 0.20-0.50 W 1.50-2.60
TP347H	S34709	0.04-0.10	2.00	0.045	0.030	1.00	17.0-19.0	9.0-13.0			8xC-1.10		
TP347HFG	S34710	0.06-0.10	2.00	0.045	0.030	1.00	17.0-19.0	9.0-13.0			8xC-1.10		
TP347LN	S34751	0.005-0.020	2.00	0.045	0.030	1.00	17.0-19.0	9.0-13.0		0.06-0.10	0.20-0.50 ^F		
С	S34752	0.005-0.020	2.00	0.035	0.010	0.60	17.0–19.0	10.0–13.0	0.20–1.20	0.06–0.12	0.20-0.50 ^F		Cu 2.50-3.50 B 0.001-0.005
TP348	S34800	0.08	2.00	0.045	0.030	1.00	17.0–19.0	9.0–13.0			G		Co 0.20, Ta 0.10
TP348H	S34809	0.04-0.10	2.00	0.045	0.030	1.00	17.0–19.0	9.0–13.0			Н		Co 0.20, Ta 0.10
	S35045	0.06-0.10	1.50	0.045	0.015	1.00	25.0–29.0	32.0–37.0				0.15-0.60	Al 0.15-0.60 Cu 0.75
XM-15	S38100	0.08	2.00	0.030	0.030	1.50-2.50	17.0-19.0	17.5-18.5					
	S38815	0.030	2.00	0.040	0.020	5.5–6.5	13.0–15.0	15.0–17.0	0.75-1.50				Cu 0.75-1.50 Al 0.30
Alloy 20	N08020	0.070	2.00	0.045	0.035	1.00	19.0-21.0	32.0-38.0	2.00-3.00		М		Cu 3.00-4.00
	N08028	0.030	2.50	0.030	0.030	1.0	26.0-28.0	30.0-34.0	3.0-4.0				Cu 0.6-1.4
	N08029	0.020	2.0	0.025	0.015	0.6	26.0-28.0	30.0-34.0	4.0-5.0				Cu 0.6-1.4

TABLE 2 Continued

	UNS		Composition										
Grade	Designation	Carbon	Manga- nese	Phospho- rus	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen ^B	Niobium ^N	Titanium	Other Elements
С	Noooz	0.000	0.00	0.040		4.00	00 0 00 0	00 5 05 5		0.40.005			0 0 75
	N08367	0.030	2.00	0.040	0.030	1.00	20.0-22.0	23.5-25.5		0.18-0.25			Cu 0.75
800	N08800	0.10	1.50	0.045	0.015	1.00	19.0–23.0	30.0–35.0	•••	•••			Cu 0.75 Al 0.15–0.60
													Ti 0.15–0.60 Fe ¹ 39.5 min
800H	N08810	0.05-0.10	1.50	0.045	0.015	1.00	19.0-23.0	30.0-35.0					Cu 0.75
													Al 0.15-0.60
													Ti 0.15–0.60 Fe ¹ 39.5 min
	N08811	0.06-0.10	1.50	0.045	0.015	1.00	19.0-23.0	30.0-35.0					Cu 0.75
													Al 0.15–0.60 ³ Ti 0.15–0.60 ³ Fe ³ 39.5 min
	N08904	0.020	2.00	0.040	0.030	1.00	19.0-23.0	23.0-28.0	4.0-5.0	0.10			Cu 1.00-2.00
	N08925	0.020	1.00	0.045	0.030	0.50	19.0-21.0	24.0-26.0	6.0-7.0	0.10-0.20			Cu 0.80-1.50
	N08926	0.020	2.00	0.030	0.010	0.50	19.0-21.0	24.0-26.0	6.0-7.0	0.15-0.25			Cu 0.50-1.50
TP444	S44400	0.03	1.00	0.040	0.030	1.00	17.5-19.5	K	1.75-2.50	0.035		L	

Amaximum, unless a range or minimum is indicated. Where ellipses (...) appear in this table, there is no minimum and analysis for the element need not be determined or reported.

^BThe method of analysis for Nitrogen shall be a matter of agreement between the purchaser and the producer.

^CFor these alloys, there is no common grade designation. The UNS number uniquely identifies these alloys.

PFor small diameter or thin walls, or both, where many drawing passes are required, a carbon maximum of 0.040 % is necessary in Grades TP304LN, TP304LN, TP316L, and TP316LN.

EGrade S30434 shall have (Ti + ½ Nb) of not less than 2 times and not more than 4 times the carbon content.

FGrade TP347LN and S34752 shall have an Nb content of not less than 15 times the carbon content.

^GGrade TP348 shall have an Nb + Ta content of not less than 10 times the carbon content and not more than 1.10 %.

^HGrade TP348H shall have an Nb + Ta content of not less than 8 times the carbon content and not more than 1.10 %.

fron shall be determined arithmetically by difference of 100 minus the sum of the other specified elements.

^JAl + Ti shall be 0.85 % min; 1.20 % max.

^KGrade TP444 shall have Ni + Cu = 1.00 max.

^LGrade TP444 shall have Ti + Nb content not less than 0.20 + 4(C+N) and not more than 0.80 %.

^MN08020 shall have an Nb + Ta content of not less than 8 times the carbon content and not more than 1.00%.

^NThe terms Niobium (Nb) and Columbium (Cb) are alternative names for the same element.

 $^{^{\}circ}$ UNS S31043 shall have a Nb + 1/2Ta content of 0.30 to 0.60 %.

^P UNS designation S31740 steel shall have a niobium content of not less than 15 times the carbon content.

TABLE 3 Heat Treatment and Grain Size Requirements $^{\!A}$

Grade	UNS Number	Heat Treat Type	Austenitizing/ Solutioning/ Stabilizing Temperature, min or range °F [°C]	Cooling Media	Subcritical Annealing or Tempering Temperature, min or range °F [°C]	ASTM Grain Size No. ^B
			Ferritic Alloy Steels	3		
Γ2	K11547	full or isothermal				
		anneal; or				
		normalize and				
		temper; or			1000 +- 1000	
		subcritical anneal		•••	1200 to 1350	
5	K41545	full or isothermal			[650 to 730]	
5	11343	anneal; or		•••		
		normalize and			1250 [675]	
		temper				
5b	K51545	full or isothermal	***	***	***	***
		anneal; or				
		normalize and	***	***	1250 [675]	***
_	144045	temper			1050 5300	
5c	K41245	subcritical anneal		air or furnace	1350 [730] ^C	
9	K90941	full or isothermal		***	•••	
		anneal; or normalize and			1250 [675]	
		temper	***	***	1230 [073]	***
11	K11597	full or isothermal				
	1111007	anneal; or		•••		•••
		normalize and			1200 [650]	
		temper				
12	K11562	full or isothermal		•••		
		anneal; or				
		normalize and	***	***	***	***
		temper; or				
		subcritical anneal			1200 to 1350	
					[650 to 730]	
17	K12047	full or isothermal				
		anneal; or			1000 [650]	
		normalize and		•••	1200 [650]	
21	K31545	temper full or isothermal				
21	101040	anneal; or		***	•••	
		normalize and			1250 [675]	
		temper				
22	K21590	full or isothermal		•••		
		anneal; or				
		normalize and	***	***	1250 [675]	
		temper				
23	K40712	normalize and	1900–1975	•••	1350–1470 [730–800]	
2.4	1400700	temper	[1040–1080]	D	1050 1100 [700 770]	
24	K30736	normalize and	1800–1870	D	1350–1420 [730–770]	
00	1404004	temper	[980–1020]	E	4400 [505]	
36	K21001	normalize and	1650 [900]	_	1100 [595]	
91 Types 1 and 2	K90901	temper normalize and	1900–1975		1350-1470 [730-800]	
31 Types Tand 2	130301	temper	[1040–1080]	***	1000-1470 [700-000]	
92	K92460	normalize and	1900–1975		1350-1470 [730-800]	
02	1102 100	temper	[1040–1080]		1000 1110 [100 000]	•••
93	K91350	normalize and	1960–2140		1380-1455 [750-790]	
		temper	[1070-1170]			
115	K91060	normalize and	1920–2010	•••	1380-1455	
		temper	[1050-1100]		[750–790]	
122	K91261	normalize and	1900–1975		1350–1470 [730–800]	
		temper	[1040–1080]			
128	K91421	normalize and	1975–2140	air	1400–1470	***
244	1/04064	temper	[1080–1170]	D	[760–800]	
911	K91061	normalize and	1900–1975	D	1365–1435	
001	K01001	temper	[1040–1080]	0:-	[740–780]	
921	K91201	normalize and temper	1670–1740 [910–950]	air	1350–1420 [730-770]	•••
		terriper	[910–950] Austenitic Stainless St	aals	[730-770]	
P201	S20100	solution treatment		water or other rapid cool		
P202	S20200	solution treatment		water or other rapid cool		
M-19	S20200 S20910	solution treatment		water or other rapid cool		
-	S21500	solution treatment		water or other rapid cool		***
	S25700	solution treatment		water or other rapid cool		
P304	S30400	solution treatment		water or other rapid cool	***	

TABLE 3 Continued

Grade	UNS Number	Heat Treat Type	Austenitizing/ Solutioning/ Stabilizing Temperature, min or range °F [°C]	Cooling Media	Subcritical Annealing or Tempering Temperature, min or range °F [°C]	ASTM Grain Size No. ^B
ΓP304L	S30403	solution treatment	1900 [1040] ^F	water or other rapid cool		
TP304H	S30409	solution treatment	1900 [1040]	water or other rapid cool		7
	S30432	solution treatment	2000 [1100] ^F	water or other rapid cool		***
	S30434	solution treatment	2120 [1160]	water or other rapid cool		
P304N	S30451	solution treatment	1900 [1040] ^F _	water or other rapid cool		
P304LN	S30453	solution treatment	1900 [1040] ^F	water or other rapid cool	•••	•••
	S30615	solution treatment	1900 [1040]	water or other rapid cool		
DOOOO	S30815	solution treatment	1920 [1050]	water or other rapid cool	•••	***
P309S P309H	S30908 S30909	solution treatment solution treatment	1900 [1040] ^F 1900 [1040]	water or other rapid cool water or other rapid cool	•••	 7
P309LMoN	S30909 S30925	solution treatment	1920 [1050]	water or other rapid cool	•••	7
P309Cb	S30940	solution treatment	1900 [1040] ^F	water or other rapid cool	•••	
P309HCb	S30941	solution treatment	1900 [1040] ^H	water or other rapid cool	•••	 7
1 0031105	S30942	solution treatment	2120 [1160]	water or other rapid cool	***	6
	S31002	solution treatment	1900 [1040] ^F	water or other rapid cool		
P310S	S31008	solution treatment	1900 [1040] ^F	water or other rapid cool		
P310H	S31009	solution treatment	1900 [1040]	water or other rapid cool		7
P310MoCbN	S31025	solution treatment	2100 [1150]	water or other rapid cool	•••	7
	S31035	solution treatment	2160–2280 [1180–1250]	water or other rapid cool		
P310Cb	S31040	solution treatment	1900 [1040] ^F	water or other rapid cool	***	
P310HCb	S31041	solution treatment	1900 [1040] ^H	water or other rapid cool	•••	7
P310HCbN	S31042	solution treatment	1900 [1040] ^{F,H}	water or other rapid cool	•••	7
***	S31043	solution treatment	1900 [1040] ^{F,H}	water or other rapid cool	•••	7
P310MoLN	S31050	solution treatment	1900 [1040] ^F	water or other rapid cool	***	
	S31060	solution treatment	1975–2160 [1080–1180] ^{<i>F</i>}	water or other rapid cool		7
	S31254	solution treatment	2100 [1150]	water or other rapid cool	•••	•••
	S31266	solution treatment	2100 [1150]	water or other rapid cool		***
	S31272	solution treatment	1920 [1050]	water or other rapid cool		***
	S31277	solution treatment	2050 [1120] ^F	water or other rapid cool	•••	•••
P316	S31600	solution treatment	1900 [1040]	water or other rapid cool		•••
P316L	S31603	solution treatment	1900 [1040] ^F	water or other rapid cool		
P316H	S31609	solution treatment	1900 [1040]	water or other rapid cool		7
P316Ti	S31635	solution treatment	1900 [1040]	water or other rapid cool		***
P316N	S31651	solution treatment	1900 [1040] ^F	water or other rapid cool		***
P316LN P317	S31653 S31700	solution treatment	1900 [1040] ^F 1900 [1040] ^F	water or other rapid cool water or other rapid cool		•••
P317L	S31700 S31703	solution treatment solution treatment	1900 [1040] ^F	water or other rapid cool	•••	***
F317L	S31705 S31725	solution treatment	1900 [1040]	water or other rapid cool	•••	***
	S31730	solution treatment	1900 [1040] ^F	water or other rapid cool	•••	•••
	S31740	solution treatment	1900 [1040] ^F	water or other rapid cool		•••
	S32050	solution treatment	2100 [1150] ^F	water or other rapid cool		•••
P321	S32100	solution treatment	1900 [1040] ^{F,H}	water or other rapid cool	***	***
P321H	S32109	solution treatment	cold worked: 2000 [1090] hot rolled:	water or other rapid cool		7
			1925 [1050] ^H			
	S32615	solution treatment	1900 [1040] ^F	water or other rapid cool	•••	3 or finer
	S32716	solution treatment	1900 [1040] ^F	water or other rapid cool	***	
	S33228	solution treatment	2050 [1120]	water or other rapid cool		
D0.4=	S34565	solution treatment	2050–2140 [1120–1170]	water or other rapid cool		
P347	S34700	solution treatment	1900 [1040] ^{F,H}	water or other rapid cool	•••	
P347W	S34705	solution treatment	2000 [1100]	water or other rapid cool		7-10
P347H	S34709	solution treatment	cold worked: 2000 [1100] hot rolled: 1925 [1050] ^H	water or other rapid cool		7
P347HFG	S34710	solution treatment,1	2150 [1175] ^F	water or other rapid cool		7-10
P347LN	S34751	solution treatment	1900 [1040] ^F	water or other rapid cool	•••	***
	S34752	solution treatment	1940-2138 [1060-1170]	Water or other rapid cool		
P348	S34800	solution treatment	1900 [1040] ^{F,H}	water or other rapid cool	***	
P348H	S34809	solution treatment	cold worked: 2000 [1100] hot rolled:	water or other rapid cool		7
	\$35045	colution treatment	1925 [1050] ^H	etill air cool or factor		
	S35045	solution treatment	2000 [1100] ⁻ _	still air cool or faster	•••	***
M-15	S38100	solution treatment	1900 [1040] ^F	water or other rapid cool		

TABLE 3 Continued

Grade	UNS Number	Heat Treat Type	Austenitizing/ Solutioning/ Stabilizing Temperature, min or range °F [°C]	Cooling Media	Subcritical Annealing or Tempering Temperature, min or range °F [°C]	ASTM Grain Size No. ^B
Alloy 20	N08020	stabilization	1700-1850	water or other rapid cool		
		treatment	[925-1010] ^F _			
	N08028	solution treatment	2000 [1100] ^F	water or other rapid cool	•••	
	N08029	solution treatment	2000 [1100] ^F	water or other rapid cool		***
	N08367	solution treatment	2025 [1105] ^F	water or other rapid cool	•••	***
800	N08800	solution treatment	1900 [1040] ^F	water or other rapid cool	•••	***
800H	N08810	solution treatment	2050 [1120] ^F	water or other rapid cool		5
	N08811	solution treatment	2100 [1150] ^F	water or other rapid cool	•••	5
	N08904	solution treatment	2000 [1100] ^F	water or other rapid cool	•••	***
	N08925	solution treatment	2010-2100	water or other rapid cool	•••	***
			[1100-1150]			
	N08926	solution treatment	2010–2100	water or other rapid cool	•••	***
			[1100-1150]			
			Ferritic Stainless St	eels		
TP444	S44400	subcritical anneal	***	•••	1400 [760]	***

^A Where ellipses (...) appear in this table there is no requirement.

- 4.1.7 Size (outside diameter and minimum wall thickness, unless average wall thickness is specified),
 - 4.1.8 Length (specific or random),
- 4.1.9 Hydrostatic Test or Nondestructive Electric Test (see 10.1).
 - 4.1.10 Specification designation and year of issue,
- 4.1.11 Increased sulfur (for machinability, see Note B, Table 1, and 16.3), and
- 4.1.12 Special requirements and any supplementary requirements selected.

5. General Requirements

5.1 Product furnished to this specification shall conform to the requirements of Specification A1016/A1016M, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A1016/A1016M constitutes nonconformance with this specification. In case of conflict between the requirements of this specification and Specification A1016/A1016M, this specification shall prevail.

6. Materials and Manufacture

- 6.1 *Manufacture and Condition*—Tubes shall be made by the seamless process and shall be either hot finished or cold finished, as specified. Grade TP347HFG shall be cold finished.
 - 6.2 Heat Treatment:
- 6.2.1 Ferritic Alloy and Ferritic Stainless Steels—The ferritic alloy and ferritic stainless steels shall be reheated for heat

- treatment in accordance with the requirements of Table 3. Heat treatment shall be carried out separately and in addition to heating for hot forming.
- 6.2.2 Austenitic Stainless Steels—All austenitic tubes shall be furnished in the heat-treated condition, and shall be heat treated in accordance with the requirements of Table 3. Other than for Grades S30815, S30942, S31272, S33228, S30432, and H grades, seamless tubing immediately following hot forming may be individually quenched in water or rapidly cooled by other means (direct quenched), provided that the temperature of the tubes after hot forming is not less than the minimum specified heat treatment temperatures. For H grades, as well as Grades S30815, S30942, S31272, S33228, and S30432, the tubes shall be reheated to the specified heat treatment temperature for the required time before quenching.
- 6.3 If any controlled structural characteristics are required, these shall be so specified in the order as to be a guide as to the most suitable heat treatment.

7. Chemical Composition

- 7.1 Composition Requirements:
- 7.1.1 The alloy steels shall conform to the chemical requirements given in Table 1.
- 7.1.2 The stainless steels shall conform to the chemical requirements given in Table 2.
 - 7.2 Product Analysis:

^B ASTM Grain Size No. listed, or coarser, unless otherwise indicated

^C Approximately, to achieve properties.

D Accelerated cooling from the normalizing temperature shall be permitted for section thicknesses greater than 3 in. [75 mm].

EAccelerated air cooling or liquid quenching shall be permitted for Class 2.

F Quenched in water or rapidly cooled by other means, at a rate sufficient to prevent re-precipitation of carbides, as demonstrable by the capability of tubes, heat treated by either separate solution annealing or by direct quenching, passing Practices A262, Practice E. The manufacturer is not required to run the test unless it is specified on the purchase order (see Supplementary Requirement S4). Note that Practices A262 requires the test to be performed on sensitized specimens in the low-carbon and stabilized types and on specimens representative of the as-shipped condition for other types. In the case of low-carbon types containing 3 % or more molybdenum, the applicability of the sensitizing treatment prior to testing shall be a matter for negotiation between the seller and the purchaser.

^G A maximum solution treating temperature of 2100 °F [1150 °C] is recommended for UNS S21500.

^H A solution treating temperature above 1950 °F [1065 °C] may impair resistance to intergranular corrosion after subsequent exposure to sensitizing conditions in the indicated grades. When specified by the purchaser, a lower temperature stabilization or resolution anneal shall be used subsequent to the higher-temperature solution anneal prescribed in this table.

⁷ Solution treatment shall be preceded by a softening heat treatment prior to cold-working. The softening temperature shall be at least 90 °F [50 °C] higher than the solution heat treatment temperature, which shall be at 2150 °F [1180 °C] minimum.

- 7.2.1 An analysis of either one billet or one tube shall be made from each heat. The chemical composition thus determined shall conform to the requirements specified.
- 7.2.2 If the original test for product analysis fails, retests of two additional billets or tubes shall be made. Both retests, for the elements in question, shall meet the requirements of the specification; otherwise all remaining material in the heat shall be rejected or, at the option of the producer, each billet or tube may be individually tested for acceptance. Billets or tubes that do not meet the requirements of the specification shall be rejected.

8. Grain Size

- 8.1 Grain size shall be as given in Table 3, as determined in accordance with Test Methods E112.
- 8.2 Grain size determinations, to demonstrate compliance with 8.1, shall be made on one end of one finished tube from each lot. See 15.1.

9. Mechanical Properties

- 9.1 Tensile Requirements:
- 9.1.1 The material shall conform to the requirements as to tensile properties given in Table 4.
- 9.1.2 Table 5 gives the computed minimum elongation values for each $\frac{1}{32}$ -in. [0.8-mm] decrease in wall thickness. Where the wall thickness lies between two values shown in Table 5, the minimum elongation value shall be determined by the following equations. For Grades T23, T24, T91, T92, T115, T122, T128, T911, T921, and S44400: E = 32t + 10.00 [E = 1.25t + 10.00]. For Grade T36: E = 32t + 5.0 [E = 1.25t + 5.0]. For grade T93: E = 32t + 9.00 [E = 1.25t + 9.00]. For all other ferritic alloy grades: E = 48t + 15.00 [E = 1.87t + 15.00].

where:

E = elongation in 2 in. [50 mm], %, and

t = actual thickness of specimen, in. [mm].

- 9.1.3 One tension test shall be made on a specimen from one tube for lots of not more than 50 tubes. Tension tests shall be made on specimens from two tubes for lots of more than 50 tubes. See 15.2.
 - 9.2 Hardness Requirements:
- 9.2.1 The material shall conform to the hardness requirements given in Table 4. See 15.2.
- 9.2.2 Brinell, Vickers, or Rockwell hardness tests shall be made on specimens from two tubes from each lot. See 15.2.
- 9.3 Flattening Test—One flattening test shall be made on specimens from each end of one finished tube, not the one used for the flaring test, from each lot. See 15.1.
- 9.4 Flaring Test—One flaring test shall be made on specimens from each end of one finished tube, not the one used for the flattening test, from each lot. See 15.1.
- 9.5 Mechanical property requirements do not apply to tubing smaller than ½ in. [3.2 mm] in inside diameter or thinner than 0.015 in. [0.4 mm] in thickness.

10. Hydrostatic or Nondestructive Electric Test

10.1 Each tube shall be subjected to the nondestructive electric test or the hydrostatic test. The type of test to be used

shall be at the option of the manufacturer, unless otherwise specified in the purchase order.

11. Forming Operations

11.1 Tubes, when inserted in a boiler or tube sheet, shall stand expanding and beading without showing cracks or flaws. Superheater tubes when properly manipulated shall stand all forging, welding, and bending operations necessary for application without developing defects. See Note 1.

Note 1—Certain of the ferritic steels covered by this specification will harden if cooled rapidly from above their critical temperature. Some will air harden, that is, become hardened to an undesirable degree when cooled in air from high temperatures, particularly chromium-containing steels with chromium of 4% and higher. Therefore, operations that involve heating such steels above their critical temperatures, such as welding, flanging, and hot bending, should be followed by suitable heat treatment.

12. Repair by Welding

- 12.1 Repair welding shall be performed in conformance with Specification A1016/A1016M.
- 12.2 All repair welds in T91 shall be made with one of the following welding processes and consumables: SMAW, A5.5/A5.5M E90XX-B9; SAW, A5.23/A5.23M EB9 + neutral flux; GTAW, A5.28/A5.28M ER90S-B9; and FCAW A5.29/A5.29M E91T1-B9. In addition, the sum of the Ni+Mn content of all welding consumables used to weld repair T91 Types 1 and 2 shall not exceed 1.0 %.
- 12.3 All repair welds in T92, T93, T911, and T122, shall be made using welding consumables meeting the chemical requirements for the grade in Table 1.

13. Permissible Variations from the Specified Wall Thickness

- 13.1 Permissible variations from the specified minimum wall thickness shall be in accordance with Specification A1016/A1016M.
- 13.2 Permissible variations from the specified average wall thickness shall be \pm 10% of the specified average wall thickness for cold formed tubes and, unless otherwise specified by the purchaser, shall be in accordance with Table 6 for hot formed tubes.

14. Surface Condition

- 14.1 Ferritic alloy cold-finished steel tubes shall be free of scale and suitable for inspection. A slight amount of oxidation is not considered scale.
- 14.2 Ferritic alloy hot-finished steel tubes shall be free of loose scale and suitable for inspection.
- 14.3 Stainless steel tubes shall be pickled free of scale. When bright annealing is used, pickling is not necessary.
- 14.4 Any special finish requirement shall be subject to agreement between the supplier and the purchaser.

15. Sampling

15.1 For flattening, flaring, and grain size requirements, the term lot applies to all tubes, prior to cutting, of the same size (see 4.1.7) that are produced from the same heat of steel. When

TABLE 4 Tensile and Hardness Requirements

			and nardness neq		Hardness ^A		
Grade	UNS Designation	Tensile Strength, min, ksi [MPa]	Yield Strength, min, ksi [MPa]	Elongation in 2 in. or 50 mm, min, % ^{B,C}	Brinell/Vickers	Rockwell	
Low Alloy Steels: T5b	K51545	60 [415]	30 [205]	30	179 HBW/	89 HRB	
Т9	K90941	60 [415]	30 [205]	30	190HV 179 HBW/	89 HRB	
T12	K11562	60 [415]	32 [220]	30	190HV 163 HBW/	85 HRB	
T23	K40712	74 [510]	58 [400]	20	170 HV 220 HBW/	97 HRB	
Γ24	K30736	85 [585]	60 [415]	20	230 HV 250 HBW/	25 HRC	
T36 Class 1	K21001	90 [620]	64 [440]	15	265 HV 250 HBW/	25 HRC	
Γ36 Class 2	K21001	95.5 [660]	66.5 [460]	15	265 HV 250 HBW/ 265 HV	25 HRC	
Γ91 Types 1 and 2	K90901	85 [585]	60 [415]	20	190 to 250 HBW/ 196 to 265 HV	90 HRB to 25 HRC	
Т92	K92460	90 [620]	64 [440]	20	250 HBW/ 265 HV	25 HRC	
Т93	K91350	90 [620]	64 [440]	19	250 HBW/ 265 HV	25 HRC	
T115	K91060	90 [620]	65 [450]	20	190 to 250 HWB/	90 HRB to 25	
Γ122	K91271	90 [620]	58 [400]	20	196 to 265 HV 250 HBW/	HRC 25 HRC	
T128 T911	K91421 K91061	94 [650] 90 [620]	71 [490] 64 [440]	20 20	265 HV 265HBW/280HV 250 HBW/	27HRC 25 HRC	
T921	K91001	109 [750]		20	265 HV	25 HRC 26 HRC	
1921	K91201	109 [750]	84 [580]	20	276 HBW/ 290 HV	20 HNC	
All other low alloy grades		60 [415]	30 [205]	30	163 HBW/ 170 HV	85 HRB	
Austenitic Stainless							
Steels: TP201	S20100	95 [655]	38 [260]	35	219 HBW/ 230 HV	95 HRB	
TP202	S20200	90 [620]	45 [310]	35	230 HV 219 HBW/ 230 HV	95 HRB	
XM-19	S20910	100 [690]	55 [380]	35	250 HBW/ 265 HV	25 HRC	
	S21500	78 [540]	33 [230]	35	192 HBW/ 200 HV	90 HRB	
 TP304	S25700 S30400	78 [540]	35 [240]	50 35	217 HBW 192 HBW/	95 HRB 90 HRB	
TP304L	S30400	75 [515] 70 [485]	30 [205]	35	200 HV 192 HBW/	90 HRB	
	S30403		25 [170]		200 HV	90 HRB	
ГР304Н		75 [515]	30 [205]	35	192 HBW/ 200 HV		
	S30432	86 [590]	34 [235]	35	219 HBW/ 230 HV	95 HRB	
	S30434	73 [500]	30 [205]	35	192 HBW/ 200 HV	90 HRB	
TP304N	S30451	80 [550]	35 [240]	35	192 HBW/ 200 HV	90 HRB	
TP304LN	S30453	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB	
	S30615	90 [620]	40 [275]	35	192 HBW/ 200 HV	90 HRB	
 TP309S	S30815 S30908	87 [600] 75 [515]	45 [310] 30 [205]	40 35	217 HBW 192 HBW/	95 HRB 90 HRB	
TP309H	S30909	75 [515]	30 [205]	35	200 HV 192 HBW/	90 HRB	
TP309LMoN	S30925	93 [640]	38 [260]	30	200 HV 256 HBW/270 HV	100 HRB	
TP309Cb	S30940	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB	
TP309HCb	S30941	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB	

TABLE 4 Continued

		TA	BLE 4 Continued			
	UNS	Tensile Strength,	Yield Strength,	Elongation in 2 in. or	Hardnes	
Grade	Designation	min, ksi [MPa]	min, ksi [MPa]	50 mm, min, % ^{B,C}	Brinell/Vickers	Rockwell
	S30942	86 [590]	34 [235]	35	219 HBW/	95 HRB
	S31002	73 [500]	30 [205]	35	230 HV 192 HBW/ 200 HV	90 HRB
TP310S	S31008	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP310H	S31009	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP310MoCbN	S31025	93 [640]	39 [270]	30	256 HBW/ 270 HV	100 HRB
	S31035	95 [655]	45 [310]	40	220 HBW/ 230 HV	96 HRB
TP310Cb	S31040	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP310HCb	S31041	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP310HCbN	S31042	95 [655]	43 [295]	30	256 HBW	100 HRB
TP310MoLN	S31043 S31050	95 [655]	43 [295]	30	256 HBW	100 HRB
$T \leq 0.25$ in. [6 mm]	22.300	84 [580]	39 [270]	25	217 HBW	95 HRB
t > 0.25 in. [6 mm]	004000	78 [540]	37 [255]	25	217 HBW	95 HRB
	S31060 S31254	87 [600]	41 [280]	40	217 HBW	95 HRB
T ≤ 0.187 in. [5 mm]	001234	98 [675]	45 [310]	35	220 HBW/ 230 HV	96 HRB
T > 0.187 in. [5 mm]		95 [655]	45 [310]	35	220 HBW/ 230 HV	96 HRB
	S31266	109 [750]	61 [420]	35		B100
	S31272 S31277	65 [450] 112 [770]	29 [200] 52 [360]	35 40	217 HBW 241 HBW	95 HRB 100 HRB
 TP316	S31600	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP316L	S31603	70 [485]	25 [170]	35	192 HBW/ 200 HV	90 HRB
TP316H	S31609	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP316Ti	S31635	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP316N	S31651	80 [550]	35 [240]	35	192 HBW/ 200 HV	90 HRB
TP317	S31700	75 [515]	30 [205]	34	192 HBW/ 200 HV	90 HRB
TP317L	S31703 S31725	75 [515]	30 [205]	35 35	192 HBW/ 200 HV	90 HRB 90 HRB
		75 [515]	30 [205]		192 HBW/ 200 HV	
	S31730 S31740	70 [480] 75 [515]	25 [175] 30 [205]	35 35	 192 HBW/	90 HRB 90 HRB
	S32050	98 [675]	48 [330]	40	200 HV 256 HBW	100 HRB
TP321	S32100	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP321H	S32109	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
	S32615	80 [550]	32 [220]	25	192 HBW/ 200 HV	90 HRB
	S32716	80 [550]	35 [240]	35	192 HBW/ 200 HV	90 HRB
	S33228	73 [500]	27 [185]	30	192 HBW/ 200 HV	90 HRB
 TP347	S34565 S34700	115 [790] 75 [515]	60 [415] 30 [205]	35 35	241 HBW 192 HBW/ 200 HV	100 HRB 90 HRB
TP347W	S34705	90 [620]	38 [260]	30	200 HV 219 HBW/ 230 HV	95 HRB
TP347H	S34709	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP347HFG	S34710	80 [550]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP347LN	S34751	75 [515]	30 [205]	35	200 HV 192 HBW/ 200 HV	90 HRB

TABLE 4 Continued

					Hardnes	s ^A
Grade	UNS Designation	Tensile Strength, min, ksi [MPa]	Yield Strength, min, ksi [MPa]	Elongation in 2 in. or 50 mm, min, % ^{B,C}	Brinell/Vickers	Rockwell
	S34752	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP348	S34800	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
TP348H	S34809	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
	S35045	70 [485]	25 [170]	35	192 HBW/ 200 HV	90 HRB
XM-15	S38100	75 [515]	30 [205]	35	192 HBW/ 200 HV	90 HRB
	S38815	78 [540]	37 [255]	30	256 HBW	100 HRB
Alloy 20	N08020	80 [550]	35 [240]	30	217 HBW	95 HRB
	N08028 N08029	73 [500] 73 [500]	31 [214] 31 [214]	40 40		
	N08367 ≤3/16 in. wall	 100 [690]	 45 [310]	 30		 100 HRB
 800	>3/16 in. wall N08800	95 [655]	45 [310]	30	241 HBW	
	cold-worked annealed	75 [515]	30 [205]	30	192 HBW/ 200 HV	90 HRB
	hot-finished annealed	65 [450]	25 [170]	30	192 HBW/ 200 HV	90 HRB
800H	N08810	65 [450]	25 [170]	30	192 HBW/ 200 HV	90 HRB
	N08811	65 [450]	25 [170]	30	192 HBW/ 200 HV	90 HRB
	N08904	71 [490]	31 [215]	35	192 HBW/ 200 HV	90 HRB
	N08925	87 [600]	43 [295]	40	217 HBW	95 HRB
	N08926	94 [650]	43 [295]	35	256 HBW	100 HRB
	S44400	60[415]	40[075]	20	217 HBW/ 220 HV	96 HRB
Ferritic Stainless Steels TP444	S44400	60[415]	40[275]	20	217 HBW/ 230 HV	96

TABLE 5 Computed Minimum Values^A

Wall Thickne	ess		Elongat or 50 m		
in.	mm	S44400, T23, T24, T91 Types 1 and 2, T92, T921, T115, T122, T128, and T911	Т93	Т 36	All Other Ferritic Grades
5/16 [0.312]	8	20	19	15	30
9/32 [0.281]	7.2	19	18	14	29
1/4 [0.250]	6.4	18	17	13	27
7/32 [0.219]	5.6	17	16	12	26
3/16 [0.188]	4.8	16	15	11	24
5/32 [0.156]	4	15	14	10	23
1/8 [0.125]	3.2	14	13	9	21
3/32 [0.094]	2.4	13	12	8	20
1/16 [0.062]	1.6	12	11	7	18
0.062 to 0.035, excl	1.6 to 0.9	12	11	7	17
0.035 to 0.022, excl	0.9 to 0.6	11	10	6	17
0.022 to 0.015 incl	0.6 to 0.4	11	10	6	16

^A Calculated elongation requirements shall be rounded to the nearest whole number.

final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and from the same

AMax, unless a range or a minimum is specified.

Be When standard round 2 in. or 50 mm gauge length or smaller proportionally sized specimens with gauge length equal to 4D (4 times the diameter) is used, the minimum elongation shall be 22 % for all low alloy grades except T23, T24, T91, T92, T93, T115, T122, T128, and T911; and except for TP444.

Copyrights For longitudinal strip tests, a deduction from the basic minimum elongation values of 1.00 % for TP444, T23, T24, T91, T92, T93, T115, T122, T128, and T911, and of 1.50 % for all other low alloy grades for each 1/32-in. [0.8-mm] decrease in wall thickness below 5/16 in. [8 mm] shall be made.

TABLE 6 Permitted Variations in Average Wall Thickness for Hot Formed Tubes

	Tolerance in %, from specified				
NPS [DN] Designator	Over	Under			
1/8 to 21/2 [6 to 65] incl, all t/D ratios ^A	20	12.5			
Above $2\frac{1}{2}$ [65], $t/D \le 5 \%^A$	22.5	12.5			
Above $2\frac{1}{2}$ [65], $t/D > 5 \%^A$	15	12.5			

At = specified wall thickness D = specified outside diameter

TABLE 7 Number of Tubes in a Lot Heat Treated by the Continuous Process or by Direct Quench After Hot Forming

Size of Lot
not more than 50 tubes
not more than 75 tubes
not more than 75 tubes
not more than 125 tubes

heat that are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace or when the heat-treated condition is obtained directly by quenching after hot forming, the number of tubes of the same size and from the same heat in a lot shall be determined from the size of the tubes as prescribed in Table 7.

15.2 For tensile and hardness test requirements, the term lot applies to all tubes prior to cutting, of the same size (see 4.1.7) that are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and the same heat that are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, or when the heat-treated condition is obtained directly by quenching after hot forming, a lot shall include all tubes of the same size and heat, heat treated in the same furnace at the same temperature, time at heat, and furnace speed; or all tubes of the same size and heat, hot formed and quenched in the same production run, except as prescribed in 9.1.3.

16. Product Marking

- 16.1 In addition to the marking prescribed in Specification A1016/A1016M, the marking shall include: the condition, hot finished or cold finished; and the wall designation, minimum wall or average wall.
- 16.2 For the austenitic stainless steels having a grain size requirement (see Table 3) the marking shall also include the heat number and heat-treatment lot identification.
- 16.3 When either T2 or T12 are ordered with higher sulfur contents as permitted by Note B of Table 1, the marking shall include the letter, S, following the grade designation: T2S or T12S.
 - 16.4 For T91, the marking shall also include the type.

17. Keywords

17.1 alloy steel tubes; austenitic stainless steel; boiler tubes; ferritic stainless steel; heat exchanger tubes; high-temperature applications; seamless steel tubes; steel tubes; superheater tubes; temperature service applications-high

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall apply only when specified by the purchaser in the inquiry, contract, or order.

S1. Stress-Relieved Annealed Tubes

- S1.1 For use in certain corrosives, particularly chlorides where stress corrosion may occur, tubes in Grades TP304L, TP316L, TP321, TP347, and TP348 may be specified in the stress-relieved annealed condition.
- S1.2 When stress-relieved tubes are specified, tubes shall be given a heat treatment at 1500 to 1650 °F [815 to 900 °C] after roll straightening. Cooling from this temperature range may be either in air or by slow cooling. No mechanical straightening is permitted after the stress-relief treatment.
- S1.3 Straightness of the tubes shall be a matter of negotiation between the purchaser and supplier.

S2. Stabilizing Heat Treatment

S2.1 Subsequent to the solution anneal required in Section 6, Grades TP309HCb, TP310HCb, TP310HCbN, TP321, TP321H, TP347, TP347H, TP348, and TP348H shall be given a stabilization heat treatment at a temperature lower than that used for the initial solution annealing heat treatment. The temperature of stabilization heat treatment shall be at a temperature as agreed upon between the purchaser and vendor.

S3. Unstraightened Tubes

- S3.1 When the purchaser specifies tubes unstraightened after final heat treatment (such as coils), the minimum yield strength of Table 4 shall be reduced by 5 ksi [35 MPa].
- S3.2 On the certification, and wherever the grade designation for unstraightened tubing appears, it shall be identified with the suffix letter "U" (for example, 304-U, 321-U, etc.).

S4. Intergranular Corrosion Test

S4.1 When specified, material shall pass intergranular corrosion tests conducted by the manufacturer in accordance with Practices A262, Practice E.

Note S4.1—Practice E requires testing on the sensitized condition for low carbon or stabilized grades, and on the as-shipped condition for other grades.

S4.2 A stabilization heat treatment in accordance with Supplementary Requirement S2 may be necessary and is permitted in order to meet this requirement for the grades containing titanium or columbium, particularly in their H versions.

SPECIFICATION FOR ELECTRIC-RESISTANCE-WELDED CARBON STEEL HEAT-EXCHANGER AND CONDENSER TUBES



SA-214/SA-214M



(23)

(Identical with ASTM Specification A214/A214M-19.)

Specification for Electric-Resistance-Welded Carbon Steel Heat-Exchanger and Condenser Tubes

1. Scope

- 1.1 This specification covers minimum-wall-thickness, electric-resistance-welded, carbon steel tubes to be used for heat exchangers, condensers, and similar heat-transfer apparatus.
- 1.2 The tubing sizes usually furnished to this specification are to 3 in. [76.2 mm] in outside diameter, inclusive. Tubing having other dimensions may be furnished, provided such tubes comply with all other requirements of this specification.
- 1.3 Mechanical property requirements do not apply to tubing smaller than $\frac{1}{8}$ in. [3.2 mm] in inside diameter or 0.015 in. [0.4 mm] in thickness.
- 1.4 The purchaser shall specify in the order the outside diameter and minimum wall thickness. The inside diameter shall not be specified.
- 1.5 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.
- 1.6 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A450/A450M Specification for General Requirements for Carbon and Low Alloy Steel Tubes

3. Ordering Information

- 3.1 Orders for material under this specification should include the following, as required, to describe the desired material adequately:
 - 3.1.1 Quantity (feet, metres, or number of lengths),
 - 3.1.2 Name of material (electric-resistance-welded tubes),
 - 3.1.3 Size (outside diameter and minimum wall thickness),
 - 3.1.4 Length (specific or random),
 - 3.1.5 Optional requirements (Section 8 and 10.5),
- 3.1.6 Test report required (see Certification Section of Specification A450/A450M),
 - 3.1.7 Specification designation, and
 - 3.1.8 Special requirements.

4. General Requirements

4.1 Material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A450/A450M, unless otherwise provided herein.

5. Manufacture

5.1 Tubes shall be made by electric-resistance welding.

6. Heat Treatment

6.1 After welding, all tubes shall be heat treated at a temperature of 1650°F [900°C] or higher and followed by cooling in air or in the cooling chamber of a controlled atmosphere furnace. Cold drawn tubes shall be heat treated after the final cold-draw pass at a temperature of 1200°F [650°C] or higher.

7. Chemical Composition

7.1 The steel shall conform to the following requirements as to chemical composition:

Carbon, max % 0.18
Manganese, % 0.27 to 0.63
Phosphorus, max, % 0.035
Sulfur, max, % 0.035

7.2 Supplying an alloy grade of steel that specifically requires the addition of any element other than those listed in 7.1 is not permitted.

8. Product Analysis

- 8.1 When requested on the purchase order, a product analysis shall be made by the supplier from 1 tube per 250 pieces; when tubes are identified by heat, one tube per heat shall be analyzed. The chemical composition thus determined shall conform to the requirements specified.
- 8.2 If the original test for product analysis fails, retests of two additional lengths of flat-rolled stock, or tubes shall be made. Both retests, for the elements in question, shall meet the requirements of the specification; otherwise all remaining material in the heat or lot (Note 1) shall be rejected or, at the option of the producer, each length of flat-rolled stock or tube may be individually tested for acceptance. Lengths of flat-rolled stock or tubes which do not meet the requirements of the specification shall be rejected.

Note 1-A lot consists of 250 tubes.

9. Hardness Requirements

9.1 The tubes shall have a hardness number not exceeding 72 HRBW.

10. Mechanical Tests Required

- 10.1 Flattening Test—One flattening test shall be made on specimens from each of two tubes from each lot (Note 1) or fraction thereof.
- 10.2 Flange Test—One flange test shall be made on specimens from each of two tubes from each lot (Note 1) or fraction thereof.

- 10.3 Reverse Flattening Test—One reverse flattening test shall be made on a specimen from each 1500 ft [450 m] of finished tubing.
- 10.4 Hardness Test—Brinell or Rockwell hardness tests shall be made on specimens from two tubes from each lot. The term *lot* applies to all tubes prior to cutting, of the same nominal diameter and wall thickness which are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and the same heat which are heat treated in the same furnace charge. When final heat treatment is in a continuous furnace, a lot shall include all tubes of the same size and heat, heat treated in the same furnace at the same temperature, time at heat, and furnace speed.
- 10.5 Hydrostatic or Nondestructive Electric Test—Each tube shall be subjected to either the hydrostatic or the nondestructive electric test. The purchaser may specify which test is to be used.

11. Surface Condition

11.1 The finished tubes shall be free of scale. A slight amount of oxidation shall not be considered as scale.

12. Product Marking

- 12.1 In addition to the marking prescribed in Specification A450/A450M, the letters "ERW" shall be legibly stenciled on each tube, or marked on a tag attached to the bundle or box in which the tubes are shipped.
- 12.2 The manufacturer's name or symbol may be placed permanently on each tube by rolling or light stamping before normalizing. If a single stamp is placed on the tube by hand, this mark should not be less than 8 in. [200 mm] from one end of the tube.
- 12.3 Bar Coding—In addition to the requirements in 12.1 and 12.2 bar coding is acceptable as a supplemental identification method. The purchaser may specify in the order a specific bar coding system to be used.



SPECIFICATION FOR STEEL CASTINGS, CARBON, SUITABLE FOR FUSION WELDING FOR HIGH-TEMPERATURE SERVICE



SA-216/SA-216M

(Identical with ASTM Specification A216/A216M-07 except for the addition of 2.3 and editorial differences in 2.1 and 10.1.)

SPECIFICATION FOR STEEL CASTINGS, CARBON, SUITABLE FOR FUSION WELDING FOR HIGH-TEMPERATURE SERVICE



SA-216/SA-216M

(Identical with ASTM Specification A 216/A 216M-07 except for the addition of 2.3 and editorial differences in 2.1 and 10.1.)

1. Scope

- 1.1 This specification covers carbon steel castings for valves, flanges, fittings, or other pressure-containing parts for high-temperature service and of quality suitable for assembly with other castings or wrought-steel parts by fusion welding.
- 1.2 Three grades, WCA, WCB, and WCC, are covered in this specification. Selection will depend upon design and service conditions, mechanical properties, and the high temperature characteristics.
- 1.3 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification.

2. Referenced Documents

- **2.1** ASTM Standards:
- A 703/A 703M Specification for Steel Castings, General Requirements, for Pressure-Containing Parts
- A 985/A 985M Specification for Steel Investment Castings General Requirements, for Pressure-Containing Parts
- E 165 Test Method for Liquid Penetrant Examination E 709 Guide for Magnetic Particle Examination
- **2.2** Manufacturers' Standardization Society of the Valve and Fittings Industry Standard:
- SP 55 Steel Castings for Valve, Flanges, and Fittings, and Other Components (Visual Method)
 - **2.3** ASME Standard:
- ASME Boiler and Pressure Vessel Code, Section IX, Welding and Brazing Qualifications

3. General Conditions for Delivery

- **3.1** Except for investment castings, castings furnished to this specification shall conform to the requirements of Specification A 703/A 703M, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A 703/A 703M constitutes nonconformance with this specification. In case of conflict between the requirements of this specification and Specification A 703/A 703M, this specification shall prevail.
- **3.2** Steel investment castings furnished to this specification shall conform to the requirements of Specification A 985/A 985M, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A 985/A 985M constitutes nonconformance with this specification. In case of conflict between the requirements of this specification and Specification A 985/A 985M, Specification A 985/A 985M shall prevail.

4. Ordering Information

- **4.1** The inquiry and order should include or indicate the following:
- **4.1.1** A description of the casting by pattern number or drawing (dimensional tolerances shall be included on the casting drawing),
 - **4.1.2** Grade of steel,
 - **4.1.3** Options in the specification,
- **4.1.4** Whether the castings are to be produced using the investment casting process, and
- **4.1.5** The supplementary requirements desired including the standards of acceptance.

5. Heat Treatment

- **5.1** All castings shall receive a heat treatment proper to their design and chemical composition.
- **5.2** Castings shall be furnished in the annealed, or normalized, or normalized and tempered condition unless Supplementary Requirement S15 is specified.
- **5.3** Heat treatment shall be performed after castings have been allowed to cool below the transformation range.

6. Temperature Control

6.1 Furnace temperatures for heat treating shall be effectively controlled by pyrometer.

7. Chemical Composition

7.1 The steel shall be in accordance with the requirements as to chemical composition prescribed in Table 1.

8. Tensile Requirements

8.1 Steel used for the castings shall be in accordance with the requirements as to tensile properties prescribed in Table 2.

9. Quality

9.1 The surface of the casting shall be examined visually and shall be free of adhering sand, scale, cracks, and hot tears. Other surface discontinuities shall meet the visual acceptance standards specified in the order. Visual Method SP-55 or other visual standards may be used to define acceptable surface discontinuities and finish. Unacceptable visual surface discontinuities shall be removed and their removal verified by visual examination of the resultant cavities.

- **9.2** When additional inspection is desired, Supplementary Requirements S4, S5, and S10 may be ordered.
- **9.3** The castings shall not be peened, plugged, or impregnated to stop leaks.

10. Repair by Welding

- **10.1** Repairs shall be made using procedures and welders qualified under ASME Section IX.
- 10.2 Weld repairs shall be inspected to the same quality standards that are used to inspect the castings. When castings are produced with Supplementary Requirement S4 specified, weld repairs shall be inspected by magnetic particle examination to the same standards that are used to inspect the castings. When castings are produced with Supplementary Requirement S5 specified, weld repairs on castings that have leaked on hydrostatic test, or on castings in which the depth of any cavity prepared for repair welding exceeds 20% of the wall thickness or 1 in. [25 mm], whichever is smaller, or on castings in which any cavity prepared for welding is greater than approximately 10 in.² [65 cm²], shall be radiographed to the same standards that are used to inspect the castings.
- 10.3 Castings containing any repair weld that exceeds 20% of the wall thickness or 1 in. [25 mm], whichever is smaller, or that exceeds approximately 10 in.² [65 cm²] in area, or that was made to correct hydrostatic test defects, shall be stress relieved or heat treated after welding. This mandatory stress relief or heat treatment shall be in accordance with the procedure qualification used.

11. Keywords

11.1 carbon steel; high temperature; pressure-containing parts; steel castings

TABLE 1
CHEMICAL REQUIREMENTS

		Composition, %	
Element	Grade WCA UNS J02502	Grade WCB UNS J03002	Grade WCC UNS J02503
Carbon, max	0.25 ^A	0.30 ^{<i>B</i>}	0.25 ^C
Manganese, max	0.70^{A}	1.00 ^B	1.20 ^C
Phosphorus, max	0.04	0.04	0.04
Sulfur, max	0.045	0.045	0.045
Silicon, max	0.60	0.60	0.60
Specified residual elements:			
Copper, max	0.30	0.30	0.30
Nickel, max	0.50	0.50	0.50
Chromium, max	0.50	0.50	0.50
Molybdenum, max	0.20	0.20	0.20
Vanadium, max	0.03	0.03	0.03
Total of these specified residual elements, \max^D	1.00	1.00	1.00

^A For each reduction of 0.01% below the specified maximum carbon content, an increase of 0.04% manganese above the specified maximum will be permitted up to a maximum of 1.10%.

TABLE 2
TENSILE REQUIREMENTS

	Grade WCA	Grade WCB	Grade WCC
Tensile strength, ksi [MPa] Yield strength, min,	60 to 85 [415 to 585] 30 [205]	70 to 95 [485 to 655] 36 [250]	70 to 95 [485 to 655] 40 [275]
ksi [MPa] Elongation in 2 in. [50 mm], min, % ^B	24	22	22
Reduction of area, min, %	35	35	35

 $^{^{\}it A}$ Determine by either 0.2% offset method or 0.5% extension-under-load method.

 $^{^{\}it B}$ For each reduction of 0.01% below the specified maximum carbon content, an increase of 0.04% Mn above the specified maximum will be permitted up to a maximum of 1.28%.

 $^{^{\}it C}$ For each reduction of 0.01% below the specified maximum carbon content, an increase of 0.04% manganese above the specified maximum will be permitted to a maximum of 1.40%.

^D Not applicable when Supplementary Requirement S11 is specified.

 $^{^{\}it B}$ When ICI test bars are used in tensile testing as provided for in Specification A 703/A 703M, the gage length to reduced section diameter ratio shall be 4 to 1.

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall not apply unless specified in the purchase order. A list of standardized supplementary requirements for use at the option of the purchaser is included in Specification A 703/A 703M. Those which are ordinarily considered suitable for use with this specification are given below. Others enumerated in Specification A 703/A 703M may be used with this specification upon agreement between the manufacturer and purchaser.

- S1. Unspecified Elements
- S2. Destruction Tests
- S3. Bend Test
- S4. Magnetic Particle Inspection
- S5. Radiographic Inspection

S10. Examination of Weld Preparation

S10.1 The method of performing the magnetic particle or liquid penetrant test shall be in accordance with Guide E 709 or Test Method E 165.

S11. Carbon Equivalent

S11.1 When specified on the order, the maximum carbon equivalent shall be:

Grade	Carbon Equivalent, max
WCA	0.50
WCB	0.50
WCC	0.55

S11.2 Carbon equivalent (*CE*) shall be determined as follows:

$$CE = C + \frac{Mn}{6} + \frac{Cr + Mo + V}{5} + \frac{Ni + Cu}{15}$$

S15. Quench and Temper Heat-Treatment

S16. Requirements for Carbon Steel Castings for Hydrofluoric Acid Alkylation Service

S16.1 Castings shall be provided in the normalized or normalized and tempered heat-treated condition.

S16.2 The maximum carbon equivalent shall be as follows:

	CE maximum
Maximum specified section thickness less	
than or equal to 1 in. [25 mm]	0.43
Maximum specified section thickness	
greater than 1 in. [25 mm]	0.45

S16.3 Determine the carbon equivalent (*CE*) as follows:

$$CE = C + \frac{Mn}{6} + \frac{(Cr + Mo + V)}{5} + \frac{(Ni + Cu)}{15}$$

S16.4 Vanadium and niobium maximum content based upon heat analysis shall be:

NOTE 1 — Niobium = columbium

Maximum vanadium	0.02 wt%
Maximum niobium	0.02 wt%
Maximum vanadium plus niobium	0.03 wt%

- **S16.5** The sum of the nickel and copper contents, based upon heat analysis, shall not exceed 0.15 wt%.
- **S16.6** The minimum carbon content shall be 0.18 wt%. The maximum carbon content shall be as required for the appropriate grade.
- **S16.7** Welding consumables for repair welds shall be of the low-hydrogen type. E60XX electrodes shall not be used and the resulting weld chemistry shall meet the same chemistry requirements as the base metal.
- **S16.8** In addition to the requirements for product marking in the specification, an "HF-N" stamp or marking shall be provided on each casting to identify that the casting complies with this supplementary requirement.



SPECIFICATION FOR STEEL CASTINGS, MARTENSITIC STAINLESS AND ALLOY, FOR PRESSURE-CONTAINING PARTS, SUITABLE FOR HIGH-TEMPERATURE SERVICE



SA-217/SA-217M



(Identical with ASTM Specification A217/A217M-07.)

SPECIFICATION FOR STEEL CASTINGS, MARTENSITIC STAINLESS AND ALLOY, FOR PRESSURE-CONTAINING PARTS, SUITABLE FOR HIGH-TEMPERATURE SERVICE



SA-217/SA-217M



(Identical with ASTM Specification A 217/A 217M-07.)

1. Scope

- 1.1 This specification covers martensitic stainless steel and alloy steel castings for valves, flanges, fittings, and other pressure-containing parts (Note 1) intended primarily for high-temperature and corrosive service (Note 2).
- **1.2** One grade of martensitic stainless steel and nine grades of ferritic alloy steel are covered. Selection will depend on design and service conditions, mechanical properties, and the high-temperature and corrosion-resistant characteristics (Note 3).
- NOTE 1 Carbon steel castings for pressure-containing parts are covered by Specification A 216/A 216M. Low alloy quench-and-tempered grades equivalent to Specification A 217/A 217M grades may be found in both Specifications A 352/A 352M and A 487/A 487M.
- NOTE 2 The grades covered by this specification represent materials that are generally suitable for assembly with other castings or wrought steel parts by fusion welding. It is not intended to imply that these grades possess equal degrees of weldability; therefore, it is the responsibility of the purchaser to establish for himself a suitable welding technique. Since these grades possess varying degrees of suitability for high-temperature and corrosion-resistant service, it is also the responsibility of the purchaser to determine which grade shall be furnished, due consideration being given to the requirements of the applicable construction codes.
- NOTE 3 The committee formulating this specification has included nine grades of materials that are considered to represent basic types of ferritic alloy steels suitable for valves, flanges, fittings, and other pressure-containing parts. Additional alloy steels that may better fulfill certain types of service will be considered for inclusion in this specification by the committee as the need becomes apparent.
- 1.3 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining

values from the two systems may result in nonconformance with the specification. Inch-pound units are applicable for material ordered to Specification A 217 and SI units for materials ordered to Specification A 217M.

2. Referenced Documents

- **2.1** ASTM Standards:
- A 216/A 216M Specification for Steel Castings, Carbon, Suitable for Fusion Welding, for High-Temperature Service
- A 352/A 352M Specification for Steel Castings, Ferritic and Martensitic, for Pressure-Containing Parts, Suitable for Low-Temperature Service
- A 487/A 487M Specification for Steel Castings Suitable for Pressure Service
- A 488/A 488M Practice for Steel Castings, Welding, Qualifications of Procedures and Personnel
- A 703/A 703M Specification for Steel Castings, General Requirements, for Pressure-Containing Parts
- A 802/A 802M Practice for Steel Castings, Surface Acceptance Standards, Visual Examination
- A 985/A 985M Specification for Steel Investment Castings General Requirements, for Pressure-Containing Parts
- E 165 Test Method for Liquid Penetrant Examination E 709 Guide for Magnetic Particle Examination

3. General Conditions for Delivery

3.1 Except for investment castings, castings furnished to this specification shall conform to the requirements of Specification A 703/A 703M including any supplementary

requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A 703/A 703M constitutes nonconformance with this specification. In case of conflict between the requirements of this specification and Specification A 703/A 703M, this specification shall prevail.

3.2 Steel investment castings furnished to this specification shall conform to the requirements of Specification A 985/A 985M, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A 985/A 985M constitutes nonconformance with this specification. In case of conflict between the requirements of this specification and Specification A 985/A 985M, Specification A 985/A 985M shall prevail.

4. Ordering Information

- **4.1** The inquiry and order should include or indicate the following:
- **4.1.1** A description of the casting by pattern number or drawing (dimensional tolerances shall be included on the casting drawing),
 - **4.1.2** Grade of steel,
 - **4.1.3** Options in the specification,
- **4.1.4** Whether the castings are to be produced using the investment casting process, and
- **4.1.5** The supplementary requirements desired including the standards of acceptance.

5. Heat Treatment

- **5.1** All castings shall receive a heat treatment proper to their design and chemical composition.
- **5.2** Castings shall be furnished in the normalized and tempered conditions; Grades WC1, WC4, WC5, WC6, and CA15 shall be tempered at 1100°F [595°C] min; Grades WC9, C5, C12, and WC11 shall be tempered at 1250°F [675°C] min; Grade C12A shall be normalized at 1900-1975°F [1040–1080°C] and tempered at 1350–1470°F [730–800°C].
- **5.3** Heat treatment shall be performed after castings have been allowed to cool below the transformation range.

6. Chemical Composition

6.1 The steel shall be in accordance with the requirements as to chemical composition prescribed in Table 1 (Note 4).

NOTE 4 — The role of alloying elements in the development of Grade C12A has been extensively investigated. V and Cb contribute to precipitation strengthening by forming fine and coherent precipitation of M(C,N)X

carbo-nitrides in the ferrite matrix. V also precipitates as VN during tempering or during creep. The two elements are more effective in combination. Therefore, the addition of strong nitride-forming elements, those with a stronger affinity for nitrogen than Cb and V, as deoxidation agents, interferes with these high-temperature strengthening mechanisms.

7. Tensile Requirements

7.1 Steel used for the castings shall be in accordance with the requirements as to tensile properties prescribed in Table 2.

8. Quality

- 8.1 The surface of the casting shall be examined visually and shall be free of adhering sand, scale, cracks, and hot tears. Other surface discontinuities shall meet the visual acceptance standards specified in the order. Practice A 802/A 802M or other visual standards may be used to define acceptable surface discontinuities and finish. Unacceptable visual surface discontinuities shall be removed and their removal verified by visual examination of the resultant cavities. When methods involving high temperature are used in the removal of discontinuities, castings shall be preheated to at least the minimum temperatures in Table 3.
- **8.2** When additional inspection is desired, Supplementary Requirements S4, S5, and S10 may be ordered.
- **8.3** The castings shall not be peened, plugged, or impregnated to stop leaks.

9. Repair by Welding

- **9.1** Repairs shall be made using procedures and welders qualified under Practice A 488/A 488M.
- **9.2** Weld repaired Grade C12A castings shall be postweld heat treated at 1350-1470°F [730-800°C].
- 9.3 Weld repairs shall be inspected to the same quality standards that are used to inspect the castings. When castings are produced with Supplementary Requirement S4 specified, weld repairs shall be inspected by magnetic particle examination to the same standards that are used to inspect the castings. When castings are produced with Supplementary Requirement S5 specified, weld repairs on castings that have leaked on hydrostatic test, or on castings in which the depth of any cavity prepared for repair welding exceeds 20% of the wall thickness or 1 in. [25 mm], whichever is smaller, or on castings in which any cavity prepared for welding is greater than approximately 10 in. ² [65 cm²], shall be radiographed to the same standards that are used to inspect the castings.
- **9.4** Weld repairs shall be considered major in the case of a casting that has leaked on hydrostatic test, or when

the depth of the cavity prepared for welding exceeds 20% of the wall thickness or 1 in. [25 mm], whichever is smaller, or when the extent of the cavity exceeds approximately 10 in.² [65 cm²]. All castings with major repair welds shall be thermally stress relieved or completely reheat-treated. This mandatory stress relief or reheat-treatment shall be in accordance with the qualified procedure used. Major

repairs shall be inspected to the same quality standards that are used to inspect the castings.

10. Keywords

10.1 alloy steel; high temperature; martensitic stainless steel; pressure containing; steel castings

TABLE 1 CHEMICAL REQUIREMENTS

	Composition, %									
	Carbon Molybdenum	Nickel Chromium Molybdenum	Nickel Chromium Molybdenum	Chromium Molybdenum	Chromium Molybdenum	Chromium Molybdenum	Chromium Molybdenum	Chromium Molybdenum	Chromium Molybdenum Vanadium	Chromium
Grade Identification Symbol UNS Number	WC1 J12524	WC4 J12082	WC5 J22000	WC6 J12072	WC9 J21890	WC11 J11872	C5 J42045	C12 J82090	C12A J84090	CA15 J91150
Carbon	0.25	0.05-0.20	0.05-0.20	0.05-0.20	0.05-0.18	0.15-0.21	0.20	0.20	0.08-0.12	0.15
Manganese	0.50-0.80	0.50-0.80	0.40-0.70	0.50-0.80	0.40-0.70	0.50-0.80	0.40-0.70	0.35-0.65	0.30-0.60	1.00
Phosphorus	0.04	0.04	0.04	0.04	0.04	0.020	0.04	0.04	0.030	0.040
Sulfur	0.045	0.045	0.045	0.045	0.045	0.015	0.045	0.045	0.010	0.040
Silicon	0.60	0.60	0.60	0.60	0.60	0.30-0.60	0.75	1.00	0.20-0.50	1.50
Nickel		0.70-1.10	0.60-1.00						0.40	1.00
Chromium		0.50-0.80	0.50-0.90	1.00-1.50	2.00-2.75	1.00-1.50	4.00-6.50	8.00-10.00	8.0-9.5	11.5-14.0
Molybdenum	0.45-0.65	0.45-0.65	0.90-1.20	0.45-0.65	0.90-1.20	0.45-0.65	0.45-0.65	0.90-1.20	0.85-1.05	0.50
Columbium									0.060-0.10	
Nitrogen									0.030-0.070	
Vanadium									0.18-0.25	
				Specified	Residual Elemen	nts				
Aluminum						0.01			0.02	
Copper	0.50	0.50	0.50	0.50	0.50	0.35	0.50	0.50		
Nickel	0.50			0.50	0.50	0.50	0.50	0.50		
Chromium	0.35									
Titanium									0.01	
Tungsten	0.10	0.10	0.10	0.10	0.10		0.10	0.10		
Vanadium						0.03				
Zirconium									0.01	
Total content of these residual elements	1.00	0.60	0.60	1.00	1.00	1.00	1.00	1.00		

 ${\tt NOTE}-{\tt All}$ values are maximum unless otherwise indicated.

TABLE 2 TENSILE REQUIREMENTS

Grade	Tensile Strength, ksi [MPa]	Yield Strength, ⁴ min, ksi [MPa]	Elongation in 2 in. [50 mm], min, % ^B	Reduction of Area, min, %
WC1	65 [450] to 90 [620]	35 [240]	24	35
WC4, WC5, WC6, WC9	70 [485] to 95 [655]	40 [275]	20	35
WC11	80 [550] to 105 [725]	50 [345]	18	45
C5, C12	90 [620] to 115 [795]	60 [415]	18	35
C12A	85 [585] to 110 [760]	60 [415]	18	45
CA15	90 [620] to 115 [795]	65 [450]	18	30

TABLE 3 MINIMUM PREHEAT TEMPERATURES

Grade	Thickness, in. [mm]	Minimum Preheat Temperature, °F [°C]
WC1	⁵% and under	50 [10]
	Over ½ [15.9]	250 [120]
WC4	AII	300 [150]
WC5	AII	300 [150]
WC6	All	300 [150]
WC9	AII	400 [200]
WC11	All	300 [150]
C5	AII	400 [200]
C12	All	400 [200]
C12A	AII	400 [200]
CA15	AII	400 [200]

 $^{^{\}it A}$ Determine by either 0.2% offset method or 0.5% extension-under-load method. $^{\it B}$ When ICI test bars are used in tensile testing as provided for in Specification A 703/A 703M, the gage length to reduced section diameter ratio shall be 4 to 1.

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall not apply unless specified in the purchase order. A list of standardized supplementary requirements for use at the option of the purchaser is included in Specification A 703/A 703M. Those which are ordinarily considered suitable for use with this specification are given below. Others enumerated in Specification A 703/A 703M may be used with this specification upon agreement between the manufacturer and purchaser.

- S1. Unspecified Elements
- **S2.** Destruction Tests
- S3. Bend Tests
- **S4.** Magnetic Particle Inspection
- S5. Radiographic Inspection
- S10. Examination of Weld Preparation

S10.1 The method of performing the magnetic particle or liquid penetrant test shall be in accordance with Test Method E 165 or Guide E 709.

- S13. Hardness Test
- S21. Heat Treatment Furnace Record
- S22. Heat Treatment
- S51. Mandatory Postweld Heat Treatment

S51.1 All castings with repair welds shall receive a mandatory thermal stress relief or complete reheat treatment in accordance with the qualified procedure after all weld repairs.



SPECIFICATION FOR PRESSURE VESSEL PLATES, ALLOY STEEL, MANGANESE-VANADIUM-NICKEL



SA-225/SA-225M



(Identical with ASTM Specification A225/A225M-17.)

Standard Specification for Pressure Vessel Plates, Alloy Steel, Manganese-Vanadium-Nickel

1. Scope

- 1.1 This specification covers manganese-vanadium-nickel alloy steel plates intended primarily for welded layered pressure vessels.
- 1.2 Plates under this specification are available in two grades having different strength levels as follows:

Grade	Tensile Strength, ksi [MPa]
С	105-135 [725-930]
D	
3 in. [75 mm] and under	80-105 [550-725]
Over 3 in. [75 mm]	75-100 [515-690]

- 1.3 The maximum thickness of plates is limited only by the capacity of the chemical composition to meet the specified mechanical property requirements.
- 1.4 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification.
- 1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

- A20/A20M Specification for General Requirements for Steel Plates for Pressure Vessels
- A435/A435M Specification for Straight-Beam Ultrasonic Examination of Steel Plates
- A577/A577M Specification for Ultrasonic Angle-Beam Examination of Steel Plates
- A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applications

3. General Requirements and Ordering Information

- 3.1 Material supplied to this material specification shall conform to Specification A20/A20M. These requirements outline the testing and retesting methods and procedures, permitted variations in dimensions, and mass, quality and repair of defects, marking, loading, and ordering information.
- 3.2 In addition to the basic requirements of this specification, certain supplementary requirements are available when additional control, testing, or examination is required to meet end use requirements. The purchaser is referred to the listed supplementary requirements in this specification and to the detailed requirements in Specification A20/A20M.
- 3.3 Coils are excluded from qualification to this specification until they are processed into finished plates. Plates produced from coil means plates that have been cut to individual lengths from coil. The processor directly controls, or is responsible for, the operations involved in the processing of coils into finished plates. Such operations include decoiling, leveling, cutting to length, testing, inspection, conditioning, heat treatment (if applicable), packaging, marking, loading for shipment, and certification.

Note 1—For plates produced from coil and furnished without heat treatment or with stress relieving only, three test results are reported for each qualifying coil. Additional requirements regarding plates from coil are described in Specification A20/A20M.

3.4 If the requirements of this specification are in conflict with the requirements of Specification A20/A20M, the requirements of this specification shall prevail.

TABLE 1 Chemical Requirements

Elements		Composition, %
Elements	Grade C	Grade D
Carbon, max ^A	0.25	0.20
Manganese, max:		
Heat analysis	1.60	1.70
Product analysis	1.72	1.84
Phosphorus, max ^A	0.025	0.025
Sulfur, max ^A	0.025	0.025
Silicon:		
Heat analysis	0.15-0.40	0.10-0.50
Product analysis	0.13-0.45	0.08-0.56
Vanadium:		
Heat analysis	0.13-0.18	0.10-0.18
Product analysis	0.11-0.20	0.08-0.20
Nickel:		
Heat analysis	0.40-0.70	0.40-0.70
Product analysis	0.37-0.73	0.37-0.73

^A Applies to both heat and product analyses.

TABLE 2 Tensile Requirements

	Grade C		Gra	ide D
	ksi	[MPa]	ksi	[MPa]
Tensile strength:				
All thicknesses	105-135	[725–930]		
3 in. [75 mm] and under			80-105	[550-725]
Over 3 in. [75 mm]			75–100	[515-690]
Yield strength, min: ^A				
All thicknesses	70	[485]		
3 in. [75 mm] and under			60	[415]
Over 3 in. [75 mm]			55	[380]
Elongation in 8 in. [200 mm], min, % ^B				
Elongation in 2 in. [50 mm], min, % ^B	2	20		19
Elongation in 5D, min, %B				17

^A Determined by either the 0.2 % offset method or the 0.5 % extension-under-load method.

4. Materials and Manufacture

4.1 Steelmaking Practice—The steel shall be killed and shall conform to the fine austenitic grain size requirement of Specification A20/A20M.

5. Heat Treatment

- 5.1 Grade D plates of all thicknesses and Grade C plates of thicknesses over 2 in. [50 mm] shall be normalized.
- 5.2 Grade C plates 2 in. [50 mm] and under in thickness are usually supplied in the as-rolled condition. The plates may be ordered normalized or stress-relieved, or both.

6. Chemical Composition

6.1 The steel shall conform to the chemical requirements given in Table 1, unless otherwise modified in accordance with

Supplementary Requirement S17, Vacuum Carbon-Deoxidized Steel, in Specification A20/A20M.

7. Mechanical Properties

- 7.1 *Tension Test*—The plates, as represented by the tension test specimens, shall conform to the requirements given in Table 2.
- 7.2 For plates with a nominal thickness of 3 /4 in. [20 mm] and under, the 1^{1} /2-in. [40-mm] wide rectangular specimen may be used and the elongation determined in a 2-in. [50-mm] gage length that includes the fracture and that shows the greatest elongation.

8. Keywords

8.1 alloy steel plates; manganese-vanadium-nickel steel plate; plate for pressure vessels; pressure containing parts

^B See Specification A20/A20M for elongation adjustment.

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified in the purchase order.

A list of standardized supplementary requirements for use at the option of the purchaser is included in Specification A20/A20M. Those that are considered suitable for use with this specification are listed below by title.

- S1. Vacuum Treatment,
- S2. Product Analysis,
- S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons,
 - S4.1 Additional Tension Test,
 - S5. Charpy V-Notch Impact Test,
- S6. Drop Weight Test (for Material 0.625 in. [16 mm] and over in Thickness),
 - S7. High-Temperature Tension Test,

- S8. Ultrasonic Examination in accordance with Specification A435/A435M,
 - S9. Magnetic Particle Examination,
- S11. Ultrasonic Examination in accordance with Specification A577/A577M,
- S12. Ultrasonic Examination in accordance with Specification A578/A578M, and
 - S17. Vacuum Carbon-Deoxidized Steel.

SPECIFICATION FOR CHROMIUM-VANADIUM ALLOY STEEL SPRING WIRE



SA-231/SA-231M

(Identical with ASTM Specification A231/A231M-96 except that certification requirements in para. 13.1 are mandatory.)

SPECIFICATION FOR CHROMIUM-VANADIUM ALLOY STEEL SPRING WIRE



SA-231/SA-231M

(Identical with ASTM Specification A 231/A 231M-96 except that certification requirements in para. 13.1 are mandatory.)

1. Scope

- 1.1 This specification covers round chromium-vanadium alloy steel spring wire having properties and quality intended for the manufacture of springs used at moderately elevated temperatures. This wire shall be either in the annealed and cold-drawn or oil-tempered condition as specified by the purchaser.
- 1.2 The values stated in either SI (metric) units or inchpound units are to be regarded separately as standard. The values stated in each system are not exact equivalents; therefore, each system must be used independent of the other.

2. Referenced Documents

- **2.1** ASTM Standards:
- A 370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A 700 Practices for Packaging, Marking, and Loading Methods for Steel Products for Domestic Shipment
- A 751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- A 752 Specification for General Requirements for Wire Rods and Coarse Round Wire, Alloy Steel
- E 29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications
 - 2.2 ANSI Standard:
- B 32.4M Preferred Metric Sizes for Round, Square, Rectangle, and Hexagon Metal Products
 - **2.3** *Military Standard:*
- MIL-STD-163 Steel Mill Products, Preparation for Shipment and Storage
 - **2.4** Federal Standard:

Fed. Std. No. 123 Marking for Shipment (Civil Agencies)

2.5 AIAG Standard:

AIAGB-5 02.00 Primary Metals Identification Tag Application Standard

3. Ordering Information

- **3.1** Orders for material under this specification should include the following information for each ordered item:
 - **3.1.1** Quantity (mass);
- **3.1.2** Name of material (chromium-vanadium alloy steel wire);
 - **3.1.3** Wire diameter (Table 1 and Table 2);
 - **3.1.4** Packaging (Section 14);
 - **3.1.5** Cast or heat analysis report (if requested) (5.2);
 - **3.1.6** Certification and test report (Section 13); and
 - 3.1.7 ASTM designation and date of issue.

NOTE 1 — A typical ordering description is as follows: 20,000 kg oil-tempered chromium-vanadium alloy steel wire, size 6.00 mm in 150 kg coils to ASTM A 231M dated______, or for inch-pound units, 40 000 lb oil-tempered chromium-vanadium alloy steel spring wire, size 0.250 in, in 350 lb coils to ASTM A 231 dated

4. Materials and Manufacture

- **4.1** The steel may be made by any commercially accepted steel-making process. The steel may be either ingot cast or strand cast.
- **4.2** The finished wire shall be free from detrimental pipe and undue segregation.

5. Chemical Composition

- **5.1** The steel shall conform to the requirements as to chemical composition specified in Table 3.
- **5.2** Cast or Heat Analysis Each cast or heat of steel shall be analyzed by the manufacturer to determine the

percentage of elements prescribed in Table 3. This analysis shall be made from a test specimen preferably taken during the pouring of the cast or heat. When requested, this shall be reported to the purchaser and shall conform to the requirements of Table 3.

- **5.3** Product Analysis (formerly Check Analysis) An analysis may be made by the purchaser from finished wire representing each cast or heat of steel. The chemical composition thus determined, as to elements required or restricted, shall conform to the product (check) analysis requirements specified in Table 5 of Specification A 752.
- **5.4** For referee purposes, Test Methods, Practices, and Terminology A 751 shall be used.

6. Mechanical Properties

- **6.1** Annealed and Cold Drawn When purchased in the annealed and cold-drawn condition, the wire shall have been given a sufficient amount of cold working to meet the purchaser's coiling requirements and shall be in a suitable condition to respond properly to heat treatment. In special cases the hardness, if desired, shall be stated in the purchase order.
- **6.2** Oil Tempered When purchased in the oil-tempered condition, the tensile strength and minimum percent reduction of area, sizes 2.50 mm or 0.105 in. and coarser, of the wire shall conform to the requirements as shown in Table 1 or Table 2.
- **6.2.1** *Number of Tests* One test specimen shall be taken for each ten coils, or fraction thereof, in a lot. Each cast or heat in a given lot shall be tested.
- **6.2.2** Location of Tests Test specimens shall be taken from either end of the coil.
- **6.2.3** *Test Method* The tension test shall be made in accordance with Test Methods and Definitions A 370.

6.3 Wrap Test:

- **6.3.1** Oil tempered or cold drawn wire 4.00 mm or 0.162 in. and smaller in diameter shall wind on itself as an arbor without breakage. Larger diameter wire up to and including 8.00 mm or 0.312 in. in diameter shall wrap without breakage on a mandrel twice the wire diameter. The wrap test is not applicable to wire over 8.00 mm or 0.312 in. in diameter.
- **6.3.2** *Number of Tests* One test specimen shall be taken for each ten coils, or fraction thereof, in a lot. Each cast or heat in a given lot shall be tested.
- **6.3.3** Location of Test Test specimens shall be taken from either end of the coil.
- **6.3.4** *Test Method* The wrap test shall be made in accordance with Supplement IV of Test Methods and Definitions A 370.

7. Metallurgical Properties

7.1 Surface Condition:

- **7.1.1** The surface of the wire as received shall be free of rust and excessive scale. No serious die marks, scratches, or seams may be present. Based upon examination of etched end specimen, seams shall not exceed 3.5% of the wire diameter, or 0.25 mm or 0.010 in., whichever is the smaller as measured on a transverse section.
- **7.1.2** *Number of Tests* One test specimen shall be taken for each ten coils, or fraction thereof, in a lot. Each cast or heat in a given lot shall be tested.
- **7.1.3** Location of Test Test specimens shall be taken from either or both ends of the coil.
- **7.1.4** Test Method The surface shall be examined after etching in a solution of equal parts of hydrochloric acid and water that has been heated to approximately 80° C. Test ends shall be examined using 10× magnification. Any specimen which shows questionable seams of borderline depth shall have a transverse section taken from the unetched area, properly mounted and polished and examined to measure the depth of the seam.

8. Dimensions and Permissible Variations

8.1 The permissible variations in the diameter of the wire shall be as specified in Table 4 or Table 5.

9. Workmanship and Appearance

- **9.1** Annealed and Cold Drawn —The wire shall not be kinked or improperly cast. To test for cast, a few convolutions of wire shall be cut loose from the coil and placed on a flat surface. The wire shall lie flat on itself and not spring up nor show a wavy condition.
- **9.2** *Oil Tempered* The wire shall be uniform in quality and temper and shall not be wavy or crooked.
- **9.3** Each coil shall be one continuous length of wire properly coiled. Welds made prior to cold drawing are permitted. If unmarked welds are unacceptable to the purchaser, special arrangements should be made with the manufacturer at the time of the purchase.
- **9.4** Appearance The surface shall be smooth and free of defects such as seams, pits, die marks, and other defects tending to impair the use of the wire for springs. Any additional surface requirements must be negotiated at the time of entry of the order.

10. Retests

10.1 If any test specimen exhibits obvious defects or shows the presence of a weld, it may be discarded and another specimen substituted.

11. Inspection

11.1 Unless otherwise specified in the contract or purchase order, the manufacturer is responsible for the performance of all inspection and test requirements specified in this specification. Except as otherwise specified in the contract or purchase order, the manufacturer may use his own or any other suitable facilities for the performance of the inspection and test requirements unless disapproved by the purchaser at the time the order is placed. The purchaser shall have the right to perform any of the inspections and tests set forth in this specification when such inspections and tests are deemed necessary to assure that the material conforms to prescribed requirements.

12. Rejection and Rehearing

- **12.1** Unless otherwise specified, any rejection based on tests made in accordance with this specification shall be reported to the manufacturer as soon as possible so that an investigation may be initiated.
- **12.2** The material must be adequately protected and correctly identified in order that the manufacturer may make a proper investigation.

13. Certification

- 13.1 A manufacturer's or supplier's certification shall be furnished to the purchaser that the material was manufactured, sampled, tested, and inspected in accordance with this specification and has been found to meet the requirements. A report of the test results shall be furnished.
- **13.2** The certification shall include the specification number, year date of issue, and revision letter, if any.

14. Packaging, Marking, and Loading for Shipment

- **14.1** The coil mass, dimensions, and the method of packaging shall be as agreed upon between the manufacturer and purchaser.
- **14.2** The size of the wire, purchaser's order number, ASTM Specification number, heat number, and name or mark of the manufacturer shall be marked on a tag securely attached to each coil of wire.
- **14.3** Unless otherwise specified in the purchaser's order, packing, marking, and loading for shipments shall be in accordance with those procedures recommended by Practices A 700.

14.4 For Government Procurement:

- 14.4.1 Packaging, packing, and marking of material for military procurement shall be in accordance with the requirements of MIL-STD-163, Level A, Level C, or commercial as specified in the contract or purchase order. Marking for shipment of material for civil agencies shall be in accordance with Fed. Std. No. 123.
- 14.5 Bar Coding In addition to the previously-stated identification requirements, bar coding is acceptable as a supplementary identification method. Bar coding should be consistent with AIAG B-5 02.00, Primary Metals Identification Tag Application. The bar code may be applied to a substantially affixed tag.

15. Keywords

15.1 alloy; chromium-vanadium; spring; wire

TABLE 1 TENSILE REQUIREMENTS, SI UNITS $^{\it A}$

		Strength, Pa	Reduction of Areas,
Diameter, ^B mm	Min.	Max.	Min., %
0.50	2060	2260	С
0.55	2050	2240	С
0.60	2030	2220	С
0.65	2010	2200	С
0.70	2000	2160	С
0.80	1980	2140	С
0.90	1960	2120	С
1.00	1940	2100	С
1.10	1920	2080	С
1.20	1900	2060	С
1.40	1860	2020	С
1.60	1820	1980	С
1.80	1800	1960	С
2.00	1780	1930	С
2.20	1750	1900	С
2.50	1720	1860	45
2.80	1680	1830	45
3.00	1660	1800	45
3.50	1620	1760	45
4.00	1580	1720	40
4.50	1560	1680	40
5.00	1520	1640	40
5.50	1480	1620	40
6.00	1460	1600	40
6.50	1440	1580	40
7.00	1420	1560	40
8.00	1400	1540	40
9.00	1380	1520	40
10.00	1360	1500	40
11.00	1340	1480	40
12.00	1320	1460	40

 $^{^{\}rm A}$ Tensile strength values for intermediate diameters may be interpolated.

TABLE 2 TENSILE REQUIREMENTS, INCH-POUND UNITS $^{\it A}$

		Strength, si	Reduction of Areas,
Diameter, ^B in.	Min.	Max.	Min., %
0.020	300	325	С
0.032	290	315	С
0.041	280	305	С
0.054	270	295	С
0.062	265	290	С
0.080	255	275	С
0.105	245	265	45
0.135	235	255	45
0.162	225	245	40
0.192	220	240	40
0.244	210	230	40
0.283	205	225	40
0.312	203	223	40
0.375	200	220	40
0.438	195	215	40
0.500	190	210	40

 $^{^{\}it A}$ Tensile strength values for intermediate diameters may be interpolated.

TABLE 3
CHEMICAL REQUIREMENTS

Element	, ,
Carbon	0.48-0.53
Manganese	0.70-0.90
Phosphorus	0.040 max.
Sulfur	0.040 max.
Silicon	0.15-0.35
Chromium	0.80-1.10
Vanadium	0.15 min.

^B Preferred sizes. For a complete list, refer to ANSI B 32.4M, Preferred Metric Sizes for Round, Square, Rectangle, and Hexagon Metal Products.

 $[\]ensuremath{^{\mathcal{C}}}$ The reduction of area test is not applicable to wire diameters under 2.34 mm.

^B Preferred sizes. For a complete list, refer to ANSI B 32.4M, Preferred Metric Sizes for Round, Square, Rectangle, and Hexagon Metal Products.

 $^{^{\}it C}$ The reduction of area test is not applicable to wire diameters under 0.092 in.

TABLE 4 PERMISSIBLE VARIATIONS IN WIRE DIAMETER, SI UNITS $^{\it A}$

Diameter, mm	Permissible Variations, plus and Minus, mm	Permissible Out- of Round, mm
To 0.70, incl.	0.02	0.02
Over 0.70 to 2.00, incl.	0.03	0.03
Over 2.00 to 9.00, incl.	0.05	0.05
Over 9.00	0.08	0.08

 $^{^{\}it A}$ For purposes of determining conformance with this specification, all specified limits are absolute as defined in Practice E 29.

TABLE 5 PERMISSIBLE VARIATIONS IN WIRE DIAMETER, INCH-POUND UNITS $^{\it A}$

Diameter, in.	Permissible Variations, Plus and Minus, mm	Permissible Out- of Round, mm
0.020 to 0.028, incl.	0.0008	0.0008
Over 0.028 to 0.075, incl.	0.001	0.001
Over 0.075 to 0.375, incl.	0.002	0.002
Over 0.375 to 0.500, incl.	0.003	0.003

 $^{^{\}it A}$ For purposes of determining conformance with this specification, all specified limits are absolute as defined in Practice E 29.

SPECIFICATION FOR CHROMIUM-VANADIUM ALLOY STEEL VALVE SPRING QUALITY WIRE



SA-232/SA-232M



(Identical with ASTM Specification A232/A232M-91.)

SPECIFICATION FOR CHROMIUM-VANADIUM ALLOY STEEL VALVE SPRING QUALITY WIRE



SA-232/SA-232M



(Identical with ASTM Specification A 232/A 232M-91.)

1. Scope

- 1.1 This specification covers the highest quality of round chromium-vanadium alloy steel valve spring wire, uniform in quality and temper, intended for the manufacture of valve springs and other springs requiring high-fatigue properties when used at moderately elevated temperatures. This wire shall be either in the annealed and cold-drawn or oil-tempered condition as specified by the purchaser.
- 1.2 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the inch-pound units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independent of the other.

2. Referenced Documents

- **2.1** ASTM Standards:
- A 370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A 700 Practices for Packaging, Marking, and Loading Methods for Steel Products for Domestic Shipment
- A 751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- E 29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications
 - 2.2 ANSI Standard:
- B32.4 Preferred Metric Sizes for Round, Square, Rectangle, and Hexagon Metal Products
 - 2.3 Federal Standard:
- Fed. Std. No. 123 Marking for Shipment (Civil Agencies)
 - **2.4** *Military Standard:*
- MIL-STD-163 Steel Mill Products, Preparation for Shipment and Storage

3. Ordering Information

- **3.1** Orders for material under this specification should include the following information for each ordered item:
 - **3.1.1** Quantity (mass),
- **3.1.2** Name of material (chromium-vanadium alloy steel valve spring quality wire),
 - **3.1.3** Dimensions (Table 1 and Section 8),
 - **3.1.4** Condition (Section 6),
 - 3.1.5 Packaging (Section 14),
 - **3.1.6** Heat analysis report, if requested (Section 5.2),
- **3.1.7** Certification or test report, or both, if specified (Section 13), and
 - **3.1.8** ASTM designation and year of issue.

NOTE 1 — A typical ordering description is as follows: 20 000 kg oil-tempered chromium-vanadium alloy steel valve spring quality wire, size 6.00 mm in 150 kg coils to ASTM A 232/A 232M dated _______, or for inch-pound units, 40 000 lb oil-tempered chromium-vanadium alloy steel valve spring quality wire, size 0.250 in. in 350-lb coils to ASTM A 232/A 232M dated ______.

4. Materials and Manufacture

- **4.1** The steel may be made by any commercially accepted steel making process. The steel may be either ingot cast or strand cast.
- **4.2** The finished wire shall be free from detrimental pipe and undue segregation.

5. Chemical Requirements

- **5.1** The steel shall conform to the requirements for chemical composition specified in Table 2.
- **5.2** *Heat Analysis* Each heat of steel shall be analyzed by the manufacturer to determine the percentage of elements prescribed in Table 2. This analysis shall be made

from a test specimen preferably taken during the pouring of the heat. When requested, this shall be reported to the purchaser and shall conform to the requirement of Table 2.

- **5.3** Product Analysis An analysis may be made by the purchaser from finished wire representing each heat of steel. The average of all the separate determinations made shall be within the limits specified in the analysis column. Individual determinations may vary to the extent shown in the product analysis tolerance column, except that the several determinations of a single element in any one heat shall not vary both above and below the specified range.
- **5.4** For referee purposes, Test Methods, Practices and Terminology A 751 shall be used.

6. Mechanical Requirements

- **6.1** Annealed and Cold Drawn When purchased in the annealed and cold-drawn condition, the wire shall have been given a sufficient amount of cold working to meet the purchaser's coiling requirements and shall be in a suitable condition to respond properly to heat treatment. In special cases the hardness, if desired, shall be stated in the purchase order.
- **6.2** Oil Tempered When purchased in the oil-tempered condition, the tensile strength and minimum percent reduction of area, sizes 2.50 mm [0.105 in.] and coarser, of the wire shall conform to the requirements prescribed in Table 1.
- **6.2.1** *Number of Tests* One test specimen shall be taken for each five coils, or fraction thereof, in a lot. Each heat in a given lot shall be tested.
- **6.2.2** Location of Tests Test specimens shall be taken from either end of the coil.
- **6.2.3** *Test Method* The tension test shall be made in accordance with Test Methods and Definitions A 370.

6.3 Wrap Test:

- **6.3.1** Oil-tempered or cold-drawn wire 4.00 mm [0.162 in.] and smaller in diameter shall wind on itself as an arbor without breakage. Larger diameter wire up to and including 8.00 mm [0.312 in.] in diameter shall wrap without breakage on a mandrel twice the wire diameter. The wrap test is not applicable to wire over 8.00 mm [0.312 in.] in diameter.
- **6.3.2** *Number of Tests* One test specimen shall be taken for each five coils or fraction thereof, in a lot. Each heat in a given lot shall be tested.
- **6.3.3** Location of Test Test specimens shall be taken from either end of the coil.
- **6.3.4** *Test Method* The wrap test shall be made in accordance with Test Methods and Definitions A 370.

7. Metallurgical Requirements

7.1 *Surface Condition:*

- **7.1.1** The surface of the wire as received shall be free of imperfections such as pits, die marks, scratches, seams, and other defects tending to impair the fatigue value of the springs.
- **7.1.2** *Number of Tests* One test specimen shall be taken from each end of every coil.
- **7.1.3** Test Method The surface shall be examined after etching in a solution of equal parts of hydrochloric acid and water that has been heated to approximately 80°C for a sufficient length of time to remove up to approximately 1% of the diameter of the wire. Test ends shall be examined using 10× magnification.

7.2 *Decarburization:*

- **7.2.1** Transverse sections of the wire properly mounted, polished, and etched shall show no completely decarburized (carbon-free) areas when examined at a magnification of 100 diameters. Partial decarburization shall not exceed a depth of 0.025 mm [0.001 in.] on wire 5.00 mm [0.192 in.] and smaller or 0.038 mm [0.0015 in.] on larger than 5.00 mm [0.192 in.].
- **7.2.2** To reveal the decarburization more accurately in the untempered wire, the specimen shall be hardened and tempered before microscopical examination. Prior to hardening, the specimen shall be filed flat on one side enough to reduce the diameter at least 20%. The subsequent mounted specimen shall show the flattened section, as well as the original wire edge. Any decarburization on this flattened section shall necessitate a new specimen for examination.
- **7.2.3** *Number of Tests* One test specimen shall be taken for each five coils, or fraction thereof, in a lot. Each in a given lot shall be tested.
- **7.2.4** Location of Tests Test specimens may be taken from either end of the coil.

8. Dimensions and Permissible Variations

- **8.1** The permissible variations in the diameter of the wire shall be specified in Table 3.
- **8.2** *Number of Tests* One test specimen shall be taken from each end of every coil.

9. Workmanship, Finish, and Appearance

9.1 Annealed and Cold Drawn — The wire shall not be kinked or improperly cast. To test for cast, a few convolutions of wire shall be cut loose from the coil and placed on a flat surface. The wire shall lie substantially flat on itself and not spring up nor show a wavy condition.

- **9.2** *Oil Tempered* The wire shall be uniform in quality and temper and shall not be wavy or crooked.
- **9.3** Each coil shall be one continuous length of wire properly coiled and firmly tied.
- **9.4** No welds are permitted in the finished product and any welds made during processing must be removed.

10. Retests

10.1 If any test specimen exhibits obvious defects it may be discarded and another specimen substituted.

11. Inspection

11.1 Unless otherwise specified in the contract or purchase order, the manufacturer is responsible for the performance of all inspection and test requirements specified in this specification. Except as otherwise specified in the contract or purchase order, the manufacturer may use his own or any other suitable facilities for the performance of the inspection and test requirements unless disapproved by the purchaser at the time the order is placed. The purchaser shall have the right to perform any of the inspections and tests set forth in this specification when such inspections and tests are deemed necessary to assure that the material conforms to prescribed requirements.

12. Rejection and Rehearing

- **12.1** Unless otherwise specified, any rejection based on tests made in accordance with these specifications shall be reported to the manufacturer as soon as possible so that an investigation may be initiated.
- **12.2** The material must be adequately protected and correctly identified in order that the manufacturer may make a proper investigation.

13. Certification

- 13.1 When specified in the purchase order or contract, a manufacturer's or supplier's certification shall be furnished to the purchaser that the material was manufactured, sampled, tested, and inspected in accordance with this specification and has been found to meet the requirements. When specified in the purchase order or contract, a report of the test results shall be furnished.
- **13.2** The certification shall include the specification number, year date of issue, and revision letter, if any.

14. Packaging, Marking, and Loading for Shipment

- **14.1** The coil mass, dimensions, and the method of packaging shall be agreed upon between the manufacturer and purchaser.
- **14.2** The size of the wire, purchaser's order number, ASTM specification number, heat number, and name or mark of the manufacturer shall be marked on a tag securely attached to each coil of wire.
- **14.3** Unless otherwise specified in the purchaser's order, packaging, marking, and loading for shipments shall be in accordance with those procedures recommended by Practice A 700.
- **14.4** For Government Procurement Packaging, packing, and marking of material for military procurement shall be in accordance with the requirements of MIL-STD-163, Level A, Level C, or commercial as specified in the contract or purchase order. Marking for shipment of material for civil agencies shall be in accordance with Fed. Std. No. 123.

TABLE 1
TENSILE REQUIREMENTS^A
SI Units

Diameter ^B	MPa, min	MPa, max	Reduction of Area, min, %
0.50	2060	2260	\mathcal{C}
0.55	2050	2240	\mathcal{C}
0.60	2030	2220	\mathcal{C}
0.65	2010	2200	\mathcal{C}
0.70	2000	2160	\mathcal{C}
0.80	1980	2140	С
0.90	1960	2120	С
1.00	1940	2100	С
1.10	1920	2080	С
1.20	1900	2060	С
1.40	1860	2020	С
1.60	1820	1980	С
1.80	1800	1960	С
2.00	1780	1930	\mathcal{C}
2.20	1750	1900	\mathcal{C}
2.50	1720	1860	45
2.80	1680	1830	45
3.00	1660	1800	45
3.50	1620	1760	45
4.00	1580	1720	40
4.50	1560	1680	40
5.00	1520	1640	40
5.50	1480	1620	40
6.00	1460	1600	40
6.50	1440	1580	40
7.00	1420	1560	40
8.00	1400	1540	40
9.00	1380	1520	40
10.00	1360	1500	40
11.00	1340	1480	40
12.00	1320	1460	40

Inch-Pound Units

Diameter, in.	ksi, min	ksi, max	Reduction of Area, min, %
0.020	300	325	С
0.032	290	315	\mathcal{C}
0.041	280	305	\mathcal{C}
0.054	270	295	\mathcal{C}
0.062	265	290	\mathcal{C}
0.080	255	275	\mathcal{C}
0.105	245	265	45
0.135	235	255	45
0.162	225	245	40
0.192	220	240	40
0.244	210	230	40
0.283	205	225	40
0.312	203	223	40
0.375	200	220	40
0.438	195	215	40
0.500	190	210	40

 $^{^{\}it A}\,{\rm Tensile}$ strength values for intermediate diameters may be interpolated.

TABLE 2 CHEMICAL REQUIREMENTS

	Analysis, %	Product Analysis Tolerance, %
Carbon	0.48-0.53	±0.02
Manganese	0.70-0.90	±0.03
Phosphorus	0.020 max	+0.005
Sulfur	0.035 max	+0.005
Silicon	0.15-0.35	±0.02
Chromium	0.80-1.10	±0.05
Vanadium	0.15 min	-0.01

TABLE 3
PERMISSIBLE VARIATIONS IN WIRE DIAMETER^A
SI Units

	Permissible Variations, plus and	Permissible Out-of-Round,
Diameter, mm	minus, mm	mm
to 2.0, incl	0.02	0.02
Over 2.0 to 4.00, incl	0.03	0.03
Over 4.00 to 9.00, incl	0.04	0.04
Over 9.00	0.05	0.05

Inc	ьD	ound
THE	II-F	ouna

Diameter, in.	Permissible Variations, plus and minus, in.	Permissible Out-of-Round, in.		
0.020 to 0.075, incl	0.0008	0.0008		
Over 0.075 to 0.148, incl	0.001	0.001		
Over 0.148 to 0.375, incl	0.0015	0.0015		
Over 0.375 to 0.500, incl	0.002	0.002		

 $^{^{\}it A}$ For purposes of determining conformance with this specification, all specified limits are absolute as defined in Practice E 29.

 $^{^{\}it B}$ Preferred sizes. For a complete list, refer to ANSI B32.4.

 $^{^{\}it C}$ The reduction of area test is not applicable to wire under 2.50 mm [0.105 in.] in diameter.



SPECIFICATION FOR PIPING FITTINGS OF WROUGHT CARBON STEEL AND ALLOY STEEL FOR MODERATE AND HIGH-TEMPERATURE SERVICE



SA-234/SA-234M



(Identical with ASTM Specification A234/A234M-19.)
For welded and filler metal products ordered to Section III, Division 1, Supplementary Requirement S4 is mandatory.

Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service

1. Scope

- 1.1 This specification covers wrought carbon steel and alloy steel fittings of seamless and welded construction covered by the latest revision of ASME B16.9, B16.11, MSS-SP-79, MSS-SP-83, MSS-SP-95, and MSS-SP-97. These fittings are for use in pressure piping and in pressure vessel fabrication for service at moderate and elevated temperatures. Fittings differing from these ASME and MSS standards shall be furnished in accordance with Supplementary Requirement S58 of Specification A960/A960M.
- 1.2 Optional supplementary requirements are provided for fittings where a greater degree of examination is desired. When desired, one or more of these supplementary requirements may be specified in the order.
- 1.3 This specification does not cover cast welding fittings or fittings machined from castings. Cast steel welding fittings are governed by Specifications A216/A216M and A217/A217M.
- 1.4 This specification is expressed in both inch-pound units and in SI units. However, unless the order specifies the applicable "M" specification designation (SI units), the material shall be furnished to inch-pound units.
- 1.5 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.6 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the

Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 In addition to those reference documents listed in Specification A960/A960M, the following list of standards apply to this specification.

2.2 ASTM Standards:

A105/A105M Specification for Carbon Steel Forgings for Piping Applications

A216/A216M Specification for Steel Castings, Carbon, Suitable for Fusion Welding, for High-Temperature Service

A217/A217M Specification for Steel Castings, Martensitic Stainless and Alloy, for Pressure-Containing Parts, Suitable for High-Temperature Service

A960/A960M Specification for Common Requirements for Wrought Steel Piping Fittings

2.3 ASME Standards:

B16.9 Steel Butt-Welding Fittings

B16.11 Forged Steel Fittings, Socket Welding and Threaded

2.4 ASME Boiler and Pressure Vessel Code:

Section III

Section V

Section VIII, Division 1

Section IX

2.5 MSS Standards:

MSS-SP-25 Standard Marking System for Valves, Fittings, Flanges, and Unions

MSS-SP-79 Socket Welding Reducer Inserts

- MSS-SP-83 Steel Pipe Unions, Socket-Welding and Threaded
- MSS-SP-95 Swage(d) Nipples and Bull Plugs
- MSS-SP-97 Integrally Reinforced Forged Branch Outlet Fittings—Socket Welding, Threaded and Buttwelding Ends
- 2.6 ASNT Standard:
- SNT-TC-1A Recommended Practice for Nondestructive Testing Personnel Qualification and Certification
- 2.7 AWS Specifications
- A5.5/A5.5M Specification for Low-Alloy Steel Electrodes for Shielded Metal Arc Welding
- A5.23/A5.23M Specification for Low-Alloy Steel Electrodes and Fluxes for Submerged Arc Welding
- A5.28/A5.28M Specification for Low-Alloy Steel Electrodes for Gas Shielded Arc Welding
- A5.29/A5.29M Low-Alloy Steel Electrodes for Flux Cored Arc Welding

3. Ordering Information

3.1 See Specification A960/A960M.

4. General Requirements

4.1 Product furnished to this specification shall conform to the requirements of Specification A960/A960M, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the requirements of Specification A960/A960M constitutes non-conformance with this specification. In case of a conflict between the requirements of this specification and Specification A960/A960M, this specification shall prevail.

5. Materials

- 5.1 The starting material for fittings shall be fully killed steel, consisting of forgings, bars, plates, sheet, and seamless or fusion-welded tubular products with filler metal added and shall conform to the chemical requirements of Table 1. Unless otherwise specified for carbon steel plates and sheet, the steel may be made to either coarse grain or fine grain practice. Grade WP9 shall be made to fine grain practice.
- 5.2 A starting material specification that specifically requires the addition of any element beyond those listed for the materials in Table 1 for the applicable grade of material is not permitted. This does not preclude the use of deoxidizers or the judicious use of elements for grain size control.

6. Manufacture

6.1 Forging or shaping operations may be performed by hammering, pressing, piercing, extruding, upsetting, rolling, bending, fusion welding, machining, or by a combination of two or more of these operations. The forming procedure shall be so applied that it will not produce injurious imperfections in the fittings.

- 6.2 Fittings NPS-4 and under may be machined from hot-forged or rolled, cold-sized, and straightened bar stock having the chemical composition of the Grade in Table 1 and the mechanical properties of the Grade in Table 2. Heat treatment shall be in accordance with Section 7. All caps machined from bar stock shall be examined by liquid penetrant or magnetic particle in accordance with S52 or S53 in Specification A960/A960M.
- 6.3 All welds including welds in tubular products from which fittings are made shall be (I) made by welders, welding operators, and welding procedures qualified under the provisions of ASME Section IX, (2) heat treated in accordance with Section 7 of this specification, and (3) radiographically examined throughout the entire length of each weld in accordance with Article 2, ASME Section V with acceptance limits in accordance with Paragraph UW-51 of ASME Section VIII, Division 1 of the ASME Boiler & Pressure Vessel Code. In place of radiographic examination, welds may be ultrasonically examined in accordance with Appendix 12 of Section VIII. The NDE of welds in Grades WPB, WPC, WP1, WP11 Class 1, WP11 Class 2, WP11 Class 3, WP12 Class 1, WP12 Class 2, and WPR may be performed either prior to or after forming. NDE of welds in Grades WP5, WP9, WP91 Types 1 and 2, WP911, WP92, WP22 Class 1, WP22 Class 3, and WP24 shall be done after forming.
- 6.3.1 All welds in WP91 Types 1 and 2 shall be made with one of the following welding processes and consumables: SMAW, A5.5/A5.5M E90XX-B9; SAW, A5.23/A5.23M EB9 + flux; GTAW, A5.28/A5.28M ER90S-B9; and FCAW A5.29/A5.29M E91T1-B9. In addition, the Ni+Mn content of all welding consumables used to fabricate WP91 Type 1 and Type 2 fittings shall not exceed 1.0 %.
- 6.3.2 All welds in WP92 and WP911 shall be made using welding consumables meeting the chemical requirements for the grade in Table 1.
- 6.3.3 All welds in WP115 shall be made using deposited filler metal suitable for the composition being welded. Any defects shall be thoroughly chipped or ground out before welding and each welded length shall be re-heat treated or stress relieved as required by the application specification. Alternately, the weld shall be made with the welding products and procedures of 6.3.1.
- 6.4 Personnel performing NDE examinations shall be qualified in accordance with SNT-TC-1A.
- 6.5 The welded joints of the fittings shall be finished in accordance with the requirements of Paragraph UW-35 (a) of ASME Section VIII, Division 1.
- 6.6 All butt-weld tees manufactured by cold-forming method(s) shall be liquid penetrant or magnetic particle examined by one of the methods specified in Supplementary Requirement S52 or S53 in Specification A960/A960M. This examination shall be performed after final heat treat. Only the side wall area of the tees need be examined. This area is defined by a circle that covers the area from the weld bevel of the branch outlet to the center line of the body or run. Internal and external surfaces shall be examined when size permits accessibility. No cracks shall be permitted. Other imperfections shall be treated in

TABLE 1 Chemical Requirements

Note 1—All requirements are maximum unless otherwise indicated.

Note 2—Where an ellipsis (...) appears in this table, there is no requirement and analysis for the element need not be determined or reported.

Grade and						Composition	1, %			
Marking Symbol ^A	Carbon	Manganese	Phospho- rus	Sulfur	Silicon	Chromium	Molybdenum	Nickel	Copper	Others
WPB ^{B,C,D,E,} WPC ^{C,D,E,} WP1	0.30 0.35 0.28	0.29-1.06 0.29-1.06 0.30-0.90	0.050 0.050 0.045	0.058 0.058 0.045	0.10 min 0.10 min 0.10–0.50	0.40 0.40	0.15 max 0.15 max 0.44–0.65	0.40 0.40	0.40 0.40	Vanadium 0.08 Vanadium 0.08
WP12 CL1, WP12 CL2	0.05-0.20	0.30-0.80	0.045	0.045	0.60	0.80–1.25	0.44–0.65			
WP11 CL1 WP11 CL2,	0.05-0.15 0.05-0.20	0.30-0.60 0.30-0.80	0.030 0.040	0.030 0.040	0.50-1.00 0.50-1.00	1.00-1.50 1.00-1.50	0.44-0.65 0.44-0.65	• • •		
WP11 CL3 WP22 CL1, WP22 CL3	0.05-0.15	0.30-0.60	0.040	0.040	0.50	1.90-2.60	0.87-1.13			
WP24	0.05–0.10	0.30-0.70	0.020	0.010	0.15–0.45	2.20–2.60	0.90–1.10	•••	0.75–1.25	Aluminum 0.020 Boron 0.0015–0.0070 Nitrogen 0.12 Titanium 0.06–0.10 Vanadium 0.20–0.30
WP5 CL1, WP5 CL3	0.15	0.30-0.60	0.040	0.030	0.50	4.0–6.0	0.44–0.65		• • • •	
WP9 CL1, WP9 CL3	0.15	0.30-0.60	0.030	0.030	1.00	8.0–10.0	0.90–1.10			
WPR WP91 Type 1	0.20 0.08–0.12	0.40–1.06 0.30–0.60	0.045 0.020	0.050 0.010	0.20–0.50	8.0–9.5	0.85–1.05	1.60–2.24 0.40	0.75–1.25	Vanadium 0.18–0.25 Columbium ^G 0.06–0.10 Nitrogen 0.03–0.07 Aluminum 0.02 ^F Titanium 0.01 ^F
WP91 Type 2	0.08-0.12	0.30-0.50 ^F	0.020 ^F	0.005 ^F	0.20-0.40 ^F	8.0–9.5 ^F	0.85–1.05	0.20 ^F	0.10 ^F	Zirconium 0.01 ^F Vanadium 0.18–0.25 Columbium ^G 0.06–0.10 Nitrogen 0.035–0.070 ^F Aluminum 0.020 ^F N/AI ratio ≥4.0 Boron 0.001 ^F Zirconium 0.01 ^F Titanium 0.01 ^F
WP115	0.08-0.13	0.20–0.50	0.020	0.005	0.15–0.45	10.0–11.0	0.40-0.60	0.25	0.10	Arsenic 0.010 ^F Tin 0.010 ^F Antimony 0.003 ^F Tungsten 0.05 ^F Vanadium 0.18–0.25 Niobium 0.02–0.06 Nitrogen 0.030–0.070 Aluminum 0.02 Titanium 0.01 Boron 0.001 Zirconium 0.01 Tungsten 0.05 Arsenic 0.010 Tin 0.010 Antimony 0.003
WP911	0.09–0.13	0.30–0.60	0.020	0.010	0.10-0.50	8.5–9.5	0.90-1.10	0.40		Antimony 0.003 N/Al ratio 4.0 min CNB ^H 10.5 Vanadium 0.18–0.25 Columbium ^G 0.060–0.10 Nitrogen 0.04–0.09 Aluminum 0.02 max ^F Boron 0.0003–0.006 Tungsten 0.90–1.10 Titanium 0.01 max ^F
WP92	0.07-0.13	0.30-0.60	0.020	0.010	0.50	8.50-9.50	0.30-0.60	0.40		Zirconium 0.01 max ^F Aluminum 0.02 ^F Boron 0.001–0.006 Columbium ^G 0.04–0.09 Nitrogen 0.030–0.070 Titanium 0.01 ^F Tungsten 1.50–2.00 Vanadium 0.15–0.25 Zirconium 0.01 ^F

^A When fittings are of welded construction, the grade and marking symbol shown above shall be supplemented by letter "W". ^B Fittings made from bar or plate may have 0.35 max carbon.

- $^{\it C}$ Fittings made from forgings may have 0.35 max carbon and 0.35 max silicon with no minimum.
- ^D For each reduction of 0.01 % below the specified carbon maximum, an increase of 0.06 % manganese above the specified maximum will be permitted, up to a maximum of 1.65 %.
- ^E The sum of Copper, Nickel, Chromium, and Molybdenum shall not exceed 1.00 %.
- FApplies both to heat and product analyses.
- ^GColumbium (Cb) and Niobium (Nb) are alternate names for element 41 in the Periodic Table of the Elements.
- "Chromium Nickel Balance is defined as CNB = (Cr + 6Si + 4Mo + 1.5W + 11V + 5Nb + 9Ti + 12Al) (40C + 30N + 4Ni + 2Mn + 1Cu)

accordance with Section 14 on Surface Quality. After the removal of any crack, the tee(s) shall be re-examined by the original method. Acceptable tees shall be marked with the symbol PT or MT, as applicable, to indicate compliance.

6.7 Stubends may be produced with the entire lap added by the welding of a ring, made from plate or bar of the same alloy grade and composition, to the outside of a straight section of pipe, provided the weld is double welded, is a full penetration joint, satisfies the requirements of 6.3 for qualifications and 7.3.4 for post weld heat treatment.

7. Heat Treatment

- 7.1 Heat Treatment Procedures—Fittings, after forming at an elevated temperature, shall be cooled to a temperature below the critical range under suitable conditions to prevent injurious defects caused by too rapid cooling, but in no case more rapidly than the cooling rate in still air. Heat treatment temperatures specified are metal (part) temperatures. Heat-treated fittings shall be treated according to Section 7 in Specification A960/A960M.
 - 7.2 WPB, WPC, and WPR Fittings:
- 7.2.1 Hot-formed WPB, WPC, and WPR fittings upon which the final forming operation is completed at a temperature above 1150 °F [620 °C] and below 1800 °F [980 °C] need not be heat treated provided they are cooled in still air.
- 7.2.2 Hot-formed or forged WPB, WPC, and WPR fittings finished at temperature in excess of 1800 °F [980 °C] shall subsequently be annealed, normalized, or normalized and tempered. Hot-forged fittings NPS 4 or smaller need not be heat treated.
- 7.2.3 WPB, WPC, and WPR fittings over NPS 12, produced by locally heating a portion of the fitting stock to any temperature for forming, shall be subsequently annealed, normalized, or normalized and tempered. Fittings such as elbows, tees, header tees, reducers and lap joint stub ends with a carbon content less than 0.26 %, NPS 12 and under, shall not require heat treatment after forming a locally heated portion of the fitting.
- 7.2.4 Cold-formed WPB, WPC, and WPR fittings, upon which the final forming operation is completed at a temperature below 1150 $^{\circ}$ F [620 $^{\circ}$ C], shall be normalized, or shall be stress relieved at 1100 to 1275 $^{\circ}$ F [595 to 690 $^{\circ}$ C].
- 7.2.5 WPB, WPC, and WPR fittings produced by fusion welding and having a nominal wall thickness at the welded joint of ³/₄ in. [19 mm] or greater shall be post-weld heat treated at 1100 to 1250 °F [595 to 675 °C], or in accordance with 7.2.6.
- 7.2.6 At the option of the manufacturer, WPB and WPC fittings produced by any of the methods in Section 6 may be annealed, normalized, or normalized and tempered.
 - 7.3 Fittings Other than WPB, WPC, and WPR:

- 7.3.1 Fittings of Grades WP1, WP11 Class 1, WP11 Class 2, WP11 Class 3, WP12 Class 1, WP12 Class 2, WP22 Class 1, WP22 Class 3, WP5, and WP9 shall be furnished in the annealed, isothermal-annealed, or normalized and tempered condition. If normalized and tempered, the tempering temperature for WP11 Class 1, WP11 Class 2, WP11 Class 3, WP12 Class 1, and WP12 Class 2 shall not be less than 1150 °F [620 °C]; for Grades WP5, WP9, WP22 Class 1, and WP22 Class 3 the tempering temperature shall not be less than 1250 °F [675 °C].
- 7.3.2 Fittings of Grades WP1, WP12 Class 1, or WP12 Class 2 either hot formed or cold formed may be given a final heat treatment at $1200 \,^{\circ}\text{F}$ [650 $^{\circ}\text{C}$] instead of the heat treatment specified in 7.3.1.
- 7.3.3 Fittings of WP24 either hot formed or cold formed shall be furnished in the normalized and tempered condition. The normalizing temperature range shall be 1800 to 1975 °F [980 to 1080 °C]. The tempering temperature range shall be 1350 to 1470 °F [730 to 800 °C].
- 7.3.4 Fittings in all thicknesses produced by fusion welding after the heat treatment specified in 7.3.1 shall be post-weld heat treated at a temperature not less than prescribed above for tempering except that Grade WP1 Type 1 and Type 2 are required to be post-weld heat treated only when the nominal wall thickness at the welded joint is ½ in. [13 mm] or greater, and except that preheat and post weld heat treatment are not required for WP24 fittings whose section thickness does not exceed 0.500 in. [12.7 mm].
- 7.3.5 Except when Supplementary Requirement S1 is specified by the purchaser, Grade WP91 Type 1 and Type 2 shall be normalized at 1900 °F [1040 °C] minimum, and 1975 °F [1080 °C] maximum, and tempered in the temperature range of 1350 °F [730 °C] to 1470 °F [800 °C] as a final heat treatment.
- 7.3.6 Grade WP911 shall be normalized in the temperature range of 1900 to 1975 °F [1040 to 1080 °C], and tempered in the temperature range of 1365 to 1435 °F [740 to 780 °C] as a final heat treatment.
- 7.3.7 Grade WP92 shall be normalized at 1900 °F [1040 °C] minimum, and 1975 °F [1080 °C] maximum, and tempered in the temperature range of 1350 °F [730 °C] to 1470 °F [800 °C] as a final heat treatment.
- 7.3.8 Grade WP115 shall be normalized in the temperature range of 1920 $^{\circ}$ F [1050 $^{\circ}$ C] to 2010 $^{\circ}$ F [1100 $^{\circ}$ C].
- 7.4 WPB and WPC Fittings Made from Bar—Cold-finished bars reduced in cross-sectional area more than 10 % by cold drawing or cold rolling are not acceptable for use in the manufacture of these fittings unless the bars have been either stress relieved in the temperature range of 1100 to 1250 °F [595 to 675 °C], normalized, normalized and tempered, or

TABLE 2 Tensile Requirements

Note 1—Where an ellipsis (...) appears in this table, there is no requirement.

Grade and Marking Symbol	WPB	WPC, WP11 CL2, WP12 CL2	WP1	WP11 CL1, WP22 CL1, WP5 CL1 WP9 CL1	WPR	WP11 CL3, WP22 CL3 WP5 CL3 WP9 CL3	WP24	WP91 Types 1 and 2	WP92 WP911	WP115	WP12 CL1
Tensile strength, minimum unless	60 [415]	70 [485]	55-80	60 [415]	63-88	75 [520]	85 [585]	90 [620]	90-120	90 [620]	60 [415]
a range is given ksi [MPa]			[380-550]		[435-605]				[620-840]		
Yield strength, min, ksi [MPa]	35 [240]	40 [275]	30 [205]	30 [205]	46 [315]	45 [310]	60 [415]	60 [415]	64 [440]	65 [450]	32 [220]
(0.2 % offset or 0.5 %											
extension-											
under-load)											

	Elongation Requirements Grades					
	All Grades except WPR, WP91 Type 1 and Type 2, WP115 and WP911		WPR an	d WP24	WF	es 1 and 2 292 1115 1911
	Longi- tudinal	Trans- verse	Longi- tudinal	Trans- verse	Longi- tudinal	Trans- verse
Elongation:						
Standard round specimen, or small proportional specimen, min % in 4 D	22	14	20		20	13
Rectangular specimen for wall thickness 5/16 in. [7.94 mm] and over,	30	20 ^A	28			
and for all small sizes tested in full section; min % in 2 in. [50 mm] Rectangular specimen for wall thickness less than 5/16 in. [7.94 mm]; min % in 2 in. [50 mm] (½-in. [12.7-mm] wide specimen)	В	В	В			

^A WPB and WPC fittings manufactured from plate shall have a minimum elongation of 17 %.

^B For each ½2 in. [0.79 mm] decrease in wall thickness below 5/16 in. [7.94 mm], a deduction of 1.5 % for longitudinal and 1.0 % for transverse from the values shown above is permitted. The following table gives the minimum value for various wall thicknesses.

				Grades	3	
	Wall Thickne	ss	All Grades except WPR, WP91 Type 1 and Type 2, WP115, and WP911 WPR			WP91 Types 1 and 2, WP92, WP115, and WP911
	in.	[mm]	Longitudinal	Transverse	Longitudinal	Longitudinal
5/16	(0.312)	7.94	30.0	20.0	28.0	20
9/32	(0.281)	7.14	28.5	19.0	26.5	19
1/4	(0.250)	6.35	27.0	18.0	25.0	18
7/32	(0.219)	5.56	25.5		23.5	17
3/16	(0.188)	4.76	24.0		22.0	16
5/32	(0.156)	3.97	22.5		20.5	15
1/8	(0.125)	3.17	21.0		19.0	14
3/32	(0.094)	2.38	19.5		17.5	13
1/16	(0.062)	1.59	18.0		16.0	12

Note—This table gives the computed minimum % elongation value for each $\frac{1}{2}$ in. [0.79 mm] decrease in wall thickness. Where the wall thickness lies between two values above, the minimum elongation value is determined by the following equations:

Direction of Test Equation

Longitudinal E = 48t + 15.00Transverse E = 32t + 10.00

where:

334

E = elongation in 2 in. or [50 mm], %, and

t = actual thickness of specimen, in. [mm].

annealed. Mechanical testing must be performed subsequent to the final heat-treating operation.

- 7.5 Liquid quenching followed by tempering shall be permitted for all grades when approved by the purchaser. Minimum tempering temperature shall be 1100 °F [595 °C] for WPB, WPC, and WPR, 1150 °F [620 °C] for Grades WP1 Type 1 and Type 2, WP11 Class 1, WP11 Class 2, WP 12 Class 1, and WP12 Class 2 and 1250 °F [675 °C] for Grades WP5, WP9, WP22 Class 1, 1350 °F [730 °C] for both Grade WP91 Type 1 and Type 2 and WP911 and 1380 °F [750 °C] for Grade WP115. The tempering temperature range for WP24 shall be as in 7.3.3.
- 7.5.1 Liquid quenching followed by tempering for grades WP11 Class 3 and WP22 Class 3 shall be permitted at the manufacturer's option unless otherwise provided in the purchase order. The minimum tempering temperature for WP11 Class 3 shall be 1150 °F [620 °C] and for WP22 Class 3 shall be 1250 °F [675 °C].

8. Chemical Composition

- 8.1 The chemical composition of each cast or heat used shall be determined and shall conform to the requirements of the chemical composition for the respective materials listed in Table 1. The ranges as shown have been expanded to include variations of the chemical analysis requirements that are listed in the various specifications for the starting materials (pipe, tube, plate, bar, and forgings) normally used in the manufacturing of fittings to this specification.
- 8.2 The steel shall not contain any unspecified elements for the ordered grade to the extent that it conforms to the requirements of another grade for which that element is a specified element having a required minimum content.
- 8.3 Weld metal used in the construction of carbon-steel fittings shall be mild steel analysis No. A1 of Table QW-442, Section IX of the ASME Boiler and Pressure Vessel Code, No. A2 may be used for Grade WPCW.
- 8.4 The molybdenum and chromium content of the deposited weld metal of alloy steel fittings shall be within the same percentage range as permitted for the base metal.
- 8.5 Weld metal used in the construction of WP24 fittings shall be of the composition: 2.25 % Cr, 1 % Mo, 0.25 % V.

9. Tensile Requirements

- 9.1 The tensile properties of the fitting material shall conform to the requirements listed in Table 2.
- 9.1.1 Longitudinal or transverse specimens cut from either a fitting or from the starting plate or pipe they were manufactured from shall be acceptable for the tension test. For fittings made from forgings, the test specimen shall meet the requirements of Specification A105/A105M for the tension test.
- 9.1.2 While Table 2 specifies elongation requirements for both longitudinal and transverse specimens, it is not the intent that both requirements apply simultaneously. Instead, it is intended that only the elongation requirement that is appropriate for the specimen used be applicable.
- 9.2 One tension test shall be made on each heat of material and in the same condition of heat treatment as the finished

- fittings it represents. Where plate or pipe is used for the test specimen, the specimen thickness tested shall represent all fittings made from the same heat of material in the same heat treat condition in any thickness up to and including the tested thickness. Same heat treatment condition means that the same type of heat treatment (for example, stress relieve, normalize) and the same heat treating cycles (temperatures, time at temperature (minimum), temperature uniformity of ±25 °F [±14 °C], cooling method, etc.) are used (see 9.3 of Specification A960/A960M for furnace uniformity requirement).
- 9.3 When cold-formed fittings are furnished, samples of the raw material shall be normalized or stress relieved as required in 7.2.4. Tension tests conducted on these heat-treated samples shall be considered to be the tensile properties of the cold-formed fittings.
- 9.4 Records of raw material test report of the tension tests shall be certification that the material of the fitting meets the tensile requirements of this specification provided the heat treatments of the finished fitting are the same as the raw material test report. If the raw material was not tested, or the fitting is not in the same condition of heat treatment, the fitting manufacturer shall perform the required test on material representative of the finished fitting from each heat of starting material. For fittings that are not heat treated in accordance with 7.2.1 or 7.2.3, the raw material test report data can be used to represent the fitting properties provided the heat treatments are the same.
- 9.5 When testing of the finished fittings is requested by the purchaser, see Supplementary Requirement S51 in Specification A960/A960M.

10. Hardness

- 10.1 Except when only one fitting is produced, and except for Grade WP91 Type 1 and Type 2, a minimum of two pieces per batch or continuous run shall be hardness tested to ensure the fittings are within the following limits for each grade in Table 2. The purchaser may verify that the requirement has been met by testing at any location on the fitting provided such testing does not render the fitting useless.
- 10.1.1 Fittings of Grades WP5, WP9, and WPR—217 HBW maximum.
- 10.1.2 Fittings of Grade WP24 and WP911—248 HBW maximum.
 - 10.1.3 Fittings of Grade WP92—269 HBW maximum.
 - 10.1.4 Fittings of all other grades—197 HBW maximum.
- 10.2 All fittings of Grade WP91 Type 1 and Type 2 and WP115 shall be hardness tested and shall have a hardness of 190 HBW-250 HBW.
- 10.3 When additional hardness testing of the fittings is required, see Supplementary Requirement S57 in Specification A960/A960M.

11. Hydrostatic Tests

11.1 See Specification A960/A960M.

12. Nondestructive Examination

12.1 For WP91 Type 1 and Type 2 and WP92 fittings, one of the following examinations, as found in the Supplementary

Requirements of Specification A960/A960M, shall be performed: S52 Liquid Penetrant Examination, S53 Magnetic Particle Examination, S62 Ultrasonic Test, or S72 Nondestructive Electromagnetic (Eddy-Current) Test.

13. Dimensions

- 13.1 Butt-welding fittings and butt-welding short radius elbows and returns purchased in accordance with this specification shall conform to the dimensions and tolerances given in the latest revision of ASME B16.9. Steel socket-welding and threaded fittings purchased in accordance with this specification shall conform to the sizes, shapes, dimensions, and tolerances specified in the latest revision of ASME B16.11, MSS-SP-79, or MSS-SP-83. Swage(d) Nipples, Bull Plugs, and Integrally Reinforced Forged Branch Outlet Fittings purchased in accordance with this specification shall conform to the sizes, shapes, dimensions, and tolerances specified in the latest revision of MSS-SP-95 or MSS-SP-97.
- 13.2 Fittings of size or shape differing from these standards, but meeting all other requirements of this specification may be furnished in accordance with Supplementary Requirement S58 in Specification A960/A960M.

14. Surface Finish, Appearance, and Corrosion Protection

14.1 The requirements of Specification A960/A960M apply.

15. Repair by Welding

- 15.1 See Specification A960/A960M.
- 15.2 In addition to the requirements for weld repair of Specification A960/A960M, weld repairs to WP91 Type 1 and Type 2 fittings shall meet the requirements of 6.3.1.
- 15.3 In addition to the requirements for weld repair of Specification A960/A960M, weld repairs to WP24 fittings shall meet the requirements of 8.5. The recommended preheat and interpass temperature ranges are 200 to 400 °F [95 to 205 °C]. Weld repairs to WP24 fittings shall be post weld heat treated at 1350 to 1470 °F [730 to 800 °C], except that preheat and post weld heat treatment are not required for WP24 fittings whose section thickness does not exceed 0.500 in. [12.7 mm].

16. Inspection

- 16.1 See Specification A960/A960M.
- 16.2 Other tests, when required by agreement, shall be made from material of the lots covered in the order.

17. Rejection and Rehearing

17.1 Material that fails to conform to the requirements of this specification may be rejected. Rejection should be reported to the producer or supplier promptly in writing. In case of dissatisfaction with the results of the tests, the producer or supplier may make claim for a rehearing.

17.2 Fittings that develop defects in shopworking or application operations may be rejected. Upon rejection, the manufacturer shall be notified promptly in writing.

18. Certification

- 18.1 Test reports are required for all fittings covered by this specification. Each test report shall meet the requirements for certification in A960/A960M as well as include the following information specific to this specification:
- 18.1.1 Chemical analysis results, Section 8 (Table 1), reported results shall be to the same number of significant figures as the limits specified in Table 1 for that element.
- 18.1.2 Tensile property results, Section 9 (Table 2), report the yield strength and tensile strength in ksi [MPa] and elongation in percent,
 - 18.1.3 Hardness results, Section 10,
 - 18.1.4 Type heat treatment, if any, Section 7,
 - 18.1.5 Seamless or welded,
 - 18.1.6 Starting material, specifically pipe, plate, etc.,
- 18.1.7 Statement regarding radiographic or ultrasonic examination, Section 6.3, and
- 18.1.8 Any supplementary testing required by the purchase order.

19. Product Marking

- 19.1 In addition to marking requirements of A960/A960M, the following marking requirements shall apply:
- 19.1.1 Butt-welding fittings shall be marked with the fitting designation for marking in accordance with Annex A1.
- 19.1.2 Butt-welding fittings containing welds that have been ultrasonically examined instead of radiography shall be marked U after heat identity.
- 19.1.3 Threaded or socket-welding fittings shall be marked with the pressure class and fitting designation for marking in accordance with Annex A1. Plugs and bushings furnished to ASME B16.11 requirements are not required to be marked.
- 19.1.4 When agreed upon between the purchaser and manufacturer, and specified in the order, the markings shall be painted or stenciled on the fitting or stamped on a metal or plastic tag which shall be securely attached to the fitting.
- 19.1.5 WP91 material shall additionally be marked with the appropriate Type.
- 19.2 Bar Coding—In addition to the requirements in 19.1, bar coding is acceptable as a supplemental identification method. The purchaser may specify in the order a specific bar coding system to be used. The bar coding system, if applied at the discretion of the supplier, should be consistent with one of the published industry standards for bar coding. If used on small fittings, the bar code may be applied to the box or a substantially applied tag.

20. Keywords

20.1 pipe fittings—steel; piping applications; pressure containing parts; pressure vessel service; temperature service applications—elevated

SUPPLEMENTARY REQUIREMENTS

These requirements shall not be considered unless specified in the order, in which event, the supplementary requirements specified shall be made at the place of manufacture, unless otherwise agreed upon, at the purchaser's expense. The test specified shall be witnessed by the purchaser's inspector before shipment of material, if so specified in the order.

S1. Alternative Heat Treatment—Grade WP91 Type 1 and Type 2

S1.1 Grade WP91 Type 1 and Type 2 shall be normalized in accordance with 7.3.5 and tempered at a temperature, to be specified by the purchaser, less than 1350 °F [730 °C]. It shall be the purchaser's responsibility to subsequently temper the entire fitting in the temperature range of 1350 °F [730 °C] to 1470 °F [800 °C] as a final heat treatment. All mechanical tests shall be made on material heat treated in accordance with 7.3.5. The certification shall reference this supplementary requirement indicating the actual tempering temperature applied. The notation "S1" shall be included with the required marking of the fitting.

S2. Restricted Vanadium Content

S2.1 The vanadium content of the fittings shall not exceed 0.03 %.

S3. Carbon Equivalent

S3.1 For grades WPB and WPC, the maximum carbon equivalent (C.E.), based on heat analysis and the following formula, shall be 0.50.

C.E. =
$$C + \frac{Mn}{6} + \frac{Cr + Mo + V}{5} + \frac{Ni + Cu}{15}$$

S3.2 A lower maximum carbon equivalent may be agreed upon between the purchaser and the supplier.

S3.3 The C.E. shall be reported on the test report.

S4. ASME Section III Construction

- S4.1 Products welded with filler metal furnished under this specification that are intended for application under the rules of Section III of the ASME Boiler and Pressure Vessel Code shall be manufactured by holders of the appropriate ASME Certificate of Authorization and Certification Mark. The product is subject to all applicable requirements of Section III, including welding, heat treatment, nondestructive examination, authorized inspection at the point of manufacture, and application of the Certification Mark.
- S4.2 The applicable ASME Partial Data Report form, signed by an Authorized Nuclear Inspector, and a material test report shall be furnished for each lot of pipe fittings.
- S4.3 The material used to fabricate the pipe fittings shall conform to the applicable SA specification in ASME Boiler and Pressure Vessel Code, Section II. The welded joints shall be full penetration butt welds as obtained by double welding or by other means that will obtain the same quality of deposited weld metal on the inside and outside. Welds using metal backing strips that remain in place are prohibited.
- S4.4 Each piece of pipe fitting shall be so marked as to identify each such piece of pipe fitting with the lot and the material test report.

ANNEX

(Mandatory Information)

A1. FITTING DESIGNATION FOR MARKING PURPOSES

TABLE A1.1 Fitting Designation for Marking Purposes

Grade	Class	Construction	Mandatory Marking
WPB		W (Welded construction)	WPBW ^A
		S (Seamless construction)	WPB
WPC		W (Welded construction)	WPCW ^A
		S (Seamless construction)	WPC
WP1		W (Welded construction)	WP1W ^A
		S (Seamless construction)	WP1
WP12	CL1	W (Welded construction)	WP12 CL1W ^A
		S (Seamless construction)	WP12 CL1
	CL2	W (Welded construction)	WP12 CL2W ^A
		S (Seamless construction)	WP12 CL2
WP11	CL1	W (Welded construction)	WP11 CL1W ^A
		S (Seamless construction)	WP11 CL1
	CL2	W (Welded construction)	WP11 CL2W ^A
		S (Seamless construction)	WP11 CL2
	CL3	W (Welded construction)	WP11 CL3W ^A
		S (Seamless construction)	WP11 CL3
WP22	CL1	W (Welded construction)	WP22 CL1W ^A
		S (Seamless construction)	WP22 CL1
	CL3	W (Welded construction)	WP22 CL3W ^A
		S (Seamless construction)	WP22 CL3
WP5	CL1	W (Welded construction)	WP5 CL1W ^A
		S (Seamless construction)	WP5 CL1
	CL3	W (Welded construction)	WP5 CL3 W ^A
		S (Seamless construction)	WP5 CL3
WP9	CL1	W (Welded construction)	WP9 CL1 W ^A
		S (Seamless construction)	WP9 CL1
	CL3	W (Welded construction)	WP9 CL3 W ^A
		S (Seamless construction)	WP9 CL3
WPR		W (Welded construction)	WPR W ^A
		S (Seamless construction)	WPR
WP91 Type 1		W (Welded construction)	WP91T1W ^A
		S (Seamless construction)	WP91T1
WP91 Type 2		W (Welded construction)	WP91T2W ^A
		S (Seamless construction)	WP91T2
WP92		W (Welded construction)	WP92W ^A
		S (Seamless construction)	WP92
WP115		W (Welded construction)	WP115W ^A
		S (Seamless construction)	WP115
WP911		W (Welded construction)	WP911W ^A
		S (Seamless construction)	WP911

Add "U" to marking if welds are ultrasonic inspected in lieu of radiography.

SPECIFICATION FOR CHROMIUM AND CHROMIUM-NICKEL STAINLESS STEEL PLATE, SHEET, AND STRIP FOR PRESSURE VESSELS AND FOR GENERAL APPLICATIONS



SA-240/SA-240M



(Identical with ASTM Specification A240/A240M-17.)

Standard Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications

1. Scope

- 1.1 This specification covers chromium, chromium-nickel, and chromium-manganese-nickel stainless steel plate, sheet, and strip for pressure vessels and for general applications including architectural, building, construction, and aesthetic applications.
- 1.2 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.3 This specification is expressed in both inch-pound and SI units. However, unless the order specifies the applicable "M" specification designation (SI units), the material shall be furnished in inch-pound units.
- 1.4 This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.
- 1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A480/A480M Specification for General Requirements for Flat-Rolled Stainless and Heat-Resisting Steel Plate, Sheet, and Strip
- A923 Test Methods for Detecting Detrimental Intermetallic Phase in Duplex Austenitic/Ferritic Stainless Steels
- E112 Test Methods for Determining Average Grain Size
- E140 Hardness Conversion Tables for Metals Relationship Among Brinell Hardness, Vickers Hardness, Rockwell Hardness, Superficial Hardness, Knoop Hardness, Scleroscope Hardness, and Leeb Hardness
- E527 Practice for Numbering Metals and Alloys in the Unified Numbering System (UNS)
- 2.2 SAE Standard:
- J 1086 Practice for Numbering Metals and Alloys (UNS)

3. General Requirements

- 3.1 The following requirements for orders for material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A480/A480M.
 - 3.1.1 Definitions;
 - 3.1.2 General requirements for delivery;
 - 3.1.3 Ordering information;
 - 3.1.4 Process;
 - 3.1.5 Special tests;
 - 3.1.6 Heat treatment;

- 3.1.7 Dimensions and permissible variations;
- 3.1.8 Workmanship, finish and appearance;
- 3.1.9 Number of tests/test methods;
- 3.1.10 Specimen preparation;
- 3.1.11 Retreatment;
- 3.1.12 Inspection;
- 3.1.13 Rejection and rehearing;
- 3.1.14 Material test report;
- 3.1.15 Certification; and
- 3.1.16 Packaging, marking, and loading.

4. Chemical Composition

4.1 The steel shall conform to the requirements as to chemical composition specified in Table 1 and shall conform to applicable requirements specified in Specification A480/A480M.

5. Mechanical Properties

5.1 The material shall conform to the mechanical properties specified in Table 2.

- 5.2 When specified by the purchaser, Charpy impact tests shall be performed in accordance with Supplementary Requirement S1.
- 5.3 When specified by the purchaser, 1 % offset yield strength shall be measured and reported in accordance with Supplementary Requirement S3.

6. Materials for High-Temperature Service

- 6.1 The austenitic H Types shall conform to an average grain size of ASTM No. 7 or coarser as measured by Test Methods E112.
- 6.2 Supplementary Requirement S2 shall be invoked when non-H grade austenitic stainless steels are ordered for ASME Code applications for service above 1000°F [540°C].
- 6.3 Grade S31060, unless otherwise specified in the purchase order, shall conform to an average grain size of ASTM No. 7 or coarser, as measured by Test Methods E112.

7. Keywords

7.1 architectural; building; chromium; chromium-nickel stainless steel; chromium-manganese-nickel stainless steel; construction; pressure vessels

TABLE 1 Chemical Composition Requirements, %^A

UNS	- 0	0 : 0		Phos-		Composition				A Pri		Other
Designation ^B	Type ^C	Carbon ^D	Manganese	phorus	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen	Copper	Elements ^{E, F}
						-Nickel) (Chromiui						
N08020		0.07	2.00	0.045	0.035	1.00	19.0–21.0	32.0–38.0	2.00-3.00		3.00-4.00	Cb 8×C min, 1.00 max
N08367		0.030	2.00	0.040	0.030	1.00	20.0-22.0	23.5–25.5	6.0-7.0	0.18-0.25	0.75	
N08700		0.04	2.00	0.040	0.030	1.00	19.0–23.0	24.0–26.0	4.3–5.0		0.50	Cb 8×C min 0.40 max
N08800	800 ^{<i>G</i>}	0.10	1.50	0.045	0.015	1.00	19.0–23.0	30.0–35.0			0.75	Fe ^H 39.5 min Al 0.15–0.60 Ti 0.15–0.60
N08810	800H ^G	0.05-0.10	1.50	0.045	0.015	1.00	19.0–23.0	30.0–35.0	• • •		0.75	Fe ^H 39.5 min Al 0.15–0.60 Ti 0.15–0.60
N08811		0.06-0.10	1.50	0.040	0.015	1.00	19.0–23.0	30.0–35.0			0.75	Fe ^H 39.5 min Ti ^I 0.25–0.60 Al ^I 0.25–0.60
N08904	904L ^G	0.020	2.00	0.045	0.035	1.00	19.0-23.0	23.0-28.0	4.00-5.00	0.10	1.00-2.00	
N08925		0.020	1.00	0.045	0.030	0.50	19.0-21.0	24.0-26.0	6.00-7.00	0.10-0.20	0.80-1.50	
N08926		0.020	2.00	0.030	0.010	0.50	19.0-21.0	24.0-26.0	6.00-7.00	0.15-0.25	0.50-1.50	
S20100	201	0.15	5.50-7.50	0.060	0.030	1.00	16.0-18.0	3.5-5.5		0.25		
S20103		0.03	5.50-7.50	0.045	0.030	0.75	16.0-18.0	3.5-5.5		0.25		
S20153		0.03	6.40–7.50	0.045	0.015	0.75	16.0–17.5	4.0-5.0		0.10-0.25	1.00	
S20161		0.15	4.00–6.00	0.040	0.040	3.00-4.00	15.0–18.0	4.0–6.0		0.08-0.20		
S20200	202	0.15	7.50–10.00	0.060	0.030	1.00	17.0–19.0	4.0–6.0		0.25		
S20400		0.030	7.00–9.00	0.040	0.030	1.00	15.0–17.0	1.50-3.00		0.15-0.30		
S20400 S20431		0.12	5.00-7.00	0.045	0.030	1.00	17.0–18.0	2.0-4.0		0.10-0.25	1.50–3.50	
S20431 S20432		0.12	3.00-7.00	0.045	0.030	1.00	17.0–18.0	4.0-6.0		0.10-0.23	2.00–3.00	
S20433	· · · ·	0.08	5.50-7.50	0.045	0.030	1.00	17.0–18.0	3.5–5.5	4.50.000	0.10-0.25	1.50–3.50	0
S20910	XM-19 ³	0.06	4.00–6.00	0.040	0.030	0.75	20.5–23.5	11.5–13.5	1.50–3.00	0.20-0.40		Cb 0.10-0.30 V 0.10-0.30
S21400	XM-31 ^J	0.12	14.00-16.00	0.045	0.030	0.30-1.00	17.0-18.5	1.00		0.35 min		
S21600	XM-17 ^J	0.08	7.50-9.00	0.045	0.030	0.75	17.5-22.0	5.0-7.0	2.00-3.00	0.25-0.50		
S21603	XM-18 ^J	0.03	7.50-9.00	0.045	0.030	0.75	17.5-22.0	5.0-7.0	2.00-3.00	0.25-0.50		
S21640		0.08	3.50–6.50	0.060	0.030	1.00	17.5–19.5	4.0–6.5	0.50-2.00	0.08-0.30		Cb 0.10-1.00
S21800		0.10	7.00–9.00	0.060	0.030	3.5–4.5	16.0–18.0	8.0–9.0		0.08-0.18		
S21904	XM-11 ^J	0.04	8.00–10.00	0.060	0.030	0.75	19.0–21.5	5.5–7.5		0.15-0.40		
S24000	XM-29 ^J	0.08	11.50–14.50	0.060	0.030	0.75	17.0–19.0	2.3–3.7		0.20-0.40		
S30100	301	0.15	2.00	0.045	0.030	1.00	16.0–18.0	6.0–8.0		0.10		
S30100 S30103	301L ^G	0.13	2.00	0.045	0.030	1.00	16.0–18.0	6.0–8.0		0.10		
S30153	301LN ^G	0.03	2.00	0.045	0.030	1.00	16.0–18.0			0.20		
								6.0–8.0				• • •
S30200	302 304	0.15	2.00	0.045	0.030	0.75	17.0–19.0	8.0–10.0		0.10		
S30400		0.07	2.00	0.045	0.030	0.75	17.5–19.5	8.0–10.5		0.10		
S30403	304L	0.030	2.00	0.045	0.030	0.75	17.5–19.5	8.0–12.0		0.10		
S30409	304H	0.04-0.10	2.00	0.045	0.030	0.75	18.0–20.0	8.0–10.5				
S30415		0.04-0.06	0.80	0.045	0.030	1.00-2.00	18.0–19.0	9.0–10.0		0.12-0.18		Ce 0.03-0.08
S30435		0.08	2.00	0.045	0.030	1.00	16.0–18.0	7.0–9.0			1.50-3.00	
S30441		0.08	2.00	0.045	0.030	1.0–2.0	17.5–19.5	8.0–10.5	• • •	0.10	1.5–2.5	Cb 0.1–0.5 W 0.2–0.8
S30451	304N	0.08	2.00	0.045	0.030	0.75	18.0–20.0	8.0-10.5		0.10-0.16		
S30452	XM-21 ^J	0.08	2.00	0.045	0.030	0.75	18.0-20.0	8.0-10.5		0.16-0.30		
S30453	304LN	0.030	2.00	0.045	0.030	0.75	18.0-20.0	8.0-12.0		0.10-0.16		
S30500	305	0.12	2.00	0.045	0.030	0.75	17.0-19.0	10.5-13.0				
S30530		0.08	2.00	0.045	0.030	0.50-2.50	17.0-20.5	8.5-11.5	0.75-1.50		0.75-3.50	
S30600		0.018	2.00	0.020	0.020	3.7-4.3	17.0-18.5	14.0-15.5	0.20		0.50	
S30616		0.020	1.50	0.030	0.015	3.9-4.7	16.5-18.5	13.0-15.5	0.50		0.40	Cb. 0.30-0.70
S30601		0.015	0.50-0.80	0.030	0.013	5.0-5.6	17.0-18.0	17.0-18.0	0.20	0.05	0.35	
S30615		0.16-0.24	2.00	0.030	0.030	3.2–4.0	17.0–19.5	13.5–16.0				Al 0.80-1.50
S30815		0.05-0.10	0.80	0.040	0.030	1.40-2.00	20.0–22.0	10.0–12.0		0.14-0.20		Ce 0.03-0.08
S30908	309S	0.08	2.00	0.045	0.030	0.75	22.0–24.0	12.0–15.0				
230300	0000	0.00	2.00	0.073	0.000	0.75	22.0-24.0	12.0-13.0				

TABLE 1 Continued

					IA	BLE 1 Continu	ied					
UNS Designation ^B	Type ^C	Carbon ^D	Manganese	Phos- phorus	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen	Copper	Other Elements ^{E, F}
S30909	309H ^G	0.04-0.10	2.00	0.045	0.030	0.75	22.0-24.0	12.0-15.0				
S30940	309Cb ^G	0.08	2.00	0.045	0.030	0.75	22.0-24.0	12.0-16.0				Cb 10×C min,
												1.10 max
S30941	309HCb ^G	0.04-0.10	2.00	0.045	0.030	0.75	22.0-24.0	12.0-16.0				Cb 10×C min,
												1.10 max
S31008	310S	0.08	2.00	0.045	0.030	1.50	24.0-26.0	19.0-22.0				
S31009	310H ^G	0.04-0.10	2.00	0.045	0.030	0.75	24.0-26.0	19.0–22.0				
S31040	310Cb ^G	0.08	2.00	0.045	0.030	1.50	24.0-26.0	19.0–22.0				Cb 10×C min,
												1.10 max
S31041	310HCb ^G	0.04-0.10	2.00	0.045	0.030	0.75	24.0–26.0	19.0-22.0				Cb 10×C min,
												1.10 max
S31050	310 MoLN ^G	0.020	2.00	0.030	0.010	0.50	24.0-26.0	20.5-23.5	1.60-2.60	0.09-0.15		
S31060		0.05-0.10	1.00	0.040	0.030	0.50	22.0-24.0	10.0–12.5		0.18-0.25		Ce + La
												0.025-0.070
												B 0.001-0.010
S31254		0.020	1.00	0.030	0.010	0.80	19.5–20.5	17.5–18.5	6.0–6.5	0.18-0.25	0.50-1.00	
S31266		0.030	2.00-4.00	0.035	0.020	1.00	23.0-25.0	21.0-24.0	5.2-6.2	0.35-0.60	1.00-2.50	W 1.50-2.50
S31277		0.020	3.00	0.030	0.010	0.50	20.5-23.0	26.0-28.0	6.5–8.0	0.30-0.40	0.50-1.50	
S31600	316	0.08	2.00	0.045	0.030	0.75	16.0-18.0	10.0-14.0	2.00-3.00	0.10		
S31603	316L	0.030	2.00	0.045	0.030	0.75	16.0-18.0	10.0-14.0	2.00-3.00	0.10		
S31609	316H	0.04-0.10	2.00	0.045	0.030	0.75	16.0-18.0	10.0-14.0	2.00-3.00			
S31635	316Ti ^{<i>G</i>}	0.08	2.00	0.045	0.030	0.75	16.0-18.0	10.0-14.0	2.00-3.00	0.10		Ti $5 \times (C + N)$
												min, 0.70 max
S31640	316Cb ^G	0.08	2.00	0.045	0.030	0.75	16.0-18.0	10.0-14.0	2.00-3.00	0.10		Cb 10 × C
												min, 1.10 max
S31651	316N	0.08	2.00	0.045	0.030	0.75	16.0-18.0	10.0-14.0	2.00-3.00	0.10-0.16		
S31653	316LN	0.030	2.00	0.045	0.030	0.75	16.0–18.0	10.0–14.0	2.00-3.00	0.10-0.16		
S31655		0.030	2.00	0.045	0.015	1.00	19.5–21.5	8.0–9.5	0.50-1.50	0.14-0.25	1.00	
S31700	317	0.08	2.00	0.045	0.030	0.75	18.0–20.0	11.0–15.0	3.0–4.0	0.10		
S31703	317L	0.030	2.00	0.045	0.030	0.75	18.0–20.0	11.0–15.0	3.0–4.0	0.10		
S31725	317LM ^G	0.030	2.00	0.045	0.030	0.75	18.0–20.0	13.5–17.5	4.0-5.0	0.20		
S31726	317LMN ^G	0.030	2.00	0.045	0.030	0.75	17.0–20.0	13.5–17.5	4.0-5.0	0.10-0.20		
S31727		0.030	1.00	0.043	0.030	1.00	17.5–19.0	14.5–16.5	3.8–4.5	0.15-0.21	2.80–4.00	
S31727		0.030	2.00			1.00	17.0–19.0	15.0–16.5				
	 317LN ^G	0.030	2.00	0.040	0.010 0.030	0.75		11.0–15.0	3.0–4.0 3.0–4.0	0.045 0.10–0.22	4.0–5.0	
S31753				0.045			18.0–20.0				0.40	
S32050		0.030	1.50	0.035	0.020	1.00	22.0–24.0	20.0–23.0	6.0–6.8	0.21-0.32	0.40	
S32053		0.030	1.00	0.030	0.010	1.00	22.0–24.0	24.0–26.0	5.0–6.0	0.17-0.22		 T. 5 (O. N)
S32100	321	0.08	2.00	0.045	0.030	0.75	17.0–19.0	9.0–12.0		0.10		Ti $5 \times (C + N)$
000100	00411	0.04.040	0.00	0.045		0.75	470 400	0 0 40 0				min, 0.70 max
S32109	321H	0.04-0.10	2.00	0.045	0.030	0.75	17.0–19.0	9.0–12.0				Ti $4 \times (C + N)$
000015		0.07	0.00	0.045		4.00.000	10 = 10 =	10.0.00.0	0.00 4.50		4 50 0 50	min, 0.70 max
S32615		0.07	2.00	0.045	0.030	4.80-6.00	16.5–19.5	19.0–22.0	0.30-1.50		1.50-2.50	
S32654		0.020	2.00-4.00	0.030	0.005	0.50	24.0-25.0	21.0-23.0	7.0–8.0	0.45-0.55	0.30-0.60	
S33228		0.04-0.08	1.00	0.020	0.015	0.30	26.0-28.0	31.0–33.0				Ce 0.05-0.10
												Cb 0.6-1.0
												Al 0.025
S33400	334 ^{<i>G</i>}	0.08	1.00	0.030	0.015	1.00	18.0-20.0	19.0–21.0				Al 0.15-0.60
												Ti 0.15–0.60
S33425		0.08	1.50	0.045	0.020	1.00	21.0-23.0	20.0-23.0	2.00-3.00			AI 0.15-0.60
												Ti 0.15-0.60
S33550		0.04-0.10	1.50	0.040	0.030	1.00	25.0-28.0	16.5-20.0		0.18-0.25		Cb 0.05-0.15
												La + Ce
												0.025-0.070
S34565		0.030	5.00-7.00	0.030	0.010	1.00	23.0-25.0	16.0-18.0	4.0-5.0	0.40-0.60		Cb 0.10
S34700	347	0.08	2.00	0.045	0.030	0.75	17.0–19.0	9.0–13.0				Cb 10 × C min,
										-		

TABLE 1 Continued

UNS Designation ^B	Type ^C	Carbon ^D	Manganese	Phos- phorus	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen	Copper	Other Elements ^{E, F}
S34709	347H	0.04-0.10	2.00	0.045	0.030	0.75	17.0–19.0	9.0-13.0				Cb 8 × C min, 1.00 max
S34751	347LN	0.005-0.020	2.00	0.045	0.030	1.00	17.0-19.0	9.0-13.0		0.06-0.10		Cb 0.20-0.50,
S34800	348	0.08	2.00	0.045	0.030	0.75	17.0–19.0	9.0–13.0				15 × C min (Cb + Ta) 10×C min, 1.00 max Ta 0.10 Co 0.20
S34809	348H	0.04–0.10	2.00	0.045	0.030	0.75	17.0–19.0	9.0–13.0	• • •		•••	(Cb + Ta) 8×C min, 1.00 max Ta 0.10 Co 0.20
S35045		0.06-0.10	1.50	0.045	0.015	1.00	25.0–29.0	32.0–37.0			0.75	AI 0.15-0.60 Ti 0.15-0.60
S35115		0.030	1.00	0.045	0.015	0.50-1.50	23.0-25.0	19.0-22.0	1.50-2.50	0.20-0.30		
S35125		0.10	1.00-1.50	0.045	0.015	0.50	20.0-23.0	31.0-35.0	2.00-3.00			Cb 0.25-0.60
S35135		0.08	1.00	0.045	0.015	0.60-1.00	20.0-25.0	30.0-38.0	4.0-4.8		0.75	Ti 0.40-1.00
S35140		0.10	1.00-3.00	0.045	0.030	0.75	20.0-22.0	25.0-27.0	1.00-2.00	0.08-0.20		Cb 0.25-0.75
S35315		0.04-0.08	2.00	0.040	0.030	1.20-2.00	24.0-26.0	34.0-36.0		0.12-0.18		Ce 0.03-0.10
S38100	XM-15 ^J	0.08	2.00	0.030	0.030	1.50-2.50	17.0–19.0	17.5–18.5				
S38815		0.030	2.00	0.040	0.020	5.50-6.50	13.0–15.0	15.0–17.0	0.75-1.50		0.75-1.50	AI 0.30
000010		0.000	2.00	0.010		lex (Austenitic-Fer		10.0 17.0	0.70 1.00		0.70 1.00	711 0.00
S31200		0.030	2.00	0.045	0.030	1.00	24.0–26.0	5.5-6.5	1.20-2.00	0.14-0.20		
S31260		0.03	1.00	0.030	0.030	0.75	24.0-26.0	5.5-7.5	2.5-3.5	0.10-0.30	0.20-0.80	W 0.10-0.50
S31803		0.030	2.00	0.030	0.020	1.00	21.0-23.0	4.5-6.5	2.5-3.5	0.08-0.20		
S32001		0.030	4.00-6.00	0.040	0.030	1.00	19.5–21.5	1.00-3.00	0.60	0.05-0.17	1.00	
S32003		0.030	2.00	0.030	0.020	1.00	19.5–22.5	3.0–4.0	1.50-2.00	0.14-0.20		
S32101		0.040	4.00-6.00	0.040	0.030	1.00	21.0–22.0	1.35–1.70	0.10-0.80	0.20-0.25	0.10-0.80	
S32202		0.030	2.00	0.040	0.010	1.00	21.5–24.0	1.00-2.80	0.45	0.18-0.26		
S32202 S32205	2205 ^{<i>G</i>}	0.030	2.00	0.040	0.010	1.00	22.0–23.0	4.5–6.5	3.0–3.5	0.14-0.20		
S32304	2304 ^G	0.030	2.50	0.030	0.020	1.00	21.5–24.5	3.0-5.5	0.05-0.60	0.14-0.20	0.05–0.60	
												W 0.05 0.00
S32506		0.030	1.00	0.040	0.015	0.90	24.0–26.0	5.5–7.2	3.0–3.5	0.08-0.20		W 0.05-0.30
S32520		0.030	1.50	0.035	0.020	0.80	24.0–26.0	5.5–8.0	3.0-4.0	0.20-0.35	0.50-2.00	
S32550	255 ^G	0.04	1.50	0.040	0.030	1.00	24.0-27.0	4.5–6.5	2.9–3.9	0.10-0.25	1.50-2.50	
S32750	2507 ^{G,O}	0.030	1.20	0.035	0.020	0.80	24.0-26.0	6.0–8.0	3.0-5.0	0.24-0.32	0.50	
S32760 ^K		0.030	1.00	0.030	0.010	1.00	24.0-26.0	6.0–8.0	3.0-4.0	0.20-0.30	0.50-1.00	W 0.50-1.00
S32808		0.030	1.10	0.030	0.010	0.50	27.0-27.9	7.0-8.2	0.80-1.2	0.30-0.40		W 2.10-2.50
S32900	329	0.08	1.00	0.040	0.030	0.75	23.0-28.0	2.0-5.00	1.00-2.00			
S32906		0.030	0.80-1.50	0.030	0.030	0.80	28.0-30.0	5.8–7.5	1.50-2.60	0.30-0.40	0.80	
S32950		0.030	2.00	0.035	0.010	0.60	26.0-29.0	3.5-5.2	1.00-2.50	0.15-0.35		
S39274		0.030	1.00	0.030	0.020	0.80	24.0-26.0	6.0-8.0	2.5-3.5	0.24-0.32	0.20-0.80	W 1.50-2.50
S81921		0.030	2.00-4.00	0.040	0.030	1.00	19.0-22.0	2.0-4.0	1.00-2.00	0.14-0.20		
S82011		0.030	2.00-3.00	0.040	0.020	1.00	20.5-23.5	1.0-2.0	0.10-1.00	0.15-0.27	0.50	
S82012		0.05	2.00-4.00	0.040	0.005	0.80	19.0-20.5	0.8-1.5	0.10-0.60	0.16-0.26	1.00	
S82013		0.060	2.50-3.50	0.040	0.030	0.90	19.5–22.0	0.5–1.5		0.20-0.30	0.20-1.20	
S82031		0.05	2.50	0.040	0.005	0.80	19.0–22.0	2.0-4.0	0.60-1.40	0.14-0.24	1.00	
S82121		0.035	1.00-2.50	0.040	0.010	1.00	21.0-23.0	2.0-4.0	0.30-1.30	0.15-0.25	0.20-1.20	
S82122		0.030	2.0–4.0	0.040	0.020	0.75	20.5–21.5	1.5–2.5	0.60	0.15-0.20	0.50-1.50	
S82441		0.030	2.50-4.00	0.035	0.005	0.70	23.0–25.0	3.0–4.5	1.00-2.00	0.20-0.30	0.10-0.80	
						or Martensitic (Chr		2.20	2.00		22 0.00	**
S32803		0.015	0.50	0.020	0.0035	0.55	28.0–29.0	3.0-4.0	1.80-2.50	0.020 (C+N) 0.030		Cb 12×(C+N) min, 0.15–0.50
S40300	403	0.15	1.00	0.040	0.030	0.50	11.5-13.0	0.60				0.10 0.00
S40500	405	0.13	1.00	0.040	0.030	1.00	11.5–13.0	0.60				Al 0.10-0.30
S40900 ^L	409 ^L	0.06	1.00	0.040	0.030	1.00	11.5-14.5	0.00				AI 0.10-0.30

ASME BPVC.II.A-2023

TABLE 1 Continued

					TA	BLE 1 Contil	nued					
UNS Designation ^B	Type ^C	Carbon ^D	Manganese	Phos- phorus	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen	Copper	Other Elements ^{E, F}
S40910		0.030	1.00	0.040	0.020	1.00	10.5–11.7	0.50		0.030		Ti 6×(C+N) min, 0.50 max; Cb 0.17
S40920		0.030	1.00	0.040	0.020	1.00	10.5–11.7	0.50		0.030		Ti 8×(C+N) min, Ti 0.15–0.50; Cb 0.10
S40930		0.030	1.00	0.040	0.020	1.00	10.5–11.7	0.50		0.030		(Ti+Cb) [0.08+8 ×(C+N)] min, 0.75 max;
S40945		0.030	1.00	0.040	0.030	1.00	10.5–11.7	0.50		0.030		Ti 0.05 min Cb 0.18–0.40 Ti 0.05–0.20
S40975		0.030	1.00	0.040	0.030	1.00	10.5–11.7	0.50-1.00		0.030		Ti 6×(C+N) min, 0.75 max
S40977		0.030	1.50	0.040	0.015	1.00	10.5-12.5	0.30-1.00		0.030		
S41000	410	0.08-0.15	1.00	0.040	0.030	1.00	11.5-13.5	0.75				
S41003		0.030	1.50	0.040	0.030	1.00	10.5-12.5	1.50		0.030		
S41008	410S	0.08	1.00	0.040	0.030	1.00	11.5-13.5	0.60				
S41045		0.030	1.00	0.040	0.030	1.00	12.0–13.0	0.50		0.030		Cb 9×(C+N) min, 0.60 max
S41050		0.04	1.00	0.045	0.030	1.00	10.5-12.5	0.60-1.10		0.10		
S41500 ^M		0.05	0.50-1.00	0.030	0.030	0.60	11.5-14.0	3.5-5.5	0.50-1.00			
S42000	420	0.15 min	1.00	0.040	0.030	1.00	12.0-14.0	0.75	0.50			
S42035		0.08	1.00	0.045	0.030	1.00	13.5–15.5	1.0–2.5	0.2–1.2			Ti 0.30-0.50
S42200	422	0.20-0.25	0.50-1.00	0.025	0.025	0.50	11.0–12.5	0.50-1.00	0.90-1.25			V 0.20-0.30,
S42900	429 ^G	0.12	1.00	0.040	0.030	1.00	14.0–16.0					W 0.90-1.25
S43000	430	0.12	1.00	0.040	0.030	1.00		0.75				
							16.0–18.0	0.75				T: [0.00, 4/O, N)]
S43035	439	0.030	1.00	0.040	0.030	1.00	17.0–19.0	0.50		0.030		Ti [0.20+4(C+N)] min, 1.10 max; Al 0.15
S43037		0.030	1.00	0.040	0.030	1.00	16.0-19.0					Ti 0.10-1.00
S43100	431	0.20	1.00	0.040	0.030	1.00	15.0-17.0	1.25-2.50				
S43400	434	0.12	1.00	0.040	0.030	1.00	16.0–18.0		0.75–1.25			
S43600	436	0.12	1.00	0.040	0.030	1.00	16.0–18.0		0.75-1.25			Cb 5×C min,
S43932		0.030	1.00	0.040	0.030	1.00	17.0–19.0	0.50		0.030		0.80 max (Ti+Cb)
543932		0.030	1.00	0.040	0.030	1.00	17.0–19.0	0.50	• • •	0.030		[0.20+4(C+N)] min, 0.75 max; AI 0.15
S43940		0.030	1.00	0.040	0.015	1.00	17.5–18.5			• • •		Ti 0.10–0.60 Cb [0.30+(3×C)] min
S44100		0.030	1.00	0.040	0.030	1.00	17.5–19.5	1.00		0.030		Ti 0.1-0.5 Cb [0.3 + (9× C)] min, 0.90 max
S44200	442	0.20	1.00	0.040	0.040	1.00	18.0-23.0	0.60				
S44330		0.025	1.00	0.040	0.030	1.00	20.0–23.0			0.025	0.30-0.80	(Ti+Cb) 8×(C+N) min,
S44400	444	0.025	1.00	0.040	0.030	1.00	17.5–19.5	1.00	1.75–2.50	0.035		0.80 max (Ti+Cb)[0.20+4(C+N)] min, 0.80 max
S44500		0.020	1.00	0.040	0.012	1.00	19.0–21.0	0.60		0.03	0.30-0.60	Cb 10×(C+N) min, 0.80 max
S44535		0.030	0.30-0.80	0.050	0.020	0.50	20.0–24.0				0.50	Ti 0.03–0.20 Ti 0.03–0.20 Al 0.50

TABLE 1 Continued

					17	DLL I COITH	lucu					
UNS Designation ^B	Type ^C	Carbon ^D	Manganese	Phos- phorus	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen	Copper	Other Elements ^{E, F}
S44536		0.015	1.00	0.040	0.030	1.00	20.0–23.0	0.5		0.015		(Ti+Cb) 8X(C+N)-0.8, Cb min 0.05
S44537		0.030	0.8	0.050	0.006	0.1–0.6	20.0–24.0	0.5		0.04	0.5	AI 0.1 W 1.0–3.0 Cb 0.2–1.0 Ti 0.02–0.20 La 0.04–0.20
S44626	XM-33 ^J	0.06	0.75	0.040	0.020	0.75	25.0–27.0	0.50	0.75-1.50	0.04	0.20	Ti 0.20-1.00; Ti 7(C+N) min
S44627	XM-27 ^J	0.010 ^N	0.40	0.020	0.020	0.40	25.0–27.5	0.50	0.75-1.50	0.015 ^N	0.20	Cb 0.05-0.20 (Ni + Cu) 0.50
S44635		0.025	1.00	0.040	0.030	0.75	24.5–26.0	3.5–4.5	3.5–4.5	0.035		(Ti+Cb) [0.20+4 (C+N)] min, 0.80 max
S44600	446	0.20	1.50	0.040	0.030	1.00	23.0-27.0	0.75		0.25		
S44660		0.030	1.00	0.040	0.030	1.00	25.0–28.0	1.0–3.5	3.0–4.0	0.040		(Ti+Cb) 0.20 – 1.00, Ti + Cb 6×(C+N) min
S44700		0.010	0.30	0.025	0.020	0.20	28.0-30.0	0.15	3.5-4.2	0.020	0.15	(C+N) 0.025
S44725		0.015	0.40	0.040	0.020	0.040	25.0–28.5	0.30	1.5–2.5	0.018		(Ti+Cb) ≥8×(C+N)
S44735		0.030	1.00	0.040	0.030	1.00	28.0–30.0	1.00	3.6–4.2	0.045		(Ti+Cb) 0.20-1.00, (Ti+Cb) 6× (C+N) min
S44800 S46800		0.010 0.030	0.30 1.00	0.025 0.040	0.020 0.030	0.20 1.00	28.0–30.0 18.0–20.0	2.00–2.50 0.50	3.5–4.2 	0.020 0.030	0.15	(C+N) 0.025 Ti 0.07-0.30 Cb 0.10-0.60 (Ti+Cb) [0.20+4 (C+N)] min, 0.80 max

A Maximum, unless range or minimum is indicated. Where ellipses (...) appear in this table, there is no requirement and the element need not be determined or reported.

^B Designation established in accordance with Practice E527 and SAE J 1086.

^C Unless otherwise indicated, a grade designation originally assigned by the American Iron and Steel Institute (AISI).

^D Carbon analysis shall be reported to nearest 0.01 % except for the low-carbon types, which shall be reported to nearest 0.001 %.

^E The terms Columbium (Cb) and Niobium (Nb) both relate to the same element.

F When two minimums or two maximums are listed for a single type, as in the case of both a value from a formula and an absolute value, the higher minimum or lower maximum shall apply.

^G Common name, not a trademark, widely used, not associated with any one producer.

^H Iron shall be determined arithmetically by difference of 100 minus the sum of the other specified elements.

^{&#}x27;(AI + Ti) 0.85-1.20.

J Naming system developed and applied by ASTM.

 $^{^{}K}$ Cr + 3.3 Mo + 16 N = 40 min.

^L S40900 (Type 409) has been replaced by S40910, S40920, and S40930. Unless otherwise specified in the ordering information, an order specifying S40900 or Type 409 shall be satisfied by any one of S40910, S40920, or S40930 at the option of the seller. Material meeting the requirements of S40910, S40920, or S40930, may at the option of the manufacturer be certified as S40900.

^M Plate version of CA-6NM.

^N Product (check or verification) analysis tolerance over the maximum limit for C and N in XM-27 shall be 0.002 %.

 $^{^{\}circ}$ Cr + 3.3 Mo + 16 N = 41 min.

TABLE 2 Mechanical Test Requirements

		Tensile Str	ength, min	Yield Stre	ength, ^B min	Elongation in	Hard	lness, max ^C	
UNS Designation	Type ^A	ksi	MPa	ksi	MPa	2 in. or 50 mm, min, %	Brinell. HBW	Rockwell	Cold Bend ^o
		Austei	nitic (Chromium-Nic	kel) (Chromium-Ma	anganese-Nickel)				
N08020		80	550	35	240	30 ^E	217	95 HRBW	not required
N08367									
Sheet and Strip		100	690	45	310	30		100 HRBW	not required
Plate		95	655	45	310	30	241		not required
N08700		80	550	35	240	30	192	90 HRBW	not required
V08800	800 ^F	75	520	30 ^{<i>G</i>}	205 ^G	30 ^H			not required
N08810	800H ^F	65	450	25 ^G	170 ^{<i>G</i>}	30			not required
N08811		65	450	25	170	30			not required
N08904	904L ^F	71	490	31	220	35		90 HRBW	not required
N08925		87	600	43	295	40			not required
N08926		94	650	43	295	35			not required
100020	• • • • • • • • • • • • • • • • • • • •	01	000	10	200	00		• • • •	not roquiroc
S20100	201-1'	75	515	38	260	40	217	95 HRBW	
S20100	201-2 ¹	95	655	45	310	40	241	100 HRBW	
S20103	201L ^F	95	655	38	260	40	217	95 HRBW	not required
S20153	201LN ^F	95	655	45	310	45	241	100 HRBW	not required
S20161	201111	125	860	50	345	40	255	25 HRC	not required
S20200	202	90	620	38	260	40	241		
S20400		95	655	48	330	35	241	100 HRBW	not required
S20431		90	620	46 45	310	40	241	100 HRBW	not required
S20432		75	515	30	205	40	201	92 HRBW	not required
S20433		80	550	35	240	40	217	95 HRBW	not required
S20910	XM-19 ^J								
Sheet and Strip		105	725	60	415	30	241	100 HRBW	not required
Plate		100	690	55	380	35	241	100 HRBW	not required
S21600	XM-17 ^J								
Sheet and Strip		100	690	60	415	40	241	100 HRBW	not required
Plate		90	620	50	345	40	241	100 HRBW	not required
S21603	XM-18 ^J		020	•	0.0			.00	or.oquiiot
Sheet and Strip	7111 10	100	690	60	415	40	241	100 HRBW	not required
Plate		90	620	50	345	40	241	100 HRBW	not required
S21640		95	650	45	310	40			not required
S21800		95	655	50	345	35	241	100 HRBW	not required
S21904	XM-11 ^J	33	000	30	0-10	00	271	100 1111044	not required
Sheet and Strip	Win II	100	690	60	415	40	241	100 HRBW	not required
Plate		90	620	50	345	40 45	241	100 HRBW	not required
S24000	XM-29 ^J	30	020	50	343	40	441	IOO HIDDW	not required
	VIAI-5A	100	600	60	415	40	2/1	100 HDDW	not rocuite
Sheet and Strip Plate		100 100	690 690	60 55	415 380	40 40	241 241	100 HRBW 100 HRBW	not required not required
ı idle		100	090	ან	300	40	2 4 1	אסחרו טטו	not required
330100	301	75	515	30	205	40	217	95 HRBW	not required
330103	301L ^F	80	550	32	220	45	241	100 HRBW	not required
S30153	301LN ^F	80	550	35	240	45	241	100 HRBW	not required
S30200	302	75	515	30	205	40	201	92 HRBW	not required
S30400	304	75 75	515	30	205	40	201	92 HRBW	not required
S30403	304L	70 70	485	25	170	40	201	92 HRBW	not required
S30409	304L 304H	70 75	515	30	205	40	201	92 HRBW	not required
530409 530415		75 87	600	30 42	205 290	40 40	201 217	92 HRBW 95 HRBW	
		87 65	450	23	290 155	40 45	187	90 HRBW	not required
S30435		co	450	23	100	45	187	90 HRBW	

TABLE 2 Continued

				IADLE 2	Jonilinaea				
UNS Designation Ty		Tensile Str	ength, min	Yield Stre	ength, ^B min	Elongation in	Hard	Iness, max ^C	
UNS Designation	Type ^A	ksi	MPa	ksi	MPa	2 in. or 50 mm, min, %	Brinell. HBW	Rockwell	Cold Bend ^o
S30441		75	515	30	205	40	201	92 HRBW	not required
S30451	304N	80	550	35	240	30	217	95 HRBW	not required
S30452	XM-21 ^J								
Sheet and Strip		90	620	50	345	30	241	100 HRBW	not required
Plate		85	585	40	275	30	241	100 HRBW	not required
S30453	304LN	75	515	30	205	40	217	95 HRBW	not required
S30500	305	70 70	485	25	170	40	183	88 HRBW	not required
S30530	• • •	75 70	515	30	205	40	201	92 HRBW	not required
S30600		78	540	35	240	40			
S30616		86	590	36	245	40	241	100 HRBW	not required
S30601		78	540	37	255	30		• • •	not required
S30615		90	620	40	275	35	217	95 HRBW	not required
S30815		87	600	45	310	40	217	95 HRBW	
S30908	309S	75	515	30	205	40	217	95 HRBW	not required
S30909	309H ^F	75	515	30	205	40	217	95 HRBW	not required
S30940	309Cb ^F	75	515	30	205	40	217	95 HRBW	not required
S30941	309HCb ^F	75	515	30	205	40	217	95 HRBW	not required
S31008	310S	75 75	515	30	205	40	217	95 HRBW	not required
S31009	310H ^F	75 75	515	30	205	40	217	95 HRBW	not required
	310Cb ^F								
S31040		75 75	515	30	205	40	217	95 HRBW	not required
S31041	310HCb ^F	75	515	30	205	40	217	95 HRBW	not required
S31050	310 MoLN ^F								
	$t \leq 0.25$ in.	84	580	39	270	25	217	95 HRBW	not required
	t > 0.25 in.	78	540	37	255	25	217	95 HRBW	not required
S31060 S31254	•••	87	600	41	280	40	217	95 HRBW	not required
Sheet and Strip		100	690	45	310	35	223	96 HRBW	not required
Plate		95	655	45	310	35	223	96 HRBW	not required
S31266		109	750	61	420	35			not required
S31277		112	770	52	360	40			not required
S31600	316	75	515	30	205	40	217	95 HRBW	not required
S31603		70 70	485	25	170		217	95 HRBW	not required
	316L					40			
S31609	316H	75	515	30	205	40	217	95 HRBW	not required
S31635	316Ti ^F	75	515	30	205	40	217	95 HRBW	not required
S31640	316Cb ^F	75	515	30	205	30	217	95 HRBW	not required
331651	316N	80	550	35	240	35	217	95 HRBW	not required
31653	316LN	75	515	30	205	40	217	95 HRBW	not required
31655		92	635	45	310	35	241	100 HRBW	not required
S31700	317	75	515	30	205	35	217	95 HRBW	not required
S31703	317L	75	515	30	205	40	217	95 HRBW	not required
S31725	317LM ^F	75	515	30	205	40	217	95 HRBW	not required
S31726	317LMN ^F	80	550	35	240	40	223	96 HRBW	not required
S31727		80	550	36	245	35	217	96 HRBW	not required
S31730		70	480	25	175	35		90 HRBW	not required
S31753	317LN	80	550	35	240	40	217	95 HRBW	not required
S32050	317LN	98	675	48	330	40	250	93 FINDW	not required
C220E2		02	640	43	205	40	217	OS LIDDW	not roquired
S32053		93	640		295	40	217	96 HRBW	not required
S32100	321	75	515	30	205	40	217	95 HRBW	not required
S32109	321H	75	515	30	205	40	217	95 HRBW	not required
S32615 ^K		80	550	32	220	25			not required

TABLE 2 Continued

					ontinuea				
		Tensile Str	ength, min	Yield Stre	ngth, ^B min	Elongation in	Hard	ness, max ^C	
UNS Designation	Type ^A	ksi	MPa	ksi	MPa	2 in. or 50 mm, min, %	Brinell. HBW	Rockwell	Cold Bend ^o
S32654		109	750	62	430	40	250		not required
S33228		73	500	27	185	30	217	95 HRBW	not required
S33400	334 ^F	70	485	25	170	30		92 HRBW	not required
S33425		75	515	30	205	40			not required
S33550		87	600	41	280	35	217	95 HRBW	not required
S34565		115	795	60	415	35	241	100 HRBW	not required
S34700	347	75	515	30	205	40	201	92 HRBW	not required
S34709	347H	75	515	30	205	40	201	92 HRBW	not required
S34751	347LN	75	515	30	205	40	201	92 HRBW	not required
S34800	348	75	515	30	205	40	201	92 HRBW	not required
S34809	348H	75 75	515	30	205	40	201	92 HRBW	not required
S35045		70	485	25	170	35			not required
		70 85	585	40	275	40	0.11	100 HRBW	
S35115							241		not required
S35125 S35135	• • •	70	485	30	205	35			not required
Sheet and Strip		80	550	30	205	30			not required
Plate		75	515	30	205	30			not required
S35140		90	620	40	275	30	241	100 HRBW	not required
S35315		94	650	39	270	40	217	95 HRBW	not required
S38100	XM-15 ^J	75	515	30	205	40	217	95 HRBW	not required
S38815		78	540	37	255	30			not required
				Duplex (Austen					
S31200		100	690	65	450	25	293	31 HRC	not required
S31260		100	690	70	485	20	290		
S31803		90	620	65	450	25	293	31 HRC	not required
S32001	***	90	620	65	450	25		25 HRC	not required
S32003									
332003	t ≤ 0.187 in.	100	690	70	485	25	293	31 HRC	not required
	[5.00 mm]								
	t > 0.187 in.	95	655	65	450	25	293	31 HRC	not required
	[5.00 mm]								
S32101									
	$t \le 0.187 \text{ in.}$	101	700	77	530	30	290	31 HRC	not required
	[5.00 mm]								•
	t > 0.187 in.	94	650	65	450	30	290	31 HRC	not required
	[5.00 mm]								•
000000		94	650	65	450	30	290	31 HRC	not required
532202	2205 ^F	95	655	65	450	25	293	31 HRC	not required
	2205				400	25	290	32 HRC	not required
S32205			600	- 30					
S32205 S32304	2304 ^F	87	600 620	58 65					
S32205 S32304 S32506	2304 ^F	87 90	620	65	450	18	302	32 HRC	not required
S32205 S32304 S32506 S32520	2304 ^F 	87 90 112	620 770	65 80	450 550	18 25	302 310	32 HRC 32 HRC	not required not required
\$32205 \$32304 \$32506 \$32520 \$32550	2304 ^F 255 ^F	87 90 112 110	620 770 760	65 80 80	450 550 550	18 25 15	302 310 302	32 HRC 32 HRC 32 HRC	not required not required not required
S32205 S32304 S32506 S32520 S32550 S32750	2304 ^F 255 ^F 2507 ^F	87 90 112 110 116	620 770 760 795	65 80 80 80	450 550 550 550	18 25 15 15	302 310 302 310	32 HRC 32 HRC 32 HRC 32 HRC	not required not required not required not required
\$32205 \$32304 \$32506 \$32520 \$32550 \$32750 \$32760	2304 ^F 255 ^F 2507 ^F 	87 90 112 110 116 108	620 770 760 795 750	65 80 80 80 80	450 550 550 550 550	18 25 15 15 25	302 310 302 310 310	32 HRC 32 HRC 32 HRC 32 HRC 32 HRC	not required not required not required not required not required
\$32205 \$32304 \$32506 \$32520 \$32550 \$32750 \$32760 \$32760 \$32808	2304 ^F 255 ^F 2507 ^F 	87 90 112 110 116 108	620 770 760 795 750 700	65 80 80 80 80 72	450 550 550 550 550 550	18 25 15 15 25 15	302 310 302 310 310 310	32 HRC 32 HRC 32 HRC 32 HRC 32 HRC ^R 32 HRC	not required not required not required not required not required not required
\$32205 \$32304 \$32506 \$32520 \$32550 \$32750 \$32760 \$32760 \$32808 \$32900	2304 ^F 255 ^F 2507 ^F 329	87 90 112 110 116 108 101 90	620 770 760 795 750 700 620	65 80 80 80 80 72 70	450 550 550 550 550 550 500 485	18 25 15 15 25 15	302 310 302 310 310 310 269	32 HRC 32 HRC 32 HRC 32 HRC 32 HRC ^A 32 HRC 28 HRC	not required not required not required not required not required not required not required
\$32205 \$32304 \$32506 \$32520 \$32550 \$32750 \$32760 \$32760 \$32808 \$32900	2304 ^F 255 ^F 2507 ^F 329	87 90 112 110 116 108	620 770 760 795 750 700	65 80 80 80 80 72	450 550 550 550 550 550	18 25 15 15 25 15	302 310 302 310 310 310	32 HRC 32 HRC 32 HRC 32 HRC 32 HRC ^R 32 HRC	not required not required not required not required not required not required
\$32205 \$32304 \$32506 \$32520 \$32550 \$32750 \$32760 \$32808 \$32900	2304 ^F 255 ^F 2507 ^F 329 t < 0.4 in.	87 90 112 110 116 108 101 90	620 770 760 795 750 700 620	65 80 80 80 80 72 70	450 550 550 550 550 550 500 485	18 25 15 15 25 15	302 310 302 310 310 310 269	32 HRC 32 HRC 32 HRC 32 HRC 32 HRC ^A 32 HRC 28 HRC	not required not required not required not required not required not required not required
\$32202 \$32205 \$32205 \$32304 \$32506 \$32520 \$32550 \$32750 \$32760 \$32760 \$32808 \$32900 \$32906	2304 ^F 255 ^F 2507 ^F 329	87 90 112 110 116 108 101 90	620 770 760 795 750 700 620	65 80 80 80 80 72 70	450 550 550 550 550 550 500 485	18 25 15 15 25 15	302 310 302 310 310 310 269	32 HRC 32 HRC 32 HRC 32 HRC 32 HRC ^A 32 HRC 28 HRC	not required not required not required not required not required not required not required

TABLE 2 Continued

				IABLE 2	Jonanaea				
	_	Tensile Str	ength, min	Yield Stre	ength, ^B min	Elongation in	Hard	lness, max ^C	_
UNS Designation	Type ^A	ksi	MPa	ksi	MPa	2 in. or 50 mm, min, %	Brinell. HBW	Rockwell	Cold Bend ^o
S32950 ^L		100	690	70	485	15	293	32 HRC	not required
S39274		116	800	80	550	15	310	32 HRC	not required
S81921		90	620	65	450	25	293	31 HRC	not required
S82011		101	700	75	515	30	293	31 HRC	not required
	$t \le 0.187 \text{ in.}$ [5.00 mm]								
	t > 0.187 in.	95	655	65	450	30	293	31 HRC	not required
000040	[5.00 mm]	0.4	252	=0	400	25	222		
S82012	t >0.187 in.	94	650	58	400	35	290		
	[5.00 mm]	100	700	70	500	0.5		O4 LIDO	
	t ≤0.187 in.	102	700	73	500	35		31 HRC	not required
S82013	[5.00 mm]	90	620	65	450	30	293	31^J	not required
S82031	t>0.187 in.	94	650	58	400	35	290	31	not required
302031	[5.00 mm]	34	050	36	400	33	290		not required
	t≤0.187 in.	102	700	73	500	35		31 HRC	not required
	[5.00 mm]	102	700	70	300	03		011110	not required
S82121	[5.00 mm]	94	650	65	450	25	286	30 HRC	not required
S82122	t<0.118 in.	101	700	72	500	25	290	32 HRC	not required
002122	[3.00 mm]	101	700	, _	000	20	200	02 11110	not roquirou
	t≥0.118 in.	87	600	58	400	30	290	32 HRC	not required
	[3.00 mm]								
S82441									
	t < 0.4 in. [10.0	107	740	78	540	25	290	31 HRC	not required
	mm]								•
	t ≥ 0.4 in. [10.0	99	680	70	480	25	290	31 HRC	not required
	mm]								
				Ferritic or Martensi					
S32803	111	87	600	72	500	16	241	100 HRBW	not required
S40300	403	70	485	30	205	25 ^N	217	96 HRBW	180
S40500	405	60	415	25	170	20	179	88 HRBW	180
S40900 ^M	409 ^M		000	0.5	470	00	470	OO LIDDW	400
S40910		55	380	25	170	20	179	88 HRBW	180
S40920 S40930		55 55	380 380	25 25	170 170	20 20	179 179	88 HRBW 88 HRBW	180 180
S40945	• • •	55 55	380	30	205	22		80 HRBW	180
S40975	• • •	60	415	40	205 275	20	197	92 HRBW	180
S40975	• • •	65	450	41	280	18	180	88 HRBW	not required
340377	• • •	05	430	41	200	10	100	OO TII IDVV	not required
S41000	410	65	450	30	205	20	217	96 HRBW	180
S41003		66	455	40	275	18	223	20 HRC	not required
S41008	410S	60	415	30	205	22 ^N	183	89 HRBW	180
S41045		55	380	30	205	22		80 HRBW	180
S41050		60	415	30	205	22	183	89 HRBW	180
S41500		115	795	90	620	15	302	32 HRC	not required
S42000	420	100 ^Q	690 ^Q			15	217	96 HRBW	not required
S42035		80	550	55	380	16	180	88 HRBW	not required
S42200	422						248	24 HRC	not required
S42900	429 ^F	65	450	30	205	22 ^N	183	89 HRBW	180
S43000	430	65	450	30	205	22 ^N	183	89 HRBW	180
S43035	439	60	415	30	205	22	183	89 HRBW	180

TABLE 2 Continued

				IADLE 2	ontinueu				
		Tensile Str	ength, min	Yield Stre	ngth, ^B min	Elongation in	Hard	ness, max ^C	
UNS Designation	Type ^A	ksi	MPa	ksi	MPa	2 in. or 50 mm, min, %	Brinell. HBW	Rockwell	Cold Bend ^o
S43037		50	360	30	205	22	183	89	180
S43100	431						285	29 HRC	not required
S43400	434	65	450	35	240	22		89 HRBW	180
S43600	436	65	450	35	240	22		89 HRBW	180
S43932		60	415	30	205	22	183	89 HRBW	180
S43940		62	430	36	250	18	180	88 HRBW	not required
S44330		56	390	30	205	22	187	90 HRBW	not required
S44100		60	414	35	241	20	190	90 HRBW	not required
S44200	442	65	515	40	275	20	217	96 HRBW	180
S44400		60	415	40	275	20	217	96 HRBW	180
S44500		62	427	30	205	22		83 HRBW	180
S44535		58	400	36	250	25 ^E		90 ^O HRBW	not required
S44536		60	410	35	245	20	192	90 HRBW	180
S44537		65	450	46	320	18 ^P	200	93 HRBW	180
S44600	446	65	515	40	275	20	217	96 HRBW	135
S44626	XM-33 ^J	68	470	45	310	20	217	96 HRBW	180
S44627	XM-27 ^J	65	450	40	275	22	187	90 HRBW	180
S44635		90	620	75	515	20	269	28 HRC	180
S44660		85	585	65	450	18	241	100 HRBW	180
S44700		80	550	60	415	20	223	20 HRC	180
S44725		65	450	40	275	20	210	95 HRBW	180
S44735		80	550	60	415	18	255	25 HRC	180
S44800		80	550	60	415	20	223	20 HRC	180
S46800		60	415	30	205	22		90 HRBW	180

A Unless otherwise indicated, a grade designation originally assigned by the American Iron and Steel Institute (AISI).

^B Yield strength shall be determined by the offset method at 0.2 % in accordance with Test Methods and Definitions A370. Unless otherwise specified (see Specification A480/A480M, paragraph 4.1.11, Ordering Information), an alternative method of determining yield strength may be based on total extension under load of 0.5 %.

^C Either Brinell or denoted Rockwell Hardness scale is permissible. For thin materials, see Specification A480/A480M (17.2.1) and Test Methods A370 (18.1.2) on superficial testing.

Dend tests are not required for chromium steels (ferritic or martensitic) thicker than 1 in. [25 mm] or for any austenitic or duplex (austenitic-ferritic) stainless steels regardless of thickness.

^E Elongation for thickness, less than 0.015 in. [0.38 mm] shall be 20 % minimum, in 1 in. [25.4 mm].

F Common name, not a trademark, widely used, not associated with any one producer.

^G Yield strength requirements shall not apply to material under 0.020 in [0.50 mm] in thickness.

^H Not applicable for thicknesses under 0.010 in. [0.25 mm].

Type 201 is generally produced with a chemical composition balanced for rich side (Type 201-1) or lean side (Type 201-2) austenite stability depending on the properties required for specific applications.

J Naming system developed and applied by ASTM.

K For S32615, the grain size as determined in accordance with the Test Methods E112, Comparison Method, Plate II, shall be No. 3 or finer.

^L Prior to Specification A240 – 89b, the tensile value for S32950 was 90 ksi.

M S40900 (Type 409) has been replaced by S40910, S40920, and S40930. Unless otherwise specified in the ordering information, an order specifying S40900 or Type 409 shall be satisfied by any one of S40910, S40920, or S40930 at the option of the seller. Material meeting the requirements of S40910, S40920, or S40930, may at the option of the manufacturer be certified as S40900.

^N Material 0.050 in [1.27 mm] and under in thickness shall have a minimum elongation of 20 %.

O Hardness is required to be provided for information only, but is not required to meet a particular requirement.

^P The minimum elongation for plates thicker than 0.630 in. (16 mm) shall be 8 %.

^Q Maximum. Type 420 is usually used in the heat-treated condition (quenched and tempered to a specific range of hardness or tensile strength).

Hardness conversion tables for superduplex stainless steels do not exist in ASTM E140. The conversion value from HBW to HRC has been added to maintain consistency with other ASTM standards for these superduplex stainless steels.

SUPPLEMENTARY REQUIREMENTS

A supplementary requirement shall apply only when specified in the purchase order.

S1. Charpy Impact Testing of Plate

- S1.1 Charpy impact tests shall be conducted in accordance with Test Methods and Definitions A370.
- S1.2 *Number of Tests*—One impact test (three specimens) shall be made from one plate per heat treatment lot in the final heat treated condition.
- S1.3 Orientation of Test Specimens—Unless specified as transverse specimens (long axis of the specimen transverse to the final rolling direction, root of the notch perpendicular to the rolling face) on the purchase order, the orientation of the specimens shall be longitudinal (long axis of the specimen parallel to the final rolling direction, root of the notch perpendicular to the rolling face). The manufacturer is permitted to test transverse specimens provided that such tests meet the acceptance criteria applicable to longitudinal specimens. Unless otherwise specified on the purchase order, the specimens shall be taken so as to include the mid-thickness of the product.
- S1.4 Test Temperature—The purchaser shall specify the test temperature. The manufacturer is permitted to test specimens at a temperature lower than that specified by the purchaser, provided that such tests shall meet the acceptance criteria applicable to specimens tested at the specified temperature (see the note below).

Note S1.1—Test Methods A923, Method B, applicable to some duplex (austenitic-ferritic) stainless steels as listed in Test Methods A923, uses a Charpy impact test for the purpose of determining the absence of detrimental intermetallic phases. Method B specifies a test temperature and acceptance criterion, expressed as impact energy, for each type of steel covered. It may be economical for the Charpy impact tests performed on duplex stainless steels covered in both Specification A240 and Test Methods A923 to be performed at the lower of the temperatures specified by this supplementary requirement and Test Methods A923 Method B, with measurement of both lateral expansion and impact energy.

- S1.5 Acceptance Limit —Unless otherwise specified on the purchase order, each of the three specimens tested shall show a lateral expansion opposite the notch of not less than 0.015 in. [0.38 mm].
- S1.6 *Records*—The recorded results shall include the specimen orientation, specimen size, test temperature, absorbed energy values (if required), and lateral expansion opposite the notch.

S2. Materials for High-Temperature Service

- S2.1 Unless an H grade has been ordered, this supplementary requirement shall be specified for ASME Code applications for service above 1000°F [540°C].
- S2.2 The user is permitted to use an austenitic stainless steel as the corresponding H grade when the material meets all requirements of the H grade including chemistry, annealing temperature, and grain size (see Section 6).
- S2.3 The user is permitted to use an L grade austenitic stainless steel for service above 1000°F [540°C], subject to the applicable allowable stress table of the ASME Code, when the material meets all requirements of this specification and the grain size is ASTM No. 7 or coarser as determined in accordance with Test Methods E112. The grain size shall be reported on a Certified Test Report.

S3. One Percent Offset Yield Strength

- S3.1 If reporting of 1 % offset yield strength is specified on the purchase order; the material shall meet the strength requirements shown in Table S3.1.
- S3.2 The mechanical properties, including 1 % offset yield strength and all other required properties shall be reported on a Material Test Report.

TABLE S3.1 Tensile and Yield Strength Requirements

 $\ensuremath{\text{Note}}\xspace$ 1—These values apply only for material of 1.5 inches (38 mm) nominal thickness or less.

UNS	Grade	Tensile Strength, min., Ksi [MPa]	0.2 % Offset Yield Strength, Min., Ksi [MPa]	1 % Offset Yield Strength, Min., Ksi [MPa]
S31603	316L	70 [485]	25 [170]	38 [260]
S31600	316	75 [515]	30 [205]	38 [260]
S31653	316LN	75 [515]	30 [205]	46 [320]
S30403	304L	70 [485]	25 [170]	35 [240]
S30400	304	75 [515]	30 [205]	36 [250]
S30453	304LN	75 [515]	30 [205]	45 [310]
S30451	304N	80 [550]	35 [240]	45 [310]
S32100	321	75 [515]	30 [205]	35 [240]



SPECIFICATION FOR WELDED AUSTENITIC STEEL BOILER, SUPERHEATER, HEAT-EXCHANGER, AND CONDENSER TUBES



SA-249/SA-249M

(23)

(Identical with ASTM Specification A249/A249M-18a except for deletion of S5, which allows lower mechanical properties, and for Section I only, S9 is mandatory when 100% joint efficiency is required; title for Supplementary Requirement S9 is revised.)

Specification for Welded Austenitic Steel Boiler, Superheater, Heat-Exchanger, and Condenser Tubes

1. Scope

- 1.1 This specification covers nominal-wall-thickness welded tubes and heavily cold worked welded tubes made from the austenitic steels listed in Table 1, with various grades intended for such use as boiler, superheater, heat exchanger, or condenser tubes.
- 1.2 Grades TP304H, TP309H, TP309HCb, TP310H, TP310HCb, TP316H, TP321H, TP347H, and TP348H are modifications of Grades TP304, TP309S, TP309Cb, TP310S, TP310Cb, TP316, TP321, TP347, and TP348, and are intended for high-temperature service such as for superheaters and reheaters.
- 1.3 The tubing sizes and thicknesses usually furnished to this specification are $\frac{1}{8}$ in. [3.2 mm] in inside diameter to 12 in. [304.8 mm] in outside diameter and 0.015 to 0.320 in. [0.4 to 8.1 mm], inclusive, in wall thickness. Tubing having other dimensions may be furnished, provided such tubes comply with all other requirements of this specification.
- 1.4 Mechanical property requirements do not apply to tubing smaller than $\frac{1}{8}$ in. [3.2 mm] in inside diameter or 0.015 in. [0.4 mm] in thickness.
- 1.5 Optional supplementary requirements are provided and, when one or more of these are desired, each shall be so stated in the order.
- 1.6 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the

- standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.
- 1.7 The following safety hazards caveat pertains only to the test method described in the Supplementary Requirements of this specification. This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use. A specific warning statement is given in Supplementary Requirement S7, Note S7.1.
- 1.8 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A262 Practices for Detecting Susceptibility to Intergranular Attack in Austenitic Stainless Steels
- A480/A480M Specification for General Requirements for Flat-Rolled Stainless and Heat-Resisting Steel Plate, Sheet, and Strip
- A1016/A1016M Specification for General Requirements for Ferritic Alloy Steel, Austenitic Alloy Steel, and Stainless Steel Tubes
- E112 Test Methods for Determining Average Grain Size
- E213 Practice for Ultrasonic Testing of Metal Pipe and Tubing
- E273 Practice for Ultrasonic Testing of the Weld Zone of Welded Pipe and Tubing
- E527 Practice for Numbering Metals and Alloys in the Unified Numbering System (UNS)

TABLE 1 Chemical Requirements, %^A

				•	•		Composition, %				•	
Grade	UNS Designation ^B	Carbon	Manganese	Phosphorous	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen ^C	Copper	Other
TP 201	S20100	0.15	5.50-7.5	0.060	0.030	1.00	16.0–18.0	3.5–5.5		0.25		+
TP 201LN	S20100 S20153	0.13			0.030	0.75					1.00	
			6.4–7.5	0.045			16.0–17.5	4.0–5.0		0.10-0.25	1.00	
TP 202	S20200	0.15	7.5–10.0	0.060	0.030	1.00	17.0–19.0	4.0–6.0		0.25		
TPXM-19	S20910	0.06	4.0–6.0	0.045	0.030	1.00	20.5–23.5	11.5–13.5	1.50–3.00	0.20-0.40		Nb ^G 0.10–0.30 V 0.10–0.30
TPXM-29	S24000	0.08	11.5–14.5	0.060	0.030	1.00	17.0-19.0	2.3-3.7		0.20-0.40		l
TP304	S30400	0.08	2.00	0.045	0.030	1.00	18.0-20.0	8.0-11.0				
TP304L ^D	S30403	0.030	2.00	0.045	0.030	1.00	18.0-20.0	8.0-12.0				
TP304H	S30409	0.04-0.10	2.00	0.045	0.030	1.00	18.0-20.0	8.0-11.0				
	S30415	0.04-0.06	0.80	0.045	0.030	1.00-2.00	18.0-19.0	9.0–10.		0.12-0.18		Ce
												0.03-0.08
TP304N	S30451	0.08	2.00	0.045	0.030	1.00	18.0-20.0	8.0-11.0		0.10-0.16		
TP304LN ^D	S30453	0.030	2.00	0.045	0.030	1.00	18.0-20.0	8.0-11.0		0.10-0.16		
TP305	S30500	0.12	2.00	0.045	0.030	1.00	17.0-19.0	11.0-13.0				
	S30615	0.16-0.24	2.00	0.030	0.030	3.2-4.0	17.0-19.5	13.5-16.0				
	S30815	0.05-0.10	0.80	0.040	0.030	1.40-2.00	20.0-22.0	10.0-12.0		0.14-0.20		Ce
												0.03-0.08
TP309S	S30908	0.08	2.00	0.045	0.030	1.00	22.0-24.0	12.0-15.0				
TP309H	S30909	0.04-0.10	2.00	0.045	0.030	1.00	22.0-24.0	12.0-15.0				

-						Cor	nposition, %					
Grade	UNS Designation ^B	Carbon	Manganese	Phosphorous	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen ^C	Copper	Other
	S30601	0.015	0.50-0.80	0.030	0.013	5.0-5.6	17.0–18.0	17.0-18.0	0.20	0.05	0.35	
TP309Cb	S30940	0.08	2.00	0.045	0.030	1.00	22.0–24.0	12.0–16.0				Nb 10x C-1.10
TP309HCb	S30941	0.04-0.10	2.00	0.045	0.030	1.00	22.0–24.0	12.0–16.0				Nb 10x C-1.10
TP310S	S31008	0.08	2.00	0.045	0.030	1.00	24.0–26.0	19.0–22.0				
TP310H	S31009	0.04-0.10	2.00	0.045	0.030	1.00	24.0-26.0	19.0-22.0				
TP310Cb	S31040	0.08	2.00	0.045	0.030	1.00	24.0–26.0	18.0–22.0				Nb 10x C-1.10
TP310HCb	S31041	0.04-0.10	2.00	0.045	0.030	1.00	24.0–26.0	19.0–22.0				Nb 10x C-1.10
	S31050	0.030	2.00	0.030	0.015	0.40	24.0–26.0	21.0-23.0	2.00-3.00	0.10-0.16		
	S31254	0.020	1.00	0.030	0.010	0.80	19.5–20.5	17.5–18.5	6.0-6.5	0.18-0.25	0.50-1.00	
	S31266	0.030	2.00-4.00	0.035	0.020	1.00	23.0–25.0	21.0–24.0	5.2-6.2	0.35-0.60	1.00-2.50	W
	S31277	0.020	3.00	0.030	0.010	0.50	20.5–23.0	26.0–28.0	6.5–8.0	0.30-0.40	0.50-1.50	1.50–2.50
TP316	S31600	0.08	2.00	0.045	0.030	1.00	16.0–18.0	10.0-14.0	2.00-3.00			
TP316L ^D	S31603	0.030	2.00	0.045	0.030	1.00	16.0–18.0	10.0–14.0	2.00-3.00			
TP316H	S31609	0.04-0.10	2.00	0.045	0.030	1.00	16.0-18.0	10.0-14.0	2.00-3.00			
TP316N	S31651	0.08	2.00	0.045	0.030	1.00	16.0–18.0	10.0-13.0	2.00-3.00	0.10-0.16		
TP316LN ^D	S31653	0.030	2.00	0.045	0.030	1.00	16.0–18.0	10.0-13.0	2.00-3.00	0.10-0.16		l
	S31655	0.030	2.00	0.045	0.015	1.00	19.5–21.5	8.0-9.5	0.50-1.50	0.14-0.25	1.00	
TP317	S31700	0.08	2.00	0.045	0.030	1.00	18.0–20.0	11.0-15.0	3.0-4.0			
TP317L	S31703	0.030	2.00	0.045	0.030	1.00	18.0–20.0	11.0–15.0	3.0-4.0			
	1	<u> </u>	Composition, %							1		
Grade	UNS Designation ^B	Carbon	Manganese	Phosphorous	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen ^C	Copper	Other
	S31725	0.030	2.00	0.045	0.030	1.00	18.0–20.0	13.5–17.5	4.0-5.0	0.20		·
	S31726	0.030	2.00	0.045	0.030	1.00	17.0–20.0	14.5–17.5	4.0–5.0	0.10-0.20		
	S31727	0.030	1.00	0.030	0.030	1.00	17.5–19.0	14.5–16.5	3.8–4.5	0.15–0.21	2.8-4.0	
	S32050	0.030	1.50	0.035	0.020	1.00	22.0–24.0	20.0-23.0	6.0-6.8	0.21-0.32	0.40	

358

TABLE 1 Continued

					IADLE I	Continuea						
	S32053	0.030	1.00	0.030	0.010	1.00	22.0–24.0	24.0–26.0	5.0–6.0	0.17-0.22		
TP321	S32100	0.08	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0		0.10		Ti 5(C+N)- 0.70
TP321H	S32109	0.04-0.10	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0		0.10		Ti 5(C+N)- 0.70
 	\$32615 \$32654 \$33228	0.07 0.020 0.04–0.08	2.00 2.0–4.0 1.00	0.045 0.030 0.020	0.030 0.005 0.015	4.80–6.00 0.50 0.30	16.5–19.5 24.0–25.0 26.0–28.0	19.0–22.0 21.0–23.0 31.0–333.0	0.30–1.50 7.0–8.0 	 0.45–0.55 	1.50–2.50 0.30–0.60 	0.70 Nb 0.60-1.00 Ce 0.05-0.10 Al0.025
	S34565	0.030	5.0-7.0	0.030	0.010	1.00	23.0–25.0	16.0–18.0	4.0–5.0	0.40-0.60		Nb 0.10
TP347	S34700	0.08	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0				Nb 10xC- 1.10
TP347H	S34709	0.04–0.10	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0				Nb 8xC- 1.10
TP348	S34800	0.08	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0				(Nb+Ta) 10xC-1.10 Ta 0.10 Co 0.20
TP348H 	S34809 S35045	0.04-0.10	2.00	0.045 0.045	0.030 0.015	1.00	17.0–19.0 25.0–29.0	9.0–12.0 32.0–37.0			 0.75	(Nb+Ta) 8xC-1.10 Ta 0.10 Co 0.20 Al
												0.15–0.60 Ti 0.15–0.60
TPXM-15 	S38100 S38815	0.08 0.030	2.00 2.00	0.030 0.040	0.030 0.020	1.50–2.50 5.5–6.5	17.0–19.0 13.0–15.0	17.5–18.5 15.0–17.0	 0.75–1.50		 0.75–1.50	 AI 0.30 max
Alloy 20	N08020	0.070	2.00	0.045	0.035	1.00	19.0–21.0	32.0–38.0	2.00-3.00		3.00-4.00	Nb 8 × C min. to 1.00 max
	N08367	0.030	2.00	0.040	0.030	1.00	20.0–22.0	23.5–25.5	6.0–7.0	0.18-0.25	0.75	
800	N08800	0.10	1.50	0.045	0.015	1.00	19.0–23.0	30.0–35.0			0.75	AI 0.15–0.60 Ti
												0.15–0.60 Fe [£] 39.5 min
800H	N08810	0.05–0.10	1.50	0.045	0.015	1.00	19.0–23.0	30.0–35.0			0.75	AI 0.15–0.60 Ti 0.15–0.60
												Fe ^E 39.5 min

TABLE 1 Continued

 N08811	0.05–0.10	1.50	0.045	0.015	1.00	19.0–23.0	30.0–35.0			0.75	Al 0.25–0.60 ^F Ti 0.25–0.60 ^F Fe ^E 39.5
 N08926	0.020	2.00	0.030	0.010	0.50	19.0–21.0	24.0–26.0	6.0–7.0	0.15–0.25	0.50-1.50	min
 N08904	0.020	2.00	0.040	0.030	1.00	19.0–23.0	23.0–28.0	4.0–5.0	0.10	1.00-2.00	

^A Maximum, unless otherwise indicated.

^B New designation established in accordance with Practice E527 and SAE J1086.

 $^{^{\}it C}$ The method of analysis for nitrogen shall be a matter of agreement between the purchaser and manufacturer.

^D For small diameter or thin walls, or both, where many drawing passes are required, a carbon maximum of 0.040 % is necessary in Grades TP 304L and TP 316L. Small outside diameter tubes are defined as those less than 0.500 in. [12.7 mm] in outside diameter and light wall are those less than 0.049 in. [1.2 mm] in minimum wall thickness.

Elron shall be determined arithmetically by difference of 100 minus the sum of the other specified elements.

F(AI + Ti) = 0.85 to 1.20.

^GThe term Niobium (Nb) and Columbium (Cb) are alternate names for the same element.

2.2 ASME Boiler and Pressure Vessel Code:

Section VIII

2.3 Other Standard:

SAE J1086 Practice for Numbering Metals and Alloys (UNS)

3. Ordering Information

- 3.1 It is the responsibility of the purchaser to specify all requirements that are necessary for material ordered under this specification. Such requirements may include, but are not limited to, the following:
 - 3.1.1 Quantity (feet, metres, or number of lengths),
- 3.1.2 Name of material welded tubes (WLD) or heavily cold worked tubes (HCW).
 - 3.1.3 Grade (Table 1),
 - 3.1.4 Size (outside diameter and nominal wall thickness),
 - 3.1.5 Length (specific or random),
 - 3.1.6 Optional requirements (13.6),
- 3.1.7 Test report required (see Certification Section of Specification A1016/A1016M),
 - 3.1.8 Specification designation, and
- 3.1.9 Special requirements and any supplementary requirements selected.
- 3.1.9.1 If Supplementary Requirement S7 is specified, include weld decay ratio per S11.1.1.

4. General Requirements

4.1 Material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A1016/A1016M, unless otherwise provided herein.

5. Manufacture

- 5.1 The welded (WLD) tubes shall be made from flat-rolled steel by an automatic welding process with no addition of filler metal
- 5.1.1 Subsequent to welding and prior to final heat treatment, the tubes shall be cold worked either in both weld and base metal or in weld metal only. The method of cold working may be specified by the purchaser. When cold drawn, the purchaser may specify the minimum amount of reduction in cross-sectional area or wall thickness, or both.
- 5.1.2 Heavily cold worked (HCW) tubes shall be made by applying cold working of not less than 35 % reduction in both wall and weld to a welded tube prior to the final anneal. No filler metal shall be used in the making of the weld. Prior to cold working, the weld shall be 100 % radiographically inspected in accordance with the requirements of ASME Boiler and Pressure Vessel Code, Section VIII, Division 1, latest revision, Paragraph UW 51.

6. Heat Treatment

6.1 All material shall be furnished in the heat-treated condition in accordance with the requirements of Table 2.

- 6.2 A solution annealing temperature above 1950 °F [1065 °C] may impair the resistance to intergranular corrosion after subsequent exposure to sensitizing conditions in TP309HCb, TP310HCb, TP321, TP321H, TP347, TP347H, TP348, and TP348H. When specified by the purchaser, a lower temperature stabilization or re-solution anneal shall be used subsequent to the initial high temperature solution anneal (see Supplementary Requirement S4).
- 6.3 N08020 shall be supplied in the stabilization treatment condition.

7. Chemical Composition

7.1 The heat analysis shall conform to the requirements as to chemical composition given in Table 1.

8. Product Analysis

- 8.1 An analysis of either one length of flat-rolled stock or one tube shall be made for each heat. The chemical composition thus determined shall conform to the requirements given in Section 7.
- 8.2 A product analysis tolerance of Table A1.1 in Specification A480/A480M shall apply. The product analysis tolerance is not applicable to the carbon content for material with a specified maximum carbon of 0.04 % or less.
- 8.3 If the original test for product analysis fails, retests of two additional lengths of flat-rolled stock or tubes shall be made. Both retests for the elements in question shall meet the requirements of the specification; otherwise all remaining material in the heat or lot (See 13.9.1) shall be rejected or, at the option of the producer, each length of flat-rolled stock or tube may be individually tested for acceptance. Lengths of flat-rolled stock or tubes that do not meet the requirements of the specification shall be rejected.

9. Tensile Requirements

9.1 The material shall conform to the tensile properties prescribed in Table 3.

10. Hardness Requirements

- 10.1 The tubes shall have a Rockwell hardness number not exceeding the values specified in Table 3.
- 10.2 For tubing less than 0.354 in. [9.00 mm] in inside diameter and for tubing less than 0.065 in. [1.65 mm] in wall thickness, it is permissible to use the Vickers hardness test in lieu of the Rockwell test. Tubes shall have a Vickers hardness number not exceeding the values specified in Table 3.

11. Reverse-Bend Test Requirement

11.1 A section 4 in. [100 mm] minimum in length shall be split longitudinally 90° on each side of the weld. The sample shall then be opened and bent around a mandrel with a maximum thickness of four times the wall thickness, with the mandrel parallel to the weld and against the original outside surface of the tube. The weld shall be at the point of maximum bend. There shall be no evidence of cracks, or of overlaps resulting from the reduction in thickness of the weld areas by cold working. When the geometry or size of the tubing make it

TABLE 2 Heat Treatment Requirements

Grade	UNS Number	Solutioning Temperature, min or range	Quenching Method
All grades not		1900 °F [1040 °C]	Α
individually listed			
below			
	S30601	2010 to 2140 °F [1100 to 1170 °C]	В
	S30815	1920 °F [1050 °C]	В
TP309HCb	S30941	1900 °F [1040 °C] ^C	В
TP310H	S31009	1900 °F [1040 °C]	В
TP310HCb	S31041	1900 °F [1040 °C] ^C	В
	S31254	2100 °F [1150 °C]	В
	S31266	2100 °F [1150 °C]	В
	S31277	2050 °F [1120 °C]	В
TP316H	S31609	1900 °F [1040 °C]	В
	S31727	1975 °F [1080 °C]–	В
	001.2.	2155 °F [1180 °C]	В
	S32053	1975 °F [1080 °C]–	В
	002000	2155 °F [1180 °C]	В
TP321	S32100	1900 °F [1040 °C] ^C	В
TP321H	S32109	2000 °F [1100 °C] ^C	В
	S32654	2100 °F [1150 °C]	В
•••	S33228	2050 °F [1120 °C]	В
•••	S34565	·	В
•••	334303	2050 °F [1120 °C]–	В
TD047	604700	2140 °F [1170 °C]	В
TP347	S34700	1900 °F [1040 °C] ^C	В
TP347H	S34709	2000 °F [1100 °C] ^C	В
TP348	S34800	1900 °F [1040 °C] ^C	В
TP348H	S34809	2000 °F [1100 °C] ^C	D
•••	S35045	2000 °F [1100 °C]	В
•••	S38815	1950 °F [1065 °C]	
Alloy 20	N08020	1700–1850 °F [925–1010 °C] stabilization treatment	В
	N08367	2025 °F [1110 °C]	В
800	N08800	1900 °F [1040 °C]	В
800H	N08810	2050 °F [1120 °C]	В
	N08811	2100 °F [1150 °C]	В
	N08904	2000 °F [1100 °C]	В
	N08926	2010 °F [1105 °C]	В

A Quenched in water or rapidly cooled by other methods, at a rate sufficient to prevent reprecipitation of chromium carbides, as demonstrated by the capability of passing Practices A262, Practice E. The manufacturer is not required to run the test unless it is specified on the purchase order (See Supplementary Requirement S6). Note that Practices A262 requires the test to be performed on sensitized specimens in the low carbon and stabilized types and on specimens representative of the as-shipped condition of the other types. In the case of low-carbon types containing 3 % or more molybdenum, the applicability of the sensitizing treatment prior to testing shall be a matter for negotiation between the seller and purchaser.

difficult to test the sample as a single piece, the sample may be sectioned into smaller pieces provided a minimum of 4 in. of weld is subjected to reverse bending.

Note 1—The reverse bend test is not applicable when the specified wall is 10% or more of the specified outside diameter, or the wall thickness is 0.134 in. [3.4 mm] or greater, or the outside diameter size is less than 0.375 in. [9.5 mm]. Under these conditions the reverse flattening test of Specification A1016/A1016M shall apply.

12. Grain Size Requirement

- 12.1 The grain size of Grades TP309H, TP309HCb, TP310H and TP310HCb, as determined in accordance with Test Methods E112, shall be No. 6 or coarser.
- 12.2 The grain size of Grades TP304H, TP316H, TP321H, TP347H and TP348H, as determined in accordance with Test Methods E112, shall be No. 7 or coarser.
- 12.3 The grain size of Grade UNS S32615, as determined in accordance with Test Methods E112, shall be No. 3 or finer.
- 12.4 The grain size of N08810 and N08811, as determined in accordance with Test Methods E112, shall be 5 or coarser.

13. Mechanical Tests and Grain Size Determinations Required

- 13.1 *Tension Test*—One tension test shall be made on a specimen for lots of not more than 50 tubes. Tension tests shall be made on specimens from two tubes for lots of more than 50 tubes (See 13.9.2).
- 13.2 *Flattening Test*—One flattening test shall be made on specimens from each end of one finished tube, not the one used for the flange test, from each lot (See 13.9.1).
- 13.3 *Flange Test*—One flange test shall be made on specimens from each end of one finished tube, not the one used for the flattening test, from each lot (See 13.9.1).
- 13.4 Reverse-Bend Test—One reverse-bend test shall be made on a specimen from each 1500 ft [450 m] of finished tubing.
- 13.5 *Hardness Test*—Brinell or Rockwell hardness tests shall be made on specimens from two tubes from each lot (See 13.9.2).

^B Quenched in water or rapidly cooled by other methods.

^C A solution treating temperature above 1950 °F [1065 °C] may impair resistance to intergranular corrosion after subsequent exposure to sensitizing conditions in the indicated grades. When specified by the purchaser, a lower temperature stabilization or re-solution anneal shall be used subsequent to the higher-temperature solution anneal prescribed in this table (See Supplementary Requirement S4).

^DCooled in still air, or faster.

TABLE 3 Tensile and Hardness Requirements^A

TABLE 3 Telisile and nardiless nequirements								
Grade	UNS Designation	Tensile Strength, min, ksi [MPa]		Elongation in 2 in. or 50 mm, min, %	Rockwell Hardness Number, max	Vickers Hardness Number, max ^B		
TP201	S20100	95	38 [260]	35	B95	230		
TP 201LN	S20153	[655] 95	45 [310]	45	B100	263		
TP202	S20200	[655] 90 [620]	38 [260]	35	B95	230		
TPXM-19	S20910	100	55 [380]	35	C25	285		
TPXM-29	S24000	100 [690]	55 [380]	35	B100	270		
TP304	S30400	75 [515]	30 [205]	35	B90	200		
TP304L	S30403	70 [485]	25 [170]	35	B90	200		
TP304H	S30409	75 [515]	30 [205]	35	B90	200		
	S30415	87 [600]	42 [290]	35	B96	230		
TP304N	S30451	80 [550]	35 [240]	35	B90	200		
TP304LN	S30453	75 [515]	30 [205]	35	B90	200		
TP305	S30500	75 [515]	30 [205]	35	B90	200		
	S30601 S30615	78 [540] 90 [620]	37 [255] 40 [275]	30 35	B100 B95	270 230		
	S30815	87 [600]	45 [310]	35	B95	230		
TP309S	S30908	75 [515]	30 [205]	35	B90	200		
TP309H	S30909	75 [515]	30 [205]	35	B90	200		
TP309Cb	S30940	75 [515]	30 [205]	35	B90	200		
TP309HCb	S30941	75 [515]	30 [205]	35	B90	200		
TP310S	S31008	75 [515]	30 [205]	35	B90	200		
TP310H	S31009	75 [515]	30 [205]	35	B90	200		
TP310Cb	S31040	75 [515]	30 [205]	35	B90	200		
TP310HCb	S31041	75 [515]	30 [205]	35	B90	200		
	S31050: t ≤ 0.25 in. [6 mm]	84 [580]	39 [270]	25	B95	230		
	t > 0.25 in. [6 mm] S31254:	78 [540]	37 [255]	25	B95	230		
	t ≤ 0.187 in. [5.00 mm]	98 [675]	45 [310]	35	B100	270		
	t > 0.187 in. [5.00 mm]	95 [655]	45 [310]	35	B100	270		
	S31266	109 [750]	61 [420]	35	B100	270		
	S31277	112	52 [360]	40	B100	270		
TP316	S31600	[770] 75	30 [205]	35	B90	200		
TP316L	S31603	[515] 70	25 [170]	35	B90	200		
TP316H	S31609	[485] 75	30 [205]	35	B90	200		
TP316N	S31651	[515] 80	35 [240]	35	B90	200		

[550]

TABLE 3 Continued

Grade	UNS Designation		Strength,	Elongation in 2 in.	Rockwell Hardness	Vickers Hardness
		min, ksi [MPa]	min, ksi [MPa]	or 50 mm, min, %	Number, max	Number, max ^B
TP316LN	S31653	75 [515]	30 [205]	35	B90	200
 TP317	S31655 S31700	92 [635] 75 [515]	45 [310] 30 [205]	35 35	B100 B90	270 200
TP317L	S31703	75 [515]	30 [205]	35	B90	200
	S31725	75 [515]	30 [205]	35	B90	200
	S31726	80 [550]	35 [240]	35	B90	200
	S31727	80 [550]	36 [245]	35	B96	230
	S32050	98 [675]	48 [330]	40	B100	270
	S32053	93 [640]	43 [295]	40	B96	230
TP321	S32100	75 [515]	30 [205]	35	B90	200
TP321H	S32109	75 [515]	30 [205]	35	B90	200
	S32615 S32654	80 [550] 109 [750]	32 [220] 62 [430]	25 35	B100 B100	270 270
	S33228	73 [500]	27 [185]	30	B90	200
	S34565	115 [795]	60 [415]	35	B100	270
TP347	S34700	75 [515]	30 [205]	35	B90	200
TP347H	S34709	75 [515]	30 [205]	35	B90	200
TP348	S34800	75 [515]	30 [205]	35	B90	200
TP348H	S34809	75 [515]	30 [205]	35	B90	200
	S35045	70 [485]	25 [170]	35	B90	200
TPXM-15	S38100	75 [515]	30 [205]	35	B90	200
Alloy 20	S38815 N08020 N08367	78 [540] 80 [550]	37 [255] 35 [240]	30 30	B100 B95	270 230
• • •	t ≤ 0.187 in. [5 mm]	100 [690]	45 [310]	30	B100	270
	t > 0.187 in. [5 mm]	95 [655]	45 [310]	30	B100	270
800 800H	N08800 N08810	75 [515] 65 [450]	30 [205] 25 [170]	30 30	B90 B90	200 200
	N08811	65 [450]	25 [170] 25 [170]	30	B90	200
	N08904	71 [490]	31 [215]	35	B90	200
	N08926	94 [650]	43 [295]	35	B100	270

A Not applicable to tubes less than ½ in. [3.2 mm] in outside diameter or having wall thickness below 0.015 in. [0.4 mm], or both. The tensile properties of such small diameter or thin wall tubes shall be a matter of agreement between the manufacturer and the purchaser

13.6 Hydrostatic or Nondestructive Electric Test—Each tube shall be subjected to either the hydrostatic or the nondestructive electric test. The purchaser may specify which test is to be used.

manufacturer and the purchaser.

BSee 10.2 for when Vickers testing is permitted.

- 13.7 Grain Size—Grain size determinations on grades TP309H, TP309HCb, TP310H and TP310HCb shall be made on the same number of tubes as prescribed for the flattening test.
- 13.8 Heavily cold worked tubes (HCW) shall be capable of passing the weld decay test listed in Supplementary S7 with a weld metal to base metal loss ratio of 0.90 to 1.10. The test is not required unless S7 is specified in the purchase order.

13.9 Lot Definitions:

13.9.1 For flattening and flange requirements, the term lot applies to all tubes prior to cutting of the same nominal size and wall thickness which are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and from the same heat which are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, the number of tubes of the same size and from the same heat in a lot shall be determined from the size of the tubes as prescribed in Table 4.

13.9.2 For tension and hardness test requirements, the term lot applies to all tubes prior to cutting, of the same nominal diameter and wall thickness which are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and the same heat which are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, a lot shall include all tubes of the same size and heat, annealed in the same furnace at the same temperature, time at heat, and furnace speed.

14. Permissible Variations in Dimensions

14.1 Dimensional tolerances other than wall thickness tolerances shall be in accordance with Specification A1016/

TABLE 4 Number of Tubes in a Lot Heat Treated by the Continuous Process

Size of Tube	Size of Lot
2 in. [50.8 mm] and over in outside diameter and 0.200 in. [5.1 mm] and over in wall thickness	not more than 50 tubes
Less than 2 in. [50.8 mm] but over 1 in. [25.4 mm] in outside diameter or over 1 in. [25.4 mm] in outside diameter and under 0.200 in. [5.1 mm] in wall thickness	not more than 75 tubes
1 in. [25.4 mm] or less in outside diameter	not more than 125 tubes

- A1016M. Wall thickness tolerances shall be ± 10 % of nominal wall for all tubing sizes.
- 14.2 The wall thickness of the weld shall not exceed the wall thickness measured 90° from the weld by more than 6% of the specified wall thickness or 0.004 in. [0.1 mm], whichever is greater.
- 14.2.1 Requirements of 14.2 are not applicable when any of the following apply:
- 14.2.1.1 When the specified wall thickness exceeds 12 % of the specified outside diameter;
- 14.2.1.2 When the specified wall thickness exceeds 0.165 in. [4.2 mm];
- 14.2.1.3 When the specified OD exceeds 3 in. [76.2 mm]; or 14.2.1.4 When the specified minimum yield strength given in Table 3 for the specified grade is 35 ksi [240 MPa] or greater.

15. Workmanship, Finish, and Appearance

15.1 Finished tubes shall have smooth ends free of burrs and shall not deviate from straightness by more than 0.030 in. [0.8 mm] in 3 ft [900 mm] of length.

16. Surface Condition

16.1 The tubes, after final heat treatment, shall be chemically descaled or pickled free of scale. When bright annealing is used, pickling or chemical descaling is not necessary.

17. Forming Operations

17.1 Tubes when inserted in the boiler shall stand expanding and beading without showing cracks or flaws. All tubes, when properly manipulated, shall be able to stand expanding and beading without showing cracks and flaws, and also shall stand all forging, welding, and bending operations necessary for application without developing defects.

18. Product Marking

18.1 In addition to the marking prescribed in Specification A1016/A1016M, the marking for Grades TP304H, TP309H, TP309HCb, TP310H, TP310HCb, TP316H, TP321H, TP347H, TP348H, N08810, and N08811 shall also include the heat number and the heat-treatment lot identification.

19. Keywords

19.1 austenitic stainless steel; boiler tubes; condenser tube; heat exchanger tube; high temperature applications; N08800; N08810; N08811; steel tube; superheater tubes; temperature service applications, high; welded steel tube and heavily cold worked (HCW) tubes

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall apply only when specified by the purchaser in the inquiry, contract, or order.

S1. Stress-Relieved Annealed Tubes

- S1.1 For use in certain corrosives, particularly chlorides where stress corrosion may occur, tubes in Grades TP304L, TP316L, TP321, TP347, and TP348 may be specified in the stress-relieved annealed condition. Details of these supplemental requirements shall be agreed upon by the manufacturer and the purchaser.
- S1.2 When stress-relieved tubes are specified, tubes shall be given a heat treatment at 1550 to 1650 °F [845 to 900 °C] after roll straightening. Cooling from this temperature range may be either in air or by slow cooling. No mechanical straightening is permitted after the stress-relief treatment.
- S1.3 Straightness of the tubes shall be a matter of negotiation between the purchaser and manufacturer.

S2. Minimum Wall Tubes

S2.1 When specified by the purchaser, tubes shall be furnished on a minimum wall basis. Such tubes shall satisfy the minimum wall thickness requirements of Specification A1016/A1016M rather than the nominal wall requirements of this specification. In addition to the marking required by Section 18, the tubing shall be marked S2.

S3. Pneumatic Test

S3.1 The tubing shall be examined by a pneumatic test (either air under water or pneumatic leak test) in accordance with Specification A1016/A1016M.

S4. Stabilizing Heat Treatment

S4.1 Subsequent to the solution anneal required in Section 6, Grades TP309HCb, TP310HCb, TP321, TP321H, TP347, TP347H, TP348, and TP348H shall be given a stabilization heat treatment at a temperature lower than that used for the initial solution annealing heat treatment. The temperature of stabilization heat treatment shall be at a temperature as agreed upon between the purchaser and vendor.

S5. DELETED

S6. Intergranular Corrosion Test

S6.1 When specified, material shall pass intergranular corrosion tests conducted by the manufacturer in accordance with Practices A262, Practice E.

Note S6.1—Practice E requires testing on the sensitized condition for low carbon or stabilized grades, and on the as-shipped condition for other grades.

S6.2 A stabilization heat treatment in accordance with Supplementary Requirement S4 may be necessary and is permitted in order to meet this requirement for the grades containing titanium or columbium, particularly in their H versions.

S7. Weld Decay Test

- S7.1 This test is not applicable to alloys with a nickel content \geq 19.0 % or a molybdenum content \geq 4.00 %, or both.
- Note S7.1—The weld decay test is sensitive for the presence of delta ferrite in the weld material. Increasing amounts of delta ferrite will result in a higher ratio as defined in S7.10. Alloys with the high nickel or molybdenum content of S7.1 may not form delta ferrite and therefore may not be sensitive to this test.
- S7.2 When specified by the purchase order, one sample from each lot of tubing (See 13.9.2) shall be subjected to testing in a boiling mixture of 50 % reagent grade hydrochloric acid and 50 % water.
- S7.3 Approximately 2-in. long samples shall be prepared from a production length of tubing. Shorter, 1-in. samples may be used for small diameter (½-in. and below) tubing. Split the sample longitudinally to allow for easy micrometer measurements. The sample may be one piece which contains the weld and at least 90° of base-metal to one side of the weld. Alternately, the sample may be two separate pieces with one containing the weld and a similar size section from the balance of the tube opposite the weld consisting of 100 % base metal. Remove all burrs and sharp edges by lightly grinding. Remove dust and grease by cleaning with soap and water or other suitable solvents. Then, place sample(s) in the flask. It is not recommended to test more than four samples together, or to mix alloy types.
- S7.4 Prepare the hydrochloric acid solution by slowly adding reagent grade (approximately 37%) hydrochloric acid to an equal volume of distilled water. (**Warning**—Protect eyes and use rubber gloves when handling acid. Mixing shall be done under a hood and testing shall be run under a hood.)
- S7.5 The test container shall be a 1-L Erlenmeyer flask equipped with ground-glass joints and an Ahlin condenser. The volume of the solution shall be approximately 700 mL.
- S7.6 Measure the thickness of the tube at five locations along the weld area and at five locations along the base-metal section. In both cases, take measurements at approximately equal longitudinal intervals along the section lengths. Make these measurements with a sharp pointed micrometer accurate to at least 0.001 in. The micrometer must be suitable for measuring the small features in the surface after testing. Typical pin micrometers have tapered anvils with a tip radius of less than 0.015 in.
- S7.7 Immerse the samples into the solution. Add boiling chips and bring to a boil. Allow the chips to remain boiling throughout the test. The time of testing shall be that which is required to remove 40 to 60 % of the original base-metal

thickness (usually 2 h or less). If more than 60 % of the base-metal thickness remains, the sample may be removed after 24 h.

S7.8 At the end of the test period, remove the samples from the solution, rinse with distilled water, and dry.

S7.9 After exposure to the test solution, repeat the tube-thickness measurement as in S7.6. If the thinning is not uniform across the width of the weld, then two sets of weld-metal measurement are required. One set of measurements is to be taken along the centerline of the weld. The second set of measurements is to be taken in the thinnest area of the weld.

S7.10 Calculate the corrosion ratio, R, for both sections of the weld as follows in Eq 1:

$$R = \frac{W_o - W}{B_o - B} \tag{1}$$

where:

 W_o = average weld-metal thickness before the test,

W = average weld-metal thickness after the test,

 B_o = average base-metal thickness before the test, and

B = average base-metal thickness after the test.

S7.11 Acceptance Criteria:

S7.11.1 The ratio of the thinnest section of the weld and adjacent heat affected zone versus the base metal shall be determined. The following ratios or alternatives are commonly specified:

S7.11.1.1 A corrosion ratio of 1.25 or less. If not specified by the purchase order, this is the default criteria.

S7.11.1.2 A corrosion ratio of 1.00 or less.

S7.11.1.3 Alternative ratios may be agreed between the purchaser and supplier.

S8. Special Applications

S8.1 For special applications, such as hydraulic expansion of tubes into tube sheets, dimensions of the weld shape and thickness shall be per agreement between the purchaser and supplier. Tubes ordered to this requirement shall bear the additional marking of NB.

S9. Additional Testing of Welded Tubing for ASME Requirements

S9.1. When this supplement is specified in the purchase order, in certain ASME applications it is permissible to use 100 % joint efficiency for longitudinal weld, provided the following additional requirements are met:

S9.1.1 Each tube shall be subjected to an ultrasonic inspection employing Practices E273 or E213 with the rejection criteria referenced in Specification A1016/A1016M.

S9.1.2 If Practice E273 is employed, a 100 % volumetric inspection of the entire length of each tube shall also be performed using one of the nondestructive electric tests permitted by Specification A1016/A1016M.

S9.1.3 The test methods described in the supplement may not be capable of inspecting the end portions of tubes. This condition is referred to as end effect. This portion, as determined by the manufacturer, shall be removed and discarded.

S9.1.4 In addition to the marking prescribed in Specification A1016/A1016M, "S9" shall be added after the grade designation.

Note S9.1—When specified, the special testing in this supplement is intended for special ASME applications. It is not mandatory for all ASME applications.



SPECIFICATION FOR ELECTRIC-RESISTANCE-WELDED FERRITIC ALLOY-STEEL BOILER AND SUPERHEATER TUBES



SA-250/SA-250M

(Identical with ASTM Specification A250/A250M-05(2014) except that Supplementary Requirement S1 is mandatory when 100% weld joint efficiency is required.)

Standard Specification for Electric-Resistance-Welded Ferritic Alloy-Steel Boiler and Superheater Tubes

1. Scope

- 1.1 This specification covers several grades, designated T1, T1a, T1b, T2, T11, T12 and T22, of minimum-wall-thickness, electric-resistance-welded, carbon-molybdenum and chromium-molybdenum alloy-steel, boiler and superheater tubes.
- 1.2 The tubing sizes and thicknesses usually furnished to this specification are $\frac{1}{2}$ to 5 in. [12.7 to 127 mm] in outside diameter and 0.035 to 0.320 in. [0.9 to 8.1 mm], inclusive, in minimum wall thickness. Tubing having other dimensions may be furnished, provided such tubes comply with all other requirements of this specification.
- 1.3 Mechanical property requirements do not apply to tubing smaller than $\frac{1}{8}$ in. [3.2 mm] in inside diameter or 0.015 in. [0.4 mm] in thickness.
- 1.4 An optional supplementary requirement is provided for non-destructive examination for certain ASME applications.
- 1.5 The values stated in either SI units or inch-pound units are to be reaagrded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
 - 1.5.1 Within the text, the SI units are shown in brackets.
- 1.5.2 The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.

2. Referenced Documents

2.1 ASTM Standards:

- A1016/A1016M Specification for General Requirements for Ferritic Alloy Steel, Austenitic Alloy Steel, and Stainless Steel Tubes
- E213 Practice for Ultrasonic Testing of Metal Pipe and Tubing
- E273 Practice for Ultrasonic Testing of the Weld Zone of Welded Pipe and Tubing

3. Ordering Information

- 3.1 Orders for material under this specification should include the following, as required, to describe the desired material adequately:
 - 3.1.1 Quantity (feet, metres, or number of lengths),
 - 3.1.2 Name of material (electric-resistance-welded tubes),
 - 3.1.3 Grade (Table 1),
 - 3.1.4 Size (outside diameter or minimum wall thickness),
 - 3.1.5 Length (specific or random),
 - 3.1.6 Optional requirement (7.3.6),
- 3.1.7 Test report required (see Certification Section of Specification A1016/A1016M),
 - 3.1.8 Specification designation, and
- 3.1.9 Special requirements and any supplementary requirements selected.

4. General Requirements

4.1 Product furnished under this specification shall conform to the applicable requirements of Specification A1016/A1016M, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A1016/A1016M constitutes nonconformance with this specification. In case of conflicts with the requirements of this specification and Specification A1016/A1016M, this specification shall prevail.

5. Materials and Manufacture

- 5.1 The steel shall be killed.
- 5.2 The tubes shall be made by electric-resistance welding.
- 5.3 Heat Treatment
- 5.3.1 After welding, or when cold finished, after the final cold-drawing pass, all tubes shall be heat treated and, except as provided in 5.3.2, furnished in the full annealed, isothermal annealed, normalized, or normalized and tempered condition at

TABLE 1 Chemical Requirements

Element				Composition	, %		
	Grade T1	Grade T1a	Grade T1b	Grade T2	Grade T11	Grade T12	Grade T22
Carbon	0.10-0.20	0.15-0.25	0.14 max	0.10-0.20	0.05-0.15	0.05-0.15	0.15 max
Manganese	0.30-0.80	0.30-0.80	0.30-0.80	0.30-0.61	0.30-0.60	0.30-0.61	0.30-0.60
Phosphorus, max	0.025	0.025	0.025	0.025	0.025	0.030	0.025
Sulfur, max	0.025	0.025	0.025	0.020	0.020	0.020	0.020
Silicon	0.10-0.50	0.10-0.50	0.10-0.50	0.10-0.30	0.50-1.00	0.50 max	0.50 max
Molybdenum	0.44-0.65	0.44-0.65	0.44-0.65	0.44-0.65	0.44-0.65	0.44-0.65	0.87-1.13
Chromium				0.50-0.81	1.00-1.50	0.80-1.25	1.90-2.60

the option of the manufacturer. If furnished in the normalized and tempered condition, the minimum tempering temperature shall be 1200 °F [650 °C], except T22 shall be tempered at 1250 °F [676 °C] minimum.

5.3.2 When grades T1, T1a, T1b, and T2 are cold finished, the tubes may, at the option of the manufacturer, be heat treated after the final cold-drawing pass at a temperature of 1200 °F or higher, provided one of the heat treatments specified in 5.3.1 was applied after welding.

6. Chemical Composition

6.1 The steel shall conform to the requirements given in Table 1

6.2 Product Analysis

6.2.1 An analysis of either one length of flat-rolled stock or one tube shall be made on each heat. The chemical composition thus determined shall conform to the requirements given in Table 1.

6.2.2 If the original test for product analysis fails, retests of two additional lengths of flat-rolled stock or tubes shall be made. Both retests for the elements in question shall meet the requirements of the specification; otherwise all remaining material in the heat or lot (See 8.1) shall be rejected or, at the option of the producer, each length of flat-rolled stock or tube may be individually tested for acceptance. Lengths of flat-rolled stock or tubes that do not meet the requirements of the specification shall be rejected.

7. Mechanical Requirements

7.1 Tensile Requirements

7.1.1 The material shall conform to the requirements as to tensile properties given in Table 2.

7.1.2 Table 3 gives the computed minimum elongation values for each ½32-in. [0.8-mm] decrease in wall thickness. Where the wall thickness lies between two values given in Table 3, the minimum elongation value shall be determined by the following equation:

$$E = 48t + 15.00$$
 [$E = 1.87t + 15.00$]

where:

E = elongation in 2 in. [50 mm] %, and

t = actual thickness of specimen, in.[mm].

7.2 *Hardness Requirements*—The tubes shall have a hardness not exceeding the values given in Table 4.

7.3 Mechanical Tests Required

7.3.1 *Tension Test*—One tension test shall be made on a specimen for lots of not more than 50 tubes. Tension tests shall be made on specimens from two tubes for lots of more than 50 tubes (See 8.2).

7.3.2 Flattening Test—One flattening test shall be made on specimens from each end of one finished tube, not the one used for the flange test, from each lot (See 8.1).

7.3.3 Flange Test—One flange test shall be made on specimens from each end of one finished tube, not the one used for the flattening test, from each lot (See 8.1).

7.3.4 Reverse Flattening Test—One reverse flattening test shall be made on a specimen from each 1500 ft [450 m] of finished tubing.

7.3.5 *Hardness Test*—Brinell and Rockwell hardness tests shall be made on specimens from two tubes from each lot (See 8.2).

7.3.6 Hydrostatic or Nondestructive Electric Tests—Each tube shall be subjected to either the hydrostatic or the nondestructive electric test. The purchaser may specify which is to be used.

8. Sampling

8.1 For flattening and flange requirements, the term *lot* applies to all tubes prior to cutting of the same specified outside diameter and specified wall thickness that are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and from the same heat that are heat treated in the same furnace charge. When the final heat treatment is in a

TABLE 2 Tensile Requirements

		•					
Grade	T1	T1a	T1b	T2	T11	T12	T22
Tensile strength, min, ksi [MPa]	55 [380]	60 [415]	53 [365]	60 [415]	60 [415]	60 [415]	60 [415]
Yield strength, min, ksi [MPa]	30 [205]	32 [220]	28 [195]	30 [205]	30 [205]	32 [220]	30 [205]
Elongation in 2 in. or 50 mm, min, %	30	30	30	30	30	30	30
For longitudinal strip tests a deduction shall be made for each	1.50 ^A						
1/32-in. [0.8-mm] decrease in wall thickness below 5/16 in.							
[8 mm] from the basic minimum elongation of the following							
nercentage points							

^A See Table 3 for the computed minimum values.

TABLE 3 Minimum Elongation Values

Wall Thick	Wall Thickness			
in.	mm	50 mm, min,% ^A Grades T1, T1a, T1b,		
		T2, T11, T12, and T22		
5/16 (0.312)	8	30		
%2 (0.281)	7.2	29		
1/4 (0.250)	6.4	27		
7/32 (0.219)	5.6	26		
3/16 (0.188)	4.8	24		
5/32 (0.156)	4	22		
1/8 (0.125)	3.2	21		
3/32 (0.094)	2.4	20		
1/16 (0.062)	1.6	18		

^A Calculated elongation requirements shall be rounded to the nearest whole number.

TABLE 4 Hardness Requirements

Grade	Brinell Hardness	Rockwell Hardness
	Number (Tubes 0.200	Number (Tubes less
	in. [5.1 mm] and over	than 0.200 in. [5.1 mm]
	in wall thickness), HBW	in wall thickness), HRB
T1	146	80
T1a	153	81
T1b	137	77
T2	163	85
T11	163	85
T12	163	85
T22	163	85

continuous furnace, the number of tubes of the same size and from the same heat in a lot shall be determined from the size of the tubes given in Table 5.

8.2 For tensile and hardness test requirements, the term *lot* applies to all tubes prior to cutting, of the same specified outside diameter and specified wall thickness that are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and the same heat that are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, a lot shall include all tubes of the same size and heat, heat treated in the same furnace at the same temperature, time at heat, and furnace speed.

9. Forming Operations

9.1 Tubes when inserted in the boiler shall stand expanding and beading without showing cracks or flaws. Superheater tubes when properly manipulated shall stand all forging, welding, and bending operations necessary for application without developing defects.

TABLE 5 Number of Tubes in a Lot Heat Treated by the Continuous Process

Size of Tube	Size of Lot
2 in. [50.8 mm] and over in outside diameter and 0.200 in. [5.1 mm] and over in wall thickness Less than 2 in. [50.8 mm] but over 1 in. [25.4 mm] in outside diameter or over 1 in. [25.4 mm] in outside diameter and under 0.200 in. [5.1 mm] in wall thickness	not more than 50 tubes not more than 75 tubes
1 in. [25.4 mm] or less in outside diameter	not more than 125 tubes

10. Product Marking

10.1 In addition to the marking prescribed in Specification A1016/A1016M, the marking shall include the words "Electric Resistance-Welded Steel."

11. Keywords

11.1 boiler tube; resistance welded steel tube; steel tube, alloy; superheater tube; welded steel tube

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements may become a part of the specification when specified in the inquiry or invitation to bid, and purchase order or contract. These requirements shall not be considered, unless specified in the order and the necessary tests shall be made at the mill.

S1. Additional Testing of Welded Tubing for 100 % Joint Efficiency in Certain ASME Applications

- S1.1 Where this supplement is specified in the purchase order, in certain ASME applications it is permissible to use 100 % joint efficiency for the longitudinal weld, provided the following additional requirements are met:
- S1.1.1 Each tube shall be subjected to an ultrasonic inspection employing Practices E273 or E213E273E213 with the rejection criteria referenced in Specification A1016/A1016M.
- S1.1.2 If Practice E273 is employed, a 100 % volumetric inspection of the entire length of each tube shall also be performed using one of the non-destructive electric tests permitted by Specification A1016/A1016M.
- S1.1.3 The test methods described in the supplement may not be capable of inspecting the end portions of tubes. This condition is referred to as end effect. This portion, as determined by the manufacturer, shall be removed and discarded.
- S1.1.4 In addition to the marking prescribed in Specification A1016/A1016M, "S1" shall be added after the grade designation



SPECIFICATION FOR STAINLESS CHROMIUM STEEL-CLAD PLATE



SA-263



(Identical with ASTM Specification A263-12(2019).)

Standard Specification for Stainless Chromium Steel-Clad Plate

1. Scope

- 1.1 This specification covers plate of a carbon steel or low-alloy steel base to which is integrally and continuously bonded on one or both sides a layer of stainless chromium steel. The material is generally intended for pressure vessel use.
- 1.2 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

2. Referenced Documents

- 2.1 ASTM Standards:
- A6/A6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
- A20/A20M Specification for General Requirements for Steel Plates for Pressure Vessels
- A240/A240M Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A480/A480M Specification for General Requirements for Flat-Rolled Stainless and Heat-Resisting Steel Plate, Sheet, and Strip
- A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applications
- A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products

2.2 Other Standards:

ASME Code Boiler and Pressure Vessel Code, Section IX, Welding Qualifications

3. Terminology

- 3.1 Definitions of Terms Specific to This Standard:
- 3.1.1 This material is considered as single-clad or doubleclad stainless chromium-steel plate, depending on whether one or both sides are covered.
- 3.1.2 *alloy cladding*—the stainless chromium steel component of the composite plate.
- 3.1.3 base metal (backing steel)—component to which the alloy cladding is applied, usually the greater percentage of the composite plate.
- 3.1.4 integrally and continuously bonded—a condition in which the alloy cladding and base metal are brought together to form a metallurgical bond at essentially the entire interface of the two metals by means other than those processes that do not produce a homogeneous composite plate.

4. Ordering Information

- 4.1 It is the responsibility of the purchaser to specify all requirements that are necessary for material ordered under this specification. Such requirements may include, but are not limited to, the following:
 - 4.1.1 Quantity (weight or number of pieces).
- 4.1.2 Cladding alloy specification (UNS or ASTM Specification A240/A240M) and whether cladding is for corrosion allowance only.
 - 4.1.3 Base metal specification.
 - 4.1.4 Bond integrity Class (1, 3, or 5; see Section 13).
- 4.1.5 Dimensions including the minimum or nominal thicknesses of the cladding alloy and the backing steel, or of the total composite and if more or less restrictive thickness tolerances apply.
- 4.1.6 Product analysis, if required (see Section 10). Specify whether applicable to the cladding alloy, backing steel, or both.

- 4.1.7 Mechanical properties including shear test if required (see Sections 7, 8, and 9).
 - 4.1.8 Finish (see Section 12).
- 4.1.9 Restrictions, if required, on repair by welding (see Section 14).
- 4.1.10 Additions to the specification or special requirements such as any applicable construction code rules.
- 4.1.11 Notification when the cladding alloy is to be used for inclusion in the design strength calculations for an applicable construction code.
- Note 1—Construction codes may dictate certain fabrication requirements when the cladding is used in the design calculations that may be different than if the cladding is used for corrosion resistance only. This may be particularly important when the alloy cladding involves the use of welded components in the explosion bonded clad manufacturing process. It is incumbent on the purchaser to make the clad manufacturer aware of any such restrictions or applications at time of order.
- 4.2 In addition to the basic requirements of this specification and the backing steel specification, certain supplementary requirements are available when additional control, testing, or examination is required to meet end use requirements. The purchaser is referred to the listed supplementary requirements in this specification and to the detailed requirements in Specification A20/A20M.
- 4.3 If the requirements of this specification are in conflict with the requirements of Specification A20/A20M, the requirements of this specification shall prevail.

5. Materials and Manufacture

- 5.1 Process:
- 5.1.1 The steel shall be made by the open-hearth, electric-furnace, or basic-oxygen processes, or by secondary processes whereby steel made from these primary processes is remelted using, but not limited to electroslag remelting or vacuum-arc remelting processes.
- 5.1.2 The alloy-cladding metal may be metallurgically bonded to the base metal by any method that will produce a clad steel that will conform to the requirements of this specification.
- 5.1.3 For explosively bonded products, the alloy cladding metal may be comprised of two or more separate alloy plates or sheets completely welded together to form a single fabricated component.
- 5.2 *Heat Treatment*—Unless otherwise specified or agreed upon between the purchaser and the manufacturer, all plates shall be furnished in the normalized, tempered, normalized and tempered, or quenched and tempered condition as permitted by the backing steel specification. Stress relieving of the composite plate by heating subcritically is permitted, provided the temperature is 75°F (40°C) or more below the minimum tempering temperature (when tempered).

6. Chemical Composition

6.1 The composite plate shall conform to any desired combination of alloy-cladding metal and base metal as described in 6.2 and 6.3 and as agreed upon between the purchaser and the manufacturer.


- 6.2 Alloy Cladding Metal—The alloy-cladding metal specified shall conform to the requirements as to chemical composition prescribed for the respective chromium steel in Specification A240/A240M.
- 6.3 Base Metal—The base metal shall be carbon steel or low-alloy steel conforming to the ASTM specifications for steels for pressure vessels or other as agreed by the purchaser and the manufacturer. The base metal shall conform to the chemical requirements of the specification to which it is ordered.

7. Mechanical Properties

- 7.1 Tensile Requirements:
- 7.1.1 The tensile properties shall be determined by a tension test of the composite plate for clad plates that meet all of the following conditions.
- (1) The nominal composite gage is less than or equal to $1\frac{1}{2}$ in. (38 mm).
- (2) The specified minimum tensile strength of the base steel is less than or equal to 70 000 psi (485 MPa).
- (3) The specified minimum yield strength of the base steel is less than or equal to 40 000 psi (275 MPa).

The tensile properties thus determined shall be not less than the minimum and not more than 5000 psi (35 MPa) over the maximum prescribed in the specification for the base steel used. All other tensile test requirements of the specification for the base steel shall be met.

- 7.1.2 The tensile properties shall be determined by a tension test of the base steel only for clad plates that meet one of the following conditions. The properties thus determined shall meet all of the tensile test requirements for the base steel.
 - (1) The composite gage is greater than $1\frac{1}{2}$ in. (38 mm).
- (2) The specified minimum tensile strength of the base steel is greater than 70 000 psi (485 MPa).
- (3) The specified minimum yield strength of the base steel is greater than 40 000 psi (275 MPa).
- 7.1.3 If the cladding is for corrosion allowance only, the cladding need not be included in the tensile test. The tensile properties thus determined shall meet the base steel requirements.
- 7.2 Tests for strength of the bond, when required, must be specified by the purchaser and shall consist of one of the following.
- 7.2.1 Shear Strength—When required by the purchaser, the minimum shear strength of the alloy cladding and base metals shall be 20 000 psi (140 MPa). The shear test, when specified, shall be made in the manner indicated in Fig. 1. The minimum cladding thickness for shear testing shall be 0.075 in. (1.9 mm) exclusive as ordered. Testing for shear strength for clad plates with minimum cladding thickness of 0.075 in. (1.9 mm) or less shall be permitted upon agreement between the purchaser and the manufacturer.
- 7.2.2 Bond Strength—As an alternative to the shear strength test provided in 7.2.1, or when agreed upon by the purchaser and the manufacturer, or both, three bend tests shall be made with the alloy cladding in compression to determine the quality of the bond. These bend tests shall be made in the manner of the tension tests indicated in Fig. 2 and shall be bent through an

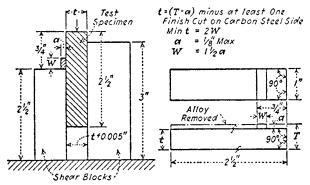


Shear Blocks shall be Bolted Firmly Together against Filler Piece which Provide Space 0.005" Wider than tof Specimen

Metric Equivalents

in.	mm	in.	mm
0.005	0.127	1	25.4
1/8	3.18	2 1/2	64.5
3/4	19.1	3	76.2

FIG. 1 Test Specimen and Method of Making Shear Test of Clad



Metric Equivalents				
in.	mm.	in.	mm	
0.01	0.254 3.17 6.35 25.4	1½ 2 3 8	38.1 50.8 76.2 203.2	

Note 1—When necessary, it is permissible to use a narrower specimen, but in such a case the reduced portion shall be not less than 1 in. in width.

Note 2—Punch marks for measuring elongation after fracture shall be made on the flat or on the edge of the specimen and within the parallel section; either a set of nine punch marks 1 in. apart, or one or more sets of 8-in. punch marks may be used.

Note 3—The dimension t is the thickness of the test specimen as provided for in the applicable material specifications.

FIG. 2 Standard Rectangular Tension Test Specimen with 8-in.

Gage Length

angle of 180° to the bend diameters provided for in either Specification A6/A6M or Specification A20/A20M, Appendix X4 or equivalent, as applicable. At least two of the three tests shall show not more than 50 % separation on both edges of the bent portion. Greater separation shall be cause for rejection.


7.3 Methods and practices relating to mechanical testing required by this specification shall be in accordance with the Test Methods and Definitions of A370.

8. Number of Tests and Retests

- 8.1 One or more tension tests, as required by the specifications for the base metal and, when specified, one shear test or three bond bend tests shall be made representing each plate as rolled. Each specimen shall be in the final condition of heat treatment required for the plate, including any SPWHT if required.
- 8.2 If any test specimen shows defective machining or develops flaws, it may be discarded and another specimen substituted.

9. Test Specimens

- 9.1 The tension test specimens from plate shall conform to the requirements prescribed in the specifications for the base metal.
- 9.2 Bend test specimens for the alternative bond strength tests shall be taken at right angles to longitudinal axis of the plate.
- 9.3 When required by the purchaser, the shear test specimen should be taken near a corner of the plate, parallel to its longitudinal axis, or other location that is representative of the final product.
- 9.4 For plates $1\frac{1}{2}$ in. (38 mm) and under in thickness tension test specimens shall be full thickness of the material except as specified in 7.1.2 and 7.1.3.
- 9.5 For plates over $1\frac{1}{2}$ in. (38 mm) in thickness, tension tests shall be of the form shown in Fig. 3 and shall be of all base steel conforming to the requirements of the specification for the base steel.
- 9.6 The bend test specimen used for bond strength determination shall be 1½ in. (38 mm) wide by not more than ¾ in. (19 mm) in thickness and shall be machined to the form and dimensions shown in Fig. 2, or may be machined with both



iв. mm in. mm 0.003 9.53 0.0763∕8 0.127 0.50 12.7 0.005 0.010.25450.8 21/4 ⅓ 3.18 64.5

Note 1—The gage length and fillets shall be as shown, but the ends may be of any shape to fit the holders of the testing machine in such a way that the load shall be axial. The reduced section shall have a gradual taper from the ends toward the center, with the ends 0.003 to 0.005 in. larger in diameter than the center.

FIG. 3 Standard Round Tension Test Specimen with 2-in. Gage Length

edges parallel. In reducing the thickness of the specimen, both the alloy cladding and the base steel shall be machined so as to maintain the same ratio of clad metal to base steel as is maintained in the plate, except that the thickness of the clad metal need not be reduced below ½ in. (3.1 mm). The sides of the bend test specimen used for bond strength determination may have the corners rounded to a radius not over ½ in. (1.6 mm) for plates, 2 in. (50 mm) and under in thickness, and not over ½ in. (3.1 mm) for plates over 2 in. (50 mm) in thickness.

10. Product Analysis

- 10.1 Product analysis may be required for the cladding alloy on the finished product. Chemical analysis may be accomplished by wet chemical or instrumental procedures. If wet chemical procedures are used, millings may be taken only when the composite plate thickness is sufficient to permit obtaining millings without danger of contamination from the adjacent layer. If spectrometric procedures are used, the sample shall be exposed on the center line of the cladding when there is sufficient cladding thickness available so that there is no contamination from the adjacent base metal.
- 10.2 If product analysis is specified by the purchaser for the cladding alloy, it shall be made from drillings or millings taken from the final piece or a broken test specimen. For wet chemical analysis, in order to avoid contamination by the base plate metal, millings of cladding samples shall be taken from the test coupon by removal and discard of all the base metal plate material, plus 40 % of the cladding thickness from the bonded side, not to exceed ½6 in. (1.6 mm). The material shall be chemically cleaned and sufficient millings shall be taken to represent the full cross-section of the remainder. If there is insufficient cladding thickness available to spectrographically expose on the center line of the cladding without contamination, 50 % of the cladding shall be removed and the sample exposed on this surface.
- 10.3 Methods and practices relating to chemical analysis required by this specification shall be in accordance with the Test Methods, Practices, and Terminology of A751.
- 10.4 Results of the product analysis shall conform to the requirements of Section 7 of Specification A480/A480M.
- 10.5 Results of the product analysis for the backing steel when required shall conform to the requirements of Section 7 of Specification A20/A20M.

11. Permissible Variations

- 11.1 Permissible variations except for thickness shall be in accordance with Specification A20/A20M.
- 11.2 Minimum thickness of the alloy cladding metal and of the backing steel, or of the total composite plate shall be as required by purchase order documents when ordered to minimum thicknesses.
- 11.3 Permissible variation in thickness when ordered to nominal thicknesses shall be 0.01 in. (0.3 mm) under each for backing steel or total composite, and 0.03 in. (0.8 mm) under for the alloy cladding.

- 11.4 Permissible variations for excess thickness of the total composite shall be the greater of 0.125 in. (3 mm) or 10 % of the total composite thickness ordered and may occur in either backing steel, cladding, or both, provided the minimum for each is met.
- 11.5 More restrictive or less restrictive permissible variations may be agreed upon by the purchaser and the manufacturer

12. Workmanship, Finish, and Appearance

- 12.1 The material shall be free of injurious defects, shall have a workmanlike appearance, and shall conform to the designated finish.
- 12.2 Plate alloy surfaces shall be blasted (descaled by means such as sand or stainless grit, shot or wire, or equivalent), pickled, blast-cleaned and pickled, or 100 % conditioned.

13. Bond Quality

- 13.1 The cladding metal shall be integrally and continuously bonded to the base metal.
 - 13.2 Inspection:
- 13.2.1 Clad plates less than 3/8 in. (10 mm) total minimum composite thickness shall be visually inspected for bond integrity prior to shipment.
- 13.2.2 Clad plates 3/8 in. (10 mm) and thicker total minimum composite thickness, and when specified by the purchaser, clad plates less than 3/8 in. (10 mm) total minimum composite thickness, shall be ultrasonically inspected for bond integrity prior to shipment in accordance with the Procedures and Methods of Specification A578/A578M.
- 13.2.3 Areas of non-bond detected visually shall be explored ultrasonically to determine the extent of the condition in accordance with 13.2.2. For purposes of defining non-bond, the cladding shall be interpreted to be unbonded when there is complete loss of back reflection accompanied by an echo indication from the plane of the interface of the clad and backing steel. Areas within 1 in. (25 mm) of a cut edge on the plate that contain indications exceeding 50 % of the back reflection at the bond interface shall be considered to be unbonded.
- 13.2.4 Extent of ultrasonic examination shall be at the discretion of the manufacturer and sufficient enough to provide the quality level required by the purchaser. Plates may be ordered with 100 % coverage (Supplementary Requirements S12).
 - 13.3 Quality Levels:
- 13.3.1 *Class I*—No single unbonded area exceeding 1 in. (25 mm) in its longest dimension with total unbonded area not to exceed 1 % of the total cladded surface area.
- 13.3.2 Class 3—No single unbonded area exceeding 3 in. (75 mm) in its longest dimension with total unbonded area not to exceed 3 % of the total cladded surface area.
- 13.3.3 Class 5—No single unbonded area exceeding 9 in.² (58 cm²) with total unbonded area not to exceed 5 % of the total cladded surface area.

13.3.4 The class to be supplied should be listed on the purchase order. When none has been specified, plates shall be furnished as Class 5 at the option of the manufacturer.

14. Welding

- 14.1 All welding which is a part of the delivered product, including any made in the fabrication of the cladding alloy component, shall be performed with a procedure and welders or welding operators that are qualified in accordance with Section IX of the ASME Code.
- 14.2 The material manufacturer may repair defects in cladding by welding provided the following requirements are met:
- 14.2.1 When specified in the purchase order, prior approval shall be obtained from the purchaser.
- 14.2.2 The defective area shall be removed and the area prepared for repair shall be examined by a magnetic particle method or a liquid penetrant method to ensure all defective area has been removed. Method of test and acceptance standard shall be as agreed upon between the purchaser and the manufacturer.
- 14.2.3 The repair weld shall be deposited in accordance with a welding procedure and welding materials suitable for the cladding material. The surface condition of the repaired area shall be restored to a condition similar to the rest of the cladding.
- 14.2.4 The repaired area shall be examined by a liquid penetrant method.
- 14.2.5 The location and extent of the weld repairs together with the repair procedure and examination results shall be transmitted as a part of the certification.
- 14.3 All repairs in Alloy Type 410 and any repairs to Type 410S penetrating into the backing steel shall be stress relieved to eliminate residual stresses unless otherwise agreed upon.

15. General Requirements for Delivery

15.1 Material furnished under this specification shall conform to the applicable requirements of Specification A20/A20M.

16. Certification

- 16.1 The chemical analysis of the base metal and the alloy cladding shall be certified to the purchaser by the clad plate manufacturer.
- 16.2 The results of the tests in Section 7 and any other tests required by the purchase order shall be reported to the purchaser.
- 16.3 Compliance with the clad quality level of 13.3 shall be certified. Reports shall include the results of ultrasonic inspection when Supplementary Requirement S12 is specified.
- 16.4 Compliance with any applicable construction code shall be certified and the appropriate documentation provided when appropriate in the case of explosively bonded clad produced using welded alloy cladding components (see 4.1.10 and 4.1.11).

17. Product Marking

- 17.1 Except as specified in 17.2, plates shall be marked in accordance with the requirements of Specification A20/A20M for the backing steel and the type number of the alloy cladding metal and this specification number.
- 17.2 For double-clad material or for material under ½ in. (6.35 mm) in thickness, the marking shall be legibly stenciled instead of stamped.

18. Keywords

18.1 alloy cladding; backing steel; bond strength; carbon steel; clad steel plate; low-alloy steel; pressure vessel; shear strength; stainless chromium steel

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified on the order. A list of standardized supplementary requirements for use at the option of the purchaser are included in Specification A20/A20M. Several of those considered suitable for use with this specification are listed below by title. Other tests may be performed by agreement between the supplier and the purchaser.

- S2. Product Analysis
- S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons
- S5. Charpy V-Notch Impact Test
- S12. Ultrasonic Examination in accordance with Specification A578/A578M

SPECIFICATION FOR STAINLESS CHROMIUM-NICKEL STEEL-CLAD PLATE



SA-264



(Identical with ASTM Specification A264-12(2019).)

Standard Specification for Stainless Chromium-Nickel Steel-Clad Plate

1. Scope

- 1.1 This specification covers plate of a carbon steel or low-alloy steel base to which is integrally and continuously bonded on one or both sides a layer of stainless chromiumnickel steel. The material is generally intended for pressure vessel use.
- 1.2 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

2. Referenced Documents

- 2.1 ASTM Standards:
- A6/A6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
- A20/A20M Specification for General Requirements for Steel Plates for Pressure Vessels
- A240/A240M Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A480/A480M Specification for General Requirements for Flat-Rolled Stainless and Heat-Resisting Steel Plate, Sheet, and Strip
- A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applications
- A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products

2.2 Other Standards:

ASME Code Boiler and Pressure Vessel Code, Section IX, Welding Qualifications

3. Terminology

- 3.1 Definitions of Terms Specific to This Standard:
- 3.1.1 This material is considered as single-clad or doubleclad corrosion-resisting chromium-nickel steel plate, depending on whether one or both sides are covered.
- 3.1.2 *alloy cladding*—the stainless chromium-nickel steel component of the composite plate.
- 3.1.3 base metal (backing steel)—component to which the alloy cladding is applied, usually the greater percentage of the composite plate and usually consisting of carbon or low-alloy steel
- 3.1.4 integrally and continuously bonded—the process by which the alloy cladding and base metal are brought together to form a metallurgical bond at essentially the entire interface of the two metals by means other than those processes that do not produce a homogeneous composite plate.

4. Ordering Information

- 4.1 It is the responsibility of the purchaser to specify all requirements that are necessary for material ordered under this specification. Such requirements may include, but are not limited to, the following:
 - 4.1.1 Quantity (weight or number of pieces).
- 4.1.2 Cladding alloy specification, (UNS or ASTM Specification A240/A240M and whether cladding is for corrosion allowance only),
 - 4.1.3 Base metal specification.
 - 4.1.4 Bond integrity Class (1, 3, or 5).
- 4.1.5 Dimensions including the minimum or nominal thickness of the cladding alloy, and the backing steel, or of the total composite plate and if more or less restrictive thickness tolerances apply.
- 4.1.6 Product analysis, if required (see Section 10). Specify whether applicable to the cladding alloy, backing steel or both.

- 4.1.7 Mechanical properties, including shear test if required.
- 4.1.8 Finish (see Section 12).
- 4.1.9 Restrictions, if required, on repair by welding (see Section 14).
- 4.1.10 Additions to the specification or special requirements such as any applicable construction code rules.
 - 4.1.11 Corrosion testing if applicable.
- 4.1.12 Notification when the cladding alloy is to be used for inclusion in the design strength calculations for an applicable construction code.
- Note 1—Construction codes may dictate certain fabrication requirements when the cladding is used in the design calculations that may be different than if the cladding is used for corrosion resistance only. This may be particularly important when the alloy cladding involves the use of welded components in the explosion bonded clad manufacturing process. It is incumbent on the purchaser to make the clad manufacturer aware of any such restrictions or applications at time of order.
- 4.2 In addition to the basic requirements of this specification and the backing steel specification, certain supplementary requirements are available when additional control, testing, or examination is required to meet end use requirements. The purchaser is referred to the listed supplementary requirements in this specification and to the detailed requirements in Specification A20/A20M.
- 4.3 If the requirements of this specification are in conflict with the requirements of Specification A20/A20M, the requirements of this specification shall prevail.
 - 4.4 Special tests.

5. Materials and Manufacture

- 5.1 Process:
- 5.1.1 The steel shall be made by the open-hearth, electric-furnace, or basic-oxygen processes, or by secondary processes whereby steel made from these primary processes is remelted using, but not limited to electroslag remelting or vacuum-arc remelting processes.
- 5.1.2 The alloy-cladding metal may be metallurgically bonded to the base metal by any method that will produce a clad steel that will conform to the requirements of this specification.
- 5.1.3 For explosively bonded products, the alloy cladding metal may be comprised of two or more separate alloy plates or sheets completely welded together to form a single fabricated component.
 - 5.2 Heat Treatment:
- 5.2.1 Unless otherwise specified or agreed upon between the purchaser and the manufacturer, all austenitic stainless steel clad plates shall be given a heat treatment consisting of heating to the proper temperature for the solution of the chromium carbides in the cladding followed by individual air cooling. For base metals of air-hardening low-alloy steels the above heat treatment shall be followed by a tempering treatment. In the case of clad plate manufactured without hot rolling, the base metal and alloy cladding components may be heat treated separately as appropriate prior to bonding.
- 5.2.2 Duplex stainless steel clad plates shall be provided in a heat treated condition as agreed upon between the purchaser and the manufacturer.


5.2.3 When plates are to be cold formed, or when otherwise required by the base metal specification, the purchaser may specify that such plates, following solution annealing, be heat treated for grain refinement of the base metal by normalizing and either air cooled or water quenched as appropriate.

6. Chemical Composition

- 6.1 The composite plate may conform to any desired combination of alloy-cladding metal and base metal as described in 6.2 and 6.3 and as agreed upon between the purchaser and the manufacturer.
- 6.2 Alloy Cladding Metal—The alloy-cladding metal specified shall conform to the requirements as to chemical composition prescribed for the respective chromium-nickel or duplex steel in Specification A240/A240M.
- 6.3 Base Metal—The base metal shall be carbon steel or low-alloy steel conforming to the ASTM specifications for steel for pressure vessels, or other, as agreed by the purchaser and the manufacturer. The base metal shall conform to the chemical requirements of the specification to which it is ordered.

7. Mechanical Properties

- 7.1 Tensile Requirements:
- 7.1.1 The tensile properties shall be determined by a tension test of the composite plate for clad plates that meet all of the following conditions.
- (1) The composite gage is less than or equal to $1\frac{1}{2}$ in. (38 mm).
- (2) The specified minimum tensile strength of the base steel is less than or equal to 70 000 psi (485 MPa)
- (3) The specified minimum yield strength of the base steel is less than or equal to 40 000 psi (275 MPa).
- (4) The tensile properties thus determined shall be not less than the minimum and not more than 5000 psi (35 MPa) over the maximum prescribed in the specification for the base steel used. All other tensile test requirements of the specification for the base steel shall be met.
- 7.1.2 The tensile properties shall be determined by a tension test of the base steel only for clad plates that meet one of the following conditions. The properties thus determined shall meet all of the tensile test requirements for the base steel.
 - (1) The composite gage is greater than $1\frac{1}{2}$ in. (38 mm).
- (2) The specified minimum tensile strength of the base steel is greater than 70 000 psi (485 MPa).
- (3) The specified minimum yield strength of the base steel is greater than 40 000 psi (275 MPa).
- 7.1.3 If the cladding is for corrosion allowance only, the cladding need not be included in the tensile test. The tensile properties thus determined shall meet the base steel requirements.
- 7.2 Tests for strength of the bond, when required, must be specified by the purchaser and shall consist of one of the following.
- 7.2.1 Shear Strength—When required by the purchaser, the minimum shear strength of the alloy cladding and base metals shall be 20 000 psi (140 MPa). The shear test, when specified, shall be made in the manner indicated in Fig. 1. The minimum

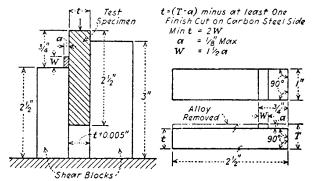


Shear Blocks shall be Bolted Firmly Together against Filler Piece which Provide Space 0.005" Wider than t of Specimen

Metric Equivalents					
in. mm in. mm					
0.005	0.127	1	25.4		
1/8	3.18	21/2	64.5		
3/4	19.1	3	76.2		

FIG. 1 Test Specimen and Method of Making Shear Test of Clad Plate

cladding thickness for shear testing shall be 0.075 in. (1.9 mm), exclusive as ordered. Testing for shear strength for clad plates with minimum cladding thickness of 0.075 in. (1.9 mm) or less shall be permitted upon agreement between the purchaser and the manufacturer.

7.2.2 Bond Strength—As an alternative to the shear strength test provided in 7.2.1, or when agreed upon by the purchaser and the manufacturer, or both, three bend tests shall be made with the alloy cladding in compression to determine the quality of the bond. These bend tests shall be made in the manner of the tension tests indicated in Fig. 2 and shall be bent through an angle of 180° to the bend diameters provided for in either



Metric Equivalents

		=	
in.	mm	in.	mm
0.01	0.254	11/2	38.1
1/8	3.17	2	50.8
1/4	6.35	3	76.2
1	25.4	8	203.2

Note 1—When necessary, it is permissible to use a narrower specimen, but in such a case the reduced portion shall be not less than 1 in. in width.

Note 2—Punch marks for measuring elongation after fracture shall be made on the flat or on the edge of the specimen and within the parallel section; either a set of nine punch marks 1 in. apart, or one or more sets of 8-in. punch marks may be used.

Note 3—The dimension t is the thickness of the test specimen as provided for in the applicable material specifications.

FIG. 2 Standard Rectangular Tension Test Specimen with 8-in.

Gage Length

Specification A6/A6M or Specification A20/A20M, Appendix X4 or equivalent, as applicable. At least two of the three tests shall show not more than 50 % separation on both edges of the bent portion. Greater separation shall be cause for rejection.

7.3 Methods and practices relating to mechanical testing required by this specification shall be in accordance with the Test Methods and Definitions of A370.

8. Number of Tests and Retests


- 8.1 One or more tension tests, as required by the specifications for the base metal and when specified, one shear test or three bond bend tests shall be made, representing each plate as rolled. Each specimen shall be in the final condition of heat treatment required for the plate, including any SPWHT if required.
- 8.2 If any test specimen shows defective machining or develops flaws, it may be discarded and another specimen substituted.

9. Test Specimens

- 9.1 The tension test specimens from plate shall conform to the requirements prescribed in the specifications for the base metal.
- 9.2 Bend test specimens for the alternative bond strength tests, shall be taken at right angles to its longitudinal axis.
- 9.3 When required by the purchaser, the shear test specimen should be taken near a top or bottom corner of the plate as rolled, parallel to its longitudinal axis, or other location that is representative of the final product.
- 9.4 For plates 1½ in. (38 mm) and under in thickness, tension test specimens shall be the full thickness of the material, except as specified in 7.1.2 and 7.1.3.
- 9.5 For plates over $1\frac{1}{2}$ in. (38 mm) in thickness, tension tests shall be of the form shown in Fig. 3 and shall be of all base steel conforming to the requirements of the specification for the base steel.
- 9.6 The bend test specimen used for bond strength determination shall be 1½ in. (38 mm) wide by not more than ¾ in. (19 mm) in thickness and shall be machined to the form and dimensions shown in Fig. 2, or may be machined with both edges parallel. In reducing the thickness of the specimen, both the alloy cladding and the base steel shall be machined so as to maintain the same ratio of clad metal to base steel as is maintained in the plate, except that the thickness of the clad metal need not be reduced below ⅓ in. (3.1 mm). The sides of the bend test specimen used for bond strength determination may have the corners rounded to a radius not over ⅓ in. (1.6 mm) for plates, 2 in. (50 mm) and under in thickness, and not over ⅓ in. (3.1 mm) for plates over 2 in. (50 mm) in thickness.

10. Product Analysis

10.1 Product analysis may be required for the cladding alloy on finished product. Chemical analysis may be accomplished by wet chemical or instrumental procedures. If wet chemical procedures are used, millings may be taken only when the composite plate thickness is sufficient to permit obtaining



in.	mm	in.	mm
0.003	0.076	3/8	9.53
0.005	0.127	0.50	12.7
0.01	0.254	2	50.8
1/8	3.18	21/4	64.5

Note 1—The gage length and fillets shall be as shown, but the ends may be of any shape to fit the holders of the testing machine in such a way that the load shall be axial. The reduced section shall be a gradual taper from the ends toward the center, with the ends 0.003 to 0.005 in. larger in diameter than the center.

FIG. 3 Standard Round Tension Test Specimen with 2-in. Gage Length

millings without danger of contamination from the adjacent layer. If spectrometric procedures are used, the sample shall be exposed on the center line of the cladding when there is sufficient cladding thickness available so that there is no contamination from the adjacent base metal.

- 10.2 If product analysis is specified by the purchaser for the cladding alloy, it shall be made on a sample taken from the finished product or a broken test specimen. For wet chemical analysis, in order to avoid contamination by the base plate metal, millings of cladding samples shall be taken from the test coupon by removal and discard of all the base metal plus 40 % of the cladding thickness from the bonded side, not to exceed ½16 in. (1.6 mm). The material shall be cleaned and sufficient millings taken to represent the full cross-section of the remainder. If there is insufficient cladding thickness available to spectrographically expose on the center line of the cladding without contamination, 50 % of the cladding shall be removed and the sample exposed on this surface.
- 10.3 The results of the product analysis shall conform to the requirements of Section 7 of Specification A480/A480M.
- 10.4 Methods and practices relating to chemical analysis required by this specification shall be in accordance with the Test Methods, Practices, and Definitions of A751.
- 10.5 Results of the product analysis for the backing steel when required shall conform to the requirements of Section 7 of Specification A20/A20M.

11. Permissible Variations

- 11.1 Permissible variations except for thickness shall be in accordance with Specification A20/A20M.
- 11.2 Minimum thickness of the alloy cladding metal and of the backing steel, or of the total composite plate shall be as required by purchase order documents when ordered to minimum thicknesses.

- 11.3 Permissible variation in thickness when ordered to nominal thicknesses shall be 0.01 in. (0.3 mm) under each for backing steel or total composite, and 0.03 in. (0.8 mm) under for the alloy cladding.
- 11.4 Permissible variations for excess thickness of the total composite shall be the greater of 0.125 in. (3 mm) or 10 % of the total composite thickness ordered and may occur in either backing steel, cladding, or both, provided the minimum for each is met.
- 11.5 More restrictive or less restrictive permissible variations may be agreed upon by the purchaser and the manufacturer.

12. Workmanship, Finish, and Appearance

- 12.1 The material shall be free of injurious defects, shall have a workmanlike appearance, and shall conform to the designated finish.
- 12.2 Plate alloy surfaces shall be blasted (descaled by means of sand or stainless grit, shot, or wire), pickled, blast-cleaned and pickled, or 100 % conditioned.

13. Bond Quality

- 13.1 The cladding metal shall be integrally and continuously bonded to the base metal.
 - 13.2 Inspection:
- 13.2.1 Clad plates less than $\frac{3}{8}$ in. (10 mm) total minimum composite thickness shall be visually inspected for bond integrity prior to shipment.
- 13.2.2 Clad plates 3/8 in. (10 mm) and thicker total minimum composite thickness, and when specified by the purchaser, clad plates less than 3/8 in. (10 mm) total minimum composite thickness, shall be ultrasonically inspected for bond integrity prior to shipment in accordance with the Procedures and Methods of Specification A578/A578M.
- 13.2.3 Areas of non-bond detected visually shall be explored ultrasonically to determine the extent of the condition in accordance with 13.2.2. For purposes of defining non-bond, the cladding shall be interpreted to be unbonded when there is complete loss of back reflection accompanied by an echo indication from the plane of the interface of the clad and backing steel. Areas within 1 in. (25 mm) of a cut edge on the plate that contain indications exceeding 50 % of the back reflection at the bond interface shall be considered to be unbonded.
- 13.2.4 Extent of ultrasonic examination shall be at the discretion of the manufacturer and sufficient enough to provide the quality level required by the purchaser. Plates may be ordered with 100 % coverage (Supplementary Requirement S12).
 - 13.3 Quality Levels:
- 13.3.1 *Class I*—No single unbonded area exceeding 1 in. (25 mm) in its longest dimension with total unbonded area not to exceed 1 % of the total cladded surface area.
- 13.3.2 Class 3—No single unbonded area exceeding 3 in. (75 mm) in its longest dimension with total unbonded area not to exceed 3 % of the total cladded surface area.

- 13.3.3 *Class* 5—No single unbonded area exceeding 9 in.² (58 cm²) with total unbonded area not to exceed 5 % of the total cladded surface area.
- 13.3.4 The class to be supplied should be listed on the purchase order. When none has been specified, plates shall be furnished as Class 5 at the option of the manufacturer.

14. Welding

- 14.1 All welding which is part of the delivered product, including any made in the fabrication of the cladding alloy component, shall be performed with a procedure and welders or welding operators that are qualified in accordance with Section IX of the ASME Code.
- 14.2 The material manufacturer may repair defects in cladding by welding provided the following requirements are met:
- 14.2.1 When specified in the purchase order, prior approval shall be obtained from the purchaser.
- 14.2.2 The defective area shall be removed and the area prepared for repair shall be examined by a liquid penetrant method to ensure that all of the defective area has been removed. Method of test and acceptance standard shall be as agreed upon between the purchaser and the manufacturer.
- 14.2.3 The repair weld shall be deposited in accordance with a welding procedure and welding materials suitable for the cladding material. The surface condition of the repaired area shall be restored to a condition similar to the rest of the cladding.
- 14.2.4 The repaired area shall be examined by a liquid penetrant method.
- 14.2.5 The location and extent of the weld repairs together with the repair procedure and examination results shall be transmitted as a part of the certification.

15. General Requirements for Delivery

15.1 Material furnished under this specification shall conform to the applicable requirements of Specification A20/A20M.

16. Certification

- 16.1 The chemical analysis of the base metal and the alloy cladding shall be certified to the purchaser by the clad plate manufacturer.
- 16.2 The results of the tests in Section 7 and any other tests required by the purchase order shall be reported to the purchaser.
- 16.3 Compliance with the clad quality level of 13.3 shall be certified. Reports shall include the results of ultrasonic inspection when Supplementary Requirement S12 is specified.
- 16.4 Compliance with any applicable construction code shall be certified and the appropriate documentation provided when appropriate in the case of explosively bonded clad produced using welded alloy cladding components (see 4.1.10 and 4.1.12).

17. Product Marking

- 17.1 Except as specified in 17.2, plates shall be marked in accordance with the requirements of Specification A20/A20M for the backing steel and the type number of the alloy cladding metal and this specification number.
- 17.2 For double-clad material or for material under ½ in. (6.35 mm) in thickness, the marking specified in 17.1 shall be legibly stenciled instead of stamped.

18. Keywords

18.1 alloy cladding; backing steel; bond strength; carbon steel; clad steel plate; low-alloy steel; pressure vessel; shear strength; stainless chromium-nickel steel

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified on the order. A list of standardized supplementary requirements for use at the option of the purchaser are included in Specification A20/A20M. Several of those considered suitable for use with this specification are listed below by title. Other tests may be performed by agreement between the supplier and the purchaser.

- S2. Product Analysis
- S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons
- S5. Charpy V-Notch Impact Test
- S12. Ultrasonic Examination in accordance with Specification A578/A578M

SPECIFICATION FOR NICKEL AND NICKEL-BASE ALLOY-CLAD STEEL PLATE



SA-265



(Identical with ASTM Specification A265-12(2019).)

Standard Specification for Nickel and Nickel-Base Alloy-Clad Steel Plate

1. Scope

- 1.1 This specification covers plate of a carbon steel or low-alloy steel base to which is integrally and continuously bonded on one or both sides a layer of nickel or nickel-base alloy. The material is generally intended for pressure vessel use but may be used in other structural applications where corrosion resistance of the alloy is of prime importance.
- 1.2 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

2. Referenced Documents

- 2.1 ASTM Standards:
- A6/A6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
- A20/A20M Specification for General Requirements for Steel Plates for Pressure Vessels
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applications
- A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- B127 Specification for Nickel-Copper Alloy (UNS N04400) Plate, Sheet, and Strip
- B162 Specification for Nickel Plate, Sheet, and Strip
- B168 Specification for Nickel-Chromium-Iron Alloys (UNS N06600, N06601, N06603, N06690, N06693, N06025, N06045, and N06696), Nickel-Chromium-Cobalt-

- Molybdenum Alloy (UNS N06617), and Nickel-Iron-Chromium-Tungsten Alloy (UNS N06674) Plate, Sheet, and Strip
- B333 Specification for Nickel-Molybdenum Alloy Plate, Sheet, and Strip
- B409 Specification for Nickel-Iron-Chromium Alloy Plate, Sheet, and Strip
- B424 Specification for Ni-Fe-Cr-Mo-Cu Alloy (UNS N08825, UNS N08221, and UNS N06845) Plate, Sheet, and Strip
- B443 Specification for Nickel-Chromium-Molybdenum-Columbium Alloy(UNS N06625) and Nickel-Chromium-Molybdenum-SiliconAlloy (UNS N06219) Plate, Sheet, and Strip
- B463 Specification for UNS N08020 Alloy Plate, Sheet, and Strip
- B575 Specification for Low-Carbon Nickel-Chromium-Molybdenum, Low-Carbon Nickel-Chromium-Molybdenum-Copper, Low-Carbon Nickel-Chromium-Molybdenum-Tantalum, and Low-Carbon Nickel-Chromium-Molybdenum-Tungsten Alloy Plate, Sheet, and Strip
- B582 Specification for Nickel-Chromium-Iron-Molybdenum-Copper Alloy Plate, Sheet, and Strip
- B625 Specification for UNS N08925, UNS N08031, UNS N08932, UNS N08926, UNS N08354, and UNS R20033 Plate, Sheet, and Strip
- 2.2 Other Standards:
- ASME Code Boiler and Pressure Vessel Code, Section IX, Welding Qualifications

3. Terminology

- 3.1 Definitions of Terms Specific to This Standard:
- 3.1.1 This material is considered as single-clad or double-clad nickel or nickel-base alloy clad steel plate, depending on whether one or both sides are covered.
- 3.1.2 The term plate as used in this specification applies to material $\frac{3}{16}$ in. (2.73 mm) and over in thickness, and over 10 in. (254 mm) in width.

- 3.1.3 *alloy cladding*—the nickel or nickel-base alloy component of the composite plate.
- 3.1.4 base metal (backing steel)—component to which the alloy cladding is applied, usually the greater percentage of the composite plate and usually consisting of carbon or low-alloy steel.
- 3.1.5 integrally and continuously bonded—the process by which the alloy cladding and base metal are brought together to form a metallurgical bond at essentially the entire interface of the two metals by means other than those processes that do not produce a homogeneous composite plate.

4. Ordering Information

- 4.1 It is the responsibility of the purchaser to specify all requirements that are necessary for material ordered under this specification. Such requirements may include, but are not limited to the following:
 - 4.1.1 Quantity (weight or number of pieces).
 - 4.1.2 Heat treatment, if required (see Section 5).
- 4.1.3 Dimensions, including the thickness of the cladding alloy and the backing steel, or of the total composite plate and if more or less restrictive thickness tolerances apply.
 - 4.1.4 Cladding alloy specification (see Section 6).
 - 4.1.5 Base metal specification (see Section 6).
- 4.1.6 Product analysis, if required. Specify whether applicable to the cladding alloy, backing steel, or both (see Section 10).
 - 4.1.7 Mechanical Properties (see Sections 7, 13, and 14).
- 4.1.8 Restrictions, if required, on repair by welding (see Section 14).
- 4.1.9 Additions to the specification or special requirements such as applicable construction code rules.
 - 4.1.10 Corrosions tests, if required.
- 4.1.11 Notification when the cladding alloy is to be used for inclusion in the design strength calculations for an applicable construction code.
- Note 1—Construction codes may dictate certain fabrication requirements when the cladding is used in the design calculations that may be different than if the cladding is used for corrosion resistance only. This may be particularly important when the alloy cladding involves the use of welded components in the explosion bonded clad manufacturing process. It is incumbent on the purchaser to make the clad manufacturer aware of any such restrictions or applications at time of order.
- 4.2 In addition to the basic requirements of this specification and the backing steel specification, certain supplementary requirements are available when additional control, testing, or examination is required to meet end use requirements. The purchaser is referred to the listed supplementary requirements in this specification and to the detailed requirements in Specification A20/A20M.
 - 4.2.1 Nondestructive examination,
 - 4.2.2 Impact testing, and
- 4.2.3 Simulated Post-Weld Heat Treatment of Mechanical Test Coupons (SPWHT).
- 4.3 If the requirements of this specification are in conflict with the requirements of Specification A20/A20M, the requirements of this specification shall prevail.
 - 4.4 Special tests.

5. Materials and Manufacture

5.1 *Process:*

- 5.1.1 The steel shall be made by the open-hearth, electric-furnace (with separate degassing and refining optional), or basic-oxygen processes, or by secondary processes whereby steel made from these primary processes is remelted using, but not limited to electroslag remelting or vacuum arc remelting processes.
- 5.1.2 The cladding metal may be metallurgically bonded to the base metal by any method that will produce a clad steel that will conform to the requirements of this specification.
- 5.1.3 For explosively bonded products, the alloy cladding metal may be comprised of two or more separate alloy plates or sheets completely welded together to form a single fabricated component.
- 5.2 Heat Treatment—Unless a specific heat treatment is required by the cladding material or base steel specification, or unless otherwise agreed upon by the purchaser and manufacturer, the clad plate shall be furnished in a condition that is appropriate for the cladding alloy, base metal, or both.

6. Chemical Composition

- 6.1 The composite plate may conform to any desired combination cladding metal and base metal as described in 6.2 and 6.3, and as agreed upon between the purchaser and the manufacturer.
- 6.2 Cladding Metal—The nickel or nickel-base alloy cladding metal specified shall conform to the requirements as to chemical composition prescribed for the respective metal in Specifications B127, B162, B168, B333, B409, B424, B443, B463, B575, B582, and B625, or other nickel-base alloy as agreed upon by the purchaser and manufacturer.
- 6.3 Base Metal—The base metal shall be carbon steel or low-alloy steel conforming to the ASTM specifications for steels for either pressure vessels or general structural applications, or other, as agreed upon by the purchaser and manufacturer. The base metal shall conform to the chemical requirements of the specification to which it is ordered.


7. Mechanical Properties

- 7.1 *Tensile Requirements:*
- 7.1.1 The tensile properties shall be determined by a tension test of the composite plate for clad plates that meet all of the following conditions.
- (1) The nominal composite gage is less than or equal to $1\frac{1}{2}$ in (38 mm).

TABLE 1 Weights for Component Materials

	Der	nsity	Weight per Square Foot for Material
	lb/in. ³	g/cm ³	1 in. (25.4 mm) in Thickness, lb
Steel	0.283	7.83	40.80
Nickel	0.321	8.88	46.22
Nickel-copper alloy	0.319	8.83	45.94
Nickel-chromium-iron alloy	0.307	8.49	44.21

- (2) The specified minimum tensile strength of the base steel is less than or equal to 70 000 psi (485 MPa).
- (3) The specified minimum yield strength of the base steel is less than or equal to 40 000 psi (275 MPa).
- (4) The tensile properties thus determined shall not be less than the minimum and not more than 5000 psi (35 MPa) over the maximum prescribed in the specification for the base steel used. All other tensile test requirements of the specification for the base steel shall be met.
- 7.1.2 The tensile properties shall be determined by a tension test of the base steel only for clad plates that meet one of the following conditions. The properties thus determined shall meet all of the tensile test requirements for the base steel.
 - (1) The composite gage is greater than $1\frac{1}{2}$ in. (38 mm).
- (2) The specified minimum tensile strength of the base steel is greater than 70 000 psi (485 MPa).
- (3) The specified minimum yield strength of the base steel is greater than 40 000 psi (275 MPa).
- 7.1.3 If the cladding is for corrosion allowance only, the cladding need not be included in the tensile test. The tensile properties thus determined shall meet the base steel requirements.
- 7.2 Test for strength of the bond, when required, must be specified by the purchaser and shall consist of one of the following.
- 7.2.1 Shear Strength—When required by the purchaser, the minimum shear strength of the alloy cladding and base metals shall be 20 000 psi (140 MPa). The shear test, when specified, shall be made in the manner indicated in Fig. 1. The minimum cladding thickness for shear testing shall be 0.075 in. (1.9 mm) exclusive as ordered. Testing for shear strength for clad plates with minimum cladding thickness of 0.075 in (1.9 mm) or less shall be permitted upon agreement between the purchaser and the manufacturer.

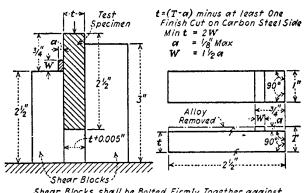

Shear Blocks shall be Bolted Firmly Together against Filler Piece which Provide Space 0.005" Wider than to of Specimen

Metric	Equivalents

in.	mm	in.	mm
0.005	0.127	1	25.4
1/8	3.17	21/2	64.5
3/4	19.1	3	76.2

FIG. 1 Test Specimen and Method of Making Shear Test of Clad Plate


- 7.2.2 Bond Strength—As an alternative to the shear strength test provided in 7.2.1 or when agreed upon by the purchaser and the manufacturer, or both, three bend tests shall be made with the alloy cladding in compression to determine the quality of the bond. These bend tests shall be made in the manner of the tension tests indicated in Fig. 2 and shall be bent through an angle of 180° to the bend diameters provided for in either Specification A6/A6M or Specification A20/A20M (Appendix X4, or equivalent), as applicable. At least two of the three tests shall show not more than 50 % separation on both edges of the bent portion. Greater separation shall be cause for rejection.
- 7.3 Methods and practices relating to mechanical testing required by this specification shall be in accordance with the Test Methods and Definitions of A370.

8. Number of Tests and Retests

- 8.1 One or more tension tests, as required by the specifications for the base metal and when specified, one shear test or three bond bend tests shall be made, representing each plate as rolled. Each specimen shall be in the final condition of heat treatment required for the plate, including any SPWHT if required.
- 8.2 If any test specimen shows defective machining or develops flaws, it may be discarded and another specimen substituted.

9. Test Specimens

- 9.1 The tension test specimens shall conform to the requirements prescribed in the specifications for the base metal.
- 9.2 Bend test specimens for the alternative bond strength tests shall be taken at right angles to its longitudinal axis.



Metric Equivalents

in.	mm	in.	mm
0.01	0.254	11/2	38.1
1/8	3.17	2	50.8
1/4	6.35	3	76.2
1	25.4	8	203.2

Note 1—When necessary, it is permissible to use a narrower specimen, but in such a case the reduced portion shall be not less than 1 in. in width.

Note 2—Punch marks for measuring elongation after fracture shall be made on the flat or on the edge of the specimen and within the parallel section; either a set of nine punch marks 1 in. apart, or one or more sets of 8-in. punch marks may be used.


Note 3—The dimension t is the thickness of the test specimen as provided for in the applicable material specifications.

FIG. 2 Standard Rectangular Test Specimens with 8-in. Gage Length

- 9.3 When required by the purchaser, the shear test specimen shall be taken near a top or bottom corner of the plate as rolled, parallel to its longitudinal axis, or other location that is representative of the final product.
- 9.4 For plates $1\frac{1}{2}$ in. (38 mm) and under in thickness, tension test specimens shall be the full thickness of the material, except as specified in 7.1.2 and 7.1.3.
- 9.5 For plates over 1½ in. (38 mm) in thickness, tension tests shall be of the form shown in Fig. 3 and shall be of all base steel conforming to the requirements of the specification for the base steel.
- 9.6 The bend test specimen used for bond strength determination shall be 1½ in. (38 mm) by not more than ¾ in. (19 mm) in thickness and shall be machined to the form and dimensions shown in Fig. 2, or may be machined with both edges parallel. In reducing the thickness of the specimen, both the alloy cladding and the base steel shall be machined so as to maintain the same ratio of clad metal to base steel as is maintained in the plate, except that the thickness of the clad material need not be reduced below 1/8 in. (3.1 mm). The sides of the bend test specimen used for bond strength determination may have the corners rounded to a radius not over 1/16 in. (1.6 mm) for plates, 2 in. (50 mm) and under in thickness, and not over 1/8 in. (3.1 mm) for plates over 2 in. (50 mm) in thickness.

10. Product Analysis

10.1 Product analysis may be required for the cladding alloy on finished product. Chemical analysis may be accomplished by wet chemical or instrumental procedures. If wet chemical procedures are used, millings may be taken only when the composite plate thickness is sufficient to permit obtaining millings without danger of contamination from the adjacent layer. If spectrometric procedures are used, the sample shall be exposed on the center line of the cladding when there is



Metric Equivalents

in.	mm	in.	mm
0.003	0.076	3/8	9.53
0.005	0.127	0.50	12.7
0.01	0.254	2	50.8
1/8	3.18	21/4	64.5

Note 1—The gage length and fillets shall be as shown, but the ends may be of any shape to fit the holders of the testing machine in such a way that the load shall be axial. The reduced section shall have a gradual taper from the ends toward the center, with the ends 0.003 to 0.005 in. larger in diameter than the center.

FIG. 3 Standard Round Tension Tests Specimen with 2-in. Gage Length

sufficient cladding thickness available so that there is no contamination from the adjacent base metal.

- 10.2 If product analysis is specified by the purchaser for the cladding alloy, it shall be made on a sample taken from the finished product or a broken test specimen. For wet chemical analysis, in order to avoid contamination by the base plate metal, millings of cladding samples shall be taken from the test coupon by removal and discard of all the base metal plus 40 % of the cladding thickness from the bonded side, not to exceed ½16 in. (1.6 mm). The material shall be cleaned and sufficient millings taken to represent the full cross-section of the remainder. If there is insufficient cladding thickness available to spectrographically expose on the center line of the cladding without contamination, 50 % of the cladding shall be removed and the sample exposed on this surface.
- 10.3 The results of the product analysis shall conform to the requirements of standards referenced in Section 2.
- 10.4 Methods and practices relating to chemical analysis required by this specification shall be in accordance with the Test Methods, Practices, and Terminology of A751.
- 10.5 Results of the product analysis for the backing steel when required shall conform to the requirements of Section 7 of Specification A20/A20M or A6/A6M, as applicable.

11. Permissible Variations

- 11.1 Permissible variations except for thickness shall be in accordance with Specification A20/A20M or A6/A6M as applicable based on the backing specification.
- 11.2 Minimum thickness of the alloy cladding metal and of the backing steel, or of the total composite plate shall be as required by purchase order documents when ordered to minimum thickness.
- 11.3 Permissible variation in thickness when ordered to nominal thicknesses shall be 0.01 in. (0.3 mm) under each for backing steel or total composite, and 0.03 in. (0.8 mm) under for the alloy cladding.
- 11.4 Permissible variations for excess thickness of the total composite shall be the greater of 0.125 in. (3 mm) or 10 % of the total composite thickness ordered and may occur in either backing steel, cladding, or both, provided the minimum for each is met.
- 11.5 More restrictive or less restrictive permissible variations may be agreed upon by the purchaser and the manufacturer.

12. Workmanship Finish, and Appearance

- 12.1 The material shall be free of injurious defects and shall have a workmanlike appearance.
- 12.2 Unless otherwise specified, the clad surface may be supplied as-rolled, blasted (descaled by means of sand, grit, shot or wire followed by pickling), or 100 % conditioned.

13. Bond Quality

13.1 The cladding metal shall be integrally and continuously bonded to the base metal.

- 13.2 Inspection:
- 13.2.1 Clad plates less than 3/8 in. (10 mm) total minimum composite thickness shall be visually inspected for bond integrity prior to shipment.
- 13.2.2 Clad plates 3% in. (10 mm) and thicker total minimum composite thickness, and when specified by the purchaser, clad plates less than 3% in. (10 mm) total minimum composite thickness, shall be ultrasonically inspected for bond integrity prior to shipment in accordance with the Procedures and Methods of Specification A578/A578M.
- 13.2.3 Areas of non-bond detected visually shall be explored ultrasonically to determine the extent of the condition in accordance with 13.2.2. For purposes of defining non-bond, the cladding shall be interpreted to be unbonded when there is complete loss of back reflection accompanied by an echo indication from the plane of the interface of the clad and backing steel. Areas within 1 in. (25 mm) of a cut edge on the plate that contain indications exceeding 50 % of the back reflection at the bond interface shall be considered to be unbonded.
- 13.2.4 Extent of ultrasonic examination shall be at the discretion of the manufacturer and sufficient enough to provide the quality level required by the purchaser. Plates may be ordered with 100 % coverage (see Supplementary Requirement S12).
 - 13.3 Quality Levels:
- 13.3.1 *Class I*—No single unbonded area exceeding 1 in. (25 mm) in its longest dimension with total unbonded area not to exceed 1 % of the total cladded surface area.
- 13.3.2 Class 3—No single unbonded area exceeding 3 in. (75 mm) in its longest dimension with total unbonded area not to exceed 3% of the total cladded surface area.
- 13.3.3 Class 5—No single unbonded area exceeding 9 in.² (58 cm²) with total unbonded area not to exceed 5 % of the total cladded surface area.
- 13.3.4 The class to be supplied shall be listed on the purchase order. When none has been specified, plates shall be furnished as Class 5 at the option of the manufacturer.

14. Welding

- 14.1 All welding which is a part of the delivered product, including any made in the fabrication of the cladding alloy component, shall be performed with a procedure and welders or welding operators that are qualified in accordance with Section IX of the ASME Code.
- 14.2 The material manufacturer may repair defects in cladding by welding provided the following requirements are met:
- 14.2.1 When specified in the purchase order, prior approval shall be obtained from the purchaser.
- 14.2.2 The defective area shall be removed and the area prepared for repair shall be examined by a liquid penetrant method to ensure all defective area has been removed. Method

- of test and acceptance standard shall be as agreed upon between the purchaser and the manufacturer.
- 14.2.3 The repair weld shall be deposited in accordance with a welding procedure and welding materials suitable for the cladding material. The surface condition of the repaired area shall be restored to a condition similar to the rest of the cladding.
- 14.2.4 The repaired area shall be examined by a liquid penetrant method in accordance with 14.2.2.
- 14.2.5 The location and extent of the weld repairs together with the repair procedure and examination results shall be transmitted as a part of the certification.

15. General Requirements for Delivery

- 15.1 Material furnished under this specification shall conform to the applicable requirements of Specification A6/A6M or A20/A20M as appropriate for the backing metal.
- 15.2 In the event of conflicts between this specification and the general delivery requirement specification for the backing steel, this specification shall apply.

16. Certification

- 16.1 The chemical analysis of the base metal and the alloy cladding shall be certified to the purchaser by the clad plate manufacturer.
- 16.2 The results of the tests in Section 7 and any other tests required by the purchase order shall be reported to the purchaser.
- 16.3 Compliance with the clad quality level of 13.3 shall be certified. Reports shall include the results of ultrasonic inspection when Supplementary Requirement S12 is specified.
- 16.4 Compliance with any applicable construction code shall be certified and the appropriate documentation provided when appropriate in the case of explosively bonded clad produced using welded alloy cladding components (see 4.1.9 and 4.1.11).

17. Product Marking

- 17.1 Except as specified in 17.2, plates shall be marked in accordance with the requirements of Specification A6/A6M or A20/A20M for the backing steel as applicable, the cladding alloy designation, and this specification number.
- 17.2 For double-clad material or for material under 3/8 in. (6.35 mm) nominal in thickness or for clad plates provided with conditioned surfaces, the marking specified in 17.1 shall be legibly stenciled instead of stamped when the material is shipped with the alloy surface up.

18. Keywords

18.1 alloy cladding; bond strength; carbon steel; clad steel plate; low-alloy steel; nickel; nickel-base alloy

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified on the order. A list of standardized supplementary requirements for use at the option of the purchaser are included in Specification A20/A20M. Several of those considered suitable for use with this specification are listed below by title. Other tests may be performed by agreement between the supplier and the purchaser.

- S2. Product Analysis
- S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons
- S5. Charpy V-Notch Impact Test
- S12. Ultrasonic Examination in accordance with Specification A578/A578M



SPECIFICATION FOR CARBON STEEL FORGINGS FOR PRESSURE VESSEL COMPONENTS



SA-266/SA-266M



(23)

(Identical with ASTM Specification A266/A266M-21.)

Specification for Carbon Steel Forgings for Pressure Vessel Components

1. Scope

1.1 This specification covers four grades of carbon steel forgings for boilers, pressure vessels, and associated equipment.

Note 1—Designations have been changed as follows:

Current	Formerly
Grade 1	Class 1
Grade 2	Class 2
Grade 3	Class 3
Grade 4	Class 4

- 1.2 Supplementary requirements are provided for use when additional testing or inspection is desired. These shall apply only when specified individually by the purchaser in the order.
- 1.3 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system are not necessarily exact equivalents; therefore, to ensure conformance with the standard, each system shall be used independently of the other, and values from the two systems shall not be combined.
- 1.4 Unless the order specifies the applicable "M" specification designation, the material shall be furnished to the inchpound units.
- 1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

- A275/A275M Practice for Magnetic Particle Examination of Steel Forgings
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A788/A788M Specification for Steel Forgings, General Requirements
- A1058 Test Methods for Mechanical Testing of Steel Products—Metric
- E112 Test Methods for Determining Average Grain Size
- E165/E165M Practice for Liquid Penetrant Testing for General Industry
- E381 Method of Macroetch Testing Steel Bars, Billets, Blooms, and Forgings
- 2.2 Other Standard:
- ASME Boiler and Pressure Vessel Code, Section IX

3. Ordering Information and General Requirements

- 3.1 In addition to the ordering information required by Specification A788/A788M, the purchaser shall include with the inquiry and order a detailed drawing, sketch, or written description of the forging.
- 3.2 Material supplied to this specification shall conform to the requirements of Specification A788/A788M, which outlines additional ordering information, manufacturing requirements, testing and retesting methods and procedures, marking, certification, product analysis variations, and additional supplementary requirements.
- 3.3 If the requirements of this specification are in conflict with the requirements of Specification A788/A788M, the requirements of this specification shall prevail.
- 3.4 For hubbed flat heads and tube sheets ordered for ASME Boiler and Pressure Vessel Code application, Supplementary Requirement S12 of Specification A788/A788M shall be specified in addition to Supplementary Requirement S8 of this specification.

4. Materials and Manufacture

4.1 The steel shall be made in accordance with the Melting Process Section of Specification A788/A788M. A sufficient

discard shall be made to secure freedom from injurious pipe and undue segregation.

- 4.2 The material shall be forged as close as practical to the specified shape and size.
- 4.3 The finished product shall be a hot-worked forging as defined by Specification A788/A788M.

5. Machining

- 5.1 Surfaces shall be machined as designated by the purchaser. Unmachined surfaces shall be sufficiently free of scale to permit inspection.
- 5.2 Machining may be performed either prior to or after heat treatment at the option of the manufacturer unless specified in accordance with Supplementary Requirement S1.

6. Heat Treatment

- 6.1 After forging and before reheating for heat treatment, the forgings shall be cooled in such a manner as to prevent injury and to accomplish transformation.
- 6.2 All forgings shall be annealed, normalized, or normalized and tempered, but alternatively may be liquid quenched and tempered when mutually agreed upon between the manufacturer and the purchaser. When tempering is performed, it shall be at a subcritical temperature, but no less than 1100 °F [595 °C].
- 6.3 A multiple stage austenitizing procedure may be used whereby the forging is first fully austenitized and liquid quenched, followed by reheating within the intercritical temperature range to partially reaustenitize, and again liquid quenched. On completion of the austenitizing/quenching cycles, tempering at a temperature between 1100 °F [595 °C] and the lower critical temperature shall follow.
- Note 2—Although liquid quenching from the austenitizing temperatures is more effective in enhancing impact properties, air cooling from the austenitizing temperatures is also beneficial and may be used instead of the normalizing procedure in 6.2.

7. Chemical Composition

- 7.1 *Heat Analysis*—The heat analysis obtained from sampling in accordance with Specification A788/A788M shall comply with Table 1 except that the additional features of Supplementary Requirements S11 and S12 shall also apply as individually specified in the ordering information.
- 7.2 *Product Analysis*—The purchaser may use the product analysis provision of Specification A788/A788M to obtain a product analysis from a forging representing each heat or multiple heat.

TABLE 1 Chemical Requirements

		Composition, %	
	Grades 1 and 2	Grade 3	Grade 4
Carbon, max	0.30	0.35	0.30
Manganese	0.40-1.05	0.80-1.35	0.80-1.35
Phosphorus, max	0.025	0.025	0.025
Sulfur, max	0.025	0.025	0.025
Silicon	0.15-0.35	0.15-0.35	0.15-0.35

8. Mechanical Properties

- 8.1 General Requirements—Except when otherwise specified in accordance with Supplementary Requirement S2, the material shall conform to the requirements for mechanical properties prescribed in Table 2 when tested in accordance with the latest issue of Test Methods and Definitions A370 or Test Methods A1058 when the M suffix standard has been specified. The largest obtainable tension test specimen as specified in Test Methods and Definitions A370 or Test Methods A1058, as applicable, shall be used.
- 8.1.1 Except when otherwise specified in accordance with Supplementary Requirement S2, the longitudinal axis of the specimens shall be parallel to the direction of major working of the forging. For upset-disc forgings, the longitudinal axis of the test specimen shall be in the tangential direction.
- 8.1.1.1 The longitudinal axis of the specimen shall be located midway between the parallel surfaces of the test extension if added to the periphery of disks or midway between the center and surface of solid forgings. For hollow forgings, or those heat-treated after boring, the specimen shall be located at midwall. For the special case of forgings that are heat-treated solid, but are subsequently bored, the tension test specimen may be taken at the location of the minimum inside diameter after boring instead of the mid-radius position. When separately forged test blocks are employed as defined in 8.1.3, the tension test specimens shall be taken from a location that represents the midwall of the heaviest section of the production forgings. When specimens are required from opposite ends, they shall be taken from the diagonal corners of an axial plane.
- 8.1.2 Except as specified herein, tests for acceptance shall be made after heat treatment has been completed. When the ends of the cylindrical forgings are closed in by reforging, the cylindrical forgings may be annealed, normalized, or normalized and tempered and tested prior to reforging. After reforging, the entire forging shall be reheat-treated in the same manner and at the same temperature range as employed when the forging was heat-treated prior to certification testing.
- 8.1.3 When mutually agreed upon between manufacturer and purchaser, test specimens may be machined from a specially forged block suitably worked and heat-treated with the production forgings. Such a special block shall be obtained from an ingot, slab, or billet from the same heat used to make the forgings it represents. This block shall receive essentially the same type of hot working and forging reduction as the production forgings; however, a longitudinally forged bar with dimensions not less than T by T by T may be used to represent a ring forging. The dimension T shall be representative of the heaviest effective cross section of the forging. For quenched

TABLE 2 Tensile Requirements

	Grade 1	Grades 2 and 4	Grade 3
Tensile strength, min, ksi [MPa]	60–85 [415–585]	70–95 [485–655]	75–100 [515–690]
Yield strength (0.2 % offset), min, ksi [MPa]	30 [205]	36 [250]	37.5 [260]
Elongation in 2 in. [62.5 mm], min, %	23 [21]	20 [18]	19 [17]
Reduction of area, min, %	38	33	30

and tempered forgings for which tests are required at both ends by 8.2.2.3 and 8.2.2.4, separately forged test blocks are not allowed.

Note 3—In using separately forged test blocks, attention is drawn to the effect of mass differences between the production forgings and the test blocks.

- 8.2 Specific Requirements—The number and location of tests are based on forging length, weight, and heat treatment, and shall be as prescribed below. The length and weight to be used for this purpose shall be the shipped length and weight of forgings produced individually or the aggregate shipped length and weight of all pieces cut from a multiple forging.
- 8.2.1 Annealed, Normalized, or Normalized and Tempered Steel Forgings:
- 8.2.1.1 For forgings weighing 5000 lb [2250 kg] or less at the time of heat treatment, one tension test shall be taken from one forging per heat in each heat treatment charge. When heat treatment is performed in continuous-type furnaces with suitable temperature controls and equipped with recording pyrometers so that complete heat treatment records are available, a tempering charge may be considered as any continuous run not exceeding an 8 h period.
- 8.2.1.2 For forgings weighing over 5000 lb [2250 kg] at the time of heat treatment, one tension test shall be taken from each forging.
 - 8.2.2 Quenched and Tempered Forgings:
- 8.2.2.1 For quenched and tempered forgings weighing 5000 lb [2250 kg] or less at the time of heat treatment, but not exceeding 12 ft [3.7 m] in length, one tension test shall be taken from one forging per heat in each heat treatment charge. When heat treatment is performed in continuous-type furnaces with suitable temperature controls and equipped with recording pyrometers so that complete heat treatment records are available, a tempering charge may be considered as any continuous run not exceeding an 8 h period.

- 8.2.2.2 For quenched and tempered forgings weighing over 5000 lb [2250 kg] to 10 000 lb [4500 kg] at the time of heat treatment, but not exceeding 12 ft [3.7 m] in length, one tension test shall be taken from each forging.
- 8.2.2.3 For quenched and tempered forgings that exceed 12 ft [3.7 m] in length, one tension test shall be taken from each end of each forging.
- 8.2.2.4 For quenched and tempered forgings weighing more than 10 000 lb [4500 kg] at the time of heat treatment, two tension test specimens shall be taken from each forging. These shall be offset 180° from each other except that if the length of the forging, excluding test prolongations, exceeds 12 ft [3.7 m], then one specimen shall be taken from each end of the forging.

9. Repair Welding

9.1 Repair welding of forgings is permissible only at the option of the purchaser. If repair welding is performed, welders and weld procedures shall be qualified in accordance with Section IX of the ASME Boiler and Pressure Vessel Code.

10. Certification

10.1 In addition to the mandatory certification requirements of Specification A788/A788M, the heat treatment cycle data shall be included.

11. Product Marking

11.1 Each forging shall be identified in accordance with the Marking Section of Specification A788/A788M. In addition, the forging shall be marked following the grade designation by the letter "A" for annealed, "N" for normalized, "NT" for normalized and tempered, and "S" for liquid quenched and tempered, as applicable.

12. Keywords

12.1 pressure vessel service; steel forgings—carbon

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall apply only when specified by the purchaser in the inquiry, contract, or order. Details of these supplementary requirements shall be agreed upon between the manufacturer and the purchaser.

S1. Rough Turning and Boring

S1.1 The position of the rough turning and boring in the sequence of manufacturing operations shall be as specified by the purchaser.

S2. Alternative Tension Test Orientation

S2.1 In lieu of the requirements of Section 8, the longitudinal axis of the test specimens shall be transverse to the direction of major working of the forging. The results shall

conform with requirements of Table 2, with the exception of the ductility limits that shall be as follows:

Grade	1	2 and 4	3
Elongation in 2 in. [62.5 mm], min, %	20 [18]	19 [17]	18 [16]
Reduction of area min %	30	25	25

S3. Hydrostatic Test

S3.1 A hydrostatic pressure test shall be applied. The details of the test, including its position in the sequence of manufacturing operations, shall be specified.

S4. Magnetic Particle Examination

S4.1 All accessible surfaces of the finished forging shall be examined by a magnetic particle method. The method shall be in accordance with Practice A275/A275M. Acceptance limits shall be as agreed upon between the manufacturer and the purchaser.

S5. Liquid Penetrant Examination

S5.1 After forgings have been heat-treated by liquid quenching and tempering, all accessible surfaces shall be inspected for quench cracks by the liquid penetrant method in accordance with Test Method E165/E165M as an alternative to magnetic particle examination.

S6. Macroetch Test

S6.1 A sample forging shall be sectioned and etched to show flow lines and internal imperfections. The test shall be conducted in accordance with Method E381. Details of the test shall be agreed upon between the manufacturer and the purchaser.

S7. Product Analysis

S7.1 A product analysis in accordance with Section 7 shall be made from one randomly selected forging representing each size and shape of forging on the order. If the analysis fails to comply, each forging shall be checked or the lot rejected. All results shall be reported to the purchaser.

S8. Specimen Location on Forged Hubs

S8.1 Forged hubs to be butt-welded to shells shall be forged in such a manner as to provide in the hub the full minimum tensile strength and elongation specified for the material, in a direction parallel to the axis of the vessel. A tension specimen (subsize if necessary) shall be taken in this direction and as close to the finished hub outside diameter as practical.

S9. Hardness

S9.1 The purchaser may check the Brinell hardness of the forging at any location on the surface of the forging, and the hardness shall be within the following limits:

Grade	Brinell Hardness Range HBW
1	121 to 170
2 and 4	137 to 197
3	156 to 207

S10. Grain Size

S10.1 The austenitic grain size of the steel shall be 1 to 5 as determined using Test Methods E112.

S11. Restriction on Residual Elements (Applicable to Heat Analysis)

S11.1 Nickel, chromium, and molybdenum shall be determined and shall not exceed the following limits:

Nickel	0.25 % max
Chromium	0.20 % max
Molybdenum	0.08 % max

S12. Deleted.

S13. Impact Tests

- \$13.1 Charpy impact tests shall be made. The number and location of the tests, minimum properties, and test temperatures shall be specified.
- S13.2 The specimens shall be machined and tested in accordance with Test Methods and Definitions A370.
- S13.3 Retests may be conducted in accordance with Section 10 of Specification A788/A788M.

S14. Individual Forging

- S14.1 Forgings, whether identical or not, shall be produced individually. They shall not be forged in multiples and separated prior to or after heat treatment.
- S14.2 The shape and size of individual forgings shall be agreed upon between the manufacturer and the purchaser by means of a forging drawing or the purchase order.

S15. Carbon Equivalency

S15.1 The heat analysis including the residual element restrictions of S1 in Specification A788/A788M shall be limited such that the carbon equivalent shall not exceed 0.45 for Grade 1 or 0.50 for Grade 2 or 4 when calculated in accordance with the following formula:

$$CE = \% \text{ C} + \frac{\% \text{ Mn}}{6} + \frac{\% \text{ Cr} + \% \text{ Mo} + \% \text{ V}}{5} + \frac{\% \text{ Ni} + \% \text{ Cu}}{15}$$



SPECIFICATION FOR SEAMLESS AND WELDED FERRITIC AND MARTENSITIC STAINLESS STEEL TUBING FOR GENERAL SERVICE



SA-268/SA-268M



(23)

(Identical with ASTM Specification A268/A268M-20.)

Specification for Seamless and Welded Ferritic and Martensitic Stainless Steel Tubing for General Service

1. Scope

- 1.1 This specification covers a number of grades of nominal-wall-thickness, stainless steel tubing for general corrosion-resisting and high-temperature service. Most of these grades are commonly known as the "straight-chromium" types and are characterized by being ferromagnetic. Two of these grades, TP410 and UNS S 41500 (Table 1), are amenable to hardening by heat treatment, and the high-chromium, ferritic alloys are sensitive to notch-brittleness on slow cooling to ordinary temperatures. These features should be recognized in the use of these materials.
- 1.2 An optional supplementary requirement is provided, and when desired, shall be so stated in the order.
- 1.3 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.
- 1.4 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A480/A480M Specification for General Requirements for Flat-Rolled Stainless and Heat-Resisting Steel Plate, Sheet, and Strip
- A763 Practices for Detecting Susceptibility to Intergranular Attack in Ferritic Stainless Steels
- A1016/A1016M Specification for General Requirements for Ferritic Alloy Steel, Austenitic Alloy Steel, and Stainless Steel Tubes
- E213 Practice for Ultrasonic Testing of Metal Pipe and Tubing
- E273 Practice for Ultrasonic Testing of the Weld Zone of Welded Pipe and Tubing

3. Terminology

- 3.1 Lot Definitions:
- 3.1.1 For flange and flaring requirements, the term lot applies to all tubes, prior to cutting, of the same nominal size and wall thickness that are produced from the same heat of steel. If final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and from the same heat that are heat treated in the same furnace charge. If the final heat treatment is in a continuous furnace, the number of tubes of the same size and from the same heat in a lot shall be determined from the size of the tubes as given in Table 2.
- 3.1.2 For tensile and hardness test requirements, the term lot applies to all tubes, prior to cutting, of the same nominal diameter and wall thickness that are produced from the same heat of steel. If final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and the same heat that are heat treated in the same furnace charge. If the final heat treatment is in a continuous furnace, a lot shall

ASME BPVC.II.A-2023

TABLE 1 Chemical Requirements

Grade	TP405	TP410	TP429	TP430	TP443	TP446-1	TP446-2 ^A		TP409
UNS Designation	S40500	S41000	S42900	S43000	S44300	S44600	S44600	S40800	S40900
Element			•		Composition, %				
C, max	0.08	0.15	0.12	0.12	0.20	0.20	0.12	0.08	0.08
Mn, max	1.00	1.00	1.00	1.00	1.00	1.50	1.50	1.00	1.00
P, max	0.040	0.040	0.040	0.040	0.040	0.040	0.040	0.045	0.045
S, max	0.030	0.030	0.030	0.030	0.030	0.030	0.030	0.045	0.030
Si, max	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
Ni	0.50 max				0.75 max	0.75 max	0.50 max	0.80 max	0.50 max
Cr	11.5–14.5	11.5–13.5	14.0-16.0	16.0-18.0	18.0-23.0	23.0-27.0	23.0-27.0	11.5-13.0	10.5–11.7
Мо									
Al	0.10-0.30								
Cu					0.90-1.25				
N						0.25	0.25		
Ti								12 × C min;	6 × C min;
								1.10 max	0.75 max

TABLE 1	Continued

Grade	TP439			TP430 Ti	TP XM-27	TP XM-33 ^A	18Cr- 2Mo	29-4	29-4-2	26-3-3	25-4-4						TP468
UNS																	
Designa- tion	S43035	S43932	S41500 ^B	S43036	S44627	S44626	S44400	S44700	S44800	S44660	S44635	S44735	S32803	S40977	S43940	S42035	S46800
Element									omposition,								
C, max	0.07	0.030	0.05	0.10	0.01 ^A	0.06	0.025	0.010	0.010	0.030	0.025	0.030	0.015 ^C	0.03	0.03	0.08	0.030
Mn, max	1.00	1.00	0.5-1.0	1.00	0.40	0.75	1.00	0.30	0.30	1.00	1.00	1.00	0.5	1.50	1.00	1.00	1.00
P, max	0.040	0.040	0.03	0.040	0.02	0.040	0.040	0.025	0.025	0.040	0.040	0.040	0.020	0.040	0.040	0.045	0.040
S, max	0.030	0.030	0.03	0.030	0.02	0.020	0.030	0.020	0.020	0.030	0.030	0.030	0.005	0.015	0.015	0.030	0.030
Si, max Ni	1.00 0.50 max	1.00 0.50	0.60 3.5–5.5	1.00 0.75 max	0.40 0.5 ^D max	0.75 0.50 max	1.00 1.00 max	0.20 0.15 max	0.20 2.0–2.5	1.00 1.0–3.50	0.75 3.5–4.5	1.00 1.00 max	0.50 3.0–4.0	1.00 0.30–1.00	1.00	1.00 1.0–2.5	1.00 0.50
Cr	17.00-	17.0–19.0		16.00-	25.0–27.5	25.0–27.0	17.5–19.5	28.0–30.0		25.0–28.0		28.00–	28.0-	10.50-	17.50–	13.5-	18.00-
O.	17.00	17.0 10.0	11.0 11.0	10.00	20.0 27.0	20.0 27.0	17.0 10.0	20.0 00.0	20.0 00.0	20.0 20.0	1.0 20.0	20.00	29.0	12.50	18.50	15.5	20.00
	19.00			19.50								30.00					
Mo			0.5–1.0		0.75–1.50	0.75–1.50	1.75–2.50	3.5-4.2	3.5-4.2	3.0-4.0	3.5–4.5	3.60-4.20	1.8–2.5			0.2-1.2	
Al, max	0.15	0.15															
Cu, max N, max	0.04	0.030 (Ti			0.2 0.015	0.20 0.040	0.035	0.15 0.020 ^E	0.15 0.020 ^E	0.040	0.035	 0.045	0.020	0.030			0.030
IN, IIIAX	0.04	+ Cb)			0.015	0.040	0.035	0.020	0.020	0.040	0.035	0.045	0.020	0.030			0.030
		{0.20 + 4															
		(C + N)}															
		min.;															
T :	0.00 . 4	0.75 max				7 (0	(T: Ob)			(T: Ob)	(T: Ob)	(T: Ob)			0.40.000	0 00 0 50	0.07.000
Ti	0.20 + 4 (C			5 × C min;		7 × (C + N)	(Ti + Cb)			(Ti + Cb)	(Ti + Cb)	(Ti + Cb) =			0.10-0.60	0.30-0.50	0.07-0.30
	+ N)			0.75		but no less	0.20 + 4			0.20-1.00		0.20–1.00					
	min;			max		Dut 110 1000	0.20			0.2000	0.20	0.2000					
	1.10					than	(C + N)			and 6 ×	(C + N)	and 6 ×					
	max					0.20 min;	min;			(C + N)	min to	(C+ N)					
						1.00	0.80			(0 1 11)		(0 : 1.)					
						max	max			min	0.80	min					
											max						
Cb					0.05-0.20								0.15-		(3 × %C		0.10-0.60
													0.50 ^F		+ 0.30)		
															min		
																	(Ti + Cb)
																	0.20
																	+4(C+N)
																	min;0.80
																	max

^A For small diameter or thin walls, or both, tubing, where many drawing passes are required, a carbon maximum of 0.015 % is necessary. Small outside diameter tubes are defined as those less than 0.500 in. [12.7 mm] in outside diameter and light wall tubes as those less than 0.049 in. [1.2 mm] in average wall thickness (0.040 in. [1 mm] in minimum wall thickness). ^B Plate version of CA6NM.

^C Carbon plus nitrogen = 0.30 max.

^D Nickel plus copper.

^E Carbon plus nitrogen = 0.025 % max.

 $^{^{}F}$ Cb/(C + N) = 12 min.

TABLE 2 Number of Tubes in a Lot Heat Treated by the Continuous Process

	Size of Lot
Size of Tube	
2 in. [50.8 mm] and over in outside diameter and 0.200 in. [5.1 mm] and over in wall thickness	not more than 50 tubes
Less than 2 in. [50.8 mm] but over 1 in. [25.4 mm] in outside diameter or over 1 in. [25.4 mm] in outside diameter and under 0.200 in. [5.1 mm] in wall thickness	not more than 75 tubes
1 in. [25.4 mm] or less in outside diameter	not more than 125 tubes

include all tubes of the same size and heat, heat treated in the same furnace at the same temperature, time at heat, and furnace speed.

4. Ordering Information

- 4.1 It is the responsibility of the purchaser to specify all requirements that are necessary for material ordered under this specification. Such requirements may include, but are not limited to, the following:
 - 4.1.1 Quantity (feet, metres, or number of lengths),
 - 4.1.2 Name of material (seamless or welded tubes),
 - 4.1.3 Grade (Table 1),
 - 4.1.4 Size (outside diameter and nominal wall thickness),
 - 4.1.5 Length (specific or random),
- 4.1.6 Optional requirements (hydrostatic or nondestructive electric test, Section 16).
- 4.1.7 Test report required (Certification Section of Specification A1016/A1016M),
 - 4.1.8 Specification designation,
 - 4.1.9 Intergranular corrosion test, and
 - 4.1.10 Special requirements.

5. General Requirements

5.1 Material furnished under this specification shall conform to the applicable requirements of Specification A1016/A1016M unless otherwise provided herein.

6. Manufacture

6.1 The tubes shall be made by the seamless or welded process with no filler metal added.

7. Heat Treatment

- 7.1 As a final heat treatment, tubes shall be reheated to a temperature of 1200 °F [650 °C] or higher and cooled (as appropriate for the grade) to meet the requirements of this specification.
- 7.2 The martensitic grade UNS S 41500 shall be reheated to a temperature of 950 °F [510 °C] or higher and cooled as appropriate to meet the requirements of this specification.

8. Chemical Composition

8.1 The steel shall conform to the chemical requirements prescribed in Table 1.

9. Product Analysis

- 9.1 An analysis of either one billet or one length of flatrolled stock or one tube shall be made from each heat. The chemical composition thus determined shall conform to the requirements specified.
- 9.2 The product analysis tolerance of the Chemical Requirements Table of A480/A480M shall apply. The product analysis tolerance is not applicable to the carbon content for material with a specified maximum carbon of 0.04 % or less.
- 9.3 If the original test for product analysis fails, retests of two additional billets, lengths of flat-rolled stock or tubes shall be made. Both retests for the elements in question shall meet the requirements of the specification; otherwise all remaining material in the heat or lot shall be rejected or, at the option of the producer, each billet or tube may be individually tested for acceptance. Billets, lengths of flat-rolled stock or tubes which do not meet the requirements of the specification shall be rejected.

10. Tensile Requirements

10.1 The material shall conform to the tensile properties prescribed in Tables 3 and 4.

11. Hardness Requirements

11.1 The tubes shall have a hardness number not to exceed those prescribed in Table 5.

12. Permissible Variations in Dimensions

- 12.1 Variations in outside diameter, wall thickness, and length from those specified shall not exceed the amounts prescribed in Table 6.
- 12.2 The permissible variations in outside diameter given in Table 6 are not sufficient to provide for ovality in thin-walled tubes, as defined in the Table. In such tubes, the maximum and minimum diameters at any cross section shall deviate from the nominal diameter by no more than twice the permissible variation in outside diameter given in Table 6; however, the mean diameter at that cross section must still be within the given permissible variation.
- 12.3 When the specified wall is 2 % or less of the specified outside diameter, the method of measurement is in accordance with the agreement between the purchaser and the manufacturer (see Note 1).

Note 1—Very thin wall tubing may not be stiff enough for the outside diameter to be accurately measured with a point contact test method, such as with the use of a micrometer or caliper. When very thin walls are specified, "go"—'no go" ring gages are commonly used to measure diameters of $1 \frac{1}{2}$ in. [38.1 mm] or less. A 0.002-in. [0.05-mm] additional tolerance is usually added on the "go" ring gage to allow clearance for sliding. On larger diameters, measurement is commonly performed with a pi tape. Other test methods such as optical test methods may also be considered.

13. Surface Condition

13.1 All tubes shall be free of excessive mill scale, suitable for inspection. A slight amount of oxidation will not be

TABLE 3 Tensile Requirements

Grade and UNS Designation	Tensile strength, min, ksi [MPa]	Yield strength, min, ksi [MPa]	Elongation ^{A,E} in 2 in. or 50 mm, min, %
TP405	60 [415]	30 [205]	20
S40500	60 [415]	30 [205]	20
S40800	55 [380]	30 [205]	20
TP410 S41000	60 [415]	30 [205]	20
TP429, TP430, and TP430 Ti S429000, S 43000, and S 43036	60 [415]	35 [240]	20
TP443 S44300	70 [485]	40 [275]	20
TP446-1 S44600	70 [485]	40 [275]	18
TP446-2 S44600	65 [450]	40 [275]	20
TP409 \$40900 TP439	55 [380]	25 [170]	20
S43035	60 [415]	30 [205]	20
S43932	60 [415]	30 [205]	20
S41500	115 [795]	90 [620]	15
TPXM-27 S44627	65 [450]	40 [275]	20
TPXM-33 S44626	68 [470]	45 [310]	20
18Cr-2Mo \$44400	60 [415]	40 [275]	20
29-4 and 29-4-2 S44700 and S44800	80 [550]	60 [415]	20
26-3-3 \$44660	85 [585]	65 [450]	20
25-4-4 \$44635	90 [620]	75 [515]	20
S44735 28-2-3.5	75 [515]	60 [415]	18
\$32803 \$40977	87 [600] 65 [450]	72 [500] 41 [280]	16 18
S43940	62 [430]	36 [250]	
S42035	80 [550]	55 [380]	16
TP468 \$46800	60 [415]	30 [205]	22

 $^{^{}A}$ For tubing smaller than $\frac{1}{2}$ in. [12.7 mm] in outside diameter, the elongation values given for strip specimens in Table 2 shall apply. Mechanical property requirements do not apply to tubing smaller than $\frac{1}{6}$ in. [3.2 mm] in outside diameter or with walls thinner than 0.015 in. [0.4 mm].

considered as scale. Any special finish requirements shall be subject to agreement between the manufacturer and the purchaser.

14. Mechanical Tests Required

14.1 *Tension Tests*—One tension test shall be made on a specimen for lots of not more than 50 tubes. Tension tests shall be made on specimens from two tubes for lots of more than 50 tubes.

14.2 Flaring Test (for Seamless Tubes)—One test shall be made on specimens from one end of one tube from each lot of finished tubes. The minimum expansion of the inside diameter shall be 10 %. For tubes over 8 in. [203.2 mm] in outside diameter, or tubes with wall thickness 3/8 in. [9.52 mm] and

TABLE 4 Minimum Elongation Values

Wall Thick	ness	Elor or	Elongation ^A in 2 in. or 50 mm, min, %			
		TP446-1				
		and		All Other		
in.	mm	S44735	S41500	Grades		
5/16 [0.312]	8	18	15	20		
%2 [0.281]	7.2	17	14	19		
1/4 [0.250]	6.4	16	14	18		
7/32 [0.219]	5.6	15	13	17		
3/16 [0.188]	4.8	14	12	16		
5/32 [0.156]	4	13	11	15		
1/8 [0.125]	3.2	13	11	14		
3/32 [0.094]	2.4	12	10	13		
1/16 [0.062]	1.6	11	9	12		
0.062-0.035, excl	1.6-0.9	10	8	12		
0.035-0.022, excl	0.9-0.6	10	8	11		
0.022-0.015, incl	0.6-0.4	10	8	11		

^ACalculated elongation requirements shall be rounded to the nearest whole number

Note—The above table gives the computed minimum values for each $\frac{1}{2}$ in. [0.8 mm] decrease in wall thickness. Where the wall thickness lies between two values shown above, the minimum elongation value shall be determined by the following equation:

Grade	Equation
TP446-1 and S44735	E = 28.8t + 9.00 [E = 1.13t + 9.00]
S41500	E = 24t + 7.5
All other grades	E = 32t + 10.00 [E = 1.25t + 10.00]

where:

E =elongation in 2 in. or 50 mm, %.

t =actual thickness of specimen, in. [mm].

TABLE 5 Hardness Requirements.

		Brinell Hardness,	Rockwell Hardness,
Grade	UNS Designation	max	B Scale, max
TP405	S40500	207	95
	S40800	207	95
TP410	S41000	207	95
TP429, TP430, and TP430 TI	S42900, S 43000, and S 43036	190	90
TP443	S44300	207	95
TP446-1 and TP446-2	S44600	207	95
TP409	S40900	207	95
TP439	S43035 ^A	190	90
	S43932	190	90
	S41500	295 ^B	32
TPXM-33 and TPXM-27	S44626 and S44627	241	100
18CR-2Mo	S44400	217	95
29-4 and 29-4-2	S44700 and S44800	207	100
26-3-3	S44660	265	25 ^B
25-4-4	S44635	270	27 ^B
	S44735		100
28-2-3.5	S32803	240	100
	S40977	180	88
	S43940	180	88
	S42035	180	88

^A Editorially corrected October 2000.

over, the flattening test may be performed instead of the flaring test unless the flaring test is specified in the purchase order.

14.3 Flange Test (for Welded Tubes)—One test shall be made on specimens from one end of one tube from each lot of

 $^{^{\}it B}$ For longitudinal strip tests a deduction of 0.90 % for TP446–1 and S44735 and 1.00 % for all other grades shall be made from the basic minimum elongation for each 1/32 in. [0.8 mm] decrease in wall thickness below 5/16 in. [8 mm]. The following table gives the computed minimum values:

^B Rockwell hardness, C scale.

TABLE 6 Permissible Variations in Dimensions

	Permissible Vari- Size, Outside ations in Outside Diameter, in. Diameter,		Permissible Variations in Wall	Permissible Variations in Cut Length, in. ^B [mm]		
Group	[mm]	in. [mm]	Thickness, ^A %	Over	Under	Thin-Walled Tubes ^C
1	Up to ½ [12.7], excl	±0.005 [0.13]	±15	1/8 [3]	0	
2	½ to 1½ [12.7 to 38.1], excl	±0.005 [0.13]	±10	1/8 [3]	0	less than 0.065 in. [1.6 mm] nominal
3	1½ to 3½ [38.1 to 88.9], excl	±0.010 [0.25]	±10	3/16 [5]	0	less than 0.095 in. [2.4 mm]
						nominal
4	3½ to 5½ [88.9 to 139.7], excl	±0.015 [0.38]	±10	3/16 [5]	0	less than 0.150 in. [3.8 mm]
						nominal
5	5½ to 8 [139.7 to 203.2], incl	±0.030 [0.76]	±10	3/16 [5]	0	less than 0.150 in. [3.8 mm]
						nominal

AWhen tubes as ordered require wall thicknesses ¾ in. [19 mm] or over, or an inside diameter 60 % or less of the outside diameter, a wider variation in wall thickness is required. On such sizes a variation in wall thickness of 12.5 % over or under will be permitted.

finished tubes. For tubes over 8 in. [203.2 mm] in outside diameter, or tubes with wall thickness 3/8 in. [9.52 mm] and over, the flattening test may be performed instead of the flange test unless the flange test is specified in the purchase order.

- 14.4 Hardness Test—Brinell or Rockwell hardness tests shall be made on specimens from two tubes from each lot.
- 14.5 When more than one heat is involved, the tension, flaring, flanging, and hardness test requirements shall apply to each heat.
- 14.6 Reverse Flattening Test-For welded tubes, one reverse flattening test shall be made on a specimen from each 1500 ft [450 m] of finished tubing.

15. Intergranular Corrosion Test

15.1 If intergranular corrosion testing is specified in the purchase order, the test shall be made in accordance with Practices A763, using samples prepared as agreed upon between the seller and the purchaser.

16. Hydrostatic or Nondestructive Electric Test

16.1 Each tube, seamless or welded, shall be subjected to the nondestructive electric test or the hydrostatic test. The type of test to be used shall be at the option of the manufacturer, unless otherwise specified in the purchase order.

17. Product Marking

17.1 In addition to the marking described in Specification A1016/A1016M, the marking shall indicate whether the tubing is seamless or welded.

18. Keywords

18.1 ferritic stainless steel; seamless steel tube; stainless steel tube; steel tube; welded steel tube

For tubes less than ½ in. [12.7 mm] in inside diameter which cannot be successfully drawn over a mandrel, the wall thickness may vary ±15 % from that specified. ^B These tolerances apply to cut lengths up to and including 24 ft [7.3 m]. For lengths greater than 24 ft [7.3 m], the above over tolerances shall be increased by 1/8 in. [3 mm] for each 10 ft [3 m] or fraction thereof over 24 ft, or $\frac{1}{2}$ in. [13 mm], whichever is lesser. C Ovality provisions of 12.2 apply.

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall apply only when specified by the purchaser in the inquiry, contract, or order.

S1. Pneumatic Test

- S1.1 The tubing shall be examined by a pneumatic test (either air under water or pneumatic leak test) in accordance with Specification A1016/A1016M.
- S2. Additional Testing of Welded Tubing for 100 % Joint Efficiency in Certain ASME Applications (see Note S2.1)

NOTE S2.1—When specified, the special testing in this supplement is intended for special ASME applications. It is not mandatory for all ASME applications.

S2.1 Where this supplement is specified in the purchase order, in certain ASME applications it is permissible to use 100 % joint efficiency for the longitudinal weld, provided the following additional requirements are met:

- S2.1.1 Each tube shall be subjected to an ultrasonic inspection employing Practices E273 or E213 with the rejection criteria referenced in Specification A1016/A1016M.
- S2.1.2 If Practice E273 is employed, a 100 % volumetric inspection of the entire length of each tube shall also be performed using one of the non-destructive electric tests permitted by Specification A1016/A1016M.
- S2.1.3 The test methods described in the supplement may not be capable of inspecting the end portions of tubes. This condition is referred to as end effect. This portion, as determined by the manufacturer, shall be removed and discarded.
- S2.1.4 In addition to the marking prescribed in Specification A1016/A1016M," S2" shall be added after the grade designation.

406

ASME BPVC.II.A-2023 SA-276

SPECIFICATION FOR STAINLESS STEEL BARS AND SHAPES



SA-276/SA-276M



(23)

(Identical with ASTM Specification A276/A276M-17.)

Specification for Stainless Steel Bars and Shapes

1. Scope

1.1 This specification covers hot-finished or cold-finished bars except bars for reforging (Note 1). It includes rounds, squares, and hexagons, and hot-rolled or extruded shapes, such as angles, tees, and channels in the more commonly used types of stainless steels. The free-machining types (Note 2) for general corrosion resistance and high-temperature service are covered in a separate specification.

Note 1—For bars for reforging, see Specification A314.

Note 2—For free-machining stainless bars designed especially for optimum machinability, see Specification A582/A582M.

Note 3—There are standards covering high nickel, chromium, austenitic corrosion, and heat-resisting alloy materials. These standards are under the jurisdiction of ASTM Subcommittee B02.07 and may be found in *Annual Book of ASTM Standards*, Vol. 02.04.

1.2 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.

2. Referenced Documents

- 2.1 ASTM Standards:
- A314 Specification for Stainless Steel Billets and Bars for Forging
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A484/A484M Specification for General Requirements for Stainless Steel Bars, Billets, and Forgings
- A582/A582M Specification for Free-Machining Stainless Steel Bars

- A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- A1058 Test Methods for Mechanical Testing of Steel Products—Metric
- E527 Practice for Numbering Metals and Alloys in the Unified Numbering System (UNS)
- 2.2 SAE Document:
- SAE J 1086 Recommended Practice for Numbering Metals and Alloys

3. Ordering Information

- 3.1 It is the responsibility of the purchaser to specify all requirements that are necessary for material ordered under this specification. Such requirements may include but are not limited to the following:
 - 3.1.1 Quantity (weight or number of pieces),
 - 3.1.2 Name of material: stainless steel,
 - 3.1.3 Form (bars, angles, and so forth),
 - 3.1.4 Condition (Section 4.1),
 - 3.1.5 Finish (Section 8 of Specification A484/A484M),
- 3.1.6 Surface preparation of shapes (Section 8 of Specification A484/A484M),
- 3.1.7 Applicable dimensions including size, thickness, width, and length, l,
 - 3.1.8 Cross section (round, square, and so forth),
 - 3.1.9 Type or UNS designation (Table 1),
 - 3.1.10 ASTM designation and date of issue, and
- 3.1.11 Whether bars are to be rolled as bars or cut from strip or plate.
- 3.1.12 Test for magnetic permeability when specified by customer purchase order when ordering Types 201 and 205.
- 3.1.13 Choice of testing track from the options listed in Test Methods A1058 when material is ordered to an M suffix (SI units) product standard. If the choice of test track is not specified in the order, then the default ASTM track shall be used as noted in Test Methods A1058.
 - 3.1.14 Supplementary requirements, and
 - 3.1.15 Additional requirements.

TABLE 1 Chemical Requirements^A

					TABLE 1	Chemical F	Requirements	A			
UNS Designa-	Type	Composition, %									
tion ^B	Турс	Carbon	Manganese	Phos- phorus	Sulfur	Silicon	Chromium	Nickel	Molyb- denum	Nitrogen	Other Elements ^L
						Austenitic G	rades				
N08020	Alloy 20	0.07	2.00	0.045	0.035	1.00	19.0–21.0	32.0–38.0	2.00-3.00		Cu 3.0-4.0
											Nb 8 × C min.;
											1.00 max
N08367		0.030	2.00	0.040	0.030	1.00	20.0–22.0	23.5–25.5	6.0-7.0	0.18–0.25	Cu 0.75
N08700		0.04	2.00	0.040	0.030	1.00	19.0–23.0	24.0–26.0	4.3–5.0		Cu 0.50
											Cb 8 × C min 0.40 max
N08800	800	0.10	1.50	0.045	0.015	1.00	19.0–23.0	30.0–35.0			Fe ^J 39.5 min.
											Cu 0.75
											Al 0.15-0.60 Ti 0.15-0.60
N08810	800H	0.05-0.10	1.50	0.045	0.015	1.00	19.0–23.0	30.0–35.0	l		Fe ^J 39.5 min.
											Cu 0.75
											Al 0.15–0.60 Ti 0.15–0.60
N08811		0.06-0.10	1.50	0.045	0.015	1.00	19.0–23.0	30.0–35.0			Fe ^J 39.5 min.
											Cu 0.75
											Al ^K 0.25–0.60 Ti ^K 0.25–0.60
N08904	904L	0.020	2.00	0.045	0.035	1.00	19.0–23.0	23.0–28.0	4.0-5.0	0.10	Cu 1.0–2.0
N08925		0.020	1.00	0.045	0.030	0.50	19.0-21.0	24.0-26.0	6.0-7.0	0.10-0.20	Cu 0.80-1.50
N08926		0.020	2.00	0.030	0.015	0.50	19.0–21.0	24.0-26.0	6.0-7.0	0.15-0.25	Cu 0.50-1.50
S20100	201	0.15	5.5–7.5	0.060	0.030	1.00	16.0–18.0	3.5–5.5		0.25	
S20161		0.15	4.0–6.0	0.045	0.030	3.0-4.0	15.0–18.0	4.0–6.0	1 :::	0.08-0.20	
S20162 S20200		0.15	4.0-8.0	0.040	0.040 0.030	2.5–4.5 1.00	16.5–21.0	6.0–10.0 4.0–6.0	0.50-2.50	0.05–0.25 0.25	
S20200 S20500	202 205	0.15 0.12–0.25	7.5–10.0 14.0–15.5	0.060 0.060	0.030	1.00	17.0–19.0 16.5–18.0	1.0-6.0		0.25	
S20300	XM-19	0.12-0.23	4.0-6.0	0.000	0.030	1.00	20.5–23.5	11.5–13.5	1.50-3.00	0.32-0.40	Cb 0.10-0.30,
											V 0.10-0.30
S21800		0.10	7.0–9.0	0.060	0.030	3.5–4.5	16.0–18.0	8.0–9.0		0.08–0.18	
S21900	XM-10	0.08	8.0–10.0	0.045	0.030	1.00	19.0–21.5	5.5–7.5		0.15-0.40	
S21904	XM-11	0.04	8.0–10.0	0.045	0.030	1.00	19.0–21.5	5.5–7.5		0.15–0.40	
S24000	XM-29	0.08	11.5–14.5	0.060	0.030	1.00	17.0–19.0	2.3–3.7		0.20-0.40	
S24100	XM-28	0.15	11.0–14.0	0.045	0.030	1.00	16.5–19.0	0.50-2.50		0.20-0.45	
S28200		0.15	17.0–19.0	0.045	0.030	1.00	17.0–19.0		0.75–1.25	0.40-0.60	Cu 0.75–1.25
S30200	302	0.15	2.00	0.045	0.030	1.00	17.0–19.0	8.0–10.0		0.10	
S30215	302B	0.15	2.00	0.045	0.030	2.00–3.00	17.0–19.0	8.0–10.0		0.10	
S30400	304	0.08	2.00	0.045	0.030	1.00	18.0-20.0	8.0-11.0			
S30403	304L ^C	0.030	2.00	0.045	0.030	1.00	18.0–20.0	8.0–12.0			
S30451	304N	0.08	2.00	0.045	0.030	1.00	18.0–20.0	8.0–11.0		0.10-0.16	
S30452	XM-21	0.08	2.00	0.045	0.030	1.00	18.0–20.0	8.0–10.0		0.16-0.30	
S30453 S30454	304LN	0.030 0.03	2.00 2.00	0.045 0.045	0.030 0.030	1.00 1.00	18.0–20.0 18.0–20.0	8.0–11.0		0.10-0.16 0.16-0.30	
S30500	305	0.03	2.00	0.045	0.030	1.00	17.0–19.0	8.0–11.0 11.0–13.0		0.10-0.30	
S30800	308	0.08	2.00	0.045	0.030	1.00	19.0–21.0	10.0–12.0			l
S30815		0.05-0.10	0.80	0.040	0.030	1.40-2.00	20.0–22.0	10.0–12.0		0.14-0.20	Ce 0.03-0.08
S30900	309	0.20	2.00	0.045	0.030	1.00	22.0-24.0	12.0-15.0			
S30908	309S	0.08	2.00	0.045	0.030	1.00	22.0-24.0	12.0-15.0			
S30940	309Cb	0.08	2.00	0.045	0.030	1.00	22.0–24.0	12.0–16.0			Cb 10×C-1.10
S31000	310	0.25	2.00	0.045	0.030	1.50	24.0–26.0	19.0–22.0			
S31008 S31010 ^D	310S	0.08	2.00	0.045 0.030	0.030 0.0010	1.50	24.0–26.0 28.5–30.5	19.0–22.0 14.0–16.0	15_25	0.80-0.90	 ALO 05
331010		0.030	5.50–6.50	0.030	0.0010	0.25–0.75	20.0-30.5	14.0-10.0	1.5–2.5	0.00-0.90	AI 0.05 B 0.005
S31040	310Cb	0.08	2.00	0.045	0.030	1.50	24.0-26.0	19.0–22.0	l		Cb 10×C-1.10
S31254		0.020	1.00	0.030	0.010	0.80	19.5–20.5	17.5–18.5	6.0-6.5	0.18-0.25	Cu 0.50-1.00
004000		0.000	0.00.4.00	0.00-	0.000	1.00	00.0.07.0	010010	[[[]]	0.05.000	01.00.0.50
S31266		0.030	2.00-4.00	0.035	0.020	1.00	23.0–25.0	21.0–24.0	5.2–6.2	0.35–0.60	Cu 1.00–2.50 W 1.50–2.50
S31400	314	0.25	2.00	0.045	0.030	1.50-3.00	23.0–26.0	19.0–22.0			
S31600	316	0.08	2.00	0.045	0.030	1.00	16.0–18.0	10.0–14.0	2.00-3.00		
S31603	316L ^C	0.030	2.00	0.045	0.030	1.00	16.0–18.0	10.0–14.0	2.00–3.00		
S31635	316Ti	0.08	2.00	0.045	0.030	1.00	16.0–18.0	10.0–14.0	2.00-3.00	0.10	Ti 5×(C+N)-0.70
S31640	316Cb	0.08	2.00	0.045	0.030	1.00	16.0–18.0	10.0–14.0	2.00-3.00	0.10	Cb 10×C-1.10

TABLE 1 Continued

					IA	BLE 1 Co	ontinued					
		Composition 9/										
UNS		Composition, %										
Designa-	Type											
tion ^B	"	l <u>.</u> .				l					,	
		Carbon	Manganese	Phos-	Sulfur	Silicon	Chromium	Nickel	Molyb-	Nitrogen	Other Elements ^L	
				phorus					denum			
S31651	316N	0.08	2.00	0.045	0.030	1.00	16.0–18.0	10.0–14.0	2.00-3.00	0.10–0.16		
S31653	316LN	0.030	2.00	0.045	0.030	1.00	16.0–18.0	10.0–13.0	2.00-3.00	0.10-0.16		
S31654		0.03	2.00	0.045	0.030	1.00	16.0–18.0	10.0–13.0	2.00-3.00	0.16–0.30		
S31700	317	0.08	2.00	0.045	0.030	1.00	18.0–20.0	11.0–15.0	3.0-4.0	0.10		
S31700 S31725	-	0.08	2.00	0.045	0.030	1.00	18.0–20.0	13.5–17.5	4.0-5.0	0.10		
S31726		0.030	2.00	0.045	0.030	1.00	17.0–20.0	14.5–17.5	4.0-5.0	0.10-0.20		
S31727		0.030	1.00	0.030	0.030	1.00	17.5–19.0	14.5–16.5	3.8–4.5	0.15-0.21	Cu 2.8–4.0	
S31730		0.030	2.00	0.040	0.010	1.00	17.0–19.0	15.0–16.5	3.0-4.0	0.045	Cu 4.0-5.0	
S32053		0.030	1.00	0.030	0.010	1.00	22.0-24.0	24.0-26.0	5.0-6.0	0.17-0.22		
S32100	321	0.08	2.00	0.045	0.030	1.00	17.0-19.0	9.0-12.0			Ti 5×(C+N)-0.70 ^E	
S32654		0.020	2.0-4.0	0.030	0.005	0.50	24.0-25.0	21.0-23.0	7.0-8.0	0.45-0.55	Cu 0.30-0.60	
S34565		0.030	5.0-7.0	0.030	0.010	1.00	23.0-25.0	16.0–18.0	4.0-5.0	0.40-0.60	Cb 0.10	
S34700	347	0.08	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0			Cb 10×C-1.10	
S34800	348	0.08	2.00	0.045	0.030	1.00	17.0–19.0	9.0–12.0			Cb 10×C-1.10,	
											Ta 0.10	
					Λ	<u>l</u> stenitic-Ferriti	o Crados				Co 0.20	
S31100	XM-26	0.06	1.00	0.045	0.030	1.00	25.0–27.0	6.0-7.0		l	Ti 0.25	
S31803		0.030	2.00	0.043	0.030	1.00	21.0–23.0	4.5–6.5	2.5–3.5	0.08-0.20		
S32101		0.040	4.0–6.0	0.040	0.030	1.00	21.0–22.0	1.35–1.70	0.10-0.80	0.20-0.25	Cu 0.10-0.80	
S32202		0.030	2.00	0.040	0.010	1.00	21.5–24.0	1.00-2.80	0.45	0.18-0.26		
S32205		0.030	2.00	0.030	0.020	1.00	22.0-23.0	4.5-6.5	3.0-3.5	0.14-0.20		
S32304		0.030	2.50	0.040	0.030	1.00	21.5–24.5	3.0-5.5	0.05-0.60	0.05-0.20	Cu 0.05-0.60	
S32506		0.030	1.00	0.040	0.015	0.90	24.0-26.0	5.5–7.2	3.0–3.5	0.08-0.20	W 0.05-0.30	
S32550		0.04	1.50	0.040	0.030	1.0	24.0–27.0	4.5–6.5	2.9–3.9	0.10-0.25	Cu 1.50–2.50	
000750M				0.005							0 0 50	
S32750 ^M S32760 ^F		0.030 0.030	1.20 1.00	0.035 0.030	0.020 0.010	0.80 1.00	24.0–26.0 24.0–26.0	6.0–8.0 6.0–8.0	3.0–5.0 3.0–4.0	0.24-0.32 0.20-0.30	Cu 0.50 Cu 0.50–1.00	
332760		0.030	1.00	0.030	0.010	1.00	24.0-20.0	0.0-6.0	3.0-4.0	0.20-0.30	W 0.50-1.00	
S82441	l	0.030	2.5-4.0	0.035	0.005	0.070	23.0–25.0	3.0-4.5	1.00-2.00	0.20-0.30	Cu 0.10–0.80	
						Ferritic Gra						
S40500	405	0.08	1.00	0.040	0.030	1.00	11.5–14.5	0.50			Al 0.10-0.30	
S40976		0.030	1.00	0.040	0.030	1.00	10.5–11.7	0.75–1.00		0.040	Cb 10×(C+N)-	
											0.80	
S42900	429	0.12	1.00	0.040	0.030	1.00	14.0–16.0					
S43000 S44400	430 444	0.12 0.025	1.00 1.00	0.040 0.040	0.030 0.030	1.00 1.00	16.0–18.0 17.5–19.5	1.00	1.75–2.50	0.035	 Ti+Cb 0.20+4 ×	
344400	444	0.025	1.00	0.040	0.030	1.00	17.5-19.5	1.00	1.75-2.50	0.035	(C+N)-	
											0.80	
S44600	446	0.20	1.50	0.040	0.030	1.00	23.0–27.0	0.75	l	0.25		
S44627	XM-27 ^G	0.010 ^H	0.40	0.020	0.020	0.40	25.0-27.5	0.50	0.75-1.50	0.015 ^H	Cu 0.20	
											Cb 0.05-0.20	
S44700		0.010	0.30	0.025	0.020	0.20	28.0–30.0	0.15	3.5–4.2	0.020	C+N 0.025	
			l			l					Cu 0.15	
S44800		0.010	0.30	0.025	0.020	0.20	28.0–30.0	2.00–2.50	3.5–4.2	0.020	C+N 0.025	
						<u>l</u> Martensitic G	radas		l		Cu 0.15	
S40300	403	0.15	1.00	0.040	0.030	0.50	11.5–13.0					
S41000	410	0.08-0.15	1.00	0.040	0.030	1.00	11.5–13.5					
S41040	XM-30	0.18	1.00	0.040	0.030	1.00	11.0–13.0				Cb 0.05-0.30	
S41400	414	0.15	1.00	0.040	0.030	1.00	11.5–13.5	1.25-2.50				
S41425		0.05	0.50-1.00	0.020	0.005	0.50	12.0-15.0	4.0-7.0	1.50-2.00	0.06-0.12	Cu 0.30	
S41500	1	0.05	0.50-1.00	0.030	0.030	0.60	11.5–14.0	3.5–5.5	0.50-1.00			
S42000	420	0.15 min	1.00	0.040	0.030	1.00	12.0–14.0					
S42010		0.15-0.30	1.00	0.040	0.030	1.00	13.5–15.0	0.35-0.85	0.40-0.85			
S43100	431	0.20	1.00	0.040	0.030	1.00	15.0–17.0	1.25–2.50				
S44002	440A	0.60-0.75	1.00	0.040	0.030	1.00	16.0–18.0		0.75			
S44003 S44004	440B 440C	0.75–0.95 0.95–1.20	1.00 1.00	0.040 0.040	0.030 0.030	1.00 1.00	16.0–18.0 16.0–18.0		0.75 0.75			
U-1004	1 4400	0.00-1.20	1.00	0.040	0.000	1.00	10.0-10.0		0.70		• • • •	

A Maximum, unless range or minimum is indicated. Where ellipses (. . .) appear in this table, there is no requirement and the element need not be determined or reported.

B Designations established in accordance with Practice E527 and SAE J 1086.

Designations established in accordance with Practice E327 and SAE J 1000.

C For some applications, the substitution of Type 304L for Type 316L for Type 316 may be undesirable because of design, fabrication, or service requirements. In such cases, the purchaser should so indicate on the order.

D UNS S31010 is a highly alloyed austenitic stainless steel type 3b as defined in NACE MR0175/ISO 15156-3.

E Nitrogen content is to be reported for this grade. F % Cr + 3.3 × % Mo + 16 × % N \geq 40.

 $^{^{\}it G}$ Nickel plus copper shall be 0.50 % max.

H Product analysis tolerance over the maximum limit for carbon and nitrogen shall be 0.002 %.

Note 4—A typical ordering description is as follows: 5000 lb [2270 kg] Stainless Steel Bars, Annealed and Centerless Ground, 1½ in. [40 mm] Round, 10 to 12 ft [3 to 3.7 m] in length, Type 304, ASTM Specification A276/A276M dated ______. End use: machined valve parts.

4. Manufacture

- 4.1 Condition:
- 4.1.1 Bars shall be furnished in one of the following conditions listed in the Mechanical Requirements table:
 - 4.1.1.1 Condition A—Annealed.
- 4.1.1.2 *Condition H*—Hardened and tempered at a relatively low temperature.
- 4.1.1.3 *Condition T*—Hardened and tempered at a relatively high temperature.
- 4.1.1.4 Condition S— Strain Hardened—Relatively light cold work.
 - 4.1.1.5 Condition B—Relatively severe cold work.
 - 4.1.1.6 Condition SA—Stabilized annealed.

5. Chemical Composition

- 5.1 The steel shall conform to the requirements for chemical composition specified in Table 1.
- 5.2 Methods and practices relating to chemical analysis required by this specification shall be in accordance with Test Methods, Practices, and Terminology A751.

6. Mechanical Properties Requirements

6.1 The material shall conform to the mechanical test requirements specified in Table 2.

- 6.2 The martensitic grades shall be capable of meeting the hardness requirements after heat treating as specified in Table 3.
- 6.3 Hardness measurements, when required, shall be made at a location midway between the surface and the center of the cross section.

7. Magnetic Permeability

7.1 When required by the purchase order, the magnetic permeability of Types 201 and 205 in the annealed condition shall not exceed 1.2 as tested by a Severn-type indicator.

8. General Requirements

8.1 In addition to the requirements of this specification, all requirements of the current edition of Specification A484/A484M shall apply. Failure to comply with the general requirements of Specification A484/A484M constitutes nonconformance to this specification.

9. Certification

9.1 Upon request of the purchaser in the contract or order, the producer's certification that the material was manufactured and tested in accordance with this specification, together with a certified report of the test results shall be furnished at the time of the shipment.

10. Keywords

10.1 austenitic stainless steel; austenitic-ferritic duplex stainless steel; ferritic stainless steel; martensitic stainless steel; stainless steel bars; stainless steel shapes

Wrought version of CA 6NM.

J Iron shall be determined arithmetically by difference of 100 minus the sum of specified elements.

K (AI + Ti) = 0.85 - 1.20.

^LThe terms Columbium (Cb) and Niobium (Nb) both relate to the same element.

 $^{^{}M}$ % Cr + 3.3 × % Mo + 16 × % N \geq 41.

TABLE 2 Mechanical Requirements

Туре	Condition	Finish	Diameter or Thickness, in. [mm]	Tensile Strength, min		Yield Strength, ^A min		Elonga- tion in 2 in. [50 mm] ^B or 4D	Reduc- tion of Area, ^{C, L}	HBW unless
				ksi	MPa	ksi	MPa	min %	min, %	otherwise indicated, E max
			Austenitic Grade	s						
N08020	SA	hot-finished or	all	80	[550]	35	[240]	30	50	
N08367	Α	cold-finished hot-finished or	all	95	655	45	310	30	50	
100007	Α	cold-finished	all	93	055	45	310	30	50	
N08700	Α	hot-finished or cold-finished	all	80	550	35	240	30	50	
N08800 800	Α	hot-finished or cold-finished	all	75	515	30	205	30		192
N08810 800H	Α	hot-finished or	all	65	450	25	170	30		192
N08811	Α	cold-finished hot-finished or	all	65	450	25	170	30		192
NOODO 4 DO 41		cold-finished	-11	74	400	0.4	000	0.5		
N08904 904L	Α	hot-finished or cold-finished	all	71	490	31	220	35		
N08925	Α	hot-finished or cold-finished	all	87	600	43	295	40		217
N08926	Α	hot-finished or	all	94	650	43	295	35		256
004 000		cold-finished	-11			40			45	
201, 202	Α	hot-finished or cold-finished	all	75	515	40	275	40	45	
S20161	Α	hot-finished	all	125	860	50	345	40	40	255
		cold-finished	all	125	860	50	345	40	40	311
S20162	Α	hot-finished or cold finished	all	100	690	50	345	50	60	
205	Α	hot-finished or cold-finished	all	100	690	60	414	40	50	
XM-19	Α	hot-finished or cold-finished	all	100	690	55	380	35	55	
	As hot- rolled	hot-finished or cold-finished	up to 2 [50.8], incl	135	930	105	725	20	50	
	Tolled		over 2 to 3 [50.8 to 76.2],	115	795	75	515	25	50	
			incl over 3 to 8 [76.2 to 203.2],	100	690	60	415	30	50	
S21800	Α	hot-finished or	incl all	95	655	50	345	35	55	241
XM-10, XM-11	Α	cold-finished hot-finished or	all	90	620	50	345	45	60	
XM-29	Α	cold-finished hot-finished or	all	100	690	55	380	30	50	
XM-28	Α	cold-finished hot-finished or	all	100	690	55	380	30	50	
S24565	Α	cold-finished hot-finished or	all	115	795	60	415	35	40	
S28200	Α	cold-finished hot-finished or	all	110	760	60	410	35	55	
302, 302B, 304, 304LN,	Α	cold finished hot-finished	all	75 ^F	515	30 ^F	205	40 ^{<i>G</i>}	50	
305, 308, 309, 309S,	7	cold-finished	up to ½ [12.70] incl	90	620	45	310	30	40	
309Cb, 310, 310S, 310Cb, 314, 316, 316LN, 316Cb, 316Tl, 317, 321, 347,			over ½ [12.70]	75 ^{<i>F</i>}	515	30 ^F	205	30	40	
348 304L, 316L	Α	hot-finished	all	70	485	25	170	40 ^{<i>G</i>}	50	
,		cold-finished	up to ½ [12.70] incl.	90	620	45	310	30	40	
			over ½ [12.70]	70	485	25	170	30	40	
304N, 316N	Α	hot-finished or cold-finished	all	80	550	35	240	30		
202, 302, 304, 304N, 316, 316N	В	cold-finished	up to ¾ [19.05] incl	125	860	100	690	12	35	
304L, 316L			over ¾ [19.05] to 1 [25.40]	115	795	80	550	15	35	
			over 1 [25.40] to 11/4 [31.75]	105	725	65	450	20	35	
			over 11/4 [31.75] to 11/2 [38.10]	100	690	50	345	24	45	

TABLE 2 Continued

Туре	Condition	Finish	Diameter or Thickness, in. [mm]	Stre	nsile ngth, nin	Yield Str mi		Elonga- tion in 2 in. [50 mm] ^B or 4D	Reduction of Area, C, D	
				ksi	MPa	ksi	MPa	min %	min, %	otherwise indicated, [£] max
			over 1½ [38.10] to 1¾ [44.45]	95	655	45	310	28	45	
304, 304N, 316, 316N 304L, 316L	S	cold-finished	up to 2 [50.8] incl	95	650	75	515	25	40	
,			over 2 to 2½ [50.8 to 63.5] incl	90	620	65	450	30	40	
			over 2½ to 3 [63.5 to 76.2] incl	80	550	55	380	30	40	
XM-21, S30454, S31654	Α	hot-finished or cold-finished	all	90	620	50	345	30	50	
XM-21, S30454 S31654	В	cold-finished	up to 1 [25.40] incl	145	1000	125	860	15	45	
001034			over 1 [25.40] to 11/4 [31.75]	135	930	115	795	16	45	
			over 11/4 [31.75] to 11/2 [38.10]	135	895	105	725	17	45	
			over 1½ [38.10] to 1¾ [44.45]	125	860	100	690	18	45	
S30815	Α	hot-finished or	all	87	600	45	310	40	50	
		cold-finished		87	600	45	310	40	50	
S31010	Α	hot-finished or cold-finished	all	110	760	75	515	40	50	330
S31254	Α	hot-finished or cold-finished	all	95	650	44	300	35	50	
S31266	Α	hot-finished or cold-finished	all	109	750	61	420	35		
S31725	Α	hot-finished or cold-finished	all	75	515	30	205	40		
S31726	Α	hot-finished or cold-finished	all	80	550	35	240	40		
S31727	Α	hot-finished or cold-finished	all	80	550	36	245	35		217
S31730	Α	hot-finished or cold-finished	all	70	480	25	175	35		90 HRB
S32053	Α	hot-finished or cold-finished	all	93	640	43	295	40		217
S32654	Α	hot-finished or cold-finished	all	109	750	62	430	40	40	250
		colu-III II Si leu	Austenitic-Ferritic Gr	ades						
XM-26	Α	hot-finished or	all	90	620	65	450	20	55	
S31803	Α	cold-finished hot-finished or	all	90	620	65	448	25		290
		cold-finished								
S32056	Α	hot-finished or cold-finished	all	90	620	65	450	18		302
S32101	Α	hot-finished or cold-finished	all	94	650	65	450	30	• • •	290
S32202	Α	hot-finished or cold-finished	all	94	650	65	450	30		290
S32205	Α	hot-finished or cold-finished	all	95	655	65	450	25		290
S32304	Α	hot-finished or cold-finished	all	87	600	58	400	25		290
332304		ooid iiillolled		100	750	80	550	25		290
S32550	Α	hot-finished or	all	109	, 00					
S32550		hot-finished or cold-finished				105	720	16		335
	A S A	hot-finished or	all all up to 2 [50.8] incl	125 116	860 800	105 80	720 550	16 15		335 310
S32550 S32550 S32750	S A	hot-finished or cold-finished cold-finished hot-finished or cold-finished	all up to 2 [50.8] incl over 2 [50.8]	125	860 800 760	80 75		15 15		
S32550 S32550	S	hot-finished or cold-finished cold-finished hot-finished or	all up to 2 [50.8] incl	125 116	860 800	80	550	15		310
S32550 S32550 S32750	S A	hot-finished or cold-finished cold-finished hot-finished or cold-finished hot-finished or	all up to 2 [50.8] incl over 2 [50.8]	125 116 110	860 800 760	80 75	550 515	15 15		310 310
\$32550 \$32550 \$32750 \$32760	S A A	hot-finished or cold-finished cold-finished hot-finished or cold-finished hot-finished or cold-finished	all up to 2 [50.8] incl over 2 [50.8] all	125 116 110 109	860 800 760 750	80 75 80	550 515 550	15 15 25		310 310 310
\$32550 \$32550 \$32750 \$32760 \$32760 \$82441	S A A S A	hot-finished or cold-finished cold-finished hot-finished or cold-finished or cold-finished cold-finished hot-finished or cold-finished	all up to 2 [50.8] incl over 2 [50.8] all all Under 7/16 [11 mm] 7/16 and over [11 mm] Ferritic Grades	125 116 110 109 125 107	860 800 760 750 860 740	80 75 80 105 78	550 515 550 720 540	15 15 25 16 25		310 310 310 335 290 290
\$32550 \$32550 \$32750 \$32760 \$32760	S A A S	hot-finished or cold-finished cold-finished hot-finished or cold-finished or cold-finished or cold-finished cold-finished or cold-finished hot-finished or cold-finished	all up to 2 [50.8] incl over 2 [50.8] all all Under 7/16 [11 mm] 7/16 and over [11 mm] Ferritic Grades all	125 116 110 109 125 107 99	860 800 760 750 860 740 680	80 75 80 105 78 70	550 515 550 720 540 480	15 15 25 16 25 25		310 310 310 335 290 290
\$32550 \$32550 \$32750 \$32760 \$32760 \$82441	S A A S A	hot-finished or cold-finished cold-finished hot-finished or cold-finished or cold-finished cold-finished hot-finished or cold-finished	all up to 2 [50.8] incl over 2 [50.8] all all Under 7/16 [11 mm] 7/16 and over [11 mm] Ferritic Grades	125 116 110 109 125 107 99	860 800 760 750 860 740 680	80 75 80 105 78 70	550 515 550 720 540 480	15 15 25 16 25 25		310 310 310 335 290 290

TABLE 2 Continued

Туре	Condition	Finish	h Diameter or Thickness, in. [mm]		Tensile Strength, min		rength, ^A in	Elonga- tion in 2 in. [50 mm] ^B	Reduc- tion of Area, ^{C, D}	Brinell Hard- ness, HBW unless
				ksi	MPa	ksi	MPa	or 4D min %	min, %	otherwise indicated, ^E max
430	Α	hot-finished or cold-finished	all	60	415	30	207	20	45	
S40976	Α	hot-finished or cold-finished	all	60	415	20	140	20	45	244
S44400	Α	hot-finished cold-finished	all all	60 60	415 415	45 45	310 310	20 16	45 45	217 217
446, XM-27	Α	hot-finished cold-finished	all all	65 65	450 450	40 40	275 275	20 16	45 45	219 219
S44700	Α	hot-finished cold-finished	all all	70 75	480 520	55 60	380 415	20 15	40 30	
S44800	Α	hot-finished cold-finished	all all	70 75	480 520	55 60	380 415	20 15	40 30	
		cola lililorica	Martensitic Gra		020		110	10	- 00	
403, 410	Α	hot-finished cold-finished	all all	70 70	480 480	40 40	275 275	20 16	45 45	
403, 410	Т	hot-finished cold-finished	all all	100 100	690 690	80 80	550 550	15 12	45 40	
XM-30	Т	hot-finished cold-finished	all all	125 125	860 860	100 100	690 690	13 12	45 35	302
403, 410	Н	hot-finished	all	120	830	90	620 620	12	40 40	
XM-30	Α	cold-finished hot-finished	all (rounds only) all	120 70	830 480	90 40	275	12 13	45	235
414	Α	cold-finished hot-finished or cold-finished	all all	70 	480	40	275	12	35	298
414	Т	hot-finished or cold-finished	all	115	790	90	620	15	45	
S41425	Т	hot-finished	all	120	825	95	655	15	45	321
S41500	T	hot-finished or cold-finished	all	115	795	90	620	15	45	295
420	Α	hot-finished cold-finished	all all							241 255
S42010	Α	hot-finished cold-finished	all all							235 255
431	Α	hot-finished or cold-finished	all							285
440A, 440B, and 440C	Α	hot-finished cold-finished	all all							269 285

A Yield strength shall be determined by the 0.2 % offset method in accordance with Test Methods and Definitions A370 or Test Methods A1058. An alternative method of determining yield strength may be used based on a total extension under load of 0.5 %.

^B For some specific products, it may not be practicable to use a 2-in. or 50-mm gage length. The use of sub-size test specimens, when necessary, is permissible in

To some specific products, it may not be practicative to use a 2-in. Or 30-initing age length. The use of sub-size test specifiers, when necessary, is permissible in accordance with Test Methods and Definitions A370 or Test Methods A1058.

C Reduction of area does not apply on flat bars % in. [4.76 mm] and under in thickness as this determination is not generally made in this product size.

D The material shall be capable of meeting the required reduction of area where listed, but actual measurement and reporting of the reduction of area are not required unless

For extruded shapes of all Cr-Ni grades of Condition A, the yield strength shall be 25 ksi [170 MPa] min and tensile strength shall be 70 ksi [480 MPa] min.

For shapes having section thickness of ½ in. [12.5 mm] or less, 30% min. elongation is acceptable.

Material shall be capable of being heat treated to a maximum Brinell hardness of 250 HBW when oil quenched from 1750°F [950°C].

TABLE 3 Response to Heat Treatment

Type ^A	Heat Treatment Temperature ^B °F [°C], min	Quenchant	Hardness HRC, min
403	1750 [955]	Air	35
410	1750 [955]	Air	35
414	1750 [955]	Oil	42
420	1825 [995]	Air	50
S42010	1850 [1010]	Oil	48
431	1875 [1020]	Oil	40
440A	1875 [1020]	Air	55
440B	1875 [1020]	Oil	56
440C	1875 [1020]	Air	58

 $[^]A$ Samples for testing shall be in the form of a section not exceeding % in. [9.50 mm] in thickness. B Temperature tolerance is ±25°F [14°C].



SPECIFICATION FOR GRAY IRON CASTINGS FOR PRESSURE CONTAINING PARTS FOR TEMPERATURES UP TO 650°F (350°C)



SA-278/SA-278M

(Identical with ASTM Specification A278/A278M-01(2015) except for an editorial change to 5.1.1 and a change to 16.1 making certification mandatory.)

Standard Specification for Gray Iron Castings for Pressure-Containing Parts for Temperatures Up to 650°F (350°C)

1. Scope

- 1.1 This specification covers gray iron for castings suitable for pressure-containing parts for use at temperatures up to 650°F (350°C).
 - 1.2 Classes of Iron:
- 1.2.1 Castings of all classes are suitable for use up to 450° F (230°C). For temperatures above 450° F and up to 650° F, only Class 40, 45, 50, 55, and 60 castings are suitable.
- 1.2.2 Castings of all classes are suitable for use up to 230°C. For temperatures above 230°C and up to 350°C, only Class 275, 300, 325, 350, 380, and 415 castings are suitable.
- 1.3 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

2. Referenced Documents

2.1 ASTM Standards:

A644 Terminology Relating to Iron Castings E8 Test Methods for Tension Testing of Metallic Materials

3. Terminology

3.1 Definitions of many terms common to gray iron castings may be found in Terminology A644.

4. Classification

4.1 Classification by tensile strength.

- 4.1.1 Castings ordered to this specification are classified based upon the minimum tensile strength of the iron in ksi, in English units. Class 25 has a minimum specified tensile strength of 25 ksi.
- 4.1.2 Castings ordered to this specification are classified based upon the minimum tensile strength of the iron in MPa, in Metric units. Class 150 has a minimum specified tensile strength of 150 MPa.

5. Ordering Information

- 5.1 Orders for material in this specification should include the following information:
 - 5.1.1 ASTM designation and year date,
 - 5.1.2 Class of iron required and service temperature,
 - 5.1.3 Quantity,
 - 5.1.4 Heat Treatment:
- 5.1.4.1 Whether or not heat treatment is required for Class 40, 45, 50, 55, and 60 castings to be used at temperatures at 450°F or less (see 6.2),
- 5.1.4.2 Whether or not heat treatment is required for Class 275, 300, 325, 350, 380, and 415 castings to be used at temperatures at 230°C or less (see 6.2),
- 5.1.5 The size of separately cast test bar to be poured (see Section 9 and Table 1),
- 5.1.6 The size of test specimen to be machined from test bars C or S, and
 - 5.1.7 Special requirements.

6. Materials and Manufacture

- 6.1 Castings intended for use above 450°F (230°C) shall be stress-relieved by placing them in a suitable furnace at a temperature not exceeding 400°F (200°C) and heating them uniformly to the temperatures and for the times specified in Table 2. The heating and cooling rates shall be uniform and shall not be more than 400°F/h (250°C/h) for castings of 1-in. (25-mm) maximum section. For heavier sections the maximum heating and cooling rates in degrees Fahrenheit per hour shall be 400 divided by the maximum section thickness.
 - 6.2 Heat Treatment and Cooling Rate:
- 6.2.1 Castings of Class Nos. 45, 50, 55, and 60, which are to be used at temperatures below 450°F, may be heat treated in

TABLE 1 Diameters and Lengths of Cast Test Bars

Test	As-0	Cast Diameter	, in. (mm)	Length, i	n. (mm)
Bar	Minimum (Bottom)	Maximum (Top)	Minimum (Specified) (I	Maximum Recommended)	
A B C S ^A	0.88 (23) 1.20 (33) 2.00 (54)	0.85 (22) 1.14 (32) 1.90 (53)	0.96 (25) 1.32 (36) 2.10 (58)	5.0 (125) 7.0 (150) 6.0 (175)	6.0 (1.50) 9.0 (230) 10.0 (255)

^A All dimensions of Test Bar S shall be agreed upon by the manufacturer and the purchaser.

TABLE 2 Stress Relieving Requirements

Class	Metal Temperature, °F (°C)	Holding Time, h ^A	
40, 45, 50, 55, 60	1050 to 1200	2	12
(275, 300, 325, 350,	(565 to 650)	(2 min) ^B	(12 max) ^B
380, 415)			

A In no case shall the holding time be less than 1 h/in. of maximum metal section, or in excess of 12 h max, dependent upon which governs.

accordance with 6.1 or they shall be cooled in the mold to 500°F at an average rate of not more than 100°F/h for castings up to 1 in. in section. For heavier sections the maximum cooling rate in degrees Fahrenheit per hour shall be 100 divided by the maximum section thickness.

6.2.2 Castings of Class Nos. 275, 300, 325, 350, 380, and 415, which are to be used at temperatures below 230°C, may be heat treated in accordance with 6.1 or they shall be cooled in the mold to 250°C at an average rate of not more than 50°C/h for castings up to 25-mm in section. For heavier sections the maximum cooling rate in degrees Celsius per hour shall be 1250 divided by the maximum section thickness.

7. Chemical Composition

7.1 Carbon Equivalent:

- 7.1.1 Class 40, 45, 50, 55, and 60 castings intended for service above 450°F (230°C) shall have a maximum carbon equivalent of 3.8 % as calculated from the equation CE = %C + 0.3 (%Si + %P). The maximum phosphorus and sulfur contents shall be 0.25 % and 0.12 %, respectively.
- 7.1.2 Class 275, 300, 325, 350, 380, and 415 castings intended for service above 230°C shall have a maximum carbon equivalent of 3.8 % as calculated from the equation CE = %C + 0.3 (%Si + %P). The maximum phosphorus and sulfur contents shall be 0.25 % and 0.12 %, respectively.
- 7.2 The chemical analysis for total carbon shall be made on either chilled cast pencil-type specimens or thin wafers approximately ½2 in. thick cut from test coupons. Drillings shall not be used because of attendant loss of graphite.

8. Tensile Requirements

8.1 Iron used in supplying castings to this specification shall conform to the tensile requirements prescribed in Table 3 and Table 4.

9. Test Bars

9.1 Separately cast test bars having the dimensions shown in Table 1 shall be poured from the same lot as the castings

TABLE 3 Tensile Requirements

Class	Tensile Strength, min, ksi
No. 20	20
No. 25	25
No. 30	30
No. 35	35
No. 40	40
No. 45	45
No. 50	50
No. 55	55
No. 60	60

TABLE 4 Tensile Requirements (SI)

Class	Tensile Strength,
	min, MPa
	IIIII, IVIFa
No. 150	150
No. 175	175
No. 200	200
No. 225	225
No. 250	250
No. 275	275
No. 300	300
No. 325	325
No. 350	350
No. 380	380
No. 415	415

represented. The size of the test bar to be poured shall be selected by the purchaser using Table 5. In the event no choice is made, the selection will be made by the manufacturer.

- 9.2 Separately cast test bars shall be heat treated in the same furnace together with the castings represented.
- 9.3 At the option of the manufacturer, test coupons may be removed from the casting at a location agreed upon between the manufacturer and purchaser.
- 9.4 Castings weighing in excess of 2000 lb may be represented either by separately cast test bars (9.1) or by integrally cast test bars having a cooling rate closely approximating that of the controlling section of the casting.
- 9.5 For castings weighing in excess of 10 000 lb or having a controlling section greater than 2 in., test bars may be removed from the casting or integral projections having a cross section no less than the controlling section. The minimum tensile strength requirement for tension tests performed on either of these test bars shall be 80 % of the specified class.


10. Molding and Pouring Test Bars

10.1 The test bars shall be cast in dried siliceous sand molds maintained at approximately room temperature. A suitable design for a mold is shown in Fig. 1.

TABLE 5 Separately Cast Test Bars for Use When a Specific Correlation Has Not Been Established Between the Test Bar and the Casting

Thickness of the Wall of the Controlling Section of the Casting, in. (mm)	Test Bar
Under 0.25 (6)	S
0.25 to 0.50 (6 to 12)	Α
0.51 to 1.00 (13 to 25)	В
1.01 to 2 (26 to 50)	С
Over 2 (50)	S

^B In no case shall the holding time be less than 1 h for every 25-mm metal section, or in excess of 12 h max, depending upon which governs.

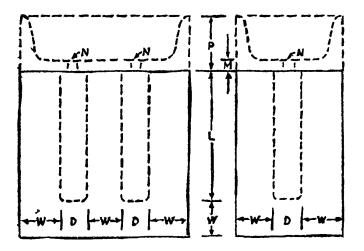

Number of test bars in a single mold-2 suggested. *L*—see Table 1. *D*—see Table 1. *W*—not less than diameter, *D*. P—2 in. (50-mm) suggested N—5/16 in. (8-mm) in diameter, suggested M—1.5 N, suggested

FIG. 1 Suitable Design and Dimensions for Mold for Separately Cast Cylindrical Test Bars for Gray Iron

11. Workmanship, Finish, and Appearance

- 11.1 All castings shall be made in a workmanlike manner and shall conform to the dimensions on drawings furnished by the purchaser. If the pattern is supplied by the purchaser without drawings, the dimensions of the casting shall be as predicted by the pattern.
- 11.2 The surface of the casting shall be free of adhering sand, scale, cracks, and hot tears as determined by visual examination. Other surface discontinuities shall meet the visual acceptance standards specified in the order.

12. Sampling

- 12.1 A lot shall consist of one of the following:
- 12.1.1 All the metal poured from a single heating in a batch type melting furnace,
- 12.1.2 All the metal from two or more batch type melting furnaces poured into a single ladle or single casting, or
- 12.1.3 All the metal poured from a continuous melting furnace for a given period of time between changes in charge, processing conditions, or aim-for chemistry or 4 h, whichever is the shorter period.
- 12.1.3.1 The purchaser may agree to extend the 4-h time period to 8 h if the manufacturer can demonstrate sufficient process control to warrant such an extension.

13. Tension Test Specimens

- 13.1 Tension test specimens A and B in Fig. 2 shall be machined from test bars A and B in Table 1, respectively.
- 13.2 The purchaser shall specify whether test specimen B or C is to be machined from test bar C. If no choice is made, the manufacturer shall make the selection.
- 13.3 The size of the test specimen to be machined from test bar S shall be as agreed upon between the manufacturer and purchaser.

14. Number of Tests and Retests

- 14.1 One tension test shall be performed on each lot in accordance with Test Method E8 and conform to the tensile requirements specified.
- 14.2 If the results of a valid test fail to conform to the requirements of this specification, two retests shall be made. If either retest fails to meet the specification requirements, the castings represented by these test specimens shall be rejected.
- 14.3 If, after testing, a test specimen shows evidence of a defect, the results of the test may be invalidated and another made on a specimen from the same lot.

15. Repair


15.1 Any repairs performed on castings produced to this specification shall be agreed upon between the manufacturer and purchaser.

16. Certification

- 16.1 When requested by the purchaser, the manufacturer shall furnish his certification stating that the material was manufactured, sampled, tested, and inspected in accordance with this specification including the year date. The certification shall also include the results of all tests performed.
- 16.2 A signature is not required on the certification. However, the document shall clearly identify the organization submitting the certification and the authorized agent of the manufacturer who certified the test results. Notwithstanding the absence of a signature, the organization submitting the certification is responsible for its content.

17. Inspection

17.1 All tests and inspections required by this specification shall be performed by the manufacturer or other reliable sources whose services have been contracted for by the

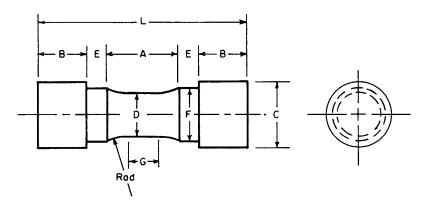

Dimensions, in. (mm)	Tension Test Specimen A	Tension Test Specimen B	Tension Test Specimen C
G— Length of parallel, min	0.50 (13)	0.75 (20)	1.25 (32)
D— Diameter	$0.500 \pm 0.010 (13 \pm 0.25)$	$0.750 \pm 0.015 (20 \pm 0.4)$	$1.25 \pm 0.025 (32 \pm 0.5)$
R— Radius of fillet, min	1 (25)	1 (25)	2 (50)
A— Length of reduced section, min	11/4 (32)	1½ (38)	21/4 (57)
L— Overall length, min	33/4 (95)	4 (100)	63/8 (160)
C— Diameter of end section, approximate	⁷ / ₈ (22)	11/4 (32)	17/8 (47)
E— Length of shoulder, min	1/4 (6)	1/4 (6)	5/16 (8)
F— Diameter of shoulder	5/8 ± 1/64 (16 ± 0.5)	$\frac{15}{16} \pm \frac{1}{64} (25 \pm 0.5)$	$1\frac{7}{16} \pm \frac{1}{64} (36 \pm 0.5)$
B— Length of end section	Ä	A	A

^A Optional to fit holders on testing machine. If threaded, root diameter shall not be less than dimension F.

FIG. 2 Tension-Test Specimens

manufacturer. Complete records of all tests and inspections shall be maintained by the manufacturer and shall be available for review by the purchaser.

18. Rejection and Rehearing

18.1 Castings which fail to conform to the requirements specified when inspected or tested by the purchaser or his agent may be rejected. Rejection shall be reported to the manufacturer or supplier promptly and in writing. In case of dissatisfaction with the test results, the manufacturer or supplier may make claim for a rehearing.

19. Product Marking

19.1 Castings shall have the name of the manufacturer, or his recognized trademark, and the class of iron to which it conforms, cast or indelibly stamped on a surface indicated by the purchaser or in such a position as not to injure the usefulness of the casting.

20. Keywords

20.1 elevated temperature service; gray iron castings; pressure containing parts



SPECIFICATION FOR LOW AND INTERMEDIATE TENSILE STRENGTH CARBON STEEL PLATES



SA-283/SA-283M



(23)

(Identical with ASTM Specification A283/A283M-13.)

Specification for Low and Intermediate Tensile Strength Carbon Steel Plates

1. Scope

- 1.1 This specification covers two grades (C and D) of carbon steel plates of structural quality for general application.
- 1.2 When the steel is to be welded, a welding procedure suitable for the grade of steel and intended use or service is to be utilized. See Appendix X3 of Specification A6/A6M for information on weldability.
- 1.3 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exactly equivalents; therefore, each system is to be used independently of the other, without combining values in any way.
- 1.4 For plate produced from coil and furnished without heat treatment or with stress relieving only, the additional requirements, including additional testing requirements and the reporting of additional test results, of Specification A6/A6M apply.
- 1.5 This specification contains notes or footnotes, or both, that provide explanatory material. Such notes and footnotes, excluding those in tables and figures, do not contain any mandatory requirements.

2. Referenced Documents

2.1 ASTM Standards:

A6/A6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling

3. General Requirements for Delivery

- 3.1 Plates furnished under this specification shall con-form to the requirements of the current edition of Specification A6/A6M, for the specific date ordered, unless a conflict exists, in which case this specification shall prevail.
- 3.2 Coils are excluded from qualification to this specification until they are processed into finished plates. Plates produced from coil means plates that have been cut to individual lengths from a coil. The processor directly controls, or is responsible for, the operations involved in the processing of a coil into finished plates. Such operations include decoiling, leveling, cutting to length, testing, inspection, conditioning, heat treatment (if applicable), packaging, marking, loading for shipment, and certification.

Note 1—For plates produced from coil and furnished without heat treatment or with stress relieving only, two test results are to be reported for each qualifying coil. Additional requirements regarding plate produced from coil are described in Specification A6/A6M.

4. Process

- 4.1 The steel shall be made by one or more of the following processes: open-hearth, basic-oxygen, or electric-furnace.
 - 4.2 The steel shall be killed.

5. Chemical Requirements

- 5.1 The heat analysis shall conform to the requirements prescribed in Table 1.
- 5.2 The steel shall conform on product analysis to the requirements prescribed in Table 1, subject to the product analysis tolerances in Specification A6/A6M.

6. Mechanical Properties

- 6.1 Tensile Properties:
- 6.1.1 Material as represented by the test specimens shall conform to the requirements as to tensile properties prescribed in Table 2.

7. Keywords

7.1 carbon steel; plates; structural quality

TABLE 1 Chemical Requirements

Elements	Heat An	alysis, %
	Grade C	Grade D
Carbon, max	0.24	0.27
Manganese, max	0.90	0.90
Phosphorus, max	0.030	0.030
Sulfur, max	0.030	0.030
Silicon		
Plates 11/2 in. [40 mm] and under, max	0.40	0.40
Plates over 1½ in. [40 mm]	0.15-0.40	0.15-0.40
Copper, min % when copper is specified	0.20	0.20

TABLE 2 Tensile Requirements^A

	Grade C	Grade D
Tensile strength, ksi [MPa]	55–75 [380–515]	60-80 [415-550]
Yield point, min, ksi [MPa]	30 [205]	33 [230]
Elongation in 8 in. [200 mm], min, % ^B	22	20
Elongation in 2 in. [50 mm], min, % ^B	25	23

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified in the order or contract. Standardized supplementary requirements for use at the option of the purchaser are listed in Specification A6/A6M. Those that are considered suitable for use with this specification are listed by title:

- S2. Product Analysis.
- S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons.
 - S5. Charpy V-Notch Impact Test.

- S6. Drop Weight Test (for Material 0.625 in. [16 mm] and over in Thickness).
 - S8. Ultrasonic Examination.
 - S15. Reduction of Area.

A See Specimen Orientation under the Tension Tests section of Specification A6/A6M.

For plates wider than 24 in. [600 mm], the elongation requirement is reduced two percentage points. See elongation requirement adjustments in the Tension Tests section of Specification A6/A6M.



SPECIFICATION FOR PRESSURE VESSEL PLATES, CARBON STEEL, LOW- AND INTERMEDIATE-TENSILE STRENGTH



SA-285/SA-285M



(Identical with ASTM Specification A285/A285M-17.)

Standard Specification for Pressure Vessel Plates, Carbon Steel, Low- and Intermediate-Tensile Strength

1. Scope

- 1.1 This specification covers carbon steel plates of lowand intermediate-tensile strengths which may be killed or semi-killed at the producer's option. These plates are intended for fusion-welded pressure vessels.
- 1.2 Plates under this specification are available in three grades having different strength levels as follows:

Grade	Tensile Strength, ksi [MPa
Α	45-65 [310-450]
В	50-70 [345-485]
С	55-75 [380-515]

1.3 The maximum thickness of plates is limited by the capacity of the composition to meet the specified mechanical property requirements.

Note 1—For killed carbon steels only, refer to the following ASTM specifications:

A299/A299M Specification for Pressure Vessel Plates, Carbon Steel, Manganese-Silicon

A515/A515M Specification for Pressure Vessel Plates, Carbon Steel, for Intermediate- and Higher-Temperature Service

A516/A516M Specification for Pressure Vessel Plates, Carbon Steel, for Moderate- and Lower-Temperature Service

- 1.4 For plates produced from coil and furnished without heat treatment or with stress relieving only, the additional requirements, including additional testing requirements and the reporting of additional test results, of Specification A20/A20M apply.
- 1.5 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each

system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification.

1.6 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A20/A20M Specification for General Requirements for Steel Plates for Pressure Vessels
- A299/A299M Specification for Pressure Vessel Plates, Carbon Steel, Manganese-Silicon
- A435/A435M Specification for Straight-Beam Ultrasonic Examination of Steel Plates
- A515/A515M Specification for Pressure Vessel Plates, Carbon Steel, for Intermediate- and Higher-Temperature Service
- A516/A516M Specification for Pressure Vessel Plates, Carbon Steel, for Moderate- and Lower-Temperature Service A577/A577M Specification for Ultrasonic Angle-Beam Examination of Steel Plates
- A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applications

3. General Requirements and Ordering Information

- 3.1 Material supplied to this material specification shall conform to Specification A20/A20M. These requirements outline the testing and retesting methods and procedures, permitted variations in dimensions, and mass, quality and repair of defects, marking, loading, and ordering information.
- 3.2 In addition to the basic requirements of this specification, certain supplementary requirements are available when additional control, testing, or examination is required to meet end use requirements. The purchaser is referred to the

TABLE 1 Chemical Requirements

Elements		Composition, %				
Elements	Grade A	Grade B	Grade C			
Carbon, max ^A	0.17	0.22	0.28			
Manganese, max:						
Heat analysis	0.90	0.90	0.90			
Product analysis	0.98	0.98	0.98			
Phosphorus, max ^A	0.025	0.025	0.025			
Sulfur, max ^A	0.025	0.025	0.025			

^A Applies to both heat and product analyses.

TABLE 2 Tensile Requirements

	G	Grade A		Grade B		Grade C	
	ksi	[MPa]	ksi	[MPa]	ksi	[MPa]	
Tensile strength	45-65	[310-450]	50-70	[345-485]	55–75	[380–515]	
Yield strength, min ^A	24	[165]	27	[185]	30	[205]	
Elongation in 8 in. or [200 mm], min, % ^B		27		25		23	
Elongation in 2 in. or [50 mm], min, % ^B		30		28		27	

A Determined by either the 0.2 % offset method or the 0.5 % extension-under-load method.

listed Supplementary requirements in this specification and to the detailed requirements in Specification A20/A20M.

3.3 Coils are excluded from qualification to this specification until they are processed into finished plate. Plates produced from coil means plates that have been cut to individual lengths from coil. The processor directly controls, or is responsible for, the operations involved in the processing of coils into finished plates. Such operations include decoiling, leveling, cutting to length, testing, inspection, conditioning, heat treatment (if applicable), packaging, marking, loading for shipment, and certification.

Note 2—For plates produced from coil and furnished without heat treatment or with stress relieving only, three test results are reported for each qualifying coil. Additional requirements regarding plate produced from coil are described in Specification A20/A20M.

3.4 If the requirements of this specification are in conflict with the requirements of Specification A20/A20M, the requirements of this specification shall prevail.

4. Heat Treatment

4.1 Plates are normally supplied in the as-rolled condition. The plates may be ordered normalized or stress relieved, or both

5. Chemical Composition

5.1 The steel shall conform to the requirements as to chemical composition as given in Table 1.

6. Mechanical Properties

6.1 *Tension Test*—The plates, as represented by the tension test specimens, shall conform to the requirements given in Table 2.

7. Keywords

7.1 carbon steel plate; low-and-intermediate strength steel plate for pressure vessels; steel plate for pressure vessels

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified in the purchase order.

A list of standardized supplementary requirements for use at the option of the purchaser is included in Specification A20/A20M. Those that are considered suitable for use with this specification are listed below by title.

- S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons,
 - S4. Additional Tension Test,
- S8. Ultrasonic Examination in accordance with Specification A435/A435M.
- S11. Ultrasonic Examination in accordance with Specification A577/A577M, and
- S12. Ultrasonic Examination in accordance with Specification A578/A578M.

^B See Specification A20/A20M for elongation adjustment.

ADDITIONAL SUPPLEMENTARY REQUIREMENTS

Also listed below are additional optional supplementary requirements suitable for this specification:

S57. Copper-Bearing

S58. Restricted Copper

S57.1 The copper content, by heat analysis shall be 0.20–0.35 % and by product analysis 0.18–0.37 %.

S58.1 The maximum incidental copper content by heat analysis shall not exceed 0.25 %.

SPECIFICATION FOR PRESSURE VESSEL PLATES, CARBON STEEL, MANGANESE-SILICON



SA-299/SA-299M



(Identical with ASTM Specification A299/A299M-17.)

Standard Specification for Pressure Vessel Plates, Carbon Steel, Manganese-Silicon

1. Scope

- 1.1 This specification covers manganese-silicon carbon steel plates for use in welded boilers and other pressure vessels.
- 1.2 Plates under this specification are produced in two grades. The specified minimum yield strength decreases for thicknesses over 1 in. [25 mm].
- 1.3 The maximum thickness of plates is limited only by the capacity of the composition to meet the specified mechanical property requirements.
- 1.4 For plates produced from coil and furnished without heat treatment or with stress relieving only, the additional requirements, including additional testing requirements and the reporting of additional test results, of Specification A20/A20M apply.
- 1.5 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification.
- 1.6 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

- A20/A20M Specification for General Requirements for Steel Plates for Pressure Vessels
- A435/A435M Specification for Straight-Beam Ultrasonic Examination of Steel Plates
- A577/A577M Specification for Ultrasonic Angle-Beam Examination of Steel Plates
- A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applications

3. General Requirements and Ordering Information

- 3.1 Plates supplied to this product specification shall conform to Specification A20/A20M, which outlines the testing and retesting methods and procedures, permitted variations in dimensions and mass, quality and repair of defects, marking, loading, and ordering information.
- 3.2 In addition to the basic requirements of this specification, certain supplementary requirements are available where additional control, testing, or examination is required to meet end use requirements. The purchaser is referred to the listed supplementary requirements in this specification and to the detailed requirements in Specification A20/A20M.
- 3.3 Coils are excluded from qualification to this specification until they are processed into finished plates. Plates produced from coil means plates that have been cut to individual lengths from coil. The processor directly controls, or is responsible for, the operations involved in the processing of coils into finished plates. Such operations include decoiling, leveling, cutting to length, testing, inspection, conditioning, heat treatment (if applicable), packaging, marking, loading for shipment, and certification.

Note 1—For plates produced from coil and furnished without heat treatment or with stress relieving only, three test results are reported for each qualifying coil. Additional requirements regarding plates from coil are described in Specification A20/A20M.

3.4 If the requirements of this specification are in conflict with the requirements of Specification A20/A20M, the requirements of this specification shall prevail.

4. Materials and Manufacture

4.1 Steelmaking Practice—The steel shall be killed and shall conform to the fine austenitic grain size requirement of Specification A20/A20M.

TABLE 1 Chemical Requirements

Elements	Composition, %
Carbon, max: ^A	
1 in. [25 mm] and under	
Grade A	0.26
Grade B	0.28
Over 1 in. [25 mm]	
Grade A	0.28
Grade B	0.30
Manganese:	
1 in. [25 mm] and under	
Heat analysis	0.90 to 1.40
Product analysis	0.84 to 1.52
Over 1 in. [25 mm]	
Heat analysis	0.90 to 1.50
Product analysis	0.84 to 1.62
Phosphorus, max ^A	0.025
Sulfur, max ^A	0.025
Silicon:	
Heat analysis	0.15 to 0.40
Product analysis	0.13 to 0.45

^A Applies to both heat and product analyses.

5. Heat Treatment

- 5.1 Plates 2 in. [50 mm] and under in thickness are normally supplied in the as-rolled condition. Plates may be ordered normalized or stress relieved, or both.
- $5.2\,$ Plates over 2 in. [50 mm] in thickness shall be normalized.

TABLE 2 Tensile Requirements

	Grade A	Grade B
Tensile strength, ksi [MPa]	75-95 [515-655]	80-100 [550-690]
Yield strength, min, ^A ksi [MPa]:		
1 in. [25 mm] and under	42 [290]	47 [325]
Over 1 in. [25 mm]	40 [275]	45 [310]
Elongation in 8 in. [200 mm], min, % ^B	16	16
Elongation in 2 in. [50 mm], min, % ^B	19	19

 $^{^{\}it A}$ Determined by either the 0.2 % offset method or the 0.5 % extension-under-load method.

6. Chemical Composition

6.1 The steel shall conform to the requirements given in Table 1.

7. Mechanical Properties

7.1 Tension Test Requirements—The plates, as represented by the tension test specimens, shall conform to the requirements given in Table 2.

8. Keywords

8.1 carbon steel plate; pressure containing parts; pressure vessel steels; steel plates; steel plates for pressure vessel applications

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified in the purchase order.

A list of standardized supplementary requirements for use at the option of the purchaser is included in Specification A20/A20M. Those that are considered suitable for use with this specification are listed below by title.

- S1. Vacuum Treatment,
- S2. Product Analysis.
- S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons,
 - S4. Additional Tension Test,
 - S5. Charpy V-Notch Impact Test,
- S6. Drop Weight Test (for Material 0.625 in. [16 mm] and over in Thickness),
- S7. High-Temperature Tension Test,
- S8. Ultrasonic Examination in accordance with Specification A435/A435M,
 - S9. Magnetic Particle Examination,
- S11. Ultrasonic Examination in accordance with Specification A577/A577M,
- S12. Ultrasonic Examination in accordance with Specification A578/A578M.

^B See the Elongation Requirement Adjustments subsection in the Tension Tests section of Specification A20/A20M.



SPECIFICATION FOR PRESSURE VESSEL PLATES, ALLOY STEEL, MANGANESE-MOLYBDENUM AND MANGANESE-MOLYBDENUM-NICKEL



SA-302/SA-302M



(Identical with ASTM Specification A302/A302M-17.)

Standard Specification for Pressure Vessel Plates, Alloy Steel, Manganese-Molybdenum and Manganese-Molybdenum-Nickel

1. Scope

- 1.1 This specification covers manganese-molybdenum and manganese-molybdenum-nickel alloy steel plates intended particularly for welded boilers and other pressure vessels.
- 1.2 Plates under this specification are available in four grades having different strength levels as follows:

Grade	Tensile Strength, ksi [MPa]	Туре
Α	75-95 [515-655]	manganese-molybdenum
В	80-100 [550-690]	manganese-molybdenum
С	80-100 [550-690]	manganese-molybdenum-nickel
D	80-100 [550-690]	manganese-molybdenum-nickel

- 1.3 The maximum thickness of plates is limited only by the capacity of the chemical composition to meet the specified mechanical property requirements.
- 1.4 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification.
- 1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A20/A20M Specification for General Requirements for Steel Plates for Pressure Vessels
- A435/A435M Specification for Straight-Beam Ultrasonic Examination of Steel Plates
- A577/A577M Specification for Ultrasonic Angle-Beam Examination of Steel Plates
- A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applications

3. General Requirements and Ordering Information

- 3.1 Material supplied to this material specification shall conform to Specification A20/A20M. These requirements outline the testing and retesting methods and procedures, permitted variations in dimensions, and mass, quality and repair of defects, marking, loading, and ordering information.
- 3.2 In addition to the basic requirements of this specification, certain supplementary requirements are available when additional control, testing, or examination is required to meet end use requirements. The purchaser is referred to the listed supplementary requirements in this specification and to the detailed requirements in Specification A20/A20M.
- 3.3 Coils are excluded from qualification to this specification until they are processed into finished plates. Plates produced from coil means plates that have been cut to individual lengths from coil. The processor directly controls, or is responsible for, the operations involved in the processing of coils into finished plates. Such operations include decoiling, leveling, cutting to length, testing, inspection, conditioning, heat treatment (if applicable), packaging, marking, loading for shipment, and certification.

TABLE 1 Chemical Requirements

Note 1—Where "..." appears, there is no requirement.

Elements		Composition, %					
Elements	Grade A	Grade B	Grade C	Grade D			
Carbon, max: ^A							
Up to 1 in. [25 mm], incl, in thickness	0.20	0.20	0.20	0.20			
Over 1 to 2 in. [50 mm], incl	0.23	0.23	0.23	0.23			
Over 2 in. [50 mm] in thickness	0.25	0.25	0.25	0.25			
Manganese:							
Heat analysis	0.95-1.30	1.15-1.50	1.15-1.50	1.15-1.50			
Product analysis	0.87-1.41	1.07-1.62	1.07-1.62	1.07-1.62			
Phosphorus, max ^A	0.025	0.025	0.025	0.025			
Sulfur, max ^A	0.025	0.025	0.025	0.025			
Silicon:							
Heat analysis	0.15-0.40	0.15-0.40	0.15-0.40	0.15-0.40			
Product analysis	0.13-0.45	0.13-0.45	0.13-0.45	0.13-0.45			
Molybdenum:							
Heat analysis	0.45-0.60	0.45-0.60	0.45-0.60	0.45-0.60			
Product analysis	0.41-0.64	0.41-0.64	0.41-0.64	0.41-0.64			
Nickel:							
Heat analysis		•••	0.40-0.70	0.70-1.00			
Product analysis		•••	0.37-0.73	0.67-1.03			

Applies to both heat and product analyses.

TABLE 2 Tensile Requirements

	Grade A	Grade B	Grade C	Grade D
Tensile strength, ksi [MPa]	75–95 [515–655]	80-100 [550-690]	80-100 [550-690]	80–100 [550–690]
Yield strength, min, ksi [MPa]	45 [310]	50 [345]	50 [345]	50 [345]
Elongation in 8 in. [200 mm], min, % ^A	15	15	17	17
Elongation in 2 in. [50 mm], min, % ^A	19	18	20	20

^A See Specification A20/A20M for elongation adjustment.

Note 1—For plates produced from coil and furnished without heat treatment or with stress relieving only, three test results are reported for each qualifying coil. Additional requirements regarding plates from coil are described in Specification A20/A20M.

3.4 If the requirements of this specification are in conflict with the requirements of Specification A20/A20M, the requirements of this specification shall prevail.

4. Materials and Manufacture

4.1 Steelmaking Practice—The steel shall be killed and shall conform to the fine grain size requirement of Specification A20/A20M.

5. Heat Treatment

- 5.1 Plates 2 in. [50 mm] and under in thickness are normally supplied in the as-rolled condition. Plates may be ordered normalized, normalized and tempered, or stress relieved.
- 5.2 Plates over 2 in. [50 mm] in thickness shall be normalized or normalized and tempered.
- 5.3 When normalizing plates 4 in. [100 mm] or over in thickness, the cooling rate may be accelerated by air blasting or liquid quenching followed by tempering in the temperature range from 1100 to 1300°F [595 to 705°C] to obtain mechanical properties comparable to those developed by normalizing plates in the lesser thicknesses.

5.4 If approved by the purchaser, for plates less than 4 in. [100 mm] in thickness, cooling rates faster than those obtained by cooling in air are permissible for improvement of toughness, provided the plates are subsequently tempered in the temperature range from 1100 to 1300°F [595 to 705°C].

6. Chemical Composition

6.1 The steel shall conform to the chemical requirements shown in Table 1 unless otherwise modified in accordance with Supplementary Requirement S17, Vacuum Carbon-Deoxidized Steel, in Specification A20/A20M.

7. Mechanical Properties

- 7.1 Tension Test Requirements—The plates, as represented by the tension test specimens, shall conform to the requirements given in Table 2.
- 7.1.1 For accelerated cooled plates with a nominal thickness of 3 /4 in. [20 mm] or less, the 1^{1} /2-in. [40-mm] wide rectangular specimen may be used for the tension test, and the elongation may be determined in a 2-in. [50-mm] gage length that includes the fracture and that shows the greatest elongation.

8. Keywords

8.1 alloy steel plate; pressure containing parts; pressure vessel steels; steel plates; steel plates for pressure vessel applications

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified in the purchase order. A list of standardized supplementary requirements for use at the option of the purchaser is included in Specification A20/A20M. Those that are considered suitable for use with this specification are listed below by title.

- S1. Vacuum Treatment,
- S2. Product Analysis,
- S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons,
 - S4.1 Additional Tension Test,
 - S5. Charpy V-Notch Impact Test,
- S6. Drop Weight Test (for Material 0.625 in. [16 mm] and over in Thickness),
 - S7. High-Temperature Tension Test,

- S8. Ultrasonic Examination in accordance with Specification A435/A435M,
 - S9. Magnetic Particle Examination,
- S11. Ultrasonic Examination in accordance with Specification A577/A577M,
- S12. Ultrasonic Examination in accordance with Specification A578/A578M, and
 - S17. Vacuum Carbon-Deoxidized Steel.

SPECIFICATION FOR CARBON STEEL BOLTS AND STUDS, 60 000 PSI TENSILE STRENGTH



SA-307

(Identical with ASTM Specification A307-10 except for the deletion of "private label distributor" and "as appropriate" in para. 13.1.1.)

Standard Specification for Carbon Steel Bolts and Studs, 60 000 PSI Tensile Strength

1. Scope

1.1 This specification covers the chemical and mechanical requirements of three grades of carbon steel bolts and studs in sizes ½ in. through 4 in. The fasteners are designated by "Grade" denoting tensile strength and intended use, as follows:

Grade	Description
Grade A	Bolts and studs having a minimum tensile strength of 60 ksi and intended for general applications,
Grade B	Bolts and studs having a tensile strength of 60 to 100 ksi and intended for flanged joints in piping systems with
Grade C	cast iron flanges, and Replaced by Specification F1554 Gr.36

- 1.1.1 The term *studs* includes stud stock, sometimes referred to as *threaded rod*.
- 1.2 This specification does not cover requirements for machine screws, thread cutting/forming screws, mechanical expansion anchors or similar externally threaded fasteners.
- 1.3 Suitable nuts are covered in Specification A563. Unless otherwise specified, the grade and style of nut for each grade of fastener, of all surface finishes, shall be as follows:

Fastener Grade and Size	Nut Grade and Style ^A
A 1/4 to 11/2 in.	A, hex
A over 1½ to 4 in.	A, heavy hex
B, 1/4 to 4 in.	A, heavy hex

^A Nuts of other grades and styles having specified proof load stresses (Specification A563, Table 3) greater than the specified grade and style of nut are also suitable.

1.4 The values stated in inch-pound units are to be regarded as the standard.

- 1.5 Supplementary Requirement S1 of an optional nature is provided, which describes additional restrictions to be applied when bolts are to be welded. It shall apply only when specified in the inquiry, order, and contract.
- 1.6 Terms used in this specification are defined in Terminology F1789 unless otherwise defined herein.

2. Referenced Documents

- 2.1 ASTM Standards:
- A563 Specification for Carbon and Alloy Steel Nuts
- A706/A706M Specification for Low-Alloy Steel Deformed and Plain Bars for Concrete Reinforcement
- A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- B695 Specification for Coatings of Zinc Mechanically Deposited on Iron and Steel
- D3951 Practice for Commercial Packaging
- F606 Test Methods for Determining the Mechanical Properties of Externally and Internally Threaded Fasteners, Washers, Direct Tension Indicators, and Rivets
- F1470 Practice for Fastener Sampling for Specified Mechanical Properties and Performance Inspection
- F1554 Specification for Anchor Bolts, Steel, 36, 55, and 105-ksi Yield Strength
- F1789 Terminology for F16 Mechanical Fasteners
- F2329 Specification for Zinc Coating, Hot-Dip, Requirements for Application to Carbon and Alloy Steel Bolts, Screws, Washers, Nuts, and Special Threaded Fasteners
- 2.2 ASME Standards:
- B 1.1 Unified Screw Threads
- B 18.2.1 Square and Hex Bolts and Screws
- B 18.24 Part Identifying Number (PIN) Code System

2.3 SAE Standard:

J429 Mechanical and Material Requirements For Externally Threaded Fasteners

3. Ordering Information

- 3.1 Orders for externally threaded fasteners (including nuts and accessories) under this specification shall include the following:
 - 3.1.1 ASTM designation and year of issue,
- 3.1.2 Name of product, bolts or studs; and bolt head style, that is, hex or heavy hex,
- 3.1.3 Grade, that is, A, or B. If no grade is specified, Grade A is furnished.
 - 3.1.4 Quantities (number of pieces by size including nuts),
 - 3.1.5 Fastener size and length,
 - 3.1.6 Washers—Quantity and size (separate from bolts),
- 3.1.7 Zinc Coating—Specify the zinc-coating process required, for example, hot-dip, mechanically deposited, or no preference (see 4.5).
- 3.1.8 Other Finishes—Specify other protective finish, if required.
- 3.1.9 Specify if inspection at point of manufacture is required,
- 3.1.10 Specify if certified test report is required (see 8.2), and
- 3.1.11 Specify additional testing (8.3) or special requirements.
- 3.1.12 For establishment of a part identifying system, see ASME B18.24.

4. Materials and Manufacture

- 4.1 Steel for bolts and studs shall be made by the open-hearth, basic-oxygen, or electric-furnace process.
- 4.2 Bolts shall be produced by hot or cold forging of the heads or machining from bar stock.
 - 4.3 Heat Treatment:
- 4.3.1 Cold headed fasteners with head configurations other than hex having a minimum head height less than or equal to .5 D (D is nominal diameter) shall be stress relief annealed at a minimum temperature of 875°F.
- 4.3.2 Stress relieving of hex head fasteners and those with minimum head heights greater than .5 D shall be at the manufacturer's option.
 - 4.4 Bolt and stud threads shall be rolled or cut.
 - 4.5 Zinc Coatings, Hot-Dip and Mechanically Deposited:
- 4.5.1 When zinc-coated fasteners are required, the purchaser shall specify the zinc-coating process, for example hot dip, mechanically deposited, or no preference.
- 4.5.2 When hot-dip is specified, the fasteners shall be zinc-coated by the hot-dip process in accordance with the requirements of Specification F2329.

- 4.5.3 When mechanically deposited is specified, the fasteners shall be zinc-coated by the mechanical-deposition process in accordance with the requirements of Class 55 of Specification B695.
- 4.5.4 When no preference is specified, the supplier may furnish either a hot-dip zinc coating in accordance with Specification F2329, or a mechanically deposited zinc coating in accordance with Specification B695, Class 55. Threaded components (bolts and nuts) shall be coated by the same zinc-coating process and the supplier's option is limited to one process per item with no mixed processes in a lot.

5. Chemical Composition

- 5.1 Grade A and B bolts and studs shall have a heat analysis conforming to the requirements specified in Table 1 based on the steel producer's heat analysis.
- 5.2 The purchaser shall have the option of conducting product analyses on finished bolts in each lot, which shall conform to the product analysis specified in Table 1.
- 5.3 In case of conflict or for referee purposes, the product analysis shall take precedence.
- 5.4 Bolts and studs are customarily furnished from stock, in which case individual heats of steel cannot be identified.
- 5.5 Application of heats of steel to which bismuth, selenium, tellurium, or lead has been intentionally added shall not be permitted for Grade B bolts and studs.
- 5.6 Chemical analyses shall be performed in accordance with Test Methods, Practices, and Terminology A751.

6. Mechanical Properties

- 6.1 Grades A and B bolts and studs shall conform to the hardness specified in Table 2.
- 6.2 Grade A and B bolts and studs 1½ in. in diameter or less, other than those excepted in 6.4, shall be tested full size and shall conform to the requirements for tensile strength specified in Table 3.
- 6.3 Grade A and B bolts and studs larger than 1½ in. in diameter, other than those excepted in 6.4, shall preferably be tested full size and when equipment of sufficient capacity is available and shall conform to the requirements for tensile strength specified in Table 3. When equipment of sufficient capacity for full-size bolt testing is not available, or when the length of the bolt makes full-size testing impractical, machined specimens shall be tested and shall conform to the requirements specified in Table 4.

TABLE 1 Chemical Requirements for Grades A and B Bolts and Studs

	Heat Analysis	Product Analysis
Carbon, max	0.29	0.33
Manganese, max	1.20	1.25
Phosphorus, max	0.04	0.041
Sulfur, max		
Grade A	0.15	A
Grade B	0.05	0.051

^A Resulfurized steel is not subject to rejection based on product analysis for sulfur.

TABLE 2 Hardness Requirements for Bolts and Studs

Grade	Length, in.	Hardness ^A			
		Bri	Brinell		well B
		min	max	min	max
Α	Less than $3 \times dia^B$	121	241	69	100
	3 × dia and longer		241		100
В	Less than $3 \times dia^B$	121	212	69	95
	$3 \times dia$ and longer		212		95

^A As measured anywhere on the surface or through the cross section.

TABLE 3 Tensile Requirements for Full-Size Bolts and Studs

HADI	TABLE 3 Tensile Requirements for Full-Size Boits and Studs							
Bolt	Threads	Stress	Tensile Strength, lbf ^B					
Size,	per inch	Area, ^A in. ²	Grade Grad		arade B			
in.		111.	A, m	nin ^C	mi	n ^D	max	(D
1/4	20	0.0318	1	900	1	900	3	180
5/16	18	0.0524	3	100	3	100	5	240
3/8	16	0.0775	4	650	4	650	7	750
7/16	14	0.1063	6	350	6	350	10	630
1/2	13	0.1419	8	500	8	500	14	190
9/16	12	0.182	11	000	11	000	18	200
5/8	11	0.226	13	550	13	550	22	600
3/4	10	0.334	20	050	20	050	33	400
7/8	9	0.462	27	700	27	700	46	200
1	8	0.606	36	350	36	350	60	600
11/8	7	0.763	45	800	45	800	76	300
11/4	7	0.969	58	150	58	150	96	900
13⁄8	6	1.155	69	300	69	300	115	500
11/2	6	1.405	84	300	84	300	140	500
13/4	5	1.90	114	000	114	000	190	000
2	41/2	2.50	150	000	150	000	250	000
21/4	4½	3.25	195	000	195	000	325	000
21/2	4	4.00	240	000	240	000	400	000
23/4	4	4.93	295	800	295	800	493	000
3	4	5.97	358			200		000
31/4	4	7.10	426		426			000
3½	4	8.33	499	800	499	800	833	000
33/4	4	9.66	579			600		000
4	4	11.08	664			800	1 108	

^A Area calculated from the equation:

 $A_s = 0.7854 [D - (0.9743/n)]^2$

where:

6.4 Grades A and B bolts and studs less than three diameters in length or bolts with drilled or undersize heads are not subject to tensile tests.

6.5 In the event that bolts are tested by both full size and by machine test specimen methods, the full-size test shall govern if a controversy between the two methods exists.

TABLE 4 Tensile Requirements for Machined Specimens

	Grade A	Grade B
Tanaila atuanath Isai	COi	00.100
Tensile strength, ksi	60 min	60–100
Yield point, min ksi	• • •	• • •
Elongation in 2 in., min, %	18	18

6.6 For bolts and studs on which both hardness and tension tests are performed, acceptance based on tensile requirements shall take precedence in the event that there is controversy over low readings of hardness tests.

7. Dimensions

7.1 Unless otherwise specified, threads shall be the Coarse Thread Series as specified in the latest issue of ASME B1.1, and shall have a Class 2A tolerance.

7.2 Unless otherwise specified, Grade A bolts shall be hex bolts with dimensions as given in the latest issue of ASME B18.2.1. Unless otherwise specified, Grade B bolts shall be heavy hex bolts with dimensions as given in the latest issue of ASME B18.2.1.

7.3 Unless otherwise specified, bolts and studs to be used with nuts or tapped holes which have been tapped oversize, in accordance with Specification A563, shall have Class 2A threads before hot-dip or mechanically deposited zinc coating. After zinc coating the maximum limit of pitch and major diameter shall not exceed the Class 2A maximum limit by more than the following amounts:

Diameter, in.	Oversize Limit, in. (mm) ^A
1/4	0.016
5/16, 3/8	0.017
7/16, 1/2	0.018
9/16 to 3 /4, incl	0.020
7/8	0.022
1.0 to 11/4, incl	0.024
13/8, 11/2	0.027
13/4 to 4.0, incl	0.050

^A These values are the same as the overtapping required for zinc-coated nuts in Specification A563.

7.4 The gaging limit for bolts and studs shall be verified during manufacture or use by assembly of a nut tapped as nearly as practical to the amount oversize shown above. In case of dispute, a calibrated thread ring gage of that same size (Class X tolerance, gage tolerance plus) shall be used. Assembly of the gage, or the nut described above, must be possible with hand effort following application of light machine oil to prevent galling and damage to the gage. These inspections, when performed to resolve disputes, shall be performed at the frequency and quality described in Table 5.

8. Number of Tests and Retests

8.1 The requirements of this specification shall be met in continuous mass production for stock, and the manufacturer shall make sample inspections to ensure that the product conforms to the specified requirements. Additional tests of

^B Also bolts with drilled or undersize heads. These sizes and bolts with modified heads shall meet the minimum and maximum hardness as hardness is the only requirement.

 $^{^{}B}$ 1 lbf = 4.448 N.

^C Based on 60 ksi (414 MPa).

^D Based on 60-100 ksi (414-690 MPa).

TABLE 5 Sample Sizes and Acceptance Numbers for Inspection of Hot-Dip or Mechanically Deposited Zinc-Coated Threads

Lot Size	Sample Size ^A	Acceptance Number
2 to 90	13	1
91 to 150	20	2
151 to 280	32	3
281 to 500	50	5
501 to 1 200	80	7
1 201 to 3 200	125	10
3 201 to 10 000	200	14
10 001 and over	315	21

^A Inspect all bolts in the lot if the lot size is less than the sample size.

individual shipments of material are not ordinarily contemplated. Individual heats of steel are not identified in the finished product.

- 8.2 When specified in the order, the manufacturer shall furnish a test report certified to be the last completed set of mechanical tests for each stock size in each shipment.
- 8.3 When additional tests are specified on the purchase order, a lot, for purposes of selecting test samples, shall consist of all material offered for inspection at one time that has the following common characteristics:
 - 8.3.1 One type of item,
 - 8.3.2 One nominal size, and
 - 8.3.3 One nominal length of bolts and studs.
- 8.4 From each lot, the number of tests for each requirement shall be as follows:

Number of Pieces in Lot	Number of Samples
800 and under	1
801 to 8 000	2
8 001 to 22 000	3
Over 22 000	5

- 8.5 If any machined test specimen shows defective machining it shall be discarded and another specimen substituted.
- 8.6 Should any sample fail to meet the requirements of a specified test, double the number of samples from the same lot shall be tested, in which case all of the additional samples shall meet the specification.

9. Test Methods

- 9.1 Grades A and B bolts and studs shall be tested in accordance with Test Methods F606.
- 9.2 Standard square and hex head bolts only shall be tested by the wedge tension method except as noted in 6.4. Fracture shall be in the body or threads of the bolt without any fracture at the junction of the head and body. Other headed bolts shall be tested by the axial tension method.
- 9.3 Speed of testing as determined with a free running crosshead shall be a maximum of 1 in./min for the tensile strength tests of bolts.

10. Inspection

10.1 If the inspection described in 10.2 is required by the purchaser it shall be specified in the inquiry, order, or contract.

10.2 The inspector representing the purchaser shall have free entry to all parts of the manufacturer's works that concern the manufacture of the material ordered. The manufacturer shall afford the inspector all reasonable facilities to satisfy him that the material is being furnished in accordance with this specification. All tests and inspections required by the specification that are requested by the purchaser's representative shall be made before shipment, and shall be conducted as not to interfere unnecessarily with the operation of the works.

11. Responsibility

11.1 The party responsible for the fastener shall be the organization that supplies the fastener to the purchaser.

12. Rejection and Rehearing

12.1 Disposition of nonconforming lots shall be in accordance with Guide F1470, specifically sections on disposition of nonconforming lots, suppliers option, and purchasers option.

13. Product Marking

- 13.1 Grades A and B Bolts and Studs:
- 13.1.1 Bolt heads and one end of studs shall be marked with a unique identifier by the manufacturer to identify the manufacturer. Additional marking required by the manufacturer for his own use shall be at the option of the manufacturer.
- 13.1.2 In addition to the requirements of 13.1, all bolt heads, one end of studs $\frac{3}{8}$ in. and larger, and whenever feasible studs less than $\frac{3}{8}$ in. shall be marked with a grade marking as follows:

Grade	Marking
A	307A
В	307B

13.1.3 All markings shall be located on the top of the bolt head or stud end and shall be raised or depressed at the option of the manufacturer.

14. Packaging and Package Marking

- 14.1 Packaging:
- 14.1.1 Unless otherwise specified, packaging shall be in accordance with Practice D3951.
- 14.1.2 When special packaging requirements are required, they shall be defined at the time of the inquiry and order.
 - 14.2 Package Marking:
- 14.2.1 Each shipping unit shall include or be plainly marked with the following information:
 - 14.2.1.1 ASTM designation and grade,
 - 14.2.1.2 Size,
 - 14.2.1.3 Name and brand or trademark of the manufacturer,
 - 14.2.1.4 Number of pieces,
 - 14.2.1.5 Purchase order number,
 - 14.2.1.6 Country of origin.

15. Keywords

15.1 bolts; carbon steel; steel; studs

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirement shall apply only when specified in the purchase order or contract:

S1. Bolts Suitable for Welding

- S1.1 The material described in this section is intended for welding. This supplemental section, by additional chemical composition restrictions and by a carbon equivalent formula, provides assurance of weldability by chemical composition control.
- S1.2 Welding technique is of fundamental importance when bolts produced to this supplementary section are welded. It is presupposed that suitable welding procedures for the steel being welded and the intended service will be selected.
- S1.3 All of the requirements of this supplemental section apply in addition to all of the chemical, mechanical, and other requirements of the base specification, Specification A307 for Grade B.
- S1.4 Because of the embrittling effects of welding temperatures on cold-forged steel, this supplemental section is limited to hot-forged bolts, or, if not forged, then to bolts produced from hot-rolled bars without forging or threaded bars, bars studs, or stud bolts produced from hot-rolled bars without forging. Cold-forged bolts, or cold-drawn threaded bars, if they are given a thermal treatment by heating to a temperature of not less than 1500°F (815°C) and air-cooled are also suitable.
 - S1.5 Chemical Requirements:
- S1.5.1 *Heat Chemical Analysis*—Material conforming to the following additional analysis limitations shall be used to manufacture the product described in this supplementary requirement.

Carbon	0.30 %, max
Manganese	1.00 %, max
Phosphorus	0.04 %, max
Sulfur	0.05 %, max
Silicon	0.50 %, max

S1.5.2 Carbon Equivalent (Source—Specification A706/A706M)—In addition to the heat chemical analysis requirements in S1.5.1, the heat analysis shall be such as to provide a carbon equivalent (CE) not exceeding 0.55 when calculated as follows:

$$CE = \% C + \frac{\% Mn}{6} + \frac{\% Cu}{40} + \frac{\% Ni}{20} + \frac{\% Cr}{10} - \frac{\% Mo}{50} - \frac{\% V}{10}$$

- S1.6 *Analysis Reports*—If requested on the order or contract, the chemical composition of each heat of steel used and the calculated carbon equivalent for each heat shall be reported to the purchaser.
- S1.7 Product (Check) Verification Analysis—Chemical analyses when made by the purchaser or a representative on bolts from each heat of steel, shall not exceed the values specified in S1.5.2 by more than the following amounts:

	%
Carbon	+0.03
Manganese	+0.06
Phosphorus	+0.008
Sulfur	+0.008
Silicon	+0.05

S2. Permanent Manufacturer's Identification

S2.1 Replaced by Specification F1554.

S3. Permanent Grade Identification

S3.1 Replaced by Specification F1554.

SPECIFICATION FOR COLD-DRAWN, STRESS-RELIEVED CARBON STEEL BARS SUBJECT TO MECHANICAL PROPERTY REQUIREMENTS



SA-311/SA-311M

(Identical with ASTM Specification A311/A311M-04(2015) except for deletion of 5.1.11, revision of Note A to Table 1 and an editorial change to 5.1.9. Certification has been made mandatory in 11.1.)

SPECIFICATION FOR COLD-DRAWN, STRESS-RELIEVED CARBON STEEL BARS SUBJECT TO MECHANICAL PROPERTY REQUIREMENTS



SA-311/SA-311M

[Identical to ASTM Specification A 311/A 311M-04(2015) except for deletion of 5.1.11, revision of Note A to Table 1 and an editorial change to 5.1.9. Certification has been made mandatory in 11.1.]

1. Scope

- 1.1 This specification covers two classes, nine grades, and four conditions of stress-relieved cold-drawn carbon steel bars produced to mechanical property requirements. One class, B, is cold drawn with higher than normal (heavy) drafts to provide higher strength levels, and four grades provide improved machinability.
- **1.2** Supplementary Requirements, S1 through S6, of an optional nature are provided.
- 1.3 The values stated in inch-pound units or SI units are to be regarded as the standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents, therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification.

2. Referenced Documents

- 2.1 ASTM Standards:
- A 29/A 29M Specification for Steel Bars, Carbon and Alloy, Hot-Wrought and Cold-Finished, General Requirements for
- A 108 Specification for Steel Bar, Carbon and Alloy, Cold-Finished
- A 370 Test Methods and Definitions for Mechanical Testing of Steel Products
- E 527 Practice for Numbering Metals and Alloys (UNS)

3. Terminology

- **3.1** *Definitions:*
- **3.1.1** *stress relieving* heating to a suitable temperature, holding long enough to reduce residual stresses, and

then cooling slowly enough to minimize the development of new residual stresses.

- **3.2** Definitions of Terms Specific to This Standard:
- **3.2.1** heavy draft Using higher than normal drafts (approximately 10% through 35% reduction), followed by stress relieving, produces higher tensile and yield strengths provided an appropriate composition is used; for example, medium carbon with normal or higher manganese content.

4. Classification

- **4.1** The bars are furnished in the following classes and grades, and in the conditions shown in 6.4.
- **4.1.1** Class A Normal-draft cold-drawn and stress-relieved rounds, squares, hexagons, and flats in the following grades:

Grades	UNS Designations
1018	G10180
1035	G10350
1045	G10450
1050	G10500
1541	G15410
1117	G11170
1137	G11370
1141	G11410
1144	G11440

4.1.2 *Class B* — Heavy-draft cold-drawn and stress-relieved rounds and hexagons in the following grades:

Grades	UNS Designations	
1045	G10450	
1050	G10500	
1541	G15410	
1141	G11410	
1144	G11440	

5. Ordering Information

- **5.1** Orders for material under this specification should include the following information as required to adequately describe the desired material:
 - **5.1.1** Quantity (weight [mass] or number of pieces),
- **5.1.2** Name of material (carbon steel bars, cold drawn, stress relieved),
 - **5.1.3** Condition 8.3,
 - **5.1.4** Cross-sectional shape,
 - **5.1.5** Size,
 - **5.1.6** Length,
 - **5.1.7** Class and grade,
- **5.1.8** Report of heat analysis, tensile properties Section 11,
 - **5.1.9** Specification designation A 311 or A 311M,
 - 5.1.10 Application,
 - **5.1.11 DELETED**
 - **5.1.12** Supplementary requirements, if any, and
 - **5.1.13** Additional requirements, if any.

NOTE 1 — A typical ordering description is as follows: 10000 lb carbon steel bars, cold drawn, stress relieved turned and polished, round 2.0 in. (50.8 mm) Diameter, 10 to 12 ft (3048 to 3658 mm) long, Class B, Grade 1050, (UNS G10500), fine grain, test reports required, ASTM A 311/A 311M dated ______, hydraulic cylinder piston rods. [5000 kg carbon steel bars, cold drawn, stress relieved turned and polished round 50 mm diameter, 3050 to 3650 mm long, Class B, Grade 1050 (UNS G10500), fine grain, test reports required, ASTM A 311M dated ______, hydraulic cylinder piston rods.]

6. Materials and Manufacture

6.1 Melting Practice — The steel shall be made by one or more of the following primary processes: open-hearth, basic-oxygen, or electric-furnace. The primary melting may incorporate separate degassing or refining and may be followed by secondary melting using electroslag remelting or vacuum arc remelting. Where secondary melting is employed, the heat shall be defined as all of the ingots remelted from a single primary heat.

6.2 Cold Working:

- **6.2.1** Class A bars shall be cold drawn using normal drafting practices.
- **6.2.2** Class B bars shall be cold drawn using heavy (higher than normal) drafting practices.
- **6.3** Thermal Treatment After cold drawing, the bars shall be stress relieved at a temperature of not less than 550°F [288°C] to meet the mechanical requirements specified in Table 2.
- **6.4** Condition The bars shall be furnished in the following cold finish conditions, as specified:

- **6.4.1** Cold drawn, stress relieved;
- **6.4.2** Cold drawn, stress relieved, turned, and polished:
- **6.4.3** Cold drawn, stress relieved, turned, ground, and polished; and
- **6.4.4** Cold drawn, stress relieved, ground, and polished.

NOTE 2 — When turned bars are specified, turning may be performed prior to cold-drawing.

7. Chemical Composition

7.1 Composition — The cast or heat analysis shall conform to the chemical composition requirements specified in Table 1 for the grade ordered.

8. Mechanical Properties

- **8.1** Requirements The bars shall conform to the requirements listed in Table 2.
- **8.2** Number of Tests At least one tension test shall be made on each lot. A lot shall consist of bars of the same size from the same heat which have been stress relieved in the same stationary furnace charge. For continuous type of treatment, a lot shall consist of 25 tons [25 Mg] or less of the same size of each heat, treated in the same cycle.
- **8.3** Specimens Tension test specimens shall be taken longitudinally in accordance with and from the locations specified in Test Methods and Definitions A 370.
- **8.4** Test Methods Tension tests shall be made in accordance with Test Methods and Definitions A 370. The yield strength shall be determined at 0.2% offset or at 0.005 in./in. [0.005 mm/mm] of gage length, total extension under load.

9. Workmanship, Finish, and Appearance

- **9.1** Surface Finish Unless otherwise specified, the bars shall have a commercial bright smooth surface finish consistent with the cold finishing operations specified in 6.4.
- **9.2** Bars that are thermal treated after cold finishing may have a discolored or oxidized surface.
- **9.3** Oiling The bars shall be given a surface coating of oil or other rust inhibitor to protect against rust during shipment.

9.4 Workmanship — The bars shall be free of pipe, cracks, and flakes. Within the limits of good manufacturing and inspection practices, the bars shall be free of injurious seams, laps, segregation, or other imperfections that, due to their nature, degree, or extent, will interfere with the use of the material in machining or fabrication of suitable parts.

10. General Requirements

10.1 Material furnished under this specification shall conform to the requirements of the current edition of Specification A 29/A 29M and/or Specification A 108 unless otherwise stated.

11. Certification and Test Reports

11.1 A manufacturer's certification that the material was manufactured and tested in accordance with this specification together with a report of the heat analysis and tension test results shall be furnished at the time of shipment. The report shall include the name of the manufacturer, ASTM designation and year date and revision letter, if any, class and grade, heat number, size, and grain size (if requested).

12. Keywords

12.1 carbon steel bars; cold finished steel bars; steel bars

TABLE 1
CHEMICAL REQUIREMENTS
(CAST OR HEAT ANALYSIS)^A

UNS					
Designation	Grade	Carbon, %	Manganese, %	Phosphorus, max %	Sulfur, %
G10180	1018	0.15-0.20	0.60-0.90	0.040	0.050 max
G10350	1035	0.32-0.38	0.60-0.90	0.040	0.050 max
G10450	1045	0.43-0.50	0.60-0.90	0.040	0.050 max
G10500	1050	0.48 - 0.55	0.60-0.90	0.040	0.050 max
G15410	1541	0.36-0.44	1.35-1.65	0.040	0.050 max
G11170	1117	0.14-0.20	1.00-1.30	0.040	0.08-0.13
G11370	1137	0.32-0.39	1.35-1.65	0.040	0.08-0.13
G11410	1141	0.37-0.45	1.35-1.65	0.040	0.08-0.13
G11440	1144	0.40 - 0.48	1.35-1.65	0.040	0.24-0.33

^A The intentional addition of Bi, Se, Te, and Pb is not permitted.

ASME BPVC.II.A-2023

TABLE 2 MECHANICAL REQUIREMENTS

		MECHANICAL R	EQUIREWENTS	Yield Strength,	Elongation in	Reduction
UNS No.	Grade Designation	Diameter, Thickness, or Distance Between Parallel Faces, in. [mm]	Tensile Strength, min., ksi [MPa]	min., ksi [MPa]	2 in. [50 mm], min., %	of Area, min., %
		Class A — Normal Draft Cold Dra	nwn and Stress Reliev	ved Annealed		
G10180	1018	Up to $\frac{7}{8}$ [20], incl	70 [485]	60 [415]	18	40
		Over $\frac{7}{8}$ [20] to $1\frac{1}{4}$ [30], incl	65 [450]	55 [380]	16	40
		Over 1 1/4 [30] to 2 [50], incl	60 [415]	50 [345]	15	35
		Over 2 [50] to 3 [75], incl	55 [380]	45 [310]	15	35
G10350	1035	Up to $\frac{7}{8}$ [20], incl	85 [590]	75 [520]	13	35
		Over $\frac{7}{8}$ [20] to $1\frac{1}{4}$ [30], incl	80 [550]	70 [485]	12	35
		Over $1\frac{1}{4}$ [30] to 2 [50], incl	75 [520]	65 [450]	12	35
		Over 2 [50] to 3 [75], incl	70 [485]	60 [415]	10	30
G10450	1045	Up to $\frac{7}{8}$ [20], incl	95 [655]	85 [585]	12	35
		Over $\frac{7}{8}$ [20] to $1\frac{1}{4}$ [30], incl	90 [620]	80 [550]	11	30
		Over $1\frac{1}{4}$ [30] to 2 [50], incl	85 [585]	75 [520]	10	30
		Over 2 [50] to 3 [75], incl	80 [550]	70 [485]	10	30
G10500	1050	Up to $\frac{7}{8}$ [20], incl	100 [690]	90 [620]	11	35
and	and	Over $\frac{7}{8}$ [20] to $1\frac{1}{4}$ [30], incl	95 [655]	85 [585]	11	30
G15410	G1541	Over $1\frac{1}{4}$ [30] to 2 [50], incl	90 [620]	80 [550]	10	30
		Over 2 [50] to 3 [75], incl	85 [585]	75 [520]	10	30
G11170	1117	Up to $\frac{7}{8}$ [20], incl	75 [520]	65 [450]	15	40
		Over $\frac{7}{8}$ [20] to $1\frac{1}{4}$ [30], incl	70 [485]	60 [415]	15	40
		Over $1^{1}/_{4}$ [30] to 2 [50], incl	65 [450]	55 [380]	13	35
		Over 2 [50] to 3 [75], incl	60 [415]	50 [345]	12	30
G11370	1137	Up to $\frac{7}{8}$ [20], incl	95 [655]	90 [620]	11	35
and	and	Over $\frac{7}{8}$ [20] to $1\frac{1}{4}$ [30], incl	90 [620]	85 [585]	11	30
G11410	1141	Over $1^{1}/_{4}$ [30] to 2 [50], incl	85 [585]	80 [550]	10	30
		Over 2 [50] to 3 [70], incl	80 [550]	75 [520]	10	30
G11440	1144	Up to $\frac{7}{8}$ [20], incl	105 [725]	95 [655]	10	30
		Over $\frac{7}{8}$ [20] to $1\frac{1}{4}$ [30], incl	100 [690]	90 [620]	10	30
		Over $1\frac{1}{4}$ [30] to 2 [50], incl	95 [655]	85 [585]	10	25
		Over 2 [50] to 3 [70], incl	90 [620]	80 [550]	10	20
		Over 3 [70] to $4\frac{1}{2}$ [115], incl	85 [585]	75 [520]	10	20
		Class B — Heavy Draft Cold Draw	wn and Stress Reliev	ed Annealed		
				Yield Strength,	Elongation in	Reduction
UNS	Grade		Tensile Strength,	min., ksi	2 in. [50 mm],	of Area,
No.	Designation	In. [mm], Round or Hexagon ⁴	min., ksi [MPa]	[MPa]	min., %	min., %
G10450	1045	Up to $\frac{7}{8}$ [20] incl	115 [795]	100 [690]	10	25
		Over $\frac{7}{8}$ [20] to $1\frac{1}{4}$ [30], incl	115 [795]	100 [690]	10	25
		Over $1\frac{1}{4}$ [30] to 2 [50], incl	115 [795]	100 [690]	10	25
		Over 2 [50] to 3 [75], incl	115 [795]	100 [690]	9	25
		Over 3 [75] to 4 [102], incl	105 [725]	90 [620]	7	20
G10500	1050	Up to $\frac{7}{8}$ [20], incl	115 [795]	100 [690]	8	25
G15410	1541	Over $\frac{7}{8}$ [20] to $1\frac{1}{4}$ [30], incl	115 [795]	100 [690]	8	25
G11410	1141	Over $1\frac{1}{4}$ [30] to 2 [50], incl	115 [795]	100 [690]	8	25
and	and	Over 2 [50] to 3 [75], incl	115 [795]	100 [690]	8	20
G11440	1144	Over 3 [75] to $4\frac{1}{2}$ [115], incl	115 [795]	100 [690]	7	20

 $^{^{\}it A}$ Maximum size for hexagons is 1 $^{1}\!\!/_{\!\!2}$ in. [40 mm].

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall apply only when specified by the purchaser in the inquiry or order. Details of these requirements shall be agreed upon between the manufacturer and the purchaser.

S1. Special Surface

S1.1 When inspection standards more restrictive than visual inspection are required, special surface may be specified

S2. Restricted Cast or Heat Analysis

S2.1 When required, the purchaser may specify restrictive cast or heat analysis limits on one or more elements. The degree of restriction and the number of elements so restricted are both subject to agreement between the manufacturer and the purchaser.

S3. Restricted Decarburization

S3.1 The purchaser may specify a maximum affected depth of decarburization when required for special applications, subject to agreement between the manufacturer and the purchaser.

S4. Nonmetallic Inclusion Requirements (Microscopical)

S4.1 When nonmetallic inclusion requirements are specified, the samples for testing shall be taken on a longitudinal direction midway between the center and the surface of the material. The area of the sample to be examined

should be agreed upon between the purchaser and the manufacturer, and the test specimen should be hardened by heating and quenched before being polished to avoid pits. The rating of the inclusion count should also be agreed upon and be based upon examination at a magnification of 100 diameters. Resulfurized steels are not subject to inclusion ratings.

S5. Restricted Incidental Elements

S5.1 The purchaser may specify limiting maximum requirements for copper, nickel, chromium, or molybdenum subject to agreement between the manufacturer and the purchaser.

S6. Grain Size

- **S6.1** The steel shall conform to either the coarse austenitic grain size (except as stated in S6.2), or the fine austenitic grain size requirement of Specification A 29/A 29M.
- **S6.2** Certain elements, or combinations of elements, such as manganese, sulfur, and lead tend to produce grain refinement and it is technically inappropriate to ensure coarse grain size as measured by the McQuaid-Ehn test on high manganese, high sulfur, and leaded steels such as 1144, 1151, and 11L41.

SPECIFICATION FOR SEAMLESS, WELDED, AND HEAVILY COLD WORKED AUSTENITIC STAINLESS STEEL PIPES



SA-312/SA-312M

(Identical with ASTM Specification A312/A312M-18a except for the revision to para. 6.2 to add "H" grade heat treatment requirements.)

Specification for Seamless, Welded, and Heavily Cold Worked Austenitic Stainless Steel Pipes

1. Scope

1.1 This specification covers seamless, straight-seam welded, and heavily cold worked welded austenitic stainless steel pipe intended for high-temperature and general corrosive service.

Note 1—When the impact test criterion for a low-temperature service would be 15 ft·lbf [20 J] energy absorption or 15 mils [0.38 mm] lateral expansion, some of the austenitic stainless steel grades covered by this specification are accepted by certain pressure vessel or piping codes without the necessity of making the actual test. For example, Grades TP304, TP304L, and TP347 are accepted by the ASME Pressure Vessel Code, Section VIII Division 1, and by the Chemical Plant and Refinery Piping Code, ASME B31.3, for service at temperatures as low as -425 °F [-250 °C] without qualification by impact tests. Other AISI stainless steel grades are usually accepted for service temperatures as low as -325 °F [-200 °C] without impact testing. Impact testing may, under certain circumstances, be required. For example, materials with chromium or nickel content outside the AISI ranges, and for material with carbon content exceeding 0.10 %, are required to be impact tested under the rules of ASME Section VIII Division 1 when service temperatures are lower than -50 °F [-45 °C].

- 1.2 Grades TP304H, TP309H, TP309HCb, TP310H, TP310HCb, TP316H, TP321H, TP347H, and TP348H are modifications of Grades TP304, TP309Cb, TP309S, TP310Cb, TP310S, TP316, TP321, TP347, and TP348, and are intended for service at temperatures where creep and stress rupture properties are important.
- 1.3 Optional supplementary requirements are provided for pipe where a greater degree of testing is desired. These supplementary requirements call for additional tests to be made and, when desired, it is permitted to specify in the order one or more of these supplementary requirements.
- 1.4 Table X1.1 lists the standardized dimensions of welded and seamless stainless steel pipe as shown in ASME B36.19. These dimensions are also applicable to heavily cold worked pipe. Pipe having other dimensions is permitted to be ordered

and furnished provided such pipe complies with all other requirements of this specification.

- 1.5 Grades TP321 and TP321H have lower strength requirements for pipe manufactured by the seamless process in nominal wall thicknesses greater than 3/s in. [9.5 mm].
- 1.6 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.

Note 2—The dimensionless designator NPS (nominal pipe size) has been substituted in this standard for such traditional terms as "nominal diameter," "size," and "nominal size."

1.7 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A262 Practices for Detecting Susceptibility to Intergranular Attack in Austenitic Stainless Steels
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys
- A999/A999M Specification for General Requirements for Alloy and Stainless Steel Pipe
- A1016/A1016M Specification for General Requirements for Ferritic Alloy Steel, Austenitic Alloy Steel, and Stainless Steel Tubes
- E112 Test Methods for Determining Average Grain Size

E381 Method of Macroetch Testing Steel Bars, Billets, Blooms, and Forgings

E527 Practice for Numbering Metals and Alloys in the Unified Numbering System (UNS)

2.2 ASME Standards:

B1.20.1 Pipe Threads, General Purpose

B36.10M Welded and Seamless Wrought Steel Pipe

B36.19 Stainless Steel Pipe

ASME Boiler and Pressure Vessel Code: Section VIII

2.3 AWS Standard:

A5.9 Corrosion-Resisting Chromium and Chromium-Nickel Steel Welding Rods and Electrodes

2.4 Other Standard:

SAE J1086 Practice for Numbering Metals and Alloys (UNS)

3. Terminology

- 3.1 Definitions:
- 3.1.1 The definitions in Specification A999/A999M and Terminology A941 are applicable to this specification.

4. Ordering Information

4.1 Orders for material to this specification shall conform to the requirements of the current edition of Specification A999/A999M.

5. General Requirements

5.1 Material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A999/A999M unless otherwise provided herein.

6. Materials and Manufacture

- 6.1 Manufacture:
- 6.1.1 The pipe shall be manufactured by one of the following processes:
- 6.1.2 Seamless (SML) pipe shall be made by a process that does not involve welding at any stage of production.
- 6.1.3 Welded (WLD) pipe shall be made using an automatic welding process with no addition of filler metal during the welding process.
- 6.1.4 Heavily cold-worked (HCW) pipe shall be made by applying cold working of not less than 35% reduction in thickness of both wall and weld to a welded pipe prior to the final anneal. No filler shall be used in making the weld. Prior to cold working, the weld shall be 100% radiographically inspected in accordance with the requirements of ASME Boiler and Pressure Vessel Code, Section VIII, Division 1, latest revision, Paragraph UW-51.
- 6.1.5 Welded pipe and HCW pipe of NPS 14 and smaller shall have a single longitudinal weld. Welded pipe and HCW pipe of a size larger than NPS 14 shall have a single longitudinal weld or shall be produced by forming and welding two longitudinal sections of flat stock when approved by the purchaser. All weld tests, examinations, inspections, or treatments shall be performed on each weld seam.

- 6.1.6 At the option of the manufacturer, pipe shall be either hot finished or cold finished.
- 6.1.7 The pipe shall be free of scale and contaminating exogenous iron particles. Pickling, blasting, or surface finishing is not mandatory when pipe is bright annealed. The purchaser is permitted to require that a passivating treatment be applied to the finished pipe.
- 6.2 Heat Treatment—All pipe shall be furnished in the heat-treated condition in accordance with the requirements of Table 2. Other than for Grades S33228, S30815, S31272, and the H Grades, seamless pipe immediately following hot forming may be individually quenched by water or rapidly cooled by other means, provided that the temperature of the pipes after hot forming is not less than the minimum specified solution treatment temperature in Table 2. For H Grades, as well as Grades S33228, S30815, and S31272, the pipes shall be reheated to the specified solution treatment for the required time before quenching.

7. Chemical Composition

7.1 The steel shall conform to the requirements as to chemical composition prescribed in Table 1.

8. Product Analysis

8.1 At the request of the purchaser, an analysis of one billet or one length of flat-rolled stock from each heat, or two pipes from each lot shall be made by the manufacturer. A lot of pipe shall consist of the following number of lengths of the same size and wall thickness from any one heat of steel:

NPS Designator Lengths of Pipe in Lot Under 2 400 or fraction thereof 2 to 5 200 or fraction thereof 6 and over 100 or fraction thereof

- 8.2 The results of these analyses shall be reported to the purchaser or the purchaser's representative, and shall conform to the requirements specified in Section 7.
- 8.3 If the analysis of one of the tests specified in 8.1 does not conform to the requirements specified in Section 7, an analysis of each billet or pipe from the same heat or lot may be made, and all billets or pipe conforming to the requirements shall be accepted.

9. Permitted Variations in Wall Thickness

9.1 In addition to the implicit limitation of wall thickness for seamless pipe imposed by the limitation on weight in Specification A999/A999M, the wall thickness for seamless and welded pipe at any point shall be within the tolerances specified in Table 3, except that for welded pipe the weld area shall not be limited by the "Over" tolerance. The wall thickness and outside diameter for inspection for compliance with this requirement for pipe ordered by NPS and schedule number is shown in Table X1.1.

10. Tensile Requirements

 $10.1\,$ The tensile properties of the material shall conform to the requirements prescribed in Table 4.

TABLE 1 Continued

	Т							IAL		ONUNU									
	UNS		ı		1				T	npositio T	n, % ² T	T		1	1	ı	I	ı	
Grade	Desig- nation ^A	Carbon	Manga- nese	Phos- phorus	Sulfur	Silicon	Chrom- ium	Nickel	Molyb- denum	Tita- nium	Niobium ^M	Tanta- lum, max	Nitro- gen ^C	Vana- dium	Copper	Cerium	Boron	Alum- inum	Other
TP309HCb	S30941	0.04– 0.10	2.00	0.045	0.030	1.00	22.0– 24.0	12.0- 16.0	0.75		10 × C min, 1.10 max								
	S31002	0.015	2.00	0.020	0.015	0.15	24.0– 26.0	19.0– 22.0	0.10		1.10 max		0.10						
TP310S	S31008	0.08	2.00	0.045	0.030	1.00	24.0– 26.0	19.0– 22.0	0.75										
TP310H	S31009	0.04- 0.10	2.00	0.045	0.030	1.00	24.0– 26.0	19.0– 22.0											
	S31035	0.04– 0.10	0.60	0.025	0.015	0.40	21.5– 23.5	23.5– 26.5			0.40- 0.60		0.20– 0.30		2.5– 3.5		0.002- 0.008		W 3.0– 4.0 Co 1.0–
TP310Cb	S31040	0.08	2.00	0.045	0.030	1.00	24.0– 26.0	19.0– 22.0	0.75		10 × C min, 1.10 max								2.0
TP310HCb	S31041	0.04– 0.10	2.00	0.045	0.030	1.00	24.0– 26.0	19.0– 22.0	0.75		10 × C min, 1.10 max								
	S31050	0.025	2.00	0.020	0.015	0.4	24.0- 26.0	20.5– 23.5	1.6- 2.6				0.09– 0.15						
	S31254	0.020	1.00	0.030	0.010	0.80	19.5– 20.5	17.5– 18.5	6.0– 6.5				0.18– 0.25		0.50- 1.00				
	S31266	0.030	2.00- 4.00	0.035	0.020	1.00	23.0- 25.0	21.0- 24.0	5.2- 6.2				0.35– 0.60		1.00- 2.50				W 1.50- 2.50
	S31272 S31277	0.08– 012 0.020	1.5- 2.00 3.00	0.030	0.015	0.25- 0.75 0.50	14.0– 16.0 20.5–	14.0– 16.0 26.0–	1.00- 1.40 6.5-	0.30- 0.60			0.30-		0.50-		0.004- 0.008		
TD010	001000	0.00	0.00	0.045	0.000	1.00	23.0	28.0	8.0				0.40		1.50				
TP316	S31600	0.08	2.00	0.045	0.030	1.00	16.0– 18.0	10.0– 14.0	3.00										
TP316L	S31603	0.035 ^D	2.00	0.045	0.030	1.00	16.0– 18.0	10.0– 14.0	2.00- 3.00										
TP316H	S31609	0.04– 0.10	2.00	0.045	0.030	1.00	16.0– 18.0	10.0– 14.0	2.00- 3.00										
TP316Ti	S31635	0.08	2.00	0.045	0.030	0.75	16.0– 18.0	10.0– 14.0	2.00- 3.00	5× (C+N) –0.70			0.10						
TP316N	S31651	0.08	2.00	0.045	0.030	1.00	16.0– 18.0	10.0– 14.0	2.00- 3.00				0.10– 0.16						
TP316LN	S31653	0.035	2.00	0.045	0.030	1.00	16.0– 18.0	10.0– 14.0	2.00- 3.00				0.10- 0.16						
	S31655	0.030	2.00	0.045	0.015	1.00	19.5– 21.5	8.0– 9.5	0.50– 1.50				0.16 0.14– 0.25		1.00				
TP317	S31700	0.08	2.00	0.045	0.030	1.00	18.0– 20.0	11.0– 15.0	3.0- 4.0										

TABLE 1 Continued

										npositio	n, % ^B								
Grade	UNS Desig- nation ^A	Carbon	Manga- nese	Phos- phorus	Sulfur	Silicon	Chrom- ium	Nickel	Molyb- denum	Tita- nium	Niobium ^M	Tanta- lum, max	Nitro- gen ^C	Vana- dium	Copper	Cerium	Boron	Alum- inum	Other
TP317L	S31703	0.035	2.00	0.045	0.030	1.00	18.0-	11.0-	3.0-										
	S31725	0.03	2.00	0.040 ^E	0.030	1.00	20.0 18.0– 20.0	15.0 13.5– 17.5	4.0 4.0– 5.0				0.10		0.75				
	S31726	0.03	2.00	0.040 ^E	0.030	1.00	17.0– 20.0	13.5– 17.5	4.0- 5.0				0.10- 0.20		0.75				
	S31727	0.03	1.00	0.030	0.030	1.00	17.5– 19.0	14.5– 16.5	3.8- 4.5				0.15– 0.21		2.8- 4.0				
• • •	S31730	0.030	2.00	0.040	0.010	1.00	17.0– 19.0	15.0– 16.5	3.0- 4.0				0.045		4.0- 5.0				
	S32053	0.03	1.00	0.030	0.010	1.00	22.0– 24.0	24.0– 26.0	5.0– 6.0				0.17– 0.22						
TP321	S32100	0.08	2.00	0.045	0.030	1.00	17.0– 19.0	9.0– 12.0		F			0.10						
TP321H	S32109	0.04– 0.10	2.00	0.045	0.030	1.00	17.0– 19.0	9.0– 12.0		4(C+N) min; 0.70 max			0.10						
	S32615	0.07	2.00	0.045	0.030	4.8– 6.0	16.5– 19.5	19.0– 22.0	0.30- 1.50						1.50- 2.50				
	S32654	0.020	2.0- 4.0	0.030	0.005	0.50	24.0– 25.0	21.0- 23.0	7.0– 8.0				0.45– 0.55		0.30- 0.60				
	S33228	0.04– 0.08	1.00	0.020	0.015	0.30	26.0– 28.0	31.0– 33.0			0.60- 1.00					0.05– 0.10		0.025	
• • •	S34565	0.03	5.0– 7.0	0.030	0.010	1.00	23.0– 25.0	16.0– 18.0	4.0– 5.0		0.10		0.40– 0.60						
TP347	S34700	0.08	2.00	0.045	0.030	1.00	17.0– 19.0	9.0– 13.0			G								
TP347H	S34709	0.04– 0.10	2.00	0.045	0.030	1.00	17.0– 19.0	9.0– 13.0			Н								
TP347LN	S34751	0.005– 0.020	2.00	0.045	0.030	1.00	17.0– 19.0	9.0– 13.0			0.20- 0.50 [/]		0.06– 0.10						
TP348	S34800	0.08	2.00	0.045	0.030	1.00	17.0– 19.0	9.0– 13.0			G	0.10							
TP348H	S34809	0.04– 0.10	2.00	0.045	0.030	1.00	17.0– 19.0	9.0– 13.0			н	0.10							
	S35045	0.10 0.06– 0.10	1.50		0.015	1.00	25.0– 29.0	32.0– 37.0		0.15- 0.60					0.75			0.15– 0.60	
	S35315	0.04– 0.08	2.00	0.040	0.030	1.20- 2.00	24.0– 26.0	34.0– 36.0					0.12– 0.18			0.03– 0.08			
TPXM-15	S38100	0.08	2.00	0.030	0.030	1.50- 2.50	17.0– 19.0	17.5– 18.5											
	S38815	0.030	2.00	0.040	0.020	5.5– 6.5	13.0– 15.0	15.0– 17.0	0.75– 1.50						0.75– 1.50			0.30	

TABLE 1 Continued

	UNS								Cor	npositio	n, % ^B								
Grade	Desig- nation ^A	Carbon	Manga- nese	Phos- phorus	Sulfur	Silicon	Chrom- ium	Nickel	Molyb- denum	Tita- nium	Niobium ^M	Tanta- lum, max	Nitro- gen ^C	Vana- dium	Copper	Cerium	Boron	Alum- inum	Other
Alloy 20	N08020	0.07	2.00	0.045	0.035	1.00	19.0-	32.0-	2.0-		L	L			3.0-				
							21.0	38.0	3.0						4.0				
	N08028	0.030	2.50	0.030	0.030	1.0	26.0-	30.0-	3.0-						0.60-				
							28.0	34.0	4.0						1.4				
	N08029	0.020	2.0	0.025	0.015	0.6	26.0-	30.0-	4.0-						0.6-				
							28.0	34.0	5.0						1.4				
	N08367	0.030	2.00	0.040	0.030	1.00	20.0-	23.5-	6.0-				0.18–		0.75				
							22.0	25.5	7.0				0.25						
800	N08800	0.10	1.50	0.045	0.015	1.00	19.0– 23.0	30.0– 35.0							0.75			0.15- 0.60	Fe ^J 39.5 min.
800H	N08810	0.05-	1.50	0.045	0.015	1.00	19.0-	30.0-		0.15-					0.75			0.15-	Fe ^J
		0.10					23.0	35.0		0.60								0.60	39.5 min.
	N08811	0.06-	1.50	0.045	0.015	1.00	19.0-	30.0-		0.15-					0.75			0.15-	Fe ^J
		0.10					23.0	35.0		0.60 ^K								0.60 ^K	39.5 min.
	N08904	0.020	2.00	0.040	0.030	1.00	19.0–	23.0-	4.0-				0.10		1.00-				
							23.0	28.0	5.0						2.00				
	N08925	0.020	1.00	0.045	0.030	0.50	19.0-	24.0-	6.0-				0.10-		0.80-				
	Nooooc	0,000	0.00	0.000	0.010	0.50	21.0	26.0	7.0				0.20		1.50				
	N08926	0.020	2.00	0.030	0.010	0.50	19.0– 21.0	24.0– 26.0	6.0– 7.0				0.15– 0.25		0.50- 1.50				
							21.0	20.0	7.0				0.25		1.50				

^A New designation established in accordance with Practice E527 and SAE J1086.

^B Maximum, unless otherwise indicated. Where elipses (...) appear in this table, there is no requirement and analysis for the element need not be determined or reported.

^C The method of analysis for nitrogen shall be a matter of agreement between the purchaser and manufacturer.

^D For small diameter or thin walls or both, where many drawing passes are required, a carbon maximum of 0.040 % is necessary in grades TP304L and TP316L. Small outside diameter tubes are defined as those less than 0.500 in. [12.7 mm] in outside diameter and light wall tubes as those less than 0.049 in. [1.20 mm] in average wall thickness (0.044 in. [1.10 mm] in minimum wall thickness).

^E For welded pipe, the phosphorus maximum shall be 0.045 %.

FTi $5 \times (C+N)$ min, 0.70 max.

^G The niobium content shall be not less than ten times the carbon content and not more than 1.00 %.

^HThe niobium content shall be not less than eight times the carbon content and not more than 1.0 %.

¹ Grade S34751 shall have a niobium content of not less than 15 times the carbon content.

^{&#}x27;Iron shall be determined arithmetically by difference of 100 minus the sum of the other specified elements.

^KAI + Ti shall be 0.85 % min; 1.20 % max.

^LNiobium (Nb) + Tantalum = 8 × Carbon min, 1.00 max.

^MThe terms Niobium (Nb) and Columbium (Cb) are alternate names for the same element.

TABLE 2 Annealing Requirements

IADLE 2 A	ilinealing Requirement	S
Grade or UNS Designation ^A	Heat Treating Temperature ^B	Cooling/Testing Requirements
All grades not individually listed	1900 °F [1040 °C]	С
below:		
TP321H, TP347H, TP348H		
Cold finished	2000 °F [1100 °C]	D
Hot finished	1925 °F [1050 °C]	D
TP304H, TP316H		
Cold finished	1900 °F [1040 °C]	D
Hot finished	1900 °F [1040 °C]	D
TP309H, TP309HCb, TP310H, TP310HCb	1900 °F [1040 °C]	D
S30600	2010-2140 °F	D
	[1100-1170 °C]	
S30601	2010–2140 °F	D
	[1100-1170 °C]	
S30815, S31272	1920 °F [1050 °C]	D
S31035	2160–2280 °F	D
00.000	[1180–1250 °C]	
S31254, S32654	2100 °F [1150 °C]	D
S31266	2100 °F [1150 °C]	D
S31277	2050 °F [1120 °C]	D
S31727, S32053	1975–2155 °F	D
33.72., 332333	[1080-1180 °C]	
S33228	2050–2160 °F	D
000220	[1120–1180 °C]	
S34565	2050–2140 °F	D
00-300	[1120–1170 °C]	
S35315	2010 °F [1100 °C]	D
S38815	1950 °F [1065 °C]	D
N08367	2025 °F [1110 °C]	D
N08020	1700–1850 °F	D
1400020	[925–1010 °C]	
N08028	2000 °F [1100 °C]	D
N08029	2000 °F [1100 °C]	D
N08810	2050 °F [1120 °C]	D
N08811	2100 °F [1150 °C]	D
N08904	2000 °F [1100 °C]	D
N08925, N08926	2010–2100 °F	D
1100325, 1100320	[1100–1150 °C]	
	[1100-1150 [0]	

A New designation established in accordance with Practice E527 and SAE J1086.
B Minimum, unless otherwise stated.

11. Mechanical Tests, Grain Size Determinations, and Weld Decay Tests Required

11.1 Mechanical Testing Lot Definition—The term lot for mechanical tests shall be as follows:

11.1.1 Where the final heat treated condition is obtained, consistent with the requirements of 6.2, in a continuous furnace, by quenching after hot forming or in a batch-type furnace equipped with recording pyrometers and automatically controlled within a 50 °F [30 °C] or lesser range, the term *lot* for mechanical tests shall apply to all pipes of the same specified outside diameter and specified wall thickness (or schedule) that are produced from the same heat of steel and subjected to the same finishing treatment within the same operating period.

TABLE 3 Permitted Variations in Wall Thickness

	Tolerance,	% from Nominal
NPS Designator	Over	Under
1/8 to 21/2 incl., all t/D ratios	20.0	12.5
3 to 18 incl., t/D up to 5 % incl.	22.5	12.5
3 to 18 incl., t/D > 5 %	15.0	12.5
20 and larger, welded, all t/D ratios	17.5	12.5
20 and larger, seamless, t/D up to 5 % incl.	22.5	12.5
20 and larger, seamless, t/D > 5 %	15.0	12.5

where:

t = Nominal Wall Thickness

D = Ordered Outside Diameter

11.1.2 Where the final heat treated condition is obtained, consistent with the requirements of 6.2, in a batch-type furnace not equipped with recording pyrometers and automatically controlled within a 50 °F [30 °C] or lesser range, the term *lot* shall apply to the larger of: (a) each 200 ft [60 m] or fraction thereof and (b) those pipes heat treated in the same furnace batch charge for pipes of the same specified outside diameter and specified wall thickness (or schedule) that are produced from the same heat of steel and are subjected to the same finishing temperature within the same operating period.

11.2 Transverse or Longitudinal Tension Test—One tension test shall be made on a specimen for lots of not more than 100 pipes. Tension tests shall be made on specimens from two tubes for lots of more than 100 pipes.

11.3 Flattening Test—For material heat treated in a continuous furnace, by quenching after hot forming or in a batch-type furnace equipped with recording pyrometers and automatically controlled within a 50 °F [30 °C] or lesser range, flattening tests shall be made on a sufficient number of pipe to constitute 5 % of the lot, but in no case less than 2 lengths of pipe. For material heat treated in a batch-type furnace not equipped with recording pyrometers and automatically controlled within a 50 °F [30 °C] or lesser range, flattening tests shall be made on 5 % of the pipe from each heat treated lot.

11.3.1 For welded pipe a transverse-guided face bend test of the weld may be conducted instead of a flattening test in accordance with the method outlined in the steel tubular product supplement of Test Methods and Definitions A370. For welded pipe with a specified wall thickness over 3/8 in., two side bend tests may be made instead of the face bend test. The ductility of the weld shall be considered acceptable when there is no evidence of cracks in the weld or between the weld and the base metal after bending. Test specimens from 5 % of the lot shall be taken from the pipe or test plates of the same material as the pipe, the test plates being attached to the end of the cylinder and welded as a prolongation of the pipe longitudinal seam.

11.4 *Grain Size*—Grain size determinations, in accordance with Test Methods E112, shall be made on the grades listed in Table 5. Grain size determinations shall be made on each heat

^C Quenched in water or rapidly cooled by other means, at a rate sufficient to prevent re-precipitation of carbides, as demonstrable by the capability of pipes, heat treated by either separate solution annealing or by direct quenching, of passing Practices A262, Practice E. The manufacturer is not required to run the test unless it is specified on the purchase order (see Supplementary Requirement S7). Note that Practices A262 requires the test to be performed on sensitized specimens in the low-carbon and stabilized types and on specimens representative of the as-shipped condition for other types. In the case of low-carbon types containing 3 % or more molybdenum, the applicability of the sensitizing treatment prior to testing shall be a matter for negotiation between the seller and the

purchaser.

^D Quenched in water or rapidly cooled by other means.

TABLE 4 Tensile Requirements

		<u> </u>	
Grade	UNS	Tensile	Yield
	Designation	Strength, min	Strength, min
	2 congriculor.	-	-
		ksi [MPa]	ksi [MPa]
TP201	S20100	75 [515]	38 [260]
TP201LN	S20153	95 [655]	45 [310]
	S20400	95 [635]	48 [330]
TPXM-19	S20910	100 [690]	55 [380]
TPXM-10	S21900	90 [620]	50 [345]
TPXM-11	S21904	90 [620]	50 [345]
TPXM-29	S24000	100 [690]	55 [380]
TP304	S30400	75 [515]	30 [205]
TP304L	S30403	70 [485]	25 [170]
TP304H	S30409	75 [515]	30 [205]
	S30415	87 [600]	42 [290]
TDOGAN			
TP304N	S30451	80 [550]	35 [240]
TP304LN	S30453	75 [515]	30 [205]
	S30600	78 [540]	35 [240]
	S30601	78 [540]	37 [255]
	S30615	90 [620]	40 [275]
	S30815		
		87 [600]	45 [310]
TP309S	S30908	75 [515]	30 [205]
TP309H	S30909	75 [515]	30 [205]
TP309Cb	S30940	75 [515]	30 [205]
TP309HCb	S30941	75 [515]	30 [205]
	S31002	73 [500]	30 [205]
TP310S	S31008	75 [515]	30 [205]
TP310H	S31009	75 [515]	30 [205]
	S31035	95 [655]	45 [310]
TD0400F			
TP310Cb	S31040	75 [515]	30 [205]
TP310HCb	S31041	75 [515]	30 [205]
	S31050:		
	001000.	0.4 [500]	00 [070]
$t \le 0.250 \text{ in.}$		84 [580]	39 [270]
[6.35 mm]			
t > 0.250 in.		78 [540]	37 [255]
		70 [340]	07 [200]
[6.35 mm]			
	S31254:		
$t \le 0.187 \text{ in. } [5.00 \text{ mm}]$		98 [675]	45 [310]
t > 0.187 in. [5.00 mm]		95 [655]	45 [310]
	S31266	109 [750]	61 [420]
	S31272	65 [450]	29 [200]
	S31277	112 [770]	52 [360]
TP316	S31600	75 [515]	30 [205]
TP316L	S31603	70 [485]	25 [170]
TP316H	S31609	75 [515]	30 [205]
	S31635	75 [515]	30 [205]
TP316N			
	S31651	80 [550]	35 [240]
TP316LN	S31653	75 [515]	30 [205]
	S31655	92 [635]	45 [310]
TP317			
	S31700	75 [515]	30 [205]
TP317L	S31703	75 [515]	30 [205]
	S31725	75 [515]	30 [205]
	S31726	80 [550]	35 [240]
	S31727	80 [550]	36 [245]
	S31730	70 [480]	25 [175]
	000050	00 10 101	40 [00=]
111.	\$32053	93 [640]	43 [295]
TP321	S32100:		
Welded		75 [515]	30 [205]
Seamless:		- [1	1
		75 (545)	00 [00=]
$t \leq 0.375$ in.		75 [515]	30 [205]
[9.50 mm]			
t > 0.375 in.		70 [485]	25 [170]
		70 [405]	23 [170]
[9.50 mm]			
TP321H	S32109:		
Welded		75 [515]	30 [205]
		75 [515]	30 [203]
Seamless:			
t ≤ 0.375 in.		75 [515]	30 [205]
[9.50 mm]			
t > 0.375 in.		70 [480]	25 [170]
[9.50 mm]			
	S32615	80 [EEU]	ຊວ [ວວດາ
• • •		80 [550]	32 [220]
	S32654	109 [750]	62 [430]
	S33228	73 [500]	27 [185]
	S34565	115 [795]	60 [415]
TP347	S34700	75 [515]	30 [205]
TP347H	S34709	75 [515]	30 [205]
TP347LN	S34751	75 [515]	30 [205]
		· · · · · · · · · · · · · · · · · · ·	· · · · · · · · · · · · · · · · · · ·

TABLE 4 Continued

Grade	UNS	Tensile	Yield
Grade	Designation	Strength, min	Strength, min
	Designation	ksi [MPa]	ksi [MPa]
TP348	S34800	75 [515]	30 [205]
TP348H	S34809	75 [515]	30 [205]
	S35045	70 [485]	25 [170]
	S35315		
Welded		94 [650]	39 [270]
Seamless		87 [600]	38 [260]
TPXM-15	S38100	75 [515]	30 [205]
	S38815	78 [540]	37 [255]
Alloy 20	N08020	80 [550]	35 [240]
	N08028	73 [500]	31 [214]
	N08029	73 [500]	31 [214]
	N08367:		
$t \le 0.187 \text{ in.}$		100 [690]	45 [310]
[5.00 mm]			
t > 0.187 in.		95 [655]	45 [310]
[5.00 mm]			
800	N08800		
	cold-worked	75 [515]	30 [205]
	annealed		
	hot finished annealed	65 [450]	25 [170]
800H	N08810	65 [450]	25 [170]
	N08811	65 [450]	25 [170]
	N08904	71 [490]	31 [215]
	N08925	87 [600]	43 [295]
	N08926	94 [650]	43 [295]
Elongation	n in 2 in. or	Longi-	Trans-
50 mm (or	4D), min, %	tudinal	verse
All Grades except S31	050 and S32615	35	25
S32615, S31050		25	
S31277, N08925, N08028, N08029		40	
N08367, N08020, N08800, N08810,		30	
N08811			

TABLE 5 Grain Size Requirements

	·	
Grade	UNS Designation	Grain Size
	N08810	5 or coarser
	N08811	5 or coarser
TP304H	S30409	7 or coarser
TP309H	S30909	6 or coarser
TP309HCb	S30940	6 or coarser
TP310H	S31009	6 or coarser
TP310HCb	S31041	6 or coarser
TP316H	S31609	7 or coarser
TP321H	S32109	7 or coarser
	S32615	3 or finer
TP347H	S34709	7 or coarser
TP348H	S34809	7 or coarser

treatment lot, as defined in 11.1, for the same number of pipes as prescribed for the flattening test in 11.3. The grain size results shall conform to the requirements prescribed in Table 5.

11.5 HCW pipe shall be capable of passing the weld decay tests listed in Supplementary S9 with a weld metal to base metal loss ratio of 0.90 to 1.1. The test is not required to be performed unless S9 is specified in the purchase order.

12. Hydrostatic or Nondestructive Electric Test

12.1 Each pipe shall be subjected to the nondestructive electric test or the hydrostatic test. The type of test to be used

shall be at the option of the manufacturer, unless otherwise specified in the purchase order.

- 12.2 The hydrostatic test shall be in accordance with Specification A999/A999M, unless specifically exempted under the provisions of 12.3.
- 12.3 For pipe whose dimensions equal or exceed NPS10, the purchaser, with the agreement of the manufacturer, is permitted to waive the hydrostatic test requirement when in lieu of such test the purchaser performs a system test. Each length of pipe furnished without the completed manufacturer's hydrostatic test shall include with the mandatory markings the letters "NH."
- 12.4 The nondestructive electric test shall be in accordance with Specification A999/A999M.

13. Lengths

- 13.1 Pipe lengths shall be in accordance with the following regular practice:
- 13.1.1 Unless otherwise agreed upon, all sizes from NPS ½ to and including NPS 8 are available in a length up to 24 ft with the permitted range of 15 to 24 ft. Short lengths are acceptable and the number and minimum length shall be agreed upon between the manufacturer and the purchaser.
- 13.1.2 If definite cut lengths are desired, the lengths required shall be specified in the order. No pipe shall be under the specified length and no pipe shall be more than ½ in. [6 mm] over the specified length.
 - 13.1.3 No jointers are permitted unless otherwise specified.

14. Workmanship, Finish, and Appearance

14.1 The finished pipes shall be reasonably straight and shall have a workmanlike finish. Removal of imperfections by grinding is permitted, provided the wall thicknesses are not decreased to less than that permitted in the Permissible Variations in Wall Thickness section of Specification A999/A999M.

15. Repair by Welding

- 15.1 For welded pipe whose diameter equals or exceeds NPS 6, and whose nominal wall thickness equals or exceeds 0.200, it is permitted to make weld repairs to the weld seam with the addition of compatible filler metal using the same procedures specified for plate defects in the section on Repair by Welding of Specification A999/A999M.
- $15.2\,$ Weld repairs of the weld seam shall not exceed $20\,\%$ of the seam length.
- 15.3 Weld repairs shall be made only with the gas tungstenarc welding process using the same classification of bare filler rod qualified to the most current AWS Specification A5.9 as the grade of stainless steel pipe being repaired and as shown in Table 6. Alternatively, subject to approval by the purchaser, weld repairs shall be made only with the gas tungsten-arc welding process using a filler metal more highly alloyed than the base metal when needed for corrosion resistance or other properties.
- 15.4 Pipes that have had weld seam repairs with filler metal shall be uniquely identified and shall be so stated and identified

TABLE 6 Pipe and Filler Metal Specification

Pipe		Filler Metal	
Grade	UNS	AWS A5.9	UNS Designation
	Designation	Class	
TP201	S20100		
TP201LN	S20153		
TP304	S30400	ER308	S30800, W30840
TP304L	S30403	ER308L	S30883, W30843
TP304N	S30451	ER308	S30880, W30840
TP304LN	S30453	ER308L	S30883, W30843
TP304H	S30409	ER308	S30880, W30840
	S30601		
TP309Cb	S30940		
TP309S	S30908		
TP310Cb	S31040		
TP310S	S31008		
	S31266	ERNiCrMo-4	N10276
		ERNiCrMo-10	N06022
		ERNiCrMo-13	N06059
		ERNiCrMo-14	N06686
		ERNiCrMo-17	N06200
	S31272		
TP316	S31600	ER316	S31680, W31640
TP316L	S31603	ER316L	S31683, W31643
TP316N	S31651	ER316	S31680, W31640
TP316LN	S31653	ER316L	S31683, W31643
	S31655		
TP316H	S31609	ER316H	S31680, W31640
• • •	S31730	ERNiCr-3, or ERNiCrMo-3,	N06082, N06625, N10276
		or	
TDOOL	000400	ERNiCrMo-4	000100 11100110
TP321	S32100	ER321	S32180, W32140
TD0 47	004700	ER347	S34780, W34740
TP347	S34700	ER347	S34780, W34740
TP348	S34800	ER347	S34780, W34740
TPXM-19	S22100	ER209	S20980, W32240
TPXM-29	S28300	ER240	S23980, W32440
Allow 20	N08367 N08020	ER320	N06625 N08021
Alloy 20	1100020	ER320LR	N08021
	N08028	ER383	N08028
	N08028	ERNiCrMo-3 ^A	N06625
	1400029	ERNiCrMo-13 ^A	N06059
	S20400	ER209	S20980, W32240
800	N08800	ERNiCr-3 ^A	N06082
800H	N08810	ERNiCr-3 ^A	N06082
55011	N08811	ERNiCr-3 ^A	N06082
	N08925		N06625
	N08926		N06625
	1400320		1100023

AAWS A5.14 Class.

on the certificate of tests. When filler metal other than that listed in Table 6 is used, the filler metal shall be identified on the certificate of tests.

16. Certification

16.1 In addition to the information required by Specification A999/A999M, the certification shall state whether or not the material was hydrostatically tested. If the material was nondestructively tested, the certification shall so state and shall state which standard practice was followed and what reference discontinuities were used.

17. Marking

17.1 In addition to the marking specified in Specification A999/A999M, the marking shall include the NPS (nominal pipe size) or outside diameter and schedule number or average wall thickness, heat number, and NH when hydrotesting is not

performed and ET when eddy-current testing is performed or UT when ultrasonic testing is performed. The marking shall also include the manufacturer's private identifying mark, the marking requirement of 12.3, if applicable, and whether seamless (SML), welded (WLD), or heavily cold-worked (HCW). For Grades TP304H, TP316H, TP321H, TP347H, TP348H, and S30815, the marking shall also include the heat number and heat-treatment lot identification. If specified in the purchase order, the marking for pipe larger than NPS 4 shall include the weight.

18. Government Procurement

- 18.1 Scale Free Pipe for Government Procurement:
- 18.1.1 When specified in the contract or order, the following requirements shall be considered in the inquiry, contract or order, for agencies of the U.S. Government where scale free pipe or tube is required. These requirements shall take precedence if there is a conflict between these requirements and the product specifications.
- 18.1.2 The requirements of Specification A999/A999M for pipe and Specification A1016/A1016M for tubes shall be applicable when pipe or tube is ordered to this specification.
- 18.1.3 Pipe and tube shall be one of the following grades as specified herein:

Grade	UNS Designation
TP304	S30400
TP304L	S30403
TP304N	S30451
TP316	S31600
TP316L	S31603
TP316N	S31651
TP317	S31700

TP317L	S31703
TP321	S32100
TP347	S34700

18.1.4 Part Number:

Example: ASTM A312/A312M Pipe 304 NPS 12 SCH 40S SMLS

Specification Number	ASTM A312
Pipe	Р
Grade	304
NPS	12
Wall	0.375
SMLS OR WELDED	SML

18.1.4.1

Specification Number	ASTM A312
Tube	T
Grade	304
Outside Diameter	0.250
Wall	0.035
SMLS OR WELDED	WLD

- 18.1.5 *Ordering Information*—Orders for material under this specification shall include the following in addition to the requirements of Section 4:
 - 18.1.5.1 Pipe or tube,
 - 18.1.5.2 Part number,
 - 18.1.5.3 Ultrasonic inspection, if required,
- 18.1.5.4 If shear wave test is to be conducted in two opposite circumferential directions,
 - 18.1.5.5 Intergranular corrosion test, and
 - 18.1.5.6 Level of preservation and packing required.

19. Keywords

19.1 austenitic stainless steel; seamless steel pipe; stainless steel pipe; steel pipe; welded steel pipe

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall apply only when specified in the purchase order. The purchaser may specify a different frequency of test or analysis than is provided in the supplementary requirement. Subject to agreement between the purchaser and manufacturer, retest and retreatment provisions of these supplementary requirements may also be modified.

S1. Product Analysis

- S1.1 For all pipe NPS 5 and larger in nominal size there shall be one product analysis made of a representative sample from one piece for each ten lengths or fraction thereof from each heat of steel.
- S1.2 For pipe smaller than NPS 5 there shall be one product analysis made from ten lengths per heat of steel or from 10 % of the number of lengths per heat of steel, whichever number is smaller.
- S1.3 Individual lengths failing to conform to the chemical requirements specified in Section 7 shall be rejected.

S2. Transverse Tension Tests

- S2.1 There shall be one transverse tension test made from one end of $10\,\%$ of the lengths furnished per heat of steel. This requirement is applicable only to pipe NPS 8 and larger.
- S2.2 If a specimen from any length fails to conform to the tensile properties specified that length shall be rejected.

S3. Flattening Test

S3.1 The flattening test of Specification A999/A999M shall be made on a specimen from one end or both ends of each pipe. Crop ends may be used. If this supplementary requirement is specified, the number of tests per pipe shall also be specified. If a specimen from any length fails because of lack of ductility prior to satisfactory completion of the first step of the flattening test requirement, that pipe shall be rejected subject to retreatment in accordance with Specification A999/A999M and satisfactory retest. If a specimen from any length of pipe fails because of a lack of soundness that length shall be rejected, unless subsequent retesting indicates that the remaining length is sound.

S4. Etching Tests

S4.1 The steel shall be homogeneous as shown by etching tests conducted in accordance with the appropriate portions of Method E381. Etching tests shall be made on a cross section

from one end or both ends of each pipe and shall show sound and reasonably uniform material free of injurious laminations, cracks, and similar objectionable defects. If this supplementary requirement is specified, the number of tests per pipe required shall also be specified. If a specimen from any length shows objectionable defects, the length shall be rejected, subject to removal of the defective end and subsequent retests indicating the remainder of the length to be sound and reasonably uniform material.

S5. Radiographic Examination

S5.1 The entire length of weld in each double welded pipe shall be radiographically examined, using X-radiation, in accordance with Paragraph UW-51 of Section VIII Division 1 of the ASME Boiler and Pressure Vessel Code. In addition to the marking required by Section 13 each pipe shall be marked "RT" after the specification and grade. Requirements of S5 shall be required in the certification.

S6. Stabilizing Heat Treatment

S6.1 Subsequent to the solution anneal required in 6.2, Grades TP309HCb, TP310HCb, TP321, TP321H, TP347, TP347H, TP348, and TP348H shall be given a stabilization heat treatment at a temperature lower than that used for the initial solution annealing heat treatment. The temperature of stabilization heat treatment shall be as agreed upon between the purchaser and vendor.

S7. Intergranular Corrosion Test

- S7.1 When specified, material shall pass intergranular corrosion tests conducted by the manufacturer in accordance with Practices A262, Practice E.
- S7.1.1 Practice E requires testing on the sensitized condition for low carbon or stabilized grades, and on the as-shipped condition for other grades. The applicability of this test and the preparation of the sample for testing for grades containing greater than 3 % molybdenum shall be as agreed by the purchaser and manufacturer.

Note S7.1—Practice E requires testing on the sensitized condition for low carbon or stabilized grades, and on the as-shipped condition for other grades.

S7.2 A stabilization heat treatment in accordance with Supplementary Requirement S6 may be necessary and is permitted in order to meet this requirement for the grades containing titanium or columbium, particularly in their H versions.

S8. Minimum Wall Pipe

S8.1 When specified by the purchaser, pipe shall be furnished on a minimum wall basis. The wall of such pipe shall not fall below the thickness specified. In addition to the marking required by Section 17, the pipe shall be marked S8.

S9. Weld Decay Test

S9.1 When specified in the purchase order, one sample from each lot of pipe shall be subject to testing in a boiling solution of 50 % reagent grade hydrochloric acid and 50 % water.

S9.2 The sample, of approximately 2-in. [50-mm] length, shall be prepared from a production length of pipe. Depending on the size of the pipe, it is permitted to section the sample longitudinally to allow it to fit in the Erlenmeyer flask. As a minimum, the tested sample shall include the entire weld and adjacent area and the full length of base metal 180° across from the weld. All burrs and sharp edges shall be removed by light grinding. Dust and grease shall be removed by cleaning with soap and water or other suitable solvents.

S9.3 The hydrochloric acid solution shall be prepared by slowly adding reagent grade (approximately 37 %) hydrochloric acid to an equal volume of distilled water.

Warning—Protect eyes and use rubber gloves when handling acid. Mixing and testing shall be performed in a protective enclosure.

S9.4 The test container shall be a 1–L Erlenmeyer flask equipped with ground-glass joints and an Ahline condenser. The volume of the solution shall be approximately 700 mL.

S9.5 The thickness of the weld and the base metal 180° from the weld shall be measured near both ends of the sample. These measurements shall be made with a micrometer with an anvil shape suitable for measuring the thickness with an accuracy to at least 0.001 in. [0.025 mm].

S9.6 The sample sections, both weld and base metal, shall be immersed in the flask containing the solution. Boiling chips shall be added and the solution brought to a boil. Boiling shall be maintained through the duration of the test. The time of testing shall be that which is required to remove 40 to 60 % of the original base metal thickness (usually 2 h or less). If more than 60 % of the base metal thickness remains, it is permitted to terminate the test after 24 h.

S9.7 At the end of the test period, the samples shall be removed from the solution, rinsed with distilled water, and dried.

S9.8 The thickness measurements as in S9.5 shall be repeated. The anvil shape of the micrometer used shall be suitable for measuring the minimum remaining thickness with an accuracy to at least 0.001 in. [0.025 mm].

S9.9 The corrosion ratio, R, shall be calculated as follows:

$$R = (W_0 - W)/(B_0 - B)$$

where:

 W_0 = average weld-metal thickness before the test,

W = average weld-metal thickness after the test,

 B_0 = average base-metal thickness before the test, and

B = average base-metal thickness after the test,

S9.9.1 The corrosion ratio for HCW pipe shall be as specified in 11.5.

S9.9.2 The corrosion ratio shall be 1.25 or less, or as further restricted in the purchase order, when the weld decay test is specified for welded (WLD) pipe.

APPENDIX

(Nonmandatory Information)

X1. DIMENSIONS OF WELDED AND SEAMLESS STAINLESS STEEL PIPE

X1.1 Table X1.1 is based on Table number 1 of the American National Standard for stainless steel pipe (ASME B36.19) but not identical.

TABLE X1.1 Dimensions of Welded and Seamless Stainless Steel Pipe

Note 1—The decimal thickness listed for the respective pipe sizes represents their nominal or average wall dimensions.

NPS	Outside I	Diameter	Nominal Wall Thickness							
Designator	in.	mm	Schedule 5S ²	ı	Schedule	10S ^A	Schedu	le 40S	Schedu	ule 80S
			in.	mm	in.	mm	in.	mm	in.	mm
1/8	0.405	10.3			0.049	1.24	0.068	1.73	0.095	2.41
1/4	0.540	13.7			0.065	1.65	0.088	2.24	0.119	3.02
3/8	0.675	17.1			0.065	1.65	0.091	2.31	0.126	3.20
1/2	0.840	21.3	0.065	1.65	0.083	2.11	0.109	2.77	0.147	3.73
3/4	1.050	26.7	0.065	1.65	0.083	2.11	0.113	2.87	0.154	3.91
1	1.315	33.4	0.065	1.65	0.109	2.77	0.133	3.38	0.179	4.55
11/4	1.660	42.2	0.065	1.65	0.109	2.77	0.140	3.58	0.191	4.85
11/2	1.900	48.3	0.065	1.65	0.109	2.77	0.145	3.68	0.200	5.08
2	2.375	60.3	0.065	1.65	0.109	2.77	0.154	3.91	0.218	5.54
21/2	2.875	73.0	0.083	2.11	0.120	3.05	0.203	5.16	0.276	7.01
3	3.500	88.9	0.083	2.11	0.120	3.05	0.216	5.49	0.300	7.62
31/2	4.000	101.6	0.083	2.11	0.120	3.05	0.226	5.74	0.318	8.08
4	4.500	114.3	0.083	2.11	0.120	3.05	0.237	6.02	0.337	8.56
5	5.563	141.3	0.109	2.77	0.134	3.40	0.258	6.55	0.375	9.53
6	6.625	168.3	0.109	2.77	0.134	3.40	0.280	7.11	0.432	10.97
8	8.625	219.1	0.109	2.77	0.148	3.76	0.322	8.18	0.500	12.70
10	10.750	273.1	0.134	3.40	0.165	4.19	0.365	9.27	0.500^{B}	12.70 ^B
12	12.750	323.9	0.156	3.96	0.180	4.57	0.375 ^B	9.53 ^B	0.500^{B}	12.70 ^B
14	14.000	355.6	0.156	3.96	0.188 ^B	4.78 ^B	0.375 ^B	9.53 ^B	0.500^{B}	12.70 ^B
16	16.000	406.4	0.165	4.19	0.188 ^B	4.78^{B}	0.375 ^B	9.53 ^B	0.500^{B}	12.70 ^B
18	18.000	457	0.165	4.19	0.188 ^B	4.78 ^B	0.375^{B}	9.53 ^B	0.500^{B}	12.70 ^B
20	20.000	508	0.188	4.78	0.218 ^B	5.54 ^B	0.375^{B}	9.53 ^B	0.500^{B}	12.70 ^B
22	22.000	559	0.188	4.78	0.218 ^B	5.54 ^B				
24	24.000	610	0.218	5.54	0.250	6.35	0.375^{B}	9.53 ^B	0.500^{B}	12.70 ^B
30	30.000	762	0.250	6.35	0.312	7.92				

^A Schedules 5S and 10S wall thicknesses do not permit threading in accordance with the American National Standard for Pipe Threads (ASME B1.20.1). ^B These do not conform to the American National Standard for Welded and Seamless Wrought Steel Pipe (ASME B36.10M).



SPECIFICATION FOR ALLOY-STEEL AND STAINLESS STEEL BOLTING FOR LOW-TEMPERATURE SERVICE



SA-320/SA-320M



(23)

(Identical with ASTM Specification A320/A320M-22.)

Specification for Alloy-Steel and Stainless Steel Bolting for Low-Temperature Service

1. Scope

- 1.1 This specification covers alloy and stainless steel bolting materials and bolting components for pressure vessels, valves, flanges, and fittings for low-temperature service. See Specification A962/A962M for the definition of bolting. The bars shall be hot-wrought and may be further processed by centerless grinding or by cold drawing. Austenitic stainless steel may be solution annealed or annealed and strainhardened. When strain hardened austenitic stainless steel is ordered, the purchaser should take special care to ensure that Appendix X1 is thoroughly understood.
- 1.2 Several grades are covered, including both ferritic and austenitic steels designated L7, B8, etc. Selection will depend on design, service conditions, mechanical properties, and low-temperature characteristics. The mechanical requirements of Table 1 indicate the diameters for which the minimum mechanical properties apply to the various grades and classes, and Table 2 stipulates the requirements for Charpy impact energy absorption. The manufacturer should determine that the material can conform to these requirements before parts are manufactured. For example, when Grade L43 is specified to meet the Table 2 impact energy values at –150 °F [–101 °C], additional restrictions (such as procuring a steel with lower P and S contents than might normally be supplied) in the chemical composition for AISI 4340 are likely to be required.

Note 1—The committee formulating this specification has included several grades of material that have been rather extensively used for the present purpose. Other compositions will be considered for inclusion by the committee from time to time as the need becomes apparent. Users should note that hardenability of some of the grades mentioned may restrict the maximum size at which the required mechanical properties are obtainable.

- 1.3 The following referenced general requirements are indispensable for application of this specification: Specification A962/A962M.
- 1.4 Nuts for use with bolting are covered in Section 10 and the nut material shall be impact tested.
- 1.5 Supplementary Requirements are provided for use at the option of the purchaser. The supplementary requirements shall apply only when specified in the purchase order or contract.
- 1.6 This specification is expressed in both inch-pound units and SI units; however, unless the purchase order or contract specifies the applicable *M* specification designation (SI) units, the inch-pound units shall apply.
- 1.7 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.8 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A194/A194M Specification for Carbon Steel, Alloy Steel, and Stainless Steel Nuts for Bolts for High Pressure or High Temperature Service, or Both
- A962/A962M Specification for Common Requirements for Bolting Intended for Use at Any Temperature from Cryogenic to the Creep Range
- E566 Practice for Electromagnetic (Eddy Current/Magnetic Induction) Sorting of Ferrous Metals

TABLE 1 Mechanical Requirements

Class and Grade, Diameter, in. [mm]	Heat Treatment	Minimum Tempering Temperature, °F [°C]	Tensile Strength, min, ksi [MPa]	Yield Strength, min, ksi [MPa] (0.2 % offset)	Elongation in 2 in. or 50 mm, min, %	Reduction of Area, min, %	Hardness, max
		Ferritic Steels					
L7, L7A, L7B, L7C, L70, L71, L72, L73			125	105	16	50	321 HBW or 35 HRC
2½ [65] and under ⁴	quenched and tempered	1100 [593]	[860]	[725]			
L43		[223]	125	105	16	50	321 HBW or 35 HRC
4 [100] and under ⁴	quenched and tempered	1100 [593]	[860]	[725]			
L7M		[500]	100	80	18	50	235 HBW ^B or 99 HRB
2½ [65] and under ^A	quenched and tempered	1150 [620]	[690]	[550]			
L1		11	125	105	16	50	
1 [25] and under ^A	quenched and tempered		[860]	[725]			
		Austenitic Steels ^C					
Class 1: B8, B8C, B8M, B8P,	carbide solution treated		75	30	30	50	223 HBW ^D or 96 HRB
B8F, B8T, B8LN, B8MLN, all diameters			[515]	[205]	00	50	
Class 1A: B8A, B8CA, B8MA, B8PA, B8FA, B8TA, B8LNA, B8MLNA, all diameters	carbide solution treated in the finished condition		75 [515]	30 [205]	30	50	192 HBW or 90 HRB
Class 2: B8, B8C, B8P, B8F, B8T:	carbide solution treated and strain hardened						
3/4 [20] and under	Hardened		125	100	12	35	321 HBW or 35
/4 [20] and and			[860]	[690]		00	HRC
over 3/4 to 1 [20 to 25], incl			115	80	15	35	321 HBW or 35
, , , , , , , , , , , , , , , , , , ,			[795]	[550]			HRC
over 1 to 11/4 [25 to 32], incl			105	65	20	35	321 HBW or 35
			[725]	[450]			HRC
over $1\frac{1}{4}$ to $1\frac{1}{2}$ [32 to 40], incl ^A			100	50	28	45	321 HBW or 35
Class 2: B8M:	carbide solution treated and strain		[690]	[345]			HRC
	hardened						
3/4 [20] and under			110	95	15	45	321 HBW or 35
0/ 1 4 500 1 053 1 1			[760]	[655]		45	HRC
over 3/4 to 1 [20 to 25], incl			100	80	20	45	321 HBW or 35
over 1 to 11/. [95 to 99] incl			[690]	[550]	05	45	HRC
over 1 to 11/4 [25 to 32], incl			95 [655]	65 [450]	25	45	321 HBW or 35 HRC
over 11/4 to 11/2 [32 to 40], incl ^A			[655] 90	[450] 50	30	45	321 HBW or 35
0v6i 1/4 to 1/2 [02 to 40], illo			[620]	[345]	30	40	HRC

A These upper diameter limits were established on the basis that these were the largest sizes commonly available that consistently met specification property limits. They are not intended as absolute limits beyond which bolting materials could no longer be certified to the specification.

^B To meet the tensile requirements, the Brinell hardness shall not be less than 200 HBW or 93 HRB.

^C Class 1 products are made from solution-treated material. Class 1A products are solution treated in the finished condition for corrosion resistance; heat treatment is critical for enhancing this physical property and meeting the mechanical property requirements. Class 2 products are made from solution-treated material that has been strain hardened. Austenitic steels in the strain-hardened condition may not show uniform properties throughout the cross section, particularly in sizes over ¾ in. [20 mm] in diameter.

^D For sizes ¾ in. [20 mm] in diameter and smaller, a maximum hardness of 241 HBW (100 HRB) is permitted.

TABLE 2 Impact	Test Tem	peratures a	nd Properties
-----------------------	-----------------	-------------	---------------

Grade	Test Tem	perature	CVN Specimen Section Size, mm	Min Average Impact Toughness of Three Test Specimens, ft-lbf [J]	Min Impact Value of a Single Specimen of Set of Three, ft-lbf [J]
	°F	°C			
			10 × 10	20 [27]	15 [20]
L7M, L70, L71, L72, L73	-100	-73	10 × 7.5	16 [22]	12 [16]
			10 × 10	20 [27]	15 [20]
L7, L7A, L7B, L7C, L43	-150	-101	10 × 7.5	16 [22]	12 [16]
			10 × 10	40 [54]	30 [41]
L1	-100	-73	10 × 7.5	32 [44]	24 [32]

F436/F436M Specification for Hardened Steel Washers Inch and Metric Dimensions

F606/F606M Test Methods for Determining the Mechanical Properties of Externally and Internally Threaded Fasteners, Washers, Direct Tension Indicators, and Rivets 2.2 ASME Standards:

B1.1 Screw Threads

B18.21.1 Washers: Helical Spring-Lock, Tooth Lock, and Plain Washers (Inch Series)

3. Ordering Information

- 3.1 It is the purchaser's responsibility to specify in the purchase order all information necessary to purchase the needed materials. Examples of such information include, but are not limited to, the following:
 - 3.1.1 Quantity and size,
- 3.1.2 Heat-treated condition, that is, for the austenitic stainless steels, solution-treated (Class 1); solution-treated after finishing (Class 1A); and annealed and strain-hardened (Class 2),
- 3.1.3 Description of items required (bars, bolts, screws, or studs),
- 3.1.4 Nuts and washers, if required by the purchaser, in accordance with Section 10, and
- 3.1.5 Special requirements, in accordance with 5.1.1, 5.1.3, 5.1.4, and 13.1.

4. Common Requirements

4.1 Bolting materials and bolting components supplied to this specification shall conform to the requirements of Specification A962/A962M. These requirements include test methods, finish, thread dimensions, macroetch (carbon and alloy steels only) marking, certification, optional supplementary requirements, and others. Failure to comply with the requirements of Specification A962/A962M constitutes nonconformance with this specification. In case of conflict between the requirements in this specification and Specification A962/A962M, this specification shall prevail.

5. Materials and Manufacture

- 5.1 Heat Treatment:
- 5.1.1 Bolting materials shall be allowed to cool to room temperature after rolling or forging. Grades L7, L7A, L7B, L7C, L7M, L43, L1, L70, L71, L72, and L73 shall be reheated

to above the upper critical temperature and liquid quenched and tempered. Grades B8, B8C, B8M, B8T, B8F, B8P, B8LN, and B8MLN shall receive a carbide solution treatment. Products made from such material are described as Class 1. This shall consist of holding the bolting material for a sufficient time at a temperature at which the chromium carbide will go into solution and then cooling in air or in a liquid medium at a rate sufficient to prevent reprecipitation of the carbide. Bolting material thus treated is described as Class 1. If specified in the purchase order, bolting material shall be solution treated in the finished condition and shall be described as Class 1A.

- 5.1.2 Use of water quenching is prohibited for any ferritic grade when heat treatment is performed after heading or threading.
- 5.1.3 When increased mechanical properties are desired, austenitic bolting shall be solution annealed and strain hardened if specified in the purchase order; material so treated is identified as Class 2.
- 5.1.4 If scale-free bright finish is required, this shall be specified in the purchase order.
- 5.1.5 For L7M bolting, the final heat treatment, which may be the tempering or stress-relieving operation conducted at 1150 °F [620 °C] minimum, shall be done after machining or rolling of the threads and any type of cutting.

6. Mechanical Requirements

- 6.1 Tensile Properties:
- 6.1.1 Bolting material as represented by the tension specimens shall conform to the requirements as to tensile properties prescribed in Table 1 at room temperature after heat treatment (see 5.1.1). Alternatively, Class 2 Strain Hardened Headed Bolting Components shall be tested full size after strain hardening to determine tensile strength and yield strength and shall conform to the requirements prescribed in Table 1. Should the results of full size tests conflict with results of tension specimen tests, full size test results shall prevail.
 - 6.1.2 Number of Tests:
- 6.1.2.1 For heat-treated bars, one tension test and one impact test consisting of three specimens shall be made for each diameter of each heat represented in each tempering charge. When heat treated without interruption in continuous furnaces, the material in a lot shall be the same heat, same prior condition, same size, and subjected to the same heat treatment. Not fewer than two tensile tests and two impact tests are required for each lot containing 20 000 lbs [9000 kg] or less. Every additional 10 000 lbs [4500 kg] or fraction thereof requires an additional tensile test and impact test.

6.1.2.2 For studs, bolts, screws, etc., one tension test and one set of three impact specimens shall be made for each diameter of each heat involved in the lot. Each lot shall consist of the following:

Diameter, in. [mm]

Lot Size, lb [kg]

1½ [30] and under

Over 1½ [30] to 1¾ [45], incl

Over 1¾ [45] to 2½ [65], incl

Over 2½ [65]

Diameter, in. [mm]

Lot Size, lb [kg]

4500 [680] or fraction thereof

6000 [2700] or fraction thereof

100 pieces or fraction thereof

6.1.2.3 Full Size Specimens, Headed Bolting Components—Headed bolts or screws 1 ½ in. in body diameter and smaller, with body length three times the diameter or longer, and that are produced by upsetting or forging (hot or cold) shall be subjected to full size testing in accordance with 6.1.3. This testing shall be in addition to tensile testing as specified in 6.1.1. Wedge tensile testing shall be limited to product with socket head cap screw, hexagon, square, hex flange, or twelve point flange heads. The lot size shall be shown in 6.1.2.2. Failure shall occur in the body or threaded section with no failure, or indications of failure, such as cracks, at the junction of the head and shank. Wedge tensile testing is not required for flat countersunk head or socket button products.

6.1.3 Full Size Bolting Components, Wedge Tensile Testing—When applicable, see 6.1.2.3. Headed components shall be wedge tested full size. The minimum full size load applied (lbf or kN) for individual sizes shall be as follows:

$$W = T_s \times A_t \tag{1}$$

where:

W = minimum wedge tensile load without fracture,

 T_s = tensile strength specified in ksi or MPa in Tables 2 and 3, and

A_t = stress area of the thread section, square inches or square millimetres, as shown in the Cone Proof Load Tables in Specification A962/A962M.

6.2 Impact Properties:

6.2.1 Requirements:

6.2.1.1 Impact tests are required for the grades shown in Table 3. Class 1, 1A, and 2 austenitic steels for temperatures above –325 °F [–200 °C]; Class 1 and 1A austenitic Grades B8, B8A, B8P, B8PA, B8C, B8CA, B8LN, and B8LNA above –425 °F [–255 °C]; and ferritic or austenitic bolting ½ in. [12.5 mm] and smaller, are exempt from impact testing, unless Supplementary Requirement S1 is specified in the purchase order (see 1.4). All other material furnished under this specification shall be tested. Material of Grades L7, L7A, L7B, L7C, L7M, L43, L70, L71, L72, and L73 shall show a minimum impact energy absorption of 20 ft · lbf [27 J] and of Grade L1 a minimum impact energy absorption of 40 ft · lbf [54 J] at the specified test temperature.

6.2.1.2 The temperature of the coolant used for chilling the test specimens shall be controlled within ± 2 °F [1 °C]. Test temperatures for ferritic grades are listed in Table 2. Exceptions to this requirement are permissible, and the impact tests may be made at specified temperatures different than those shown in Table 2, provided the test temperature is at least as low as the intended service temperature and the bolting is

suitably marked to identify the reported test temperature. When impact testing is required for austenitic grades, test criteria shall be agreed upon between the supplier and purchaser.

6.2.1.3 The impact test requirements for standard and subsize Charpy V-notch (CVN) test specimens are prescribed in Table 2. If the material is impact tested at a temperature lower than the specified test temperature with impact energy absorption results equal to or greater than the specified required impact energy absorption for that product, the material can be considered suitable for the specified test temperature.

Note 2—As an example, the purchase order or contract requires an L-grade bolt to have an average 15 ft-lbs at $-50\,^{\circ}$ F. If the Charpy V-notch testing indicates that the bolting material passes at $-100\,^{\circ}$ F and if it also meets other mechanical property or other environmental resistance requirements, it is permissible or suitable for use if that specified temperature reflects the minimum anticipated temperature range to which that the product or application will be subjected.

6.2.2 Number of Tests:

6.2.2.1 The test requirements for heat-treated bars are given in 6.1.2.1.

6.2.2.2 For test requirements on studs, bolts, screws, etc., see 6.1.2.2.

6.2.2.3 Impact tests are not required to be made on heat-treated bars, bolts, screws, studs, and stud bolts $\frac{1}{2}$ in. [12.5 mm] and under in diameter.

6.2.3 *Test Specimens*—For sections 1 in. [25 mm] or less in diameter, test specimens shall be taken at the axis; for sections over 1 in. [25 mm] in diameter, midway between the axis and the surface.

6.3 Hardness Requirements:

6.3.1 The hardness shall conform to the requirements prescribed in Table 1. Hardness testing shall be performed in accordance with either Specification A962/A962M or with Test Methods F606/F606M.

6.3.2 The maximum hardness of Grade L7M shall be 235 HBW or 99 HRB. Minimum hardness shall not be less than 200 HBW or 93 HRB. Conformance to this hardness shall be ensured by testing each bolt or stud by Brinell or Rockwell B methods in accordance with 6.3.1.

6.3.2.1 The use of 100 % electromagnetic testing for hardness as an alternative to 100 % indentation hardness testing is permissible when qualified by sampling using indentation hardness testing. Each lot tested for hardness electromagnetically shall be 100 % examined in accordance with Practice E566. Following electromagnetic testing for hardness, a random sample of a minimum of 100 pieces in each purchase lot (as defined in 6.1.2.2) shall be tested by indentation hardness methods. All samples must meet hardness requirements to permit acceptance of the lot. If any one sample is outside of the specified maximum or minimum hardness, the lot shall be rejected and either reprocessed and resampled, or tested 100 % by indentation hardness methods.

6.3.2.2 In the event a controversy exists relative to minimum strength, tension tests shall prevail over hardness readings. Products which have been tested and found acceptable shall have a line under the grade symbol.

TABLE 3 Chemical Requirements (Composition, %)^A

Туре				TABLE 3 C		Requiremen Ferritic Steels	is (Com	position, /	o)			
Grade Symbol	L7, L	_7M, L70	L	7A, L71	L	7B, L72		L7C, L73		L43		L1
Symbol				Carbon- olybdenum		romium- olybdenum		el-Chromium		el-Chromium- Molybdenum		
Description	. Chromium	-Molybdenun		NSI 4037)		NSI 4137)		(AISI 8740)	((AISI 4340)	Low-Ca	rbon Boron
		Product		Product		Product		Produ		Product		Product
	Range,	Variatior %	Hange,	Variation, %	Range,	Variatior %	Range		Hange	Variation, ' %	Range,	Variation, %
	%	Over or Under	— %	Over or Under	- %	Over or Under	— %	Over o	or %	Over or Under	- %	Over or Under
Carbon	0.38-	0.02	0.35-	0.02	0.35-	0.02	0.38-	0.02	0.38-	0.02		0.01
Manganese	0.48 ^C 0.75–	0.04	0.40 0.70–	0.03	0.40 0.70–	0.03	0.43 0.75–	0.04	0.43 0.60–	0.03	0.24 0.70–	0.04
Dhaanharus	1.00 0.035	0.005	0.90 0.035	0.005	0.90 0.035	0.005	1.00 0.035	0.005	0.85 0.035	0.005	1.40 0.035	0.005
Phosphorus, max		over	0.033	over		over		over	0.035	over		over
Sulfur, max	0.040	0.005 over	0.040	0.005 over	0.040	0.005 over	0.040	0.005 over	0.040	0.005 over	0.050	0.005 over
Silicon	0.15-	0.02	0.15-	0.02	0.15-	0.02	0.15-	0.02	0.15-	0.02		0.02
Nickel	0.35		0.35		0.35		0.35 0.40–	0.03	0.35 1.65–	0.05	0.30	
							0.70		2.00			
Chromium	0.80– 1.10	0.05			0.80– 1.10	0.05	0.40- 0.60	0.03	0.70– 0.90	0.03		
Molybdenum	0.15- 0.25	0.02	0.20 - 0.30	0.02	0.15– 0.25	0.02	0.20- 0.30	0.02	0.20- 0.30	0.02		
Boron	0.25				0.25							
_								0 0.		1 oD	0.003	
Type Grade Symb						B8, B8A	Austenitio	Steels, Clas	sses 1, 1A, a		B8CA	
UNS Design	nation					S 30400(304				S 347	00(347)	
				Range	e, %	Pı	oduct Vari		Range,	%		ariation, % or Under
Carbon, max				0.08		0.01			0.08		0.01 over	
Manganese,				2.00		0.04			2.00		0.04 over	
Phosphorus,	max			0.045		0.010			0.045		0.010 over	
Sulfur, max				0.030 1.00		0.005			0.030 1.00		0.005 over	
Silicon, max Nickel				8.0–11.0	1	0.05 d 0.15	over		9.0–12.0		0.05 over 0.15	
Chromium				18.0–20		0.20			17.0–19.0)	0.20	
Niobium ^E + 7	Tantalum								10 × carb		0.05 under	
									content max	t, min. –1.10		
Туре						Austenit	ic Steels,	Classes 1, 1				
Grade Symbol		B8T, B8			BP, B8PA			B8F,	B8FA			I, B8MA
UNS Designati	ion	S 32100(321) Product		30500 Prod	Nu ot	S 30300	(303) Product	S 303	23(303Se) Product	S 31	600(316) Product
	_	V	ariation, %		Variati	on 9/	, , ,	Variation, %		Variation %	,	Variation 9/
	Ra	ange, %	Over or Under	- Range, %	Ove	r or	ıge, % —	Over or Under	- Range, %	Over or Under	° Range, %	Over or Under
Carbon, max	0.08		1 over	0.12	0.01 ove			.01 over	0.15	0.01 over	0.08	0.01 over
Manganese, m			4 over	2.00	0.04 ove			.04 over .010 over	2.00	0.04 over	2.00	0.04 over
Phosphorus, m Sulfur			110 over 105 over	0.045 0.030, max	0.010 ov 0.005 ov			.020	0.20 0.06, max	0.010 over 0.010 over	0.045 0.030 may	0.010 over 0.005 over
Silicon, max	1.00		5 over	1.00	0.05 ove			.05 over	1.00	0.05 over	1.00	0.05 over
Nickel	9.0-	2.0 0.1	5	11– 13.0	0.15	8.0– 10.0	0.	.10	8.0– 10.0	0.10	10.0– 14.0	0.15
Chromium	17.0		10	17.0– 19.0	0.20	17.0– 19.0	0	20	17.0– 19.0	0.20	16.0– 18.0	0.20
Molybdenum											2.00-	0.10
Selenium									0.15-	0.03 under		
Titanium	5 ×		5 under						0.35			
		C+N) min .7 max										
Nitrogen), max 0.0	1									
Type							ustenitic 9	Steels, Class	es 1 and 1A	B-111111 - 1		
Grade Symb					B8LN, E					B8MLN, B8M	LNA	
UNS Designa	auUII			Danga o/	S 304	453 Product Vai	riation, %	Danie	0.9/	S 31653	Product V	ariation, %
				Range, %		Over or	Under	— Rang	€, %			r Under
Carbon, max				030 00		0.005 over 0.04 over		0.030 2.00			0.005 over	
Manganese,	παλ		2.	00		U.U4 UVEF		2.00			0.04 over	

TABLE 3 Continued

Phosphorus, max	0.045	0.010 over	0.045	0.010 over
Sulfur, max	0.030	0.005 over	0.030	0.005 over
Silicon, max	1.00	0.05 over	1.00	0.05 over
Nickel	8.0-11	0.15	10.0-13.0	0.15
Chromium	18.0-20.0	0.20	16.0-18.0	0.20
Molybdenum			2.00-3.00	0.10
Nitrogen	0.10-0.16	0.01	0.10-0.16	0.01

^A The intentional addition of Bi, Se, Te, and Pb is not permitted except for Grade B8F, in which selenium is specified and required.

7. Chemical Composition

7.1 Each alloy shall conform to the chemical composition requirements prescribed in Table 3.

8. Workmanship, Finish, and Appearance

8.1 Bolts, screws, studs, and stud bolts shall be pointed and shall have a workmanlike finish.

9. Retests

9.1 If the results of the mechanical tests of any test lot do not conform to the requirements specified, the manufacturer may retreat such lot not more than twice, in which case two additional tension tests and one additional impact test consisting of three specimens shall be made from such lot, all of which shall conform to the requirements specified.

10. Nuts and Washers

10.1 Bolts, studs, and stud bolts of Grades L7, L7A, L7B, L7C, L43, L1, L70, L71, L72, and L73 shall be equipped with ferritic alloy nuts conforming to Grade 7 of Specification A194/A194M or conforming to Grade L43 or Grade L73. Nuts manufactured of Grade L43 and Grade L73, in addition to the requirements stated for those grades, shall be subject to the proof-load requirements for Grade 7 nuts. Nuts manufactured of Grade L43 and Grade L73 shall be marked respectively with those grade symbols. Grade 7M nuts at a hardness not exceeding 235 HBW (or equivalent) shall be used with Grade L7M bolts, studs, and stud bolts. All nut materials, including those which may be supplied under Specification A194/ A194M, shall be subject to the impact requirements of this specification in the following manner: impact tests shall be made on test specimens taken from the nuts or nut blanks or the bar from the heat of steel used for manufacturing the nuts, and heat treated with the nut blanks.

10.2 Bolts, studs, and stud bolts of Grades B8, B8C, B8T, B8P, B8F, B8M, B8LN, and B8MLN shall be equipped with austenitic alloy nuts conforming to Grades 8, 8C, 8T, 8F, 8M, 8LN, and 8MLN for Specification A194/A194M. Impact tests are not required for Grades 8F, 8M, 8T, and 8MLN for temperatures above -325 °F [-200 °C] and for Grades 8, 8P, 8C, and 8LN above -425 °F [-255 °C].

10.3 If the purchaser requires nuts with a Charpy impact energy absorption of not less than 20 ft \cdot lbf [27 J] at

temperatures below -150 °F [-100 °C], he may require that the nuts conform to Grades 8, 8C, 8M, 8P, 8T, 8F, 8LN, or 8MLN of Specification A194/A194M.

- 10.4 Unless otherwise specified, washers for use with ferritic steel bolting shall conform to Specification F436/F436M.
- 10.5 Washers for use with austenitic steel bolting shall be made of austenitic steel as agreed upon between the manufacturer and purchaser.
- 10.6 Washer dimensions shall be in accordance with requirements of ASME B18.21.1, unless otherwise specified in the purchase order.

11. Threads

11.1 Where practical, all threads shall be formed after heat treatment. Class 1A, Grades B8A, B8CA, B8MA, B8PA, B8FA, B8LNA, and B8MLNA are to be solution-treated in the finished condition.

12. Certification

12.1 Certification is required. See Specification A962/A962M.

13. Product Marking

A962M, the grade symbol marked shall be as shown in Table 3. In the case of Class 2, Grades B8, B8C, B8M, B8P, B8F, and B8T strain hardened as provided in Table 1, a line shall be stamped under the grade symbol in order to distinguish it from Class 1 and Class 1A bolting which has not been strain hardened. In the case of Class 1A, the marking B8A, B8CA, B8MA, B8PA, B8FA, B8TA, B8LNA, and B8MLNA identifies the material as being in the solution-treated condition in the finished state. Grade L7M no longer requires a line under the grade symbol. However, a line is permitted.

13.2 Nuts from materials that have been impact tested shall be marked with the letter "L."

14. Keywords

14.1 additional elements; austenitic stainless steel; bolts—steel; chromium-molybdenum steel; bolting components—steel; markings on fittings; nickel-chromium-molybdenum alloy steel; pressure vessel service; stainless steel bolting;

^B Typical steel compositions used for this grade include 4140, 4142, 4145, 4140H, 4142H, and 4145H.

^C For the L7M grade, a minimum carbon content of 0.28 % is permitted provided that the required tensile properties are met in the section sizes involved; the use of AISI 4130 or 4130H is allowed.

^D Class 1 are made from solution-treated material. Class 1A products (B8A, B8CA, B8MA, B8PA, B8FA, and B8TA) are solution-treated in the finished condition. Class 2 products are solution-treated and strain-hardened.

ENiobium and columbium are interchangeable names for the same element and both names are acceptable for use in A01.22 specifications.

starting material; steel bars—alloy; steel bolting; steel flanges; steel valves; temperature service applications—low

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall apply only when specified by the purchaser in the inquiry, contract, and order.

S1. Impact Properties

S1.1 When impact properties are desired for austenitic steel grades exempt from testing under 6.2.1, test shall be made as agreed between the manufacturer and the purchaser.

S2. Lateral Expansion

S2.1 When lateral expansion measurements for ferritic steels are required in addition to the energy absorption requirements of 6.2.1.1, the minimum value for each specimen of a set must be .015 in. [0.38 mm]. The test temperature shall be specified by the purchaser and agreed upon by the producer.

Note S2.1—Grades L7, L7A, L7B will generally have difficulty meeting the minimum value at -150 °F [-101 °C]. Grade L43 may be preferred.

S3. Hardness Testing of Class 2 Bolting Components for ASME Applications

S3.1 The maximum hardness shall be Rockwell C35 immediately under the thread roots. The hardness shall be taken on a flat area at least ½ in. [3 mm] across, prepared by removing threads. No more material than necessary shall be removed to prepare the flat area. Hardness determinations shall be made at the same frequency as tensile tests.

S4. Restriction to Use Only Ingot Cast Steel

S4.1 The starting material must be ingot cast. Use of continuous cast material is not permitted.

APPENDIX

(Nonmandatory Information)

X1. STRAIN HARDENING OF AUSTENITIC STEELS

X1.1 Strain hardening is the increase in strength and hardness that results from plastic deformation below the recrystal-lization temperature (cold work). This effect is produced in austenitic stainless steels by reducing oversized bars or wire to the desired final size by cold drawing or other process. The degree of strain hardening achievable in any alloy is limited by its strain hardening characteristics. In addition, the amount of strain hardening that can be produced is further limited by the variables of the process, such as the total amount of cross-section reduction, die angle, and bar size. In large diameter bars, for example, plastic deformation will occur principally in the outer regions of the bar, so that the increased strength and hardness due to strain hardening is achieved predominantly near the surface of the bar. That is, the smaller the bar, the

greater the penetration of strain hardening.

- X1.2 Thus, the mechanical properties of a given strain hardened bolting components, such as a bolt, screw, or stud, are dependent not just on the alloy, but also on the size of bar from which it is machined. The minimum bar size that can be used, however, is established by the configuration of the component, so that the configuration can affect the strength of the component.
- X1.3 For example, a stud of a particular alloy and size may be machined from a smaller diameter bar than a bolt of the same alloy and size because a larger diameter bar is required to accommodate the head of the bolt. The stud, therefore, is likely to be stronger than the same size bolt in a given alloy.

SPECIFICATION FOR STRUCTURAL BOLTS, STEEL, HEAT TREATED, 120/105 ksi MINIMUM TENSILE STRENGTH



SA-325

(Identical with ASTM Specification A325-10 except for the deletion of the term "private label distributor" in 15.1 and 15.5.)

Standard Specification for Structural Bolts, Steel, Heat Treated, 120/105 ksi Minimum Tensile Strength

1. Scope

- 1.1 This specification covers two types of quenched and tempered steel heavy hex structural bolts having a minimum tensile strength of 120 ksi for sizes 1.0 in. and less and 105 ksi for sizes over 1.0 to $1\frac{1}{2}$ in., inclusive.
- 1.2 The bolts are intended for use in structural connections. These connections are covered under the requirements of the Specification for Structural Joints Using ASTM A325 or A490 Bolts, approved by the Research Council on Structural Connections, endorsed by the American Institute of Steel Construction and by the Industrial Fastener Institute.
- 1.3 The bolts are furnished in sizes $\frac{1}{2}$ to $\frac{1}{2}$ in., inclusive. They are designated by type, denoting chemical composition as follows:

Type Description

Type 1 Medium carbon, carbon boron, or medium carbon alloy steel.

Type 2 Withdrawn in November 1991.

Type 3 Weathering steel.

Note 1—Bolts for general applications, including anchor bolts, are covered by Specification A449. Also refer to Specification A449 for quenched and tempered steel bolts and studs with diameters greater than $1\frac{1}{2}$ in. but with similar mechanical properties.

- 1.4 The values stated in inch-pound units are to be regarded as standard. No other units of measurement are included in this standard.
- Note 2—A complete metric companion to Specification A325 has been developed, Specification A325M; therefore, no metric equivalents are presented in this specification.

- 1.5 This specification is applicable to heavy hex structural bolts only. For bolts of other configurations and thread lengths with similar mechanical properties, see Specification A449.
- 1.6 Terms used in this specification are defined in Terminology F1789.
- 1.7 The following safety hazard caveat pertains only to the test methods portion, Section 10, of this specification: This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.

2. Referenced Documents

- 2.1 ASTM Standards:
- A194/A194M Specification for Carbon and Alloy Steel Nuts for Bolts for High Pressure or High Temperature Service, or Both
- A325M Specification for Structural Bolts, Steel, Heat Treated 830 MPa Minimum Tensile Strength (Metric)
- A449 Specification for Hex Cap Screws, Bolts and Studs, Steel, Heat Treated, 120/105/90 ksi Minimum Tensile Strength, General Use
- A490 Specification for Structural Bolts, Alloy Steel, Heat Treated, 150 ksi Minimum Tensile Strength
- A563 Specification for Carbon and Alloy Steel Nuts
- A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- B695 Specification for Coatings of Zinc Mechanically Deposited on Iron and Steel
- D3951 Practice for Commercial Packaging
- F436 Specification for Hardened Steel Washers
- F606 Test Methods for Determining the Mechanical Properties of Externally and Internally Threaded Fasteners,

Washers, Direct Tension Indicators, and Rivets F788/F788M Specification for Surface Discontinuities of Bolts, Screws, and Studs, Inch and Metric Series

F959 Specification for Compressible-Washer-Type Direct Tension Indicators for Use with Structural Fasteners

- F1136 Specification for Zinc/Aluminum Corrosion Protective Coatings for Fasteners
- F1470 Practice for Fastener Sampling for Specified Mechanical Properties and Performance Inspection
- F1789 Terminology for F16 Mechanical Fasteners
- F2329 Specification for Zinc Coating, Hot-Dip, Requirements for Application to Carbon and Alloy Steel Bolts, Screws, Washers, Nuts, and Special Threaded Fasteners
- G101 Guide for Estimating the Atmospheric Corrosion Resistance of Low-Alloy Steels
- 2.2 ASME Standards:
- B 1.1 Unified Screw Threads
- B 18.2.6 Fasteners for Use in Structural Applications
- B 18.24 Part Identification Number (PIN) Code System Standard for B18 Fastener Products

3. Ordering Information

- 3.1 Orders for heavy hex structural bolts under this specification shall include the following:
 - 3.1.1 Quantity (number of pieces of bolts and accessories).
- 3.1.2 Size, including nominal bolt diameter, thread pitch, and bolt length.
 - 3.1.3 Name of product, heavy hex structural bolts.
- 3.1.4 When bolts threaded full length are required, Supplementary Requirement S1 shall be specified.
- 3.1.5 Type of bolt: Type 1 or 3. When type is not specified, either Type 1 or Type 3 shall be furnished at the supplier's option.
 - 3.1.6 ASTM designation and year of issue.
- 3.1.7 Other components such as nuts, washers, and compressible washer-type direct-tension indicators, if required.
- 3.1.7.1 When such other components are specified to be furnished, also state "Nuts, washers, and direct tension indicators, or combination thereof, shall be furnished by lot number."
- 3.1.8 Zinc Coating—Specify the zinc coating process required, for example, hot dip, mechanically deposited, Zinc/Aluminum Corrosion Protective Coating or no preference (see 4.3).
- 3.1.9 Other Finishes—Specify other protective finish, if required.
 - 3.1.10 Test reports, if required (see Section 13).
 - 3.1.11 Supplementary or special requirements, if required.
- 3.1.12 For establishment of a part identifying system, see ASME B18.24.

Note 3—A typical ordering description follows: 1000 pieces 1½-7 UNC in. dia × 4 in. long heavy hex structural bolt, *Type 1 ASTM A325–02*, each with one hardened washer, ASTM F436 Type 1, and one heavy hex nut, ASTM A563 Grade DH. Each component hot-dip zinc-coated. Nuts lubricated.

3.2 Recommended Nuts:

3.2.1 Nuts conforming to the requirements of Specification A563 are the recommended nuts for use with Specification A325 heavy hex structural bolts. The nuts shall be of the class and have a surface finish for each type of bolt as follows:

Bolt Type and Finish	Nut Class and Finish
1, plain (noncoated)	A563-C, C3, D, DH, DH3, plain
1, zinc coated	A563-DH, zinc coated
1, coated in accordance with Specification F1136, Grade 3	A563-DH coated in accordance with Specification F1136, Grade 5
3, plain	A563-C3, DH3, plain

- 3.2.2 Alternatively, nuts conforming to Specification A194/A194M Gr. 2H are considered a suitable substitute for use with Specification A325 Type 1 heavy hex structural bolts.
- 3.2.3 When Specification A194/A194M Gr. 2H zinc-coated nuts are supplied, the zinc coating, overtapping, lubrication, and rotational capacity testing shall be in accordance with Specification A563.

3.3 Recommended Washers:

3.3.1 Washers conforming to Specification F436 are the recommended washers for use with Specification A325 heavy hex structural bolts. The washers shall have a surface finish for each type of bolt as follows:

Bolt Type and Finish	Washer Finish
1, plain (uncoated)	plain (uncoated)
1, zinc coated	zinc coated
1, coated in accordance with Specification F1136, Grade 3	coated in accordance with Speci- fication F1136, Grade 3
3, plain	weathering steel, plain

- 3.4 Other Accessories:
- 3.4.1 When compressible washer type direct tension indicators are specified to be used with these bolts, they shall conform to Specification F959, Type 325.

4. Materials and Manufacture

- 4.1 Heat Treatment:
- 4.1.1 Type 1 bolts produced from medium carbon steel shall be quenched in a liquid medium from the austenitizing temperature. Type 1 bolts produced from medium carbon steel to which chromium, nickel, molybdenum, or boron were intentionally added shall be quenched only in oil from the austenitizing temperature.
- 4.1.2 Type 3 bolts shall be quenched only in oil from the austenitizing temperature.
- 4.1.3 Type 1 bolts, regardless of the steel used, and Type 3 bolts shall be tempered by reheating to not less than 800°F.
 - 4.2 Threading—Threads shall be cut or rolled.
- 4.3 Zinc Coatings, Hot-Dip and Mechanically Deposited, Zinc/Aluminum Corrosion Protective Coating:
- 4.3.1 When zinc-coated fasteners are required, the purchaser shall specify the zinc coating process, for example, hot

dip, mechanically deposited, Zinc/Aluminum Corrosion Protective Coating, or no preference.

- 4.3.2 When hot-dip is specified, the fasteners shall be zinc-coated by the hot-dip process and the coating shall conform to the coating weight/thickness and performance requirements of Specification F2329.
- 4.3.3 When mechanically deposited is specified, the fasteners shall be zinc-coated by the mechanical deposition process and the coating shall conform to the coating weight/thickness and performance requirements of Class 55 of Specification B695.
- 4.3.4 When Zinc/Aluminum Corrosion Protective Coating is specified, the coating shall conform to the coating weight/thickness and performance requirements of Grade 3 of Specification F1136.
- 4.3.5 When no preference is specified, the supplier shall furnish either a hot-dip zinc coating in accordance with Specification F2329, a mechanically deposited zinc coating in accordance with Specification B695, Class 55, or a Zinc/Aluminum Corrosion Protective Coating in accordance with Specification F1136, Grade 3. Threaded components (bolts and nuts) shall be coated by the same zinc-coating process and the supplier's option is limited to one process per item with no mixed processes in a lot.
- 4.4 *Lubrication*—When zinc-coated nuts are ordered with the bolts, the nuts shall be lubricated in accordance with Specification A563, Supplementary Requirement S1, to minimize galling.
 - 4.5 Secondary Processing:
- 4.5.1 If any processing, which can affect the mechanical properties or performance of the bolts, is performed after the initial testing, the bolts shall be retested for all specified mechanical properties and performance requirements affected by the reprocessing.
- 4.5.2 When the secondary process is heat treatment, the bolts shall be tested for all specified mechanical properties. Hot dip zinc-coated bolts shall be tested for all specified mechanical properties and rotational capacity. If zinc-coated nuts are relubricated after the initial rotational capacity tests, the assemblies shall be retested for rotational capacity.

5. Chemical Composition

- 5.1 Type 1 bolts shall be plain carbon steel, carbon boron steel, alloy steel or alloy boron steel at the manufacturer's option, conforming to the chemical composition specified in Table 1.
- 5.2 Type 3 bolts shall be weathering steel and shall conform to one of the chemical compositions specified in Table 2. The selection of the chemical composition, A, B, C, D, E, or F, shall be at the option of the bolt manufacturer. See Guide G101 for methods of estimating the atmospheric corrosion resistance of low alloy steels.
- 5.3 Product analyses made on finished bolts representing each lot shall conform to the product analysis requirements specified in Tables 1 and 2, as applicable.

TABLE 1 Chemical Requirements for Type 1 Bolts

Element .	Carbon Steel			
Liomoni	Heat Analysis	Product Analysis		
Carbon	0.30-0.52	0.28-0.55		
Manganese, min	0.60	0.57		
Phosphorus, max	0.040	0.048		
Sulfur, max	0.050	0.058		
Silicon	0.15-0.30	0.13-0.32		

Element	Carbon Boron Steel				
Element	Heat	Product			
	Analysis	Analysis			
Carbon	0.30-0.52	0.28-0.55			
Manganese, min	0.60	0.57			
Phosphorus, max	0.040	0.048			
Sulfur, max	0.050	0.058			
Silicon	0.10-0.30	0.08-0.32			
Boron	0.0005-0.003	0.0005-0.003			

Element -	Alloy Steel		
Element -	Heat	Product	
	Analysis	Analysis	
Carbon	0.30-0.52	0.28-0.55	
Manganese, min	0.60	0.57	
Phosphorus, max	0.035	0.040	
Sulfur, max	0.040	0.045	
Silicon	0.15-0.35	0.13-0.37	
Alloying Elements	A	A	

Alloy Bo	ron Steel
Heat	Product
Analysis	Analysis
0.30-0.52	0.28-0.55
0.60	0.57
0.035	0.040
0.040	0.045
0.15-0.35	0.13-0.37
0.0005-0.003	0.0005-0.003
Α	A
	Heat Analysis 0.30-0.52 0.60 0.035 0.040 0.15-0.35 0.0005-0.003

^A Steel, as defined by the American Iron and Steel Institute, shall be considered to be alloy when the maximum of the range given for the content of alloying elements exceeds one or more of the following limits: Manganese, 1.65 %; silicon, 0.60 %; copper, 0.60 % or in which a definite range or a definite minimum quantity of any of the following elements is specified or required within the limits of the recognized field of constructional alloy steels: aluminum, chromium up to 3.99 %, cobalt, columbium, molybdenum, nickel, titanium, tungsten, vanadium, zirconium, or any other alloying elements added to obtain a desired alloying effect.

- 5.4 Heats of steel to which bismuth, selenium, tellurium, or lead has been intentionally added shall not be permitted for bolts.
- 5.5 Compliance with 5.4 shall be based on certification that heats of steel having any of the listed elements intentionally added were not used to produce the bolts.
- 5.6 Chemical analyses shall be performed in accordance with Test Methods, Practices, and Terminology A751.

6. Mechanical Properties

- 6.1 *Hardness*—The bolts shall conform to the hardness specified in Table 3.
- 6.2 Tensile Properties:
- 6.2.1 Except as permitted in 6.2.1.1 for long bolts and 6.2.1.2 for short bolts, sizes 1.00 in. and smaller having a nominal length of $2\frac{1}{4}D$ and longer, and sizes larger than 1.00

TABLE 2 Chemical Requirements for Type 3 Heavy Hex Structural Bolts^A

			Compo	sition, %		
Type 3 Bolts ^A						
Element	A	В	С	D	Е	F
Carbon:						
Heat analysis	0.33-0.40	0.38-0.48	0.15-0.25	0.15-0.25	0.20-0.25	0.20-0.25
Product analysis	0.31-0.42	0.36-0.50	0.14-0.26	0.14-0.26	0.18-0.27	0.19-0.26
Manganese:						
Heat analysis	0.90-1.20	0.70-0.90	0.80-1.35	0.40-1.20	0.60-1.00	0.90-1.20
Product analysis	0.86-1.24	0.67-0.93	0.76-1.39	0.36-1.24	0.56-1.04	0.86-1.24
Phosphorus:						
Heat analysis	0.035 max	0.06-0.12	0.035 max	0.035 max	0.035 max	0.035 max
Product analysis	0.040 max	0.06-0.125	0.040 max	0.040 max	0.040 max	0.040 max
Sulfur:						
Heat analysis	0.040 max	0.040 max	0.040 max	0.040 max	0.040 max	0.040 max
Product analysis	0.045 max	0.045 max	0.045 max	0.045 max	0.045 max	0.045 max
Silicon:						
Heat analysis	0.15-0.35	0.30-0.50	0.15-0.35	0.25-0.50	0.15-0.35	0.15-0.35
Product analysis	0.13-0.37	0.25-0.55	0.13–0.37	0.20-0.55	0.13–0.37	0.13-0.37
Copper:						
Heat analysis	0.25-0.45	0.20-0.40	0.20-0.50	0.30-0.50	0.30-0.60	0.20-0.40
Product analysis	0.22-0.48	0.17-0.43	0.17-0.53	0.27-0.53	0.27-0.63	0.17-0.43
Nickel:						
Heat analysis	0.25-0.45	0.50-0.80	0.25-0.50	0.50-0.80	0.30-0.60	0.20-0.40
Product analysis	0.22-0.48	0.47–0.83	0.22-0.53	0.47–0.83	0.27–0.63	0.17–0.43
Chromium:						
Heat analysis	0.45-0.65	0.50-0.75	0.30-0.50	0.50-1.00	0.60-0.90	0.45-0.65
Product analysis	0.42-0.68	0.47-0.83	0.27-0.53	0.45-1.05	0.55-0.95	0.42-0.68
Vanadium:						
Heat analysis	В	В	0.020 min	В	В	В
Product analysis	В	В	0.010 min	В	В	В
Molybdenum:						
Heat analysis	В	0.06 max	В	0.10 max	В	В
Product analysis	В	0.07 max	В	0.11 max	В	В
Titanium:						
Heat analysis	В	В	В	0.05 max	В	В
Product analysis	В	В	В	0.06 max	В	В

^A A, B, C, D, E, and F are classes of material used for Type 3 bolts. Selection of a class shall be at the option of the bolt manufacturer.

TABLE 3 Hardness Requirements for Bolts

Bolt Size	Nominal Length				
in.	in.	Bri	nell	Rock	well C
		Min	Max	Min	Max
½ to 1, incl	Less than 2D	253	319	25	34
	2D and over		319		34
11/8 to 11/2, incl	Less than 3D	223	286	19	30
	3D and over		286		30

D = Nominal diameter or thread size.

in. having a nominal length of 3D and longer, shall be wedge tested full size and shall conform to the minimum wedge tensile load and proof load or alternative proof load specified in Table 4. The load achieved during proof load testing shall be equal to or greater than the specified proof load.

- 6.2.1.1 When the length of the bolt makes full-size testing impractical, machined specimens shall be tested and shall conform to the requirements specified in Table 5. When bolts are tested by both full-size and machined specimen methods, the full-size test shall take precedence.
- 6.2.1.2 Sizes 1.00 in. and smaller having a nominal length shorter than $2\frac{1}{4}D$ down to 2D, inclusive, that cannot be wedge tensile tested shall be axially tension tested full size and shall conform to the minimum tensile load and proof load or alternate proof load specified in Table 4. Sizes 1.00 in. and smaller having a nominal length shorter than 2D and sizes larger than 1.00 in. with nominal lengths shorter than 3D that cannot be axially tensile tested shall be qualified on the basis of hardness.
- 6.2.2 For bolts on which both hardness and tension tests are performed, acceptance based on tensile requirements shall take precedence in the event of low hardness readings.

6.3 Rotational Capacity Test:

^B These elements are not specified or required.

TABLE 4 Tensile Load Requirements for Bolts Tested Full-Size

Bolt Size, Threads pe Inch, and Series Designation		Tensile Load, ^B min, lbf	Proof Load, ^B Length Measure- ment Method	Alternative Proof Load, ^B Yield Strength Method
Column 1	Column 2	Column 3	Column 4	Column 5
½ -13 UNC	0.142	17 050	12 050	13 050
5⁄8 −11 UNC	0.226	27 100	19 200	20 800
3⁄4 −10 UNC	0.334	40 100	28 400	30 700
7⁄8 −9 UNC	0.462	55 450	39 250	42 500
1–8 UNC	0.606	72 700	51 500	55 750
11/8 -7 UNC	0.763	80 100	56 450	61 800
11/4 -7 UNC	0.969	101 700	71 700	78 500
1% -6 UNC	1.155	121 300	85 450	93 550
1½ -6 UNC	1.405	147 500	104 000	113 800

A The stress area is calculated as follows:

 $As = 0.7854 [D - (0.9743/n)]^2$

where:

 $As = stress area, in.^2,$ D = nominal bolt size, andn = threads per inch.

^B Loads tabulated are based on the following:

Bolt Size, in.	Column 3	Column 4	Column 5
½ to 1, incl	120 000 psi	85 000 psi	92 000 psi
11/8 to 11/2, incl	105 000 psi	74 000 psi	81 000 psi

- 6.3.1 *Definition*—The rotational capacity test is intended to evaluate the presence of a lubricant, the efficiency of the lubricant, and the compatibility of assemblies as represented by the components selected for testing.
- 6.3.2 Requirement—Zinc-coated bolts, zinc-coated washers, and zinc-coated and lubricated nuts tested full size in an assembled joint or tension measuring device, in accordance with 10.2, shall not show signs of failure when subjected to the nut rotation in Table 6. The test shall be performed by the responsible party (see Section 14) prior to shipment after zinc coating and lubrication of nuts (see 10.2 and Note 4).
- 6.3.3 Acceptance Criterion—The bolt and nut assembly shall be considered as non-conforming if the assembly fails to pass any one of the following specified requirements:
- 6.3.3.1 Inability to install the assembly to the nut rotation in Table 6.
- 6.3.3.2 Inability to remove the nut after installing to the rotation specified in Table 6.
- 6.3.3.3 Shear failure of the threads as determined by visual examination of bolt and nut threads following removal.
- 6.3.3.4 Torsional or torsional/tension failure of the bolt. Elongation of the bolt, in the threads between the nut and bolt head, is to be expected at the required rotation and is not to be classified as a failure.

7. Dimensions

- 7.1 Head and Body:
- 7.1.1 The bolts shall conform to the dimensions for heavy hex structural bolts specified in ASME B18.2.6.

- 7.1.2 The thread length shall not be changed except as provided in Supplementary Requirement S1. Bolts with thread lengths other than those required by this specification shall be ordered under Specification A449.
 - 7.2 Threads:
- 7.2.1 *Uncoated*—Threads shall be the Unified Coarse Thread Series as specified in ASME B1.1, and shall have Class 2A tolerances.
- 7.2.2 Coated—Unless otherwise specified, zinc-coated bolts to be used with zinc-coated nuts or tapped holes that are tapped oversize, in accordance with Specification A563, shall have Class 2A threads before hot-dip or mechanically deposited zinc coating. After zinc coating, the maximum limits of pitch and major diameter shall not exceed the Class 2A limit by more than the following amounts:

	Oversize	Limit, in. ^A
Nominal Bolt	Hot-Dip	Mechanical
Diameter (in.)	Zinc	Zinc
1/2	0.018	0.012
9/16 , 5/8, 3/4	0.020	0.013
7/8	0.022	0.015
1 to 11/4	0.024	0.016
13/8 , 11/2	0.027	0.018

^A Hot-dip zinc nuts are tapped oversize after coating, and mechanical zinccoated nuts are tapped oversize before coating.

7.2.3 The gaging limit for bolts shall be verified during manufacture. In case of dispute, a calibrated thread ring gage of the same size as the oversize limit in 7.2.2 (Class X tolerance, gage tolerance plus) shall be used to verify compliance. The gage shall assemble with hand effort following application of light machine oil to prevent galling and damage to the gage. These inspections, when performed to resolve controversy, shall be conducted at the frequency specified in the quality assurance provisions of ASME B18.2.6.

8. Workmanship

8.1 The allowable limits, inspection, and evaluation of the surface discontinuities, quench cracks, forging cracks, head bursts, shear bursts, seams, folds, thread laps, voids, tool marks, nicks, and gouges shall be in accordance with Specification F788/F788M.

9. Number of Tests and Retests

- 9.1 Testing Responsibility:
- 9.1.1 Each lot shall be tested by the manufacturer prior to shipment in accordance with the lot identification control quality assurance plan in 9.2 through 9.5.
- 9.1.2 When bolts are furnished by a source other than the manufacturer, the Responsible Party as defined in 14 shall be responsible for assuring all tests have been performed and the bolts comply with the requirements of this specification (see 4.5).
- 9.2 Purpose of Lot Inspection—The purpose of a lot inspection program is to ensure that each lot conforms to the requirements of this specification. For such a plan to be fully effective it is essential that secondary processors, distributors,

TABLE 5 Tensile Strength Requirements for Specimens Machined from Bolts

Bolt Diameter, in.	Tensile Strength, min, psi (MPa)	Yield Strength, min, psi (MPa)	Elongation, in 4D, min, %	Reduction of Area, min, %
½ to 1, incl.	120 000 (825)	92 000 (635)	14	35
Over 1 to 11/2	105 000 (725)	81 000 (560)	14	35 [†]
[†] Table alignment was editoria	Illy corrected in March 2010			

TABLE 6 Rotational Capacity Test for Zinc-Coated Bolts

Nominal Length in.	Nominal Nut Rotation, degrees (turn)
Up to and including 4 × dia Over 4 × dia, but not	240 (%) 360 (1)
exceeding 8 × dia Over 8 × dia, but not exceeding 12 × dia	420 (11%)
Over 12 × dia.	Test not applicable

and purchasers maintain the identification and integrity of each lot until the product is installed.

9.3 Lot Method—All bolts shall be processed in accordance with a lot identification-control quality assurance plan. The manufacturer, secondary processors, and distributors shall identify and maintain the integrity of each production lot of bolts from raw-material selection through all processing operations and treatments to final packing and shipment. Each lot shall be assigned its own lot-identification number, each lot shall be tested, and the inspection test reports for each lot shall be retained.

9.4 Lot Definition—A lot shall be a quantity of uniquely identified heavy hex structural bolts of the same nominal size and length produced consecutively at the initial operation from a single mill heat of material and processed at one time, by the same process, in the same manner so that statistical sampling is valid. The identity of the lot and lot integrity shall be maintained throughout all subsequent operations and packaging.

9.5 *Number of Tests*—The minimum number of tests from each lot for the tests specified below shall be as follows:

ii for for the tests specified	below shall be as follows.
Tests	Number of Tests in Accordance With
Hardness, tensile strength, proof load, and rotational capacity	Practice F1470
Coating weight/ thickness	The referenced coating specification ^A
Surface discontinuities	Specification F788/F788M
Dimensions and thread fit	ASME B18.2.6

^A Practice F1470 applies if the coating specification does not specify a testing

10. Test Methods

10.1 Tensile, Proof Load, and Hardness:

10.1.1 Tensile, proof load, and hardness tests shall be conducted in accordance with Test Methods F606.

10.1.2 Tensile strength shall be determined using the Wedge or Axial Tension Testing Method of Full Size Product Method or the Machined Test Specimens Method depending on size and nominal length as specified in 6.2.1-6.2.2. Fracture on full-size tests shall be in the body or threads of the bolt without a fracture at the junction of the head and body.

10.1.3 Proof load shall be determined using Method 1, Length Measurement, or Method 2, Yield Strength, at the option of the manufacturer.

10.2 Rotational Capacity—The zinc-coated bolt shall be placed in a steel joint or tension measuring device and assembled with a zinc-coated washer and a zinc-coated and lubricated nut with which the bolt is intended to be used (see Note 4). The nut shall have been provided with the lubricant described in the last paragraph of the Manufacturing Processes section of Specification A563. The joint shall be one or more flat structural steel plates or fixture stack up with a total thickness, including the washer, such that 3 to 5 full threads of the bolt are located between the bearing surfaces of the bolt head and nut. The hole in the joint shall have the same nominal diameter as the hole in the washer. The initial tightening of the nut shall produce a load in the bolt not less than 10 % of the specified proof load. After initial tightening, the nut position shall be marked relative to the bolt, and the rotation shown in Table 6 shall be applied. During rotation, the bolt head shall be restrained from turning. After the tightening rotation has been applied, the assembly shall be taken apart and examined for compliance with 6.3.3.

Note 4—Rotational capacity tests shall apply only to matched assembly lots that contain one A325 bolt, one A563 lubricated nut, and one F436 washer that have been zinc coated in accordance with either Specifications F2329 or B695. Both the bolt and nut components of the matched assembly shall be zinc coated using the same process.

11. Inspection

11.1 If the inspection described in 11.2 is required by the purchaser, it shall be specified in the inquiry and contract or order.

11.2 The purchaser's representative shall have free entry to all parts of the manufacturer's works, or supplier's place of business, that concern the manufacture or supply of the material ordered. The manufacturer or supplier shall afford the purchaser's representative all reasonable facilities to satisfy him that the material is being furnished in accordance with this specification. All tests and inspections required by the specification that are requested by the purchaser's representative shall be made before shipment, and shall be conducted as not to

interfere unnecessarily with the operation of the manufacturer's works or supplier's place of business.

12. Rejection and Rehearing

12.1 Disposition of nonconforming bolts shall be in accordance with the Practice F1470 section titled "Disposition of Nonconforming Lots."

13. Certification

- 13.1 When specified on the purchase order, the manufacturer or supplier, whichever is the responsible party as defined in Section 14, shall furnish the purchaser a test reports that includes the following:
- 13.1.1 Heat analysis, heat number, and a statement certifying that heats having the elements listed in 5.4 intentionally added were not used to produce the bolts,
 - 13.1.2 Results of hardness, tensile, and proof load tests,
- 13.1.3 Results of rotational capacity tests. This shall include the test method used (solid plate or tension measuring device); and the statement "Nuts lubricated" for zinc-coated nuts when shipped with zinc-coated bolts,
- 13.1.4 Zinc coating measured coating weight/thickness for coated bolts,
- 13.1.5 Statement of compliance of visual inspection for surface discontinuities (Section 8),
- 13.1.6 Statement of compliance with dimensional and thread fit requirements,
 - 13.1.7 Lot number and purchase order number,
 - 13.1.8 Complete mailing address of responsible party, and
- 13.1.9 Title and signature of the individual assigned certification responsibility by the company officers.
- 13.2 Failure to include all the required information on the test report shall be cause for rejection.

14. Responsibility

14.1 The party responsible for the fastener shall be the organization that supplies the fastener to the purchaser.

15. Product Marking

15.1 *Manufacturer's Identification*—All Type 1 and 3 bolts shall be marked by the manufacturer with a unique identifier to identify the manufacturer.

- 15.2 Grade Identification:
- 15.2.1 Type 1 bolts shall be marked "A325."
- 15.2.2 Type 3 bolts shall be marked "<u>A325</u>" with the "<u>A325</u>" underlined. The use of additional distinguishing marks to indicate that the bolts are weathering steel shall be at the manufacturer's option.
- 15.3 Marking Location and Methods—All marking shall be located on the top of the bolt head and shall be either raised or depressed at the manufacturer's option.
- 15.4 Acceptance Criteria—Bolts which are not marked in accordance with these provisions shall be considered nonconforming and subject to rejection.
- 15.5 Type and manufacturer's identification shall shall be separate and distinct. The two identifications shall preferably be in different locations and, when on the same level, shall be separated by at least two spaces.

16. Packaging and Package Marking

- 16.1 Packaging:
- 16.1.1 Unless otherwise specified, packaging shall be in accordance with Practice D3951.
- 16.1.2 When zinc coated nuts are included on the same order as zinc coated bolts, the bolts and nuts shall be shipped in the same container.
- 16.1.3 When special packaging requirements are required, they shall be defined at the time of the inquiry and order.
 - 16.2 Package Marking:
- 16.2.1 Each shipping unit shall include or be plainly marked with the following information:
 - 16.2.1.1 ASTM designation and type,
 - 16.2.1.2 Size,
 - 16.2.1.3 Name and brand or trademark of the manufacturer,
 - 16.2.1.4 Number of pieces,
- 16.2.1.5 Lot number; when nuts, washers or direct tension indicators, or combination thereof, are ordered with A325 heavy hex structural bolts, the shipping unit shall be marked with the lot number in addition to the marking required by the applicable product specification,
 - 16.2.1.6 Purchase order number, and
 - 16.2.1.7 Country of origin.

17. Keywords

17.1 bolts; carbon steel; steel; structural; weathering steel

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall apply only when specified by the purchaser in the contract or order. Details of these supplementary requirements shall be agreed upon in writing between the manufacturer and purchaser. Supplementary requirements shall in no way negate any requirement of the specification itself.

S1. Bolts Threaded Full Length

S1.1 Bolts with nominal lengths equal to or shorter than four times the nominal bolt diameter shall be threaded full length. Bolts need not have a shoulder, and the distance from the underhead bearing surface to the first complete (full form) thread, as measured with a GO thread ring gage, assembled by

hand as far as the thread will permit, shall not exceed the length of $2\frac{1}{2}$ threads for bolt sizes 1 in. and smaller, and $3\frac{1}{2}$ threads for bolt sizes larger than 1 in.

S1.2 Bolts shall be marked in accordance with Section 15, except that the symbol shall be "A325 T" instead of "A325."



SPECIFICATION FOR SEAMLESS AND WELDED STEEL PIPE FOR LOW-TEMPERATURE SERVICE AND OTHER APPLICATIONS WITH REQUIRED NOTCH TOUGHNESS



SA-333/SA-333M



(Identical with ASTM Specification A333/A333M-16.)

Standard Specification for Seamless and Welded Steel Pipe for Low-Temperature Service and Other Applications with Required Notch Toughness

1. Scope

- 1.1 This specification covers nominal (average) wall seamless and welded carbon and alloy steel pipe intended for use at low temperatures and in other applications requiring notch toughness. Several grades of ferritic steel are included as listed in Table 1. Some product sizes may not be available under this specification because heavier wall thicknesses have an adverse effect on impact properties.
- 1.2 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.

Note 1—The dimensionless designator NPS (nominal pipe size) has been substituted in this standard for such traditional terms as "nominal diameter," "size," and "nominal size."

2. Referenced Documents

2.1 ASTM Standards:

A370 Test Methods and Definitions for Mechanical Testing of Steel Products

A999/A999M Specification for General Requirements for Alloy and Stainless Steel Pipe

A671 Specification for Electric-Fusion-Welded Steel Pipe for Atmospheric and Lower Temperatures

E23 Test Methods for Notched Bar Impact Testing of Metallic Materials

E165 Practice for Liquid Penetrant Examination for General Industry

E709 Guide for Magnetic Particle Testing

2.2 ASME Boiler and Pressure Vessel Code:

Section VIII

Section IX

3. Ordering Information

- 3.1 Orders for material under this specification should include the following, as required, to describe the material adequately:
 - 3.1.1 Quantity (feet, centimetres, or number of lengths),
 - 3.1.2 Name of material (seamless or welded pipe),
 - 3.1.3 Grade (Table 1),
- 3.1.4 Size (NPS or outside diameter and schedule number of average wall thickness),
- 3.1.5 Lengths (specific or random) (Section 9), (see the Permissible Variations in Length section of Specification A999/A999M),
- 3.1.6 End finish (see the Ends section of Specification A999/A999M),
- 3.1.7 Optional requirements, (see the Heat Analysis requirement in the Chemical Composition section of A999/A999M, the Repair by Welding section, and the section on Nondestructive Test Requirements).
- 3.1.8 Test report required, (see the Certification section of Specification A999/A999M),
 - 3.1.9 Specification designation, and
- 3.1.10 Special requirements or exceptions to this specifica-
- 3.1.11 Supplementary requirements, if any (subsize impact specimens, pipe for hydrofluoric acid alkylation service).

4. Materials and Manufacture

4.1 *Manufacture*—Except as provided in paragraph 4.2, the pipe shall be made by the seamless or welding process with the

TABLE 1 Chemical Requirements^B

Floresent					Composition,	%			
Element	Grade 1	Grade 3	Grade 4	Grade 6	Grade 7	Grade 8	Grade 9	Grade 10	Grade 11
Carbon, max	0.30	0.19	0.12	0.30	0.19	0.13	0.20	0.20	0.10
Manganese	$0.40-1.06^{A}$	0.31-0.64	0.50-1.05	0.29-1.06 ^A	0.90 max	0.90 max	0.40-1.06	1.15-1.50	0.60 max
Phosphorus,	0.025	0.025	0.025	0.025	0.025	0.025	0.025	0.035	0.025
max									
Sulfur, max	0.025	0.025	0.025	0.025	0.025	0.025	0.025	0.015	0.025
Silicon		0.18-0.37	0.08-0.37	0.10 min	0.13-0.32	0.13-0.32		0.10-0.35	0.35 max
Nickel		3.18-3.82	0.47-0.98	0.40 max	2.03-2.57	8.40-9.60	1.60-2.24	0.25 max	35.0-37.0
Chromium			0.44-1.01	0.30 max				0.15 max	0.50 max
Copper			0.40-0.75	0.40 max			0.75-1.25	0.15 max	
Aluminum			0.04-0.30					0.06 max	
Vanadium, max				0.08				0.12	
Columbium,				0.02 ^C				0.05	
max									
Molybdenum,				0.12				0.05	0.50 max
max									
Cobalt									0.50 max

A For each reduction of 0.01 % carbon below 0.30 %, an increase of 0.05 % manganese above 1.06 % would be permitted to a maximum of 1.35 % manganese.

addition of no filler metal in the welding operation. Grade 4 shall be made by the seamless process.

Note 2—For electric-fusion-welded pipe, with filler metal added, fabricated of pressure vessel quality plates, see Specification A671.

- 4.2 Grade 11 pipe may be produced by welding with or without the addition of filler metal. The following requirements shall apply for Grade 11 welded with the addition of filler metal
- 4.2.1 The joints shall be full-penetration, full fusion doublewelded or single-welded butt joints employing fusion welding processes as defined in "Definitions," ASME Boiler and Pressure Vessel Code, Section IX. This specification makes no provision for any difference in weld quality requirements regardless of the weld joint type employed (single or double) in making the weld. Where backing strips are employed, the ring or strip material shall be the same as the plate being joined. Backing rings or strips shall be completely removed after welding, prior to any required radiography, and the exposed weld surface shall be examined visually for conformance to the requirements of 4.2.2. Welds made by procedures employing backing strips or rings which remain in place are prohibited. Welding procedures and welding operators shall be qualified in accordance with ASME Boiler and Pressure Vessel Code, Section IX.
- 4.2.2 The weld surface on either side of the weld may be flush with the base plate or may have a reasonably uniform crown, not to exceed ½ in. [3 mm]. Any weld reinforcement may be removed at the manufacturer's option or by agreement between the manufacturer and purchaser. The contour of the reinforcement shall be reasonably smooth and free from irregularities. The deposited metal shall be fused uniformly into the plate surface. No concavity of contour is permitted unless the resulting thickness of weld metal is equal to or greater than the minimum thickness of the adjacent base metal.
- 4.2.3 Radiographic Examination—All welded joints shall be fully radiographed in accordance with the requirements of the ASME Boiler and Pressure Vessel Code, Section VIII, Division 1, latest edition, paragraph UW-51.

- 4.2.3.1 As an alternative, the welded joints may be ultrasonically examined in accordance with Appendix 12 of the ASME Boiler and Pressure Vessel Code, Section VIII, Division
- 4.2.4 *Repair Welding*—Weld metal defects shall be repaired by removal to sound metal and repair welding if approved by the purchaser.
- 4.2.4.1 The repair shall be blended smoothly into the surrounding base metal surface and examined by the magnetic particle examination in accordance with Practice E709, or by the liquid penetrant method in accordance with Practice E165.
- 4.2.4.2 Each repair weld of a cavity where the cavity, before repair welding, has a depth exceeding the lesser of 3% in. [9.5 mm] or 10.5 % of the nominal thickness shall be radiographically examined as required for the original welds.
- 4.2.5 *Transverse Tension Test*—One test shall be made to represent each lot (Note 3) of finished pipe. The test specimens shall be taken across the welded joint. The tension test results of the welded joints shall conform to the tensile properties for Grade 11 in Table 2.
- 4.2.5.1 The test specimens shall be taken from the end of the finished pipe. As an alternative, the tension test specimens may be taken from a welded prolongation of the same material as the pipe, which is attached to the end of the pipe and welded as a prolongation of the pipe longitudinal seam.
- 4.2.5.2 The test specimens shall be in accordance with Section IX, Part QW, paragraph QW-150 of the ASME Boiler and Pressure Vessel Code and shall be one of the types shown in QW-462.1 of that code. The tension test specimen may be flattened cold before final machining to size.
- 4.2.6 *Transverse Guided-Bend Weld Test*—One transverse guided bend test (two specimens) shall be made to represent each lot (Note 3) of finished pipe.
- 4.2.6.1 The two bend test specimens shall be taken from the weld at the end of the finished pipe. As an alternative, by agreement between the purchaser and the manufacturer, the test specimens may be taken from a test plate of the same material

^B Where an ellipsis (...) appears in this table, there is no requirement and analysis for the element need not to be determined or reported.

^C By agreement between the manufacturer and the purchaser, the limit for columbium may be increased up to 0.05 % on heat analysis and 0.06 % on product analysis.

TABLE 2 Tensile Requirements

									quiioiii									
	Grad	de 1	Grad	de 3	Grad	de 4	Grad	de 6	Grac	de 7	Grad	e 8	Grad	le 9	Grad	e 10	Grad	e 11
	psi	MPa	psi	MPa	psi	MPa	psi	MPa	psi	MPa								
Tensile strength, min Yield strength, min	55 000 30 000		65 000 35 000		60 000 35 000		60 000 35 000		65 000 35 000		100 000 75 000		63 000 46 000		80 000 65 000		65 000 35 000	
Troid on origin, Trim	Longi-	Trans-	Longi-	Trans-	Longi-	Trans-	Longi-	Trans-	Lon									
	tudinal	verse	tudinal	verse	tudinal	verse	tudinal	verse	tudii	nal								
Elongation in 2 in. or 50 mm, (or 4D), min, %: Basic minimum elongation for walls ⁵ / ₁₆ in. [8 mm] and over in thickness, strip tests,	35	25	30	20	30	16.5	30	16.5	30	22	22		28		22		18	A
and for all small sizes tested in full section When standard round 2-in. or 50-mm gage length or proportionally smaller size test	28	20	22	14	22	12	22	12	22	14	16				16			
specimen with the gage length equal to 4D (4 times the diameter) is used For strip tests, a deduction for each ½2 in. [0.8 mm] decrease in wall thickness below 5/16 in. [8 mm] from the basic minimum elongation of the following percentage	1.75 ⁸	1.25 ^B	1.50 ⁸	1.00 ^B	1.25 ^B		1.50 ⁸		1.25 ^{<i>B</i>}									

Wall Thicknes	20						Е	Elongation	n in 2 in.	or 50 mm	n, min, %	C					
vvaii Triickries	55	Gra	de 1	Gra	de 3	Gra	de 4	Gra	de 6	Grad	de 7	Gra	de 8	Gra	de 9	Grad	le 10
in.	mm	Longi- tudinal	Trans- verse														
5/16 (0.312)	8	35	25	30	20	30	16	30	16	30	22	22		28		22	
%2 (0.281)	7.2	33	24	28	19	28	15	28	15	28	21	21		26		21	
1/4 (0.250)	6.4	32	23	27	18	27	15	27	15	27	20	20		25		20	
7/32 (0.219)	5.6	30		26		26		26		26		18		24		18	
3/16 (0.188)	4.8	28		24		24		24		24		17		22		17	
5/32 (0.156)	4	26		22		22		22		22		16		20		16	
1/8 (0.125)	3.2	25		21		21		21		21		15		19		15	
3/32 (0.094)	2.4	23		20		20		20		20		13		18		13	
1/16 (0.062)	1.6	21		18		18		18		18		12		16		12	

^A Elongation of Grade 11 is for all walls and small sizes tested in full section.

Note—The preceding table gives the computed minimum elongation values for each 1/32-in. [0.80-mm] decrease in wall thickness. Where the wall thickness lies between two values shown above, the minimum elongation value is determined by the following equation:

Grade	Direction of Test	Equation
1	Longitudinal	E = 56 t + 17.50 [E = 2.19t + 17.50]
	Transverse	E = 40 t + 12.50 [E = 1.56t + 12.50]
3	Longitudinal	E = 48 t + 15.00 [E = 1.87t + 15.00]
	Transverse	E = 32 t + 10.00 [E = 1.25t + 10.00]
4	Longitudinal	E = 48 t + 15.00 [E = 1.87t + 15.00]
	Transverse	E = 32 t + 6.50 [E = 1.25 t + 6.50]
6	Longitudinal	E = 48 t + 15.00 [E = 1.87t + 15.00]
	Transverse	E = 32 t + 6.50 [E = 1.25 t + 6.50]
7	Longitudinal	E = 48 t + 15.00 [E = 1.87t + 15.00]
	Transverse	E = 32 t + 11.00 [E = 1.25t + 11.00]
8 and 10	Longitudinal	E = 40 t + 9.50 [E = 1.56t + 9.50]
9	Longitudinal	E = 48 t + 13.00 [E = 1.87 t + 13.00]

where:

E = elongation in 2 in. or 50 mm, in %, and t = actual thickness of specimen, in. [mm].

as the pipe, the test plate being attached to the end of the pipe and welded as a prolongation of the pipe longitudinal seam.

4.2.6.2 The bend test shall be in accordance with QW-160 of Section IX of the ASME Boiler and Pressure Vessel Code.

4.2.7 Charpy V-notch Impact Tests—Impact tests on welded joints shall include tests on weld metal and heat affected zones and shall meet the same requirements as the base metal. (See Tables 3 and 4).

^B The following table gives the calculated minimum values.

^C Calculated elongation requirements shall be rounded to the nearest whole number.

TABLE 3 Impact Requirements for Grades 1, 3, 4, 6, 7, 9, 10, and 11

Size of Specimen, mm	Minimum Ave Bar Impac Each Set Specir	t Value of of Three	Minimum Notched Bar Impact Value of One Specimen Only of a Set ^A			
	ft-lbf	J	ft∙lbf	J		
10 by 10	13	18	10	14		
10 by 7.5	10	14	8	11		
10 by 6.67	9	12	7	9		
10 by 5	7	9	5	7		
10 by 3.33	5	7	3	4		
10 by 2.5	4	5	3	4		

^A Straight line interpolation for intermediate values is permitted.

TABLE 4 Impact Temperature

Grade	Minimum Impact	Test Temperature
Grade	°F	°C
1	-50	-45
3	-150	-100
4	-150	-100
6	-50	-45
7	-100	–75
8	-320	-195
9	-100	–75
10	–75	-60
11	-320	-195

- 4.2.7.1 Each set of weld metal impact test specimens shall be taken across the weld with the notch in the weld metal. Each test specimen shall be oriented so that the notch is normal to the surface of the material and one face of the specimen shall be within ½6 in. [1.5 mm] of the surface of the material.
- 4.2.7.2 Each set of heat affected zone impact test specimens shall be taken across the weld and of sufficient length to locate, after etching, the notch in the heat affected zone. The notch shall be cut approximately normal to the surface of the material in such a manner as to include as much heat affected zone material as possible in the resulting fracture.

Note 3—The term "lot" applies to all pipe (may include more than one heat of steel) within a $\frac{3}{16}$ in. [4.7 mm] range of thickness and welded to the weld procedure, and when heat treated, done to the same heat-treating procedure and in the same furnace. The maximum lot size shall be 200 linear ft [60 m] of pipe.

- 4.3 Heat Treatment:
- 4.3.1 All seamless and welded pipe, other than Grades 8 and 11, shall be treated to control their microstructure in accordance with one of the following methods:
- 4.3.1.1 Normalize by heating to a uniform temperature of not less than 1500 °F [815 °C] and cool in air or in the cooling chamber of an atmosphere controlled furnace.
- 4.3.1.2 Normalize as in 4.3.1.1, and, at the discretion of the manufacturer, reheat to a suitable tempering temperature.
- 4.3.1.3 For the seamless process only, reheat and control hot working and the temperature of the hot-finishing operation to a finishing temperature range from 1550 to 1750 °F [845 to 945 °C] and cool in air or in a controlled atmosphere furnace from an initial temperature of not less than 1550 °F [845 °C].
- 4.3.1.4 Treat as in 4.3.1.3 and, at the discretion of the manufacturer, reheat to a suitable tempering temperature.

- 4.3.1.5 Seamless pipe of Grades 1, 6, and 10 may be heat treated by heating to a uniform temperature of not less than 1500 °F [815 °C], followed by quenching in liquid and reheating to a suitable tempering temperature, in place of any of the other heat treatments provided for in 4.3.1.
- 4.3.2 Grade 8 pipe shall be heat treated by the manufacturer by either of the following methods:
- 4.3.2.1 Quenched and Tempered—Heat to a uniform temperature of 1475 \pm 25 °F [800 \pm 15 °C]; hold at this temperature for a minimum time in the ratio of 1 h/in. [2 min/mm] of thickness, but in no case less than 15 min; quench by immersion in circulating water. Reheat until the pipe attains a uniform temperature within the range from 1050 to 1125 °F [565 to 605 °C]; hold at this temperature for a minimum time in the ratio of 1 h/in. [2 min/mm] of thickness, but in no case less than 15 min; cool in air or water quench at a rate no less than 300 °F [165 °C]/h.
- 4.3.2.2 Double Normalized and Tempered—Heat to a uniform temperature of 1650 ± 25 °F [900 ± 15 °C]; hold at this temperature for a minimum time in the ratio of 1 h/in. [2 min/mm] of thickness, but in no case less than 15 min; cool in air. Reheat until the pipe attains a uniform temperature of 1450 ± 25 °F [790 ± 15 °C]; hold at this temperature for a minimum time in the ratio of 1 h/in. [2 min/mm] of thickness, but in no case less than 15 min; cool in air. Reheat to a uniform temperature within the range from 1050 to 1125 °F [565 to 605 °C]; hold at this temperature for a minimum time of 1 h/in. [2 min/mm] of thickness but in no case less than 15 min; cool in air or water quench at a rate not less than 300 °F [165 °C]/h.
- 4.3.3 Whether to anneal Grade 11 pipe is per agreement between purchaser and supplier. When Grade 11 pipe is annealed, it shall be normalized in the range of 1400 to 1600 °F [760 to 870 °C].
- 4.3.4 Material from which test specimens are obtained shall be in the same condition of heat treatment as the pipe furnished. Material from which specimens are to be taken shall be heat treated prior to preparation of the specimens.
- 4.3.5 When specified in the order the test specimens shall be taken from full thickness test pieces which have been stress relieved after having been removed from the heat-treated pipe. The test pieces shall be gradually and uniformly heated to the prescribed temperature, held at that temperature for a period of time in accordance with Table 5, and then furnace cooled at a temperature not exceeding 600 °F [315 °C]. Grade 8 shall be

TABLE 5 Stress Relieving of Test Pieces

	Metal Temp	erature ^{A,B}		Minimum Holding
Grades 1, 3,	Time, h/in. [min/mm]			
°F	°C	°F	°C	of Thickness
1100	600	1150	620	1 [2.4]
1050	565	1100	600	2 [4.7]
1000	540	1050	565	3 [7.1]

 $^{^{\}rm A}$ For intermediate temperatures, the holding time shall be determined by straight-line interpolation.

⁶ Grade 8 shall be stress relieved at 1025 to 1085 °F, [550 to 585 °C], held for a minimum time of 2 h for thickness up to 1.0 in. [25.4 mm], plus a minimum of 1 h for each additional inch [25.4 mm] of thickness and cooled at a minimum rate of 300 °F [165 °C]/h in air or water to a temperature not exceeding 600 °F [315 °C]. ^C Unless otherwise specified, Grade 4 shall be stress relieved at 1150 °F [620 °C].

cooled at a minimum rate of 300 °F [165 °C]/h in air or water to a temperature not exceeding 600 °F [315 °C].

5. Chemical Composition

- 5.1 The steel shall conform to the requirements as to chemical composition prescribed in Table 1.
- 5.2 When Grades 1, 6, or 10 are ordered under this specification, supplying an alloy grade that specifically requires the addition of any element other than those listed for the ordered grade in Table 1 is not permitted. However, the addition of elements required for the deoxidation of the steel is permitted.

6. Product Analysis

6.1 At the request of the purchaser, an analysis of one billet or two samples of flat-rolled stock from each heat or of two pipes from each lot shall be made by the manufacturer. A lot of pipe shall consist of the following:

NPS Designator
Under 2
400 or fraction thereof
2 to 6
Over 6

Length of Pipe in Lot
400 or fraction thereof
200 or fraction thereof
100 or fraction thereof

- 6.2 The results of these analyses shall be reported to the purchaser or the purchaser's representative and shall conform to the requirements specified.
- 6.3 If the analysis of one of the tests specified in 6.1 does not conform to the requirements specified, an analysis of each billet or pipe from the same heat or lot may be made, and all billets or pipe conforming to the requirements shall be accepted.

7. Tensile Requirements

7.1 The material shall conform to the requirements as to tensile properties prescribed in Table 2.

8. Impact Requirements

- 8.1 For Grades 1, 3, 4, 6, 7, 9, 10, and 11, the notched-bar impact properties of each set of three impact specimens, including specimens for the welded joint in welded pipe with wall thicknesses of 0.120 in. [3 mm] and larger, when tested at temperatures in conformance with 14.1 shall be not less than the values prescribed in Table 3.
- 8.1.1 If the impact value of one specimen is below the minimum value, or the impact values of two specimens are less than the minimum average value but not below the minimum value permitted on a single specimen, a retest shall be allowed. The retest shall consist of breaking three additional specimens and each specimen must equal or exceed the required average value. When an erratic result is caused by a defective specimen, or there is uncertainty in test procedures, a retest will be allowed.
- 8.2 For Grade 8 each of the notched bar impact specimens shall display a lateral expansion opposite the notch of not less than 0.015 in. [0.38 mm].
- 8.2.1 When the average lateral expansion value for the three impact specimens equals or exceeds 0.015 in. [0.38 mm] and the value for one specimen is below 0.015 in. [0.38 mm] but not below 0.010 in. [0.25 mm], a retest of three additional

specimens may be made. The lateral expansion of each of the retest specimens must equal or exceed 0.015 in. [0.38 mm].

- 8.2.2 Lateral expansion values shall be determined by the procedure in Test Methods and Definitions A370.
- 8.2.3 The values of absorbed energy in foot-pounds and the fracture appearance in percentage shear shall be recorded for information. A record of these values shall be retained for a period of at least 2 years.

9. Lengths

9.1 If definite lengths are not required, pipe may be ordered either in single random lengths of 16 to 22 ft (Note 4) with maximum 5 % of the lengths between 12 and 16 ft (Note 4), or in double random lengths with a minimum average of 35 ft (Note 4) and an absolute minimum length of 22 ft (Note 4) with maximum 5 % of the lengths between 16 and 22 ft (Note 4).

Note 4—This value(s) applies when the inch-pound designation of this specification is the basis of purchase. When the "M" designation of this specification is the basis of purchase, the corresponding metric value(s) shall be agreed upon between the manufacturer and purchaser.

10. Workmanship, Finish, and Appearance

- 10.1 The pipe manufacturer shall explore a sufficient number of visual surface imperfections to provide reasonable assurance that they have been properly evaluated with respect to depth. Exploration of all surface imperfections is not required but may be necessary to ensure compliance with 10.2.
- 10.2 Surface imperfections that penetrate more than $12\frac{1}{2}$ % of the nominal wall thickness or encroach on the minimum wall thickness shall be considered defects. Pipe with such defects shall be given one of the following dispositions:
- 10.2.1 The defect may be removed by grinding provided that the remaining wall thickness is within specified limits.
- 10.2.2 Repaired in accordance with the repair welding provisions of 10.5.
- 10.2.3 The section of pipe containing the defect may be cut off within the limits of requirements on length.
 - 10.2.4 The defective pipe may be rejected.
- 10.3 To provide a workmanlike finish and basis for evaluating conformance with 10.2, the pipe manufacturer shall remove by grinding the following:
- 10.3.1 Mechanical marks, abrasions and pits, any of which imperfections are deeper than $\frac{1}{16}$ in. [1.6 mm], and
- 10.3.2 Visual imperfections commonly referred to as scabs, seams, laps, tears, or slivers found by exploration in accordance with 10.1 to be deeper than 5% of the nominal wall thickness.
- 10.4 At the purchaser's discretion, pipe shall be subject to rejection if surface imperfections acceptable under 10.2 are not scattered, but appear over a large area in excess of what is considered a workmanlike finish. Disposition of such pipe shall be a matter of agreement between the manufacturer and the purchaser.
- 10.5 When imperfections or defects are removed by grinding, a smooth curved surface shall be maintained, and the wall thickness shall not be decreased below that permitted by

this specification. The outside diameter at the point of grinding may be reduced by the amount so removed.

- 10.5.1 Wall thickness measurements shall be made with a mechanical caliper or with a properly calibrated nondestructive testing device of appropriate accuracy. In case of dispute, the measurement determined by use of the mechanical caliper shall govern.
- 10.6 Weld repair shall be permitted only subject to the approval of the purchaser and in accordance with Specification A999/A999M.
 - 10.7 The finished pipe shall be reasonably straight.

11. General Requirements

11.1 Material furnished to this specification shall conform to the applicable requirements of the current edition of Specification A999/A999M unless otherwise provided herein.

12. Mechanical Testing

- 12.1 Sampling—For mechanical testing, the term "lot" applies to all pipe of the same nominal size and wall thickness (or schedule) that is produced from the same heat of steel and subjected to the same finishing treatment in a continuous furnace. If the final heat treatment is in a batch-type furnace, the lot shall include only those pipes that are heat treated in the same furnace charge.
- 12.2 Transverse or Longitudinal Tensile Test and Flattening Test—For material heat treated in a batch-type furnace, tests shall be made on 5 % of the pipe from each lot. If heat treated by the continuous process, tests shall be made on a sufficient number of pipe to constitute 5 % of the lot, but in no case less than 2 pipes.
- 12.3 Impact Test—One notched bar impact test, consisting of breaking three specimens, shall be made from each heat represented in a heat-treatment load on specimens taken from the finished pipe. This test shall represent only pipe from the same heat and the same heat-treatment load, the wall thicknesses of which do not exceed by more than ½ in. [6.3 mm] the wall thicknesses of the pipe from which the test specimens are taken. If heat treatment is performed in continuous or batchtype furnaces controlled within a 50 °F [30 °C] range and equipped with recording pyrometers so that complete records of heat treatment are available, then one test from each heat in a continuous run only shall be required instead of one test from each heat in each heat-treatment load.
- 12.4 *Impact Tests (Welded Pipe)*—On welded pipe, additional impact tests of the same number as required in 12.3 shall be made to test the weld.
- 12.5 Specimens showing defects while being machined or prior to testing may be discarded and replacements shall be considered as original specimens.
- 12.6 Results obtained from these tests shall be reported to the purchaser or his representative.

13. Specimens for Impact Test

13.1 Notched bar impact specimens shall be of the simple beam, Charpy-type, in accordance with Test Methods E23,

Type A with a V notch. Standard specimens 10 by 10 mm in cross section shall be used unless the material to be tested is of insufficient thickness, in which case the largest obtainable subsize specimens shall be used. Charpy specimens of width along the notch larger than 0.394 in. [10 mm] or smaller than 0.099 in. [2.5 mm] are not provided for in this specification.

- 13.2 Test specimens shall be obtained so that the longitudinal axis of the specimen is parallel to the longitudinal axis of the pipe while the axis of the notch shall be perpendicular to the surface. On wall thicknesses of 1 in. [25 mm] or less, the specimens shall be obtained with their axial plane located at the midpoint; on wall thicknesses over 1 in. [25 mm], the specimens shall be obtained with their axial plane located ½ in. [12.5 mm] from the outer surface.
- 13.3 When testing welds the specimen shall be, whenever diameter and thickness permit, transverse to the longitudinal axis of the pipe with the notch of the specimen in the welded joint and perpendicular to the surface. When diameter and thickness do not permit obtaining transverse specimens, longitudinal specimens in accordance with 13.2 shall be obtained; the bottom of the notch shall be located at the weld joint.

14. Impact Test

- 14.1 Except when the size of the finished pipe is insufficient to permit obtaining subsize impact specimens, all material furnished to this specification and marked in accordance with Section 16 shall be tested for impact resistance at the minimum temperature for the respective grades as shown in Table 4.
- 14.1.1 Special impact tests on individual lots of material may be made at other temperatures as agreed upon between the manufacturer and the purchaser.
- 14.1.2 When subsize Charpy impact specimens are used and the width along the notch is less than 80 % of the actual wall thickness of the original material, the specified Charpy impact test temperature for Grades 1, 3, 4, 6, 7, 9, 10, and 11 shall be lower than the minimum temperature shown in Table 4 for the respective grade. Under these circumstances the temperature reduction values shall be by an amount equal to the difference (as shown in Table 6) between the temperature reduction corresponding to the actual material thickness and the temperature reduction corresponding to the Charpy specimen width

TABLE 6 Impact Temperature Reduction

	Nidth Along Notch or Actual laterial Thickness		Reduction, Colder ^A
in.	mm	°F	°C
0.394	10 (standard size)	0	0
0.354	9	0	0
0.315	8	0	0
0.295	7.5 (3/4 std. size)	5	3
0.276	7	8	4
0.262	6.67 (3 std. size)	10	5
0.236	6	15	8
0.197	5 (1/2 std. size)	20	11
0.158	4	30	17
0.131	3.33 (1/3 std. size)	35	19
0.118	3	40	22
0.099	2.5 (1/4 std. size)	50	28

^A Straight line interpolation for intermediate values is permitted.

actually tested. Appendix X1 shows some examples of how the temperature reductions are determined.

- 14.2 The notched bar impact test shall be made in accordance with the procedure for the simple beam, Charpy-type test of Test Methods E23.
- 14.3 Impact tests specified for temperatures lower than 70 °F [20 °C] should be made with the following precautions. The impact test specimens as well as the handling tongs shall be cooled a sufficient time in a suitable container so that both reach the desired temperature. The temperature shall be measured with thermocouples, thermometers, or any other suitable devices and shall be controlled within 3 °F [2 °C]. The specimens shall be quickly transferred from the cooling device to the anvil of the Charpy impact testing machine and broken with a time lapse of not more than 5 s.

15. Hydrostatic or Nondestructive Electric Test

- 15.1 Each pipe shall be subjected to the nondestructive electric test or the hydrostatic test. The type of test to be used shall be at the option of the manufacturer, unless otherwise specified in the purchase order.
- 15.2 The hydrostatic test shall be in accordance with Specification A999/A999M.
- 15.3 *Nondestructive Electric Test*—Nondestructive electric tests shall be in accordance with Specification A999/A999M, with the following addition:
- 15.3.1 If the test signals were produced by visual imperfections (listed in 15.3.2), the pipe may be accepted based on visual examination, provided the imperfection is less than 0.004 in. (0.1 mm) or $12\frac{1}{2}$ % of the specified wall thickness (whichever is greater).

- 15.3.2 Visual Imperfections:
- 15.3.2.1 Scratches,
- 15.3.2.2 Surface roughness,
- 15.3.2.3 Dings,
- 15.3.2.4 Straightener marks,
- 15.3.2.5 Cutting chips,
- 15.3.2.6 Steel die stamps,
- 15.3.2.7 Stop marks, or
- 15.3.2.8 Pipe reducer ripple.

16. Product Marking

- 16.1 Except as modified in 16.1.1, in addition to the marking prescribed in Specification A999/A999M, the marking shall include whether hot finished, cold drawn, seamless or welded, the schedule number and the letters "LT" followed by the temperature at which the impact tests were made, except when a lower test temperature is required because of reduced specimen size, in which case, the higher impact test temperature applicable to a full-size specimen should be marked.
- 16.1.1 When the size of the finished pipe is insufficient to obtain subsize impact specimens, the marking shall not include the letters "LT" followed by an indicated test temperature unless Supplementary Requirement S1 is specified.
- 16.1.2 When the pipe is furnished in the quenched and tempered condition, the marking shall include the letters "QT," and the heat treatment condition shall be reported to the purchaser or his representative.

17. Keywords

17.1 low; low temperature service; seamless steel pipe; stainless steel pipe; steel pipe; temperature service applications

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirement shall apply only when specified by the purchaser in the contract or order.

S1. Subsize Impact Specimens

S1.1 When the size of the finished pipe is insufficient to permit obtaining subsize impact specimens, testing shall be a matter of agreement between the manufacturer and the purchaser.

S2. Requirements for Pipe for Hydrofluoric Acid Alkylation Service

- S2.1 The carbon equivalent (CE), based on heat analysis, shall not exceed 0.43 % if the specified wall thickness is equal to or less than 1 in. [25.4 mm] or 0.45 % if the specified wall thickness is greater than 1 in. [25.4 mm].
- S2.2 The carbon equivalent shall be determined using the following formula:
 - CE = C + Mn/6 + (Cr + Mo + V)/5 + (Ni + Cu)/15

- S2.3 Based upon heat analysis in mass percent, the vanadium content shall not exceed 0.02 %, the niobium content shall not exceed 0.02 % and the sum of the vanadium and niobium contents shall not exceed 0.03 %.
- S2.4 Based upon heat analysis in mass percent, the sum of the nickel and copper contents shall not exceed 0.15 %.
- S2.5 Based upon heat analysis in mass percent, the carbon content shall not be less than 0.18 %.
- S2.6 Welding consumables for repair welds shall be of low hydrogen type. E60XX electrodes shall not be used, and the resultant weld chemistry shall meet the chemical composition requirements specified for the pipe.
- S2.7 The designation "HF" shall be stamped or marked on each pipe to signify that the pipe complies with this supplementary requirement.

APPENDIX

(Nonmandatory Information)

X1. DETERMINATION OF TEMPERATURE REDUCTIONS

- X1.1 Under the circumstances stated in 14.1.2, the impact test temperatures specified in Table 4 must be lowered. The following examples are offered to describe the application of the provisions of 14.1.2.
- X1.1.1 When subsize specimens are used (see 10.1) and the width along the notch of the subsize specimen in 80% or greater of the actual wall thickness of the original material, the provisions of 14.1.2 do not apply.
- X1.1.1.1 For example, if the actual wall thickness of pipe was 0.200 in. [5.0 mm] and the width along the notch of the largest subsize specimen obtainable is 0.160 in. [4 mm] or greater, no reduction in test temperature is required.
- X1.1.2 When the width along the subsize specimen notch is less than 80 % of the actual wall thickness of the pipe, the

required reduction in test temperature is computed by taking the difference between the temperature reduction values shown in Table 6 for the actual pipe thickness and the specimen width used.

X1.1.2.1 For example, if the pipe were 0.262 in. [6.67 mm] thick and the width along the Charpy specimen notch was 3.33 mm (1/3 standard size), the test temperature would have to be lowered by 25 °F [14 °C]. That is, the temperature reduction corresponding to the subsize specimen is 35 °F [19 °C]; the temperature reduction corresponding to the actual pipe thickness is 10 °F [5 °C]; the difference between these two values is the required reduction in test temperature.



SPECIFICATION FOR SEAMLESS AND WELDED CARBON AND ALLOY-STEEL TUBES FOR LOW-TEMPERATURE SERVICE



SA-334/SA-334M



(Identical with ASTM Specification A334/A334M-04a(2016).)

SPECIFICATION FOR SEAMLESS AND WELDED CARBON AND ALLOY-STEEL TUBES FOR LOW-TEMPERATURE SERVICE



SA-334/SA-334M



[Identical with ASTM Specification A 334/A 334M-04a(2016).]

1. Scope

- 1.1 This specification covers several grades of minimum-wall-thickness, seamless and welded, carbon and alloy-steel tubes intended for use at low temperatures. Some product sizes may not be available under this specification because heavier wall thicknesses have an adverse affect on low-temperature impact properties.
- **1.2** Supplementary Requirement S1 of an optional nature is provided. This shall apply only when specified by the purchaser.
- NOTE 1 For tubing smaller than $\frac{1}{2}$ in. [12.7 mm] in outside diameter, the elongation values given for strip specimens in Table 1 shall apply. Mechanical property requirements do not apply to tubing smaller than $\frac{1}{8}$ in. [3.2 mm] in outside diameter and with a wall thickness under 0.015 in. [0.4 mm].
- 1.3 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.

2. Referenced Documents

- **2.1** ASTM Standards:
- A 370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A 1016/A 1016M Specification for General Requirements for Ferritic Alloy Steel, Austenitic Alloy Steel, and Stainless Steel Tubes

E 23 Test Methods for Notched Bar Impact Testing of Metallic Materials

3. Ordering Information

- **3.1** Orders for material under this specification should include the following, as required to describe the desired material adequately:
 - **3.1.1** Quantity (feet, metres, or number of lengths),
 - **3.1.2** Name of material (seamless or welded tubes),
 - **3.1.3** Grade (Table 1),
- **3.1.4** Size (outside diameter and minimum wall thickness),
 - **3.1.5** Length (specific or random),
- **3.1.6** Optional requirements (other temperatures, Section 14; hydrostatic or electric test, Section 16),
- **3.1.7** Test report required, (Certification Section of Specification A 1016/A 1016M),
 - 3.1.8 Specification designation, and
- **3.1.9** Special requirements and any supplementary requirements selected.

4. General Requirements

4.1 Material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A 1016/A 1016M, unless otherwise provided herein.

5. Materials and Manufacture

5.1 The tubes shall be made by the seamless or automatic welding process with no addition of filler metal in the welding operation.

6. Heat Treatment

- **6.1** All seamless and welded tubes, other than Grades 8 and 11, shall be treated to control their microstructure in accordance with one of the following methods:
- **6.1.1** Normalize by heating to a uniform temperature of not less than 1550°F [845°C] and cool in air or in the cooling chamber of an atmosphere controlled furnace.
- **6.1.2** Normalize as in 10.1.1, and, at the discretion of the manufacturer, reheat to a suitable tempering temperature.
- **6.1.3** For the seamless process only, reheat and control hot working and the temperature of the hot-finishing operation to a finishing temperature range from 1550 to 1750°F [845 to 955°C] and cool in a controlled atmosphere furnace from an initial temperature of not less than 1550°F [845°C].
- **6.1.4** Treat as in 6.1.3 and, at the discretion of the manufacturer, reheat to a suitable tempering temperature.
- **6.2** Grade 8 tubes shall be heat treated by the manufacturer by either of the following methods.
- **6.2.1** Quenched and Tempered Heat to a uniform temperature of $1475 \pm 25^{\circ}F$ [$800 \pm 15^{\circ}C$]; hold at this temperature for a minimum time in the ratio of 1 h/in. [2 min/mm] of thickness, but in no case less than 15 min; quench by immersion in circulating water. Reheat until the pipe attains a uniform temperature within the range from 1050 to $1125^{\circ}F$ [565 to $605^{\circ}C$]; hold at this temperature for a minimum time in the ratio of 1 h/in. [2 min/mm] of thickness, but in no case less than 15 min; cool in air or water quench at a rate no less than $300^{\circ}F$ [$165^{\circ}C$]/h.
- **6.2.2** Double Normalized and Tempered Heat to a uniform temperature of $1650 \pm 25^{\circ}F$ [900 $\pm 15^{\circ}C$]; hold at this temperature for a minimum time in the ratio of 1 h/in. [2 min/mm] of thickness, but in no case less than 15 min; cool in air. Reheat until the pipe attains a uniform temperature of $1450 \pm 25^{\circ}F$ [790 $\pm 15^{\circ}C$]; hold at this temperature for a minimum time in the ratio of 1 h/in. [2 min/mm] of thickness, but in no case less than 15 min; cool in air. Reheat to a uniform temperature within the range from 1050 to $1125^{\circ}F$ [565 to $605^{\circ}C$]; hold at this temperature for a minimum time of 1 h/in. [2 min/mm] of thickness but in no case less than 15 min; cool in air or water quench at a rate not less than $300^{\circ}F$ [$165^{\circ}C$]/h.
- **6.3** Material from which impact specimens are obtained shall be in the same condition of heat treatment as the finished tubes.
- **6.4** Whether to anneal Grade 11 tubes is per agreement between purchaser and supplier. When Grade 11 tubes are annealed they shall be normalized in the range of 1400 to 1600°F [760 to 870°C].

7. Chemical Composition

- **7.1** The steel shall conform to the requirements as to chemical composition prescribed in Table 1.
- **7.2** When Grades 1 or 6 are ordered under this specification, supplying an alloy grade that specifically requires the addition of any element other than those listed for the ordered grade in Table 1 is not permitted. However, the addition of elements required for the deoxidation of the steel is permitted.

8. Product Analysis

- **8.1** An analysis of either one billet or one length of flat-rolled stock or one tube shall be made for each heat. The chemical composition thus determined shall conform to the requirements specified.
- **8.2** If the original test for product analysis fails, retests of two additional billets, lengths of flat-rolled stock, or tubes shall be made. Both retests, for the elements in question, shall meet the requirements of the specification; otherwise all remaining material in the heat or lot shall be rejected or, at the option of the manufacturer, each billet, length of flat-rolled stock, or tube may be individually tested for acceptance. Billets, lengths of flat-rolled stock, or tubes which do not meet the requirements of the specification shall be rejected.

9 Sampling

- **9.1** For flattening, flare, and flange requirements, the term *lot* applies to all tubes prior to cutting of the same nominal size and wall thickness which are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and from the same heat which are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, the number of tubes of the same size and from the same heat in a lot shall be determined from the size of the tubes as prescribed in Table 2.
- 9.2 For tensile and hardness test requirements, the term *lot* applies to all tubes prior to cutting, of the same nominal diameter and wall thickness which are produced from the same heat of steel. When final heat treatment is in a batchtype furnace, a lot shall include only those tubes of the same size and the same heat which are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, a lot shall include all tubes of the same size and heat, heat treated in the same furnace at the same temperature, time at heat and furnace speed.

10. Tensile Requirements

10.1 The material shall conform to the requirements as to tensile properties prescribed in Table 3.

11. Hardness Requirements

11.1 The tubes shall have a hardness number not exceeding those prescribed in Table 4.

12. Impact Requirements

- **12.1** For Grades 1, 3, 6, 7 and 9, the notched-bar impact properties of each set of three impact specimens, including specimens for the welded joint in welded pipe with wall thicknesses of 0.120 in. [3 mm] and larger, when tested at temperatures in conformance with 14.1 shall be not less than the values prescribed in Table 5. The impact test is not required for Grade 11.
- 12.1.1 If the impact value of one specimen is below the minimum value, or the impact values of two specimens are less than the minimum average value but not below the minimum value permitted on a single specimen, a retest shall be allowed. The retest shall consist of breaking three additional specimens and each specimen must equal or exceed the required average value. When an erratic result is caused by a defective specimen, or there is uncertainty in test procedures, a retest will be allowed.
- **12.2** For Grade 8 each of the notched bar impact specimens shall display a lateral expansion opposite the notch not less than 0.015 in. [0.38 mm].
- 12.2.1 When the average lateral expansion value for the three impact specimens equals or exceeds 0.015 in. [0.38 mm] and the value for one specimen is below 0.015 in. [0.38 mm] but not below 0.010 in. [0.25 mm], a retest of three additional specimens may be made. The lateral expansion of each of the retest specimens must equal or exceed 0.015 in. [0.38 mm].
- **12.2.2** Lateral expansion values shall be determined in accordance with Test Methods and Definitions A 370.
- **12.2.3** The values of absorbed energy in foot-pounds and the fracture appearance in percentage shear shall be recorded for information. A record of these values shall be retained for a period of at least 2 years.

13. Mechanical Tests

- **13.1** Tension Test One tension test shall be made on a specimen for lots of not more than 50 tubes. Tension tests shall be made on specimens from two tubes for lots of more than 50 tubes.
- **13.2** Flattening Test One flattening test shall be made on specimens from each end of one finished tube of each lot but not the one used for the flare or flange test.
- **13.3** Flare Test (Seamless Tubes) One flare test shall be made on specimens from each end of one finished tube of each lot, but not the one used for the flattening test.

- **13.4** Flange Test (Welded Tubes) One flange test shall be made on specimens from each end of one finished tube of each lot, but not the one used for the flattening test.
- **13.5** Reverse Flattening Test For welded tubes, one reverse flattening test shall be made on a specimen from each 1500 ft [460 m] of finished tubing.
- **13.6** Hardness Test Brinell or Rockwell hardness tests shall be made on specimens from two tubes from each lot.
- 13.7 Impact Tests One notched-bar impact test, consisting of breaking three specimens, shall be made from each heat represented in a heat-treatment load on specimens taken from the finished tube. This test shall represent only tubes from the same heat, which have wall thicknesses not exceeding by more than ¼ in. [6.3 mm] the wall thicknesses of the tube from which the test specimens are taken. If heat treatment is performed in continuous or batch-type furnaces controlled within a 50°F [30°C] range and equipped with recording pyrometers which yield complete heat-treatment records, then one test from each heat in a continuous run only shall be required instead of one test from each heat in each heat-treatment load.
- **13.8** *Impact Tests (Welded Tubes)* On welded tube, additional impact tests of the same number as required in 13.7 shall be made to test the weld.
- **13.9** Specimens showing defects while being machined or prior to testing may be discarded and replacements shall be considered as original specimens.

14. Specimens for Impact Test

- 14.1 Notched-bar impact specimens shall be of the simple beam, Charpy-type, in accordance with Test Methods E 23, Type A, with a V notch. Standard specimens 10 by 10 mm in cross section shall be used unless the material to be tested is of insufficient thickness, in which case the largest obtainable subsize specimens shall be used. Charpy specimens of width along the notch larger than 0.394 in. [10 mm] or smaller than 0.099 in. [2.5 mm] are not provided for in this specification.
- 14.2 Test specimens shall be obtained so that the longitudinal axis of the specimen is parallel to the longitudinal axis of the tube while the axis of the notch shall be perpendicular to the surface. On wall thicknesses of 1 in. [25 mm] or less, the specimens shall be obtained with their axial plane located at the midpoint; on wall thicknesses over 1 in. [25 mm], the specimens shall be obtained with their axial plane located $\frac{1}{2}$ in. [12.5 mm] from the outer surface.
- 14.3 When testing welds the specimen shall be, whenever diameter and thickness permits, transverse to the longitudinal axis of the tube with the notch of the specimen

in the welded joint and perpendicular to the surface. When diameter and thickness does not permit obtaining transverse specimens, longitudinal specimens in accordance with 14.2 shall be obtained. The bottom of the notch shall be located at the weld joint.

15. Impact Test

- 15.1 Except when the size of the finished tube is insufficient to permit obtaining subsize impact specimens, all material furnished under this specification and marked in accordance with Section 17 shall be tested for impact resistance at the temperature for the respective grades as prescribed in Table 6.
- **15.1.1** Special impact tests on individual lots of material may be made at other temperatures if agreed upon between the manufacturer and the purchaser.
- **15.2** The notched-bar impact test shall be made in accordance with the procedure for the simple beam, Charpy-type of test of Test Methods E 23.
- 15.3 Impact tests specified for temperatures lower than $+70^{\circ}F$ [20°C] should be made with the following precautions. The impact test specimens as well as the handling tongs shall be cooled a sufficient time in a suitable container so that both reach the desired temperature. The temperature shall be measured with thermocouples, thermometers, or any other suitable devices and shall be controlled within $\pm 3^{\circ}F$ [2°C]. The specimens shall be quickly transferred from the cooling device to the anvil of the Charpy impact testing machine and broken with a time lapse of not more than 5 s.
- 15.4 When subsize Charpy impact specimens are used and the width along the notch is less than 80% of the actual wall thickness of the original material, the specified Charpy

impact test temperature for Grades 1, 3, 6, 7, and 9 shall be lower than the minimum temperature shown in Table 6 for the respective grade. Under these circumstances the temperature reduction values shall be by an amount equal to the difference (as shown in Table 7) between the temperature reduction corresponding to the actual material thickness and the temperature reduction corresponding to Charpy specimen width actually tested. The appendix shows some examples of how the temperature reductions are determined.

16. Hydrostatic or Nondestructive Electric Test

16.1 Each tube shall be subjected to the nondestructive electric test or the hydrostatic test in accordance with Specification A 1016/A 1016M. The type of test to be used shall be at the option of the manufacturer, unless otherwise specified in the purchase order.

17. Product Marking

- 17.1 Except as modified in 16.1.1, in addition to the marking prescribed in Specification A 1016/A 1016M, the marking shall include whether hot-finished, cold-drawn, seamless, or welded, and the letters "LT" followed by the temperature at which the impact tests were made, except when a lower test temperature is required because of reduced specimen size, in which case, the higher impact test temperature applicable to a full-size specimen should be marked.
- 17.1.1 When the size of the finished tube is insufficient to obtain subsize impact specimens, the marking shall not include the letters LT followed by an indicated test temperature unless Supplementary Requirement S1 is specified.

TABLE 1
CHEMICAL REQUIREMENTS

				Composition, %			
Element	Grade 1 [Note (1)]	Grade 3	Grade 6 [Note (1)]	Grade 7	Grade 8	Grade 9	Grade 11
Carbon, max	0.30	0.19	0.30	0.19	0.13	0.20	0.10
Manganese	0.40-1.06	0.31-0.64	0.29-1.06	0.90 max	0.90 max	0.40-1.06	0.60 max
Phosphorus, max	0.025	0.025	0.025	0.025	0.025	0.025	0.025
Sulfur, max	0.025	0.025	0.025	0.025	0.025	0.025	0.025
Silicon		0.18-0.37	0.10 min	0.13-0.32	0.13-0.32		0.35 max
Nickel		3.18-3.82		2.03-2.57	8.40-9.60	1.60-2.24	35.0-37.0
Chromium							0.50 max
Copper						0.75-1.25	
Cobalt							0.50 max
Molybdenum							0.50 max

NOTE:

TABLE 2 HEAT-TREATMENT LOT

Size of Tube	Size of Lot
2 in. [50.8 mm] and over in outside diameter and 0.200 in. [5.1 mm] and over in wall thickness	not more than 50 tubes
Under 2 in. [50.8 mm] but over 1 in. [25.4 mm] in outside diameter, or over 1 in. [25.4 mm] in outside diameter and under 0.200 in. [5.1 mm] in thickness	not more than 75 tubes
1 in. [25.4 mm] or under in outside diameter	not more than 125 tubes

⁽¹⁾ For each reduction of 0.01% carbon below 0.30%, an increase of 0.05% manganese above 1.06% will be permitted to a maximum of 1.35% manganese.

TABLE 3
TENSILE REQUIREMENTS

	Gra	ade 1	Gra	ade 3	Gr	ade 6	Gr	ade 7	Gra	ade 8	Gra	ade 9	Gra	de 11
-	ksi	MPa	ksi	MPa	ksi	MPa	ksi	МРа	ksi	MPa	ksi	MPa	ksi	MPa
Tensile Strength, min Yield Strength, min	55 30	380 205	65 35	450 240	60 35	415 240	65 35	450 240	100 75	690 520	63 46	435 315	65 35	450 240
Elongation in 2 in. or 50 mm (or 4 <i>D</i>), min, %: Basic minimum elongation for walls $\frac{5}{16}$ in. [8 mm] and over in thickness, strip tests, and for all small sizes tested in full section		35		30		30		30		22		28	18 [N	ote (1)]
When standard round 2 in. or 50 mm gage length or proportionally smaller size specimen with the gage length equal to 4 <i>D</i> (4 times the diameter) is used		28		22		22		22		16				
For strip tests, a deduction for each $^{1}/_{32}$ in. [0.8 mm] decrease in wall thickness below $^{5}/_{16}$ in. [8 mm] from the basic minimum elongation of the following percentage points		.75 te (2)]		.50 te (2)]		1.50 te (2)]		1.50 te (2)]		.25 te (2)]		.50 te (2)]		

NOTES:

- (1) Elongation of Grade 11 is for all walls and for small sizes tested in full section.
- (2) The following table gives the calculated minimum values:

Wall Thick	ness		Elongation in 2 in. or 50 mm, min % [Note (1)]										
in.	mm	Grade 1	Grade 3	Grade 6	Grade 7	Grade 8	Grade 9						
⁵ / ₁₆ (0.312)	8	35	30	30	30	22	28						
⁹ / ₃₂ (0.281)	7.2	33	28	28	28	21	26						
$\frac{1}{4}$ (0.250)	6.4	32	27	27	27	20	25						
$\frac{7}{32}$ (0.219)	5.6	30	26	26	26	18	24						
$\frac{3}{16}$ (0.188)	4.8	28	24	24	24	17	22						
⁵ / ₃₂ (0.156)	4	26	22	22	22	16	20						
¹ / ₈ (0.125)	3.2	25	21	21	21	15	19						
$\frac{3}{32}$ (0.094)	2.4	23	20	20	20	13	18						
$\frac{1}{16}$ (0.062)	1.6	21	18	18	18	12	16						

NOTE:

(1) Calculated elongation requirements shall be rounded to the nearest whole number.

NOTE: The above table gives the computed minimum elongation values for each $\frac{1}{32}$ in. [0.8 mm] decrease in wall thickness. Where the wall thickness lies between two values shown above, the minimum elongation value is determined by the following equations.

Grade	Equation [Note (3)]						
1	E = 56t + 17.50 [E = 2.19t + 17.50]						
3	E = 48t + 15.00 [E = 1.87t + 15.00]						
6	E = 48t + 15.00 [E = 1.87t + 15.00]						
7	E = 48t + 15.00 [E = 1.87t + 15.00]						
8	E = 40t + 9.50 [E = 1.56t + 9.50]						
9	E = 48t + 13.00 [E = 1.87t + 13.00]						

where:

E= elongation in 2 in. or 50 mm, %, and

t= actual thickness of specimen, in. $\mbox{\sc Emm}$].

TABLE 4
MAXIMUM HARDNESS NUMBER

Grade	Rockwell	Brinell
1	B 85	163
3	B 90	190
6	B 90	190
7	B 90	190
8		
11	B 90	190

TABLE 5
IMPACT REQUIREMENTS FOR GRADES 1, 3, 6, 7, AND 9

Size of	Minimum Aver Bar Impact Valu of Three Specim	ie of Each Set	Minimum Notched Bar Impact Value of One Specimen Only of a Set [Note (1)]		
Specimen, mm	ft·lbf	J	ft·lbf	J	
10 by 10	13	18	10	14	
10 by 7.5	10	14	8	11	
10 by 6.67	9	12	7	9	
10 by 5	7	9	5	7	
10 by 3.33	5	7	3	4	
10 by 2.5	4	5	3	4	

NOTE:

(1) Straight line interpolation for intermediate values is permitted.

TABLE 6
IMPACT TEMPERATURE

	Impact Test	Temperature
Grade	°F	°C
1	-50	-45
3	-150	-100
6	-50	-45
7	-100	- 75
8	-320	-195
9	-100	-75

TABLE 7
IMPACT TEMPERATURE REDUCTION

	/idth Along Notch or Actual al Thickness [Note (1)]		e Reduction, s Colder
Inches	Millimeters	°F	°C
0.394	10 (standard size)	0	0
0.354	9	0	0
0.315	8	0	0
0.295	7.5 ($\frac{3}{4}$ standard size)	5	3
0.276	7	8	4
0.262	6.67 ($\frac{2}{3}$ standard size)	10	5
0.236	6	15	8
0.197	$5 (\frac{1}{2} \text{ standard size})$	20	11
0.158	4	30	17
0.131	3.33 ($\frac{1}{3}$ standard size)	35	19
0.118	3	40	22
0.099	2.5 ($\frac{1}{4}$ standard size)	50	28

NOTE:

⁽¹⁾ Straight line interpolation for intermediate values is permitted.

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirement shall apply only when specified by the purchaser in the inquiry, contract, or order.

S1. Nonstandard Test Specimens

S1.1 When the size of the finished tube is insufficient to permit obtaining subsize impact specimens, testing shall be a matter of agreement between the manufacturer and the purchaser.

APPENDIX

(Nonmandatory Information)

X1. DETERMINATION OF TEMPERATURE REDUCTIONS

- **X1.1** Under the circumstances stated in 15.4, the impact test temperatures specified in Table 6 must be lowered. The following examples are offered to describe the application of the provisions of 15.4.
- **X1.1.1** When subsize specimens are used (see 14.1) and the width along the notch of the subsize specimen is 80% or greater of the actual wall thickness of the original material, the provisions of 15.4 do not apply.
- **X1.1.1.1** For example, if the actual wall thickness of pipe was 0.200 in. [5.0 mm] and the width along the notch of the largest subsize specimen obtainable is 0.160 in. [4 mm] or greater, no reduction in test temperature is required.
- **X1.1.2** When the width along the subsize specimen notch is less than 80% of the actual wall thickness of the pipe, the required reduction in test temperature is computed by taking the difference between the temperature reduction values shown in Table 7 for the actual pipe thickness and the specimen width used.
- **X1.1.2.1** For example, if the pipe were 0.262 in. [6.67 mm] thick and the width along the Charpy specimen notch was 3.33 mm ($\frac{1}{3}$ standard size), the test temperature would have to be lowered by 25°F [14°C] (that is, the temperature reduction corresponding to the subsize specimen is 35°F [19°C], the temperature reduction corresponding to the actual pipe thickness is 10°F [5°C]; the difference between these two values is the required reduction in test temperature).



SPECIFICATION FOR SEAMLESS FERRITIC ALLOY-STEEL PIPE FOR HIGH-TEMPERATURE SERVICE



SA-335/SA-335M

(Identical with ASTM Specification A335/A335M-18 except for the revision to 9.5 to replace the words "as agreed upon in accordance with Note D in Table 2" with "performed".)

Standard Specification for Seamless Ferritic Alloy-Steel Pipe for High-Temperature Service

1. Scope

- 1.1 This specification covers nominal wall and minimum wall seamless ferritic alloy-steel pipe intended for high-temperature service. Pipe ordered to this specification shall be suitable for bending, flanging (vanstoning), and similar forming operations, and for fusion welding. Selection will depend upon design, service conditions, mechanical properties, and high-temperature characteristics.
- 1.2 Several grades of ferritic steels (see Note 1) are covered. Their compositions are given in Table 1.

Note 1—Ferritic steels in this specification are defined as low- and intermediate-alloy steels containing up to and including $10\,\%$ chromium.

- 1.3 Supplementary requirements (S1 to S8) of an optional nature are provided. Supplementary requirements S1 through S6 call for additional tests to be made, and when desired, shall be so stated in the order together with the number of such tests required.
- 1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.

Note 2—The dimensionless designator NPS (nominal pipe size) has been substituted in this standard for such traditional terms as "nominal diameter," "size," and "nominal size."

1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A999/A999M Specification for General Requirements for Alloy and Stainless Steel Pipe
- E92 Test Methods for Vickers Hardness and Knoop Hardness of Metallic Materials
- E213 Practice for Ultrasonic Testing of Metal Pipe and Tubing
- E309 Practice for Eddy Current Examination of Steel Tubular Products Using Magnetic Saturation
- E381 Method of Macroetch Testing Steel Bars, Billets, Blooms, and Forgings
- E527 Practice for Numbering Metals and Alloys in the Unified Numbering System (UNS)
- E570 Practice for Flux Leakage Examination of Ferromagnetic Steel Tubular Products
- 2.2 ASME Standard:
- B36.10M Welded and Seamless Wrought Steel Pipe
- 2.3 AWS Specifications
- A5.5/A5.5M Specification for Low-Alloy Steel Electrodes for Shielded Metal Arc Welding
- A5.23/A5.23M Specification for Low-Alloy Steel Electrodes and Fluxes for Submerged Arc Welding
- A5.28/A5.28M Specification for Low-Alloy Steel Electrodes for Gas Shielded Arc Welding

TABLE 1 Chemical Requirements

	UNS			Com	position, %				
Grade	Designa-		Mon	Phos-				Molybde-	
Crade	tion ^A	Carbon	Man- ganese	phorus, max	Sulfur, max	Silicon	Chromium	num	Others
P1	K11522	0.10-0.20	0.30-0.80	0.025	0.025	0.10-0.50		0.44-0.65	
P2	K11547	0.10-0.20	0.30-0.61	0.025	0.025	0.10-0.30	0.50-0.81	0.44-0.65	
P5	K41545	0.15 max	0.30-0.60	0.025	0.025	0.50 max	4.00-6.00	0.45 - 0.65	
P5b	K51545	0.15 max	0.30-0.60	0.025	0.025	1.00-2.00	4.00-6.00	0.45 - 0.65	
P5c	K41245	0.12 max	0.30-0.60	0.025	0.025	0.50 max	4.00-6.00	0.45-0.65	^B
P9	K90941	0.15 max	0.30-0.60	0.025	0.025	0.25-1.00	8.00-10.00	0.90-1.10	
P11	K11597	0.05-0.15	0.30-0.60	0.025	0.025	0.50-1.00	1.00-1.50	0.44-0.65	
P12	K11562	0.05-0.15	0.30-0.61	0.025	0.025	0.50 max	0.80-1.25	0.44-0.65	
P15	K11578	0.05-0.15	0.30-0.60	0.025	0.025	1.15-1.65		0.44-0.65	
P21	K31545	0.05-0.15	0.30-0.60	0.025	0.025	0.50 max	2.65-3.35	0.80-1.06	
P22	K21590	0.05-0.15	0.30-0.60	0.025	0.025	0.50 max	1.90-2.60	0.87-1.13	
P23	K41650	0.04-0.10	0.10-0.60	0.030 max	0.010 max	0.50 max	1.90-2.60	0.05 - 0.30	V 0.20-0.30
									Cb 0.02-0.08
									B 0.0010-0.006
									N 0.015 max
									Al 0.030 max
									W 1.45-1.75
									Ni 0.40 max
									Ti 0.005-0.060
									$Ti/N \ge 3.5^C$
P24	K30736	0.05-0.10	0.30-0.70	0.020	0.010	0.15-0.45	2.20-2.60	0.90-1.10	V 0.20-0.30
									Ti 0.06-0.10
									N 0.012 max
									Al 0.02 max
									B 0.0015-0.007
P36	K21001	0.10-0.17	0.80-1.20	0.030 max	0.025 max	0.25-0.50	0.30 max	0.25-0.50	Ni 1.00-1.30
									Cu 0.50-0.80
									Cb 0.015-0.045
									V 0.02 max
									N 0.02 max
DO4	1/04500	0.00.040	0.00.000	0.000	0.040	0.00 0.50	0.00 0.50	0.05.4.05	Al 0.050 max
P91	K91560	0.08-0.12	0.30-0.60	0.020	0.010	0.20-0.50	8.00-9.50	0.85-1.05	V 0 10 0 0F
Type 1									V 0.18–0.25
									N 0.030-0.070
									Ni 0.40 max
									Al 0.02 max Cb 0.06–0.10
									Ti 0.01 max
									Zr 0.01 max
P91	K91560								Zi o.o i max
Type 2									V
Heat		0.08-0.12	$0.30-0.50^{D}$	0.020^{D}	0.005^{D}	$0.20-0.40^{D}$	$8.00-9.50^{D}$	0.85-1.05	Heat 0.18-0.25
Product		0.07-0.13						0.80-1.05	Product 0.16-0.27
									Ni 0.20 max ^D
									Al 0.020 max ^D
									N 0.035-0.070 ^D
									N/Al ratio ≥4.0
									Cb
									Heat 0.06-0.10
									Product 0.05-0.11
									Ti 0.01 max ^D
									Zr 0.01 max ^D
									Sn 0.010 max ^D
									Sb 0.003 max ^D
									As 0.010 max ^D
									B 0.001 max ^D
									W 0.05 max ^D
									Cu 0.10 max ^D
P92	K92460	0.07-0.13	0.30-0.60	0.020	0.010	0.50 max	8.50-9.50	0.30-0.60	V 0.15-0.25
									N 0.03-0.07
									Ni 0.40 max
									Al 0.02 max
									Cb 0.04-0.09
									W 1.5–2.00
									B 0.001-0.006
									Ti 0.01 max
									Zr 0.01 max

TABLE 1 Continued

UNS									
Designa- Grade tion ^A	Carbon	Man- ganese	Phos- phorus, max	Sulfur, max	Silicon	Chromium	Molybde- num	Others	
P122	K92930	0.07–0.14	0.70 max	0.020	0.010	0.50 max	10.00–11.50	0.25-0.60	V 0.15–0.30 W 1.50–2.50 Cu 0.30–1.70 Cb 0.04–0.10 B 0.0005–0.005 N 0.040–0.100 Ni 0.50 max Al 0.020 max Ti 0.01 max
P911	K91061	0.09-0.13	0.30-0.60	0.020 max	0.010 max	0.10-0.50	8.5–9.5	0.90–1.10	Zr 0.01 max V 0.18–0.25 Ni 0.40 max Cb 0.060–0.10 B 0.0003–0.006 N 0.04–0.09 Al 0.02 max W 0.90–1.10 Ti 0.01 max Zr 0.01 max

^A New designation established in accordance with Practice E527 and SAE J1086, Practice for Numbering Metals and Alloys (UNS).

^DApplies to both heat and product analyses.

A5.29/A5.29M Low-Alloy Steel Electrodes for Flux Cored Arc Welding

2.4 Other Documents:

SNT-TC-1A Recommended Practice for Nondestructive Personnel Qualification and Certification

SAE J 1086 Practice for Numbering Metals and Alloys (UNS)

3. Ordering Information

- 3.1 Orders for material under this specification should include the following, as required, to describe the desired material adequately:
 - 3.1.1 Quantity (feet, metres, or number of lengths),
 - 3.1.2 Name of material (seamless alloy steel pipe),
 - 3.1.3 Grade (Table 1),
 - 3.1.4 Manufacture (hot-finished or cold-drawn),
 - 3.1.5 Size using one of the following:
 - 3.1.5.1 NPS and schedule number,
 - 3.1.5.2 Outside diameter and nominal wall thickness,
 - 3.1.5.3 Outside diameter and minimum wall thickness,
 - 3.1.5.4 Inside diameter and nominal wall thickness, and
 - 3.1.5.5 Inside diameter and minimum wall thickness.
 - 3.1.6 Length (specific or random),
- 3.1.7 End finish (Ends Section of Specification A999/A999M),

- 3.1.8 Optional requirements (Section 8, 12, and 13 of this specification. See the Sections on Hydrostatic Test Requirements and Permissible Variation in Weight for Seamless Pipe in Specification A999/A999M),
 - 3.1.9 Specification designation, and
- 3.1.10 Special requirements or any supplementary requirements selected, or both.
- 3.1.11 The flattening or bend test shall be performed on 5 % of the pipe (or fewer in accordance with 14.2) unless Supplementary Requirement S3 is specified.

4. General Requirements

4.1 Material furnished to this specification shall conform to the applicable requirements of the current edition of Specification A999/A999M, unless otherwise provided herein.

5. Materials and Manufacture

- 5.1 Pipe may be either hot finished or cold drawn with the finishing treatment as required in 5.2.
 - 5.2 Heat Treatment:
- 5.2.1 All pipe shall be reheated for heat treatment and heat treated in accordance with the requirements of Table 2.

Note 3—It is recommended that the temperature for tempering should be at least 100 °F [50 °C] above the intended service temperature; consequently, the purchaser should advise the manufacturer if the service temperature is to be over 1100 °F [600 °C].

Note 4—Certain of the ferritic steels covered by this specification will harden if cooled rapidly from above their critical temperature. Some will air harden, that is, become hardened to an undesirable degree when cooled in air from high temperatures. Therefore, operations involving heating such steels above their critical temperatures, such as welding, flanging, and hot bending, should be followed by suitable heat treatment.

^B Grade P5c shall have a titanium content of not less than 4 times the carbon content and not more than 0.70 %; or a columbium content of 8 to 10 times the carbon content. ^CAlternatively, in lieu of this ratio minimum, the material shall have a minimum hardness of 275 HV in the hardened condition, defined as after austenitizing and cooling to room temperature but prior to tempering. Hardness testing shall be performed at mid-thickness of the product. Hardness test frequency shall be two samples of product per heat treatment lot and the hardness testing results shall be reported on the material test report.

TABLE 2 Heat Treatment Requirements^A

Grade	Heat Treat Type	Normalizing Temperature, min or range °F [°C]	Cooling Media	Subcritical Annealing or Tempering Temperature, min or range
P1	full or isothermal anneal or			°F [°C]
• •	normalize and temper or			1200 [650]
	subcritical anneal			1200–1300 [650–705]
P2	full or isothermal anneal or	• • •	• • •	
1 2	normalize and temper or	• • •	• • •	1250 [675]
	subcritical anneal	• • •	• • •	1200–1300 [650–705]
P5	full or isothermal anneal or	• • •	• • •	
F3	normalize and temper	• • •	• • •	1250 [675]
P5b	full or isothermal anneal or	• • •	• • •	
F50		• • •	• • •	1050 [075]
P5c	normalize and temper subcritical anneal			1250 [675]
P9		• • •	• • •	1325–1375 [715–745]
P9	full or isothermal anneal or			
D44	normalize and temper			1250 [675]
P11	full or isothermal anneal or			
	normalize and temper			1200 [650]
P12	full or isothermal anneal or			
	normalize and temper or			1200 [650]
	subcritical anneal			1200–1300 [650–705]
P15	full or isothermal anneal or			
	normalize and temper			1200 [650]
P21	full or isothermal anneal or			
	normalize and temper			1250 [675]
P22	full or isothermal anneal or			
	normalize and temper			1250 [675]
P23	normalize and temper	1900–1975 [1040–1080]	air or	1350–1470 [730–800]
			accelerated	
			cooling	
P24	normalize and temper	1800–1870 [980–1020]	air or	1350–1420 [730–770]
			accelerated	
			cooling	
P36	normalize and temper ^B	1650 [900]		1100 [595]
P91 Type 1 and Type 2	normalize and temper or	1900-1975 [1040-1080]		1350–1470 [730–800] ^c
	quench and temper	1900–1975 [1040–1080]		1350-1470 [730-800]
P92	normalize and temper	1900–1975 [1040–1080]	D	1350-1470 [730-800]
P122	normalize and temper	1900-1975 [1040-1080]		1350-1470 [730-800]
P911	normalize and temper	1900–1975 [1040–1080]	D	1365-1435 [740-780]

^AWhere ellipses (...) appear in this table there is no requirement.

6. Chemical Composition

6.1 The steel shall conform to the requirements as to chemical composition prescribed in Table 1.

7. Workmanship, Finish, and Appearance

- 7.1 The pipe manufacturer shall explore a sufficient number of visual surface imperfections to provide reasonable assurance that they have been properly evaluated with respect to depth. Exploration of all surface imperfections is not required but may be necessary to ensure compliance with 7.2.
- 7.2 Surface imperfections that penetrate more than $12\frac{1}{2}\%$ of the nominal wall thickness or encroach on the minimum wall thickness shall be considered defects. Pipe with such defects shall be given one of the following dispositions:
- 7.2.1 The defect may be removed by grinding provided that the remaining wall thickness is within specified limits.
- 7.2.2 Repaired in accordance with the repair welding provisions of 7.6.

- 7.2.3 The section of pipe containing the defect may be cut off within the limits of requirements on length.
 - 7.2.4 Rejected.
- 7.3 To provide a workmanlike finish and basis for evaluating conformance with 7.2, the pipe manufacturer shall remove by grinding the following:
- 7.3.1 Mechanical marks, abrasions (see Note 5) and pits, any of which imperfections are deeper than ½16 in. [1.6 mm].
- Note 5—Marks and abrasions are defined as cable marks, dinges, guide marks, roll marks, ball scratches, scores, die marks, and the like.
- 7.3.2 Visual imperfections, commonly referred to as scabs, seams, laps, tears, or slivers, found by exploration in accordance with 7.1 to be deeper than 5 % of the nominal wall thickness.
- 7.4 At the purchaser's discretion, pipe shall be subject to rejection if surface imperfections acceptable under 7.2 are not scattered, but appear over a large area in excess of what is

^BAlternatively, Grade P36, Class 2 shall be cooled from the austenitizing temperature by accelerated cooling in air or by liquid quenching.

^CExcept when Supplementary Requirement S7 is specified by the purchaser.

D Accelerated cooling from the normalizing temperature shall be permitted for section thicknesses greater than 3 in. [75 mm].

considered a workmanlike finish. Disposition of such pipe shall be a matter of agreement between the manufacturer and the purchaser.

- 7.5 When imperfections or defects are removed by grinding, a smooth curved surface shall be maintained, and the wall thickness shall not be decreased below that permitted by this specification. The outside diameter at the point of grinding may be reduced by the amount so removed.
- 7.5.1 Wall thickness measurements shall be made with a mechanical caliper or with a properly calibrated nondestructive testing device of appropriate accuracy. In case of dispute, the measurement determined by use of the mechanical caliper shall govern.
- 7.6 Weld repair shall be permitted only subject to the approval of the purchaser and in accordance with Specification A999/A999M.
- 7.6.1 All repair welds in P91 shall be made with one of the following welding processes and consumables: SMAW, A5.5/A5.5M E90XX-B9; SAW, A5.23/A5.23M EB9 + neutral flux; GTAW, A5.28/A5.28M ER90S-B9; and FCAW A5.29/A5.29M E91T1-B9. In addition, the sum of the Ni+Mn content of all welding consumables used to weld repair P91 Type 1 and Type 2 shall not exceed 1.0 %.
- 7.6.2 All repair welds in P92, P911, and P122, shall be made using welding consumables meeting the chemical requirements for the grade in Table 1.
- 7.6.3 After weld repair, Grades P23, P91 Type 1 and Type 2, P92, and P122 shall be heat treated at 1350-1470 °F [730–800 °C].
- 7.6.4 After weld repair, Grade P911 shall be heat treated at $1365-1435 \,^{\circ}\text{F}[740-780 \,^{\circ}\text{C}]$.
- 7.6.5 After weld repair, Grade P24 shall be heat treated at 1350–1420 $^{\circ}$ F [730–770 $^{\circ}$ C].
 - 7.7 The finished pipe shall be reasonably straight.

8. Product Analysis

8.1 At the request of the purchaser, an analysis of two pipes from each lot as defined hereafter shall be made by the manufacturer. A lot is all pipe of the same nominal size and wall thickness (schedule) which is produced from the same heat of steel and shall be limited as follows:

NPS Designator	Maximum Number of
	Lengths in a Lot
Under 2	400
2 to 5	200
6 and over	100

- 8.2 The results of these analyses shall be reported to the purchaser or the purchaser's representative, and shall conform to the requirements specified in Table 1.
- 8.3 For grade P91 Type 1 the carbon content may vary for the product analysis by $-0.01\,\%$ and $+0.02\,\%$ from the specified range as per Table 1.
- 8.4 If the analysis of one of the tests specified in 8.1 does not conform to the requirements specified in 6.1, an analysis of each billet or pipe from the same heat or lot may be made, and all billets or pipe conforming to the requirements shall be accepted.

9. Tensile and Hardness Requirements

- 9.1 The tensile properties of the material shall conform to the requirements prescribed in Table 3.
 - 9.2 Table 4 lists elongation requirements.
- 9.3 Pipe of Grade P91 Type 1 and Type 2 shall have a hardness within the range of 190 to 250 HBW or 196 to 265 HV or 91 HRBW to 25 HRC. Pipe of Grades P24, P36, P92, P122, and P911 shall have a hardness not exceeding 250 HBW or 265 HV or 25 HRC. Pipe of grade P23 shall have a hardness not exceeding 220 HBW or 220 HV or 97 HRBW.
- 9.4 Table 5 gives the computed minimum elongation values for each ½32-in. [0.8-mm] decrease in wall thickness. Where the wall thickness lies between two values above, the minimum elongation value is determined by the following formula:

Direction of Test Longitudinal, all grades except P23, P91 Type 1 and Type 2, P92, P122, and P911	Equation B E = 48t + 15.00 [E = 1.87 t + 15.00]
Transverse, all grades except P23, P91 Type 1 and Type 2, P92, P122, and P911	E = 32t + 10.00 $[E = 1.25 t + 10.00]$
Longitudinal, P23, P24, P91 Type 1 and Type 2, P92, P122, and P911 Longitudinal, P36 where:	E = 32t + 10.00 $[E = 1.25 t + 10.00]$ $E = 32t + 5.0$ $[E = 1.25 t + 5.0]$

where

E = elongation in 2 in. or 50 mm, %, and t = actual thickness of specimens, in. [mm].

9.5 For Grade P91 Type 1 and Type 2, when quenching and tempering has been performed, the tensile and hardness properties shall be met and verified on material taken from the half-thickness location.

TABLE 3 Tensile Requirements

Grade										
	P1, P2	P12	P23	P24	P91 Type 1 and Type 2	P92, P911 P36 Class 1	P122	P36 Class 2	All Others	
Tensile strength,										
min:										
ksi	55	60	74	85	85	90	90	95.5	60	
MPa	380	415	510	585	585	620	620	660	415	
Yield strength,										
min:										
ksi	30	32	58	60	60	64	58	66.5	30	
MPa	205	220	400	415	415	440	400	460	205	

TABLE 4 Elongation Requirements

EI	ongation F	Requireme	nts		
	except F P91 Typ Type 2, P	rades P23, P36 De 1 and P92, P122, P911	Type 1 ar P92, P1	24, P91 nd Type 2, 122, and	P36
	Longi- tudi- nal	Trans- verse	Longi- tudi- nal	Trans- verse	Longi- tudi- nal
Elongation in 2 in. or 50 mm, (or 4 <i>D</i>), min, %: Basic minimum elongation for wall ⁵ / ₁₆ in. [8 mm] and over in thickness, strip tests, and for all small sizes tested in full section	30	20	20		15
When standard round 2-in. or 50-mm gage length or proportionally smaller size specimen with the gage length equal to 4D (4 times the diameter) is used	22	14	20	13	
For strip tests a deduction for each ½2-in. [0.8 mm] decrease in wall thickness below in. [8 mm] from the basic minimum elongation of the following percentage points shall be made	1.50 ^A	1.00 ^A	1.00 ^A		1.00 ^A

 $^{^{\}it A}$ Table 5 gives the calculated minimum values.

TABLE 5 Calculated Minimum Elongation Values

			Elongation in 2 in	n. or 50 mm, min, %		
Wall Thickness		P91 Type	ccept P23, P36, 1 and Type 2, 2, and P911	P23, P24, P91, Type 1 and Type 2, P92, P122, and P911	, P36	
in.	mm	Longi- tudinal	Transverse	Longi- tudinal	Longi- tudinal	
5/16 (0.312)	8	30 20		20	15	
%2 (0.281)	7.2	28 19		19	14	
1/4 (0.250)	6.4	27	18	18	13	
7/32 (0.219)	5.6	26		17	12	
3/16 (0.188)	4.8	24		16	11	
5/32 (0.156)	4	22		15	10	
1/8 (0.125)	3.2	21		14	9	
3/32 (0.094)	2.4	20		13	8	
1/16 (0.062)	1.6	18		12	7	

10. Permissible Variations in Diameter

10.1 For pipe ordered to NPS [DN] or outside diameter, variations in outside diameter shall not exceed those specified in Table 6.

10.2 For pipe ordered to inside diameter, the inside diameter shall not vary more than \pm 1 % from the specified inside diameter.

11. Permissible Variations in Wall Thickness

11.1 In addition to the implicit limitation of wall thickness for pipe imposed by the limitation on weight in Specification A999/A999M, the wall thickness for pipe at any point shall be within the tolerances specified in Table 7. The minimum wall thickness and outside diameter for inspection for compliance

TABLE 6 Permissible Variations in Outside Diameter

	Ove	r	Under				
NPS [DN] Designator	in.	mm	in.	mm			
1/8 to 11/2 [6 to 40], incl.	1/64 (0.015)	0.40	1/64 (0.015)	0.40			
Over 1½ to 4 [40 to 100], incl.	1/32 (0.031)	0.79	1/32 (0.031)	0.79			
Over 4 to 8 [100 to 200], incl.	1/16 (0.062)	1.59	1/32 (0.031)	0.79			
Over 8 to 12 [200 to 300], incl.	3/32 (0.093)	2.38	1/32 (0.031)	0.79			
Over 12 [300]	± 1 % of the specified outside diameter						

with this requirement for pipe ordered by NPS [DN] and schedule number is shown in ASME B36.10M.

TABLE 7 Permitted Variations in Wall Thickness

NPS [DN] Designator	Tolerance, % from Specified					
	Over	Under				
1/8 to 21/2 [6 to 65] incl., all t/D ratios ^A	20.0	12.5				
Above $2\frac{1}{2}$ [65], $t/D \le 5 \%^A$	22.5	12.5				
Above $2\frac{1}{2}$ [65], $t/D > 5 \%^A$	15.0	12.5				

At = Specified Wall Thickness; D = Specified Outside Diameter.

12. Hydrostatic Test

- 12.1 The requirements for grades other than P91 Type 1 and Type 2, P92, P911, and P122 are shown in 12.1.1 12.1.4.
- 12.1.1 Each length of pipe with outside diameter greater than 10 in. [250 mm] and wall thickness less than or equal to 0.75 in. [19 mm], shall be submitted to the hydrostatic test, except as provided for in 12.1.4.
- 12.1.2 Pipe of all other sizes shall be subjected to the nondestructive electric test as shown in Section 13, except as provided for in 12.1.3 and 12.1.4.
- 12.1.3 When specified by the purchaser, pipe of all other sizes shall be furnished without the hydrostatic test and without nondestructive examination.
- 12.1.4 When specified by the purchaser, pipe shall be furnished with both the hydrostatic test and a nondestructive examination having been performed.
- 12.2 The requirements for grades P91 Type 1 and Type 2, P92, P911, and P122 are shown in 12.2.1 12.2.3.
- 12.2.1 Each length of pipe with outside diameter greater than 10 in. [250 mm] and wall thickness less than or equal to 0.75 in. [19 mm], shall be submitted to both the hydrostatic test and the ultrasonic test as shown in Section 13.
- 12.2.2 Pipe of all other sizes shall be subjected to the nondestructive electric test as shown in Section 13, except as provided for in 12.2.3.
- 12.2.3 When specified by the purchaser, pipe of all other sizes shall be furnished with both the hydrostatic test and a nondestructive examination having been performed.

13. Nondestructive Examination

- 13.1 When required by 12.1.2 or 12.2 above, or when specified in the purchase order in addition to the hydrostatic test (12.2.3), each pipe shall be examined by a nondestructive examination method in accordance with Practice E213, Practice E309, or Practice E570. Except for Grades P91 Type 1 and Type 2, P92, P911, and P122, the type of nondestructive examination shall be at the option of the manufacturer, unless otherwise specified in the order. Grades P91 Type 1 and Type 2, P92, P911, and P122 shall be examined by an examination method in accordance with Practice E213. When specified in the order, pipe of Grades P91 Type 1 and Type 2, P92, P911, and P122 shall be examined by an examination method in accordance with Practices E309 or E570, in addition to the examination method in accordance with Practice E213. The range of pipe sizes that may be examined by each method shall be subject to the limitations in the scope of the respective practices.
- 13.2 Following conditions apply in lieu or in addition to those in Specification A999/A999M:

- 13.2.1 The width of the notch shall not exceed the depth.
- 13.2.2 If upon any standardization, the reference signal amplitude has decreased by more than 25 % (2 db), the test apparatus shall be considered out of standardization. The test system settings may be changed, or the transducer(s), coil(s) or sensor(s) adjusted, and the unit restandardized, but all pipe tested since the last acceptable standardization shall be retested.
- 13.2.3 Pipes producing a signal equal to or greater than the signal produced by the reference standard shall be subject to one of the following four dispositions:
- 13.2.3.1 The pipes may be rejected without further examination, at the discretion of the manufacturer.
- 13.2.3.2 The pipes shall be rejected if the test signal was produced by imperfections which cannot be identified, or was produced by cracks or crack-like imperfections.
- 13.2.3.3 The pipes may be repaired by grinding (in accordance with 7.2.1), welding (in accordance with 7.6) or sectioning (in accordance with 7.2.3). To be accepted, a repaired pipe must pass the same nondestructive examination by which it was rejected, and it must meet the remaining wall thickness requirements of this specification.
- 13.2.3.4 If the test signals were produced by visual imperfections such as those listed below, the pipes may be evaluated in accordance with the provisions of Section 7:
 - (a) Scratches,
 - (b) Surface roughness,
 - (c) Dings,
 - (d) Straightener marks,
 - (e) Cutting chips,
 - (f) Steel die stamps,
 - (g) Stop marks, or
 - (h) Pipe reducer ripple.

14. Mechanical Tests Required

- 14.1 *Lot*—For mechanical testing, a lot is all pipe of the same nominal size and wall thickness (or schedule) which is produced from the same heat of steel and subjected to the same finishing treatment in a continuous furnace; when final heat treatment is in a batch-type furnace, the lot shall include only that pipe which is heat treated in the same furnace charge.
- 14.2 Transverse or Longitudinal Tension Test, Hardness Test, and Flattening or Bend Test—For material heat treated in a batch-type furnace, tests shall be made on 5 % of the pipe from each treated lot. For small lots, at least 1 pipe shall be tested. For material heat treated by the continuous process, tests shall be made on a sufficient number of pipe to constitute 5 % of the lot, but in no case less than 2 pipe. Unless otherwise specified, the flattening test or bend test shall be chosen at the manufacturer's option.
 - 14.3 Hardness Test:
- 14.3.1 The Vickers hardness testing shall be made in accordance with Test Method E92.
- 14.3.2 For pipes with wall thickness 0.200 in. [5.1 mm] or over, either the Brinell or Rockwell hardness test shall be used. When Brinell hardness testing is used, a 10-mm ball with 3000, 1500, or 500-kg load shall be used at the option of the manufacturer.

- 14.3.3 For pipes with wall thickness 0.065 in. [1.7 mm] or over, but less than 0.200 in. [5.1 mm], the Rockwell hardness test shall be used.
- 14.3.4 For pipes with wall thickness less than 0.065 in. [1.7] mm], the hardness test shall not be required.
- 14.3.5 The Brinell test shall be made, at the option of the manufacturer, on the outside of the pipe near the end, on the outside of a specimen cut from the pipe, or on the wall cross section of a specimen cut from the pipe. This test shall be made so that the center of the impression to the edge of the specimen is at least 2.5 times the diameter of the impression.
- 14.3.6 The Rockwell hardness test shall, at the option of the manufacturer, be made on the inside surface, on the wall cross section, or on a flat of the outside surface.
- 14.3.7 For pipe of Grades P23, P24, P36, P91 Type 1 and Type 2, P92, P122 and P911, Brinell, Vickers, or Rockwell hardness tests shall be made on a specimen from each lot. For pipe of all other grades, a hardness test is not required.

14.4 Flattening Test:

14.4.1 The flattening test of Specification A999/A999M shall be made on a specimen from one end of the pipe with the number of tests as specified in 14.2. Crop ends may be used. If a specimen from any length fails because of lack of ductility prior to satisfactory completion of the first step of the flattening test requirement, that pipe shall be rejected subject to retreatment in accordance with Specification A999/A999M and satisfactory retest. If a specimen from any length of pipe fails because of a lack of soundness that length shall be rejected, unless subsequent retesting indicates that the remaining length is sound.

14.5 Bend Test:

- 14.5.1 For pipe whose diameter exceeds NPS 25 and whose diameter to wall thickness ratio is 7.0 or less shall be subjected to the bend test instead of the flattening test. Other pipe whose diameter equals or exceeds NPS 10 may be given the bend test in place of the flattening test subject to the approval of the purchaser.
- 14.5.2 The bend test specimens shall be bent at room temperature through 180° without cracking on the outside of the bent portion. The inside diameter of the bend shall be 1 in. [25 mm].
- 14.5.3 Test specimens for the bend test shall be cut from one end of the pipe with the number of tests as specified in 14.2

and, unless otherwise specified, shall be taken in a transverse direction. One test specimen shall be taken as close to the outer surface as possible and another from as close to the inner surface as possible. The specimens shall be either ½ by ½ in. [12.5 by 12.5 mm] in section or 1 by ½ in. [25 by 12.5 mm] in section with the corners rounded to a radius not over 1/16 in. [1.6 mm] and need not exceed 6 in. [150 mm] in length. The side of the samples placed in tension during the bend shall be the side closest to the inner and outer surface of the pipe, respectively.

15. Certification

- 15.1 Certification and test reports, as described in Section 25 of Specification A999/A999M, are required.
- 15.2 In addition to the information required by Specification A999/A999M, the certification shall state whether or not the pipe was hydrostatically tested. If the pipe was nondestructively examined, the certification shall so state and shall show which practice was followed and what reference discontinuities were used. In addition, the test method information as given in Table 8 shall be appended to the specification number and grade shown on the certification.

16. Product Marking

16.1 In addition to the marking prescribed in Specification A999/A999M, the marking shall include the length, an additional symbol "S", if the pipe conforms to any of the Supplementary Requirements S1 to S6, the schedule number, if the pipe is ordered to a schedule number, and the heat number or manufacturer's number by which the heat can be identified. Furthermore, the marking designated in Table 8 to indicate the test method(s) shall be included. Marking may be by stenciling, stamping, or rolling. Pipe that has been weld repaired in accordance with 7.6 shall be marked "WR."

16.2 P91 shall be additionally marked with the appropriate Type.

17. Government Procurement

17.1 Scale Free Pipe:

17.1.1 When specified in the contract or order, the following requirements shall be considered in the inquiry contract or order, for agencies of the U.S. Government where scale free

	TABLE 8 Test Method Information for Certification and Marking						
Ultrasonic	Flux Leakage	Eddy Current	Hydrostatic				
NO	NO	NO	YES				
YES	NO	NO	NO				

Ultrasonic	Flux Leakage	Eddy Current	Hydrostatic	Marking
NO	NO	NO	YES	TEST PRESSURE ^A
YES	NO	NO	NO	UT
NO	YES	NO	NO	FL
NO	NO	YES	NO	EC
YES	YES	NO	NO	UT/FL
YES	NO	YES	NO	UT/EC
NO	NO	NO	NO	NH
YES	NO	NO	YES	UT/TEST PRESSURE ^A
NO	YES	NO	YES	FL/TEST PRESSURE ^A
NO	NO	YES	YES	EC/TEST PRESSURE ^A

^ATest pressure is to be in psi [MPa].

pipe is required. These requirements shall take precedence if there is a conflict between these requirements and the product specification.

- 17.1.2 The requirements of Specification A999/A999M for pipe shall be applicable when pipe is ordered to this specification.
- 17.1.3 Pipe shall be one of the following grades as specified herein:

Grade	UNS Designation
P11	K11597
P22	K21590
P5	K41545

17.1.4 Part Number:

17.1.4.1 Pipe shall be ordered to nominal pipe size and schedule specified in ASME B36.10M

Example: A335/A335M Pipe P-11 NPS 12 Sch 40

ASTM A335/A335M					
Р					
P-11					
12					
0.375					

17.1.4.2

Specification Number	ASTM A335/A335M					
Tube	Т					
Grade	P-11					
Outside Diameter	0.250					
Wall	0.035					

- 17.1.5 *Ordering Information*—Orders for material under this specification shall include the following in addition to the requirements of Section 3:
 - 17.1.5.1 Pipe or tube,
 - 17.1.5.2 Part number,
 - 17.1.5.3 Ultrasonic inspection, if required,
- 17.1.5.4 If shear wave test is to be conducted in two opposite circumferential directions, and
 - 17.1.5.5 Level of preservation and packing required.

18. Keywords

18.1 alloy steel pipe; high temperature service; seamless steel pipe; steel pipe; temperature service applications

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall apply only when specified in the purchase order. The purchaser may specify a different frequency of test or analysis than is provided in the supplementary requirement. Subject to agreement between the purchaser and manufacturer, retest and retreatment provisions of these supplementary requirements may also be modified.

S1. Product Analysis

S1.1 Product analysis shall be made on each length of pipe. Individual lengths failing to conform to the chemical composition requirements shall be rejected.

S2. Transverse Tension Tests

S2.1 A transverse tension test shall be made on a specimen from one end or both ends of each pipe NPS 8 and over. If this supplementary requirement is specified, the number of tests per pipe shall also be specified. If a specimen from any length fails to meet the required tensile properties (tensile, yield, and elongation), that length shall be rejected subject to retreatment in accordance with Specification A999/A999M and satisfactory retest.

S3. Flattening Test

S3.1 The flattening test of Specification A999/A999M shall be made on a specimen from one end or both ends of each pipe. Crop ends may be used. If this supplementary requirement is specified, the number of tests per pipe shall also be specified. If a specimen from any length fails because of lack of ductility prior to satisfactory completion of the first step of the flattening test requirement, that pipe shall be rejected subject to retreatment in accordance with Specification A999/A999M and satisfactory retest. If a specimen from any length of pipe fails because of a lack of soundness that length shall be rejected, unless subsequent retesting indicates that the remaining length is sound. The bend test shall be substituted for the flattening

test for pipe whose diameter exceeds NPS 25 and whose diameter to wall thickness ratio is 7.0 or less.

S4. Metal Structure and Etching Tests

S4.1 The steel shall be homogeneous as shown by etching tests conducted in accordance with the appropriate portions of Method E381. Etching tests shall be made on a cross section from one end or both ends of each pipe and shall show sound and reasonably uniform material free from injurious laminations, cracks, and similar objectionable defects. If this supplementary requirement is specified, the number of tests per pipe required shall also be specified. If a specimen from any length shows objectionable defects, the length shall be rejected, subject to removal of the defective end and subsequent retests indicating the remainder of the length to be sound and reasonably uniform material.

Note S4.1—Pending development of etching methods applicable to the product covered by this specification, it is recommended that the Recommended Practice for a Standard Macro Etch Test for Routine Inspection of Iron and Steel, described in the *Metals Handbook*, Am. Soc. for Metals, 1948 edition, p. 389, be followed.

S5. Photomicrographs

S5.1 When requested by the purchaser and so stated in the order, the manufacturer shall furnish one photomicrograph at 100 diameters from a specimen of pipe in the as-finished condition for each individual size and wall thickness from each heat, for pipe NPS 3 and over. Such photomicrographs shall be suitably identified as to pipe size, wall thickness, and heat. No photomicrographs for the individual pieces purchased shall be

required except as specified in Supplementary Requirement S6. Such photomicrographs are for information only, to show the actual metal structure of the pipe as finished.

S6. Photomicrographs for Individual Pieces

S6.1 In addition to the photomicrographs required in accordance with Supplementary Requirement S5, the purchaser may specify that photomicrographs shall be furnished from each end of one or more pipes from each lot of pipe NPS 3 and larger in the as-finished condition. The purchaser shall state in the order the number of pipes to be tested from each lot. When photomicrographs are required on each length, the photomicrographs from each lot of pipe in the as-finished condition which may be required under Supplementary Requirement S5 may be omitted. All photo-micrographs required shall be properly identified as to heat number, size, and wall thickness of pipe from which the section was taken. Photomicrographs shall be further identified to permit association of each photomicrograph with the individual length of pipe it represents.

S7. Alternative Heat Treatment—Grade P91 Type 1 and Type 2

S7.1 Grade P91 shall be normalized in accordance with Table 2 and tempered at a temperature, to be specified by the purchaser, less than 1350 °F [730 °C]. It shall be purchaser's responsibility to subsequently temper at 1350–1470 °F [730–800 °C] minimum. All mechanical tests shall be made on material heat treated in accordance with Table 2. The certification shall reference this supplementary requirement indicating the tempering temperature applied. The notation "S7" shall be included with the required marking of the pipe.

S8. Melting Practice—Grades P2 and P12

S8.1 Specific limits, if any, on grain size or deoxidation practice shall be a matter of agreement between the manufacturer and purchaser.



SPECIFICATION FOR ALLOY STEEL FORGINGS FOR PRESSURE AND HIGH-TEMPERATURE PARTS



SA-336/SA-336M



(Identical with ASTM Specification A336/A336M-18.)

Standard Specification for Alloy Steel Forgings for Pressure and High-Temperature Parts

1. Scope

- 1.1 This specification covers ferritic steel forgings for boilers, pressure vessels, high-temperature parts, and associated equipment.
- 1.2 Forgings made of steel grades listed in Specification A335/A335M, may also be ordered under this specification. The chemical, tensile, heat treatment, and marking requirements of Specification A335/A335M shall apply, except the forging shall conform to the chemical requirements of Tables 1 and 2 of Specification A335/A335M only with respect to heat analysis. On product analysis they may deviate from these limits to the extent permitted in Table 1 of this specification.
- 1.3 Supplementary Requirements S1 to S9 are provided for use when additional testing or inspection is desired. These shall apply only when specified individually by the purchaser in the order.
- 1.4 Unless the order specifies the applicable "M" specification designation, the material shall be furnished to the inchpound units.
- 1.5 Specification A336/A336M formerly included austenitic steel forgings, which are now found in Specification A965/A965M.
- 1.6 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.7 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the

Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

- A275/A275M Practice for Magnetic Particle Examination of Steel Forgings
- A335/A335M Specification for Seamless Ferritic Alloy-Steel Pipe for High-Temperature Service
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A788/A788M Specification for Steel Forgings, General Requirements
- A965/A965M Specification for Steel Forgings, Austenitic, for Pressure and High Temperature Parts
- E165/E165M Practice for Liquid Penetrant Examination for General Industry

2.2 ASME Boiler and Pressure Vessel Code:

Section III Nuclear Power Plant Components

Section IX Welding and Brazing Qualifications

2.3 AWS Specifications:

- A5.5/A5.5M Low-Alloy Steel Electrodes for Shielded Metal Arc Welding
- A5.23/A5.23M Low-Alloy Steel Electrodes and Fluxes for Submerged Arc Welding
- A5.28/A5.28M Low-Alloy Steel Electrodes for Gas Shielded Arc Welding
- A5.29/A5.29M Low-Alloy Steel Electrodes for Flux Cored Arc Welding

ASME BPVC.II.A-2023

TABLE 1 Tensile Requirements

		Ferritic Steels																		
		Grade																		
	F1	F11, Class 2	F11, Class 3	F11, Class 1	F12	F5	F5A	F9	F6	F6NM	F21, Class 3	F21, Class 1	F22, Class 3	F22, Class 1	F91, Type 1 and Type 2	F911	F92	F3V	F3VCb	F22V
Tensile strength, ksi [MPa]	70- 95 [485- 660]	70- 95 [485- 660]	75- 100 [515- 690]	60- 85 [415- 585]	70- 95 [485- 660]	60- 85 [415- 585]	80- 105 [550- 725]	85- 110 [585- 760]	85- 110 [585- 760]	115- 140 [790- 965]	75- 100 [515- 690]	60- 85 [415- 585]	75- 100 [515- 690]	60- 85 [415- 585]	90- 110 [620- 760]	90- 120 [620- 830]	90- 120 [620- 830]	85- 110 [585- 760]	85- 110 [585- 760]	85- 110 [585- 760]
Yield strength, min, ksi [MPa]	40 [275]	40 [275]	45 [310]	30 [205]	40 [275]	36 [250]	50 [345]	55 [380]	55 [380]	90 [620]	45 [310]	30 [205]	45 [310]	30 [205]	60 [415]	64 [440]	64 [440]	60 [415]	60 [415]	60 [415]
Elongation in 2 in. or 50 mm, min, %	20	20	18	20	20	20	19	20	18	15	19	20	19	20	20	20	20	18	18	18
Reduction of area, min, %	40	40	40	45	40	40	35	40	35	45	40	45	40	45	40	40	45	45	45	45

Grade

3. Ordering Information and General Requirements

- 3.1 In addition to the ordering information required by Specification A788/A788M, the purchaser should include with the inquiry and order the following information:
- 3.1.1 A drawing or sketch that shows test locations when the testing is in accordance with 8.1.1.3.
 - 3.1.2 The intended use of forgings if 5.1 is applicable.
- 3.2 Material supplied to this specification shall conform to the requirements of Specification A788/A788M, which outlines additional ordering information, manufacturing requirements, testing and retesting methods and procedures, marking, certification, product analysis variations, and additional supplementary requirements.
- 3.3 If the requirements of this specification are in conflict with the requirements of Specification A788/A788M, the requirements of this specification shall prevail.
- 3.4 For hubbed flatheads and tube sheets ordered for ASME Boiler and Pressure Vessel Code application, Supplementary Requirement S12 of Specification A788/A788M shall be specified.
- 3.5 At the purchaser's request the forgings shall be rough machined before heat treatment (5.2).
- 3.6 For Section III, Part NB of the ASME Boiler and Pressure Vessel Code application, Supplementary Requirement S3 shall be specified.

4. Melting and Forging

- 4.1 In addition to the melting and forging requirements of Specification A788/A788M, which may be supplemented by Supplementary Requirement S8, the following conditions apply:
- 4.1.1 A sufficient discard shall be made to secure freedom from injurious pipe and undue segregation.

5. Machining

- 5.1 Forged pressure vessels for steam power service shall have the inner surface machined or ground. Unfired pressure vessels shall have the inner surfaces sufficiently free of scale to permit inspection.
- 5.2 Unless otherwise specified by the purchaser, when rough machining is performed, it may be done either before or after heat treatment at the manufacturer's option.

6. Heat Treatment

- 6.1 Except as permitted in 6.1.1 for Grade F22V, and in 6.1.2 for Grade F91 Type 1 and Type 2 and Grade F92, the steel forgings shall be annealed or normalized and tempered but alternatively may be liquid quenched and tempered when mutually agreed upon between the manufacturer and the purchaser. For all grades, normalizing or liquid quenching shall be followed by tempering at a subcritical temperature as shown in 6.1.4.
- 6.1.1 Grade F22V forgings shall be normalized and tempered or liquid quenched and tempered at the manufacturer's option.

- 6.1.1.1 For Grade F22V forgings the minimum austenitizing temperature shall be 1650 °F [900 °C].
- 6.1.2 Grade F91 Type 1 and Type 2 forgings having any section thickness greater than 3 in. [75 mm] shall be normalized and tempered or liquid quenched and tempered at the manufacturer's option. Grade F92 forgings shall be normalized and tempered or liquid quenched and tempered at the manufacturer's option.
- 6.1.2.1 For Grade F91 Type 1 and Type 2, F911, and F92 forgings, the austenitizing temperature shall be in the range of 1900 to 1975 °F [1040 to 1080 °C].
- 6.1.3 For Grade F6NM the austenitizing temperature shall be 1850 °F [1010 °C] minimum. The tempering temperature range shall be as shown in 6.1.4.
- 6.1.4 Except for the following grades, the minimum tempering temperature shall be 1100 °F [595 °C]:

Tempering Temperature

Grade	Minimum or Range, °F [°C]
F6	1150 [620]
F6NM	1040-1120 [560-600]
F11, Class 2	1150 [620]
F11, Class 3	1150 [620]
F11, Class 1	1150 [620]
F5, F5a	1250 [675]
F9	1250 [675]
F21, Class 1	1250 [675]
F3V, F3VCb	1250 [675]
F22, Class 1	1250 [675]
F22V	1250 [675]
F91 Type 1 and Type 2, F92	1350–1470 [730–800]
F911	1365–1435 [740–780]
F22, Class 3	1250 [675]

7. Chemical Composition

- 7.1 *Heat Analysis*—The heat analysis obtained from sampling in accordance with Specification A788/A788M and shall comply with Table 2.
- 7.2 Product Analysis—The manufacturer shall use the product analysis provision of Specification A788/A788M to obtain a product analysis from a forging representing each heat or multiple heat. The product analysis for columbium and calcium for Grade F22V shall conform to the requirements of Table 2 of this specification. Boron is not subject to product analysis. The purchaser may also make this determination in accordance with Specification A788/A788M.

8. Mechanical Properties

- 8.1 *General Requirements*—The material shall conform to the requirements for mechanical properties prescribed in Table 1. The largest obtainable tension test specimen as specified in Test Methods and Definitions A370 shall be used.
- 8.1.1 Except as required in 3.4, for annealed, normalized, and tempered or quenched and tempered forgings, the longitudinal axis of the tension test specimens, and, when required, Charpy impact test specimens, shall be parallel to the direction of major working of the forging, except when Supplementary Requirement S2 is specified. For upset disk forgings, the longitudinal axis of the test specimen shall be in the tangential direction.

TABLE 2 Chemical Requirements^A

				Compos	sition, %				
				Gra	ade				
Element	F1	F11, Classes 2 and 3	F11, Class 1	F12	F5 ^B	F5A ^B	F9	F6	F6NM
Carbon Manganese	0.20-0.30 0.60-0.80	0.10-0.20 0.30-0.80	0.05–0.15 0.30–0.60	0.10-0.20 0.30-0.80	0.15 max 0.30–0.60	0.25 max 0.60 max	0.15 max 0.30-0.60	0.12 max 1.00 max	0.05 max 0.50-1.00
Phosphorus,	0.025	0.025	0.025	0.025	0.025	0.025	0.025	0.025	0.020
max Sulfur, max	0.025	0.025	0.025	0.025	0.025	0.025	0.025	0.025	0.015
Silicon Nickel	0.20-0.35	0.50-1.00	0.50–1.00	0.10-0.60	0.50 max 0.50 max	0.50 max 0.50 max	0.50–1.00	1.00 max 0.50 max	0.60 max 3.5–5.5
Chromium		1.00–1.50	1.00–1.50	0.80-1.10	4.0–6.0	4.0–6.0	8.0–10.0	11.5–13.5	11.5–14
Molybdenum	0.40-0.60	0.45-0.65	0.44-0.65	0.45-0.65	0.45-0.65	0.45-0.65	0.90-1.10		0.50-1.00
				Gra	ade				
Element	F21, Classes	F22, Classes							
	1 and 3	1 and 3							
Carbon	0.05-0.15	0.05-0.15							
Manganese Phosphorus,	0.30-0.60 0.025	0.30-0.60 0.025							
max	0.025	0.025							
Sulfur, max	0.025	0.025							
Silicon	0.50 max	0.50 max							
Nickel Chromium	2.7–3.3	2.00–2.50							
Molybdenum	0.80-1.06	0.90-1.10							
Vanadium									
Copper									
Nitrogen									
Columbium ^C									
Element	Grade F91 Type 1	Grade F91 Type 2	Grade F911	Grade F92	F3V	F3VCb	F22V		
Carbon	0.08-0.12	0.08-0.12	0.09-0.13	0.07-0.13	0.10-0.15	0.10-0.15	0.11-0.15		
Heat Product Manganese	0.30–0.60	0.07-0.13 0.30-0.50 ^D	0.30-0.60	0.30-0.60	0.30-0.60	0.30–0.60	0.30-0.60		
Phosphorus,	0.025	0.020 ^D	0.020	0.020	0.020	0.020	0.015		
Sulfur, max	0.025	0.005^{D}	0.010	0.010	0.020	0.010	0.010		
Silicon	0.20-0.50	$0.20-0.40^{D}$	0.10-0.50	0.50	0.10 max	0.10 max	0.10 max		
Nickel	0.40 max	0.20 max ^D	0.40 max	0.40		0.25 max	0.25 max		
Chromium	8.0–9.5	8.0–9.5 ^D	8.5–9.5	8.50-9.50	2.7–3.3	2.7–3.3	2.00-2.50		
Molybdenum Vanadium	0.85-1.05 0.18-0.25	0.85-1.05 0.18-0.25	0.90-1.10 0.18-0.25	0.30-0.60 0.15-0.25	0.90-1.10 0.20-0.30	0.90-1.10 0.20-0.30	0.90-1.10 0.25-0.35		
Heat Product	0.10-0.23	0.16-0.27	0.10-0.25	0.15-0.25	0.20-0.50	0.20-0.50	0.25-0.55		
Columbium ^C	0.06-0.10	0.06-0.10	0.06-0.10	0.04-0.09		0.015-0.070	0.07 max		
Nitrogen	0.03-0.07	$0.035-0.070^{D}$	0.04-0.09	0.030-0.070					
Aluminum	0.02 max^D	0.02 max ^D	0.02 max ^D	0.02					
Boron		0.001 max ^D	0.0003-0.006	0.001-0.006	0.001-0.003		0.0020 max		
N/Al ratio Tungsten		≥4.0 0.05 max ^D	0.90–1.10	1.50–2.00					
Titanium	0.01 max ^D	0.03 max 0.01 max ^D	0.90-1.10 0.01 max ^D	0.01	0.015–0.035	0.015 max	0.030 max		
Copper	0.01 max	0.10 max ^D	0.01 max			0.25 max	0.20 max		
Calcium						0.0005-0.0150	0.015 max ^E		
Zirconium	$0.01~{\rm max}^D$	0.01 max ^D	$0.01~{\rm max}^D$	0.01					
Tin		0.010 max ^D							
Antimony	• • •	0.003 max ^D 0.010 max ^D							
Arsenic		U.U IU Max							

8.1.1.1 Except as provided for liquid quenched and tempered forgings in 8.1.1.3, the longitudinal axis of the specimen shall be located midway between the parallel surfaces of the test extension if added to the periphery of disks or midway

between the center and surface of solid forgings. For hollow forgings, the longitudinal axis of the specimens shall be located midway between the center and outer surfaces of the wall. When separately forged test blocks are employed, as defined in

A Where ellipses (...) appear in this table, there is no requirement, and the element need neither be analyzed for nor reported.

B The present Grade F5A (0.25 %, maximum carbon) previous to 1955 was assigned the identification symbol F5. Identification symbol F5 has been assigned to the 0.15 %, maximum, carbon grade to be consistent with ASTM specifications for other products such as pipe, tubing, bolting, welding, fittings, etc. ^C Columbium (Cb) and Niobium (Nb) are alternate names for Element 41 in the Periodic Table of the Elements.

 $^{^{\}it D}$ Applies to both heat and product analyses.

E For Grade F22V, rare earth metals (REM) may be added in place of calcium subject to agreement between the producer and the purchaser. In that case the total amount of REM shall be determined and reported.

- 8.1.3, the tension test specimens shall be taken from a location that represents the midwall of the heaviest section of the production forgings. When specimens are required from opposite ends, they shall be taken from the diagonal corners of an axial plane. Alternatively, and when specified by the purchaser, the specimens shall be taken in accordance with Supplementary Requirement S3.
- 8.1.1.2 For liquid quenched and tempered forgings, the test specimens shall have their longitudinal axis at least $\frac{1}{4}$ T of the maximum heat-treated thickness from any surface and with the mid-length of the specimens at least one T from any second surface. This is normally referred to as $\frac{1}{4}$ $T \times T$, where T is the maximum heat-treated thickness. A thermal buffer may be used to adhere to the above condition.
- 8.1.1.3 For liquid quenched and tempered forgings with prior purchaser approval, test specimens may be taken at a depth (t) corresponding to the distance from the area of significant stress to the nearest heat-treated surface and at least twice this distance $(2\ t)$ from any second surface. However, the test depth shall not be nearer to one heat-treated surface than 3/4 in. [19 mm] and to the second treated surface than 1/2 in. [38 mm]. This method of test specimen location normally (known as tx2t testing) applies to thick and complex pressure vessel components where the testing in accordance with 8.1.1.2 is not practical. Sketches showing the proposed exact test locations shall be approved by the purchaser when this method is used.
- 8.1.2 Except as specified in this specification, tests for acceptance shall be made after heat treatment has been completed in accordance with Section 6. When the ends of the cylindrical forgings are closed in by reforging, the cylindrical forgings may be normalized and tempered or annealed and tested before reforging. After reforging, the entire forging shall be re-heat treated in the same manner and at the same temperature range as employed when the forging was heat treated before certification testing.
- 8.1.3 When mutually agreed upon between the manufacturer and the purchaser, test specimens may be machined from a specially forged block suitably worked and heat treated with the production forgings. Such a special block shall be obtained from an ingot, slab, or billet from the same heat used to make the forgings it represents. This block shall receive essentially the same type of hot-working and forging reduction as the production forgings; however, a longitudinally forged bar with dimensions not less than $T \times T \times 3T$ may be used to represent a ring forging. The dimension T shall be representative of the heaviest effective cross section of the forging. For quenched and tempered forgings for which tests are required at both ends by 8.2.2.3 and 8.2.2.4, separately forged test blocks are not allowed.

Note 1—In using separately forged test blocks, attention is drawn to the effect of mass differences between the production forgings and the test blocks. This can be particularly significant when forgings are either normalized and tempered or quenched and tempered.

8.2 Number and Location of Tests—The number and location of tests are based on forging length, weight, and heat treatment and shall be as prescribed below. The length and weight to be used for this purpose shall be the shipped length

- and weight of forgings produced individually or the aggregate shipped length and weight of all pieces cut from a multiple forging.
 - 8.2.1 Annealed or Normalized and Tempered Forgings:
- 8.2.1.1 For forgings weighing 5000 lb [2250 kg] or less at the time of heat treatment, one tension test shall be taken from one forging per heat, per heat treatment charge. When heat treatment is performed in continuous type furnaces with suitable temperature controls and equipped with recording pyrometers so that complete heat treatment records are available, a tempering charge may be considered as any continuous run not exceeding an 8-h period.
- 8.2.1.2 For forgings and forged bars weighing over 5000 lb [2250 kg] at the time of heat treatment, one tension test shall be taken from each forging.
 - 8.2.2 Quenched and Tempered Forgings:
- 8.2.2.1 For quenched and tempered forgings weighing 5000 lb [2250 kg] or less at the time of heat treatment, but not exceeding 12 ft [3.7 m] in length, one tension test shall be taken from one forging per heat, per heat treatment charge. When heat treatment is performed in continuous type furnaces with suitable temperature controls and equipped with recording pyrometers so that complete heat treatment records are available, a tempering charge may be considered as any continuous run not exceeding an 8-h period.
- 8.2.2.2 For quenched and tempered forgings and forged bars weighing over 5000 to 10 000 lb [2250 to 4500 kg] at the time of heat treatment, but not exceeding 12 ft [3.7 m] in length, one tension test shall be taken from each forging.
- 8.2.2.3 Quenched and tempered forgings that exceed 12 ft [3.7 m] in length shall be tension tested at both ends of the forging under test.
- 8.2.2.4 For quenched and tempered forgings and forged bars weighing more than 10 000 lb [4500 kg] at the time of heat treatment, two tension test specimens shall be taken from each forging. These shall be offset 180° from each other except that if the length of the forging, excluding test prolongations, exceeds 12 ft [3.7 m], then one specimen shall be taken from each end of the forging.
- 8.3 Notch Toughness Requirements-Grades F3V, F3VCb, F22V, and F6NM:
- 8.3.1 Impact test specimens shall be Charpy V-notch, as shown in Test Methods and Definitions A370. The usage of subsize specimens due to material limitations must have prior purchaser approval.
- 8.3.2 The Charpy V-notch test specimens shall be obtained as required for tension tests in 8.1 and 8.2. One set of three Charpy V-notch specimens shall be taken from each tensile specimen location.
- 8.3.3 The longitudinal axis and mid-length of impact specimen shall be located similarly to the longitudinal axis of the tension test specimens. The axis of the notch shall be normal to the nearest heat treated surface of the forging.
- 8.3.4 The Charpy V-notch tests shall meet a minimum energy absorption value of 40 ft·lbf [54 J] average of three specimens. One specimen only in one set may be below 40 ft·lbf [54 J] and it shall meet a minimum value of 35 ft·lbf [48 J].

- 8.3.5 The impact test temperature shall be not warmer than $0\,^{\circ}\text{F}$ [-18 $^{\circ}\text{C}$].
- 8.3.6 Unless Supplementary Requirement S13 of Specification A788/A788M is specified by the purchaser, for Grade F6NM forgings a minimum average absorbed energy of 20 ft·lbf [27 J] for each test shall apply at a temperature not warmer than -100 °F [-73 °C].

9. Ultrasonic Examination

9.1 For F91 Type 1 and Type 2 and F92 hollow forgings, either S20, Ultrasonic Examination, or S22, Ultrasonic Examination from the Bore Surface, of Specification A788/A788M, shall be mandatory.

10. Workmanship, Finish, and Appearance

10.1 When forgings have been heat treated by quenching and tempering, all accessible surfaces shall subsequently be examined for quench cracks by the magnetic particle method in accordance with Practice A275/A275M.

11. Repair Welding

- 11.1 Repair welding of forgings may be permitted but only at the option of the purchaser. Such repair welds shall be made in accordance with the ASME Boiler and Pressure Vessel Code, Section IX.
- 11.2 All repair welds in F91 Type 1 and Type 2 shall be made with one of the following welding processes and consumables: SMAW, SFA 5.5 E90XX-B9; SAW, SFA 5.23 EB9 + flux; GTAW, SFA 5.28 ER90S-B9; and FCAW 5.29 E91T1-B9.

In addition, the sum of the Ni+Mn content of all welding consumables used to fabricate F91 Type 1 and Type 2 forgings shall not exceed 1.0 %.

11.3 All repair welds in F92 shall be made with one of the following processes: SMAW, SAW, GTAW, or FCAW; and the composition of the welding consumables shall meet the requirements for F92 in Table 2.

12. Marking

- 12.1 In addition to the marking requirements of Specification A788/A788M, the specification marking shall be followed by the letter A for annealed, N for normalized and tempered, or Q for liquid quenched and tempered as applicable.
- 12.2 For F91 additional marking shall include the appropriate Type.

13. Test Reports

13.1 The certification requirements of Specification A788/A788M shall apply.

14. Keywords

14.1 chromium alloy steel; chromium-molybdenum steel; martensitic stainless steel; pressure containing parts; pressure vessel service; steel forgings—alloy; temperature service applications—high

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall apply only when specified by the purchaser in the inquiry, contract, and order. Details of these supplementary requirements shall be agreed upon between the manufacturer and the purchaser.

S1. Rough Turning and Boring

S1.1 The position of the rough turning and boring in the sequence of manufacturing operations shall be specified.

S2. Transverse Mechanical Testing

S2.1 Instead of test specimens taken in accordance with 8.1.1, the longitudinal axis of the test specimens shall be transverse to the direction of major working of the forging. The tension test results shall conform with requirements of Table 1, with the exception of the ductility limits which shall be as prescribed in Table S2.1. When required, the Charpy impact test results shall conform to 8.3.

S3. Alternative Test Specimen Requirements

S3.1 The test requirements for materials of the ASME Boiler and Pressure Code, Section III, Article NB-2223.3, shall be used in place of that specified in 8.1.1.1.

S4. Hydrostatic Test

S4.1 A hydrostatic pressure test shall be applied. The details of the test, including its position in the sequence of manufacturing operations, shall be specified.

S6. Liquid Penetrant Examination

S6.1 After forgings have been heat treated by quenching and tempering, all accessible surfaces shall be inspected for quench cracks by the liquid penetrant method in accordance with Practice E165/E165M as an alternative to magnetic particle examination.

S7. Marking

S7.1 Forgings shall be marked at a location indicated by the purchaser in the purchase order or drawing.

TABLE S2.1 Ductility Limits

										Grade										
	F1	F11, Class 2	F11, Class 3	F11, Class 2	F12	F5	F5A	F9	F6	F6NM	F21, Class 3	F21, Class 1	F22, Class 3	F22, Class 1	F3V	F46	F22V	F91 Type 1	F911	F92
																		and Type 2		
Elongation in 2 in. or 50 mm, min, %	20	18	18	19	18	19	19	18	18	14	18	19	18	20	17	40	17	19	16	16
Reduction of area, min, %	30	35	30	40	25	35	35	35	35	40	35	35	25	35	35	50	35	40	30	30

S8. Forging Requirements

- S8.1 Large drum forgings shall be made from solid cast ingots, punched, bored, or trepanned, or from hollow ingots cast in metal molds. The walls of the hollowed or hollow ingots shall be reduced in thickness at least one-half by forging on mandrels.
- S8.2 Drum forgings with one solid closed end may be hollow forged in closed dies or on a draw bench provided the metal is worked thoroughly.
- S8.3 Drum forgings, either with open ends or one solid closed end, may also be produced by hot extrusion provided the metal is worked thoroughly.
- S8.4 Small drum forgings may be made as solid forgings, subsequently bored, provided the purchaser agrees to this method of forging. The cross-sectional area of the solid forgings shall have a reduction by forging from that of the ingot in the ratio of not less than 3:1.

- S8.5 Small sections or component parts of pressure vessels, which are to be subsequently assembled to form drums, may be made by expanding on a mandrel under a press or hammer, by hot extrusion or by ring rolling methods, provided the wall thickness is reduced at least one-half in the process.
- S8.6 Heads or covers shall be forged as disks, upset from blocks cut from ingots or billets. The length of block before upsetting shall be at least twice the thickness of the as-forged head or cover.

S9. Individual Forging

- S9.1 Forgings, whether identical or not identical, shall be produced individually. They shall not be forged in multiple and separated prior to or after heat treatment.
- S9.2 The shape and size of individual forgings shall be agreed between the manufacturer and the purchaser by means of a forging drawing or the purchase order.



SPECIFICATION FOR CARBON AND LOW-ALLOY STEEL FORGINGS, REQUIRING NOTCH TOUGHNESS TESTING FOR PIPING COMPONENTS



SA-350/SA-350M

(Identical with ASTM Specification A350/A350M-02b except for the deletion of 6.1.2 and 14.1, revision to 14.2.5, and test reports have been made mandatory.)

SPECIFICATION FOR CARBON AND LOW-ALLOY STEEL FORGINGS, REQUIRING NOTCH TOUGHNESS TESTING FOR PIPING COMPONENTS



SA-350/SA-350M

(Identical with ASTM Specification A 350/A 350M-02b except for the deletion of 6.1.2 and 14.1, revision to 14.2.5, and test reports have been made mandatory.)

1. Scope

- 1.1 This specification covers several grades of carbon and low-alloy steel forged or ring-rolled flanges, forged fittings and valves intended primarily for low-temperature service and requiring notch toughness testing. They are made to specified dimensions, or to dimensional standards, such as the ASME and API Specifications referenced in Section 2. Although this specification covers some piping components machined from rolled bar and seamless tubular materials (see 5.3.3), it does not cover raw material produced in these product forms.
- **1.2** No limitation on size is intended beyond the ability of the manufacturer to obtain the specified requirements. However, Class 3 of Grade LF787 is only available in the quenched-and-precipitation heat treated condition.
- **1.3** Supplementary requirements are provided for use when additional testing or inspection is desired. These shall apply only when specified by the purchaser in the order.
- **1.4** This specification is expressed in both inch-pound units and in SI units. However, unless the order specifies the applicable "M" specification designation (SI units), the material shall be furnished to inch-pound units.
- 1.5 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification.

NOTE 1 — Refer to Test Methods and Definitions A 370 for notes on significance of notched-bar impact testing.

2. Referenced Documents

- **2.1** ASTM Standards:
- A 370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A 788 Specification for Steel Forgings, General Requirements
- A 961 Specification for Common Requirements for Steel Flanges, Forged Fittings, Valves, and Parts for Piping Applications
 - **2.2** ASME Standards:
- B 16.5 Steel Pipe Flanges and Flanged Fittings
- B 16.9 Factory-Made Wrought Steel Butt-Welding Fittings
- B 16.10 Face-to-Face and End-to-End Dimensions of Ferrous Valves
- B 16.11 Forged Steel Fittings, Socket-Welding and Threaded
- B 16.30 Unfired Pressure Vessel Flange Dimensions
- B 16.34 Valves-Flanged, Threaded, and Welding End
- B 16.47 Large Diameter Steel Flanges
- **2.3** ASME Boiler and Pressure Vessel Code:

Section IX Welding Qualifications

- **2.4** AWS Standards:
- A 5.1 Mild Steel Covered Arc-Welding Electrodes
- A 5.5 Low-Alloy Steel Covered Arc-Welding Electrodes
 - **2.5** API Standards:
- 600 Steel Gate Valves with Flanged or Butt-Welding Ends 602 Compact Design Carbon Steel Gate Valves for Refinery Use
- 605 Large Diameter Carbon Steel Flanges

3. Ordering Information

3.1 It is the purchaser's responsibility to specify in the purchase order information necessary to purchase the

needed material. In addition to the ordering information guidelines in Specification A 961, orders should include the following information:

3.1.1 Additional requirements (see Table 1 footnotes).

4. General Requirements

4.1 Product furnished to this specification shall conform to the requirements of Specification A 961, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A 961 constitutes nonconformance with this specification. In case of conflict between the requirements of this specification and Specification A 961, this specification shall prevail.

5. Manufacture

- **5.1** *Melting Process* The steel shall be produced by any of the following primary processes: open-hearth, basic oxygen, electric-furnace, or vacuum-induction melting (VIM). The primary melting may incorporate separate degassing or refining, and may be followed by secondary melting using electroslag remelting (ESR), or vacuum-arc remelting (VAR).
- **5.1.1** The steel shall be fully killed, fine-grain practice.
- **5.1.2** The molten steel may be vacuum treated prior to or during pouring of the ingot.
- **5.2** *Discard* A sufficient discard shall be made to secure freedom from injurious piping and undue segregation.

5.3 Forging Process:

- **5.3.1** Material for forgings shall consist of ingots, or forged, rolled, or strandcast blooms, billets, slabs, or bars.
- **5.3.2** The finished product shall be a forging as defined in the Terminology section of Specification A 788.
- **5.3.3** Except for flanges of all types, hollow, cylindrically-shaped parts may be machined from rolled bar or seamless tubular materials provided that the axial length of the part is approximately parallel to the metal flow lines of the stock. Other parts, excluding flanges of all types, may be machined from hot-rolled or forged bar up through and including NPS 4. Elbows, return bends, tees, and header tees shall not be machined directly from bar stock.

5.4 *Heat Treatment:*

5.4.1 After hot working and before reheating for heat treatment, the forging shall be allowed to cool substantially below the transformation range.

- **5.4.2** Forgings of grades other than Grade LF787 shall be furnished in the normalized, or in the normalized and tempered, or in the quenched and tempered condition described by the following procedures:
- **5.4.2.1** *Normalize* Heat to a temperature that produces an austenitic structure, holding sufficient time to attain uniform temperature throughout. Cool uniformly in still air
- **5.4.2.2** *Normalize and Temper* Subsequent to normalize, reheat to 1100°F [590°C] minimum, holding at temperature a minimum of 30 min/in. [30 min/25 mm] of maximum thickness, but in no case less than 30 min. Cool in still air.
- **5.4.2.3** *Quench and Temper* The procedure for quenching shall consist of either (1) fully austenitizing the forgings followed by quenching in a suitable liquid medium or (2) using a multiple stage procedure whereby the forging is first fully austenitized and rapidly cooled, then reheated to partially reaustenitize, followed by quenching in a suitable liquid medium. All quenched forgings shall be tempered by reheating to a temperature between 1100°F [590°C] and the lower transformation temperature, holding at temperature a minimum of 30 min/in. [30 min/25 mm] of maximum thickness but in no case less than 30 min. Cool in still air.
- **5.4.3** Grade LF787 forgings shall be furnished in either the normalized-and-precipitation heat treated condition or in the quenched-and-precipitation heat treated condition. The heat treatment procedures shall be as follows:
- **5.4.3.1** Normalized-and-Precipitation Heat Treated Heat to a temperature in the range from 1600 to 1725°F [870 to 940°C], hold at the temperature for a time sufficient to attain uniform temperature throughout, soak at the temperature for not less than $\frac{1}{2}$ h, and remove from the furnace and cool in air. Subsequently, heat to a temperature in the range from 1000 to 1200°F [540 to 650°C], soak at the temperature for not less than $\frac{1}{2}$ h, and cool at any convenient rate.
- **5.4.3.2** Quenched-and-Precipitation Heat Treated Heat to a temperature in the range from 1600 to 1725°F [879 to 940°C], hold at the temperature for a time sufficient to attain uniform temperature throughout, soak at the temperature for not less than $\frac{1}{2}$ h and quench in a suitable liquid medium by immersion; reheat to a temperature in the range from 1000 to 1225°F [540 to 665°C], hold at the temperature for not less than $\frac{1}{2}$ h, and cool at any convenient rate.

6. Chemical Composition

6.1 Heat Analysis:

6.1.1 A chemical heat analysis in accordance with Specification A 961 shall be made and conform to the

requirements as to chemical composition prescribed in Table 1. Leaded steels shall not be permitted.

6.1.2 DELETED

6.2 Product Analysis:

6.2.1 The purchaser may make a product analysis on products supplied to this specification in accordance with Specification A 961.

7. Mechanical Properties

7.1 Tension Tests:

- **7.1.1** *Requirements* The material shall conform to requirements for tensile properties in Table 2.
- **7.1.1.1** The test specimen shall be obtained from a rough or finished forging, or prolongation thereof. For forgings under 10 000 lbs, at time of heat treatment, it may be obtained from separately forged test blanks from the same heat of steel as the production forgings. The test blank shall be reduced by forging in a manner similar to that for the products represented, and shall receive approximately the same hot working and reduction and the same heat treatment as the finished products represented. The test material shall be treated in the same furnace at the same time as the forging it represents, subject to the requirements of 7.1.2.1.
- **7.1.1.2** The test specimen shall represent all forgings from the same heat and heat-treatment load whose maximum thicknesses do not exceed the thickness of the test forging or blank by more than $\frac{1}{4}$ in. [6 mm].
- **7.1.2** *Number of Tests* One tension test at room temperature shall be made in accordance with 7.1.1.2 from each heat in each heat-treatment load.
- **7.1.2.1** If heat treatment is performed in either a continuous or a batch-type furnace controlled within ±25°F [±14°C] of the required heat-treatment temperature and equipped with recording pyrometers so that complete records of heat treatment are available and if the same heat-treating cycles are used on the forgings represented by the tension test, then one tension test from each heat shall be required, instead of one tension test from each heat in each heat treatment load in accordance with 7.1.1.2.
- **7.1.3** Test Locations and Orientations The test specimen shall be removed from the heaviest section of the forging or test blank, at locations described in 7.1.3.1, 7.1.3.2, 7.1.3.5 or as close to these locations as practical, subject to forging size and geometry.
- **7.1.3.1** For forgings or test blanks having a maximum heat-treated thickness, *T*, of 2 in. [50 mm] or less, the longitudinal axis of the test specimen shall be taken at mid-thickness and its mid-length shall be at least 2 in. [50 mm] from a second heat treated surface, exclusive of the

T dimension surfaces. (This is normally referred to as $\frac{1}{2}T$ by 2 in, [50 mm]).

- **7.1.3.2** For forgings or test blanks having a maximum heat-treated thickness, T, greater than 2 in. [50 mm], the central axis of the test specimen shall be taken at least $\frac{1}{4}T$ from the nearest heat-treated surface and at least T or 4 in. [100 mm], whichever is less, from any second heat-treated surface. For quenched and tempered forgings, the midlength of the test specimen shall be at least T from any second heat-treated surface. See Fig. 1 for test specimen location in separately forged test blanks for quenched and tempered forgings.
- 7.1.3.3 Metal Buffers The required distances from heat treated surfaces may be obtained with metal buffers instead of integral expansions. Buffer material may be carbon or low alloy steel, and shall be joined to the forging with a partial penetration weld that seals the buffered surface. Specimens shall be located at $\frac{1}{2}$ in. [13 mm] minimum from the buffered surface of the forging. Buffers shall be removed and the welded areas subjected to magnetic particle test to assure freedom from cracks unless the welded areas are completely removed by subsequent machining.
- **7.1.3.4** The test specimen shall have its longitudinal axis located parallel to the direction of major working of the forging or test blank.
- **7.1.3.5** With prior purchaser approval, tests may be taken at a depth (t) corresponding to the distance from the area of significant loading to the nearest heat treated surface and at least twice this distance (2t) from any second surface. However, the test depth shall not be nearer to one treated surface than $\frac{3}{4}$ in. [19 mm] and to the second treated surface than $1\frac{1}{2}$ in. [38 mm]. This method of test location would normally apply to contour-forged parts, or parts with thick cross-sectional areas where $\frac{1}{4}T \times T$ testing (7.1.3.2) is not practical. Sketches showing the exact test locations shall be approved by the purchaser when this method is used.
- **7.1.4** Test Method Testing shall be performed in accordance with Test Methods and Definitions A 370. The test specimen shall be as large as is practicable and shall be machined to the form and dimensions of Fig. 5 of Test Methods and Definitions A 370. When seamless tubular materials are used, testing shall be performed on longitudinal specimens in accordance with Annex A2, Steel Tubular Products, of Test Methods and Definitions A 370.

7.2 Impact Test:

7.2.1 Requirements — The material shall conform to the requirements for impact properties in Table 3 when tested at the applicable standard temperature in Table 4 within the limits of 7.2.4.2 and 7.2.4.3. When subsize specimens are used, the impact energy values obtained

shall conform to Table 5 at energy values proportional to standard size. Exceptions to this requirement are permissible when Supplementary Requirement S1 is specified by the purchaser. Impact tests may be made at temperatures different from those in Table 4, provided that the test temperature is at least as low as the intended service temperature, and that the forging is suitably marked to identify the reported test temperature.

- **7.2.1.1** The test specimens shall be machined from material obtained as in 7.1.
- **7.2.2** *Number of Tests* Three specimens shall constitute one test set. There shall be the same number of test sets as tension tests in 7.1.2.
- **7.2.3** Test Locations and Orientations The test specimen shall be located and oriented as described in 7.1.3. The area under the notch of the impact test specimen shall be used to locate the specimen with respect to the second heat-treated surface. The base of the notch shall be perpendicular to the nearest heat-treated surface.
- **7.2.4** Test Method The notched bar impact test shall be made in accordance with the procedure for the Charpy V-notch type test as described in Test Methods and Definitions A 370.
- **7.2.4.1** Standard size specimens shown in Fig. 11 of Test Methods and Definitions A 370 shall be used for the impact test. Where the material is of insufficient thickness, or the shape of the forging precludes standard size, the largest obtainable subsize specimen described in Test Methods and Definitions A 370 shall be used.
- **7.2.4.2** Where subsize specimens are used and represent forged material with thicknesses equal to or greater than 0.394 in. [10 mm], and where the largest obtainable specimen has a width along the notch of at least 8 mm, such specimen shall be tested at the temperature in Table 4. Where the largest obtainable specimen has a width along the notch less than 8 mm, the temperature for testing shall be lower than the temperature in Table 4 by the amount shown in Table 6 for the actual specimen width tested.
- **7.2.4.3** Where subsize specimens are used and represent forged material with thicknesses less than 0.394 in. [10 mm], and where the largest obtainable specimen has a width along the notch of at least 80% of the forging thickness, the specimen shall be tested at the temperature in Table 4. Where the largest obtainable specimen has a width along the notch of less than 80% of the material thickness, the temperature for testing shall be lower than the temperature in Table 4 by an amount equal to the difference (referring to Table 6) between the temperature reduction corresponding to the thickness of the material represented, and the temperature reduction corresponding to the specimen width actually tested.

7.3 Hardness Test:

7.3.1 Except when only one forging is produced, a minimum of two forgings shall be hardness tested per batch or continuous run as defined in 7.1.2.1 to ensure that hardness of the forgings does not exceed 197 HB after heat treatment for mechanical properties. The hardness measurements shall be made in accordance with Test Methods and Definitions A 370. When only one forging is produced, it shall be hardness tested to ensure that it meets the 197 HB maximum of this specification. The purchaser may verify that this requirement has been met by testing at any location on the forging, provided that such testing does not render the forging useless.

8. Hydrostatic Test

8.1 Forgings manufactured under this specification shall be capable of passing a hydrostatic test compatible with the rating of the finished item. Such tests shall be conducted by the manufacturer only when Supplementary Requirement S57 of Specification A 961 is specified.

9. Workmanship, Finish, and Appearance

9.1 Forgings shall conform to the requirements of Specification A 961.

10. Retests

10.1 If any test specimen shows flaws or defective machining, it may be discarded and another specimen substituted.

11. Rework and Retreatment

- 11.1 If the results of the mechanical tests do not conform to the requirements specified, the manufacturer may reheat treat the forgings represented, and shall retest to the applicable requirements.
- 11.2 Individually tested forgings meeting all requirements shall be acceptable.
- **11.3** *Repair by Welding* Weld repairs shall be permitted (see Supplementary Requirement S58 of Specification A 961) at the discretion of the manufacturer with the following limitations and requirements:
- 11.3.1 Repair by welding shall be made using welding procedures and welders qualified in accordance with ASME Section IX of the Code. The weld procedure qualification test shall also include impact tests of the weld metal and heat-affected zone. All impact test specimens shall have the longitudinal axis transverse to the weld and the base of the notch normal to the weld surface. Weld

specimens shall have the notch in weld metal and heat-affected zone specimens shall have the notch in the heat-affected zone. The specimens shall be as large as permitted by the weldment thickness. Where full-size specimens can be obtained and where there is sufficient weldment thickness, the weld specimen shall be taken with one side of the specimen within $\frac{1}{16}$ in. [1.6 mm] of the weld surface. Heat-affected zone impact test specimens shall be taken at the same depth and locations applicable to the forging in 7.1.3.1 and 7.1.3.2. When forgings are thermally treated after repair welding, the weld procedure test plate shall be subjected to the same thermal treatment. The mechanical properties of the weld procedure qualification test shall conform to Section 7.

- 11.3.2 Defects shall be completely removed by chipping or grinding to sound metal as verified by magnetic particle, or liquid penetrant inspection prior to welding.
- 11.3.3 For Grade LF1 forgings, and LF2 forgings that are to be only stress-relieved after repair welding, the weld metal shall be deposited using carbon steel electrodes E 7015, E 7016, or E 7018, complying with AWS A 5.1. For Grade LF2 forgings in all other conditions of postweld heat treatment, the weld metal shall be deposited using low-alloy steel electrodes E 7015-A1; E 7016-A1, or E 7018-A1 complying with AWS 5.5; for Grade LF3 forgings the weld metal shall be deposited using low-alloy steel electrodes E 8016-C2 or E 8018-C2 complying with AWS A 5.5; for Grades LF5, LF9, and LF787 forgings, the weld metal shall be deposited using low-alloy steel electrodes E 8016-C1 or E 8018-C1 complying with AWS A 5.5. For Grade LF6, the electrodes shall be low-hydrogen, E-XX15, E-XX16, or E-XX18 complying with AWS A 5.1 or A 5.5, as applicable.
- **11.3.4** After repair welding, the area welded shall be completely free of defects as verified by magnetic particle or liquid penetrant inspection.
- 11.3.5 Forgings repair welded in the normalized, normalized and tempered, or the quenched and tempered conditions shall be stress-relieved after repair welding at 1100°F [590°C] minimum, but not higher than the temperature previously used for tempering the base metal of the same forging, or shall be reheat treated in accordance with 5.4.
- **11.3.6** When the purchaser specifies Supplementary Requirement S5, the same requirements shall apply to the weld procedure qualification tests.
- 11.3.7 Repair by welding shall not exceed 10% of the surface area of the forging or $33\frac{1}{3}\%$ of the wall thickness of the finished forging, or $\frac{3}{8}$ in. [9.5 mm], whichever is less, without prior approval of the purchaser.
- **11.3.8** When approval of the purchaser is obtained, the limitations set forth in 11.3.7 may be exceeded, but all other requirements of 11.3 shall apply.

12. Inspection

12.1 Inspection provisions of Specification A 961 shall apply.

13. Rejection and Rehearing

13.1 Purchaser shall comply with provisions of Specification A 961.

14. Certification

14.1 DELETED

- 14.2 Test reports are required, they shall include certification that all requirements of this specification have been met, and shall be traceable to the forging represented. The specification designation included on test reports shall include year of issue and revision letter, if any. The manufacturer shall provide the following where applicable:
 - **14.2.1** Type heat treatment, Section 5,
 - **14.2.2** Chemical analysis results, Section 6 (Table 1),
 - **14.2.3** Product analysis results, 6.2 (Table 1),
- **14.2.4** Tensile property results, Section 7 (Table 2) report the yield strength and ultimate strength, in ksi [MPa], elongation and reduction in area, in percent,
- **14.2.5** Impact test results, 7.2 (Table 3, Table 4, Table 5, and Table 6), including specimen size if subsize samples were used,
 - **14.2.6** Hardness results, 7.3.1,
- **14.2.7** Any supplementary testing required by the purchase order, and
- **14.2.8** If repaired by welding, letter W is to follow the ASTM designation.

15. Product Marking

- **15.1** In addition to the marking requirements of Specification A 961, manufacturer's name (see Note 2) or symbol shall be permanently marked on each forging.
- NOTE 2 For purposes of identification marking, the manufacturer is considered the organization that certifies the piping component was manufactured, sampled, and tested in accordance with this specification and the results have been determined to meet the requirements of this specification.
- **15.1.1** If the forgings have been quenched and tempered or quenched-and-precipitation heat treated, the letters QT shall be stamped on the forgings following the ASTM designation.
- **15.1.2** Forgings repaired by welding shall be marked with the letter W following the ASTM designation.
- **15.2** If identification stamps are objectionable and detrimental to the forging, and when so stated on the purchase

order, the marks may be painted or stenciled on the forging, or stamped on a metal or plastic tag which shall be securely attached to the forging.


- **15.3** When test reports are required, additional marks shall be used as necessary to identify the part with the test report.
- 15.4 If the test temperature is other than the standard temperature specified in Table 4, the mark shall also include the suffix letter S to the grade and class and the test temperature. A prefix 0 to the test temperature shall indicate a less than $0^{\circ}F$ [-18°C] value. For example, LF2S 0175 denotes a test temperature of $-175^{\circ}F$ [-115°C] for an LF2 part.
- **15.5** Parts meeting all requirements for more than one class may be marked with more than one class such as LF2 CL1/CL2; LF5 CL1/CL2, and so forth.

15.6 Bar Coding — In addition to the requirements in 15.1, 15.2, 15.3, 15.4, and 15.5, bar coding is acceptable as a supplemental identification method. The purchaser may specify in the order a specific bar coding system to be used. The bar coding system, if applied at the discretion of the supplier, should be consistent with one of the published industry standards for bar coding. If used on small parts, the bar code may be applied to the box or a substantially applied tag.

16. Keywords

16.1 carbon equivalent; pipe fittings, steel; piping applications; pressure containing parts; steel flanges; steel forgings, alloy; steel forgings, carbon; steel valves; temperature service applications, low

FIG. 1 TEST SPECIMEN LOCATION FOR QUENCHED AND TEMPERED FORGINGS

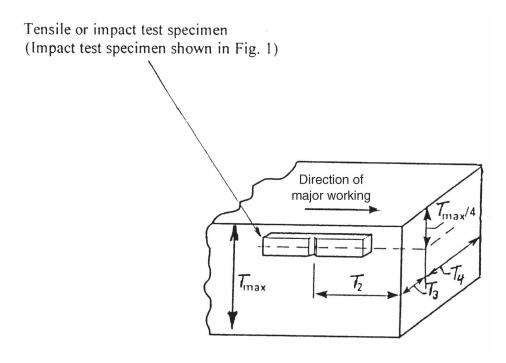

NOTE 1 — For material with thickness T greater than 2 in. [50 mm], $T_2 = T_3 = T_4 \ge T_{\rm max}$ where:

 $T_{\text{max}} = \text{maximum heat threated thickness}$

TABLE 1
CHEMICAL REQUIREMENTS

	Composition, wt. %									
Element	Grade LF1	Grade LF2	Grade LF3	Grade LF5	Grade LF6	Grade LF9	Grade LF787			
Carbon, max	0.30	0.30	0.20	0.30	0.22	0.20	0.07			
Manganese	0.60-1.35	0.60-1.35	0.90 max	0.60-1.35	1.15-1.50	0.40-1.06	0.40-0.70			
Phosphorus, max	0.035	0.035	0.035	0.035	0.025	0.035	0.025			
Sulfur, max	0.040	0.040	0.040	0.040	0.025	0.040	0.025			
Silicon ^A	0.15-0.30	0.15-0.30	0.20-0.35	0.20-0.35	0.15-0.30		0.40 max			
Nickel	0.40 max ^{<i>B</i>}	0.40 max ^{<i>B</i>}	3.3-3.7	1.0-2.0	0.40 max^B	1.60-2.24	0.70-1.00			
Chromium	0.30 max ^{B, C}	0.30 max ^{B, C}	$0.30~\text{max}^{\mathcal{C}}$	$0.30~{\rm max}^{\it C}$	0.30 max ^{B, C}	0.30 max C	0.60-0.90			
Molybdenum	$0.12 \text{ max}^{B,C}$	$0.12 \text{ max}^{B,C}$	$0.12~{\rm max}^{\it C}$	0.12 \max^{C}	$0.12 \text{ max}^{B,C}$	0.12 \max^{C}	0.15-0.25			
Copper	0.40 max ^{<i>B</i>}	0.40 max ^{<i>B</i>}	0.40 \max^{C}	0.40 \max^{C}	0.40 max ^{<i>B</i>}	0.75-1.25	1.00-1.30			
Columbium	0.02 max	0.02 max	0.02 max	0.02 max	0.02 max	0.02 max	0.02 min			
Vanadium	0.08 max	0.08 max	0.03 max	0.03 max	0.04-0.11	0.03 max	0.03 max			
Nitrogen					0.01-0.030					

 $^{^{\}it A}$ When vacuum carbon-deoxidation is required by Supplementary Requirement S4, the silicon content shall be 0.12% maximum.

 $^{^{\}it B}$ The sum of copper, nickel, chromium, vanadium, and molybdenum shall not exceed 1.00% on heat analysis.

 $^{^{\}it C}$ The sum of chromium and molybdenum shall not exceed 0.32% on heat analysis.

TABLE 2 TENSILE PROPERTIES AT ROOM TEMPERATURE $^{\mathcal{A}}$

				Grad	des			
	LF1 and	LF2	LF3 Classes	LI	F6		LF	787
	LF5 Class 1	Classes 1 and 2	1 and 2 LF5 Class 2	Class 1	Classes 2 and 3	LF9	Class 2	Class 3
Tensile strength, ksi [MPa]	60–85 [415–585]	70–95 [485–655]	70–95 [485–655]	66–91 [455–630]	75–100 [515–690]	63–88 [435–605]	65–85 [450–585]	75–95 [515–655]
Yield strength, min, ksi $[MPa]^{B,C}$ Elongation:	30 [205]	36 [250]	37.5 [260]	52 [360]	60 [415]	46 [315]	55 [380]	65 [450]
Standard round specimen, or small proportional specimen, min % in 4D gage length	25	22	22	22	20	25	20	20
Strip specimen for wall thickness $\frac{5}{16}$ in. (7.94 mm) and over and for all small sizes tested in full section; min % in 2 in. (50 mm)	28	30	30	30	28	28	28	28
Equation for calculating min elongation for strip specimens thinner than $\frac{5}{16}$ in. (7.94 mm); min % in 2 in. (50 mm) $t = \text{actual thickness in inches}$	48 <i>t</i> + 13	48 <i>t</i> + 15	48 <i>t</i> + 15	48 <i>t</i> + 15	48 <i>t</i> + 13	48 <i>t</i> + 13	48 <i>t</i> + 13	48 <i>t</i> + 13
Reduction of area, min, %	38	30	35	40	40	38	45	45

^A See 7.3 for hardness tests.

TABLE 3
CHARPY V-NOTCH ENERGY REQUIREMENTS FOR STANDARD
SIZE [10 by 10 mm] SPECIMENS

Grade	Minimum Impact Energy Required for Average of Each Set of Three Specimens, ft-lbf [J]	Minimum Impact Energy Permitted for One Specimen only of a Set, ft-lbf [J]		
LF1 and LF9	13 [18]	10 [14]		
LF2, Class 1	15 [20]	12 [16]		
LF3, Class 1	15 [20]	12 [16]		
LF5, Class 1 and 2	15 [20]	12 [16]		
LF787, Classes 2 and 3	15 [20]	12 [16]		
LF6, Class 1	15 [20]	12 [16]		
LF2, Class 2	20 [27]	15 [20]		
LF3, Class 2	20 [27]	15 [20]		
LF6, Classes 2 and 3	20 [27]	15 [20]		

 $^{^{\}it B}$ Determined by either the 0.2% offset method or the 0.5% extension under load method.

^C For round specimens only.

TABLE 4
STANDARD IMPACT TEST TEMPERATURE FOR STANDARD SIZE [10 by 10 mm] SPECIMENS

Grade	Test Temperature, °F [°C]
LF1	-20 [-29]
LF2, Class 1	-50 [-46]
LF2, Class 2	0 [-18]
LF3, Classes 1 and 2	-150 [-101]
LF5, Classes 1 and 2	- 75 [- 59]
LF6, Classes 1 and 2	-60 [-51]
LF6, Class 3	0 [-18]
LF9	-100 [-73]
LF787, Class 2	-75 [- 59]
LF787, Class 3	-100 [-73]

TABLE 5 MINIMUM EQUIVALENT ABSORBED ENERGY FT-LBF (J) FOR VARIOUS SPECIMEN SIZES 4

Standard Size [10 by 10 mm]	³ / ₄ Size [10 by 7.5 mm]	² / ₃ Size [10 by 6.6 mm]	$\frac{1}{2}$ Size [10 by 5 mm]	$\frac{1}{3}$ Size [10 by 3.3 mm]	¹ / ₄ Size [10 by 2.5 mm]
15 [20]	12 [16]	10 [14]	8 [11]	5 [7]	4 [6]
13 [18]	10 [14]	9 [12]	7 [10]	5 [7]	4 [6]
12 [16]	10 [14]	9 [12]	7 [10]	4 [6]	3 [5]
10 [14]	8 [11]	7 [10]	5 [7]	3 [5]	3 [5]

 $^{^{\}it A}$ Straight-line interpolation for intermediate values is permitted.

TABLE 6
CHARPY IMPACT TEST TEMPERATURE REDUCTION BELOW TABLE 5 TEST
TEMPERATURE WHEN THE SUBSIZE CHARPY IMPACT WIDTH ALONG NOTCH IS
LESS THAN 80% OF THE FORGING THICKNESS

Size of Bar	Thickness of the Material Represented (see 7.2.4.3), or Charpy, Impact Specimen Width Along the Notch ⁴ , in. [mm]	Temperature Reduction, °F [°C]
Standard	0.394 [10]	0 [0]
Standard	0.354 [9]	0 [0]
Standard	0.315 [8]	0 [0]
³ / ₄ -size	0.295 [7.5]	5 [3]
³ / ₄ -size	0.276 [7]	8 [5]
² / ₃ -size	0.262 [6.67]	10 [6]
² / ₃ -size	0.236 [6]	15 [8]
½-size	0.197 [5]	20 [11]
½-size	0.158 [4]	30 [17]
¹/₃-size	0.131 [3.33]	35 [20]
¹/₃-size	0.118 [3]	40 [22]
¹/₄-size	0.099 [2.5]	50 [28]

 $^{^{\}it A}$ Straight-line interpolation for intermediate values is permitted.

SUPPLEMENTARY REQUIREMENTS

In addition to any supplementary requirements of Specification A 961, the following supplementary requirements shall apply only when specified by the purchaser in the order:

S1. Other Impact Test Temperatures

- **S1.1** Impact test temperatures lower or higher than the standard temperature in Table 4 of this specification shall be used.
- **S1.1.1** When higher test temperatures are employed, the actual test temperature may not be higher than that given in Table S1.1.1.
- **S1.2** The test temperature shall be specified by the purchaser. When subsize specimens are used, the manufacturer shall adjust the test temperature in accordance with the size restrictions of 7.2.4.2 and 7.2.4.3.
- **S1.3** The forging shall be marked with the specified test temperature in accordance with 15.4. A lower temperature shall not be marked on the forging because of the use of subsize specimens.
- **S1.4** The test results shall comply with Table 3 for standard size specimens, and with Table 5 for subsize specimens.

S2. Stress-Relieved Test Specimens

- **S2.1** The test specimens shall be stress relieved. Stress relieving shall be done after heat treatment in 5.4 and before machining the specimens from the heat-treated test material.
- **S2.2** The purchaser shall furnish the forging manufacturer with details of the stress-relief treatment desired.

S3. Lateral Expansion

S3.1 Lateral expansion of the Charpy V-notch test in accordance with Section 25 of Test Methods and Definitions A 370 shall be measured and reported.

S4. Vacuum Carbon-Deoxidized Steels

S4.1 Material made to Grades LF1, LF2, LF3, LF5, and LF9 shall be vacuum carbon-deoxidized, in which case the silicon content shall be 0.12% maximum. The test report shall indicate that the steel was vacuum carbon-deoxidized.

S5. Special Impact Test Requirements for Flanges (Note S5.1)

- **S5.1** Charpy test specimens shall be cut from an actual flange representing each size, heat, and heat-treatment lot. If more than one size flange is represented by the same heat and heat-treatment lot, the maximum size flange shall be considered representative.
- **S5.2** The number, location, and orientation of the test specimens shall be stated on the order.
- **S5.3** The test results shall comply with Table 3 for standard size specimens, and with Table 5 for subsize specimens.

NOTE S5.1 — These special requirements should be considered for services when the applied stresses approach the maximum permissible limits of the governing code, or the installation is subject to severe cyclic conditions (7000 or more cycles over the expected life of the installation), or both.

S6. Carbon Equivalent

- **S6.1** The maximum carbon equivalent based on heat analysis shall be as shown in Table S6.1.
 - **S6.2** Determine the carbon equivalent (CE) as follows:

$$CE = C + Mn/6 + (Cr + Mo + V)/5 + (Ni + Cu)/15$$

S6.3 A lower maximum carbon equivalent may be agreed upon between the supplier and the purchaser.

TABLE S1.1.1 MAXIMUM SUPPLEMENTAL TEST TEMPERATURES

Grade	Maximum Test Temperature, °F (°C)									
LF1 LF2, Class 1 LF3, Classes 1 and 2 LF5, Classes 1 and 2 LF6, Classes 1 and 2 LF9 LF787, Class 2	-10 [-23] -35 [-37] -125 [-87] -60 [-51] -40 [-40] -80 [-62] -60 [-51]									
LF787, Class 3	-80 [-62]									
LF2, Class 2 LF6, Class 3	+10 [-12] +10 [-12]									

TABLE S6.1 MAXIMUM CARBON EQUIVALENT VALUE

Max. Thickness Less Than or Equal to 2 in.	Max. Thickness Greater Than 2 in.
0.45	0.46
0.47	0.48
0.45	0.46
0.47	0.48
	7 Than or Equal to 2 in. 0.45 0.47 0.45

SPECIFICATION FOR CASTINGS, AUSTENITIC, FOR PRESSURE-CONTAINING PARTS



SA-351/SA-351M



(23)

(Identical with ASTM Specification A351/A351M-18 $^{\epsilon 1}$.)

Specification for Castings, Austenitic, for Pressure-Containing Parts

1. Scope

1.1 This specification covers austenitic steel castings for valves, flanges, fittings, and other pressure-containing parts (Note 1).

Note 1—Carbon steel castings for pressure-containing parts are covered by Specification A216/A216M, low-alloy steel castings by Specification A217/A217M, and duplex stainless steel castings by Specification A995/A995M.

- 1.2 A number of grades of austenitic steel castings are included in this specification. Since these grades possess varying degrees of suitability for service at high temperatures or in corrosive environments, it is the responsibility of the purchaser to determine which grade shall be furnished. Selection will depend on design and service conditions, mechanical properties, and high-temperature or corrosion-resistant characteristics, or both.
- 1.2.1 Because of thermal instability, Grades CE20N, CF3A, CF3MA, and CF8A are not recommended for service at temperatures above 800 °F [425 °C].
- 1.3 Supplementary requirements of an optional nature are provided for use at the option of the purchaser. The Supplementary requirements shall apply only when specified individually by the purchaser in the purchase order or contract.
- 1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

- 1.4.1 This specification is expressed in both inch-pound units and in SI units; however, unless the purchase order or contract specifies the applicable M-specification designation (SI units), the inch-pound units shall apply. Within the text, the SI units are shown in brackets or parentheses.
- 1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A216/A216M Specification for Steel Castings, Carbon, Suitable for Fusion Welding, for High-Temperature Service
- A217/A217M Specification for Steel Castings, Martensitic Stainless and Alloy, for Pressure-Containing Parts, Suitable for High-Temperature Service
- A488/A488M Practice for Steel Castings, Welding, Qualifications of Procedures and Personnel
- A703/A703M Specification for Steel Castings, General Requirements, for Pressure-Containing Parts
- A985/A985M Specification for Steel Investment Castings General Requirements, for Pressure-Containing Parts
- A995/A995M Specification for Castings, Austenitic-Ferritic (Duplex) Stainless Steel, for Pressure-Containing Parts
- 2.2 Manufacturers Standardization Society of the Valve and Fittings Industry Standard:
 - SP-55 Quality Standard for Steel Castings for Valves, Flanges, and Fittings and Other Components (Visual Method)

3. General Conditions for Delivery

- 3.1 Other Than Investment Castings—Material furnished to this specification shall conform to the requirements of Specification A703/A703M, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A703/A703M constitutes nonconformance with this specification. In case of conflict between the requirements of this specification and Specification A703/A703M, this specification shall prevail.
- 3.2 Investment Castings—Material furnished to this specification shall conform to the requirements of Specification A985/A985M, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A985/A985M constitutes nonconformance with this specification. In case of conflict between the requirements of this specification and Specification A985/A985M, Specification A985/A985M shall prevail.
- 3.3 The post-weld heat treatment requirements of Supplementary Requirement S50 may be specified when austenitic castings other than HK, HT, or CT15C are to be subjected to severe corrosive service.

4. Ordering Information

- 4.1 The inquiry and order should include or indicate the following:
- 4.1.1 A description of the casting by pattern number or drawing (dimensional tolerances shall be included on the casting drawing),
 - 4.1.2 Grade of steel,
 - 4.1.3 Options in the specification, and
- 4.1.4 Supplementary requirements desired, including the standards of acceptance.

5. Process

5.1 The steel shall be made by the electric furnace process with or without separate refining such as argon-oxygen decarburization (AOD).

6. Heat Treatment

6.1 All castings shall receive a heat treatment at the temperature specified in Table 1, followed by a quench in water or rapid cool by other means except as noted.

Note 2—Proper heat treatment of these alloys is usually necessary to enhance corrosion resistance and, in some cases, to meet mechanical properties. Minimum heat-treat temperatures are specified; however, it is sometimes necessary to heat treat at higher temperatures, hold for some minimum time at temperature, and then rapidly cool the castings in order to enhance the corrosion resistance and meet mechanical properties.

7. Chemical Composition

7.1 The steel shall conform to the requirements as to chemical composition prescribed in Table 2.

8. Tensile Properties

8.1 Steel used for the castings shall conform to the requirements as to tensile properties prescribed in Table 3.

TABLE 1 Heat-Treatment Requirements

Grade -	Temperature, min				
Grade	°F	°C			
HK30, HK40, HT30, CT15C, HG10MnN	as-cast	as-cast			
CF3, CF3A, CF8, CF8A, CF3M,	1900	1040			
CF3MA, CF8M, CF3MN, CG3M, CF10,					
CF10M, CG8M					
CF10SMnN, CF8C, CF10MC	1950	1065			
CN7M, CG6MMnN	2050	1120			
CH8, CH10, CH20, CK20	2100	1150			
CK3MCuN, CN3MN ^B	2200	1200			
CE20N ^A	2225	1220			

 $^{^{\}rm A}$ Grade shall be quenched in water or the castings may be furnace cooled to 2050 °F [1120 °C] minimum, held for 15 min minimum, and then quenched in water or rapidly cooled by other means.

9. Quality

- 9.1 The surface of the casting shall be examined visually and shall be free of adhering sand, scale, cracks, and hot tears. Other surface discontinuities shall meet the visual acceptance standards specified in the order. Visual Method SP-55 or other visual standards may be used to define acceptable surface discontinuities and finish. Unacceptable visual surface discontinuities shall be removed and their removal verified by visual examination of the resultant cavities.
- 9.2 When additional inspection is desired, Supplementary Requirements S5, S6, and S10 may be ordered.
- 9.3 The castings shall not be peened, plugged, or impregnated to stop leaks.

10. Repair by Welding

- 10.1 Repairs shall be made using procedures and welders qualified under Practice A488/A488M.
- 10.2 Weld repairs shall be inspected to the same quality standards that are used to inspect the castings. When castings are produced with Supplementary Requirement S5 specified, weld repairs on castings that have leaked on hydrostatic test, or on castings in which the depth of any cavity prepared for repair welding exceeds 20 % of the wall thickness or 1 in. [25 mm], whichever is smaller, or on castings in which any cavity prepared for welding is greater than approximately 10 in.² [65 cm²], shall be radiographed to the same standards that are used to inspect the castings. When castings are produced with Supplementary Requirement S6 specified, weld repairs shall be inspected by liquid penetrant examination to the same standards that are used to inspect the castings.
- 10.3 For Grade HG10MnN, the filler metal to be used shall be established by mutual agreement between the manufacturer and the purchaser.

Note 3—When austenitic steel castings are to be used in services where they will be subject to stress corrosion, the purchaser should so indicate in his order and such castings should be solution heat treated following all weld repairs.

11. Keywords

11.1 austenitic stainless steel; pressure containing parts; stainless steel; steel castings

^B Castings of these grades shall be held at the specified temperature for a minimum of 4 h.

TABLE 2 Chemical Requirements

Note 1—CE8MN and CD3MWCuN have been deleted from this specification and added to Specification A995/A995M as Grades 2A and 6A, respectively. CD4MCu has also been removed. Specification A995/A995M Grade 1B, CD4MCuN, is an acceptable substitute.

					Eleme	nt, % (max, except	where range is give	en)				
Material Grade	Carbon	Manganese	Silicon	Sulfur	Phosphorus	Chromium	Nickel	Molybdenum	Columbium (Niobium) ^D	Vanadium	Nitrogen	Copper
CE20N J92802	0.20	1.50	1.50	0.040	0.040	23.0–26.0	8.0–11.0	0.50			0.08-0.20	
CF3, CF3A J92700	0.03	1.50	2.00	0.040	0.040	17.0–21.0	8.0–12.0	0.50				
CF8, CF8A J92600	0.08	1.50	2.00	0.040	0.040	18.0–21.0	8.0-11.0	0.50				
CF3M, CF3MA J92800	0.03	1.50	1.50	0.040	0.040	17.0–21.0	9.0–13.0	2.0–3.0				
CF8M J92900	0.08	1.50	1.50	0.040	0.040	18.0–21.0	9.0–12.0	2.0–3.0				
CF3MN J92804	0.03	1.50	1.50	0.040	0.040	17.0–21.0	9.0–13.0	2.0–3.0			0.10-0.20	
CF8C J92710	0.08	1.50	2.00	0.040	0.040	18.0–21.0	9.0–12.0	0.50	Α			
CF10 J92950	0.04-0.10	1.50	2.00	0.040	0.040	18.0–21.0	8.0-11.0	0.50				
CF10M J92901	0.04-0.10	1.50	1.50	0.040	0.040	18.0–21.0	9.0–12.0	2.0-3.0				
CF10MC	0.10	1.50	1.50	0.040	0.040	15.0–18.0	13.0–16.0	1.75–2.25	В			
CF10SMnN J92972	0.10	7.00-9.00	3.50-4.50	0.030	0.060	16.0–18.0	8.0-9.0				0.08-0.18	
CG3M J92999	0.03	1.50	1.50	0.04	0.04	18.0–21.0	9.0–13.0	3.0-4.0				
CG6MMnN J93790	0.06	4.0-6.0	1.00	0.030	0.040	20.5–23.5	11.5–13.5	1.50-3.00	0.10-0.30	0.10-0.30	0.20-0.40	
CG8M J93000	0.08	1.50	1.50	0.04	0.04	18.0–21.0	9.0–13.0	3.0–4.0				
CH8 J93400	0.08	1.50	1.50	0.040	0.040	22.0–26.0	12.0–15.0	0.50				
CH10 J93401	0.04-0.10	1.50	2.00	0.040	0.040	22.0–26.0	12.0–15.0	0.50				
CH20 J93402	0.04-0.20	1.50	2.00	0.040	0.040	22.0–26.0	12.0–15.0	0.50				

TABLE 2 Continued

					Eleme	nt, % (max, except	where range is give	en)				
Material Grade	Carbon	Manganese	Silicon	Sulfur	Phosphorus	Chromium	Nickel	Molybdenum	Columbium (Niobium) ^D	Vanadium	Nitrogen	Copper
CK20 J94202	0.04-0.20	1.50	1.75	0.040	0.040	23.0–27.0	19.0–22.0	0.50				•••
CK3MCuN J93254	0.025	1.20	1.00	0.010	0.045	19.5–20.5	17.5–19.5	6.0–7.0			0.18-0.24	0.50-1.00
CN3MN J94651	0.03	2.00	1.00	0.010	0.040	20.0–22.0	23.5–25.5	6.0–7.0			0.18-0.26	0.75
CN7M N08007	0.07	1.50	1.50	0.040	0.040	19.0–22.0	27.5–30.5	2.0-3.0				3.0-4.0
CT15C N08151	0.05-0.15	0.15-1.50	0.50-1.50	0.03	0.03	19.0–21.0	31.0–34.0		0.50-1.50			
HG10MnN J92604	0.07–0.11	3.0-5.0	0.70	0.030	0.040	18.5–20.5	11.5–13.5	0.25-0.45	С		0.20-0.30	0.50
HK30 J94203	0.25-0.35	1.50	1.75	0.040	0.040	23.0–27.0	19.0–22.0	0.50				•••
HK40 J94204	0.35-0.45	1.50	1.75	0.040	0.040	23.0–27.0	19.0–22.0	0.50				
HT30 N08030	0.25-0.35	2.00	2.50	0.040	0.040	13.0–17.0	33.0–37.0	0.50				

^A Grade CF8C shall have a columbium (niobium) content of not less than 8 times the carbon content but not over 1.00 %.

^B Grade CF10MC shall have a columbium (niobium) content of not less than 10 times the carbon content but not over 1.20 %.

 $^{^{\}it C}$ Grade HG10MnN shall have a columbium (niobium) content of not less than 8 times the carbon, but not over 1.00 %.

^D Columbium (Cb) and niobium (Nb) are alternate names for Element 41.

TABLE 3 Tensile Requirements

	IADEL 0 10	nsile nequireme	1113
Material Grade	Tensile strength, min, ksi [MPa]	Yield strength, ^A min, ksi [MPa]	Elongation in 2 in. or 50 mm, ^B min, %
CE20N J92802	80 [550]	40 [275]	30
J92002	[550]	[275]	
CF3	70	30	35
J92700	[485]	[205]	
CF3A	77	35	35
J92700	[530]	[240]	
CF8	70	30	35
J92600	[485]	[205]	
CF8A	77	35	35
J92600	[530]	[240]	
CF3M	70	30	30
J92800	[485]	[205]	30
CF3MA J92800	80 [550]	37 [255]	30
332000	[550]	[233]	
CF8M	70	30	30
J92900	[485]	[205]	
CF3MN	75	37	35
J92804	[515]	[255]	
CF8C	70	30	30
J92710	[485]	[205]	00
0=10		-	
CF10 J92950	70 [485]	30 [205]	35
092930	[400]	[203]	
CF10M	70	30	30
J92901	[485]	[205]	
CF10MC	70	30	20
	[485]	[205]	
CF10SMnN	85	42.5	30
J92972	[585]	[295]	30
CG3M J92999	75 [515]	35 [240]	25
032333	[515]	[240]	
CG6MMnN	85	42.5	30
J93790	[585]	[295]	
CG8M	75	35	25
J93000	[515]	[240]	
CH8	65	28	30
J93400	[450]	[195]	00
01140	70	00	00
CH10 J93401	70 [485]	30 [205]	30
000.0.	[.00]	[200]	
CH20	70	30	30
J93402	[485]	[205]	
CK20	65	28	30
J94202	[450]	[195]	
CK3MCuN	80	38	35
J93254	[550]	[260]	
CNIONANI	90	00	0.5
CN3MN J94651	80 [550]	38 [260]	35
CN7M	62	25	35
N08007	[425]	[170]	
CT15C	63	25	20
N08151	[435]	[170]	

TABLE 3 Continued

Material Grade	Tensile strength, min, ksi [MPa]	Yield strength, ^A min, ksi [MPa]	Elongation in 2 in. or 50 mm, ^B min, %
HG10MnN	76	33	20
J92604	[525]	[225]	
HK30	65	35	10
J94203	[450]	[240]	
HK40	62	35	10
J94204	[425]	[240]	
HT30	65	28	15
N08030	[450]	[195]	
_			

^A Determine by the 0.2 % offset method.

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall not apply unless specified in the purchase order. A list of standardized supplementary requirements for use at the option of the purchaser is included in Specifications A703/A703M and A985/A985M. Those which are ordinarily considered suitable for use with this specification are given below. Others enumerated in Specifications A703/A703M and A985/A985M may be used with this specification upon agreement between the manufacturer and purchaser.

- S2. Destruction Tests
- S5. Radiographic Inspection
- **S6.** Liquid Penetrant Inspection
- S10. Examination of Weld Preparation
- S33. Stabilization Heat Treatment of CF8C

S33.1 CF8C shall be stabilized at 1600 to 1650 °F [870 to 900 °C] for a minimum time of 1 h/in. [25 mm] of thickness and water quenched or rapidly cooled by other means. The grade designation symbol shall be followed by the symbol "S33."

S34. Stabilization Heat Treatment of CF10MC

S34.1 CF10MC shall be stabilized at 1600 to 1650 °F [870 to 900 °C] for a minimum time of 1 h/in. [25 mm] of thickness and water quenched or rapidly cooled by other means. The grade designation symbol shall be followed by the symbol "S34."

S50. Post-Weld Heat Treatment

S50.1 All austenitic castings, except Grades HK, HT, and CT15C, which have been subjected to weld repairs, shall be given a post-weld solution heat treatment.

S50.2 The post-weld treatment for grades CK3MCuN and CN3MN shall be as specified in Table 3, except that the minimum soak time for castings that have already been heat treated according to Table 3 may be 1 h.

^B When ICI test bars are used in tensile testing as provided for in Specification A985/A985M, the gauge length to reduced section diameter ratio shall be 4 to 1.



SPECIFICATION FOR STEEL CASTINGS, FERRITIC AND MARTENSITIC, FOR PRESSURE-CONTAINING PARTS, SUITABLE FOR LOW-TEMPERATURE SERVICE



SA-352/SA-352M



(Identical with ASTM Specification A352/A352M-06(2012).)

Standard Specification for Steel Castings, Ferritic and Martensitic, for Pressure-Containing Parts, Suitable for Low-Temperature Service

1. Scope

- 1.1 This specification covers steel castings for valves, flanges, fittings, and other pressure-containing parts intended primarily for low-temperature service.
- 1.2 Several grades of ferritic steels and one grade of martensitic steel are covered. Selection of analysis will depend on design and service conditions (Note). The temperature shown is the lowest temperature at which the material ordinarily is required to meet the impact requirements of this specification (see Supplementary Requirement S22, Impact Test Temperatures). Users should note that hardenability of some of the grades mentioned may restrict the maximum size at which the required mechanical properties are obtainable (see Appendix X1).

Grade	Usual Minimum Testing
	Temperatures, °F [°C]
LCA	-25 [-32]
LCB	-50 [-46]
LCC	-50 [-46]
LC1	-75 [- 59]
LC2	-100 [-73]
LC2-1	-100 [-73]
LC3	-150 [-101]
LC4	-175 [- 115]
LC9	-320 [-196]
CA6NM	-100 [-73]

Note 1—This specification covers the low-temperature requirements particularly pertinent for ferritic and martensitic steels. Certain of the grades of austenitic steel castings furnished in accordance with Specification A351/A351M have been found suitable for low-temperature service down to $-300^\circ F$ [$-184^\circ C$] and others down to $-425^\circ F$ [$-254^\circ C$]. These grades may be used when impact tested in accordance with Specification A352/A352M with energy levels and temperatures of test mutually agreed upon between the purchaser and the manufacturer. As a guide to the selection of energy levels and testing temperatures, Appendix X1 should be consulted.

1.3 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification. Inch-pound units are applicable for material ordered to Specification A352 and SI units for material ordered to Specification A352M.

2. Referenced Documents

- 2.1 ASTM Standards:
- A351/A351M Specification for Castings, Austenitic, for Pressure-Containing Parts
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A488/A488M Practice for Steel Castings, Welding, Qualifications of Procedures and Personnel
- A703/A703M Specification for Steel Castings, General Requirements, for Pressure-Containing Parts
- E165 Practice for Liquid Penetrant Examination for General Industry
- E709 Guide for Magnetic Particle Testing
- 2.2 Manufacturers' Standardization Society of the Valve and Fittings Industry Standard:
 - SP-55 Quality Standard for Steel Castings for Valves, Flanges, and Fittings and Other Piping Components (Visual Method)

3. General Conditions for Delivery

3.1 Material furnished to this specification shall conform to the requirements of Specification A703/A703M including any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A703/A703M constitutes nonconformance with

this specification. In case of conflict between the requirements of this specification and Specification A703/A703M, this specification shall prevail.

4. Ordering Information

- 4.1 The inquiry and order should include or indicate the following:
- 4.1.1 A description of the casting by pattern number or drawing (dimensional tolerances shall be included on the casting drawing),
 - 4.1.2 Grade of steel,
 - 4.1.3 Options in the specification, and
- 4.1.4 The supplementary requirements desired, including the standards of acceptance.

5. Heat Treatment

- 5.1 All castings shall receive a heat treatment proper to their design and chemical composition. It should be recognized that liquid quenching of the ferritic grades is normally required to meet the mechanical properties of heavier sections and will greatly enhance the low-temperature properties of thinner sections.
- 5.2 Ferritic castings shall be furnished in the normalized and tempered or liquid-quenched and tempered condition, except for Grade LC9, which shall be liquid-quenched and tempered. Castings shall be tempered at a minimum of 1100°F [590°C], except Grade LC4, which shall be 1050°F [565°C], and Grade LC9, which shall be tempered in the range of 1050 to 1175°F [565 to 635°C], followed by cooling in air or liquid.
- 5.3 CA6NM castings shall be heat-treated by heating to 1850°F [1010°C] minimum, and air cooling to 200°F [95°C] maximum before any optional intermediate temper, but shall cool to 100°F [40°C] maximum before the final temper, which shall be between 1050 and 1150°F [565 and 620°C].
- 5.4 Castings shall be allowed to cool below the transformation range directly after pouring and solidification before they are reheated for normalizing or liquid quenching.
- 5.5 *Temperature Control*—Furnace temperature for heat treating shall be controlled by use of pyrometers.

6. Chemical Composition

6.1 The steel shall conform to the requirements as to chemical composition for the grade ordered as specified in Table 1.

7. Mechanical Requirements

- 7.1 Tension Test:
- 7.1.1 Tensile properties of steel used for the castings shall conform to the requirements specified in Table 1.
 - 7.2 Impact Test:
- 7.2.1 The notched bar impact properties of the material shall be determined by testing a set of three Charpy V-notch impact specimens for each heat at one of the standard test temperatures shown in Table 1, depending on the intended service temperature (see Appendix X1). The average energy value of the three specimens shall not be less than specified, with not more than

- one value permitted below the average minimum specified and no value permitted below the minimum specified for a single specimen.
- 7.2.2 The notched bar impact test shall be made in accordance with Test Methods and Definitions A370.
- 7.2.3 Impact test specimens shall be machined to the form and dimensions shown in Test Methods and Definitions A370, Fig. 11.

8. Quality

- 8.1 The surface of the casting shall be examined visually and shall be free of adhering sand, scale, cracks, and hot tears. Other surface discontinuities shall meet the visual acceptance standards specified in the order. Visual Method SP-55 or other visual standards may be used to define acceptable surface discontinuities and finish. Unacceptable visual surface discontinuities shall be removed and their removal verified by visual examination of the resultant cavities. When methods involving high temperature are used in the removal of discontinuities, castings shall be preheated to at least the minimum temperatures in Table 2.
- 8.2 When additional inspection is desired, Supplementary Requirements S4, S5, and S10, may be ordered.
- 8.3 The castings shall not be peened, plugged, or impregnated to stop leaks.

9. Repair by Welding

- 9.1 Repairs shall be made using procedures and welders in accordance with Practice A488/A488M.
- 9.2 Welding of Grade LC9 shall be accomplished using nonmagnetic filler material of AWS classification ENiCrFe-2, and shall require liquid penetrant inspection of the weld (Supplementary Requirement S6) when magnetic particle inspection (Supplementary Requirement S4) is specified for the casting.
- 9.3 Weld repairs shall be inspected to the same quality standards that are used to inspect the castings. When castings are produced with Supplementary Requirement S4 specified, weld repairs shall be inspected by magnetic particle examination to the same standards that are used to inspect the castings. When castings are produced with Supplementary Requirement S5 specified, weld repairs on castings that have leaked on hydrostatic tests, or on castings in which the depth of any cavity prepared for repair welding exceeds 20 % of the wall thickness or 1 in. [25 mm] whichever is smaller, or on castings in which any cavity prepared for welding is greater than approximately 10 in.² [65 cm ²shall be radiographed to the same standards that are used to inspect the castings.
- 9.4 Castings containing any repair weld that exceeds 20 % of the wall thickness, or 1 in. [25 mm], whichever is smaller, or that exceeds approximately 10 in.² [65 cm²] in area, or that was made to correct hydrostatic test defects shall be stress relieved or heat treated after welding. This mandatory stress relief or heat treatment shall be in accordance with the procedure qualification used. When stress relief is required for Grade LC9, cooling shall be in still air.

TABLE 1 Chemical, Tensile, and Impact Requirements

			DEE 1 OHOII	ioui, iciione,	una impaot					
Туре	Carbon Steel	Carbon Steel	Carbon- Manganese Steel	Carbon- Molybdenum Steel	2½ % Nickel Steel	Nickel- Chromium- Molybdenum Steel	3½ % Nickel Steel	4½ % Nickel Steel	9 % Nickel Steel	12½ % Chromium, Nickel- Molybdenum Steel
Grade	LCA	LCB ^A	LCC	LC1	LC2	LC2-1	LC3	LC4	LC9	CA6NM
UNS Number	J02504	J03003	J02505	J12522	J22500	J42215	J31550	J41500	J31300	J91540
Element, % (max, except where range is given)										
Carbon	0.25 ^A	0.30	0.25 ^A	0.25	0.25	0.22	0.15	0.15	0.13	0.06
Silicon	0.60	0.60	0.60	0.60	0.60	0.50	0.60	0.60	0.45	1.00
Manganese	0.70 ^A	1.00	1.20 ^A	0.50-0.80	0.50-0.80	0.55-0.75	0.50-0.80	0.50-0.80	0.90	1.00
Phosphorus	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.04
Sulfur	0.045	0.045	0.045	0.045	0.045	0.045	0.045	0.045	0.045	0.03
Nickel	0.50 ^B	0.50 ^B	0.50 ^B		2.00-3.00	2.50-3.50	3.00-4.00	4.00-5.00	8.50-10.0	3.5-4.5
Chromium	0.50 ^B	0.50 ^B	0.50 ^B			1.35-1.85			0.50	11.5-14.0
Molybdenum	0.20	0.20 ^B	0.20 ^B	0.45-0.65		0.30-0.60			0.20	0. 4-1.0
Copper	0.30	0.30 ^B	0.30 ^B						0.30	
Vanadium	0.03 ^B	0.03 ^B	0.03 ^B						0.03	
Tensile										
Requirements:C										
Tensile strength,	60.0-85.0	65.0-90.0	70.0-95.0	65.0-90.0	70.0-95.0	105.0-130.0	70.0-95.0	70.0-95.0	85.0	110.0-135.0
ksi [MPa]	[415-585]	[450-620]	[485-655]	[450-620]	[485-655]	[725-895]	[485-655]	[485-655]	[585]	[760-930]
Yield strength, ^D min, ksi [MPa]	30.0 [205]	35.0 [240]	40.0 [275]	35.0 [240]	40.0 [275]	80.0 [550]	40.0 [275]	40.0 [275]	75.0 [515]	80.0 [550]
Elongation in 2 in.	24	24	22	24	24	18	24	24	20	15
or 50 mm,										
min, % ^E										
Reduction of area,	35	35	35	35	35	30	35	35	30	35
min, %										
Impact Requirements Charpy V- Notch ^{C,F} Energy value, ft-lbf [J], min value for	13 [18]	13 [18]	15 [20]	13 [18]	15 [20]	30 [41]	15 [20]	15 [20]	20 [27]	20 [27]
two specimens and min avg of three specimens Energy value, ft-lbf [J], min for single specimen	10 [14]	10 [14]	12 [16]	10 [14]	12 [16]	25 [34]	12 [16]	12 [16]	15 [20]	15 [20]
Testing temperature, °F [°C]	-25 [-32]	-50 [-46]	-50 [-46]	-75 <u>[</u> -59]	-100 [-73]	-100 [-73]	–150 [–101]	–175 [–115]	-320 [-196]	-100 [-73]

^A For each reduction of 0.01 % below the specified maximum carbon content, an increase of 0.04 % manganese above the specified maximum will be permitted up to a maximum of 1.10 % for LCA, 1.28 % for LCB, and 1.40 % for LCC.

^B Specified Residual Elements—The total content of these elements is 1.00 % maximum.

^C See1.2.

TABLE 2 Minimum Preheat Temperatures

Grade	Thickness, in. [mm]	Minimum Preheat Temperature, °F [°C]						
LCA	all	50 [10]						
LCB	all	50 [10]						
LCC	all	50 [10]						
LC1	over 5/8 [15.9]	250 [120]						
	5/8 and under	50 [10]						
LC2	all	300 [150]						
LC2-1	all	300 [150]						
LC3	all	300 [150]						
LC4	all	300 [150]						
CA6NM	all	50 [10]						

10. Product Marking

10.1 All marking shall be on a raised pad using low-stress stamps.

10.2 In addition to the marking required by Specification A703/A703M, castings that have been liquid quenched and tempered shall be marked with the letters "QT".

 $^{^{\}it D}$ Determine by either 0.2 % offset method or 0.5 % extension-under-load method.

E When ICI test bars are used in tensile testing as provided for in Specification A703/A703M, the gage length to reduced section diameter ratio shall be 4 to 1.

^F See Appendix X1.

11. Keywords

11.1 alloy steel; carbon steel; ferritic steel; low temperature applications; martensitic stainless steel; pressure containing parts; stainless steel; steel castings

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirements shall not apply unless specified in the purchase order. A list of standardized supplementary requirements for use at the option of the purchaser is included in Specification A703/A703M. Those which are ordinarily considered suitable for use with this specification are given below together with additional supplementary requirements that are applicable only to this specification. Other supplementary requirements enumerated in A703/A703M may be used with this specification upon agreement between the manufacturer and purchaser.

- S1. Unspecified Elements
- **S2.** Destruction Tests
- **S4.** Magnetic Particle Inspection
- S5. Radiographic Inspection
- S9. Drop Weight Tests
- S10. Examination of Weld Preparation

S10.1 The method of performing the magnetic particle or liquid penetrant test shall be in accordance with Practice E709 or Practice E165.

S21. Heat Treatment

S21.1 Castings shall be liquid quenched and tempered.

S22. Impact Test Temperatures

S22.1 When an impact test temperature other than that listed in Table 1 is used, the lowest test temperature at which the material met the impact test requirements shall be stamped with low-stress stamps on a raised pad located immediately ahead of the material symbol; for example, 25 LCB for +25°F [-4°C] and 025 LCB for -25°F [-32°C].

S22.2 Lateral expansion of V-notch specimens shall be measured in accordance with 23.2.3.1 of Test Methods and Definitions A370, and reported for information.

S23. Carbon Equivalent

S23.1 When specified on the order the maximum carbon equivalent shall be:

Grade	Carbon Equivalent, max
LCA	0.50
LCB	0.50
LCC	0.55

S23.2 Determine carbon equivalent, CE, as follows:

$$CE = C + \frac{Mn}{6} + \frac{Cr + Mo + V}{5} + \frac{Ni + Cu}{15}$$

APPENDIX

(Nonmandatory Information)

X1. EXPLANATION OF THE USE OF NOTCHED BAR IMPACT TESTS IN DETERMINING THE ACCEPTABILITY OF STEELS FOR LOW-TEMPERATURE SERVICE

X1.1 Years of experience and test work have shown that some materials, particularly ferritic steels, change from tough to brittle behavior with a decrease in temperature. The transition temperatures and the levels of notch toughness vary with different materials, depending on many factors. When materials are used under conditions where brittle behavior may occur, there is danger that flaws, which would be considered nonhazardous if the material were tough, may propagate to disastrous failure of the equipment.

X1.2 Accordingly, many varieties of tests have been developed in an effort to evaluate the toughness of materials and the conditions under which they will transform from tough to brittle behavior. There are many opinions and shadings of

opinion as to which test is most suitable for evaluating the suitability of materials for service at low temperatures; however, as yet, only the Charpy impact test has received sufficient general acceptance and has been used as a basis for purchasing for sufficient time to be included in ASTM standards. Furthermore, this test is required for low-temperature service vessels and piping constructed in accordance with ASME Code for Unfired Pressure Vessels and the American National Standard Code for Pressure Piping (ANSI B31), respectively. These ASTM specifications for materials for low-temperature service are primarily used in piping and pressure vessel construction that are subjected to temperatures lower than ambient; consequently, the notched bar impact test requirements are written to provide material that in quality and by its testing can be

validated for use under the construction codes.

X1.3 No assurance is offered that compliance with these requirements will provide a material that will resist brittle failure under all possible conditions of service to as low as the specified impact test temperature. It may eventually be possible that other types of tests will provide greater assurance of material suitability for low-temperature services, but at this time there is insufficient knowledge for agreement and general acceptance of some test other than the Charpy impact test.

X1.4 Attention is directed to the following subjects which have a bearing on the value of Charpy impact tests:

X1.4.1 Much of the original work in the field of notch toughness was done on wrought materials that had definite directional grain flow parallel to the axis of the bar, and the specimens were taken with the longitudinal axis of the specimen parallel to the axis of the bar. It has been well established that the results from impact testing of the same piece of steel may vary considerably, depending upon the orientation of the specimen to the direction of grain flow. Although it is known that specimens taken with their axis transverse to the direction of grain flow will have lower values depending on the amount of cross rolling or forging the material has received, there were insufficient test data to permit specific mandatory requirements on the impact properties of wrought materials determined in any direction other than parallel to the direction of grain flow. Except in special cases this limitation still exists.

X1.4.2 It is acknowledged that notched bar impact tests are of a qualitative rather than a quantitative nature. As yet, except possibly for ship steel, no satisfactory correlation has been possible between tests on small standardization specimens and the behavior of a structural part under any given conditions of

loading in service. The required values as determined by the Charpy V-notch impact test are arbitrary values which can be met by carbon and low-alloy constructional steels when tested at temperatures above that where their behavior changes from tough to brittle as judged by this test. The acceptability of this dividing line seems to be justified by service experience on carbon and certain low-alloy steels.

X1.4.3 The literature shows that notched bar impact strengths in constructional steels differ widely in accordance with many variables. Consequently, there is bound to be some discrepancy between an individual test bar and the entire part that it represents. No system of test bar selection can guarantee that every sample would meet minimum requirements. Test bar selection must be a compromise to generally represent the product.

X1.4.4 The committees responsible for these material specifications have had as an objective the selection of test specimens that will represent the properties of the materials, in the form in which they will be used. However, accomplishment of this objective has only partially been realized. At this time it is impossible to select samples for testing that will represent all parts and sizes of the product involved. Particularly in ferritic steels, it is impractical to remove the test bars from heavy sections over about 4 in. [100 mm] and expect them to show results as high as tests from light sections of the same material. The practical commercial limits on the amount of testing possible, as well as limits to knowledge of what results may be expected from testing in non-standard locations, have been considered in drafting these specifications. With time and increased knowledge, it may be possible to require more representative testing.

SPECIFICATION FOR PRESSURE VESSEL PLATES, ALLOY STEEL, DOUBLE-NORMALIZED AND TEMPERED 9% NICKEL



SA-353/SA-353M



(Identical with ASTM Specification A353/A353M-17.)

Standard Specification for Pressure Vessel Plates, Alloy Steel, Double-Normalized and Tempered 9 % Nickel

ASME BPVC.II.A-2023

1. Scope

- 1.1 This specification covers double-normalized and tempered 9 % nickel steel plates intended particularly for welded pressure vessels for cryogenic service.
- 1.2 Plates produced under this specification are subject to impact testing at $-320^{\circ}F$ [-195°C] or at such other temperatures as are agreed upon.
- 1.3 The maximum thickness of plates is limited only by the capacity of the material to meet the specific mechanical property requirements.
- 1.4 This material is susceptible to magnetization. Use of magnets in handling after heat treatment should be avoided if residual magnetism would be detrimental to subsequent fabrication or service.
- 1.5 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system must be used independently of the other. Combining values from the two systems may result in nonconformance with the specification.
- 1.6 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

- A20/A20M Specification for General Requirements for Steel Plates for Pressure Vessels
- A435/A435M Specification for Straight-Beam Ultrasonic Examination of Steel Plates
- A577/A577M Specification for Ultrasonic Angle-Beam Examination of Steel Plates
- A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applications

3. General Requirements and Ordering Information

- 3.1 Material supplied to this material specification shall conform to Specification A20/A20M. These requirements outline the testing and retesting methods and procedures, permitted variations in dimensions, and mass, quality and repair of defects, marking, loading, and ordering information.
- 3.2 In addition to the basic requirements of this specification, certain supplementary requirements are available when additional control, testing, or examination is required to meet end use requirements. The purchaser is referred to the listed supplementary requirements in this specification and to the detailed requirements in Specification A20/A20M.
- 3.3 If the requirements of this specification are in conflict with the requirements of Specification A20/A20M, the requirements of this specification shall prevail.

4. Manufacture

4.1 Steelmaking Practice—The steel shall be killed and shall conform to the fine austenitic grain size requirement of Specification A20/A20M.

5. Heat Treatment

5.1 All plates shall be heat treated in accordance with 5.2. Shell plates and other parts, including heads and reinforcing

TABLE 1 Chemical Requirements

Element	Composition, %
Carbon, max ^A	0.13
Manganese, max	
Heat analysis	0.90
Product analysis	0.98
Phosphorus, max ^A	0.015
Sulfur, max ^A	0.015
Silicon:	
Heat analysis	0.15-0.40 ^B
Product analysis	0.13-0.45 ^B
Nickel:	
Heat analysis	8.50-9.50
Product analysis	8.40-9.60

^A Applies to both heat and product analyses.

TABLE 2 Tensile Requirements

Tensile strength, ksi [MPa]	100-120 [690-825]
Yield strength (0.2 % offset), min, ksi [MPa] ^A	75 [515]
Elongation in 2 in. [50 mm], min, % ^B	20.0

^A See 7.1.1.

pads that are heated for forming shall be heat treated after forming in accordance with 5.2.

5.2 Heat Treatment Procedure:

- 5.2.1 First Normalizing Treatment—Heat the plate to a uniform temperature of $1650 \pm 25^{\circ}F$ [900 $\pm 15^{\circ}C$], hold at that temperature for a minimum of 1 h/in. [2.4 min/mm] of thickness, but in no case less than 15 min, and cool in air.
- 5.2.2 Second Normalizing Treatment—Reheat the plate to a uniform temperature of $1450 \pm 25^{\circ}F$ [790 $\pm 15^{\circ}C$], hold at that temperature for a minimum of 1 h/in. [2.4 min/mm] of thickness, but in no case less than 15 min, and cool in air.
- 5.2.3 Tempering Treatment—Reheat the plate to a uniform temperature within the range from 1050 to 1125°F [565 to 605°C], hold within that temperature range for a minimum of 1 h/in. [2.4 min/mm] of thickness, but in no case less than 15 min, and cool in air or water quench at a rate not less than 300°F/h [165°C/h].
- 5.2.4 If hot forming is performed after heating to a temperature within the range from 1650 to 1750°F [900 to 955°C] the first normalizing treatment (5.2.1) may be omitted.
- 5.2.5 When the plates are heat treated by the fabricator, it shall be the fabricator's responsibility to apply the proper heat

treatment and to conduct tests it deems necessary to ensure that the specified properties are attained.

6. Chemical Requirements

6.1 The steel shall conform to the chemical composition requirements shown in Table 1 unless otherwise modified in accordance with Supplementary Requirement S17, Vacuum Carbon-Deoxidized Steel, in Specification A20/A20M.

7. Mechanical Requirements

- 7.1 *Tension Test Requirements*—The material as represented by the tension-test specimens shall conform to the requirements specified in Table 2.
- 7.1.1 Upon agreement between the purchaser and the manufacturer, yield strength may be determined by the extension under load method, using 0.005 in./in. [0.005 mm/mm] total extension.
- 7.1.2 For nominal plate thicknesses of $\frac{3}{4}$ in. [20 mm] and under, the $\frac{1}{2}$ -in. [40-mm] wide rectangular specimen may be used for the tension test and the elongation may be determined in a 2-in. [50-mm] gage length that includes the fracture and shows the greatest elongation.
- 7.1.3 One tension test shall be taken from each plate as heat treated.
 - 7.2 Impact Test Requirements:
- 7.2.1 Charpy V-notch impact tests shall be made in accordance with Specification A20/A20M.
- 7.2.2 The longitudinal axis of the test specimens shall be transverse to the final rolling direction of the plate.
- 7.2.3 Unless otherwise agreed, tests shall be conducted at -320° F [-195° C].
- 7.2.4 Each test specimen shall have a lateral expansion opposite the notch of not less than 0.015 in. [0.381 mm].

8. Finish

8.1 Because retained scale may mask surface imperfections, as well as mar the plate surface, plates shall be descaled by the producer after heat treatment. In the case of material to be heat-treated by the purchaser, the plates shall be descaled by the producer prior to shipment.

9. Keywords

9.1 alloy steel; alloy steel plate; pressure containing parts; pressure vessel steels; steel plates; steel plates for pressure vessel applications

 $^{^{\}it B}$ The specified minimum limit does not apply if the total aluminum content is 0.030 % or more, or provided that acid soluble aluminum is 0.025 % or more.

^B See Specification A20/A20M for elongation adjustment.

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified in the order.

A list of standardized supplementary requirements for use at the option of the purchaser are included in Specification A20/A20M. Several of those considered suitable for use with this specification are listed below by title. Other tests may be performed by agreement between the supplier and the purchaser.

- S1. Vacuum Treatment,
- S2. Product Analysis,
- S4.1 Additional Tension Test,
- S6. Drop Weight Test,
- S8. Ultrasonic Examination in Accordance with Specification A435/A435M,
- S11. Ultrasonic Examination in Accordance with Specification A577/A577M.
- S12. Ultrasonic Examination in Accordance with Specification A578/A578M, and
 - S17. Vacuum Carbon-Deoxidized Steel.

ADDITIONAL SUPPLEMENTARY REQUIREMENTS

Also listed below are additional optional Supplementary Requirements S55 and S56, which are suitable for this specification.

S55. Longitudinal Charpy Impact Energy Absorption Requirement

- S55.1 The longitudinal Charpy V-notch impact properties shall not be less than 25 ft·lbf [34 J] at the specified temperature.
- S55.2 Each impact-test value shall constitute the average value of three specimens, with not more than one value below the specified minimum value of 25 ft·lbf [34 J], but in no case below 20 ft·lbf [27 J] for full size specimens.

S56. Transverse Charpy Impact Energy Absorption Requirement

- S56.1 The transverse Charpy V-notch impact properties shall not be less than 20 ft·lbf [27 J] at the specified temperature.
- S56.2 Each impact-test value shall constitute the average value of three specimens, with not more than one value below the specified minimum value of 20 ft·lbf [27 J] but in no case below 15 ft·lbf [20 J] for full-size specimens.

SPECIFICATION FOR QUENCHED AND TEMPERED ALLOY STEEL BOLTS, STUDS, AND OTHER EXTERNALLY THREADED FASTENERS



SA-354

(Identical with ASTM Specification A354-11 except for the deletion of the term "private label distributor" in 15.1 and 15.3.5.)

Standard Specification for Quenched and Tempered Alloy Steel Bolts, Studs, and Other Externally Threaded Fasteners

1. Scope

1.1 This specification covers the chemical and mechanical requirements of quenched and tempered alloy steel bolts, studs, and other externally threaded fasteners 4 in. and under in diameter for application at normal atmospheric temperatures, where high strength is required and for limited application at elevated temperature (Note 1). Any alloy steel capable of meeting the minimum mechanical and chemical properties set forth in this specification may be used.

Note 1—For bolts, studs, or other externally threaded fasteners, to be used at elevated temperatures, refer to Specification A193/A193M.

1.2 Two levels of bolting strength are covered, designated Grades BC and BD. Selection will depend upon design and the stresses and service for which the product is to be used.

Note 2—Quenched and tempered alloy steel bolts for structural steel joints up through $1\frac{1}{2}$ in. in diameter are covered in Specification A490. Alloy steel bolts, studs, and other externally threaded fasteners (that is, heavy hex-structural bolts over $1\frac{1}{2}$ in., hex bolts, anchor bolts, and countersunk bolts) exhibiting similar mechanical properties to bolts conforming to Specification A490 shall be covered by Grade BD of this specification.

When bolts of Grade BD of this specification are considered for pretentioned applications in excess of 50 % of the bolt tensile strength, the additional requirements of head size, maximum tensile strength, nut size and strength, washer hardness, tests, and inspections contained in Specification A490 should be carefully considered.

1.3 Nuts are covered in Specification A563. Unless otherwise specified, the grade and style of nut for each grade of fastener shall be as follows:

Grade of Fastener and Surface Finish	Nut Grade and Style ^A
BC, plain (or with a coating of insufficient thickness to require over-tapped nuts)	C, heavy hex
BC, zinc-coated (or with a coating thickness re-	DH, heavy hex
quiring over-tapped nuts)	,,
BD, all finishes	DH, heavy hex

A Nuts of other grades and styles having specified proof load stresses (Specification A563, Table 3) greater than the specified grade and style of nut are suitable.

- 1.4 The values stated in inch-pound units are to be regarded as the standard.
- 1.5 Terms used in this specification are defined in Terminology F1789 unless otherwise defined herein.

2. Referenced Documents

- 2.1 ASTM Standards:
- A193/A193M Specification for Alloy-Steel and Stainless Steel Bolting for High Temperature or High Pressure Service and Other Special Purpose Applications
- A490 Specification for Structural Bolts, Alloy Steel, Heat Treated, 150 ksi Minimum Tensile Strength
- A563 Specification for Carbon and Alloy Steel Nuts
- A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- B695 Specification for Coatings of Zinc Mechanically Deposited on Iron and Steel
- D3951 Practice for Commercial Packaging
- F436 Specification for Hardened Steel Washers
- F606 Test Methods for Determining the Mechanical Properties of Externally and Internally Threaded Fasteners, Washers, Direct Tension Indicators, and Rivets
- F788/F788M Specification for Surface Discontinuities of Bolts, Screws, and Studs, Inch and Metric Series

- F1470 Practice for Fastener Sampling for Specified Mechanical Properties and Performance Inspection
- F1789 Terminology for F16 Mechanical Fasteners
- F2329 Specification for Zinc Coating, Hot-Dip, Requirements for Application to Carbon and Alloy Steel Bolts, Screws, Washers, Nuts, and Special Threaded Fasteners 2.2 ASME Standards:
- **B1.1 Unified Screw Threads**
- B18.2.1 Square and Hex Bolts and Screws, Inch Series B18.24 Part Identifying Number (PIN) Code System Standard for B18 Fastener Products

3. Ordering Information

- 3.1 Orders for bolts and studs (including nuts and accessories) under this specification shall include the following:
 - 3.1.1 ASTM designation and year of issue,
 - 3.1.2 Name of product (that is, bolt or stud),
 - 3.1.3 Grade (that is, BC or BD),
 - 3.1.4 Quantities (number of pieces by size, including nuts),
 - 3.1.5 Size and length,
- 3.1.6 Washers—Specify quantity and size (separate from bolts) (4.3),
- 3.1.7 Zinc Coating—When zinc-coated Grade BC fasteners are required, specify the zinc-coating process required, for example hot-dip, mechanically deposited, or no preference (see 4.4).
- 3.1.8 Other Finishes—Specify other protective finish, if required.
- 3.1.9 Specify if inspection at point of manufacture is required,
 - 3.1.10 Specify if Certification (Section 14) is required, and
- 3.1.11 Specify additional testing (Section 9) or special requirements.
- 3.1.12 For establishment of a part identifying system, see ASME B18.24.

4. Materials and Manufacture

- 4.1 The steel shall be made by the open-hearth, electric-furnace, or basic-oxygen process.
- 4.2 All fasteners shall be heat-treated. At the option of the manufacturer, heat treatment may be performed on the raw material, during the manufacturing operations, or after final machining. Heat treatment shall consist of quenching in a liquid medium (except Grade BD sizes $1\frac{1}{2}$ in. and smaller shall be quenched in oil) from above the transformation temperature and then temperating by reheating to a temperature of not less than $800^{\circ}F$ ($427^{\circ}C$) for Grade BC and for Grade BD.
- 4.3 When used, suitable hardened washers shall be quenched and tempered (non-carburized) in accordance with Specification F436.
 - 4.4 Zinc Coatings, Hot-Dip and Mechanically Deposited:
- 4.4.1 When zinc-coated fasteners are required, the purchaser shall specify the zinc coating process, for example, hot-dip, mechanically deposited, or no preference.

- 4.4.2 When "hot-dip" is specified, the fasteners shall be zinc coated by the hot-dip process in accordance with the requirements of Specification F2329.
- 4.4.3 When mechanically deposited is specified, the fasteners shall be zinc-coated by the mechanical-deposition process in accordance with the requirements of Class 55 of Specification B695.
- 4.4.4 When no preference is specified, the supplier may furnish either a hot-dip zinc coating in accordance with Specification F2329, or a mechanically deposited zinc coating in accordance with Specification B695, Class 55. Threaded components (bolts and nuts) shall be coated by the same zinc-coating process and the supplier's option is limited to one process per item with no mixed processes in a lot.
- Note 3—When the intended application requires that assembled tension exceeds 50 % of minimum bolt proof load, an anti-galling lubricant may be needed. Application of such a lubricant to nuts and a test of the lubricant efficiency are provided in Supplementary Requirement S1 of Specification A563 and should be specified when required.
- 4.5 Zinc-coated bolts and nuts shall be shipped in the same container unless specifically requested otherwise by the purchaser
- Note 4—Research conducted on bolts of similar material and manufacture indicates that hydrogen-stress cracking or stress cracking corrosion may occur on hot-dip galvanized Grade BD bolts.

5. Chemical Composition

- 5.1 All fasteners shall be made from alloy steel conforming to the chemical composition requirements in accordance with Table 1. The steel shall contain sufficient alloying elements to qualify it as an alloy steel.
- Note 5—Steel is considered to be alloy, by the American Iron and Steel Institute, when the maximum of the range given for the content of alloying elements exceeds one or more of the following limits: manganese, 1.65 %; silicon, 0.60 %; copper, 0.60 %; or in which a definite range or a definite minimum quantity of any of the following elements is specified or required within the limits of the recognized field of constructional alloy steels: aluminum, chromium up to 3.99 %, cobalt, columbium, molybdenum, nickel, titanium, tungsten, vanadium, zirconium, or any other alloying elements added to obtain a desired alloying effect.
- 5.2 Product analysis may be made by the purchaser from finished material representing each lot of fasteners. The chemical composition thus determined shall conform to the requirements given in Table 1. Choice of alloy steel composition necessary to ensure meeting the specified mechanical requirements shall be made by the manufacturer and shall be reported to the purchaser for information purposes only.
- 5.3 Application of heats of steel to which bismuth, selenium, tellurium, or lead has been intentionally added shall not be permitted.
- 5.4 Chemical analyses shall be performed in accordance with Test Methods, Practices, and Terminology A751.

6. Mechanical Properties

6.1 Fasteners shall not exceed the maximum hardness specified in Table 2. Fasteners less than three diameters in length and studs less than four diameters in length shall have hardness

TABLE 1 Chemical Requirements

	Alloy Steel	
Element	Heat Analysis, %	Product Analysis, %
Carbon:		
For sizes through 1½ in.	0.30 to 0.53	0.28 to 0.55
For sizes larger than 1½ in.	0.35 to 0.53	0.33 to 0.55
Manganese, min	0.60	0.57
Phosphorus, max	0.035	0.040
Sulfur, max Alloying Elements	0.040 A	0.045 A

	Alloy Steel with Boron Addition									
Element	Heat	Product								
	Analysis, %	Analysis, %								
Carbon										
For sizes through	0.30-0.48	0.28-0.50								
1 ½ in.										
For sizes larger than	0.35-0.53	0.35-0.55								
1 ½ in.										
Manganese, min	0.60	0.57								
Phosphorus, max	0.040	0.045								
Sulfur, max	0.040	0.045								
Boron	0.0005-0.003	0.0005-0.003								
Alloying Elements	A	Α								

^ASteel, as defined by the American Iron and Steel Institute, shall be considered to be alloy when the maximum of the range given for the content of alloying elements exceeds one or more of the following limits: Manganese, 1.65 %; silicon, 0.60 %; copper, 0.60 % or in which a definite range or a definite minimum quantity of any of the following elements is specified or required within the limits of the recognized field of constructional alloy steels: aluminum, chromium up to 3.99 %, cobalt, columbium, molybdenum, nickel, titanium, tungsten, vanadium, zirconium, or any other alloying elements added to obtain a desired alloying effect.

TABLE 2 Hardness Requirements for Full-Size Fasteners

			Hardness						
Size, in.	Grade	Bri	nell	Rockwell C					
		Minimum	Maximum	Minimum	Maximum				
1/4 to 21/2	BC	255	331	26	36				
Over 21/2	BC	235	311	22	33				
1/4 to 21/2	BD	311	363	33	39				
Over 2½	BD	293	363	31	39				

values not less than the minimum nor more than the maximum hardness limits required in Table 2, as hardness is the only requirement.

- 6.2 Fasteners 13% in. in diameter or less for Grade BC and 11/4 in. in diameter or less for Grade BD, other than those excepted in 6.1, shall be tested full size and shall conform to the tensile strength and either the proof load or the yield strength requirements in accordance with Table 3.
- 6.3 Fasteners larger than 1¾ in. in diameter for Grade BC and fasteners larger than 1¼ in. in diameter for Grade BD, other than those excepted in 6.1, shall preferably be tested full size and when so tested, shall conform to the tensile strength and either the proof load or yield strength requirements in accordance with Table 3. When equipment of sufficient capacity for full-size testing is not available, or when the length of the fastener makes full-size testing impractical, machined specimens shall be tested and shall conform to the requirements in accordance with Table 4. In the event that fasteners

are tested by both full-size and by the machined test specimen methods, the full-size test shall govern if a controversy between the two methods exists.

6.4 For fasteners on which both hardness and tension tests are performed, acceptance based on tensile requirements shall take precedence in the event that there is controversy over low readings of hardness tests.

7. Dimensions

- 7.1 *Bolts*—Unless otherwise specified, the bolts shall be Hex Head with dimensions conforming to the latest issue of ASME B18.2.1.
- 7.2 *Studs*—Studs shall have dimensions conforming to those specified by the purchaser.
 - 7.3 Threads:
- 7.3.1 Unless otherwise specified, threads shall be the Unified National Coarse Thread Series as specified in B1.1, and shall have Class 2 A tolerances.
- 7.3.2 When specified, threads shall be the Unified National Fine Thread Series, 8-Pitch Thread Series for sizes over 1 in. or 14-Pitch UNS on 1 in. size as specified in ANSI B1.1 and shall have Class 2A tolerances.
- 7.3.3 Unless otherwise specified, bolts and studs to be used with nuts or tapped holes that have been tapped oversize, in accordance with Specification A563, shall have Class 2A threads before hot dip or mechanically deposited zinc coating. After zinc coating, the maximum limit of pitch and major diameter may exceed the Class 2A limit by the following amount:

Diameter, in.	Oversize Limit, in. (mm) ^A
1/4	0.016
5/16, 3/8	0.017
⁷ / ₁₆ , ¹ / ₂	0.018
9/16 to 3/4, incl	0.020
7/8	0.022
1.0 to 11/4, incl	0.024
13/8, 11/2	0.027
3/4 to 4.0, incl	0.050

^A These values are the same as the overtapping required for zinc-coated nuts in Specification A563.

8. Workmanship

8.1 Surface discontinuity limits shall be in accordance with Specification F788/F788M.

9. Number of Tests

- 9.1 Testing Responsibility:
- 9.1.1 Each lot shall be tested by the manufacturer prior to shipment in accordance with the lot identification control quality assurance plan in 9.2 through 9.6.
- 9.1.2 When fasteners are furnished by a source other than the manufacturer, the responsible party as defined in 12.1 shall be responsible for ensuring that all tests have been performed and the fasteners comply with the requirements of this specification.
- 9.2 Purpose of Lot Inspection—The purpose of a lot inspection program is to ensure that each lot conforms to the requirements of this specification. For such a plan to be fully

SA-354

TABLE 3 Tensile Requirements for All Full-Size Fasteners—Inch-Pound Units

Bolt	Threads	Stress	·	Grade BC			Grade BD	
Size, in.	per inch	Area, ^A in. ²	Tensile Strength, min, lbf ^B	Proof Load, min, lbf ^C	Yield Strength (0.2 % offset), min, lbf ^D	Tensile Strength, min, lbf ^E	Proof Load, min, lbf ^F	Yield Strength (0.2 % offset), min, lbf ^G
1	2	3	4	5	6	7	8	9
1/4	20	0.0318	4 000	3 350	3 450	4 750	3 800	4 100
1/4	28	0.0364	4 550	3 820	3 950	5 450	4 350	4 700
5/16	18	0.0524	6 550	5 500	5 700	7 850	6 300	6 800
5/16	24	0.0580	7 250	6 090	6 300	8 700	6 950	7 500
3/8	16	0.0775	9 700	8 150	8 450	11 650	9 300	10 075
3/8	24	0.0878	11 000	9 220	9 550	13 200	10 500	11 400
7/16	14	0.1063	13 300	11 150	11 600	15 950	12 750	13 850
⁷ /16	20	0.1187	14 840	12 470	12 900	17 800	14 200	15 400
1/2	13	0.1419	17 750	14 900	15 450	21 300	17 050	18 500
1/2	20	0.1599	19 990	16 790	17 400	24 000	19 200	20 750
9/16	12	0.182	22 750	19 100	19 850	27 300	21 850	23 600
9/16	18	0.203	25 400	21 400	22 100	30 400	24 400	26 350
5/8	11	0.226	28 250	23 750	24 650	33 900	27 100	29 400
	18	0.256	32 000	26 800	27 900	38 400	30 700	33 250
5/8								
3/4	10	0.334	41 750	35 050	36 400	50 100	40 100	43 400
3/4	16	0.373	46 600	39 100	40 650	56 000	44 800	48 450
7/8	9	0.462	57 750	48 500	50 350	69 300	55 450	60 100
7/8	14	0.509	63 600	53 400	55 450	76 400	61 100	66 150
1	8	0.606	75 750	63 650	66 050	90 900	72 700	78 800
1	12	0.663	82 900	69 700	72 250	99 400	79 600	86 150
1	14 UNS	0.679	84 900	71 300	74 400	101 900	81 500	88 250
11/8	7	0.763	95 400	80 100	83 150	114 450	91 550	99 200
11/8	8	0.790	98 750	82 950	86 200	118 500	94 800	102 700
11/8	12	0.856	107 000	89 800	93 300	128 400	102 700	111 250
11/4	7	0.969	121 150	101 750	105 600	145 350	116 300	126 000
11/4	8	1.000	125 000	105 000	109 000	150 000	120 000	130 000
11/4	12	1.073	134 100	112 600	116 950	161 000	128 800	139 450
13/8	6	1.155	144 400	121 300	125 900	173 250	138 600	150 200
13/8	8	1.233	154 150	129 450	134 400	185 000	148 000	160 300
13/8	12	1.315	164 400	138 100	143 300	197 200	157 800	170 950
11/2	6	1.405	175 650	147 550	153 150	210 750	168 600	182 500
11/2	8	1.492	186 500	156 650	162 250	233 800	175 050	194 000
11/2	12	1.581	197 600	166 000	172 300	237 200	189 700	205 500
13/4	5	1.90	237 500	199 500	207 100	285 000	228 000	247 000
13/4	8	2.08	260 000	218 400	226 700	312 000	249 600	270 000
0	41/2	2.50	212 500	262 500	272 500	275 000	200,000	325 000
2		2.50	312 500	290 850	272 500	375 000 415 000	300 000	
2	8	2.77	346 250		301 950		332 400	360 000
21/4	4½	3.25	406 250	341 250	354 250	487 000	390 000	422 500
21/4	8	3.56	445 000	373 800	388 050	534 000	422 200	462 800
21/2	4	4.00	500 000	420 000	436 000	600 000	480 000	520 000
21/2	8	4.44	550 000	466 200	483 950	666 000	532 800	577 200
2 ³ / ₄ 2 ³ / ₄	4 8	4.93 5.43	566 950 624 450	468 350 515 850	488 050 537 550	690 200 750 200	517 650 570 150	566 950 624 450
3	4	5.97	686 550	567 150	591 050	835 800	626 850	686 550
3	8	6.51	748 650	618 450	644 500	911 400	683 550	748 650
31/4	4	7.10	816 500	674 500	702 900	994 000	745 500	816 500
31/4	8	7.69	884 350	730 550	761 300	1 076 600	807 650	884 350
31/2	4	8.33	957 950	791 350	824 650	1 166 200	874 650	957 950
31/2	8	8.96	1 030 400	851 200	887 050	1 254 400	940 800	1 030 400
33/4	4	9.66	1 110 900	917 700	956 350	1 352 400	1 014 300	1 110 900
33/4	8	10.34	1 199 100	983 300	1 023 650	1 447 600	1 085 700	1 189 100
,		44.00	4.074.000	4.050.000	1 000 000	4 554 000	4 400 400	4.074.000
4	4	11.08	1 274 200	1 052 600	1 096 900	1 551 200	1 163 400	1 274 200
4	8	11.81	1 358 200	1 122 000	1 169 200	1 653 400	1 240 050	1 358 150

A Stress Area, in.² = 0.7854 [*D* − 0.9743/ *n*] ² where *D* = nominal diameter, in., and *n* = threads/in.

B Based on 125 000 psi for sizes ¼ to 2½ in., inclusive, and on 115 000 psi for sizes over 2½ to 4 in., inclusive.

B Based on 105 000 psi for sizes ¼ to 2½ in., inclusive, and on 95 000 psi for sizes over 2½ to 4 in., inclusive.

B Based on 109 000 psi for sizes ¼ to 2½ in., inclusive, and on 99 000 psi for sizes over 2½ to 4 in., inclusive.

B Based on 150 000 psi for sizes ½ to 2½ in., inclusive, and on 140 000 psi for sizes over 2½ to 4 in., inclusive.

B Based on 150 000 psi for sizes ½ to 2½ in., inclusive, and on 140 000 psi for sizes over 2½ to 4 in., inclusive.

F Based on 120 000 psi for sizes 1/4 to 21/2 in., inclusive, and on 105 000 psi for sizes over 21/2 to 4 in., inclusive.

G Based on 130 000 psi for sizes 1/4 to 21/2 in., inclusive, and on 115 000 psi for sizes over 21/2 to 4 in., inclusive.

TABLE 4 Mechanical Requirements for Machined Specimens

Grade	Size, in.	Tensile Strength min, psi	Yield Strength (0.2 % offset), min, psi	Elonga- tion in 2 in. min, %	Reduc- tion of Area, min, %
BC	1/4 to 21/2, incl	125 000	109 000	16	50
BC	Over 21/2	115 000	99 000	16	45
BD	1/4 to 21/2, incl	150 000	130 000	14	40
BD	Over 21/2	140 000	115 000	14	40

effective it is essential that secondary processors, distributors, and purchasers maintain the identification and integrity of each lot until the product is installed.

- 9.3 Lot Processing—All fasteners shall be processed in accordance with a lot identification-control quality assurance plan. The manufacturer, secondary processors, and distributors shall identify and maintain the integrity of each lot of fasteners from raw-material selection through all processing operations and treatments to final packing and shipment. Each lot shall be assigned its own lot-identification number, each lot shall be tested, and the inspection test reports for each lot shall be retained.
- 9.4 Lot Definition—A lot is a quantity of a uniquely identified fastener product of the same nominal size and length produced consecutively at the initial operation from a single mill heat of material and heat treatment lot and processed at one time, by the same process, in the same manner so that statistical sampling is valid. The identity of the lot is maintained throughout all subsequent operations and packaging.
- 9.5 *Number of Tests*—The minimum number of tests from each production lot for the tests specified below shall be in accordance with Guide F1470.

Hardness Coating Weight/Thickness
Tensile Workmanship (Surface
Discontinuities Section 8)
Proof Load

- 9.5.1 The number of tests for dimensional and thread fit compliance shall be in accordance with the quality assurance provisions of the referenced dimensional standards.
- 9.6 If any test specimen shows defective machining it may be discarded and another specimen substituted.

10. Test Methods

- 10.1 Test methods shall be conducted in accordance with Test Methods F606.
- 10.2 Proof load, rather than yield strength determination is preferred and shall be the arbitration method for fasteners $1\frac{1}{4}$ in. and under in diameter.
- 10.3 Hexagon bolts shall be tested by the wedge tension method. Fracture shall be in the body or threads of the bolt without any fracture at the junction of the head and body.
- 10.3.1 At the option of the manufacturer, the yield strength test (Method 2, Yield Strength paragraph of Test Methods F606) and the wedge tension test (Wedge Tension Testing of Full-Size Product paragraph, both from the Test Method

section of Test Methods F606) may be accomplished concurrently to satisfy 10.2 and 10.3.

- 10.4 Studs and bolts other than those in 10.3 shall be tested by the axial tension method.
- 10.4.1 At the option of the manufacturer, the yield strength test and the axial tension test may be accomplished concurrently to satisfy 10.2 and 10.4.
- 10.5 The speed of testing determined with a free running crosshead shall be a maximum of $\frac{1}{8}$ in. (3.2 mm)/min for the bolt proof load (or yield strength) determination and a maximum of 1 in. (25.4 mm)/min for the tensile strength determination.

11. Inspection

- 11.1 If the inspection described in 11.2 is required by the purchaser, it shall be specified in the inquiry and contract or purchase order.
- 11.2 The inspector representing the purchaser shall have free entry to all parts of the manufacturer's works that concern the manufacture of the material ordered. The manufacturer shall afford the inspector all reasonable facilities to satisfy him that the material is being furnished in accordance with this specification. All tests and inspections required by the specification that are requested by the purchaser's representative shall be made before shipment, and shall be conducted as not to interfere unnecessarily with the operation of the works.

12. Responsibility

12.1 The party responsible for the fastener shall be the organization that supplies the fastener to the purchaser.

13. Rejection and Rehearing

13.1 Material that fails to conform to the requirements of this specification may be rejected. Rejection should be reported to the producer or supplier promptly and in writing. In case of dissatisfaction with the results of the test, the producer or supplier may make claim for a rehearing.

14. Certification

- 14.1 When specified on the purchase order, the manufacturer or supplier, whichever is the responsible party in accordance with Section 12, shall furnish the purchaser a test report which includes the following:
- 14.1.1 Product description, grade, quantity, ASTM Specification Number and issue date,
- 14.1.2 Alloy grade (AISI, SAE, UNS, etc.), heat analysis, and heat number, and type of quench,
- 14.1.3 Results of hardness, tensile, and proof load tests, as applicable,
- 14.1.4 Statement of compliance to Protective Coating Specification (if applicable),
- 14.1.5 Statement of compliance with the surface discontinuity requirements of Specification F788/F788M,
 - 14.1.6 Statement of compliance dimensionally,
- 14.1.7 Report, describe, or illustrate manufacturer's markings and their location,
- 14.1.8 Lot number, purchase order number, and date shipped,

- 14.1.9 Country of origin, and
- 14.1.10 Title and signature of the individual assigned certification responsibility by the company officers, with complete mailing address.
- 14.2 Failure to include all the required information on the test report shall be cause for rejection.

15. Product Marking

- 15.1 *Manufacturers Identification* —All products shall be marked by the manufacturer with a unique identifier to identify the manufacturer.
 - 15.2 Grade Identification:
 - 15.2.1 All Grade BC products shall be marked "BC".
- 15.2.2 All Grade BD products shall be marked "BD". In addition to the "BD" marking, the product may be marked with 6 radial lines 60° apart if manufactured from alloy steel conforming to the requirements of this specification.
 - 15.3 Marking Location and Methods:
 - 15.3.1 Bolts shall be marked on the top of the bolt head.
- 15.3.2 Where studs have both coarse and fine threads, all markings shall appear on the coarse thread end or, if preferred, the manufacturer's identification shall appear on the fine thread end and the grade marking on the coarse thread end.
- 15.3.3 Continuous thread studs may be marked on either end.

- 15.3.4 All markings may be raised or depressed at the manufacturer's option.
- 15.3.5 Grade and manufacturer's identification shall shall be separate and distinct. The two identifications shall preferably be in different locations and when on the same level shall be separated by at least two spaces.

16. Packaging and Package Marking

- 16.1 Packaging:
- 16.1.1 Unless otherwise specified, packaging shall be in accordance with Practice D3951.
- 16.1.2 When special packaging requirements are required, they shall be defined at the time of the inquiry and order.
 - 16.2 Package Marking:
- 16.2.1 Each shipping unit shall include or be plainly marked with the following information:
 - 16.2.1.1 ASTM designation and grade,
 - 16.2.1.2 Size,
 - 16.2.1.3 Name and brand or trademark of the manufacturer,
 - 16.2.1.4 Number of pieces,
 - 16.2.1.5 Purchase order number, and
 - 16.2.1.6 Country of origin.

17. Keywords

17.1 alloy steel; bolts; steel; studs

SUPPLEMENTARY REQUIREMENTS

S1. Marking

- S1.1 Studs that are continuously threaded with the same class of thread shall be marked on each end with the marking in accordance with Section 15.
- S1.2 Marking small sizes (customarily less than 0.375 in. (9.525 mm) may not be practical. Consult the producer for the minimum size that can be marked.



SPECIFICATION FOR ELECTRIC-FUSION-WELDED AUSTENITIC CHROMIUM-NICKEL STAINLESS STEEL PIPE FOR HIGH-TEMPERATURE SERVICE AND GENERAL APPLICATIONS



SA-358/SA-358M

(23)

(Identical with ASTM Specification A358/A358M-19 except for the deletion of 6.3.2.2 for HT-O pipe and 6.3.2.3 for HT-SO pipe. For products ordered to Section III and Section VIII, Division 1 of the ASME Boiler and Pressure Vessel Code, Supplementary Requirement S8 is mandatory.)

Specification for Electric-Fusion-Welded Austenitic Chromium-Nickel Stainless Steel Pipe for High-Temperature Service and General Applications

1. Scope

1.1 This specification covers electric-fusion-welded austenitic chromium-nickel stainless steel pipe suitable for corrosive or high-temperature service, or both, or for general applications.

Note 1—The dimensionless designator NPS (nominal pipe size) has been substituted in this standard for such traditional terms as "nominal diameter," "size," and "nominal size."

- 1.2 This specification covers the grades of alloy and stainless steel listed in Table 1. The selection of the proper grade and requirements for heat treatment shall be at the discretion of the purchaser, dependent on the service conditions to be encountered.
 - 1.3 Five classes of pipe are covered as follows:
- 1.3.1 *Class 1*—Pipe shall be double welded by processes employing filler metal in all passes and shall be completely radiographed.
- 1.3.2 *Class* 2—Pipe shall be double welded by processes employing filler metal in all passes. No radiography is required.
- 1.3.3 Class 3—Pipe shall be single welded by processes employing filler metal in all passes and shall be completely radiographed.
- 1.3.4 *Class 4*—Same as Class 3 except that the weld pass exposed to the inside pipe surface may be made without the addition of filler metal (see 6.2.2.1 and 6.2.2.2).
- 1.3.5 *Class* 5—Pipe shall be double welded by processes employing filler metal in all passes and shall be spot radiographed.
- 1.4 Supplementary requirements covering provisions ranging from additional testing to formalized procedures for

manufacturing practice are provided. Supplementary Requirements S1 through S6 are included as options to be specified when desired.

- 1.5 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in nonconformance with the specification. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.
- 1.6 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A240/A240M Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications
- A262 Practices for Detecting Susceptibility to Intergranular Attack in Austenitic Stainless Steels
- A480/A480M Specification for General Requirements for Flat-Rolled Stainless and Heat-Resisting Steel Plate, Sheet, and Strip
- A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys
- A999/A999M Specification for General Requirements for Alloy and Stainless Steel Pipe
- E527 Practice for Numbering Metals and Alloys in the Unified Numbering System (UNS)

TABLE 1 Plate and Filler Metal Specifications

				I			iller Metal Classific	<u> </u>		n ^A for Applicable ^B	AWS Sneci	fication			
Grade	UNS Desig-	Material,	ASTM Plate Specification No.	A5.4/A	5 4M		.9/A5.9M		A5.11/A5.11M A5.14/A5.14M				/A5.22M	A5 30/	A5.30M
Grado	nation	Туре	and Grade	Class.	UNS	Class.	UNS	Class.	UNS	Class.	Luns	Class.	UNS	Class.	UNS
	N08020		A240/A240M N08020												
	N08367		A240/A240M N08367					ENiCrMo-3	W86112	ERNiCrMo-3	N06625				
	N08700		A240/A240M N08700					ENiCrMo-3	W86112	ERNiCrMo-3	N06625				
800 [€]	N08800		A240/A240M N08800					ENiCrFe-3	W86182	ERNiCr-3	N06082				
800H ^E	N08810		A240/A240M N08810					ENiCrFe-3 ^F	W86182 ^F	ERNiCr-3 ^F	N06082 ^F				
	N08811		A240/A240M N08811					ENiCrFe-3 ^F	W86182 ^F	ERNiCr-3 ^F	N06082 ^F				
	N08904		A240/A240M N08904												
	N08926		A240/A240M N08926					ENiCrMo-3	W86112	ERNiCrMo-3	N06625				
201	S20100	201	A240/A240M Type 201												
201LN	S20153	201LN	A240/A240M Type 201LN												
	S20400		A240/A240M S20400	E 209	W32210	ER209	S20980								
XM-19	S20910	XM-19	A240/A240M Type XM-19	E209	W32210	ER209	S20980								
XM-29	S24000	XM-29	A240/A240M Type XM-29	E240	W32410	ER240	S24080								
304	S30400	304	A240/A240M Type 304	E308	W30810	ER308	S30880					E308T	W30831	IN308	S30880
304L	S30403	304L	A240/A240M Type 304	E308L	W30813	ER308L	S30883					E308LT	W30835	IN308L	S30883
304H	S30409	304H	A240/A240M Type 304H	E308H	W30810	ER308	S30880					E308T	W30831	IN308	S30880
	S30415		A240/A240M S30415												
304N	S30451	304N	A240/A240M Type 304N	E308	W30810	ER308	S30880					E308T	W30831	IN308	S30880
304LN	S30453	304LN	A240/A240M Type 304LN	E308L	W30813	ER308L	S30883					E308LTT	W30835	IN308L	S30883
	S30600 ^D		A240/A240M S30600 ^D												
	S30815		A240/A240M S30815												
309S	S30908	309S	A240/A240M Type 309S												
309Cb	S30940	309Nb	A240/A240M Type 309Cb	E309Cb	W30917										
310S	S31008	310S	A240/A240M Type 310S												
310Cb	S31040	310Cb	A240/A240M Type 310Cb	E310NB	W31017										
	S31254		A240/A240M S31254					ENiCrMo-3	W86112	ERNiCrMo-3	N06625				
	S31266		A240/A240M S31266					ENiCrMo-13	W86059	ERNiCrMo-13	N06059				

TABLE 1 Continued

	UNS		ASTM Plate		Filler Metal Classification and UNS Designation ^A for Applicable ^B AWS Specification										
Grade	Desig-	Material, Type	Specification No.	A5.4/A	5.4M	A5.	9/A5.9M	A5.11/A5	.11M	A5.14/A5.	14M	A5.22/A5.22M		A5.30//	A5.30M
	nation	Турс	and Grade	Class.	UNS	Class.	UNS	Class.	UNS	Class.	UNS	Class.	UNS	Class.	UNS
	S31266		A240/A240M S31266					ENiCrMo-10	W86022	ERNiCrMo-10	N06022				
316	S31600	316	A240/A240M Type 316	E316	W31610	ER316	S31680 W31640					E316T	W31631	IN316	S31680
316L	S31603	316L	A240/A240M Type 316L	E316L	W31613	ER316L	S31683					E316LT	W31635	IN316L	S31683
316H	S31609	316H	A240/A240M Type 316H	E316H	W31610	ER316H	S31680					E316T	W31631	IN316	S31680
316N	S31651	316N	A240/A240M Type 316N	E316	W31610	ER316	S31680					E316T	W31631	IN316	S31680
316LN	S31653	316LN	A240/A240M Type 316LN	E316L	W31613	ER316L	S31683					E316LT	W31635	IN316L	S31683
	S31655		A240/A240M S31655 A240/A240M												
317	S31700	317	Type 317 A240/A240M	E317	W31710	ER 317	S31780					E317LT	W31735		
317L	S31703	317L	Type 317L A240/A240M	E317L	W34713	ER317L	S31783					E317LT	W31735		
	S31725		S31725					ENiCrMo-3	W86112	ERNiCrMo-3	N06625				
	S31726		A240/A240M S31726					ENiCrMo-3	W86112	ERNiCrMo-3	N06625				
	S31727		A240/A240M S31727												
	S32050		A240/A240M S32050 A240/A240M												
	S32053		S32053			 ER321									
321	S32100	321	A240/A240M Type 321	E347	W34710	ER347	S32180 S34780					E347T	W34731	IN348	S34780
321H ^C	S32109 ^C	321H ^C	A240/A240M Type 321H ^C		W34710	ER321 ER347	S32180 S34780					E347T	W34731	IN348	S34780
	S32654		A240/A240M S32654												
	S34565		A240/A240M S34565												
347	S34700	347	A240/A240M Type 347	E347	W34710	ER347	S34780					E347T	W34731	IN348	S34780
347H ^C	S34709 ^C	347H ^C	A240/A240M Type 347H ^C			ER347	S34780					E347T	W34731	IN348	S34780
347LN	S34751		A240/A240M Type 347LN												
	S34752		A240/A240M S34752												
348	S34800	348	A240/A240M Type 348	E347	W34710	ER347	S34780					E347T	W34731	IN348	S34780

^A New designation established in accordance with Practice E527 and SAE J1086. ^B Choice of American Welding Society specification depends on the welding process used.

 $^{^{\}it C}$ Minimum carbon content of the filler metal shall be 0.040 mass %.

 $^{^{\}it D}$ In previous editions, S30600 was incorrectly shown as S01815.

ECommon name, not a trademark, widely used, not associated with any one producer.

These filler metals have a high nickel content and, therefore, lower creep strength than the parent metal at temperatures exceeding about 1470 °F [800 °C], and its resistance to sulphurous media is inferior in certain cases.

2.2 ASME Boiler and Pressure Vessel Code:

Section II

Section III

Section VIII

Section IX

2.3 AWS Specifications:

A5.4/A5.4M Stainless Steel Electrodes for Shielded Metal Arc Welding

A5.9/A5.9M Bare Stainless Steel Welding Electrodes and Rods

A5.11/A5.11M Nickel and Nickel-Alloy Welding Electrodes for Shielded Metal Arc Welding

A5.14/A5.14M Nickel and Nickel-Alloy Bare Welding Electrodes and Rods

A5.22/A5.22M Stainless Steel Flux Cored and Metal Cored Welding Electrodes and Rods

A5.30/A5.30M Consumable Inserts

2.4 Other Standard:

SAE J1086 Practice for Numbering Metals and Alloys (UNS)

3. Terminology

- 3.1 Definitions:
- 3.1.1 The definitions in Specification A999/A999M and Terminology A941 are applicable to this specification.

4. Ordering Information

- 4.1 It shall be the responsibility of the purchaser to specify all requirements that are necessary for product under this specification. Such requirements to be considered include, but are not limited to, the following:
 - 4.1.1 Quantity (feet, metres, or number of lengths),
 - 4.1.2 Name of material (electric-fusion-welded pipe),
 - 4.1.3 Grade (Table 1),
 - 4.1.4 Class (see 1.3),
 - 4.1.5 Size (outside diameter and nominal wall thickness),
 - 4.1.6 Length (specific or random),
- 4.1.7 End finish (Section on Ends of Specification A999/A999M),
- 4.1.8 Authorization for repair of plate defects by welding and subsequent heat treatment without prior approval if such is intended (see 9.3),
 - 4.1.9 Specification designation,
 - 4.1.10 Special requirements,
- 4.1.11 Statement invoking requirements of 16.4 if such is intended.
 - 4.1.12 Circumferential weld permissibility (see Section 16),
 - 4.1.13 Supplementary Requirements (S1 through S8),
 - 4.1.14 Applicable ASME Code if known,
- 4.1.15 For ASME Code Section III applications, the service classification intended, and

4.1.16 Certification requirements (see Section on Certification of Specification A999/A999M).

5. General Requirements

5.1 Material furnished to this specification shall conform to the applicable requirements of the current edition of Specification A999/A999M unless otherwise provided herein.

6. Materials and Manufacture

- 6.1 Materials:
- 6.1.1 The steel plate material shall conform to the requirements of one of the grades of Specification A240/A240M, listed in Table 1, except as provided in 6.3.2.3.
 - 6.2 Welding:
- 6.2.1 The joints shall be full penetration double-welded or single-welded butt joints employing fusion welding processes as defined under "Definitions," ASME Boiler and Pressure Vessel Code, Section IX. This specification makes no provision for any difference in weld quality requirements regardless of the weld joint type employed (single or double) in making the weld. Where backing rings or strips are employed, the ring or strip material shall be of the same P-Number (Table QW-422 of Section IX) as the plate being joined. Backing rings or strips shall be completely removed after welding, prior to any required radiography, and the exposed weld surface shall be examined visually for conformance to the requirements of 6.2.3. Welds made by procedures employing backing strips or rings that remain in place are prohibited. Welding procedures, and welding operators shall be qualified in accordance with ASME Boiler and Pressure Vessel Code, Section IX.
- 6.2.2 Except as provided in 6.2.2.1 and 6.2.2.2, welds shall be made in their entirety by processes involving the deposition of filler metal.
- 6.2.2.1 For Class 4 pipe employing multiple passes, the root-pass may be without the addition of filler metal.
- 6.2.2.2 For Class 4 pipe, the weld surface exposed inside the pipe may result from a single pass made from the inside of the pipe without the addition of filler metal.
- 6.2.2.3 All single-welded pipe shall be completely radio-graphed.
- 6.2.3 The weld surface on either side of the weld is permitted to be flush with the base plate or to have a reasonably uniform crown, not to exceed ½ in. [3 mm]. It is permitted at the option of the manufacturer or by agreement between the manufacturer and purchaser to remove any weld reinforcement. The contour of the reinforcement should be reasonably smooth and free from irregularities. The deposited metal shall be fused uniformly into the plate surface. No concavity of contour is permitted unless the resulting thickness of weld metal is equal to or greater than the minimum thickness of the adjacent base metal.
- 6.2.4 Weld defects shall be repaired by removal to sound metal and rewelding. Subsequent heat treatment and examination (that is, visual, radiographic, and dye penetrant) shall be as required on the original welds.
 - 6.3 Heat Treatment:

- 6.3.1 Unless otherwise stated in the order, all pipe shall be furnished in the heat-treated condition in accordance with the requirements of Table 2.
- 6.3.2 The purchase order shall specify one of the following conditions if the heat-treated condition specified in 6.3.1 is not desired by the purchaser:
- 6.3.2.1 A final heat-treatment temperature under 1900 °F [1040 °C]—Each pipe supplied under this requirement shall be stenciled with the final heat-treatment temperature in degrees Fahrenheit or degrees Celsius after the suffix "HT." Controlled structural or special service characteristics may be specified as a guide for the most suitable heat treatment.

6.3.2.2 DELETED

6.3.2.3 DELETED

6.4 A solution annealing temperature above 1950 °F [1065 °C] may impair the resistance to intergranular corrosion after subsequent exposure to sensitizing conditions in Grades 321, 321H, 347, 347H, and 348. When specified by the purchaser, a lower temperature stabilization or re-solution anneal shall be used subsequent to the initial high temperature solution anneal (see Supplementary Requirement S5).

7. Chemical Composition

- 7.1 The chemical composition of the plate shall conform to the requirements of the applicable specification and grade listed in Specification A240/A240M.
- 7.2 Except for Grade S34751 and S34752, the chemical composition of the welding filler metal shall conform to the requirements of the applicable AWS specification for the corresponding grade shown in Table 1, or shall conform to the chemical composition specified for the plate in Specification

A240/A240M, or shall, subject to purchaser approval, be a filler metal more highly alloyed than the base metal when needed for corrosion resistance or other properties. Use of a filler metal other than that listed in Table 1 or conforming to the chemical composition specified for the plate in Specification A240/A240M shall be reported and the filler metal identified on the certificate of tests. When nitrogen and cerium are specified elements for the ordered grade, the method of analysis for these elements shall be a matter of agreement between the purchaser and the manufacturer.

7.3 The chemical composition of the welding filler metal for Grade S34751 and S34752 shall conform to the chemical composition specified for the plate in Specification A240/A240M. The method for analysis for nitrogen shall be a matter of agreement between the purchaser and the manufacturer.

8. Permissible Variations in Dimensions

- 8.1 *Permissible Variations*—The dimensions at any point in a length of pipe shall not exceed the following:
- 8.1.1 *Outside Diameter*—Based on circumferential measurement, ± 0.5 % of the specified outside diameter.
- 8.1.2 *Out-of-Roundness*—Difference between major and minor outside diameters, 1 %.
- 8.1.3 *Alignment*—Using a 10-ft [3-m] straightedge placed so that both ends are in contact with the pipe, ½ in. [3 mm] deviation from contact with the pipe.

TABLE 2 Annealing Requirements

Grade or UNS Designation ^A	Heat Treating	Cooling/Testing
	Temperature ^B	Requirements
All grades not individually listed below:	1900 °F [1040 °C]	C
304H, 309S, 309Cb, 310S, 310Cb,	1900 °F [1040 °C]	D
321H, 347H, S22100, S28300,		
N08020	1800-1850 °F [980-1010 °C]	D
N08367	2025 °F [1110 °C]	D
N08700	2000 °F [1095 °C]	D
N08810	2050 °F [1120 °C]	D
N08811	2100 °F [1150 °C]	D
N08904	2000 °F [1095 °C]	D
N08926	2010 °F [1100 °C]	D
S30600	2100 °F [1150 °C]	D
S30815	1920 °F [1050 °C]	D
S31254	2100 °F [1150 °C]	D
S31266	2100 °F [1150 °C]	D
S31727	1975–2175 °F [1080 to 1180 °C]	D
S32050	2100 °F [1150 °C]	D
S32053	1975–2175 °F [1080 to 1180 °C]	D
S32654	2100 °F [1150 °C]	D
S34565	2050 °F [1120 °C]	D
S34752	1940-2138 °F [1060 to 1170 °C]	D

^A New designation established in accordance with Practice E527 and SAE J1086.

^B Minimum, unless otherwise stated.

^C Quenched in water or rapidly cooled by other means, at a rate sufficient to prevent reprecipitation of carbides, as demonstrable by the capability of passing Practices A262, Practice E. The manufacturer is not required to run the test unless it is specified on the purchase order (see Supplementary Requirement S7). Note that Practices A262 requires the test to be performed on sensitized specimens in the low-carbon and stabilized types and on specimens representative of the as-shipped condition for other types. In the case of low-carbon types containing 3 % or more molybdenum, the applicability of the sensitizing treatment prior to testing shall be a matter for negotiation between the seller and the purchaser.

^D Quenched in water or rapidly cooled by other means.

8.1.4 *Thickness*—The minimum wall thickness at any point in the pipe shall not be more than 0.01 in. [0.3 mm] under the nominal thickness.

9. Workmanship, Finish, and Appearance

- 9.1 The finished pipe shall have a workmanlike finish.
- 9.2 Repair of Plate Defects by Machining or Grinding—It is permitted to repair pipes showing slivers, or other surface defects, by machining or grounding inside or outside to a depth that ensures the removal of all included scale and slivers, provided that the wall thickness is not reduced below the specified minimum wall thickness. Machining or grinding shall follow inspection of the pipe as rolled, and shall be followed by supplementary visual inspection.
- 9.3 Repair of Plate Defects by Welding-It is permitted to repair by welding defects that violate minimum wall thickness, but only with the approval of the purchaser. Areas shall be suitably prepared for welding with tightly closed defects removed by grinding. Open, clean defects, such as pits or impressions, may require no preparation. All welders, welding operators, and weld procedures shall be qualified to the ASME Boiler and Pressure Vessel Code, Section IX. Unless the purchaser specifies otherwise, pipe required to be heat treated under the provisions of 6.3, shall be heat treated or reheat treated following repair welding. Repaired lengths, where repair depth is greater than 1/4 of the thickness, shall be pressure tested or repressure tested after repair and heat treatment (if any). Repair welds shall also be examined by suitable nondestructive examination techniques, including any techniques specifically required of the primary weld.
- 9.4 The pipe shall be free of scale and contaminating iron particles. Pickling, blasting, or surface finishing is not mandatory when pipe is bright annealed. The purchaser is permitted to request that a passivating treatment be applied.

10. Heat Analysis

10.1 An analysis of each heat of steel shall be made by the plate manufacturer to determine the percentages of the elements prescribed in Specification A240/A240M. The chemical composition thus determined shall conform to the requirements prescribed in Specification A240/A240M.

11. Product Analysis

- 11.1 For each lot of 500 ft [150 m] of pipe or fraction thereof, analysis shall be made by the manufacturer from the finished pipe of the plate and of the weld deposit. Drillings for analysis may be taken from the mechanical test specimens. The results of these analyses shall be reported to the purchaser or the purchaser's representative, and shall conform to the requirements of Section 7, subject to the product analysis tolerances of Table 1 in Specification A480/A480M.
- 11.2 If the analysis of one of the tests specified in 9.1 does not conform to the requirements specified in Section 7, analyses shall be made on additional pipe of double the original number from the same lot, each of which shall conform to the requirements specified.

12. Tensile Requirements

- 12.1 The plate used in making the pipe shall conform to the requirements as to tensile properties of the applicable specifications listed in Table 1. Tension tests made by the plate manufacturer shall qualify the plate material.
- 12.2 The transverse tension test taken across the welded joint specimen shall have a tensile strength not less than the specified minimum tensile strength of the plate.

13. Transverse Guided-Bend Weld Tests

- 13.1 Two bend test specimens shall be taken transversely from the pipe. Except as provided in 13.2, one shall be subject to a face guided-bend test and the second to a root guided-bend test. One specimen shall be bent with the inside surface of the pipe against the plunger, and the other with the outside surface against the plunger.
- 13.2 For wall thicknesses over 3/8 in. [9.5 mm] but less than 3/4 in. [19 mm] side-bend tests may be made instead of the face and root-bend tests. For specified wall thicknesses 3/4 in. [19 mm] and over, both specimens shall be subjected to the side-bend tests. Side-bend specimens shall be bent so that one of the side surfaces becomes the convex surface of the bend specimen.
- 13.3 The bend test shall be acceptable if no cracks or other defects exceeding $\frac{1}{8}$ in. [3 mm] in any direction is present in the weld metal or between the weld and the pipe metal after bending. Cracks that originate along the edges of the specimen during testing, and that are less than $\frac{1}{4}$ in. [6.5 mm] measured in any direction shall not be considered.

14. Test Specimens and Methods of Testing

- 14.1 Transverse tension and bend test specimens shall be taken from the end of the finished pipe; the transverse tension and bend test specimens shall be flattened cold before final machining to size.
- 14.2 As an alternative to the requirements of 14.1, it is permitted to take the test specimens from a test plate of the same material as the pipe that is attached to the end of the cylinder and welded as a prolongation of the pipe longitudinal seam.
- 14.3 Tension test specimens shall be made in accordance with Section IX, Part QW, Paragraph QW-150 of the ASME Boiler and Pressure Vessel Code and shall be one of the types shown in OW-462.1 of that code.
- 14.3.1 Reduced-section specimens conforming to the requirements given in QW-462.1(b) may be used for tension tests on all thicknesses of pipe having outside diameter greater than 3 in. [76 mm].
- 14.3.2 Turned specimens conforming to the requirements of QW-462.1(d) may be used for tension tests.
- 14.3.2.1 If turned specimens are used as given in 14.3.2.2 and 14.3.2.3, one complete set shall be made for each required tension test.
- 14.3.2.2 For thicknesses to and including $1\frac{1}{4}$ in. [32 mm], it is permitted to use a single turned specimen.
- 14.3.2.3 For thicknesses over $1\frac{1}{4}$ in. [32 mm], multiple specimens shall be cut through the full thickness of the weld

with their centers parallel to the material surface and not over 1 in. [25 mm] apart. The centers of the specimens adjacent to material surfaces shall not exceed 5/8 in. [16 mm] from the surface.

14.4 The test specimens shall not be cut from the pipe or test plate until after final heat treatment.

15. Mechanical Tests Required

- 15.1 For the purposes of the tension and bend test requirements, the term "lot" shall mean all pipe of the same grade, permitted to include more than one heat of steel, within a 3/16-in [4.7-mm] range of thickness and welded to the same weld procedure, and when heat treated, done so to the same heat-treating procedure and in the same furnace. The maximum lot size shall be 200 linear ft [60 m] of pipe.
- 15.1.1 *Transverse Tension Test*—One test shall be made to represent each lot of finished pipe.
- 15.1.2 *Transverse Guided-Bend Weld Test*—One test (two specimens) shall be made to represent each lot of finished pipe.
- 15.2 Hydrostatic Test—Each length of pipe shall be subjected to a hydrostatic test in accordance with Specification A999/A999M, unless specifically exempted under the provision of 15.3. Pressure shall be held for a sufficient time to permit the inspector to examine the entire length of the welded seam.
- 15.3 The purchaser, with the agreement of the manufacturer, is permitted to complete the hydrostatic test requirement with the system pressure test, performed at a pressure either lower or higher than the specification test pressure, but in no case shall the test pressure be lower than the system design pressure. Each length of pipe furnished without the completed manufacturer's hydrostatic test shall include with the mandatory marking the letters "NH."

16. Radiographic Examination

16.1 For Classes 1, 3, and 4 pipe, all welded joints shall be completely examined by radiography.

- 16.2 For Class 5 pipe, the welded joints shall be spot radiographed to the extent of not less than 12 in. [300 mm] of radiograph per 50 ft [15 m] of weld.
- 16.3 For Classes 1, 3, and 4 pipe, radiographic examination shall be in accordance with the requirements of the ASME Boiler and Pressure Vessel Code, Section VIII, latest edition, Paragraph UW-51.
- 16.4 For Class 5 pipe, radiographic examination shall be in accordance with the requirements of the ASME Boiler and Pressure Vessel Code, Section VIII, Division 1, latest edition, Paragraph UW-52.
- 16.5 Radiographic examination is permitted to be performed prior to heat treatment.

17. Lengths

17.1 Circumferentially welded joints of the same quality as the longitudinal joints shall be permitted by agreement between the manufacturer and the purchaser.

18. Product Marking

- 18.1 In addition to the marking prescribed in Specification A999/A999M, the markings on each length of pipe shall include the plate material designations as shown in Table 1, the marking requirements of 6.3 and 15.3, and Class 1, 2, 3, or 4, as appropriate (see 1.3).
- 18.2 Bar Coding—In addition to the requirements in 18.1, bar coding is acceptable as a supplementary identification method. Bar coding should be consistent with the Automotive Industry Action Group (AIAG) standard prepared by the Primary Metals Subcommittee of the AIAG Bar Code Project Team.

19. Keywords

19.1 arc welded steel pipe; austenitic stainless steel; chromium-nickel steel; fusion welded steel pipe; high temperature application; steel pipe; temperature service applications; high; welded steel pipe

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall apply only when specified in the purchase order. The purchaser is permitted to specify a different frequency of test or analysis than is provided in the supplementary requirement. Subject to agreement between the purchaser and manufacturer, it is permitted to modify the retest and retreatment provisions of these supplementary requirements.

S1. Product Analysis

S1.1 Product analysis shall be made on each length of pipe. Individual lengths failing to conform to the chemical composition requirements shall be rejected.

S2. Tension and Bend Tests

S2.1 Tension tests (Section 12) and bend tests (Section 13) shall be made on specimens to represent each length of pipe. Failure of any test specimen to meet the requirements shall be cause for the rejection of the pipe length represented.

S3. Penetrant Oil and Powder Examination

S3.1 All welded joints shall be subjected to examination by a penetrant oil and powder method. The details of the method and the disposition of flaws detected shall be a matter for agreement between the purchaser and the manufacturer.

S4. Ferrite Control in Weld Deposits

S4.1 The ferrite content of the deposited weld metal in any length of pipe shall be determined. The procedural details pertaining to this subject (that is, welding; plate and weld

deposit chemistry; testing equipment and method; number and location of test sites; and ferrite control limits) shall be a matter for agreement between the purchaser and the manufacturer.

S5. Stabilizing Heat Treatment

S5.1 Subsequent to the heat treatment required in 6.3, Grades 321, 321H, 347, 347H, and 348 shall be given a stabilization heat treatment at a temperature lower than that used for the initial solution annealing heat treatment. The temperature of stabilization heat treatment shall be at a temperature as agreed upon between the purchaser and manufacturer.

S6. Intergranular Corrosion Test

S6.1 When specified, material shall pass intergranular corrosion tests conducted by the manufacturer in accordance with Practices A262, Practice E.

Note S1—Practice E requires testing on the sensitized condition for low carbon or stabilized grades, and on the as-shipped condition for other grades.

S6.2 A stabilization heat treatment in accordance with Supplementary Requirement S5 may be necessary and is permitted in order to meet this requirement for the grades containing titanium or columbium.

S7. In-Process Heat Treatments

S7.1 For H grades, separate solution treatments are required for solution annealing. In-process heat treatments are not permitted as a substitute for separate solution annealing.

S8. ASME Section III or Section VIII, Division 1, Construction

S8.1 Products furnished under this specification that are intended for application under the rules of Section III or Section VIII, Division 1, of the ASME Boiler and Pressure

Vessel Code shall be manufactured by holders of the appropriate ASME Certificate of Authorization and Certification Mark. The product is subject to all applicable requirements of Section III or Section VIII, Division 1, including welding, heat treatment, nondestructive examination, authorized inspection at the point of manufacture, and application of the Certification Mark.

S8.2 The applicable ASME Partial Data Report form, signed by an Authorized Inspector or Authorized Nuclear Inspector and a material test report shall be furnished for each lot of pipe.

S8.3 The welded joints shall be full penetration butt welds as obtained by double welding or by other means that will obtain the same quality of deposited weld metal on the inside and outside. Welds using metal backing strips that remain in place are prohibited.

S8.4 In addition to the requirements of 15.1, for pipe that is not heat treated, or that is heat treated in a continuous furnace, a lot shall consist of each 200 ft [60 m] or fraction thereof, of all pipe of the same heat of plate starting material of the same thickness, subjected to the same heat treatment. For pipe that is heat treated in a batch-type furnace that is automatically controlled within a 50 °F [25 °C] range and is equipped with recording pyrometers so that the heating records are available, a lot shall be defined as for continuous furnace heat treatment. Each length of pipe shall be so marked as to identify each such piece of pipe with the lot and the material test report.



SPECIFICATION FOR CARBON AND FERRITIC ALLOY STEEL FORGED AND BORED PIPE FOR HIGH-TEMPERATURE SERVICE



SA-369/SA-369M



(Identical with ASTM Specification A369/A369M-18.)

Standard Specification for Carbon and Ferritic Alloy Steel Forged and Bored Pipe for High-Temperature Service

1. Scope

1.1 This specification covers heavy-wall carbon and alloy steel pipe (Note 1) made from turned and bored forgings and is intended for high-temperature service. Pipe ordered under this specification shall be suitable for bending and other forming operations and for fusion welding. Selection will depend on design, service conditions, mechanical properties and high-temperature characteristics.

Note 1—The use of the word "pipe" throughout the several sections of this specification is used in the broad sense and intended to mean pipe headers, or leads.

Note 2—The dimensionless designator NPS (nominal pipe size) has been substituted in this standard for such traditional terms as "nominal diameter," "size," and "nominal size."

- 1.2 Several grades of ferritic steels are covered. Their compositions are given in Table 1.
- 1.3 Supplementary requirements (S1 to S6) of an optional nature are provided. These supplementary requirements call for additional tests to be made, and when desired shall be so stated in the order, together with the number of such tests required.
- 1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.
- 1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A999/A999M Specification for General Requirements for Alloy and Stainless Steel Pipe

E290 Test Methods for Bend Testing of Material for Ductility

E381 Method of Macroetch Testing Steel Bars, Billets, Blooms, and Forgings

2.2 ASME Boiler and Pressure Vessel Code:

Section IX

2.3 ANSI Standard:

B 46.1 Surface Texture

2.4 AWS Specifications:

A5.5/A5.5M Specification for Low-Alloy Steel Electrodes for Shielded Metal Arc Welding

A5.23/A5.23M Specification for Low-Alloy Steel Electrodes and Fluxes for Submerged Arc Welding

A5.28/A5.28M Specification for Low-Alloy Steel Electrodes for Gas Shielded Arc Welding

A5.29/A5.29M Low-Alloy Steel Electrodes for Flux Cored Arc Welding

3. Ordering Information

- 3.1 Orders for material to this specification should include the following, as required, to describe the desired material adequately:
 - 3.1.1 Quantity (feet, centimetres, or number of lengths),
 - 3.1.2 Name of material (forged and bored pipe),
 - 3.1.3 Grade (Table 1),
 - 3.1.4 Size (inside diameter and minimum wall thickness),
- 3.1.5 Length (Permissible Variations in Length Section of Specification A999/A999M),

TABLE 1 Chemical Requirements

Grade	Composition, %									
	FPA	FPB	FF	FP2						
Carbon	0.25 max	0.30 max	0.10-	-0.20	0.10-0.20					
Manganese	0.27-0.93	0.29-1.06	0.30-	-0.80	0.30-0.61					
Phosphorus, max	0.035	0.035	0.0	25	0.025					
Sulfur, max	0.035	0.035	0.0	25	0.025					
Silicon	0.10 min	0.10 min	0.10-	-0.50	0.10-0.30					
Chromium					0.50-0.81					
Molybdenum		***	0.44-		0.44-0.65					
Grade	FP5	FP9	FP	11	FP12					
Carbon	0.15 max	0.15 max	0.05-	-0.15	0.05-0.15					
Manganese	0.30-0.60	0.30-0.60	0.30-	-0.60	0.30-0.61					
Phosphorus, max	0.025	0.030	0.0	25	0.025					
Sulfur, max	0.025	0.030	0.0	25	0.025					
Silicon	0.50 max	0.50-1.00	0.50-	-1.00	0.50 max					
Chromium	4.00-6.00	8.00-10.00	1.00-	-1.50	0.80-1.25					
Molybdenum	0.45-0.65	0.90-1.10	0.44-	-0.65	0.44-0.65					
Grade	FP21	FP22	FP	91	FP92					
			Type 1	Type 2						
Carbon					0.07-0.13					
Heat	0.05-0.15	0.05-0.15	0.08-0.12	0.08-0.12						
Product				0.07-0.13						
Manganese	0.30-0.60	0.30-0.60	0.30-0.60	0.30-0.50 ^A	0.30-0.60					
Phosphorus, max	0.025	0.025	0.025	0.020 ^A	0.020					
Sulfur, max	0.025	0.025	0.025	0.005 ^A	0.010					
Silicon	0.50 max	0.50 max	0.20-0.50	0.20-0.40 ^A	0.50 max					
Chromium	2.65-3.35	1.90-2.60	8.00-9.50	8.0–9.50 ^A	8.50-9.50					
Molybdenum					0.30-0.60					
Heat	0.80-1.06	0.87-1.13	0.85-1.05	0.85-1.05						
Product		***		0.80-1.05						
			Oth	ers:	W 1.50-2.00					
			Ni 0.40 max	0.20 max ^A	V 0.15-0.25					
				V	Cb 0.04-0.09					
			Heat 0.18-0.25	0.18-0.25						
			Product	0.16-0.27						
			(Cb	N 0.030-0.070					
			Heat 0.06-0.10	0.06-0.10						
			Product	0.05-0.11						
			N 0.03-0.07	$0.035-0.070^{A}$	Ni 0.40 max					
			Al 0.02 max	0.020 max ^A	Al 0.02 max					
			Ti 0.01 max	0.01 max ^A	Ti 0.01 max					
			Zr 0.01 max	0.01 max ^A	Zr 0.01 max					
			Sn	0.010 max ^A	B 0.001-0.006					
			Sb	0.003 max ^A						
			В	0.001 max ^A						
			Cu	0.10 max ^A						
			W	0.05 max ^A						
			As	0.010 max ^A						
			N/AI	≥ 4.0						

^AApplies to both heat and product analyses.

- 3.1.6 Verification of tensile and hardness properties at mid-thickness for Grade FP91 Type 1 and Type 2 (9.2),
 - 3.1.7 End finish (13),
- 3.1.8 Optional requirements (Sections 8, Supplementary Requirements S1 to S6; 13.2),
- 3.1.9 Test report required (Certification Section of Specification A999/A999M),
 - 3.1.10 Specification designation, and
- 3.1.11 Special requirements or exceptions to this specification.

4. General Requirements

4.1 Material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A999/A999M, unless otherwise provided herein.

5. Materials and Manufacture

5.1 Discard:

- 5.1.1 A sufficient discard shall be made from each ingot to secure freedom from injurious defects. The steel shall have a homogeneous structure.
 - 5.2 Manufacture:
- 5.2.1 Material for forging shall consist of ingots or of blooms, billets, or solid-rolled bars forged or rolled from an ingot, and cut to the required length by a process that will not produce injurious defects in the forging.
- 5.2.2 The material shall be forged (Note 3) by hammering or pressing, and shall be brought as nearly as practicable to the finished shape and size by hot working.
- Note 3—The cross-sectional area of the solid forging shall have a reduction by forging or by rolling and forging from that of the ingot in the ratio of not less than 3 to 1.
- 5.2.3 Unless otherwise specified, the final forging operation shall be followed by a treatment suitable to the grade as specified in 5.4.

- 5.3 Machining:
- 5.3.1 All forgings shall have both the inner and outer surfaces machined.
- 5.3.2 After heat treatment, the pipe shall be machined to a finish with a roughness value no greater than 250-µin. [6.4-µm] arithmetical average deviation (AA), terms as defined in ANSI B 46.1-1962, unless otherwise specified.

5.4 Heat Treatment:

5.4.1 All pipe of the grades shown in Table 1 other than FPA, FPB, FP1, FP2, FP12, FP91 Type 1 and Type 2, and FP92 shall be reheated and furnished in the full-annealed or normalized and tempered condition. If furnished in the normalized and tempered condition (Note 4), the temperature for tempering shall be 1250 °F [680 °C] or higher for Grades FP5, FP9, FP21, and FP22, and 1200 °F [650 °C] or higher for Grades FP36 and FP11.

Note 4—It is recommended that the temperature for tempering should be at least 100 °F [50 °C] above the intended service temperature; consequently, the purchaser should advise the manufacturer if the service temperature is to be over 1100 °F [600 °C].

5.4.2 Pipe in Grades FPA and FPB as a final heat treatment shall be either normalized or shall be given a stress relieving treatment at 1200 to 1300 °F [650 to 705 °C]. Pipe in Grades FP1, FP2, and FP12, as a final heat treatment shall be given a stress-relieving treatment at 1200 to 1300 °F [650 to 705 °C].

Note 5—Certain of the ferritic steels covered by this specification tend to harden if cooled rapidly from above their critical temperature. Some will air harden, that is, become hardened to an undesirable degree when cooled in air from high temperatures. Therefore, operations involving heating such steels above their critical temperatures, such as welding, hot-bending and other forming operations, should be followed by suitable heat treatment.

- 5.4.3 Except when Supplementary Requirement S6 is specified by the purchaser, Grade FP91 Type 1 and Type 2 shall be normalized and tempered by reheating within the temperature range from 1900 to 1975 °F [1040 to 1080 °C], followed by air cooling and tempering in the temperature range of 1350 to 1470 °F [730 to 800 °C].
- 5.4.4 Except when Supplementary Requirement S6 is specified by the purchaser, Grade FP92 shall be normalized and tempered by reheating within the temperature range of 1900 to 1975 °F [1040 to 1080 °C], followed by air cooling and tempering in the temperature range of 1350 to 1470 °F [730 to 800 °C].
 - 5.5 Repair by Welding:
- 5.5.1 Weld repair shall be permitted only subject to the approval of the purchaser and in accordance with Specification A999/A999M.
- 5.5.2 All repair welds in FP91 shall be made with one of the following welding processes and consumables: SMAW, A5.5/A5.5M E90XX-B9; SAW, A5.23/A5.23M EB9 + neutral flux; GTAW, A5.28/A5.28M ER90S-B9; and FCAW A5.29/A5.29M E91T1-B9. In addition, the sum of the Ni + Mn content of all welding consumables used to weld repair FP91 Type 1 and Type 2 shall not exceed 1.0 %.
- 5.5.3 All repair welds in FP92 shall be made using welding consumables meeting the chemical requirements for the grade in Table 1.

5.5.4 After weld repair, Grades FP91 Type 1 and Type 2 and FP92 shall be heat treated at 1350–1470 °F [730–800 °C].

6. Chemical Composition

6.1 The steel shall conform to the requirements as to chemical composition prescribed in Table 1.

7. Heat Analysis

- 7.1 An analysis of each heat of steel shall be made by the steel manufacturer to determine the percentages of the elements specified. If secondary melting processes are employed, the heat analysis shall be obtained from one remelted ingot or the product of one remelted ingot of each primary melt. The chemical composition thus determined, or that determined from a product analysis made by the tubular product manufacturer, shall conform to the requirements specified.
- 7.2 In the case of large ingots poured from two or more heats, the weighted average of the chemical determinations of the several heats, made in accordance with 7.1, shall conform to the requirements specified in Section 6.

8. Product Analysis

- 8.1 At the request of the purchaser, a product analysis shall be made by the manufacturer on every heat.
- 8.2 The results of these analyses shall be reported to the purchaser or his representative, and shall conform to the requirements specified in Section 6.
- 8.3 If the analysis of one of the tests specified in Section 7 or Section 8 does not conform to the requirements specified in Section 6 an analysis of each billet or pipe from the same heat may be made, and all billets or pipes conforming to the requirements shall be accepted.

9. Tensile Requirements

- 9.1 The material shall conform to the requirements as to tensile properties prescribed in Table 2. Tests for acceptance shall be made after final heat treatment of the forging.
- 9.2 For Grade FP91 Type 1 and Type 2, when requested by the purchaser, the tensile and hardness properties shall be met and verified on material taken from the half-thickness location.

10. Mechanical Tests Required

- 10.1 Transverse or Longitudinal Tension Test—One test shall be made on a specimen from one end of one length of pipe representing each heat in each heat-treatment lot.
- 10.2 Flattening Test—For pipe NPS 14 or less, and diameter to wall thickness ratios of more than 7.0, a flattening test shall be carried out in accordance with Specification A999/A999M. A test shall be carried out on a specimen taken from one end of each length of pipe.
- 10.3 Bend Test—For pipe larger than NPS 14 or NPS where diameters to wall thickness ratio is 7.0 or less, a bend test shall be carried out in accordance with Test Methods E290. Unless otherwise specified, the test specimens shall be taken in a transverse direction. The diameter of the pin shall be $\frac{2}{3}t$ for longitudinal specimens or $\frac{1}{3}t$ for transverse specimens,

TABLE 2 Tensile Requirements

Grade	FPA	FPB	FP1, FP2	FP12	FP91 Type 1	FP92	All Others
					and Type 2		
Tensile strength, min; ksi [MPa]	48 [330]	60 [415]	55 [380]	60 [415]	85 [585]	90 [620]	60 [415]
Yield strength, min; ksi [MPa]	30 [210]	35 [240]	30 [210]	32 [220]	60 [415]	64 [440]	30 [210]

				Elongation	Requirements			
Crede	FPA		FPB		FP91 Type 1 and Type 2 and FP92		All Others	
Grade	Longitu-	Trans-	Longitu-	Trans-	Longitu-	Trans-	Longitu-	Trans-
	dinal	verse	dinal	verse	dinal	verse	dinal	verse
Elongation in 2 in. or 50 mm, min, %: Basic minimum elongation for wall 5/16 in. [8 mm] and over in thickness, strip tests, and for all small sizes tested in full-section	35	25	30	17	27	18	30	20
When standard round 2-in. or 50-mm gage length test specimen is used	28	20	22	12	20	13	22	14

where t is the specimen thickness. The bend test specimens shall be bent at room temperature through 180° without cracking. One bend test shall be taken from one end of each length of pipe.

11. Workmanship

11.1 The pipe shall conform to the sizes and shapes specified by the purchaser.

12. Ends

12.1 Pipe ends shall be machined as specified in the purchase order.

13. Finish

- 13.1 The finished pipe shall be reasonably straight and shall have a workmanlike finish.
- 13.2 Repair of defects by welding shall be permitted only subject to the approval of the purchaser. Defects shall be thoroughly chipped or ground out before welding. Only quali-

fied operators and procedures in accordance with the ASME Boiler and Pressure Vessel Code, Section IX, shall be used. Local or full heat treatment in accordance with 5.4 shall follow welding. Local grinding following welding and retreating shall be considered as meeting the requirements of 5.3.

14. Product Marking

14.1 In addition to the marking prescribed in Specification A999/A999M, the marking shall include the wall thickness, piece mark, length, and additional symbol "S" if the pipe conforms to the supplementary requirements specified in Supplementary Requirements S1 to S5, and the heat number or the manufacturer's number by which the heat can be identified. Indentation stamping, instead of stenciling, will be permitted only with the written approval of the purchaser.

14.2 For FP91, additional marking shall include the appropriate Type.

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall apply only when specified in the purchase order. The purchaser may specify a different frequency of test or analysis than is provided in the supplementary requirement. Subject to agreement between the purchaser and manufacturer, retest and retreatment provisions of these supplementary requirements may also be modified.

S1. Additional Tension Test

S1.1 An additional tension test shall be made on a specimen from one or each end of each pipe. If this supplementary requirement is specified, the number of tests per pipe required shall be specified. If a specimen from any length fails to meet the required tensile properties (tensile, yield, and elongation),

that length shall be rejected subject to retreatment in accordance with Specification A999/A999M and satisfactory retest.

S2. Additional Flattening or Bend Tests

S2.1 The appropriate flattening or bend test may be made on specimens from both ends of each length of pipe. Crop ends may be used. If the specimen from either end of any length fails to conform to the specific requirement, that length shall be rejected.

S3. Ultrasonic Tests

S3.1 Each pipe shall be ultrasonically tested to determine its soundness throughout the entire length of the pipe. Until suitable standards are established, the basis for rejection of material shall be a matter of agreement between the manufacturer and purchaser.

S4. Hydrostatic Test

S4.1 A hydrostatic pressure test shall be applied as agreed upon by the manufacturer and purchaser.

S5. Metal Structure and Etching Tests

S5.1 The steel shall be homogeneous as shown by etching tests conducted in accordance with the appropriate portions of Method E381. Etching tests shall be made on a cross section

from one end or both ends of each pipe and shall show sound and reasonably uniform material free of injurious laminations, cracks, and similar objectionable defects. If this supplementary requirement is specified, the number of tests per pipe required shall also be specified. If a specimen from any length shows objectionable defects, the length shall be rejected, subject to removal of the defective end and subsequent retests indicating the remainder of the length to be sound and reasonably uniform material.

S6. Alternative Heat Treatment—Grades FP91 Type 1 and Type 2 and FP92

S6.1 Grades FP91 Type 1 and Type 2 and FP92 shall be normalized in accordance with 5.4.3 or 5.4.4, respectively, and tempered at a temperature, to be specified by the purchaser, less than 1350 °F [730 °C]. It shall be the purchaser's responsibility to subsequently temper in the range of 1350 to 1470 °F [730 to 800 °C]. All mechanical tests shall be made on material heat treated in accordance with 5.4.3 or 5.4.4, respectively. The certification shall reference this supplementary requirement indicating the tempering temperature applied. The notation "S6" shall be included with the required marking of the pipe.

TEST METHODS AND DEFINITIONS FOR MECHANICAL TESTING OF STEEL PRODUCTS



SA-370



(23)

(Identical with ASTM Specification A370-21.)

Test Methods and Definitions for Mechanical Testing of Steel Products

1. Scope

- 1.1 These test methods cover procedures and definitions for the mechanical testing of steels, stainless steels, and related alloys. The various mechanical tests herein described are used to determine properties required in the product specifications. Variations in testing methods are to be avoided, and standard methods of testing are to be followed to obtain reproducible and comparable results. In those cases in which the testing requirements for certain products are unique or at variance with these general procedures, the product specification testing requirements shall control.
 - 1.2 The following mechanical tests are described:

	Sections
Tension	7 to 14
Bend	15
Hardness	16
Brinell	17
Rockwell	18
Portable	19
Impact	20 to 30
Kevwords	32

1.3 Annexes covering details peculiar to certain products are appended to these test methods as follows:

	Annex
Bar Products	Annex A1
Tubular Products	Annex A2
Fasteners	Annex A3
Round Wire Products	Annex A4
Significance of Notched-Bar Impact Testing	Annex A5
Converting Percentage Elongation of Round Specimens to	Annex A6
Equivalents for Flat Specimens	

Testing Multi-Wire Strand

Rounding of Test Data

Methods for Testing Steel Reinforcing Bars

Procedure for Use and Control of Heat-cycle Simulation

Annex A10

- 1.4 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.
- 1.5 When these test methods are referenced in a metric product specification, the yield and tensile values may be determined in inch-pound (ksi) units then converted into SI (MPa) units. The elongation determined in inch-pound gauge lengths of 2 or 8 in. may be reported in SI unit gauge lengths of 50 or 200 mm, respectively, as applicable. Conversely, when these test methods are referenced in an inch-pound product specification, the yield and tensile values may be determined in SI units then converted into inch-pound units. The elongation determined in SI unit gauge lengths of 50 or 200 mm may be reported in inch-pound gauge lengths of 2 or 8 in., respectively, as applicable.
- 1.5.1 The specimen used to determine the original units must conform to the applicable tolerances of the original unit system given in the dimension table not that of the converted tolerance dimensions.

Note 1—This is due to the specimen SI dimensions and tolerances being hard conversions when this is not a dual standard. The user is directed to Test Methods A1058 if the tests are required in SI units.

- 1.6 Attention is directed to ISO/IEC 17025 when there may be a need for information on criteria for evaluation of testing laboratories.
- 1.7 This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.
- 1.8 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A623 Specification for Tin Mill Products, General Requirements
- A623M Specification for Tin Mill Products, General Requirements [Metric]
- A833 Test Method for Indentation Hardness of Metallic Materials by Comparison Hardness Testers
- A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys
- A956/A956M Test Method for Leeb Hardness Testing of Steel Products
- A1038 Test Method for Portable Hardness Testing by the Ultrasonic Contact Impedance Method
- A1058 Test Methods for Mechanical Testing of Steel Products—Metric
- A1061/A1061M Test Methods for Testing Multi-Wire Steel Prestressing Strand
- E4 Practices for Force Calibration and Verification of Testing Machines
- E6 Terminology Relating to Methods of Mechanical Testing E8/E8M Test Methods for Tension Testing of Metallic Materials
- E10 Test Method for Brinell Hardness of Metallic Materials E18 Test Methods for Rockwell Hardness of Metallic Materials
- E23 Test Methods for Notched Bar Impact Testing of Metallic Materials
- E29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications
- E83 Practice for Verification and Classification of Extensometer Systems
- E110 Test Method for Rockwell and Brinell Hardness of Metallic Materials by Portable Hardness Testers
- E190 Test Method for Guided Bend Test for Ductility of Welds
- E290 Test Methods for Bend Testing of Material for Ductility
- 2.2 ASME Document:
- ASME Boiler and Pressure Vessel Code, Section VIII, Division I, Part UG-8
- 2.3 ISO Standard:
- ISO/IEC 17025 General Requirements for the Competence of Testing and Calibration Laboratories

3. Terminology

3.1 Definitions:

- 3.1.1 For definitions of terms pertaining to mechanical testing of steel products not otherwise listed in this section, reference should be made to Terminology E6 and Terminology A941.
 - 3.2 Definitions of Terms Specific to This Standard:
- 3.2.1 *longitudinal test, n*—unless specifically defined otherwise, signifies that the lengthwise axis of the specimen is parallel to the direction of the greatest extension of the steel during rolling or forging.
- 3.2.1.1 *Discussion*—The stress applied to a longitudinal tension test specimen is in the direction of the greatest extension, and the axis of the fold of a longitudinal bend test specimen is at right angles to the direction of greatest extension (see Fig. 1, Fig. 2a, and Fig. 2b).
- 3.2.2 radial test, n—unless specifically defined otherwise, signifies that the lengthwise axis of the specimen is perpendicular to the axis of the product and coincident with one of the radii of a circle drawn with a point on the axis of the product as a center (see Fig. 2a).
- 3.2.3 tangential test, n—unless specifically defined otherwise, signifies that the lengthwise axis of the specimen perpendicular to a plane containing the axis of the product and tangent to a circle drawn with a point on the axis of the productas a center (see Fig. 2a, Fig. 2b, Fig. 2c, and Fig. 2d).
- 3.2.4 transition temperature, n—for specification purposes, the transition temperature is the temperature at which the designated material test value equals or exceeds a specified minimum test value.
- 3.2.4.1 *Discussion*—Some of the many definitions of transition temperature currently being used are: (1) the lowest temperature at which the specimen exhibits 100 % fibrous fracture, (2) the temperature where the fracture shows a 50 % crystalline and a 50 % fibrous appearance, (3) the temperature corresponding to the energy value 50 % of the difference




FIG. 1 Relation of Test Coupons and Test Specimens to Rolling Direction or Extension (Applicable to General Wrought Products)

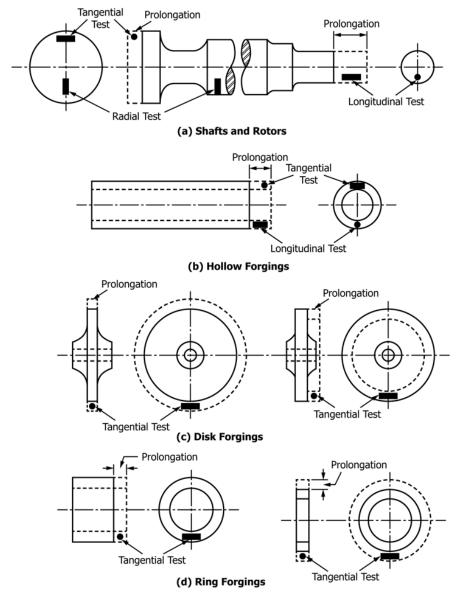


FIG. 2 Location of Longitudinal Tension Test Specimens in Rings Cut From Tubular Products

between values obtained at 100 and 0 % fibrous fracture, and (4) the temperature corresponding to a specific energy value.

3.2.5 transverse test, n—unless specifically defined otherwise, signifies that the lengthwise axis of the specimen is right angles to the direction of the greatest extension of the steel during rolling or forging.

3.2.5.1 *Discussion*—The stress applied to a transverse tension test specimen is at right angles to the greatest extension, and the axis of the fold of a transverse bend test specimen is parallel to the greatest extension (see Fig. 1).

- 3.3 Definition of Terms Specific to the Procedure for Use and Control of Heat-cycle Simulation (See Annex A9):
- 3.3.1 *master chart*, *n*—a record of the heat treatment received from a forging essentially identical to the production forgings that it will represent.
- 3.3.1.1 *Discussion*—It is a chart of time and temperature showing the output from thermocouples imbedded in the forging at the designated test immersion and test location or locations.
- 3.3.2 *program chart, n*—the metallized sheet used to program the simulator unit.
- 3.3.2.1 *Discussion*—Time-temperature data from the master chart are manually transferred to the program chart.
- 3.3.3 *simulator chart*, *n*—a record of the heat treatment that a test specimen had received in the simulator unit.
- 3.3.3.1 *Discussion*—It is a chart of time and temperature and can be compared directly to the master chart for accuracy of duplication.
- 3.3.4 *simulator cycle*, *n*—one continuous heat treatment of a set of specimens in the simulator unit.
- 3.3.4.1 *Discussion*—The cycle includes heating from ambient, holding at temperature, and cooling. For example, a simulated austenitize and quench of a set of specimens would be one cycle; a simulated temper of the same specimens would be another cycle.

4. Significance and Use

- 4.1 The primary use of these test methods is testing to determine the specified mechanical properties of steel, stainless steel, and related alloy products for the evaluation of conformance of such products to a material specification under the jurisdiction of ASTM Committee A01 and its subcommittees as designated by a purchaser in a purchase order or contract.
- 4.1.1 These test methods may be and are used by other ASTM Committees and other standards writing bodies for the purpose of conformance testing.
- 4.1.2 The material condition at the time of testing, sampling frequency, specimen location and orientation, reporting requirements, and other test parameters are contained in the pertinent material specification or in a general requirement specification for the particular product form.
- 4.1.3 Some material specifications require the use of additional test methods not described herein; in such cases, the required test method is described in that material specification or by reference to another appropriate test method standard.
- 4.2 These test methods are also suitable to be used for testing of steel, stainless steel and related alloy materials for other purposes, such as incoming material acceptance testing by the purchaser or evaluation of components after service exposure.
- 4.2.1 As with any mechanical testing, deviations from either specification limits or expected as-manufactured properties can occur for valid reasons besides deficiency of the original as-fabricated product. These reasons include, but are not limited to: subsequent service degradation from environmental exposure (for example, temperature, corrosion); static or cyclic service stress effects, mechanically-induced damage, material

inhomogeneity, anisotropic structure, natural aging of select alloys, further processing not included in the specification, sampling limitations, and measuring equipment calibration uncertainty. There is statistical variation in all aspects of mechanical testing and variations in test results from prior tests are expected. An understanding of possible reasons for deviation from specified or expected test values should be applied in interpretation of test results.

5. General Precautions

- 5.1 Certain methods of fabrication, such as bending, forming, and welding, or operations involving heating, may affect the properties of the material under test. Therefore, the product specifications cover the stage of manufacture at which mechanical testing is to be performed. The properties shown by testing prior to fabrication may not necessarily be representative of the product after it has been completely fabricated.
- 5.2 Improperly machined specimens should be discarded and other specimens substituted.
- 5.3 Flaws in the specimen may also affect results. If any test specimen develops flaws, the retest provision of the applicable product specification shall govern.
- 5.4 If any test specimen fails because of mechanical reasons such as failure of testing equipment or improper specimen preparation, it may be discarded and another specimen taken.

6. Orientation of Test Specimens

6.1 The terms "longitudinal test" and "transverse test" are used only in material specifications for wrought products and are not applicable to castings. When such reference is made to a test coupon or test specimen, see Section 3 for terms and definitions.

TENSION TEST

7. Description

- 7.1 The tension test related to the mechanical testing of steel products subjects a machined or full-section specimen of the material under examination to a measured load sufficient to cause rupture. The resulting properties sought are defined in Terminology E6.
- 7.2 In general, the testing equipment and methods are given in Test Methods E8/E8M. However, there are certain exceptions to Test Methods E8/E8M practices in the testing of steel, and these are covered in these test methods.


8. Testing Apparatus and Operations

- 8.1 Loading Systems—There are two general types of loading systems, mechanical (screw power) and hydraulic. These differ chiefly in the variability of the rate of load application. The older screw power machines are limited to a small number of fixed free running crosshead speeds. Some modern screw power machines, and all hydraulic machines permit stepless variation throughout the range of speeds.
- 8.2 The tension testing machine shall be maintained in good operating condition, used only in the proper loading range, and calibrated periodically in accordance with the latest revision of Practices E4.

- Note 2—Many machines are equipped with stress-strain recorders for autographic plotting of stress-strain curves. It should be noted that some recorders have a load measuring component entirely separate from the load indicator of the testing machine. Such recorders are calibrated separately.
- 8.3 Loading—It is the function of the gripping or holding device of the testing machine to transmit the load from the heads of the machine to the specimen under test. The essential requirement is that the load shall be transmitted axially. This implies that the centers of the action of the grips shall be in alignment, insofar as practicable, with the axis of the specimen at the beginning and during the test and that bending or twisting be held to a minimum. For specimens with a reduced section, gripping of the specimen shall be restricted to the grip section. In the case of certain sections tested in full size, nonaxial loading is unavoidable and in such cases shall be permissible.
- 8.4 Speed of Testing—The speed of testing shall not be greater than that at which load and strain readings can be made accurately. In production testing, speed of testing is commonly expressed: (1) in terms of free running crosshead speed (rate of movement of the crosshead of the testing machine when not under load), (2) in terms of rate of separation of the two heads of the testing machine under load, (3) in terms of rate of stressing the specimen, or (4) in terms of rate of straining the specimen. The following limitations on the speed of testing are recommended as adequate for most steel products:
- Note 3—Tension tests using closed-loop machines (with feedback control of rate) should not be performed using load control, as this mode of testing will result in acceleration of the crosshead upon yielding and elevation of the measured yield strength.
- 8.4.1 Any convenient speed of testing may be used up to one half the specified yield point or yield strength. When this point is reached, the free-running rate of separation of the crossheads shall be adjusted so as not to exceed ½16 in. per min per inch of reduced section, or the distance between the grips for test specimens not having reduced sections. This speed shall be maintained through the yield point or yield strength. In determining the tensile strength, the free-running rate of separation of the heads shall not exceed ½ in. per min per inch of reduced section, or the distance between the grips for test specimens not having reduced sections. In any event, the minimum speed of testing shall not be less than ½10 the specified maximum rates for determining yield point or yield strength and tensile strength.
- 8.4.2 It shall be permissible to set the speed of the testing machine by adjusting the free running crosshead speed to the above specified values, inasmuch as the rate of separation of heads under load at these machine settings is less than the specified values of free running crosshead speed.
- 8.4.3 As an alternative, if the machine is equipped with a device to indicate the rate of loading, the speed of the machine from half the specified yield point or yield strength through the yield point or yield strength may be adjusted so that the rate of stressing does not exceed 100 000 psi (690 MPa)/min. However, the minimum rate of stressing shall not be less than 10 000 psi (70 MPa)/min.

9. Test Specimen Parameters

- 9.1 *Selection*—Test coupons shall be selected in accordance with the applicable product specifications.
- 9.1.1 Wrought Steels—Wrought steel products are usually tested in the longitudinal direction, but in some cases, where size permits and the service justifies it, testing is in the transverse, radial, or tangential directions (see Figs. 1 and 2).
- 9.1.2 Forged Steels—For open die forgings, the metal for tension testing is usually provided by allowing extensions or prolongations on one or both ends of the forgings, either on all or a representative number as provided by the applicable product specifications. Test specimens are normally taken at mid-radius. Certain product specifications permit the use of a representative bar or the destruction of a production part for test purposes. For ring or disk-like forgings test metal is provided by increasing the diameter, thickness, or length of the forging. Upset disk or ring forgings, which are worked or extended by forging in a direction perpendicular to the axis of the forging, usually have their principal extension along concentric circles and for such forgings tangential tension specimens are obtained from extra metal on the periphery or end of the forging. For some forgings, such as rotors, radial tension tests are required. In such cases the specimens are cut or trepanned from specified locations.
- 9.2 Size and Tolerances—Test specimens shall be (1) the full cross section of material, or (2) machined to the form and dimensions shown in Figs. 3-6. The selection of size and type of specimen is prescribed by the applicable product specification. Full cross section specimens shall be tested in 8-in. (200 mm) gauge length unless otherwise specified in the product specification.
- 9.3 Procurement of Test Specimens—Specimens shall be extracted by any convenient method taking care to remove all distorted, cold-worked, or heat-affected areas from the edges of the section used in evaluating the material. Specimens usually have a reduced cross section at mid-length to ensure uniform distribution of the stress over the cross section and localize the zone of fracture.
- 9.4 Aging of Test Specimens—Unless otherwise specified, it shall be permissible to age tension test specimens. The time-temperature cycle employed must be such that the effects of previous processing will not be materially changed. It may be accomplished by aging at room temperature 24 to 48 h, or in shorter time at moderately elevated temperatures by boiling in water, heating in oil or in an oven.
 - 9.5 Measurement of Dimensions of Test Specimens:
- 9.5.1 Standard Rectangular Tension Test Specimens—These forms of specimens are shown in Fig. 3. To determine the cross-sectional area, the center width dimension shall be measured to the nearest 0.005 in. (0.13 mm) for the 8-in. (200 mm) gauge length specimen and 0.001 in. (0.025 mm) for the 2-in. (50 mm) gauge length specimen in Fig. 3. The center thickness dimension shall be measured to the nearest 0.001 in. for both specimens.
- 9.5.2 Standard Round Tension Test Specimens—These forms of specimens are shown in Fig. 4 and Fig. 5. To determine the cross-sectional area, the diameter shall be



DIMENSIONS

		Subsize Specimen						
			e-type, 0 mm) Wide					
		00 mm) Length	,	2-in. (50 mm) Gauge Length		Sheet-type, ½ in. (12.5 mm) Wide		m) Wide
	in.	mm	in.	mm	in.	mm	in.	mm
G—Gauge length (Notes 1 and 2)	8.00 ± 0.01	200 ± 0.25	2.000 ± 0.005	50.0 ± 0.10	2.000 ± 0.005	50.0 ± 0.10	1.000 ± 0.003	25.0 ± 0.08
<i>W</i> —Width	11/2 + 1/8	40 + 3	11/2 + 1/8	40 + 3	0.500 ± 0.010	12.5 ± 0.25	0.250 ± 0.002	6.25 ± 0.05
(Notes 3, 5, and 6)	-1/4	-6	- 1/4	-6				
T—Thickness (Note 7)				Thickne	ess of Material			
R—Radius of fillet, min (Note 4)	1/2	13	1/2	13	1/2	13	1/4	6
L—Overall length, min (Notes 2 and 8)	18	450	8	200	8	200	4	100
A—Length of reduced section, min	9	225	21/4	60	21/4	60	11/4	32
B—Length of grip section, min (Note 9)	3	75	2	50	2	50	11/4	32
C—Width of grip section, approximate (Note 4, Note 10, and Note 11)	2	50	2	50	3/4	20	3/8	10

Note 1—For the 1½-in. (40 mm) wide specimens, punch marks for measuring elongation after fracture shall be made on the flat or on the edge of the specimen and within the reduced section. For the 8-in. (200 mm) gauge length specimen, a set of nine or more punch marks 1 in. (25 mm) apart, or one or more pairs of punch marks 8 in. (200 mm) apart may be used. For the 2-in. (50 mm) gauge length specimen, a set of three or more punch marks 1 in. (25 mm) apart, or one or more pairs of punch marks 2 in. (50 mm) apart may be used.

Note 2—For the ½-in. (12.5 mm) wide specimen, punch marks for measuring the elongation after fracture shall be made on the flat or on the edge of the specimen and within the reduced section. Either a set of three or more punch marks 1 in. (25 mm) apart or one or more pairs of punch marks 2 in. (50 mm) apart may be used.

Note 3—For the four sizes of specimens, the ends of the reduced section shall not differ in width by more than 0.004, 0.004, 0.002, or 0.001 in. (0.10, 0.10, 0.05, or 0.025 mm), respectively. Also, there may be a gradual decrease in width from the ends to the center, but the width at either end shall not be more than 0.015 in., 0.005 in., 0.005 in., or 0.003 in. (0.40, 0.40, 0.10, or 0.08 mm), respectively, larger than the width at the center.

Note 4—For each specimen type, the radii of all fillets shall be equal to each other with a tolerance of 0.05 in. (1.25 mm), and the centers of curvature of the two fillets at a particular end shall be located across from each other (on a line perpendicular to the centerline) within a tolerance of 0.10 in. (2.5 mm).

Note 5—For each of the four sizes of specimens, narrower widths (W and C) may be used when necessary. In such cases, the width of the reduced section should be as large as the width of the material being tested permits; however, unless stated specifically, the requirements for elongation in a product specification shall not apply when these narrower specimens are used. If the width of the material is less than W, the sides may be parallel throughout the length of the specimen.

Note 6—The specimen may be modified by making the sides parallel throughout the length of the specimen, the width and tolerances being the same as those specified above. When necessary, a narrower specimen may be used, in which case the width should be as great as the width of the material being tested permits. If the width is $1\frac{1}{2}$ in. (38 mm) or less, the sides may be parallel throughout the length of the specimen.

Note 7—The dimension T is the thickness of the test specimen as provided for in the applicable product specification. Minimum nominal thickness of 1 to $1\frac{1}{2}$ -in. (40 mm) wide specimens shall be $\frac{3}{16}$ in. (5 mm), except as permitted by the product specification. Maximum nominal thickness of $\frac{1}{2}$ -in. (12.5 mm) and $\frac{1}{4}$ -in. (6 mm) wide specimens shall be 1 in. (25 mm) and $\frac{1}{4}$ in. (6 mm), respectively.


Note 8—To aid in obtaining axial loading during testing of 1/4-in. (6 mm) wide specimens, the overall length should be as large as the material will permit.

Note 9—It is desirable, if possible, to make the length of the grip section large enough to allow the specimen to extend into the grips a distance equal to two thirds or more of the length of the grips. If the thickness of ½-in. (13 mm) wide specimens is over 3/8 in. (10 mm), longer grips and correspondingly longer grip sections of the specimen may be necessary to prevent failure in the grip section.

Note 10—For standard sheet-type specimens and subsize specimens, the ends of the specimen shall be symmetrical with the center line of the reduced section within 0.01 and 0.005 in. (0.25 and 0.13 mm), respectively, except that for steel if the ends of the $\frac{1}{2}$ -in. (12.5 mm) wide specimen are symmetrical within 0.05 in. (1.0 mm), a specimen may be considered satisfactory for all but referee testing.

Note 11—For standard plate-type specimens, the ends of the specimen shall be symmetrical with the center line of the reduced section within 0.25 in. (6.35 mm), except for referee testing in which case the ends of the specimen shall be symmetrical with the center line of the reduced section within 0.10 in. (2.5 mm).

FIG. 3 Rectangular Tension Test Specimens



DIMENSIONS

				D						
	Standard Specimen			Small-size Specimens Proportional to Standard						
Nominal Diameter	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
	0.500	12.5	0.350	8.75	0.250	6.25	0.160	4.00	0.113	2.50
G—Gauge length	2.00±	50.0 ±	1.400±	35.0 ±	1.000±	25.0 ±	0.640±	16.0 ±	0.450±	10.0 ±
	0.005	0.10	0.005	0.10	0.005	0.10	0.005	0.10	0.005	0.10
D—Diameter (Note 1)	$0.500 \pm$	12.5±	$0.350 \pm$	8.75 ±	$0.250 \pm$	$6.25 \pm$	0.160±	$4.00 \pm$	0.113±	$2.50 \pm$
	0.010	0.25	0.007	0.18	0.005	0.12	0.003	0.08	0.002	0.05
R—Radius of fillet, min	3/8	10	1/4	6	3/16	5	5/32	4	3/32	2
A-Length of reduced section, min	21/4	60	13/4	45	11/4	32	3/4	20	5/8	16
(Note 2)										

Note 1—The reduced section may have a gradual taper from the ends toward the center, with the ends not more than 1 % larger in diameter than the center (controlling dimension).

Note 2—If desired, the length of the reduced section may be increased to accommodate an extensometer of any convenient gauge length. Reference marks for the measurement of elongation should, nevertheless, be spaced at the indicated gauge length.

Note 3—The gauge length and fillets shall be as shown, but the ends may be of any form to fit the holders of the testing machine in such a way that the load shall be axial (see Fig. 9). If the ends are to be held in wedge grips it is desirable, if possible, to make the length of the grip section great enough to allow the specimen to extend into the grips a distance equal to two thirds or more of the length of the grips.

Note 4—On the round specimens in Fig. 5 and Fig. 6, the gauge lengths are equal to four times the nominal diameter. In some product specifications other specimens may be provided for, but unless the 4-to-1 ratio is maintained within dimensional tolerances, the elongation values may not be comparable with those obtained from the standard test specimen.

Note 5—The use of specimens smaller than 0.250-in. (6.25 mm) diameter shall be restricted to cases when the material to be tested is of insufficient size to obtain larger specimens or when all parties agree to their use for acceptance testing. Smaller specimens require suitable equipment and greater skill in both machining and testing.

Note 6—Five sizes of specimens often used have diameters of approximately 0.505, 0.357, 0.252, 0.160, and 0.113 in., the reason being to permit easy calculations of stress from loads, since the corresponding cross sectional areas are equal or close to 0.200, 0.100, 0.0500, 0.0200, and 0.0100 in.², respectively. Thus, when the actual diameters agree with these values, the stresses (or strengths) may be computed using the simple multiplying factors 5, 10, 20, 50, and 100, respectively. (The metric equivalents of these fixed diameters do not result in correspondingly convenient cross sectional area and multiplying factors.)

FIG. 4 Standard 0.500-in. (12.5 mm) Round Tension Test Specimen With 2-in. (50 mm) Gauge Length and Examples of Small-size Specimens Proportional to Standard Specimens

measured at the center of the gauge length to the nearest 0.001 in. (0.025 mm) (see Table 1).

9.6 *General*—Test specimens shall be either substantially full size or machined, as prescribed in the product specifications for the material being tested.

9.6.1 It is desirable to have the cross-sectional area of the specimen smallest at the center of the gauge length to ensure fracture within the gauge length. This is provided for by the taper in the gauge length permitted for each of the specimens described in the following sections.

9.6.2 For brittle materials it is desirable to have fillets of large radius at the ends of the gauge length.

10. Plate-type Specimens

10.1 The standard plate-type test specimens are shown in Fig. 3. Such specimens are used for testing metallic materials in the form of plate, structural and bar-size shapes, and flat material having a nominal thickness of $\frac{3}{16}$ in. (5 mm) or over. When product specifications so permit, other types of specimens may be used.

Note 4—When called for in the product specification, the 8-in. (200 $\,$

mm) gauge length specimen of Fig. 3 may be used for sheet and strip material.


11. Sheet-type Specimen

11.1 The standard sheet-type test specimen is shown in Fig. 3. This specimen is used for testing metallic materials in the form of sheet, plate, flat wire, strip, band, and hoop ranging in nominal thickness from 0.005 to 1 in. (0.13 to 25 mm). When product specifications so permit, other types of specimens may be used, as provided in Section 10 (see Note 4).

12. Round Specimens

12.1 The standard 0.500-in. (12.5 mm) diameter round test specimen shown in Fig. 4 is frequently used for testing metallic materials.

12.2 Fig. 4 also shows small size specimens proportional to the standard specimen. These may be used when it is necessary to test material from which the standard specimen or specimens shown in Fig. 3 cannot be prepared. Other sizes of small round specimens may be used. In any such small size specimen it is important that the gauge length for measurement of elongation be four times the diameter of the specimen (see Note 5, Fig. 4).

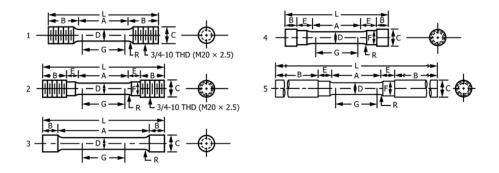

DIMENSIONS


				DIIVILIVOIC	JINO					
	Specimen 1		Specimen 2		Specimen 3		Specimen 4		Specimen 5	
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
G—Gauge length	2.000±	50.0 ±	2.000±	50.0 ±	2.000±	50.0 ±	2.000±	50.0 ±	2.00±	50.0 ±
	0.005	0.10	0.005	0.10	0.005	0.10	0.005	0.10	0.005	0.10
D—Diameter (Note 1)	$0.500 \pm$	12.5±	$0.500 \pm$	12.5±	$0.500 \pm$	12.5±	$0.500 \pm$	12.5±	0.500±	12.5 ±
	0.010	0.25	0.010	0.25	0.010	0.25	0.010	0.25	0.010	0.25
R—Radius of fillet, min	3/8	10	3/8	10	1/16	2	3/8	10	3/8	10
A—Length of reduced	21/4, min	60, min	21/4, min	60, min	4, ap-	100, ap-	21/4 , min	60, min	21/4 , min	60, min
section					proxi-	proxi-				
					mately	mately				
L—Overall length, approximate	5	125	51/2	140	51/2	140	43/4	120	91/2	240
B—Grip section	13/8, ap-	35, ap-	1, ap-	25, ap-	3∕4 , ap-	20, ap-	1/2 , ap-	13, ap-	3, min	75, min
(Note 2)	proxi-	proxi-	proxi-	proxi-	proxi-	proxi-	proxi-	proxi-		
	mately	mately	mately	mately	mately	mately	mately	mately		
C—Diameter of end section	3/4	20	3/4	20	23/32	18	7/8	22	3/4	20
E—Length of shoulder and			5/8	16			3/4	20	5/8	16
fillet section, approximate										
F—Diameter of shoulder			5/8	16			5/8	16	19/32	15

Note 1—The reduced section may have a gradual taper from the ends toward the center with the ends not more than 0.005 in. (0.10 mm) larger in diameter than the center.

Note 2—On Specimen 5 it is desirable, if possible, to make the length of the grip section great enough to allow the specimen to extend into the grips a distance equal to two thirds or more of the length of the grips.

Note 3—The types of ends shown are applicable for the standard 0.500-in. round tension test specimen; similar types can be used for subsize specimens. The use of UNF series of threads ($\frac{3}{4}$ by 16, $\frac{1}{2}$ by 20, $\frac{3}{8}$ by 24, and $\frac{1}{4}$ by 28) is suggested for high-strength brittle materials to avoid fracture in the thread portion.

FIG. 5 Suggested Types of Ends for Standard Round Tension Test Specimens



DIMENSIONS

Specin	Specin	nen 2	Specimen 3		
in.	mm	in.	mm	in.	mm
Shall be equal to or g	reater than diamet	er D			
0.500 ± 0.010	12.5± 0.25	0.750 ± 0.015	20.0 ± 0.40	1.25 ± 0.025	30.0 ± 0.60
1	25	1	25	2	50
11/4	32	11/2	38	21/4	60
33/4	95	4	100	63/8	160
1	25	1	25	13/4	45
3/4	20	11/8	30	17/8	48
1/4	6	1/4	6	5/16	8
5/8 ± 1/64	16.0 ± 0.40	15/16 ± 1/64	24.0 ± 0.40	17/16 ± 1/64	36.5 ± 0.40
	in. Shall be equal to or g 0.500 ± 0.010 1 11/4 33/4 1 9/4 1/4	$\begin{array}{cccc} \text{Shall be equal to or greater than diamet} \\ 0.500 \pm 0.010 & 12.5 \pm 0.25 \\ 1 & 25 \\ 11/4 & 32 \\ 33/4 & 95 \\ 1 & 25 \\ 3/4 & 20 \\ 1/4 & 6 \\ \end{array}$	in. mm in. Shall be equal to or greater than diameter D 0.500 ± 0.010 12.5± 0.25 0.750 ± 0.015 1 25 1 11/4 32 11/2 33/4 95 4 1 25 1 3/4 20 11/6 1/4 6 1/4	in. mm in. mm Shall be equal to or greater than diameter <i>D</i> 0.500 ± 0.010 12.5± 0.25 0.750 ± 0.015 20.0 ± 0.40 1 25 1 25 1½ 38 3¾ 95 4 100 1 25 1 25 ¾ 20 1½ 30 ½ 30 ½ 6 ½ 6	in. mm in. mm in. mm in. Shall be equal to or greater than diameter D 0.500 ± 0.010 12.5± 0.25 0.750 ± 0.015 20.0 ± 0.40 1.25 ± 0.025 1 25 1 25 2 11/4 32 11/2 38 21/4 33/4 95 4 100 63/8 1 25 1 25 13/4 3/4 20 11/6 30 17/8 1/4 6 1/4 6 5/16

Note 1—The reduced section and shoulders (dimensions A, D, E, E, E, E, E, E, and E) shall be shown, but the ends may be of any form to fit the holders of the testing machine in such a way that the load shall be axial. Commonly the ends are threaded and have the dimensions E and E0 given above.

FIG. 6 Standard Tension Test Specimens for Cast Iron

TARIF 1	Multiplying	Factors to F	Re Head for	r Various	Diameters (of Round	Test Specimens
IADLL	MULLIDIVILIA	I actors to L	JE USEU IUI	various	Diameters (n noullu	ICSL SUCCIIIICIIS

5	Standard Specime	en	Small Size Specimens Proportional to Standard								
	0.500 in. Round			0.350 in. Round		0.250 in. Round					
Actual Diameter, in.	Area, in. ²	Multiplying Factor	Actual Diameter, in.	Area, in. ²	Multiplying Factor	Actual Diameter, in.	Area, in. ²	Multiplying Factor			
0.490	0.1886	5.30	0.343	0.0924	10.82	0.245	0.0471	21.21			
0.491	0.1893	5.28	0.344	0.0929	10.76	0.246	0.0475	21.04			
0.492	0.1901	5.26	0.345	0.0935	10.70	0.247	0.0479	20.87			
0.493	0.1909	5.24	0.346	0.0940	10.64	0.248	0.0483	20.70			
0.494	0.1917	5.22	0.347	0.0946	10.57	0.249	0.0487	20.54			
0.495	0.1924	5.20	0.348	0.0951	10.51	0.250	0.0491	20.37			
0.496	0.1932	5.18	0.349	0.0957	10.45	0.251	0.0495 (0.05) ^A	20.21 (20.0) ^A			
0.497	0.1940	5.15	0.350	0.0962	10.39	0.252	0.0499 (0.05) ^A	20.05 (20.0) ^A			
0.498	0.1948	5.13	0.351	0.0968	10.33	0.253	0.0503 (0.05) ^A	19.89 (20.0) ^A			
0.499	0.1956	5.11	0.352	0.0973	10.28	0.254	0.0507	19.74			
0.500	0.1963	5.09	0.353	0.0979	10.22	0.255	0.0511	19.58			
0.501	0.1971	5.07	0.354	0.0984	10.16						
0.502	0.1979	5.05	0.355	0.0990	10.10						
0.503	0.1987	5.03	0.356	0.0995	10.05						
				$(0.1)^{A}$	$(10.0)^{A}$						
0.504	0.1995 (0.2) ^A	5.01 (5.0) ^A	0.357	0.1001 (0.1) ^A	9.99 (10.0) ^A						
0.505	0.2003 (0.2) ^A	4.99 (5.0) ^A									
0.506	0.2011 (0.2) ^A	4.97 (5.0) ^A									
0.507	0.2019	4.95									
0.508	0.2027	4.93									
0.509	0.2035	4.91									
0.510	0.2043	4.90									

^A The values in parentheses may be used for ease in calculation of stresses, in pounds per square inch, as permitted in Note 5 of Fig. 4.

12.3 The type of specimen ends outside of the gauge length shall accommodate the shape of the product tested, and shall properly fit the holders or grips of the testing machine so that axial loads are applied with a minimum of load eccentricity and slippage. Fig. 5 shows specimens with various types of ends that have given satisfactory results.

13. Gauge Marks

13.1 The specimens shown in Figs. 3-6 shall be gauge marked with a center punch, scribe marks, multiple device, or drawn with ink. The purpose of these gauge marks is to determine the percent elongation. Punch marks shall be light, sharp, and accurately spaced. The localization of stress at the marks makes a hard specimen susceptible to starting fracture at the punch marks. The gauge marks for measuring elongation after fracture shall be made on the flat or on the edge of the flat tension test specimen and within the parallel section; for the 8-in. gauge length specimen, Fig. 3, one or more sets of 8-in. gauge marks may be used, intermediate marks within the gauge length being optional. Rectangular 2-in. gauge length specimens, Fig. 3, and round specimens, Fig. 4, are gauge marked with a double-pointed center punch or scribe marks. One or more sets of gauge marks may be used; however, one

set must be approximately centered in the reduced section. These same precautions shall be observed when the test specimen is full section.

14. Determination of Tensile Properties

14.1 Yield Point—Yield point is the first stress in a material, less than the maximum obtainable stress, at which an increase in strain occurs without an increase in stress. Yield point is intended for application only for materials that may exhibit the unique characteristic of showing an increase in strain without an increase in stress. The stress-strain diagram is characterized by a sharp knee or discontinuity. Determine yield point by one of the following methods:

14.1.1 *Drop of Beam or Halt of Pointer Method*—In this method, apply an increasing load to the specimen at a uniform rate. When a lever and poise machine is used, keep the beam in balance by running out the poise at approximately a steady rate. When the yield point of the material is reached, the increase of the load will stop, but run the poise a trifle beyond the balance position, and the beam of the machine will drop for a brief but appreciable interval of time. When a machine equipped with a load-indicating dial is used there is a halt or hesitation of the load-indicating pointer corresponding to the

drop of the beam. Note the load at the "drop of the beam" or the "halt of the pointer" and record the corresponding stress as the yield point.

14.1.2 Autographic Diagram Method—When a sharp-kneed stress-strain diagram is obtained by an autographic recording device, take the stress corresponding to the top of the knee (Fig. 7), or the stress at which the curve drops as the yield point.

14.1.3 Total Extension Under Load Method—When testing material for yield point and the test specimens may not exhibit a well-defined disproportionate deformation that characterizes a yield point as measured by the drop of the beam, halt of the pointer, or autographic diagram methods described in 14.1.1 and 14.1.2, a value equivalent to the yield point in its practical significance may be determined by the following method and may be recorded as yield point: Attach a Class C or better extensometer (Notes 5 and 6) to the specimen. When the load producing a specified extension (Note 7) is reached record the stress corresponding to the load as the yield point (Fig. 8).

Note 5—Automatic devices are available that determine the load at the specified total extension without plotting a stress-strain curve. Such devices may be used if their accuracy has been demonstrated. Multiplying calipers and other such devices are acceptable for use provided their accuracy has been demonstrated as equivalent to a Class C extensometer.

Note 6—Reference should be made to Practice E83.

Note 7—For steel with a yield point specified not over 80 000 psi (550 MPa), an appropriate value is 0.005 in./in. of gauge length. For values above 80 000 psi, this method is not valid unless the limiting total extension is increased.

Note 8—The shape of the initial portion of an autographically determined stress-strain (or a load-elongation) curve may be influenced by numerous factors such as the seating of the specimen in the grips, the straightening of a specimen bent due to residual stresses, and the rapid loading permitted in 8.4.1. Generally, the aberrations in this portion of the curve should be ignored when fitting a modulus line, such as that used to determine the extension-under-load yield, to the curve. In practice, for a number of reasons, the straight-line portion of the stress-strain curve may not go through the origin of the stress-strain diagram. In these cases it is not the origin of the stress-strain curve, intersects the strain axis that is pertinent. All offsets and extensions should be calculated from the intersection of the straight-line portion of the stress-strain curve with the strain axis, and not necessarily from the origin of the stress-strain diagram. See also Test Methods E8/E8M, Note 32.

14.2 *Yield Strength*—Yield strength is the stress at which a material exhibits a specified limiting deviation from the proportionality of stress to strain. The deviation is expressed in terms of strain, percent offset, total extension under load, and so forth. Determine yield strength by one of the following methods:

14.2.1 Offset Method—To determine the yield strength by the "offset method," it is necessary to secure data (autographic or numerical) from which a stress-strain diagram with a distinct modulus characteristic of the material being tested may be drawn. Then on the stress-strain diagram (Fig. 9) lay off Om equal to the specified value of the offset, draw mn parallel to OA, and thus locate r, the intersection of mn with the stress-strain curve corresponding to load R, which is the yield-strength load. In recording values of yield strength obtained by this method, the value of offset specified or used, or both, shall be stated in parentheses after the term yield strength, for example:

Yield strength
$$(0.2\% \text{ offset}) = 52000 \text{ psi} (360 \text{ MPa})$$
 (1)

When the offset is 0.2 % or larger, the extensometer used shall qualify as a Class B2 device over a strain range of 0.05 to 1.0 %. If a smaller offset is specified, it may be necessary to specify a more accurate device (that is, a Class B1 device) or reduce the lower limit of the strain range (for example, to 0.01 %) or both. See also Note 10 for automatic devices.

Note 9—For stress-strain diagrams not containing a distinct modulus, such as for some cold-worked materials, it is recommended that the extension under load method be utilized. If the offset method is used for materials without a distinct modulus, a modulus value appropriate for the material being tested should be used: 30 000 000 psi (207 000 MPa) for carbon steel; 29 000 000 psi (200 000 MPa) for ferritic stainless steel; 28 000 000 psi (193 000 MPa) for austenitic stainless steel. For special alloys, the producer should be contacted to discuss appropriate modulus values.

14.2.2 Extension Under Load Method—For tests to determine the acceptance or rejection of material whose stress-strain characteristics are well known from previous tests of similar material in which stress-strain diagrams were plotted, the total strain corresponding to the stress at which the specified offset (see Notes 10 and 11) occurs will be known within satisfactory limits. The stress on the specimen, when this total strain is reached, is the value of the yield strength. In recording values of yield strength obtained by this method, the value of "extension" specified or used, or both, shall be stated in parentheses after the term yield strength, for example:

Yield strength
$$(0.5\% EUL) = 52\,000 \,\text{psi} (360 \,\text{MPa})$$
 (2)

The total strain can be obtained satisfactorily by use of a Class B1 extensometer (Note 5, Note 6, and Note 8).

Note 10—Automatic devices are available that determine offset yield strength without plotting a stress-strain curve. Such devices may be used if their accuracy has been demonstrated.

Note 11—The appropriate magnitude of the extension under load will obviously vary with the strength range of the particular steel under test. In general, the value of extension under load applicable to steel at any strength level may be determined from the sum of the proportional strain and the plastic strain expected at the specified yield strength. The following equation is used:

Extension under load, in./in. of gauge length = (YS/E) + r (3)

where:

YS = specified yield strength, psi or MPa, E = modulus of elasticity, psi or MPa, and

r = limiting plastic strain, in./in.

14.3 Tensile Strength—Calculate the tensile strength by dividing the maximum load the specimen sustains during a tension test by the original cross-sectional area of the specimen. If the upper yield strength is the maximum stress recorded and if the stress-strain curve resembles that of Test Methods E8/E8M–15a Fig. 25, the maximum stress after discontinuous yielding shall be reported as the tensile strength unless otherwise stated by the purchaser.

14.4 Elongation:

14.4.1 Fit the ends of the fractured specimen together carefully and measure the distance between the gauge marks to the nearest 0.01 in. (0.25 mm) for gauge lengths of 2 in. and under, and to the nearest 0.5 % of the gauge length for gauge

lengths over 2 in. A percentage scale reading to 0.5 % of the gauge length may be used. The elongation is the increase in length of the gauge length, expressed as a percentage of the original gauge length. In recording elongation values, give both the percentage increase and the original gauge length.

14.4.2 If any part of the fracture takes place outside of the middle half of the gauge length or in a punched or scribed mark within the reduced section, the elongation value obtained may not be representative of the material. If the elongation so measured meets the minimum requirements specified, no further testing is indicated, but if the elongation is less than the minimum requirements, discard the test and retest.

14.4.3 Automated tensile testing methods using extensometers allow for the measurement of elongation in a method described below. Elongation may be measured and reported either this way, or as in the method described above, fitting the broken ends together. Either result is valid.

14.4.4 Elongation at fracture is defined as the elongation measured just prior to the sudden decrease in force associated with fracture. For many ductile materials not exhibiting a sudden decrease in force, the elongation at fracture can be taken as the strain measured just prior to when the force falls below 10 % of the maximum force encountered during the test.

14.4.4.1 Elongation at fracture shall include elastic and plastic elongation and may be determined with autographic or automated methods using extensometers verified over the strain range of interest. Use a class B2 or better extensometer for materials having less than 5 % elongation; a class C or better extensometer for materials having elongation greater than or equal to 5 % but less than 50 %; and a class D or better extensometer for materials having 50 % or greater elongation. In all cases, the extensometer gauge length shall be the nominal gauge length required for the specimen being tested. Due to the lack of precision in fitting fractured ends together, the elongation after fracture using the manual methods of the preceding paragraphs may differ from the elongation at fracture determined with extensometers.

14.4.4.2 Percent elongation at fracture may be calculated directly from elongation at fracture data and be reported instead of percent elongation as calculated in 14.4.1. However, these two parameters are not interchangeable. Use of the elongation at fracture method generally provides more repeatable results.

14.5 Reduction of Area—Fit the ends of the fractured specimen together and measure the mean diameter or the width and thickness at the smallest cross section to the same accuracy as the original dimensions. The difference between the area thus found and the area of the original cross section expressed

as a percentage of the original area is the reduction of area.




FIG. 7 Stress-strain Diagram Showing Yield Point Corresponding With Top of Knee




FIG. 8 Stress-strain Diagram Showing Yield Point or Yield Strength by Extension Under Load Method

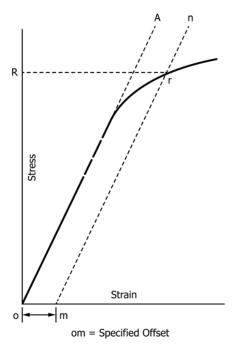


FIG. 9 Stress-strain Diagram for Determination of Yield Strength by Offset Method

BEND TEST

15. Description

15.1 The bend test is one method for evaluating ductility, but it cannot be considered as a quantitative means of predicting service performance in all bending operations. The severity of the bend test is primarily a function of the angle of bend of the inside diameter to which the specimen is bent, and of the cross section of the specimen. These conditions are varied according to location and orientation of the test specimen and the chemical composition, tensile properties, hardness, type, and quality of the steel specified. Test Methods E190 and E290 may be consulted for methods of performing the test.

15.2 Unless otherwise specified, it shall be permissible to age bend test specimens. The time-temperature cycle employed must be such that the effects of previous processing will not be materially changed. It may be accomplished by aging at room temperature 24 to 48 h, or in shorter time at moderately elevated temperatures by boiling in water or by heating in oil or in an oven.

15.3 Bend the test specimen at room temperature to an inside diameter, as designated by the applicable product specifications, to the extent specified. The speed of bending is ordinarily not an important factor.

HARDNESS TEST

16. General

16.1 A hardness test is a means of determining resistance to penetration and is occasionally employed to obtain a quick approximation of tensile strength. Tables 2-5 are for the conversion of hardness measurements from one scale to

another or to approximate tensile strength. These conversion values have been obtained from computer-generated curves and are presented to the nearest 0.1 point to permit accurate reproduction of those curves. All converted hardness values must be considered approximate. All converted Rockwell and Vickers hardness numbers shall be rounded to the nearest whole number.

16.2 Hardness Testing:

16.2.1 If the product specification permits alternative hardness testing to determine conformance to a specified hardness requirement, the conversions listed in Tables 2-5 shall be used.

16.2.2 When recording converted hardness numbers, the measured hardness and test scale shall be indicated in parentheses, for example: 353 HBW (38 HRC). This means that a hardness value of 38 was obtained using the Rockwell C scale and converted to a Brinell hardness of 353.

17. Brinell Test

17.1 Description:

17.1.1 A specified load is applied to a flat surface of the specimen to be tested, through a tungsten carbide ball of specified diameter. The average diameter of the indentation is used as a basis for calculation of the Brinell hardness number. The quotient of the applied load divided by the area of the surface of the indentation, which is assumed to be spherical, is termed the Brinell hardness number (HBW) in accordance with the following equation:

$$HBW = P/\left[\left(\pi D/2 \right) \left(D - \sqrt{D^2 - d^2} \right) \right] \tag{4}$$

where:

HBW = Brinell hardness number,

P = applied load, kgf,

D = diameter of the tungsten carbide ball, mm, and

d = average diameter of the indentation, mm.

Note 12—The Brinell hardness number is more conveniently secured from standard tables such as Table 6, which show numbers corresponding to the various indentation diameters, usually in increments of $0.05\,\mathrm{mm}$.

Note 13—In Test Method E10 the values are stated in SI units, whereas in this section kg/m units are used.

17.1.2 The standard Brinell test using a 10 mm tungsten carbide ball employs a 3000 kgf load for hard materials and a 1500 or 500 kgf load for thin sections or soft materials (see Annex A2 on Steel Tubular Products). Other loads and different size indentors may be used when specified. In recording hardness values, the diameter of the ball and the load must be stated except when a 10 mm ball and 3000 kgf load are used.

17.1.3 A range of hardness can properly be specified only for quenched and tempered or normalized and tempered material. For annealed material a maximum figure only should be specified. For normalized material a minimum or a maximum hardness may be specified by agreement. In general, no hardness requirements should be applied to untreated material.

17.1.4 Brinell hardness may be required when tensile properties are not specified.

17.2 Apparatus—Equipment shall meet the following requirements:

17.2.1 *Testing Machine*—A Brinell hardness testing machine is acceptable for use over a loading range within which its load measuring device is accurate to ± 1 %.

TABLE 2 Approximate Hardness Conversion Numbers for Nonaustenitic Steels^A (Rockwell C to Other Hardness Numbers)

Rockwell C		Drinoll	Knoon	Rockwell A		Rockwell Supe	rficial Hardness	
Scale, 150 kgf	Vickers	Brinell	Knoop	Scale, 60 kgf	15N Scale, 15	30N Scale 30	45N Scale, 45	Approximate
Load,	Hardness	Hardness	Hardness,	Load,	kgf Load,	kgf Load,	kgf Load,	Tensile
Diamond	Number	3000 kgf Load,	500 gf Load	Diamond	Diamond	Diamond	Diamond	Strength, ks
Penetrator		10 mm Ball	and Over	Penetrator	Penetrator	Penetrator	Penetrator	(MPa)
68	940		920	85.6	93.2	84.4	75.4	
67	900		895	85.0	92.9	83.6	74.2	
66	865		870	84.5	92.5	82.8	73.3	
		700						
65	832	739	846	83.9	92.2	81.9	72.0	
64	800	722	822	83.4	91.8	81.1	71.0	
63	772	706	799	82.8	91.4	80.1	69.9	
62	746	688	776	82.3	91.1	79.3	68.8	
61	720	670	754	81.8	90.7	78.4	67.7	
60	697	654	732	81.2	90.2	77.5	66.6	
59	674	634	710	80.7	89.8	76.6	65.5	351 (2420)
58	653	615	690	80.1	89.3	75.7	64.3	338 (2330)
57	633	595	670	79.6	88.9	74.8	63.2	325 (2240)
56	613	577	650	79.0	88.3	73.9	62.0	313 (2160)
55	595	560	630	78.5	87.9	73.0	60.9	301 (2070)
54	577	543	612	78.0	87.4	72.0	59.8	292 (2010)
53	560	525	594	77.4	86.9	71.2	58.6	283 (1950)
52	544	512	576	76.8	86.4	70.2	57.4	273 (1880)
51	528	496	558	76.3	85.9	69.4	56.1	264 (1820)
		482		76.3 75.9		68.5		, ,
50	513		542		85.5		55.0	255 (1760)
49	498	468	526	75.2	85.0	67.6	53.8	246 (1700)
48	484	455	510	74.7	84.5	66.7	52.5	238 (1640)
47	471	442	495	74.1	83.9	65.8	51.4	229 (1580)
46	458	432	480	73.6	83.5	64.8	50.3	221 (1520)
45	446	421	466	73.1	83.0	64.0	49.0	215 (1480)
44	434	409	452	72.5	82.5	63.1	47.8	208 (1430)
43	423	400	438	72.0	82.0	62.2	46.7	201 (1390)
42	412	390	426	71.5	81.5	61.3	45.5	194 (1340)
41	402	381	414	70.9	80.9	60.4	44.3	188 (1300)
40	392	371	402	70.4	80.4	59.5	43.1	182 (1250)
39	382	362	391	69.9	79.9	58.6	41.9	177 (1220)
38	372	353	380	69.4	79.4	57.7	40.8	171 (1180)
37	363	344	370	68.9	78.8	56.8	39.6	166 (1140)
36	354	336	360	68.4	78.3	55.9	38.4	161 (1110)
35	345	327	351	67.9	77.7	55.0	37.2	156 (1080)
34	336	319	342	67.4	77.2	54.2	36.1	152 (1050)
33	327	311	334	66.8	76.6	53.3	34.9	149 (1030)
		301						
32	318		326	66.3	76.1	52.1	33.7	146 (1010)
31	310	294	318	65.8	75.6	51.3	32.5	141 (970)
30	302	286	311	65.3	75.0	50.4	31.3	138 (950)
29	294	279	304	64.6	74.5	49.5	30.1	135 (930)
28	286	271	297	64.3	73.9	48.6	28.9	131 (900)
27	279	264	290	63.8	73.3	47.7	27.8	128 (880)
26	272	258	284	63.3	72.8	46.8	26.7	125 (860)
25	266	253	278	62.8	72.2	45.9	25.5	123 (850)
24	260	247	272	62.4	71.6	45.0	24.3	119 (820)
23	254	243	266	62.0	71.0	44.0	23.1	117 (810)
22	248	237	261	61.5	70.5	43.2	22.0	115 (790)
21	243	231	256	61.0	69.9	42.3	20.7	112 (770)
	_ 10	226	251	60.5	69.4	41.5	19.6	(,, 0)

^A This table gives the approximate interrelationships of hardness values and approximate tensile strength of steels. It is possible that steels of various compositions and processing histories will deviate in hardness-tensile strength relationship from the data presented in this table. The data in this table should not be used for austenitic stainless steels, but have been shown to be applicable for ferritic and martensitic stainless steels. The data in this table should not be used to establish a relationship between hardness values and tensile strength of hard drawn wire. Where more precise conversions are required, they should be developed specially for each steel composition, heat treatment, and part. Caution should be exercised if conversions from this table are used for the acceptance or rejection of product. The approximate interrelationships may affect acceptance or rejection.

17.2.2 Measuring Microscope—The divisions of the micrometer scale of the microscope or other measuring devices used for the measurement of the diameter of the indentations shall be such as to permit the direct measurement of the diameter to 0.1 mm and the estimation of the diameter to 0.05 mm.

Note 14—This requirement applies to the construction of the microscope only and is not a requirement for measurement of the indentation, see 17.4.3.

17.2.3 Standard Ball—The standard tungsten carbide ball for Brinell hardness testing is 10 mm (0.3937 in.) in diameter with a deviation from this value of not more than 0.005 mm (0.0002 in.) in any diameter. A tungsten carbide ball suitable for use must not show a permanent change in diameter greater than 0.01 mm (0.0004 in.) when pressed with a force of 3000 kgf against the test specimen. Steel ball indentors are no longer permitted for use in Brinell hardness testing in accordance with these test methods.

TABLE 3 Approximate Hardness Conversion Numbers for Nonaustenitic Steels^A (Rockwell B to Other Hardness Numbers)

Rockwell B						Rockwe	II Superficial H	Hardness	_
Scale, 100 kgf Load ½6- in. (1.588 mm) Ball	Vickers Hardness Number	Brinell Hardness, 300 kgf Load, 10 mm Ball	Knoop Hardness, 500 gf Load & Over	Rockwell A Scale, 60 kgf Load, Diamond Penetrator	Rockwell F Scale, 60 kgf Load, ½16-in. (1.588 mm) Ball	15T Scale, 15 kgf Load, ½16- in. (1.588 mm) Ball	30T Scale, 30 kgf Load, ½16- in. (1.588 mm) Ball	45T Scale, 45 kgf Load, ½16- in. (1.588 mm) Ball	Approximate Tensile Strength ksi (MPa)
100	240	240	251	61.5		93.1	83.1	72.9	116 (800)
99	234	234	246	60.9		92.8	82.5	71.9	114 (785)
98	228	228	241	60.2		92.5	81.8	70.9	109 (750)
97	222	222	236	59.5		92.1	81.1	69.9	104 (715)
96	216	216	231	58.9		91.8	80.4	68.9	102 (705)
95	210	210	226	58.3		91.5	79.8	67.9	100 (690)
94	205	205	221	57.6		91.2	79.1	66.9	98 (675)
93	200	200	216	57.0		90.8	78.4	65.9	94 (650)
92	195	195	211	56.4		90.5	77.8	64.8	92 (635)
91	190	190	206	55.8		90.2	77.1	63.8	90 (620)
90	185	185	201	55.2		89.9	76.4	62.8	89 (615)
89	180	180	196	54.6		89.5	75.8	61.8	88 (605)
88	176	176	192	54.0		89.2	75.1	60.8	86 (590)
87	172	172	188	53.4		88.9	74.4	59.8	84 (580)
86	169	169	184	52.8		88.6	73.8	58.8	83 (570)
85	165	165	180	52.3		88.2	73.1	57.8	82 (565)
84	162	162	176	51.7 51.1		87.9 97.6	72.4	56.8 55.9	81 (560)
83	159	159	173	51.1		87.6 97.2	71.8	55.8 54.9	80 (550)
82	156	156	170	50.6		87.3	71.1	54.8	77 (530)
81 80	153 150	153 150	167 164	50.0 49.5		86.9 86.6	70.4 69.7	53.8 52.8	73 (505) 72 (495)
79	147	147	161	48.9		86.3	69.1	52.6 51.8	, ,
79 78	144	144	158	48.4		86.0	68.4	50.8	70 (485) 69 (475)
76 77	141	141	155	47.9		85.6	67.7	49.8	68 (470)
76	139	139	152	47.3		85.3	67.1	48.8	67 (460)
75	137	137	150	46.8	99.6	85.0	66.4	47.8	66 (455)
73 74	135	135	147	46.3	99.1	84.7	65.7	46.8	65 (450)
73	132	132	145	45.8	98.5	84.3	65.1	45.8	64 (440)
73 72	130	130	143	45.3	98.0	84.0	64.4	44.8	63 (435)
71	127	127	141	44.8	97.4	83.7	63.7	43.8	62 (425)
70	125	125	139	44.3	96.8	83.4	63.1	42.8	61 (420)
69	123	123	137	43.8	96.2	83.0	62.4	41.8	60 (415)
68	121	121	135	43.3	95.6	82.7	61.7	40.8	59 (405)
67	119	119	133	42.8	95.1	82.4	61.0	39.8	58 (400)
66	117	117	131	42.3	94.5	82.1	60.4	38.7	57 (395)
65	116	116	129	41.8	93.9	81.8	59.7	37.7	56 (385)
64	114	114	127	41.4	93.4	81.4	59.0	36.7	
63	112	112	125	40.9	92.8	81.1	58.4	35.7	
62	110	110	124	40.4	92.2	80.8	57.7	34.7	
61	108	108	122	40.0	91.7	80.5	57.0	33.7	
60	107	107	120	39.5	91.1	80.1	56.4	32.7	
59	106	106	118	39.0	90.5	79.8	55.7	31.7	
58	104	104	117	38.6	90.0	79.5	55.0	30.7	
57	103	103	115	38.1	89.4	79.2	54.4	29.7	
56	101	101	114	37.7	88.8	78.8	53.7	28.7	
55	100	100	112	37.2	88.2	78.5	53.0	27.7	
54			111	36.8	87.7	78.2	52.4	26.7	
53			110	36.3	87.1	77.9	51.7	25.7	
52			109	35.9	86.5	77.5	51.0	24.7	
51			108	35.5	86.0	77.2	50.3	23.7	
50			107	35.0	85.4	76.9	49.7	22.7	
49			106	34.6	84.8	76.6	49.0	21.7	
48			105	34.1	84.3	76.2	48.3	20.7	
47			104	33.7	83.7	75.9	47.7	19.7	
46			103	33.3	83.1	75.6	47.0	18.7	
45			102	32.9	82.6	75.3	46.3	17.7	
44			101	32.4	82.0	74.9	45.7	16.7	
43			100	32.0	81.4	74.6	45.0	15.7	
42			99	31.6	80.8	74.3	44.3	14.7	
41			98	31.2	80.3	74.0	43.7	13.6	
40			97	30.7	79.7	73.6	43.0	12.6	
39			96	30.3	79.1	73.3	42.3	11.6	
38			95	29.9	78.6	73.0	41.6	10.6	
37			94	29.5	78.0	72.7	41.0	9.6	
			93	29.1	77.4	72.3	40.3	8.6	
36 35									
35			92	28.7	76.9	72.0 71.7	39.6	7.6	
		• • •	92 91 90	28.7 28.2 27.8	76.9 76.3 75.7	71.7 71.4	39.0 38.3	6.6 5.6	• • • • • • • • • • • • • • • • • • • •

TABLE 3 Continued

Rockwell B						Rockwe	II Superficial H	Hardness	
Scale, 100 kgf Load ¹ / ₁₆ - in. (1.588 mm) Ball	Vickers Hardness Number	Brinell Hardness, 300 kgf Load, 10 mm Ball	Knoop Hardness, 500 gf Load & Over	Rockwell A Scale, 60 kgf Load, Diamond Penetrator	Rockwell F Scale, 60 kgf Load, 1/16-in. (1.588 mm) Ball	15T Scale, 15 kgf Load, ½16- in. (1.588 mm) Ball	30T Scale, 30 kgf Load, ½16- in. (1.588 mm) Ball	45T Scale, 45 kgf Load, ½16- in. (1.588 mm) Ball	Approximate Tensile Strength ksi (MPa)
31			88	27.0	74.6	70.7	37.0	3.6	
30			87	26.6	74.0	70.4	36.3	2.6	

^A This table gives the approximate interrelationships of hardness values and approximate tensile strength of steels. It is possible that steels of various compositions and processing histories will deviate in hardness-tensile strength relationship from the data presented in this table. The data in this table should not be used for austenitic stainless steels, but have been shown to be applicable for ferritic and martensitic stainless steels. The data in this table should not be used to establish a relationship between hardness values and tensile strength of hard drawn wire. Where more precise conversions are required, they should be developed specially for each steel composition, heat treatment, and part.

TABLE 4 Approximate Hardness Conversion Numbers for Austenitic Steels (Rockwell C to other Hardness Numbers)

Rockwell C Scale, 150 kgf	Rockwell A Scale, 60 kgf	Rockwell Superficial Hardness									
Load, Diamond Penetrator	Load, Diamond Penetrator	15N Scale, 15 kgf Load, Diamond Penetrator	30N Scale, 30 kgf Load, Diamond Penetrator	45N Scale, 45 kgf Load, Diamond Penetrator							
48	74.4	84.1	66.2	52.1							
47	73.9	83.6	65.3	50.9							
46	73.4	83.1	64.5	49.8							
45	72.9	82.6	63.6	48.7							
44	72.4	82.1	62.7	47.5							
43	71.9	81.6	61.8	46.4							
42	71.4	81.0	61.0	45.2							
41	70.9	80.5	60.1	44.1							
40	70.4	80.0	59.2	43.0							
39	69.9	79.5	58.4	41.8							
38	69.3	79.0	57.5	40.7							
37	68.8	78.5	56.6	39.6							
36	68.3	78.0	55.7	38.4							
35	67.8	77.5	54.9	37.3							
34	67.3	77.0	54.0	36.1							
33	66.8	76.5	53.1	35.0							
32	66.3	75.9	52.3	33.9							
31	65.8	75.4	51.4	32.7							
30	65.3	74.9	50.5	31.6							
29	64.8	74.4	49.6	30.4							
28	64.3	73.9	48.8	29.3							
27	63.8	73.4	47.9	28.2							
26	63.3	72.9	47.0	27.0							
25	62.8	72.4	46.2	25.9							
24	62.3	71.9	45.3	24.8							
23	61.8	71.3	44.4	23.6							
22	61.3	70.8	43.5	22.5							
21	60.8	70.3	42.7	21.3							
20	60.3	69.8	41.8	20.2							

17.3 Test Specimen—Brinell hardness tests are made on prepared areas and sufficient metal must be removed from the surface to eliminate decarburized metal and other surface irregularities. The thickness of the piece tested must be such that no bulge or other marking showing the effect of the load appears on the side of the piece opposite the indentation.

17.4 Procedure:

17.4.1 It is essential that the applicable product specifications state clearly the position at which Brinell hardness indentations are to be made and the number of such indentations required. The distance of the center of the indentation from the edge of the specimen or edge of another indentation must be at least two and one-half times the diameter of the indentation.

- 17.4.2 Apply the load for 10 to 15 s.
- 17.4.3 Measure diameters of the indentation in accordance with Test Method E10.
- 17.4.4 The Brinell hardness test is not recommended for materials above 650 HBW.
- 17.4.4.1 If a ball is used in a test of a specimen which shows a Brinell hardness number greater than the limit for the ball as detailed in 17.4.4, the ball shall be either discarded and replaced with a new ball or remeasured to ensure conformance with the requirements of Test Method E10.

17.5 Brinell Hardness Values:

17.5.1 Brinell hardness values shall not be designated by a number alone because it is necessary to indicate which indenter and which force has been employed in making the test. Brinell

Rockwell B				Roc	kwell Superficial Hard	Iness
Scale, 100 kgf Load, 1/16- in. (1.588 mm) Ball	Brinell Indentation Diameter, mm	Brinell Hardness, 3000 kgf Load, 10 mm Ball	Rockwell A Scale, 60 kgf Load, Diamond Penetrator	15T Scale, 15 kgf Load, 1/16-in. (1.588 mm) Ball	30T Scale, 30 kgf Load, 1/16-in. (1.588 mm) Ball	45T Scale, 45 kgf Load, ½16-in. (1.588 mm) Ball
100	3.79	256	61.5	91.5	80.4	70.2
99	3.85	248	60.9	91.2	79.7	69.2
98	3.91	240	60.3	90.8	79.0	68.2
97	3.96	233	59.7	90.4	78.3	67.2
96	4.02	226	59.1	90.1	77.7	66.1
95	4.08	219	58.5	89.7	77.0	65.1
94	4.14	213	58.0	89.3	76.3	64.1
93	4.20	207	57.4	88.9	75.6	63.1
92	4.24	202	56.8	88.6	74.9	62.1
91	4.30	197	56.2	88.2	74.2	61.1
90	4.35	192	55.6	87.8	73.5	60.1
89	4.40	187	55.0	87.5	72.8	59.0
88	4.45	183	54.5	87.1	72.1	58.0
87	4.51	178	53.9	86.7	71.4	57.0
86	4.55	174	53.3	86.4	70.7	56.0
85	4.60	170	52.7	86.0	70.0	55.0
84	4.65	167	52.1	85.6	69.3	54.0
83	4.70	163	51.5	85.2	68.6	52.9
82	4.74	160	50.9	84.9	67.9	51.9
81	4.79	156	50.4	84.5	67.2	50.9
80	4.84	153	49.8	84.1	66.5	49.9

TABLE 5 Approximate Hardness Conversion Numbers for Austenitic Steels (Rockwell B to other Hardness Numbers)

hardness numbers shall be followed by the symbol HBW, and be supplemented by an index indicating the test conditions in the following order:

17.5.1.1 Diameter of the ball, mm,

17.5.1.2 A value representing the applied load, kgf, and,

17.5.1.3 The applied force dwell time, s, if other than 10 to 15 s.

17.5.1.4 The only exception to the above requirement is for the HBW 10/3000 scale when a 10 to 15 s dwell time is used. Only in the case of this one Brinell hardness scale may the designation be reported simply as HBW.

17.5.1.5 *Examples:* 220 HBW = Brinell hardness of 220 determined with a ball of 10 mm diameter and with a test force of 3000 kgf applied for 10 to 15 s; 350 HBW 5/1500 = Brinell hardness of 350 determined with a ball of 5 mm diameter and with a test force of 1500 kgf applied for 10 to 15 s.

17.6 *Detailed Procedure*—For detailed requirements of this test, reference shall be made to the latest revision of Test Method E10.

18. Rockwell Test

18.1 Description:

18.1.1 In this test a hardness value is obtained by determining the depth of penetration of a diamond point or a tungsten carbide ball into the specimen under certain arbitrarily fixed conditions. A minor load of 10 kgf is first applied which causes an initial penetration, sets the penetrator on the material and holds it in position. A major load which depends on the scale being used is applied increasing the depth of indentation. The major load is removed and, with the minor load still acting, the Rockwell number, which is proportional to the difference in penetration between the major and minor loads is determined; this is usually done by the machine and shows on a dial, digital

display, printer, or other device. This is an arbitrary number which increases with increasing hardness. The scales most frequently used are as follows:

Scale Symbol	<u>Penetrator</u>	<u>Major</u> Load, kgf	Minor Load, kgf
В	1/16-in. tungsten carbide ball	100	10
C	Diamond brale	150	10

18.1.2 Rockwell superficial hardness machines are used for the testing of very thin steel or thin surface layers. Loads of 15, 30, or 45 kgf are applied on a tungsten carbide (or a hardened steel) ball or diamond penetrator, to cover the same range of hardness values as for the heavier loads. Use of a hardened steel ball is permitted only for testing thin sheet tin mill products as found in Specifications A623 and A623M using HR15T and HR30T scales with a diamond spot anvil. (Testing of this product using a tungsten carbide indenter may give significantly different results as compared to historical test data obtained using a hardened steel ball.) The superficial hardness scales are as follows:

<u>Scale</u> Symbol	<u>Penetrator</u>	<u>Major</u> Load, kgf	<u>Minor</u> Load, kgf
15T	1/16-in. tungsten carbide or steel ball	15	3
30T	1/16-in. tungsten carbide or steel ball	30	3
45T	1/16-in. tungsten carbide ball	45	3
15N	Diamond brale	15	3
30N	Diamond brale	30	3
45N	Diamond brale	45	3

18.2 *Reporting Hardness*—In recording hardness values, the hardness number shall always precede the scale symbol, for example: 96 HRBW, 40 HRC, 75 HR15N, 56 HR30TS, or 77 HR30TW. The suffix *W* indicates use of a tungsten carbide ball. The suffix *S* indicates use of a hardened steel ball as permitted in 18.1.2.

TABLE 6 Brinell Hardness Numbers^A (Ball 10 mm in Diameter, Applied Loads of 500, 1500, and 3000 kgf)

				(Ball 10 mm				oads of 500							
Diameter	Br	inell Har Numbe		Diameter	Br	inell Haı Numb		Diameter	Bri	inell Har Numb		Diameter	Br	inell Har Numbe	
of Indenta-	500-	1500-	3000-	– of Indenta-	500-	1500-	3000-	- of Indenta-	500-	1500-	3000-	- of Indenta-	500-	1500-	3000-
tion, mm	kgf	kgf	kgf	tion, mm	kgf	kgf	kgf	tion, mm	kgf	kgf	kgf	tion, mm	kgf	kgf	kgf
	Load	Load	Load	,	Load	Load	Load		Load	Load	Load		Load	Load	Load
2.00	158	473	945	3.25	58.6	176	352	4.50	29.8	89.3	179	5.75	17.5	52.5	105
2.01	156	468	936	3.26	58.3	175	350	4.51	29.6	88.8	178	5.76	17.4	52.3	105
2.02	154	463	926	3.27	57.9	174	347	4.52	29.5	88.4	177	5.77	17.4	52.1	104
2.03	153	459	917	3.28	57.5	173	345	4.53	29.3	88.0	176	5.78	17.3	51.9	104
2.04	151	454	908	3.29	57.2	172	343	4.54	29.2	87.6	175	5.79	17.2	51.7	103
2.05	150	450	899	3.30	56.8	170	341	4.55	29.1	87.2	174	5.80	17.2	51.5	103
2.06	148	445	890	3.31	56.5	169	339	4.56	28.9	86.8	174	5.81	17.1	51.3	103
2.07 2.08	147 146	441 437	882 873	3.32 3.33	56.1 55.8	168 167	337 335	4.57 4.58	28.8 28.7	86.4 86.0	173 172	5.82 5.83	17.0 17.0	51.1 50.9	102 102
2.09	144	432	865	3.34	55.4	166	333	4.59	28.5	85.6	172	5.84	16.9	50.9	102
2.10	143	428	856	3.35	55.1	165	331	4.60	28.4	85.4	170	5.85	16.8	50.5	101
2.11	141	424	848	3.36	54.8	164	329	4.61	28.3	84.8	170	5.86	16.8	50.3	101
2.12	140	420	840	3.37	54.4	163	326	4.62	28.1	84.4	169	5.87	16.7	50.2	100
2.13	139	416	832	3.38	54.1	162	325	4.63	28.0	84.0	168	5.88	16.7	50.0	99.9
2.14	137	412	824	3.39	53.8	161	323	4.64	27.9	83.6	167	5.89	16.6	49.8	99.5
2.15	136	408	817	3.40	53.4	160	321	4.65	27.8	83.3	167	5.90	16.5	49.6	99.2
2.16	135	404	809	3.41	53.1	159	319	4.66	27.6	82.9	166	5.91	16.5	49.4	98.8
2.17	134	401	802	3.42	52.8	158	317	4.67	27.5	82.5	165	5.92	16.4	49.2	98.4
2.18	132	397	794	3.43	52.5	157	315	4.68	27.4	82.1	164	5.93	16.3	49.0	98.0
2.19	131	393	787	3.44	52.2	156	313	4.69	27.3	81.8	164	5.94	16.3	48.8	97.7
2.20	130	390	780	3.45	51.8	156	311	4.70	27.1	81.4	163	5.95	16.2	48.7	97.3
2.21	129	386	772	3.46	51.5	155	309	4.71	27.0	81.0	162	5.96	16.2	48.5	96.9
2.22	128	383	765 750	3.47	51.2	154	307	4.72	26.9	80.7	161	5.97	16.1	48.3	96.6
2.23 2.24	126 125	379 376	758 752	3.48 3.49	50.9 50.6	153 152	306 304	4.73 4.74	26.8	80.3 79.9	161 160	5.98 5.99	16.0 16.0	48.1 47.9	96.2 95.9
2.24	125	370 372	752 745	3.49	50.6	151	304	4.74	26.6 26.5	79.9	159	6.00	15.9	47.9 47.7	95.9
2.26	123	369	743 738	3.51	50.0	150	302	4.75	26.4	79.0	158	6.01	15.9	47.7	95.1
2.27	122	366	732	3.52	49.7	149	298	4.77	26.3	78.9	158	6.02	15.8	47.4	94.8
2.28	121	363	725	3.53	49.4	148	297	4.78	26.2	78.5	157	6.03	15.7	47.2	94.4
2.29	120	359	719	3.54	49.2	147	295	4.79	26.1	78.2	156	6.04	15.7	47.0	94.1
2.30	119	356	712	3.55	48.9	147	293	4.80	25.9	77.8	156	6.05	15.6	46.8	93.7
2.31	118	353	706	3.56	48.6	146	292	4.81	25.8	77.5	155	6.06	15.6	46.7	93.4
2.32	117	350	700	3.57	48.3	145	290	4.82	25.7	77.1	154	6.07	15.5	46.5	93.0
2.33	116	347	694	3.58	48.0	144	288	4.83	25.6	76.8	154	6.08	15.4	46.3	92.7
2.34	115	344	688	3.59	47.7	143	286	4.84	25.5	76.4	153	6.09	15.4	46.2	92.3
2.35	114	341	682	3.60	47.5	142	285	4.85	25.4	76.1	152	6.10	15.3	46.0	92.0
2.36	113	338	676	3.61	47.2	142	283	4.86	25.3	75.8	152	6.11	15.3	45.8	91.7
2.37	112	335	670	3.62	46.9	141	282	4.87	25.1	75.4	151	6.12	15.2	45.7	91.3
2.38	111	332	665	3.63	46.7	140	280	4.88	25.0	75.1	150	6.13	15.2	45.5	91.0
2.39	110 109	330 327	659 653	3.64 3.65	46.4 46.1	139 138	278 277	4.89 4.90	24.9 24.8	74.8 74.4	150 149	6.14 6.15	15.1 15.1	45.3 45.2	90.6 90.3
2.40 2.41	109	321 324	648	3.66	45.9	138	275	4.90	24.6	74.4	149	6.16	15.1	45.2	90.3
2.42	107	322	643	3.67	45.6	137	273	4.92	24.7	73.8	148	6.17	14.9	44.8	89.6
2.42	106	319	637	3.68	45.4	136	272	4.93	24.5	73.5	147	6.18	14.9	44.7	89.3
2.44	105	316	632	3.69	45.1	135	271	4.94	24.4	73.2	146	6.19	14.8	44.5	89.0
2.45	104	313	627	3.70	44.9	135	269	4.95	24.3	72.8	146	6.20	14.7	44.3	88.7
2.46	104	311	621	3.71	44.6	134	268	4.96	24.2	72.5	145	6.21	14.7	44.2	88.3
2.47	103	308	616	3.72	44.4	133	266	4.97	24.1	72.2	144	6.22	14.7	44.0	88.0
2.48	102	306	611	3.73	44.1	132	265	4.98	24.0	71.9	144	6.23	14.6	43.8	87.7
2.49	101	303	606	3.74	43.9	132	263	4.99	23.9	71.6	143	6.24	14.6	43.7	87.4
2.50	100	301	601	3.75	43.6	131	262	5.00	23.8	71.3	143	6.25	14.5	43.5	87.1
2.51	99.4	298	597	3.76	43.4	130	260	5.01	23.7	71.0	142	6.26	14.5	43.4	86.7
2.52	98.6	296	592	3.77	43.1	129	259	5.02	23.6	70.7	141	6.27	14.4	43.2	86.4
2.53	97.8	294	587	3.78	42.9	129	257	5.03	23.5	70.4	141	6.28	14.4	43.1	86.1
2.54	97.1	291	582	3.79	42.7	128	256	5.04	23.4	70.1	140	6.29	14.3	42.9	85.8
2.55	96.3	289	578	3.80	42.4	127	255	5.05	23.3	69.8	140	6.30	14.2	42.7	85.5
2.56	95.5	287	573	3.81	42.2	127	253	5.06	23.2	69.5	139	6.31	14.2	42.6	85.2
2.57 2.58	94.8 94.0	284 282	569 564	3.82 3.83	42.0 41.7	126 125	252 250	5.07 5.08	23.1 23.0	69.2 68.9	138	6.32 6.33	14.1 14.1	42.4 42.3	84.9 84.6
2.58	93.3	282	564 560	3.83	41.7	125	250 249	5.08	22.9	68.6	138 137	6.34	14.1 14.0	42.3 42.1	84.6
2.60	92.6	278	555	3.85	41.3	123	249	5.10	22.8	68.3	137	6.35	14.0	42.1	84.0
2.61	91.8	276	551	3.86	41.1	123	246	5.10	22.7	68.0	136	6.36	13.9	41.8	83.7
2.62	91.1	273	547	3.87	40.9	123	245	5.11	22.6	67.7	135	6.37	13.9	41.7	83.4
2.63	90.4	271	543	3.88	40.6	122	244	5.12	22.5	67.4	135	6.38	13.8	41.5	83.1
2.64	89.7	269	538	3.89	40.4	121	242	5.14	22.4	67.1	134	6.39	13.8	41.4	82.8
2.65	89.0	267	534	3.90	40.2	121	241	5.15	22.3	66.9	134	6.40	13.7	41.2	82.5
	88.4	265	530	3.91	40.0	120	240	5.16	22.2	66.6	133	6.41	13.7	41.1	82.2
2.66															
2.66 2.67	87.7	263	526	3.92	39.8	119	239	5.17	22.1	66.3	133	6.42	13.6	40.9	81.9
		263 261	526 522	3.92 3.93	39.8 39.6	119 119	239 237	5.17 5.18	22.1 22.0	66.3 66.0	133 132	6.42 6.43	13.6 13.6	40.9 40.8	81.9 81.6

TABLE 6 Continued

Orange O		Br			Diameter	Br			Diameter	Br			Diameter	Bı		
Indental Sop. 1500 3000 Indental				er												
		500-	1500-	3000-		500-	1500-	3000-		500-	1500-	3000-		500-	1500-	3000-
Coad	tion, mm	kgf	kgf	kgf		kgf	kgf	kgf		kgf	kgf	kgf		kgf	kgf	kgf
2.71 85.1 255 510 3.96 88.9 117 224 5.21 21.7 66.2 130 6.46 13.4 40.4 8 2.72 88.4 253 507 3.97 88.7 116 232 5.22 21.6 64.7 129 6.48 13.4 40.1 8 2.73 88.8 251 503 3.98 88.5 116 231 5.23 21.6 64.7 129 6.48 13.4 40.1 8 2.74 83.2 250 499 3.99 38.3 115 230 5.24 21.5 64.4 129 6.49 13.3 39.9 8 2.75 82.6 248 495 4.00 88.1 114 229 5.25 21.4 64.1 128 6.50 13.3 39.8 8 2.76 81.9 246 492 4.01 37.9 114 228 5.26 21.3 63.9 128 6.51 13.2 39.6 2 2.77 81.3 244 488 4.02 37.7 113 226 5.27 21.2 63.6 127 6.52 13.2 39.6 2 2.78 80.8 242 485 4.03 37.5 113 225 5.28 21.1 63.3 127 6.53 13.1 39.4 2 2.79 80.2 240 481 4.04 37.3 112 224 5.29 21.0 63.1 126 6.54 13.1 39.4 2 2.80 79.6 239 477 4.05 37.1 111 223 5.31 2.09 62.6 125 6.55 13.0 39.1 2 2.81 79.0 237 474 4.06 37.0 111 223 5.31 2.09 62.6 125 6.55 13.0 39.1 2 2.82 78.4 255 471 4.07 36.8 110 221 5.31 2.09 62.6 125 6.55 13.0 39.9 7 2.84 77.3 222 447 4.08 36.6 110 221 5.33 2.00 82.3 12.5 6.57 12.9 38.8 7 2.84 77.3 222 447 4.1 4.08 36.6 110 221 5.33 2.00 82.3 12.5 6.57 12.9 38.8 7 2.84 77.3 222 447 4.1 4.08 36.6 110 219 5.33 2.07 62.1 124 6.59 12.9 38.7 7 2.84 77.3 222 447 4.1 4.1 35.2 10.8 21.6 1.5 12.2 3.6 6.5 12.2 3.8 3.9 7 2.85 77.8 220 447 4.1 4.1 35.2 10.8 21.6 1.5 12.2 3.6 6.5 12.2 3.8 3.9 7 2.86 77.8 2.20 447 4.1 4.1 35.7 107 214 5.38 2.05 61.8 12.2 6.6 1.5 12.2 3.8 3.8 7 2.88 75.1 225 444 444 4.1 35.5 106 212 5.4 2.0 2.0 60.8 12.2 6.6 1.5 12.2 3.8 3.7 7 2.29 73.0 219 438 4.1 4.0 35.1 106 212 5.4 2.0 2.0 60.8 12.2 6.6 6.5 12.2 3.8 3.7 7 2.29 73.0 219 438 4.1 4.1 35.7 107 214 5.38 2.05 61.8 12.2 6.6 6.6 1.2 2.3 3.8 3.7 7 2.29 73.0 219 438 4.1 4.0 35.1 106 212 5.4 2.0 2.0 60.8 12.2 6.6 6.7 12.5 3.6 3.9 1.0 2.2 1.2 6.6 6.5 12.2 3.8 3.7 7 2.29 73.0 219 438 4.1 4.0 35.5 10.6 212 5.4 2.0 2.0 60.8 12.1 6.6 6.6 12.2 3.7 7 2.29 73.0 219 438 4.1 4.1 35.7 107 214 5.38 2.05 61.8 12.9 6.6 6.6 1.2 2.3 6.6 1.2 3.7 7 2.29 73.0 219 438 4.1 4.0 35.5 106 212 5.4 2.0 2.0 60.8 12.1 6.6 6.6 1.2 2.3 6.6 1.2 2.3 6.6 1.2 2.3 6.6 1.2 2.3 6.6 1.2 2.3 6.6 1.2 2.3 6.6 1.2 2.3 6.6 1.2 2.3 6.6 1.2 2.3 6.6 1.2 2.3 6.		Load	Load	Load	,	Load	Load	Load	,	Load	Load	Load	,	Load	Load	Load
2.72 84.4 253 507 39.7 88.7 116 232 5.22 21.6 64.9 130 6.47 13.4 40.2 8 2.74 83.2 250 499 3.99 38.5 116 231 5.23 21.6 64.7 129 6.48 13.3 49.9 1 2.75 82.6 248 495 400 38.1 114 229 5.25 21.4 64.1 129 6.49 13.3 39.9 7 2.76 81.9 246 495 400 38.1 114 229 5.25 21.4 64.1 128 6.50 13.3 39.8 6.7 2.77 81.3 244 488 402 37.7 113 226 5.26 21.3 63.9 128 6.51 13.2 39.5 7 2.78 80.8 242 485 403 37.5 113 225 5.28 21.1 63.3 127 6.52 13.2 39.5 7 2.78 80.8 242 485 40.3 37.5 113 225 5.28 21.1 63.3 127 6.53 13.1 39.4 2 2.80 79.6 239 477 4.06 37.0 111 222 5.20 5.28 21.1 63.3 127 6.55 13.0 39.1 2 2.81 79.0 237 474 4.06 37.0 111 222 5.31 2.09 62.6 125 6.56 13.0 38.9 1 2.82 77.9 234 467 4.08 36.6 110 221 5.32 2.08 62.3 125 6.57 12.9 38.8 2 2.84 77.3 232 464 4.09 36.4 109 218 5.34 2.06 61.8 124 6.59 12.8 38.5 2 2.86 78.8 230 461 4.10 36.2 109 217 5.35 2.05 61.5 12.3 6.60 12.8 38.5 2 2.86 78.2 229 457 4.11 36.0 108 216 5.36 20.4 61.3 123 6.61 12.2 83.4 2 2.86 75.7 224 448 414 35.5 108 216 5.57 2.2 20.8 62.3 125 6.57 12.9 38.5 2 2.87 75.1 225 444 4.11 36.2 109 217 5.35 20.5 61.5 12.3 6.60 12.8 38.4 2 2.88 75.1 225 451 4.13 35.7 107 214 5.38 20.3 61.0 12.2 66.6 12.2 66.6 12.2 3.6 6.0 12.2 83.4 2 2.89 77.6 224 448 4.14 35.5 106 215 5.37 2.03 61.0 12.2 66.6 12.2 3.6 6.0 12.2 83.4 2 2.89 77.1 224 448 4.14 3.55 106 215 5.37 2.03 61.0 12.2 66.6 12.2 3.6 6.0 12.2 3.8 6.0 12.2 8 2.89 75.1 225 451 4.13 35.8 108 215 5.37 2.03 61.0 12.2 66.6 12.2 3.6 6.0 12.2 3.8 6	2.70	85.7	257	514	3.95	39.1	117	235	5.20	21.8	65.5	131	6.45	13.5	40.5	81.0
2.73 83.8 251 503 39.8 38.5 116 221 5.24 21.5 64.4 129 6.48 13.3 39.9 2.75 82.6 248 495 400 38.1 115 229 5.25 21.4 64.1 128 6.50 13.3 39.9 8.7 2.76 81.9 246 492 401 37.7 113 226 5.26 21.3 63.9 128 6.51 13.2 39.9 2.7 2.78 80.8 242 485 40.3 37.5 113 226 5.28 21.1 63.3 127 6.53 13.1 39.9 2.28 27.9 80.2 240 481 4.04 40.4 37.3 111 224 5.29 21.0 63.1 126 6.55 13.0 39.9 2.28 2.7 8.2 2.8 7.7 8.2 4.8 35.7 4.0 4.8 13.6 4.1 4.0	2.71	85.1	255	510	3.96	38.9	117	234	5.21	21.7	65.2	130	6.46	13.4	40.4	80.7
2.73 8.8 8 251 503 3.98 38.5 116 221 5.24 21.5 64.4 129 6.48 13.3 39.9 2.75 82.6 248 495 400 38.1 115 229 5.25 21.4 64.1 128 6.50 13.3 39.9 8.7 2.76 81.9 246 492 401 37.9 114 228 5.25 21.3 63.9 128 6.51 13.2 39.9 2.7 2.78 80.8 242 485 403 37.5 113 226 5.28 21.1 63.3 127 6.53 13.1 39.9 2.28 27.9 80.2 240 481 4.04 37.3 111 224 5.29 21.0 63.1 126 6.55 13.0 39.1 2.28 7.7 6.23 13.0 39.9 2.28 2.7 6.2 2.8 7.7 4.2 4.8 4.9 4.0 <td< td=""><td>2.72</td><td>84.4</td><td></td><td>507</td><td>3.97</td><td></td><td>116</td><td></td><td></td><td>21.6</td><td>64.9</td><td>130</td><td>6.47</td><td>13.4</td><td>40.2</td><td>80.4</td></td<>	2.72	84.4		507	3.97		116			21.6	64.9	130	6.47	13.4	40.2	80.4
2.74 82.2 250 499 3.99 38.3 115 230 5.24 21.5 64.4 129 6.49 13.3 39.9 2.2 6.7 68.19 246 492 4.01 37.9 114 229 5.25 21.4 64.1 128 6.50 13.3 39.9 2.2 6.7 68.19 246 492 4.01 37.9 114 228 5.26 21.3 63.9 128 6.51 13.2 39.6 7.2 6.7 6.7 6.7 6.7 6.7 6.7 6.7 6.7 6.7 6.7		83.8		503			116				64.7					80.1
2.75 82.6 248 495 4.00 38.1 114 229 5.25 21.3 63.9 126 6.51 13.2 39.6 7 2.77 81.3 244 488 4.02 37.7 113 225 5.26 21.2 63.6 127 6.52 13.2 39.6 7 2.78 80.8 242 481 4.04 37.3 112 225 5.28 21.1 63.3 127 6.53 13.1 39.6 2 2.29 79.6 239 474 4.06 37.0 111 223 5.30 20.9 62.6 125 6.56 13.0 38.9 7 2.81 79.0 237 474 4.06 37.0 111 222 5.31 20.9 62.6 125 6.56 13.0 38.9 7 2.28 7.73 232 461 4.06 39.6 1.0 2.21 5.33 20.7 62.1 124 <td></td> <td>79.8</td>																79.8
2.76 81.9 246 492 4.01 37.9 114 228 5.26 21.3 63.9 128 6.51 13.2 39.6 7 2.78 80.8 242 485 4.02 37.7 113 226 5.27 21.2 63.6 127 6.52 13.2 39.5 7 2.78 80.8 242 485 4.03 37.5 113 225 5.28 21.1 63.3 127 6.53 13.1 39.4 7 2.80 79.6 239 477 4.06 37.1 111 223 5.30 20.9 62.8 126 6.55 13.0 39.1 7 2.81 79.0 237 474 4.06 37.1 111 223 5.30 20.9 62.8 126 6.55 13.0 39.1 7 2.81 79.0 237 474 4.06 37.1 111 223 5.30 20.9 62.8 126 6.55 13.0 39.1 7 2.81 79.0 237 474 4.06 37.0 111 223 5.30 20.9 62.8 126 6.55 13.0 39.9 7 2.82 78.4 235 471 4.07 36.8 110 221 5.32 20.8 62.3 125 6.57 12.9 38.8 7 2.83 77.9 234 467 4.08 36.6 110 219 5.33 20.7 62.1 124 6.58 12.9 36.7 12.9 38.8 7 2.84 77.3 232 464 4.09 36.4 109 218 5.34 20.6 61.8 124 6.59 12.8 38.5 1 2.85 76.8 230 461 4.10 36.2 109 217 5.35 20.5 61.5 123 6.60 12.8 38.4 1 2.86 76.2 229 457 4.11 36.0 108 216 5.36 20.4 61.3 123 6.61 12.8 38.3 1 2.87 75.7 227 454 4.12 35.8 108 215 5.37 20.3 61.0 122 6.62 12.7 38.0 1 2.89 74.6 224 448 4.14 35.5 106 213 5.39 20.2 60.8 122 6.63 12.7 38.0 1 2.29 74.6 224 448 4.14 35.5 106 213 5.39 20.2 60.6 121 6.63 12.7 38.0 1 2.29 73.0 219 438 4.17 34.9 105 210 5.42 19.9 59.8 120 6.67 12.6 6.5 37.9 1 2.20 74.1 222 444 4.16 35.1 105 211 5.41 20.0 60.1 120 6.65 12.6 37.7 1 2.20 77.5 22 244 23 4.2 4.19 34.6 104 20.9 5.44 13.9 59.8 120 6.67 12.5 37.5 1 2.20 77.5 212 423 4.2 4.19 34.6 104 20.9 5.44 13.8 59.3 119 6.69 12.4 37.3 1 2.20 77.5 212 423 4.2 4.19 34.6 104 20.9 5.44 13.8 59.3 119 6.69 12.4 37.3 2 2.20 77.0 213 426 4.21 34.2 103 20.5 5.45 13.5 58.4 117 6.73 12.2 36.6 1 2.20 77.5 212 423 4.2 4.19 34.6 104 20.9 5.44 13.8 59.3 119 6.69 12.4 37.3 3.0 6.6 1.2 3.3 3.9 10.2 20.3 5.48 13.5 58.4 117 6.73 12.2 36.6 1 2.20 77.0 213 426 4.21 34.2 103 20.5 5.45 13.5 58.4 117 6.73 12.2 36.9 1 2.20 77.5 212 423 4.22 34.1 103 20.5 5.49 13.5 58.4 117 6.73 12.2 36.9 1 2.20 77.5 212 423 32.9 4.20 34.1 13.2 30.5 5.5 113.5 58.4 117 6.73 12.2 36.9 1 3.00 66.1 120 420 420 34.3 10.0 20.5 5.50 13.5 59.8 119 6.69 12.4 37.3 3.0 5.7 1 3.00 66.6 13.9 39.9 4.2 3.3 1.9 5.5 11.5 5.5 111 6.60 6																79.6
2.77 81.3 244 488 4.02 37.7 113 226 5.27 21.2 63.6 127 6.52 13.2 39.5 7 2.78 80.8 242 485 4.03 37.5 113 225 5.28 21.1 63.3 127 6.53 13.1 39.2 7 2.79 80.22 240 481 4.04 37.3 112 224 5.29 21.0 63.1 126 6.54 13.1 39.2 7 2.80 79.6 239 477 4.05 37.1 111 223 5.30 2.9 62.8 126 6.55 13.0 39.1 7 2.81 79.0 237 474 4.06 37.0 111 222 5.31 2.9 6.26 125 6.56 13.0 38.9 1 2.82 78.4 235 471 4.07 36.8 110 221 5.32 2.08 62.3 125 6.57 12.9 38.8 1 2.83 77.9 234 487 4.08 36.6 110 219 5.33 20.7 62.1 124 6.58 12.9 38.7 1 2.84 77.3 232 464 4.09 36.4 109 218 5.34 20.6 61.8 124 6.59 12.8 36.5 1 2.85 76.8 230 481 4.10 36.2 109 217 5.35 20.5 61.5 123 6.60 12.8 36.5 1 2.86 76.2 229 457 4.11 36.0 108 216 5.36 20.4 61.3 123 6.60 12.8 38.3 1 2.86 75.1 227 454 4.12 35.8 108 215 5.37 20.3 61.0 122 6.62 12.7 38.1 1 2.88 77.1 227 444 4.14 35.5 106 213 5.39 20.2 60.6 121 6.64 12.6 37.7 1 2.89 77.1 222 444 4.15 35.3 106 212 5.40 20.1 60.3 121 6.65 12.6 37.7 1 2.90 74.1 222 444 4.16 35.1 105 211 5.41 20.0 60.1 120 6.65 12.6 37.7 1 2.91 73.6 221 441 4.16 35.1 105 211 5.41 20.0 60.1 120 6.65 12.6 37.7 1 2.92 77.5 21 441 4.16 35.1 105 211 5.41 20.0 60.1 120 6.65 12.6 37.7 1 2.93 77.5 21 441 4.16 35.1 105 211 5.41 20.0 60.1 120 6.65 12.6 37.7 1 2.94 77.0 213 426 4.21 34.2 103 205 5.48 19.5 59.8 120 6.67 12.5 37.5 1 2.95 71.5 215 429 4.20 34.4 103 205 5.48 19.5 59.8 120 6.67 12.2 37.5 1 2.95 71.5 215 429 4.20 34.4 103 205 5.48 19.5 59.8 118 6.71 12.3 36.8 1 2.96 70.1 210 420 4.23 33.9 102 203 5.48 19.5 59.8 118 6.71 12.3 36.8 1 2.98 77.1 210 420 4.23 33.9 102 203 5.48 19.5 59.8 118 6.71 12.3 36.8 1 2.98 77.1 210 420 4.23 33.9 102 203 5.48 19.5 59.8 118 6.71 12.3 36.8 1 2.98 77.1 210 420 4.23 33.9 102 203 5.48 19.5 59.8 118 6.71 12.3 36.8 1 3.00 69.1 207 415 4.25 33.6 101 201 5.50 19.3 57.9 118 6.77 12.1 36.2 1 3.01 66.8 206 412 4.24 33.2 99.7 199 5.52 19.5 58.8 119 6.68 117 6.73 12.2 36.7 1 3.01 68.8 206 419 388 4.37 33.9 102 20.5 5.48 19.5 5.8 118 6.77 12.1 36.2 1 3.01 68.8 191 383 4.37 31.7 95.0 190 5.52 118.5 55.1 110 6.87 11.7 35.2 1 3.01 68.8 191 383																79.3
2.78 80.8 242 485 4.03 37.5 113 225 5.28 21.1 68.3 127 6.53 13.1 39.4 7.2 2.80 79.6 239 477 4.05 37.1 111 223 5.30 20.9 62.8 16.6 6.55 13.0 39.1 7.2 2.81 7.90 237 474 4.06 37.0 111 222 5.31 2.99 62.6 125 6.56 13.0 39.9 2.2 2.82 78.4 2.25 471 4.07 36.8 110 221 5.32 20.8 62.3 125 6.57 12.9 38.8 1.0 221 5.32 20.8 62.3 125 6.57 12.9 38.8 1.0 221 5.32 20.8 62.3 125 6.61 12.9 38.8 2.2 2.85 7.68 22.0 4.1 10.0 2.80 12.5 2.35 2.61 13.3 38.9 2.2 <td></td> <td>79.0</td>																79.0
2.79 80.2 240 481 4.04 37.3 112 224 5.29 21.0 63.1 126 6.54 13.1 39.2 2.2 2.81 79.0 237 474 4.05 37.1 111 222 5.31 20.9 62.6 125 6.56 13.0 39.9 7.2 2.81 79.0 237 474 4.06 37.0 111 222 5.31 20.9 62.6 125 6.56 13.0 39.9 7.2 2.82 77.9 234 467 4.08 36.6 110 219 5.33 20.8 62.3 125 6.57 12.9 38.8 7.2 2.83 77.9 234 467 4.08 36.6 110 219 5.33 20.7 62.1 124 6.58 12.9 38.7 3.2 2.84 4.09 36.4 109 218 5.34 20.6 618 124 6.59 12.8 38.5 2.2 2.85 76.8 220 461 4.10 36.2 109 217 5.35 20.5 61.5 123 6.60 12.8 38.4 2.86 76.2 229 457 4.11 36.0 108 216 5.36 20.4 61.3 123 6.60 12.8 38.4 2.88 75.1 225 451 4.13 35.3 108 215 5.37 20.3 61.0 122 6.62 12.7 36.1 7.2 2.88 75.1 225 451 4.13 35.7 106 213 5.39 20.2 60.6 121 6.64 12.6 37.9 7.2 2.90 74.1 222 444 4.16 35.3 106 213 5.39 20.2 60.6 121 6.64 12.6 37.7 7.3 2.20 73.0 219 438 4.17 34.9 105 211 5.41 20.0 60.1 120 6.66 12.5 37.5 2.94 72.0 216 432 4.19 34.6 104 209 5.43 19.9 59.8 120 6.67 12.5 37.5 2.95 71.5 21.5 429 4.20 34.4 103 207 5.45 19.7 59.1 118 6.70 12.4 37.2 2.95 71.5 21.5 22.9 42.0 44.1 34.2 103 207 5.45 19.7 59.1 118 6.70 12.4 37.2 2.95 71.5 21.5 429 4.20 34.4 103 207 5.45 19.5 58.9 119 6.68 12.4 37.3 37.9 2.95 71.5 21.5 429 4.20 34.4 103 207 5.45 19.5 58.9 119 6.68 12.4 37.3 37.1 2.95 71.5 21.5 429 4.20 34.4 103 207 5.45 19.5 58.9 118 6.71 12.3 36.9 2.29 66.6 41.2 42.3 33.9 102 20.3 5.48 19.5 58.9 119 6.68 12.4 37.3 37.1 2.95 71.5 21.5 429 42.0 34.4 103 207 5.45 19.5 58.9 119			242													78.7
2.80 79.6 299 477 4.06 37.1 111 222 5.30 20.9 62.8 125 6.55 13.0 39.9 2.8 2.82 78.4 235 471 4.07 38.8 110 221 5.32 20.8 62.3 125 6.57 12.9 38.8 2.2 2.83 77.9 224 467 4.08 36.6 110 221 5.32 20.8 62.3 125 6.57 12.9 38.8 1.2 2.85 76.8 230 461 4.10 36.2 109 217 5.35 20.5 61.5 123 6.60 12.8 36.4 10.9 218 5.35 20.5 61.5 123 6.61 12.8 36.4 10.1 22.8 76.62 22.9 457 4.11 38.0 108 215 5.37 20.3 61.0 12.2 66.2 12.7 39.1 12.2 28.8 75.1 22.9 41.1 4.13																78.4
2.81 79.0 237 474 4.06 37.0 111 221 5.31 20.9 62.6 125 6.56 13.0 38.9 7.2 2.83 77.9 234 467 4.08 36.6 110 219 5.33 20.7 62.1 124 6.59 12.8 38.7 7.2 2.84 77.3 232 464 4.09 38.4 109 218 5.34 20.6 61.8 124 6.59 12.8 38.4 7.2 2.86 76.2 229 457 4.11 36.0 108 216 5.36 20.4 61.3 123 6.61 12.8 38.3 7.2 2.87 75.7 227 454 4.12 35.8 108 215 5.37 20.3 60.8 12.2 6.63 12.7 38.0 7.2 2.88 75.1 225 45.1 4.13 35.5 106 213 5.39 20																78.2
2.82 78.4 235 471 4.07 36.8 110 221 5.32 20.8 62.3 125 6.57 12.9 33.8 7 2.84 77.3 232 464 4.09 36.4 109 21.8 5.34 20.6 61.8 124 6.58 12.9 38.5 7 2.85 76.8 230 461 4.10 38.2 109 21.7 5.35 20.5 61.5 123 6.60 12.8 38.4 2 2.88 76.2 229 457 4.11 36.0 108 216 5.36 20.4 61.3 123 6.61 12.8 38.3 2 2.88 75.7 227 454 4.12 38.8 15 5.36 20.3 61.0 12.2 6.63 12.7 38.0 7 2.89 74.6 224 44.8 4.14 35.5 106 213 5.39 20.2 60.6 12.6 36.2 3																78.0
2.83 77.9 224 467 4.08 36.6 110 219 5.33 20.7 62.1 124 6.58 12.9 38.7 7.2 2.85 76.8 230 461 4.10 36.2 109 217 5.35 20.5 61.8 123 6.60 12.8 38.4 5.2 2.86 76.2 229 457 4.11 36.0 108 216 5.36 20.4 61.3 123 6.61 12.8 38.4 5.2 2.87 75.7 227 454 4.12 35.8 108 215 5.37 20.3 61.0 122 6.62 12.7 38.1 2.2 2.88 75.1 225 451 4.13 35.7 107 214 5.38 20.3 61.0 122 6.62 12.7 38.0 7.2 2.88 75.1 225 451 4.13 35.7 107 214 5.38 20.3 61.0 122 6.63 12.7 38.0 7.2 2.90 74.1 222 444 4.15 35.3 106 213 5.39 20.2 60.6 121 6.64 12.6 37.9 7.2 2.90 74.1 222 444 4.15 35.3 106 212 5.40 20.1 60.3 121 6.65 12.6 37.7 2.2 2.91 73.6 221 441 4.16 35.1 105 211 5.41 20.0 60.1 12.0 6.66 12.5 37.6 2.2 2.92 73.0 219 488 4.17 34.9 105 210 5.42 19.9 59.8 120 6.67 12.5 37.5 2.2 2.94 72.0 216 432 4.19 34.6 104 209 5.43 19.9 59.8 120 6.67 12.5 37.5 2.2 2.94 72.0 216 422 4.19 34.6 104 208 5.44 19.8 59.3 119 6.68 12.4 37.2 2.2 2.95 71.5 215 429 4.20 34.4 103 207 5.45 19.9 59.8 119 6.68 12.4 37.2 2.96 71.0 213 426 4.21 34.2 103 207 5.45 19.9 5.81 118 6.70 12.4 37.1 2.2 2.96 71.0 213 426 4.21 34.2 103 207 5.45 19.9 5.84 117 6.73 12.2 36.7 7.2 2.99 69.6 209 417 4.24 33.7 101 202 5.49 19.4 582 116 6.74 12.2 36.6 7.3 2.99 69.6 209 417 4.24 33.7 101 202 5.49 19.4 582 116 6.74 12.2 36.6 7.3 2.99 69.6 209 417 4.24 33.7 101 202 5.49 19.4 582 116 6.74 12.2 36.6 7.3 2.99 69.6 209 417 4.24 33.7 101 202 5.49 19.4 582 116 6.74 12.2 36.6 7.3 3.0 6.6 2.0 409 4.27 33.2 99.7 199 5.55 18.9 56.8 114 6.80 11.9 38.9 3.0 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9 56.8 114 6.80 11.9 38.9 3.3 3.0 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9 56.8 114 6.80 11.9 38.7 3.3 3.0 6.0 66.4 199 388 4.33 32.3 90.8 199 5.55 18.9 56.8 114 6.80 11.9 38.7 3.3 3.0 66.4 199 388 4.33 32.3 99.8 198 5.54 19.0 57.0 114 6.89 11.9 38.9 3.3 3.0 66.4 199 388 4.33 32.9 98.8 198 5.54 19.0 57.0 114 6.89 11.9 38.																77.6
2.84 77.3 232 464 4.09 36.4 109 218 5.34 20.6 61.8 124 6.59 12.8 36.5 0 2.85 76.8 230 461 4.10 36.2 109 217 5.35 20.5 61.5 123 6.60 12.8 38.4 1 2.86 76.2 229 457 4.11 36.0 108 216 5.36 20.4 61.3 123 6.60 12.8 38.4 1 2.87 75.7 227 454 4.12 35.8 108 215 5.37 20.3 61.0 122 6.62 12.7 38.1 1 2.88 75.1 225 451 4.13 35.7 107 214 5.38 20.3 60.8 122 6.63 12.7 38.0 1 2.89 74.6 224 448 4.14 35.5 106 213 5.39 20.2 60.6 121 6.64 12.6 37.9 1 2.90 74.1 222 444 4.15 35.3 106 212 5.40 20.1 60.3 121 6.65 12.6 37.9 1 2.91 73.6 221 441 4.16 35.1 105 211 5.41 20.0 60.1 120 6.66 12.5 37.6 1 2.92 73.0 219 438 4.17 34.9 105 210 5.42 19.9 59.8 120 6.67 12.5 37.5 1 2.93 72.5 218 435 4.18 34.8 104 209 5.43 19.9 59.8 110 6.67 12.5 37.5 1 2.94 72.0 216 432 4.19 34.6 104 208 5.44 19.8 59.3 119 6.69 12.4 37.2 1 2.95 71.5 215 429 4.20 34.4 103 207 5.45 19.7 59.1 118 6.70 12.4 37.1 1 2.96 77.0 212 423 4.22 33.9 102 203 5.48 19.5 58.6 117 6.72 12.3 36.8 1 2.99 70.1 210 420 4.23 33.9 102 203 5.48 19.5 58.6 117 6.72 12.3 36.8 1 2.99 70.1 210 420 4.23 33.9 102 203 5.48 19.5 58.6 117 6.72 12.3 36.8 1 3.00 69.1 207 415 4.25 33.6 101 201 5.50 19.3 57.9 116 6.74 12.2 36.7 1 3.01 66.6 209 417 4.24 33.1 19.2 204 5.47 19.5 58.6 117 6.77 12.1 36.2 1 3.00 66.4 19.9 398 4.31 20.2 203 5.48 19.5 58.6 117 6.78 12.1 36.4 1 3.01 66.6 206 412 4.26 33.1 19.9 5.52 19.2 57.5 115 6.77 12.1 36.4 1 3.01 66.6 206 412 4.26 33.1 19.9 5.55 11.9 57.0 116 6.74 12.1 36.2 1 3.01 66.6 200 404 4.29 33.1 19.2 204 5.54 19.5 58.6 117 6.78 12.0 36.7 1 3.01 66.8 206 412 4.26 33.1 19.9 5.55 18.9 56.6 113 6.77 12.1 36.4 1 3.01 66.8 206 412 4.26 33.1 19.9 5.55 18.9 56.6 113 6.77 12.1 36.4 1 3.01 66.8 206 412 4.26 33.1 19.5 5.55 18.9 56.6 113 6.77 12.1 36.4 1 3.01 66.9 198 398 4.31 2.2 19.6 6.7 19.5 55.6 18.9 56.6 113 6.77 12.1 36.4 1 3.01 66.9 198 398 4.32 32.4 19.9 5.55 19.1 56.1 18.5 55.5 111 6.67 1.2 1.3 36.9 1 3.01 66.9 198 398 4.32 32.4 19.3 19.5 5.57 18.8 56.0 114 6.89 11.6 33.1 36.8 11.8 35.5 11.8 35.5 110 6.89 11.6 34.9 11.8 35.5 11.8 35.5 11.8 35.5 11.8 35.5 11.8 35.5 11.8 35.5																77.3
2,85 76.8 230 461 4.10 36.2 109 217 5.35 20.5 61.5 123 6.60 12,8 38.3 2 2.87 75,7 227 454 4.12 35.8 108 215 5.37 20.3 61.0 122 6.62 12,7 38.1 2 2.88 75.1 225 451 4.13 35.7 107 214 5.38 20.3 61.0 122 6.62 12,7 38.0 2 2.99 74.1 222 444 4.15 35.3 106 212 5.40 20.1 60.6 121 6.66 12.6 37.7 2.91 73.0 221 441 4.16 35.1 105 211 5.41 20.0 60.1 120 6.66 12.5 37.6 2.292 73.0 221 438 104 209 5.42 19.9 59.8 120 6.67 12.5 37.6 2.295 7.3 2.294																77.1
2.86																76.8
2.87 75.7 227 454 4.12 35.8 108 215 5.37 20.3 61.0 122 6.62 12.7 38.1 7 2.88 75.1 225 451 4.13 35.7 107 214 5.38 20.3 60.8 122 6.63 12.7 38.0 7 2.89 74.6 224 448 4.14 35.5 106 213 5.39 20.2 60.6 121 6.64 12.6 37.9 7 2.90 74.1 222 444 4.15 35.3 106 212 5.40 20.1 60.3 121 6.65 12.6 37.7 7 2.91 73.6 221 441 4.16 35.3 105 211 5.41 20.0 60.1 120 6.66 12.6 37.7 7 2.92 73.0 219 438 4.17 34.9 105 211 5.41 20.0 60.1 120 6.66 12.5 37.6 7 2.93 72.5 218 435 4.18 34.8 104 209 54.3 19.9 59.8 120 6.67 12.5 37.6 7 2.94 72.0 216 432 4.19 34.6 104 208 5.44 19.8 59.3 119 6.69 12.4 37.3 7 2.95 71.5 215 429 4.20 34.4 103 207 5.45 19.7 59.1 118 6.70 12.4 37.1 7 2.96 71.0 213 426 4.21 34.2 103 205 5.46 19.6 58.9 118 6.71 12.3 36.9 7 2.97 70.5 212 423 4.22 34.1 102 204 5.47 19.5 58.6 117 6.72 12.3 36.8 7 2.99 69.6 209 417 4.24 33.7 101 202 203 5.48 19.5 58.4 117 6.73 12.2 36.6 7 3.00 69.1 207 415 4.25 33.6 101 201 5.50 19.5 58.4 117 6.73 12.2 36.6 7 3.00 69.1 207 415 4.25 33.6 101 201 5.50 19.5 57.7 115 6.76 12.1 36.3 7 3.01 68.6 206 412 4.28 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1 36.3 7 3.01 68.6 206 412 4.28 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1 36.3 7 3.01 68.6 206 412 4.28 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1 36.3 7 3.01 68.6 206 412 4.28 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1 36.3 7 3.03 66.4 199 398 4.31 32.6 97.8 198 5.53 19.7 57.5 115 6.76 12.1 36.3 7 3.03 66.4 199 398 4.31 32.6 97.8 198 5.54 19.0 57.0 114 6.78 12.0 36.0 7 3.04 67.3 202 404 4.29 32.9 98.8 198 5.54 19.0 57.0 114 6.78 12.0 36.0 7 3.05 66.8 200 401 4.30 32.8 98.3 197 5.55 18.8 56.3 113 6.82 11.8 35.5 7 3.06 66.8 199 398 4.31 32.6 97.8 198 5.57 18.8 56.3 113 6.82 11.8 35.5 7 3.10 64.2 193 388 4.33 32.3 98.8 197 5.55 18.5 56.8 117 6.8 11.1 6.8 11.7 33.4 6 3.11 64.2 193 385 4.36 31.8 95.5 191 5.51 18.5 55.5 111 6.67 11.6 8.8 11.6 33.4 7 3.11 64.2 193 385 4.30 31.8 95.5 191 5.51 18.5 5.57 18.8 56.3 113 6.82 11.8 35.5 7 3.11 64.2 183 385 4.36 31.8 95.5 191 5.51 18.5 55.5 111 6.86 11.7 33.1 1.6 8.9 11.6 34.7 6 3.11 60.1 180 363 4.44 30.8 91.8 18.5 5.66 1																76.6 76.5
2.88 75.1 225 451 4.13 35.7 107 214 5.38 20.3 60.8 122 6.63 12.7 38.0 7.2 2.8 2.89 74.6 224 448 4.14 35.5 106 213 5.39 20.2 60.6 121 6.64 12.6 37.9 7.2 2.91 73.6 221 441 4.16 35.1 105 211 5.41 20.0 60.1 120 6.66 12.5 37.6 7.2 2.91 73.6 221 441 4.16 35.1 105 211 5.41 20.0 60.1 120 6.66 12.5 37.6 7.2 2.92 73.0 219 438 4.17 34.9 105 210 5.42 19.9 59.6 119 6.68 12.4 37.2 2.93 72.5 218 435 4.18 34.8 104 209 5.43 19.9 59.6 119 6.68 12.4 37.2 2.94 72.0 216 432 4.19 34.6 104 209 5.43 19.9 59.6 119 6.68 12.4 37.2 7.2 2.95 71.5 215 429 4.20 34.4 103 207 5.45 19.7 59.1 118 6.70 12.4 37.1 7.2 2.96 71.0 213 426 4.21 34.2 103 205 5.46 19.6 58.9 118 6.71 12.3 36.9 7.2 2.98 70.1 210 420 4.23 33.9 102 203 5.48 19.5 58.6 117 6.72 12.3 36.8 7.2 2.98 70.1 210 420 4.23 33.9 102 203 5.48 19.5 58.6 117 6.72 12.3 36.8 7.2 2.98 70.1 210 420 4.23 33.9 102 203 5.48 19.5 58.6 117 6.73 12.2 36.7 2.3 30.0 69.1 207 415 4.25 33.6 101 201 5.50 19.4 58.2 116 6.74 12.2 36.6 7.3 30.0 69.1 207 415 4.26 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1 36.3 30.3 68.6 206 412 4.26 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1 36.3 30.3 66.2 20 404 4.29 33.9 99.7 199 5.52 19.2 57.5 115 6.76 12.1 36.3 30.3 66.6 206 412 4.26 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1 36.3 30.3 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9 56.8 114 6.78 12.0 36.9 13.0 68.6 200 401 4.30 32.8 98.3 197 5.55 18.9 56.8 114 6.78 12.0 36.9 13.0 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9 56.8 114 6.80 11.9 35.7 33.0 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9 56.8 114 6.80 11.9 35.7 33.0 66.8 199 398 4.31 32.6 97.8 196 5.56 18.9 56.6 113 6.81 11.9 35.7 33.1 6.8 11.9 38.4 39.5 33.0 66.8 199 398 4.31 32.6 97.8 196 5.56 18.9 56.6 113 6.81 11.9 35.7 33.1 6.2 18.8 19.1 57.2 114 6.83 11.8 35.4 7.3 33.9 6.5 19.1 57.2 114 6.88 11.9 35.7 7.3 33.0 66.6 119 338 4.33 32.3 96.8 194 5.55 118.5 55.5 111 6.86 11.7 35.1 33.0 66.8 199 398 4.33 32.9 9.7 199 5.50 18.8 56.3 18.3 55.0 110 6.88 11.8 35.4 7.3 33.0 66.6 119 338 4.39 33.1 99.2 198 5.56 18.3 56.6 18.9 56.6 113 6.81 11.9 35.7 33.1 6.2 188 375 4.40 31.2 93.6																76.2
2.89																
2.90 74.1 222 444 4.15 35.3 106 212 5.40 20.1 60.3 121 6.65 12.6 37.7 7.7 2.91 73.6 221 441 4.16 35.1 105 211 5.41 20.0 60.1 120 6.66 12.5 37.5 7.5 2.93 72.5 218 435 4.18 34.8 104 209 5.43 19.9 59.6 119 6.68 12.4 37.3 7.2 2.95 71.5 216 432 4.19 34.6 104 208 5.44 19.8 59.3 119 6.68 12.4 37.2 2.95 71.5 215 429 4.20 34.4 103 207 5.45 19.7 59.1 118 6.71 12.4 37.2 2.96 71.0 213 426 4.21 34.2 103 205 5.46 19.6 58.9 118 6.71 12.3																76.0
2.91 73.6 221 441 4.16 35.1 105 211 5.41 20.0 60.1 120 6.66 12.5 37.6 7 2.92 73.0 219 438 4.18 34.9 105 210 5.42 19.9 59.8 120 6.67 12.5 37.5 7 2.94 72.0 216 432 4.19 34.6 104 209 5.44 19.8 59.3 119 6.69 12.4 37.2 2 2.95 71.5 215 429 4.20 34.4 103 207 5.46 19.6 58.9 118 6.71 12.4 37.1 2.96 71.0 213 426 4.21 34.2 103 205 5.46 19.6 58.9 118 6.71 12.3 36.8 7 2.97 70.5 212 423 4.21 1102 204 5.47 19.5 58.4 117 6.72 22.3 36																75.7
2.92 73.0 219 438 4.17 34.9 105 210 5.42 19.9 59.8 120 6.67 12.5 37.5 7.2 2.94 72.0 216 432 4.19 34.6 104 208 5.43 19.8 59.3 119 6.69 12.4 37.2 7.2 2.95 71.5 215 429 4.20 34.4 103 207 5.45 19.7 59.1 118 6.70 12.4 37.1 2.96 71.0 213 426 4.21 34.2 103 205 5.46 19.6 68.9 118 6.70 12.4 37.1 7.0 2.97 70.5 212 423 4.22 34.1 102 204 5.47 19.5 58.6 117 6.72 12.3 36.8 7 2.99 70.5 212 423 33.9 102 203 5.48 19.5 58.6 117 6.72 12.3 36.8																75.4
2.93 72.5 218 435 4.18 34.6 104 209 5.43 1.99 59.6 119 6.68 12.4 37.3 2 2.95 71.5 215 429 4.20 34.4 103 207 5.45 19.7 59.1 118 6.70 12.4 37.1 2 2.96 71.0 213 426 4.21 34.2 103 205 5.46 19.6 58.9 118 6.71 12.3 36.9 7 2.97 70.5 212 423 4.22 34.1 102 204 5.47 19.5 58.6 117 6.73 12.2 36.8 7 2.99 69.6 209 417 4.24 33.7 101 202 5.49 19.4 58.2 116 6.74 12.2 36.6 7 2.99 69.6 209 417 4.24 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1																75.2
2.94 72.0 216 432 4.19 34.6 104 208 5.44 19.8 59.3 119 6.69 12.4 37.2 2.95 71.5 215 429 4.20 34.4 103 207 5.45 19.6 59.9 118 6.71 12.3 36.9 7.7 2.97 70.5 212 423 4.22 34.1 102 204 5.47 19.5 58.6 117 6.72 12.3 36.8 7.2 2.98 70.1 210 420 4.23 33.9 102 203 5.48 19.5 58.6 117 6.73 12.2 36.6 7.7 2.99 69.6 209 417 4.24 33.7 101 202 5.49 19.4 58.2 116 6.74 12.2 36.6 7.3 30.0 69.1 207 415 4.25 33.4 100 200 5.51 19.2 57.7 115 6.6 6.6																74.9
2.95 71.5 215 429 4.20 34.4 103 207 5.45 19.7 59.1 118 6.70 12.4 37.1 7 2.96 71.0 213 426 4.21 34.2 103 205 5.46 19.6 58.9 118 6.71 12.3 36.8 7 2.98 70.1 210 420 4.23 33.9 102 203 5.48 19.5 58.4 117 6.73 12.2 36.7 7 2.99 69.6 209 417 4.24 33.7 101 202 5.49 19.4 58.2 116 6.74 12.2 36.6 7 3.01 68.6 206 412 4.26 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1 36.4 36.2 3 3.02 68.2 205 409 4.27 33.2 9.8 19.8 5.53																74.7
2.96 71.0 213 426 4.21 34.2 103 205 5.46 19.6 58.9 118 6.71 12.3 36.9 7 2.98 70.1 210 420 4.23 33.9 102 203 5.48 19.5 58.6 117 6.73 12.2 36.7 7 2.99 69.6 209 417 4.24 33.7 101 202 5.49 19.4 58.2 116 6.74 12.2 36.6 7 3.00 69.1 207 415 4.25 33.6 101 201 5.51 19.2 57.7 115 6.76 12.1 36.4 7 3.01 68.6 206 412 4.26 33.4 100 200 5.51 19.2 57.5 115 6.76 12.1 36.2 7 3.02 68.2 205 409 4.27 33.2 99.7 199 5.52 19.2																74.4
2.97 70.5 212 423 4.22 34.1 102 204 5.47 19.5 58.6 117 6.72 12.3 36.8 7 2.98 70.1 210 420 4.23 33.9 102 203 5.48 19.5 58.4 117 6.73 12.2 36.7 7 2.99 69.6 209 417 4.24 33.7 101 202 5.49 19.4 58.2 116 6.74 12.2 36.6 6 3.00 69.1 207 415 4.25 33.6 101 201 5.50 19.3 57.9 116 6.75 12.1 36.4 7 3.01 68.6 206 412 4.26 33.4 100 200 5.51 19.2 57.5 115 6.76 12.1 36.3 7 3.02 68.2 205 409 4.27 33.2 99.7 199 5.52 19.2																74.1
2.98 70.1 210 420 4.23 33.9 102 203 5.48 19.5 58.4 117 6.73 12.2 36.7 7 2.99 69.6 209 417 4.24 33.7 101 202 5.49 19.4 58.2 116 6.75 12.2 36.6 7 3.01 68.6 206 412 4.26 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1 36.3 7 3.02 68.2 205 409 4.27 33.2 99.7 199 5.52 19.2 57.5 115 6.77 12.1 36.2 7 3.03 67.7 203 406 4.28 33.1 99.2 198 5.53 19.1 57.2 114 6.78 12.1 36.2 7 3.05 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9																73.9
2.99 69.6 209 417 4.24 33.7 101 202 5.49 19.4 58.2 116 6.74 12.2 36.6 7 3.00 68.1 206 412 4.25 33.6 101 201 5.50 19.3 57.9 116 6.75 12.1 36.4 7 3.01 68.6 206 412 4.26 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1 36.3 7 3.02 68.2 205 409 4.27 33.2 99.7 199 5.52 19.2 57.5 115 6.77 12.1 36.2 7 3.03 67.7 203 406 4.28 33.1 99.2 198 5.53 19.1 57.0 114 6.78 12.0 36.0 7 3.05 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9 56.6 113 6.81 11.9 35.7 3 3.06 66.4 199 </td <td></td> <td>73.6</td>																73.6
3.00 69.1 207 415 4.25 33.6 101 201 5.50 19.3 57.9 116 6.75 12.1 36.4 7 3.01 68.6 206 412 4.26 33.4 100 200 5.51 19.2 57.5 115 6.76 12.1 36.3 7 3.02 68.2 205 409 4.27 33.2 99.7 199 5.52 19.2 57.5 115 6.76 12.1 36.2 7 3.03 67.7 203 406 4.28 33.1 99.2 198 5.53 19.1 57.2 114 6.78 12.0 36.0 7 3.04 67.3 202 404 4.29 32.9 98.8 198 5.54 19.0 57.0 114 6.79 12.0 35.9 7 3.05 66.8 200 401 4.30 32.8 96.3 197 5.55 18.9																73.4
3.01 68.6 206 412 4.26 33.4 100 200 5.51 19.2 57.7 115 6.76 12.1 36.3 7 3.02 68.2 205 409 4.27 33.2 99.7 199 5.52 19.2 57.5 115 6.77 12.1 36.2 7 3.03 67.7 203 406 4.28 33.1 99.2 198 5.53 19.1 57.2 114 6.78 12.0 36.0 7 3.04 67.3 202 404 4.29 32.9 98.8 198 5.54 19.0 57.0 114 6.79 12.0 35.9 7 3.05 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9 56.8 114 6.80 11.9 35.8 7 3.06 66.4 199 398 4.31 32.6 97.8 196 5.56 18.9 56.6 113 6.81 11.9 35.7 1 3.07 65.9 198 395 4.32 32.4 97.3 195 5.57 18.8 56.3 113 6.82 11.8 35.5 7 3.08 65.5 196 393 4.33 32.3 96.8 194 5.58 18.7 56.1 112 6.83 11.8 35.4 7 3.09 65.0 195 390 4.34 32.1 96.4 193 5.59 18.6 55.9 112 6.84 11.8 35.3 7 3.11 64.2 193 385 4.36 31.8 95.5 191 5.61 18.5 55.5 111 6.85 11.7 35.2 7 3.11 64.2 193 385 4.36 31.8 95.5 191 5.61 18.5 55.5 111 6.86 11.7 35.1 7 3.12 63.8 191 383 4.37 31.7 95.0 190 5.62 18.4 55.2 110 6.87 11.6 34.9 6 3.15 62.5 188 375 4.40 31.2 93.6 187 5.65 18.2 54.6 109 6.90 11.5 34.6 6 3.16 62.1 186 373 4.41 31.1 93.2 186 5.66 18.1 54.4 109 6.91 11.5 34.5 6 3.19 60.9 183 366 4.44 30.6 91.8 184 5.69 17.9 53.7 107 6.94 11.4 34.3 6 3.20 60.5 182 363 4.45 30.5 91.4 183 5.70 17.8 53.5 107 6.95 11.3 33.8 6 3.22 59.8 179 359 4.47 30.2 90.5 181 5.72 17.7 53.1 106 6.97 11.3 33.9 6																73.1
3.02 68.2 205 409 4.27 33.2 99.7 199 5.52 19.2 57.5 115 6.77 12.1 36.2 7 3.03 67.7 203 406 4.28 33.1 99.2 198 5.53 19.1 57.2 114 6.78 12.0 36.0 7 3.04 67.3 202 404 4.29 32.9 98.8 198 5.54 19.0 57.0 114 6.79 12.0 35.9 7 3.05 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9 56.8 114 6.80 11.9 35.7 7 3.06 66.4 199 398 4.31 32.6 97.8 196 5.56 18.9 56.6 113 6.81 11.9 35.7 7 3.07 65.9 198 395 4.32 32.4 97.3 195 5.57 18.8 <td>3.00</td> <td>69.1</td> <td>207</td> <td>415</td> <td>4.25</td> <td>33.6</td> <td>101</td> <td>201</td> <td>5.50</td> <td>19.3</td> <td>57.9</td> <td>116</td> <td>6.75</td> <td>12.1</td> <td>36.4</td> <td>72.8</td>	3.00	69.1	207	415	4.25	33.6	101	201	5.50	19.3	57.9	116	6.75	12.1	36.4	72.8
3.03 67.7 203 406 4.28 33.1 99.2 198 5.53 19.1 57.2 114 6.78 12.0 36.0 7 3.04 67.3 202 404 4.29 32.9 98.8 198 5.54 19.0 57.0 114 6.79 12.0 35.9 7 3.05 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9 56.6 114 6.80 11.9 35.8 7 3.06 66.4 199 398 4.31 32.6 97.8 196 5.56 18.9 56.6 113 6.81 11.9 35.8 7 3.07 65.9 198 395 4.32 32.4 97.3 195 5.57 18.8 56.3 113 6.82 11.8 35.5 7 3.08 65.5 196 393 4.34 32.1 96.4 193 5.59 18.6 <td>3.01</td> <td>68.6</td> <td>206</td> <td>412</td> <td>4.26</td> <td>33.4</td> <td>100</td> <td>200</td> <td>5.51</td> <td>19.2</td> <td>57.7</td> <td>115</td> <td>6.76</td> <td>12.1</td> <td>36.3</td> <td>72.6</td>	3.01	68.6	206	412	4.26	33.4	100	200	5.51	19.2	57.7	115	6.76	12.1	36.3	72.6
3.04 67.3 202 404 4.29 32.9 98.8 198 5.54 19.0 57.0 114 6.79 12.0 35.9 7 3.05 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9 56.8 114 6.80 11.9 35.8 7 3.06 66.4 199 398 4.31 32.6 97.8 196 5.56 18.9 56.6 113 6.81 11.9 35.7 35.8 7 3.07 65.9 198 395 4.32 32.4 97.3 195 5.57 18.8 56.3 113 6.82 11.8 35.5 7 3.08 65.5 196 393 4.33 32.1 96.4 193 5.59 18.6 55.9 112 6.84 11.8 35.4 7 3.10 64.6 194 388 4.35 32.0 95.9 192 5.60 <td>3.02</td> <td>68.2</td> <td>205</td> <td>409</td> <td>4.27</td> <td>33.2</td> <td>99.7</td> <td>199</td> <td>5.52</td> <td>19.2</td> <td>57.5</td> <td>115</td> <td>6.77</td> <td>12.1</td> <td>36.2</td> <td>72.3</td>	3.02	68.2	205	409	4.27	33.2	99.7	199	5.52	19.2	57.5	115	6.77	12.1	36.2	72.3
3.05 66.8 200 401 4.30 32.8 98.3 197 5.55 18.9 56.8 114 6.80 11.9 35.8 7 3.06 66.4 199 398 4.31 32.6 97.8 196 5.56 18.9 56.6 113 6.81 11.9 35.7 7 3.07 65.9 198 395 4.32 32.4 97.3 195 5.57 18.8 56.3 113 6.82 11.8 35.5 7 3.08 65.5 196 393 4.33 32.3 96.8 194 5.58 18.7 56.1 112 6.83 11.8 35.5 7 3.09 65.0 195 390 4.34 32.1 96.4 193 5.59 18.6 55.9 112 6.84 11.8 35.3 7 3.10 64.6 194 388 4.35 32.0 95.9 192 5.60 18.6 <td>3.03</td> <td>67.7</td> <td>203</td> <td>406</td> <td>4.28</td> <td>33.1</td> <td>99.2</td> <td>198</td> <td>5.53</td> <td>19.1</td> <td>57.2</td> <td>114</td> <td>6.78</td> <td>12.0</td> <td>36.0</td> <td>72.1</td>	3.03	67.7	203	406	4.28	33.1	99.2	198	5.53	19.1	57.2	114	6.78	12.0	36.0	72.1
3.06 66.4 199 398 4.31 32.6 97.8 196 5.56 18.9 56.6 113 6.81 11.9 35.7 7 3.07 65.9 198 395 4.32 32.4 97.3 195 5.57 18.8 56.3 113 6.82 11.8 35.5 7 3.08 65.5 196 393 4.33 32.3 96.8 194 5.58 18.7 56.1 112 6.83 11.8 35.4 7 3.09 65.0 195 390 4.34 32.1 96.4 193 5.59 18.6 55.9 112 6.84 11.8 35.3 7 3.10 64.6 194 388 4.35 32.0 95.9 192 5.60 18.6 55.7 111 6.85 11.7 35.2 7 3.11 64.2 193 385 4.36 31.8 95.5 191 5.61 18.5 55.5 111 6.86 11.7 35.1 7 3.12 63.8 191 383 4.37 31.7 95.0 190 5.62 18.4 55.2 110 6.87 11.6 34.9 6 3.13 63.3 190 380 4.38 31.5 94.5 189 5.63 18.3 55.0 110 6.88 11.6 34.8 6 3.14 62.9 189 378 4.39 31.4 94.1 188 5.64 18.3 54.8 110 6.89 11.6 34.7 6.3 11.6 62.1 186 373 4.41 31.1 93.2 186 5.66 18.1 54.4 109 6.90 11.5 34.6 6 3.16 62.1 186 373 4.41 31.1 93.2 186 5.66 18.1 54.4 109 6.91 11.5 34.5 6 3.18 36 3.18 4368 4.43 30.8 92.3 185 5.66 18.1 54.2 108 6.92 11.4 34.3 6 3.19 60.9 183 366 4.44 30.8 92.3 185 5.68 18.0 54.0 108 6.93 11.4 34.2 6 3.20 60.5 182 363 4.45 30.5 91.4 183 5.70 17.8 53.5 107 6.95 11.3 33.9 6 3.22 59.8 179 359 4.47 30.2 90.5 181 5.72 17.7 53.1 106 6.97 11.3 33.8 6	3.04	67.3	202	404	4.29	32.9	98.8	198	5.54	19.0	57.0	114	6.79	12.0	35.9	71.8
3.07 65.9 198 395 4.32 32.4 97.3 195 5.57 18.8 56.3 113 6.82 11.8 35.5 7 3.08 65.5 196 393 4.33 32.3 96.8 194 5.58 18.7 56.1 112 6.83 11.8 35.4 7 3.09 65.0 195 390 4.34 32.1 96.4 193 5.59 18.6 55.9 112 6.84 11.8 35.3 3 3.10 64.6 194 388 4.35 32.0 95.9 192 5.60 18.6 55.7 111 6.85 11.7 35.2 7 3.11 64.2 193 385 4.36 31.8 95.5 191 5.61 18.5 55.5 111 6.86 11.7 35.1 7 3.12 63.8 191 383 4.37 31.7 95.0 190 5.62 18.4 55.2<	3.05	66.8	200	401	4.30	32.8	98.3	197	5.55	18.9	56.8	114	6.80	11.9	35.8	71.6
3.08 65.5 196 393 4.33 32.3 96.8 194 5.58 18.7 56.1 112 6.83 11.8 35.4 7 3.09 65.0 195 390 4.34 32.1 96.4 193 5.59 18.6 55.9 112 6.84 11.8 35.3 7 3.10 64.6 194 388 4.35 32.0 95.9 192 5.60 18.6 55.7 111 6.85 11.7 35.2 7 3.11 64.2 193 385 4.36 31.8 95.5 191 5.61 18.5 55.5 111 6.86 11.7 35.1 7 35.1 64.2 193 385 4.36 31.8 95.5 191 5.61 18.5 55.5 111 6.86 11.7 35.1 7 35.1 63.8 191 383 4.37 31.7 95.0 190 5.62 18.4 55.2 11	3.06	66.4	199	398	4.31	32.6	97.8	196	5.56	18.9	56.6	113	6.81	11.9	35.7	71.3
3.08 65.5 196 393 4.33 32.3 96.8 194 5.58 18.7 56.1 112 6.83 11.8 35.4 7 3.09 65.0 195 390 4.34 32.1 96.4 193 5.59 18.6 55.9 112 6.84 11.8 35.3 7 3.10 64.6 194 388 4.35 32.0 95.9 192 5.60 18.6 55.7 111 6.85 11.7 35.2 7 3.11 64.2 193 385 4.36 31.8 95.5 191 5.61 18.5 55.5 111 6.86 11.7 35.1 7 3.12 63.8 191 383 4.37 31.7 95.0 190 5.62 18.4 55.2 110 6.87 11.6 34.9 6 3.13 63.3 190 380 4.38 31.5 94.5 189 5.63 18.3 55.0 110 6.88 11.6 34.8 6 3.14 62.9 189 378 4.39 31.4 94.1 188 5.64 18.3 54.8 110 6.89 11.6 34.7 6 3.15 62.5 188 375 4.40 31.2 93.6 187 5.65 18.2 54.6 109 6.90 11.5 34.6 6 3.17 61.7 185 370 4.42 30.9 92.7 185 5.67 18.1 54.4 109 6.91 11.5 34.5 6 3.18 61.3 184 368 4.43 30.8 92.3 185 5.68 18.0 54.0 108 6.92 11.4 34.3 6 3.19 60.9 183 366 4.44 30.6 91.8 184 5.69 17.9 53.7 107 6.94 11.4 34.1 6 3.20 60.5 182 363 4.45 30.5 91.4 183 5.70 17.8 53.5 107 6.95 11.3 34.0 6 3.22 59.8 179 359 4.47 30.2 90.5 181 5.72 17.7 53.1 106 6.97 11.3 33.8 6	3.07	65.9	198	395	4.32	32.4	97.3	195	5.57	18.8	56.3	113	6.82	11.8	35.5	71.1
3.09 65.0 195 390 4.34 32.1 96.4 193 5.59 18.6 55.9 112 6.84 11.8 35.3 7 3.10 64.6 194 388 4.35 32.0 95.9 192 5.60 18.6 55.7 111 6.85 11.7 35.2 7 3.11 64.2 193 385 4.36 31.8 95.5 191 5.61 18.5 55.5 111 6.86 11.7 35.1 7 3.12 63.8 191 383 4.37 31.7 95.0 190 5.62 18.4 55.2 110 6.87 11.6 34.9 6 3.13 63.3 190 380 4.38 31.5 94.5 189 5.63 18.3 55.0 110 6.88 11.6 34.9 6 3.14 62.9 189 378 4.39 31.4 94.1 188 5.64 18.3 54.8<	3.08	65.5	196	393	4.33	32.3	96.8	194		18.7	56.1	112	6.83	11.8	35.4	70.8
3.10 64.6 194 388 4.35 32.0 95.9 192 5.60 18.6 55.7 111 6.85 11.7 35.2 7 3.11 64.2 193 385 4.36 31.8 95.5 191 5.61 18.5 55.5 111 6.86 11.7 35.1 7 3.12 63.8 191 383 4.37 31.7 95.0 190 5.62 18.4 55.2 110 6.87 11.6 34.9 6 3.13 63.3 190 380 4.38 31.5 94.5 189 5.63 18.3 55.0 110 6.88 11.6 34.9 6 3.14 62.9 189 378 4.39 31.4 94.1 188 5.64 18.3 54.8 110 6.89 11.6 34.7 6 3.15 62.5 188 375 4.40 31.2 93.6 187 5.65 18.2 54.6 109 6.90 11.5 34.6 6 3.16 62.																70.6
3.11 64.2 193 385 4.36 31.8 95.5 191 5.61 18.5 55.5 111 6.86 11.7 35.1 7 3.12 63.8 191 383 4.37 31.7 95.0 190 5.62 18.4 55.2 110 6.87 11.6 34.9 6 3.13 63.3 190 380 4.38 31.5 94.5 189 5.63 18.3 55.0 110 6.88 11.6 34.8 6 3.14 62.9 189 378 4.39 31.4 94.1 188 5.64 18.3 54.8 110 6.89 11.6 34.8 6 3.15 62.5 188 375 4.40 31.2 93.6 187 5.65 18.2 54.6 109 6.90 11.5 34.6 6 3.16 62.1 186 373 4.41 31.1 93.2 186 5.66 18.1 54.4 109 6.91 11.5 34.5 6 3.17 61.7 185 370 4.42 30.9 92.7 185 5.67 18.1 54.2 108 6.92 11.4 34.3<																70.4
3.12 63.8 191 383 4.37 31.7 95.0 190 5.62 18.4 55.2 110 6.87 11.6 34.9 6 3.13 63.3 190 380 4.38 31.5 94.5 189 5.63 18.3 55.0 110 6.88 11.6 34.8 6 3.14 62.9 189 378 4.39 31.4 94.1 188 5.64 18.3 54.8 110 6.89 11.6 34.7 6 3.15 62.5 188 375 4.40 31.2 93.6 187 5.65 18.2 54.6 109 6.90 11.5 34.6 6 3.16 62.1 186 373 4.41 31.1 93.2 186 5.66 18.1 54.4 109 6.91 11.5 34.5 6 3.17 61.7 185 370 4.42 30.9 92.7 185 5.67 18.1 54.2 108 6.92 11.4 34.3 6 3.18 61.																70.1
3.13 63.3 190 380 4.38 31.5 94.5 189 5.63 18.3 55.0 110 6.88 11.6 34.8 6 3.14 62.9 189 378 4.39 31.4 94.1 188 5.64 18.3 54.8 110 6.89 11.6 34.7 6 3.15 62.5 188 375 4.40 31.2 93.6 187 5.65 18.2 54.6 109 6.90 11.5 34.6 6 3.16 62.1 186 373 4.41 31.1 93.2 186 5.66 18.1 54.4 109 6.91 11.5 34.5 6 3.17 61.7 185 370 4.42 30.9 92.7 185 5.67 18.1 54.2 108 6.92 11.4 34.3 6 3.18 61.3 184 368 4.43 30.8 92.3 185 5.68 18.0 <td></td> <td>69.9</td>																69.9
3.14 62.9 189 378 4.39 31.4 94.1 188 5.64 18.3 54.8 110 6.89 11.6 34.7 6 3.15 62.5 188 375 4.40 31.2 93.6 187 5.65 18.2 54.6 109 6.90 11.5 34.6 6 3.16 62.1 186 373 4.41 31.1 93.2 186 5.66 18.1 54.4 109 6.91 11.5 34.5 6 3.17 61.7 185 370 4.42 30.9 92.7 185 5.67 18.1 54.2 108 6.92 11.4 34.3 6 3.18 61.3 184 368 4.43 30.8 92.3 185 5.68 18.0 54.0 108 6.93 11.4 34.2 6 3.19 60.9 183 366 4.44 30.6 91.8 184 5.69 17.9 53.7 107 6.94 11.4 34.1 6 3.20 60.5 182 363 4.45 30.5 91.4 183 5.70 17.8 53.5 107 6.95 11.3 34.0<																69.6
3.15 62.5 188 375 4.40 31.2 93.6 187 5.65 18.2 54.6 109 6.90 11.5 34.6 6 3.16 62.1 186 373 4.41 31.1 93.2 186 5.66 18.1 54.4 109 6.91 11.5 34.5 6 3.17 61.7 185 370 4.42 30.9 92.7 185 5.67 18.1 54.2 108 6.92 11.4 34.3 6 3.18 61.3 184 368 4.43 30.8 92.3 185 5.68 18.0 54.0 108 6.93 11.4 34.2 6 3.19 60.9 183 366 4.44 30.6 91.8 184 5.69 17.9 53.7 107 6.94 11.4 34.1 6 3.20 60.5 182 363 4.45 30.5 91.4 183 5.70 17.8 53.5 107 6.95 11.3 34.0 6 3.21 60.1 180 361 4.46 30.3 91.0 182 5.71 17.8 53.3 107 6.96 11.3 33.9<																69.4
3.16 62.1 186 373 4.41 31.1 93.2 186 5.66 18.1 54.4 109 6.91 11.5 34.5 6 3.17 61.7 185 370 4.42 30.9 92.7 185 5.67 18.1 54.2 108 6.92 11.4 34.3 6 3.18 61.3 184 368 4.43 30.8 92.3 185 5.68 18.0 54.0 108 6.93 11.4 34.2 6 3.19 60.9 183 366 4.44 30.6 91.8 184 5.69 17.9 53.7 107 6.94 11.4 34.1 6 3.20 60.5 182 363 4.45 30.5 91.4 183 5.70 17.8 53.5 107 6.95 11.3 34.0 6 3.21 60.1 180 361 4.46 30.3 91.0 182 5.71 17.8 53.3 107 6.96 11.3 33.9 6 3.22 59.8 179 359 4.47 30.2 90.5 181 5.72 17.7 53.1 106 6.97 11.3 33.8<																69.2
3.17 61.7 185 370 4.42 30.9 92.7 185 5.67 18.1 54.2 108 6.92 11.4 34.3 6 3.18 61.3 184 368 4.43 30.8 92.3 185 5.68 18.0 54.0 108 6.92 11.4 34.2 6 3.19 60.9 183 366 4.44 30.6 91.8 184 5.69 17.9 53.7 107 6.94 11.4 34.1 6 3.20 60.5 182 363 4.45 30.5 91.4 183 5.70 17.8 53.5 107 6.95 11.3 34.0 6 3.21 60.1 180 361 4.46 30.3 91.0 182 5.71 17.8 53.3 107 6.96 11.3 33.9 6 3.22 59.8 179 359 4.47 30.2 90.5 181 5.72 17.7 53.1 106 6.97 11.3 33.8 6																68.9
3.18 61.3 184 368 4.43 30.8 92.3 185 5.68 18.0 54.0 108 6.93 11.4 34.2 6 3.19 60.9 183 366 4.44 30.6 91.8 184 5.69 17.9 53.7 107 6.94 11.4 34.1 6 3.20 60.5 182 363 4.45 30.5 91.4 183 5.70 17.8 53.5 107 6.95 11.3 34.0 6 3.21 60.1 180 361 4.46 30.3 91.0 182 5.71 17.8 53.3 107 6.96 11.3 33.9 6 3.22 59.8 179 359 4.47 30.2 90.5 181 5.72 17.7 53.1 106 6.97 11.3 33.8 6																68.7
3.19 60.9 183 366 4.44 30.6 91.8 184 5.69 17.9 53.7 107 6.94 11.4 34.1 6 3.20 60.5 182 363 4.45 30.5 91.4 183 5.70 17.8 53.5 107 6.95 11.3 34.0 6 3.21 60.1 180 361 4.46 30.3 91.0 182 5.71 17.8 53.3 107 6.96 11.3 33.9 6 3.22 59.8 179 359 4.47 30.2 90.5 181 5.72 17.7 53.1 106 6.97 11.3 33.8 6																68.4
3.20 60.5 182 363 4.45 30.5 91.4 183 5.70 17.8 53.5 107 6.95 11.3 34.0 6 3.21 60.1 180 361 4.46 30.3 91.0 182 5.71 17.8 53.3 107 6.96 11.3 33.9 6 3.22 59.8 179 359 4.47 30.2 90.5 181 5.72 17.7 53.1 106 6.97 11.3 33.8 6																68.2
3.21 60.1 180 361 4.46 30.3 91.0 182 5.71 17.8 53.3 107 6.96 11.3 33.9 6 3.22 59.8 179 359 4.47 30.2 90.5 181 5.72 17.7 53.1 106 6.97 11.3 33.8 6																
3.22 59.8 179 359 4.47 30.2 90.5 181 5.72 17.7 53.1 106 6.97 <i>11.3 33.8 6</i>																68.0
																67.7
3.23 59.4 178 356 4.48 30.0 90.1 180 5.73 17.6 52.9 106 6.98 <i>11.2 33.6 F</i>																67.5
																67.3
3.24 59.0 177 354 4.49 29.9 89.7 179 5.74 17.6 52.7 105 6.99 <i>11.2 33.5</i> 6	3.24	59.0	1/7	354	4.49	29.9	89.7	1/9	5./4	17.6	52.7	105	6.99	11.2	33.5	67.0

^A Prepared by the Engineering Mechanics Section, Institute for Standards Technology.

- 18.3 *Test Blocks*—Machines should be checked to make certain they are in good order by means of standardized Rockwell test blocks.
- 18.4 *Detailed Procedure*—For detailed requirements of this test, reference shall be made to the latest revision of Test Methods E18.

19. Portable Hardness Test

- 19.1 Although this standard generally prefers the use of fixed-location Brinell or Rockwell hardness test methods, it is not always possible to perform the hardness test using such equipment due to the part size, location, or other logistical reasons. In this event, hardness testing using portable equipment as described in Test Methods A956/A956M, A1038, and E110 shall be used with strict compliance for reporting the test results in accordance with the selected standard (see examples below).
- 19.1.1 *Practice A833*—The measured hardness number shall be reported in accordance with the standard methods and given the HBC designation followed by the comparative test bar hardness to indicate that it was determined by a portable comparative hardness tester, as in the following example:
- 19.1.1.1 232 HBC/240, where 232 is the hardness test result using the portable comparative test method (HBC) and 240 is the Brinell hardness of the comparative test bar.
 - 19.1.2 Test Method A956/A956M:
- 19.1.2.1 The measured hardness number shall be reported in accordance with the standard methods and appended with a Leeb impact device in parenthesis to indicate that it was determined by a portable hardness tester, as in the following example:
- (1) 350 HLD where 350 is the hardness test result using the portable Leeb hardness test method with the HLD impact device.
- 19.1.2.2 When hardness values converted from the Leeb number are reported, the portable instrument used shall be reported in parentheses, for example:
- (1) 350 HB (HLD) where the original hardness test was performed using the portable Leeb hardness test method with the HLD impact device and converted to the Brinell hardness value (HB).
- 19.1.3 *Test Method A1038*—The measured hardness number shall be reported in accordance with the standard methods and appended with UCI in parenthesis to indicate that it was determined by a portable hardness tester, as in the following example:
- 19.1.3.1 446 HV (UCI) 10 where 446 is the hardness test result using the portable UCI test method under a force of $10 \, \mathrm{kgf}$.
- 19.1.4 *Test Method E110*—The measured hardness number shall be reported in accordance with the standard methods and appended with a /P to indicate that it was determined by a portable hardness tester, as follows:
 - 19.1.4.1 Rockwell Hardness Examples:
- (1) 40 HRC/P where 40 is the hardness test result using the Rockwell C portable test method.

- (2) 72 HRBW/P where 72 is the hardness test result using the Rockwell B portable test method using a tungsten carbide ball indenter.
 - 19.1.4.2 Brinell Hardness Examples:
- (1) 220 HBW/P 10/3000 where 220 is the hardness test result using the Brinell portable test method with a ball of 10 mm diameter and with a test force of 3000 kgf (29.42 kN) applied for 10 to 15 s.
- (2) 350~HBW/P~5/750 where 350 is the hardness test result using the Brinell portable test method with a ball of 5 mm diameter and with a test force of 750 kgf (7.355 kN) applied for 10 to 15 s.

CHARPY IMPACT TESTING

20. Summary

- 20.1 A Charpy V-notch impact test is a dynamic test in which a notched specimen is struck and broken by a single blow in a specially designed testing machine. The measured test values may be the energy absorbed, the percentage shear fracture, the lateral expansion opposite the notch, or a combination thereof.
- 20.2 Testing temperatures other than room (ambient) temperature often are specified in product or general requirement specifications (hereinafter referred to as the specification). Although the testing temperature is sometimes related to the expected service temperature, the two temperatures need not be identical.

21. Significance and Use

- 21.1 Ductile Versus Brittle Behavior—Body-centered-cubic or ferritic alloys exhibit a significant transition in behavior when impact tested over a range of temperatures. At temperatures above transition, impact specimens fracture by a ductile (usually microvoid coalescence) mechanism, absorbing relatively large amounts of energy. At lower temperatures, they fracture in a brittle (usually cleavage) manner absorbing appreciably less energy. Within the transition range, the fracture will generally be a mixture of areas of ductile fracture and brittle fracture.
- 21.2 The temperature range of the transition from one type of behavior to the other varies according to the material being tested. This transition behavior may be defined in various ways for specification purposes.
- 21.2.1 The specification may require a minimum test result for absorbed energy, fracture appearance, lateral expansion, or a combination thereof, at a specified test temperature.
- 21.2.2 The specification may require the determination of the transition temperature at which either the absorbed energy or fracture appearance attains a specified level when testing is performed over a range of temperatures. Alternatively the specification may require the determination of the fracture appearance transition temperature (FATTn) as the temperature at which the required minimum percentage of shear fracture (n) is obtained.
- 21.3 Further information on the significance of impact testing appears in Annex A5.

22. Apparatus


- 22.1 Testing Machines:
- 22.1.1 A Charpy impact machine is one in which a notched specimen is broken by a single blow of a freely swinging pendulum. The pendulum is released from a fixed height. Since the height to which the pendulum is raised prior to its swing, and the mass of the pendulum are known, the energy of the blow is predetermined. A means is provided to indicate the energy absorbed in breaking the specimen.
- 22.1.2 The other principal feature of the machine is a fixture (see Fig. 10) designed to support a test specimen as a simple beam at a precise location. The fixture is arranged so that the notched face of the specimen is vertical. The pendulum strikes the other vertical face directly opposite the notch. The dimensions of the specimen supports and striking edge shall conform to Fig. 10.
- 22.1.3 Charpy machines used for testing steel generally have capacities in the 220 to 300 ft·lbf (300 to 400 J) energy range. Sometimes machines of lesser capacity are used; however, the capacity of the machine should be substantially in excess of the absorbed energy of the specimens (see Test Methods E23). The linear velocity at the point of impact should be in the range of 16 to 19 ft/s (4.9 to 5.8 m/s).


Note 15—An investigation of striker radius effect is available.

- 22.2 Temperature Media:
- 22.2.1 For testing at other than room temperature, it is necessary to condition the Charpy specimens in media at controlled temperatures.
- 22.2.2 Low temperature media usually are chilled fluids (such as water, ice plus water, dry ice plus organic solvents, or liquid nitrogen) or chilled gases.
- 22.2.3 Elevated temperature media are usually heated liquids such as mineral or silicone oils. Circulating air ovens may be used.
- 22.3 Handling Equipment—Tongs, especially adapted to fit the notch in the impact specimen, normally are used for removing the specimens from the medium and placing them on the anvil (refer to Test Methods E23). In cases where the machine fixture does not provide for automatic centering of the test specimen, the tongs may be precision machined to provide centering.

23. Sampling and Number of Specimens

- 23.1 Sampling:
- 23.1.1 Test location and orientation should be addressed by the specifications. If not, for wrought products, the test location shall be the same as that for the tensile specimen and the orientation shall be longitudinal with the notch perpendicular to the major surface of the product being tested.
 - 23.1.2 Number of Specimens.
- 23.1.2.1 All specimens used for a Charpy impact test shall be taken from a single test coupon or test location.
- 23.1.2.2 When the specification calls for a minimum average test result, three specimens shall be tested.





All dimensional tolerances shall be $\pm 0.05~\text{mm}$ (0.002 in.) unless otherwise specified.

Note 1—A shall be parallel to B within 2:1000 and coplanar with B within 0.05 mm (0.002 in.).

Note 2—C shall be parallel to D within 20:1000 and coplanar with D within 0.125 mm (0.005 in.).

Note 3—Finish on unmarked parts shall be 4 μ m (125 μ in.).


Note 4—Tolerance for the striker corner radius shall be -0.05 mm (0.002 in.)/+0.50 mm (0.020 in.)

FIG. 10 Charpy (Simple-beam) Impact Test

- 23.1.2.3 When the specification requires determination of a transition temperature, eight to twelve specimens are usually needed.
 - 23.2 Type and Size:
- 23.2.1 Use a standard full size Charpy V-notch specimen as shown in Fig. 11, except as allowed in 23.2.2.
 - 23.2.2 Subsized Specimens.
- 23.2.2.1 For flat material less than 7/16 in. (11 mm) thick, or when the absorbed energy is expected to exceed 80 % of full scale, use standard subsize test specimens.
- 23.2.2.2 For tubular materials tested in the transverse direction, where the relationship between diameter and wall thickness does not permit a standard full size specimen, use standard subsize test specimens or standard size specimens containing outer diameter (OD) curvature as follows:
- (1) Standard size specimens and subsize specimens may contain the original OD surface of the tubular product as shown in Fig. 12. All other dimensions shall comply with the requirements of Fig. 11.

Note 16—For materials with toughness levels in excess of about 50 ft-lbs, specimens containing the original OD surface may yield values in excess of those resulting from the use of conventional Charpy specimens.


23.2.2.3 If a standard full-size specimen cannot be prepared, the largest feasible standard subsize specimen shall be prepared. The specimens shall be machined so that the specimen does not include material nearer to the surface than 0.020 in. (0.5 mm).



Note 1—Permissible variations shall be as follows:

Notch length to edge 90 ±2° $90^{\circ} \pm 10 \text{ min}$ Adjacent sides shall be at Cross-section dimensions ±0.075 mm (±0.003 in.) Length of specimen (L) + 0, - 2.5 mm (+ 0, - 0.100 in.) Centering of notch (L/2) ±1 mm (±0.039 in.) Angle of notch ±1° Radius of notch ±0.025 mm (±0.001 in.) Notch depth ±0.025 mm (±0.001 in.) Finish requirements 2 µm (63 µin.) on notched surface and opposite face; 4 µm (125 µin.) on other two surfaces

(a) Standard Full Size Specimen



Note 2—On subsize specimens, all dimensions and tolerances of the standard specimen remain constant with the exception of the width, which varies as shown above and for which the tolerance shall be $\pm 1~\%$.

(b) Standard Subsize Specimens

FIG. 11 Charpy (Simple Beam) Impact Test Specimens

- 23.2.2.4 Tolerances for standard subsize specimens are shown in Fig. 11. Standard subsize test specimen sizes are: 10×7.5 mm, 10×6.7 mm, 10×5 mm, 10×3.3 mm, and 10×2.5 mm.
- 23.2.2.5 Notch the narrow face of the standard subsize specimens so that the notch is perpendicular to the 10 mm wide face.
- 23.3 Notch Preparation—The machining (for example, milling, broaching, or grinding) of the notch is critical, as minor deviations in both notch radius and profile, or tool marks at the bottom of the notch may result in variations in test data, particularly in materials with low-impact energy absorption. (see Annex A5).

24. Calibration

24.1 Accuracy and Sensitivity—Calibrate and adjust Charpy impact machines in accordance with the requirements of Test Methods E23.

25. Conditioning—Temperature Control

25.1 When a specific test temperature is required by the specification or purchaser, control the temperature of the heating or cooling medium within ± 2 °F (1 °C).

Note 17—For some steels there may not be a need for this restricted temperature, for example, austenitic steels.

Note 18—Because the temperature of a testing laboratory often varies from 60 to 90 °F (15 to 32 °C) a test conducted at "room temperature" might be conducted at any temperature in this range.

26. Procedure

- 26.1 Temperature:
- 26.1.1 Condition the specimens to be broken by holding them in the medium at test temperature for at least 5 min in liquid media and 30 min in gaseous media.
- 26.1.2 Prior to each test, maintain the tongs for handling test specimens at the same temperature as the specimen so as not to affect the temperature at the notch.
 - 26.2 Positioning and Breaking Specimens:
- 26.2.1 Carefully center the test specimen in the anvil and release the pendulum to break the specimen.
- 26.2.2 If the pendulum is not released within 5 s after removing the specimen from the conditioning medium, do not break the specimen. Return the specimen to the conditioning medium for the period required in 26.1.1.
- 26.3 Recovering Specimens—In the event that fracture appearance or lateral expansion must be determined, recover the matched pieces of each broken specimen before breaking the next specimen.
 - 26.4 Individual Test Values:
- 26.4.1 *Impact Energy*—Record the impact energy absorbed to the nearest ft·lbf (J).
 - 26.4.2 Fracture Appearance:
- 26.4.2.1 Determine the percentage of shear fracture area by any of the following methods:
- (1) Measure the length and width of the brittle portion of the fracture surface, as shown in Fig. 13 and determine the percent shear area from either Table 7 or Table 8 depending on the units of measurement.
- (2) Compare the appearance of the fracture of the specimen with a fracture appearance chart as shown in Fig. 14.
- (3) Magnify the fracture surface and compare it to a precalibrated overlay chart or measure the percent shear fracture area by means of a planimeter.
- (4) Photograph the fractured surface at a suitable magnification and measure the percent shear fracture area by means of a planimeter.
- 26.4.2.2 Determine the individual fracture appearance values to the nearest 5 % shear fracture and record the value.
 - 26.4.3 Lateral Expansion:
- 26.4.3.1 Lateral expansion is the increase in specimen width, measured in thousandths of an inch (mils), on the compression side, opposite the notch of the fractured Charpy V-notch specimen as shown in Fig. 15.
- 26.4.3.2 Examine each specimen half to ascertain that the protrusions have not been damaged by contacting the anvil, machine mounting surface, and so forth. Discard such samples since they may cause erroneous readings.
- 26.4.3.3 Check the sides of the specimens perpendicular to the notch to ensure that no burrs were formed on the sides during impact testing. If burrs exist, remove them carefully by rubbing on emery cloth or similar abrasive surface, making sure that the protrusions being measured are not rubbed during the removal of the burr.


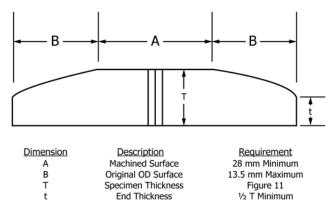


FIG. 12 Tubular Impact Specimen Containing Original OD Surface



Note 1—Measure average dimensions A and B to the nearest 0.02 in. or 0.5 mm.

Note 2—Determine the percent shear fracture using Table 7 or Table 8.

FIG. 13 Determination of Percent Shear Fracture

TABLE 7 Percent Shear for Measurements Made in Inches

Note 1—Since this table is set up for finite measurements or dimensions A and B, 100 % shear is to be reported when either A or B is zero.

Dimen-								Di	mension .	A, in.							
sion <i>B</i> , in.	0.05	0.10	0.12	0.14	0.16	0.18	0.20	0.22	0.24	0.26	0.28	0.30	0.32	0.34	0.36	0.38	0.40
0.05	98	96	95	94	94	93	92	91	90	90	89	88	87	86	85	85	84
0.10	96	92	90	89	87	85	84	82	81	79	77	76	74	73	71	69	68
0.12	95	90	88	86	85	83	81	79	77	75	73	71	69	67	65	63	61
0.14	94	89	86	84	82	80	77	75	73	71	68	66	64	62	59	57	55
0.16	94	87	85	82	79	77	74	72	69	67	64	61	59	56	53	51	48
0.18	93	85	83	80	77	74	72	68	65	62	59	56	54	51	48	45	42
0.20	92	84	81	77	74	72	68	65	61	58	55	52	48	45	42	39	36
0.22	91	82	79	75	72	68	65	61	57	54	50	47	43	40	36	33	29
0.24	90	81	77	73	69	65	61	57	54	50	46	42	38	34	30	27	23
0.26	90	79	75	71	67	62	58	54	50	46	41	37	33	29	25	20	16
0.28	89	77	73	68	64	59	55	50	46	41	37	32	28	23	18	14	10
0.30	88	76	71	66	61	56	52	47	42	37	32	27	23	18	13	9	3
0.31	88	75	70	65	60	55	50	45	40	35	30	25	20	18	10	5	0

26.4.3.4 Measure the amount of expansion on each side of each half relative to the plane defined by the undeformed portion of the side of the specimen using a gauge similar to that shown in Figs. 16 and 17.

26.4.3.5 Since the fracture path seldom bisects the point of maximum expansion on both sides of a specimen, the sum of the larger values measured for each side is the value of the test. Arrange the halves of one specimen so that compression sides are facing each other. Using the gauge, measure the protrusion on each half specimen, ensuring that the same side of the specimen is measured. Measure the two broken halves individually. Repeat the procedure to measure the protrusions on

the opposite side of the specimen halves. The larger of the two values for each side is the expansion of that side of the specimen.

26.4.3.6 Measure the individual lateral expansion values to the nearest mil (0.025 mm) and record the values.

26.4.3.7 With the exception described as follows, any specimen that does not separate into two pieces when struck by a single blow shall be reported as unbroken. The lateral expansion of an unbroken specimen can be reported as broken if the specimen can be separated by pushing the hinged halves together once and then pulling them apart without further fatiguing the specimen, and the lateral expansion measured for

TABLE 8 Percent Shear for Measurements Made in Millimetres

Note 1—Since this table is set up for fir	nite measurements or dimensions	A and R 100 % shear is to be ren	orted when either A or B is zero

Dimen-									Dime	ension A	, mm								
sion <i>B</i> , mm	1.0	1.5	2.0	2.5	3.0	3.5	4.0	4.5	5.0	5.5	6.0	6.5	7.0	7.5	8.0	8.5	9.0	9.5	10
1.0	99	98	98	97	96	96	95	94	94	93	92	92	91	91	90	89	89	88	88
1.5	98	97	96	95	94	93	92	92	91	90	89	88	87	86	85	84	83	82	81
2.0	98	96	95	94	92	91	90	89	88	86	85	84	82	81	80	79	77	76	75
2.5	97	95	94	92	91	89	88	86	84	83	81	80	78	77	75	73	72	70	69
3.0	96	94	92	91	89	87	85	83	81	79	77	76	74	72	70	68	66	64	62
3.5	96	93	91	89	87	85	82	80	78	76	74	72	69	67	65	63	61	58	56
4.0	95	92	90	88	85	82	80	77	75	72	70	67	65	62	60	57	55	52	50
4.5	94	92	89	86	83	80	77	75	72	69	66	63	61	58	55	52	49	46	44
5.0	94	91	88	85	81	78	75	72	69	66	62	59	56	53	50	47	44	41	37
5.5	93	90	86	83	79	76	72	69	66	62	59	55	52	48	45	42	38	35	31
6.0	92	89	85	81	77	74	70	66	62	59	55	51	47	44	40	36	33	29	25
6.5	92	88	84	80	76	72	67	63	59	55	51	47	43	39	35	31	27	23	19
7.0	91	87	82	78	74	69	65	61	56	52	47	43	39	34	30	26	21	17	12
7.5	91	86	81	77	72	67	62	58	53	48	44	39	34	30	25	20	16	11	6
8.0	90	85	80	75	70	65	60	55	50	45	40	35	30	25	20	15	10	5	0

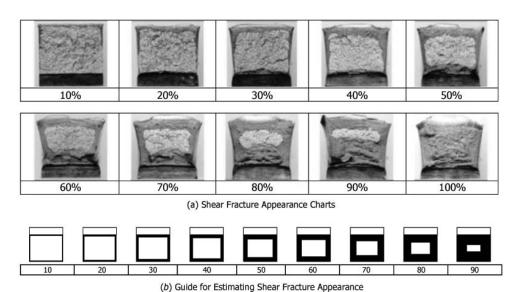


FIG. 14 Fracture Appearance Charts and Percent Shear Fracture Comparator

the unbroken specimen (prior to bending) is equal to or greater than that measured for the separated halves. In the case where a specimen cannot be separated into two halves, the lateral expansion can be measured as long as the shear lips can be accessed without interference from the hinged ligament that has been deformed during testing.

27. Interpretation of Test Result

- 27.1 When the acceptance criterion of any impact test is specified to be a minimum average value at a given temperature, the test result shall be the average (arithmetic mean rounded to the nearest ft-lbf (J)) of the individual test values of three specimens from one test location.
 - 27.1.1 When a minimum average test result is specified:
- 27.1.1.1 The test result is acceptable when all of the below are met:

- (1) The test result equals or exceeds the specified minimum average (given in the specification),
- (2) The individual test value for not more than one specimen measures less than the specified minimum average, and
- (3) The individual test value for any specimen measures not less than two-thirds of the specified minimum average.
- 27.1.1.2 If the acceptance requirements of 27.1.1.1 are not met, perform one retest of three additional specimens from the same test location. Each individual test value of the retested specimens shall be equal to or greater than the specified minimum average value.
 - 27.2 Test Specifying a Minimum Transition Temperature:
 - 27.2.1 Determination of Transition Temperature:
- 27.2.1.1 Break one specimen at each of a series of temperatures above and below the anticipated transition temperature

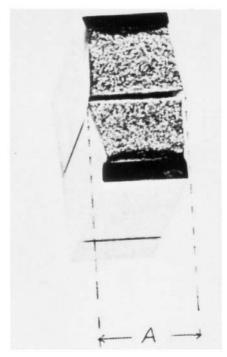


FIG. 15 Halves of Broken Charpy V-notch Impact Specimen Joined for Measurement of Lateral Expansion, Dimension A


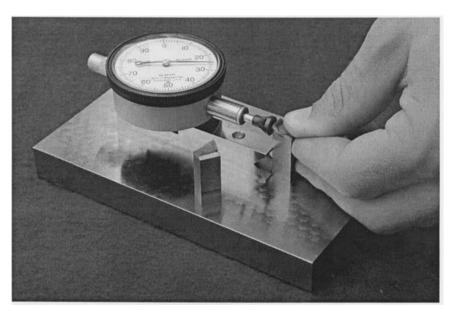


FIG. 16 Lateral Expansion Gauge for Charpy Impact Specimens

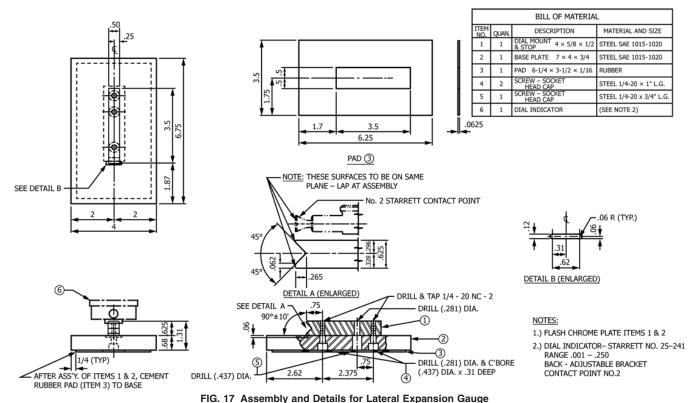

using the procedures in Section 26. Record each test temperature to the nearest 1 °F (0.5 °C).

27.2.1.2 Plot the individual test results (ft-lbf or percent shear) as the ordinate versus the corresponding test temperature as the abscissa and construct a best-fit curve through the plotted

27.2.1.3 If transition temperature is specified as the temperature at which a test value is achieved, determine the temperature at which the plotted curve intersects the specified test value by graphical interpolation (extrapolation is not permitted). Record this transition temperature to the nearest 5 °F (3 °C). If the tabulated test results clearly indicate a transition temperature lower than specified, it is not necessary to plot the data. Report the lowest test temperature for which test value exceeds the specified value.

27.2.1.4 Accept the test result if the determined transition temperature is equal to or lower than the specified value.

27.2.1.5 If the determined transition temperature is higher than the specified value, but not more than 20 °F (12 °C) higher than the specified value, test sufficient samples in accordance with Section 26 to plot two additional curves. Accept the test results if the temperatures determined from both additional tests are equal to or lower than the specified value.

27.3 When subsize specimens are permitted or necessary, or both, modify the specified test requirement according to Table 9 or test temperature according to ASME Boiler and Pressure Vessel Code, Table UG-84.2, or both. Greater energies or lower test temperatures may be agreed upon by purchaser and supplier.

28. Records

28.1 The test record should contain the following information as appropriate:

28.1.1 Full description of material tested (that is, specification number, grade, class or type, size, heat number).

28.1.2 Specimen orientation with respect to the material

28.1.3 Specimen size.

28.1.4 Test temperature and individual test value for each specimen broken, including initial tests and retests.

28.1.5 Test results.

28.1.6 Transition temperature and criterion for its determination, including initial tests and retests.

TABLE 9 Charpy V-notch Test Acceptance Criteria for Various Sub-size Specimens^{A,B,C}

	Size,	3/4 S	Size, 7.5 mm	2/3 S			Size, 5 mm	1/3 S	Size, 3.3 mm		Size, 2.5 mm
ft-lbf	[J]	ft-lbf	[J]	ft-lbf	[J]	ft-lbf	[J]	ft-lbf	[J]	ft-lbf	[J]
75	[102]	56	[76]	50	[68]	38	[52]	25	[34]	19	[26]
70	[95]	53	[72]	47	[64]	35	[48]	23	[31]	18	[24]
65	[88]	49	[67]	44	[60]	33	[45]	21	[29]	16	[22]
60	[82]	45	[61]	40	[54]	30	[41]	20	[27]	15	[20]
55	[75]	41	[56]	37	[50]	28	[38]	18	[24]	14	[19]
50	[68]	38	[52]	34	[46]	25	[34]	17	[23]	13	[18]
45	[61]	34	[46]	30	[41]	23	[31]	15	[20]	11	[15]
40	[54]	30	[41]	27	[37]	20	[27]	13	[18]	10	[14]
35	[48]	26	[35]	23	[31]	18	[24]	12	[16]	9	[12]
30	[41]	22	[30]	20	[27]	15	[20]	10	[14]	8	[11]
25	[34]	19	[26]	17	[23]	12	[16]	8	[11]	6	[8]
20	[27]	15	[20]	13	[18]	10	[14]	7	[10]	5	[7]
16	[22]	12	[16]	11	[15]	8	[11]	5	[7]	4	[5]
15	[20]	11	[15]	10	[14]	8	[11]	5	[7]	4	[5]
13	[18]	10	[14]	9	[12]	6	[8]	4	[5]	3	[4]
12	[16]	9	[12]	8	[11]	6	[8]	4	[5]	3	[4]
10	[14]	8	[11]	7	[10]	5	[7]	3	[4]	2	[3]
7	[10]	5	[7]	5	[7]	4	[5]	2	[3]	2	[3]

A Care must be taken when using Table 9 for the conversion of subsize specimen absorbed energy results to those values that may be expected from full size Charpy specimens. The use of conversion values should only be applied when both specimens types (full-size and sub-size) are in the same fracture regime (in other words. a lower shelf, transition, or upper shelf) at the test temperature for the material under investigation. In particular test specimens <5 mm can exhibit variable absorbed energy

29. Report

29.1 The specification should designate the information to be reported.

IZOD IMPACT TEST

30. Procedure

30.1 Testing equipment and methods are given in Test Methods E23.

31. Precision and Bias

31.1 The precision and bias of these test methods for measuring mechanical properties are essentially as specified in Test Methods E8/E8M, E10, E18, and E23.

32. Keywords

32.1 bend test; Brinell hardness; Charpy impact test; elongation; FATT (Fracture Appearance Transition Temperature); hardness test; Izod impact test; portable hardness; reduction of area; Rockwell hardness; tensile strength; tension test; yield strength

ANNEXES

(Mandatory Information)

A1. STEEL BAR PRODUCTS

A1.1 Scope

A1.1.1 This annex contains testing requirements for Steel Bar Products that are specific to the product. The requirements contained in this annex are supplementary to those found in the general section of this specification. In the case of conflict between requirements provided in this annex and those found in the general section of this specification, the requirements of this annex shall prevail. In the case of conflict between requirements provided in this annex and requirements found in product specifications, the requirements found in the product specification shall prevail.

values (NIST Technical Note 1858). (1)

^B Limit based upon presentation by Kim Wallin, VTT, "Sub-sized CVN Specimen Conversion Methodology 4, Slide #10," which shows a common relationship for sub-sized specimens up to 75 ft-lbf (102J). (2)

^C Analysis of Data from NIST Note 1858 by J. A. Griffin, UAB, ASTM A01.13 Task Group meeting, San Antonio, TX 5.4.16. (1)

A1.2 Orientation of Test Specimens

A1.2.1 Carbon and alloy steel bars and bar-size shapes, due to their relatively small cross-sectional dimensions, are customarily tested in the longitudinal direction. In special cases where size permits and the fabrication or service of a part justifies testing in a transverse direction, the selection and location of test or tests are a matter of agreement between the manufacturer and the purchaser.

A1.3 Tension Test

A1.3.1 Carbon Steel Bars—Carbon steel bars are not commonly specified to tensile requirements in the as-rolled condition for sizes of rounds, squares, hexagons, and octagons under ½ in. (13 mm) in diameter or distance between parallel faces nor for other bar-size sections, other than flats, less than 1 in.² (645 mm²) in cross-sectional area.

- A1.3.2 *Alloy Steel Bars*—Alloy steel bars are usually not tested in the as-rolled condition.
- A1.3.3 When tension tests are specified, the practice for selecting test specimens for hot-rolled and cold-finished steel bars of various sizes shall be in accordance with Table A1.1, unless otherwise specified in the product specification.

A1.4 Bend Test

A1.4.1 When bend tests are specified, the recommended practice for hot-rolled and cold-finished steel bars shall be in accordance with Table A1.2.

A1.5 Hardness Test

A1.5.1 Hardness Tests on Bar Products (flats, rounds, squares, hexagons, and octagons) are conducted on the surface after a minimum removal of 0.015 in. to provide for accurate

TABLE A1.1 Practices for Selecting Tension Test Specimens for Steel Bar Products

Note 1—For bar sections where it is difficult to determine the cross-sectional area by simple measurement, the area in square inches may be calculated by dividing the weight per linear inch of specimen in pounds by 0.2833 (weight of 1 in.³ of steel) or by dividing the weight per linear foot of specimen by 3.4 (weight of steel 1 in. square and 1 ft long).

Thickness, in. (mm)	Width, in. (mm)	Hot-Rolled Bars		Cold-Finished Bars
		Flats		
Under % (16)	Up to 1½ (38), incl	Full section by 8-in. (200 mm) g length (Fig. 3).	auge	Mill reduced section to 2-in. (50 mm) gauge length and approximately 25 % less than test specimen width.
	Over 1½ (38)	Full section, or mill to 1½ in. (38 wide by 8-in. (200 mm) gauge le 3).		Mill reduced section to 2-in. gauge length and $1\frac{1}{2}$ in. wide.
5% to 1½ (16 to 38), excl	Up to 1½ (38), incl	Full section by 8-in. gauge lengthine standard ½ by 2-in. (13 by gauge length specimen from ce section (Fig. 4).	y 50 mm)	Mill reduced section to 2-in. (50 mm) gauge length and approximately 25 % less than test specimen width or machine standard ½ by 2-in. (13 by 50 mm) gauge length specimen from center of section (Fig. 4).
	Over 1½ (38)	Full section, or mill 1½ in. (38 n by 8-in. (200 mm) gauge length machine standard ½ by 2-in. ga by 50 mm) gauge length specim midway between edge and cent tion (Fig. 4).	(Fig. 3) or luge (13 nen from	Mill reduced section to 2-in. gauge length and 1½ in. wide or machine standard ½ by 2-in. gauge length specimen from midway between edge and center of section (Fig. 4).
$1\frac{1}{2}$ (38) and over		Full section by 8-in. (200 mm) g length, or machine standard ½ (13 by 50 mm) gauge length sp from midway between surface a (Fig. 4).	by 2-in. ecimen	Machine standard ½ by 2-in. (13 by 50 mm) gauge length specimen from midway between surface and center (Fig. 4).
		Rounds, Squares, Hexagons, and Oc	tagons	
Diameter or Distance Between Parallel Faces, in. (mm)	l	Hot-Rolled Bars		Cold-Finished Bars
Under 5⁄8		in. (200 mm) gauge length or ma- specimen (Fig. 4).	Machine to	sub-size specimen (Fig. 4).
5/s to 11/2 (16 to 38), excl	chine standard 1/2	in. (200 mm) gauge length or ma- in. by 2-in. (13 by 50 mm) gauge from center of section (Fig. 4).		tandard ½ in. by 2-in. gauge length specimen er of section (Fig. 4).
$11/_{\! 2}$ (38) and over	chine standard 1/2	· · · ·		tandard $\frac{1}{2}$ in. by 2-in. (13 by 50 mm gauge lengt from midway between surface and center of sec- l)).
All sizes		Other Bar-size Sections in. (200 mm) gauge length or pre- en 1½ in. (38 mm) wide (if possible) gauge length.		ad section to 2-in. (50 mm) gauge length and appy 25 $\%$ less than test specimen width.

TABLE A1.2 Recommended Practice for Selecting Bend Test Specimens for Steel Bar Products

Note 1—The length of all specimens is to be not less than 6 in. (150 mm).

Note 2—The edges of the specimen may be rounded to a radius not exceeding 1/16 in. (1.6 mm).

	Flats	
Thickness, in. (mm)	Width, in. (mm)	Recommended Size
Up to ½ (13), incl	Up to 3/4 (19), incl	Full section.
	Over ¾ (19)	Full section or machine to not less than ot less than 3 4 in. (19 mm) in width by thickness of specimen.
Over ½ (13)	All	Full section or machine to 1 by $1\!\!/\!\!2$ in. (25 by 13 mm) specimen from midway between center and surface.
	Rounds, Squares, Hexagons, and Octago	ns
Diameter or Distance Between Parallel Faces	, in. (mm)	Recommended Size
Up to 1½ (38), incl		Full section.
Over 1½ (38)	Machine to 1 by	½-in. (25 by 13 mm) specimen from midway between center and surface.

hardness penetration.

A2. STEEL TUBULAR PRODUCTS

A2.1 Scope

A2.1.1 This annex contains testing requirements for Steel Tubular Products that are specific to the product. The requirements contained in this annex are supplementary to those found in the general section of this specification. In the case of conflict between requirements provided in this annex and those found in the general section of this specification, the requirements of this annex shall prevail. In the case of conflict between requirements provided in this annex and requirements found in product specifications, the requirements found in the product specification shall prevail.

A2.1.2 Tubular shapes covered by this specification include, round, square, rectangular, and special shapes.

A2.2 Tension Test

A2.2.1 Full-size Longitudinal Test Specimens:

A2.2.1.1 As an alternative to the use of longitudinal strip test specimens or longitudinal round test specimens, tension test specimens of full-size tubular sections are used, provided that the testing equipment has sufficient capacity. Snug-fitting metal plugs should be inserted far enough in the end of such tubular specimens to permit the testing machine jaws to grip the specimens properly without crushing. A design that may be used for such plugs is shown in Fig. A2.1. The plugs shall not extend into that part of the specimen on which the elongation is measured (see Fig. A2.1). Care should be exercised to see that insofar as practicable, the load in such cases is applied axially. The length of the full-section specimen depends on the gauge length prescribed for measuring the elongation.

A2.2.1.2 Unless otherwise required by the product specification, the gauge length is 2 in. or 50 mm, except that for tubing having an outside diameter of $\frac{3}{8}$ in. (9.5 mm) or less, it is customary for a gauge length equal to four times the outside




FIG. A2.1 Metal Plugs for Testing Tubular Specimens, Proper Location of Plugs in Specimen and of Specimen in Heads of Testing Machine

diameter to be used when elongation comparable to that obtainable with larger test specimens is required.

A2.2.1.3 To determine the cross-sectional area of the full-section specimen, measurements shall be recorded as the average or mean between the greatest and least measurements of the outside diameter and the average or mean wall thickness, to the nearest 0.001 in. (0.025 mm) and the cross-sectional area is determined by the following equation:

$$A = 3.1416t (D - t) \tag{A2.1}$$

where:

 $A = \text{sectional area, in.}^2$

D = outside diameter, in., and

t = thickness of tube wall, in.

Note A2.1—There exist other methods of cross-sectional area determination, such as by weighing of the specimens, which are equally

accurate or appropriate for the purpose.

A2.2.2 Longitudinal Strip Test Specimens:


A2.2.2.1 As an alternative to the use of full-size longitudinal test specimens or longitudinal round test specimens, longitudinal strip test specimens, obtained from strips cut from the tubular product as shown in Fig. A2.2 and machined to the dimensions shown in Fig. A2.3 are used. For welded structural tubing, such test specimens shall be from a location at least 90° from the weld; for other welded tubular products, such test specimens shall be from a location approximately 90° from the weld. Unless otherwise required by the product specification, the gauge length shall conform to dimension C in Fig. A2.3. The test specimens shall be tested using grips that are flat or have a surface contour corresponding to the curvature of the tubular product, or the ends of the test specimens shall be flattened without heating prior to the test specimens being tested using flat grips. The test specimen shown as specimen 4 in Fig. 3 shall be used, unless the capacity of the testing equipment or the dimensions and nature of the tubular product to be tested makes the use of specimen nos. 1, 2, or 3 necessary.

Note A2.2—An exact formula for calculating the cross-sectional area of specimens of the type shown in Fig. A2.3 taken from a circular tube is given in Test Methods E8/E8M.

A2.2.2.2 The width should be measured at each end of the gauge length to determine parallelism and also at the center. The thickness should be measured at the center and used with the center measurement of the width to determine the cross-sectional area. The center width dimension should be recorded to the nearest 0.005 in. (0.127 mm), and the thickness measurement to the nearest 0.001 in.

A2.2.3 Transverse Strip Test Specimens:

A2.2.3.1 In general, transverse tension tests are not recommended for tubular products, in sizes smaller than 8 in. in nominal diameter. When required, transverse tension test specimens may be taken from rings cut from ends of tubes or pipe as shown in Fig. A2.4. Flattening of the specimen may be done either after separating it from the tube as in Fig. A2.4 (a), or before separating it as in Fig. A2.4 (b), and may be done hot or cold; but if the flattening is done cold, the specimen may subsequently be normalized. Specimens from tubes or pipe for which heat treatment is specified, after being flattened either hot or cold, shall be given the same treatment as the tubes or



 ${\it Note}$ 1—The edges of the blank for the specimen shall be cut parallel to each other.

FIG. A2.2 Location of Longitudinal Tension—Test Specimens in Rings Cut From Tubular Products

pipe. For tubes or pipe having a wall thickness of less than ³/₄ in. (19 mm), the transverse test specimen shall be of the form and dimensions shown in Fig. A2.5 and either or both surfaces may be machined to secure uniform thickness. Specimens for transverse tension tests on welded steel tubes or pipe to determine strength of welds, shall be located perpendicular to the welded seams with the weld at about the middle of their length.

A2.2.3.2 The width should be measured at each end of the gauge length to determine parallelism and also at the center. The thickness should be measured at the center and used with the center measurement of the width to determine the cross-sectional area. The center width dimension should be recorded to the nearest 0.005 in. (0.127 mm), and the thickness measurement to the nearest 0.001 in. (0.025 mm).

A2.2.4 Round Test Specimens:

A2.2.4.1 When provided for in the product specification, the round test specimen shown in Fig. 4 may be used.

A2.2.4.2 The diameter of the round test specimen is measured at the center of the specimen to the nearest 0.001 in. (0.025 mm).

A2.2.4.3 Small-size specimens proportional to standard, as shown in Fig. 4, may be used when it is necessary to test material from which the standard specimen cannot be prepared. Other sizes of small-size specimens may be used. In any such small-size specimen, it is important that the gauge length for measurement of elongation be four times the diameter of the specimen (see Note 5, Fig. 4). The elongation requirements for the round specimen 2-in. gauge length in the product specification shall apply to the small-size specimens.

A2.2.4.4 For transverse specimens, the section from which the specimen is taken shall not be flattened or otherwise deformed.

A2.2.4.5 Longitudinal test specimens are obtained from strips cut from the tubular product as shown in Fig. A2.2.


A2.3 Determination of Transverse Yield Strength, Hydraulic Ring-expansion Method

A2.3.1 Hardness tests are made on the outside surface, inside surface, or wall cross-section depending upon product-specification limitation. Surface preparation may be necessary to obtain accurate hardness values.

A2.3.2 A testing machine and method for determining the transverse yield strength from an annular ring specimen, have been developed and described in A2.3.3 - 9.1.2.

A2.3.3 A diagrammatic vertical cross-sectional sketch of the testing machine is shown in Fig. A2.6.

A2.3.4 In determining the transverse yield strength on this machine, a short ring (commonly 3 in. (76 mm) in length) test specimen is used. After the large circular nut is removed from the machine, the wall thickness of the ring specimen is determined and the specimen is telescoped over the oil resistant rubber gasket. The nut is then replaced, but is not turned down tight against the specimen. A slight clearance is left between the nut and specimen for the purpose of permitting free radial movement of the specimen as it is being tested. Oil under pressure is then admitted to the interior of the rubber gasket



DIMENSIONS

Canaiman Na		Dimension	s, in.	
Specimen No.	А	В	С	D
1	½ ± 0.015	11/16 approximately	2 ± 0.005	21/4 min
2	$\frac{3}{4} \pm 0.031$	1 approximately	2 ± 0.005	21/4 min
			4 ± 0.005	4½ min
3	1± 0.062	11/2 approximately	2 ± 0.005	21/4 min
			4 ± 0.005	4½ min
4	1½ ± .125	2 approximately	2 ± 0.010	21/4 min
			4 ± 0.015	4½ min
			8 ± 0.020	9 min
5	$\frac{1}{4} \pm .002$	3/8 approximately	1 ± 0.003	1 1/4 min

Note 1—Cross-sectional area may be calculated by multiplying A and t.

Note 2—The dimension t is the thickness of the test specimen as provided for in the applicable material specifications.

Note 3—The reduced section shall be parallel within 0.010 in. and may have a gradual taper in width from the ends toward the center, with the ends not more than 0.010 in. wider than the center.

Note 4—The ends of the specimen shall be symmetrical with the center line of the reduced section within 0.10 in.

Note 5—Metric equivalent: 1 in. = 25.4 mm.

Note 6—Specimens with sides parallel throughout their length are permitted, except for referee testing, provided: (a) the above tolerances are used; (b) an adequate number of marks are provided for determination of elongation; and (c) when yield strength is determined, a suitable extensometer is used. If the fracture occurs at a distance of less than 2A from the edge of the gripping device, the tensile properties determined may not be representative of the material. If the properties meet the minimum requirements specified, no further testing is required, but if they are less than the minimum requirements, discard the test and retest.

Note 7—Specimen 5 is intended for testing specimens removed from an in-service product. Specimen 5 shall not be used for conformance testing of new product. Acceptance criteria for elongation values obtained from 1 in. gauge length specimens shall be determined by agreement between the responsible parties.

FIG. A2.3 Dimensions and Tolerances for Longitudinal Strip Tension Test Specimens for Tubular Products





FIG. A2.4 Location of Transverse Tension Test Specimens in Ring Cut from Tubular Products.

through the pressure line under the control of a suitable valve. An accurately calibrated pressure gauge serves to measure oil pressure. Any air in the system is removed through the bleeder line. As the oil pressure is increased, the rubber gasket expands which in turn stresses the specimen circumferentially. As the pressure builds up, the lips of the rubber gasket act as a seal to prevent oil leakage. With continued increase in pressure, the ring specimen is subjected to a tension stress and elongates accordingly. The entire outside circumference of the ring specimen is considered as the gauge length and the strain is measured with a suitable extensometer which will be described later. When the desired total strain or extension under load is reached on the extensometer, the oil pressure in pounds per square inch is read and by employing Barlow's formula, the unit yield strength is calculated. The yield strength, thus determined, is a true result since the test specimen has not been



Note 1—The dimension t is the thickness of the test specimen as provided for in the applicable material specifications.

Note 2—The reduced section shall be parallel within 0.010 in. and may have a gradual taper in width from the ends toward the center, with the ends not more than 0.010 in. wider than the center.

Note 3—The ends of the specimen shall be symmetrical with the center line of the reduced section within $0.10\,\mathrm{in}$.

Note 4—Metric equivalent: 1 in. = 25.6 mm.

FIG. A2.5 Transverse Tension Test Specimen Machined From Ring Cut from Tubular Products

cold worked by flattening and closely approximates the same condition as the tubular section from which it is cut. Further, the test closely simulates service conditions in pipe lines. One testing machine unit may be used for several different sizes of pipe by the use of suitable rubber gaskets and adapters.

Note A2.3—Barlow's formula may be stated two ways:




FIG. A2.6 Testing Machine for Determination of Transverse Yield Strength from Annular Ring Specimens

$$(1) P = 2St/D \tag{A2.2}$$

$$(2) S = PD/2t \tag{A2.3}$$

where:

P = internal hydrostatic pressure, psi,

S = unit circumferential stress in the wall of the tube produced by the internal hydrostatic pressure, psi,

= thickness of the tube wall, in., and

D = outside diameter of the tube, in.

A2.3.5 A roller chain type extensometer which has been found satisfactory for measuring the elongation of the ring specimen is shown in Figs. A2.7 and A2.8. Fig. A2.7 shows the extensometer in position, but unclamped, on a ring specimen. A small pin, through which the strain is transmitted to and measured by the dial gauge, extends through the hollow threaded stud. When the extensometer is clamped, as shown in Fig. A2.8, the desired tension which is necessary to hold the instrument in place and to remove any slack, is exerted on the roller chain by the spring. Tension on the spring may be

regulated as desired by the knurled thumb screw. By removing or adding rollers, the roller chain may be adapted for different sizes of tubular sections.

A2.4 Hardness Tests

A2.4.1 Hardness tests are made either on the outside or the inside surfaces on the end of the tube as appropriate.

A2.4.2 The standard 3000 kgf Brinell load may cause too much deformation in a thin-walled tubular specimen. In this case the 500 kgf load shall be applied, or inside stiffening by means of an internal anvil should be used. Brinell testing shall not be applicable to tubular products less than 2 in. (51 mm) in outside diameter, or less than 0.200 in. (5.1 mm) in wall thickness.

A2.4.3 The Rockwell hardness tests are normally made on the inside surface, a flat on the outside surface, or on the wall cross-section depending upon the product limitation. Rockwell hardness tests are not performed on tubes smaller than 5/16 in. (7.9 mm) in outside diameter, nor are they performed on the inside surface of tubes with less than 1/4 in. (6.4 mm) inside diameter. Rockwell hardness tests are not performed on annealed tubes with walls less than 0.065 in. (1.65 mm) thick or cold worked or heat treated tubes with walls less than 0.049 in. (1.24 mm) thick. For tubes with wall thicknesses less than those permitting the regular Rockwell hardness test, the Superficial Rockwell test is sometimes substituted. Transverse Rockwell hardness readings can be made on tubes with a wall thickness of 0.187 in. (4.75 mm) or greater. The curvature and the wall thickness of the specimen impose limitations on the

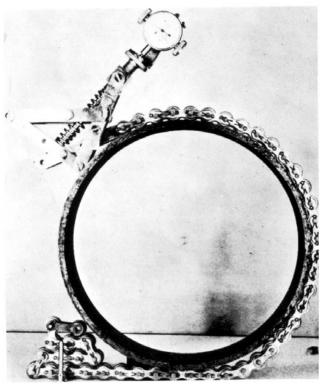


FIG. A2.7 Roller Chain Type Extensometer, Unclamped

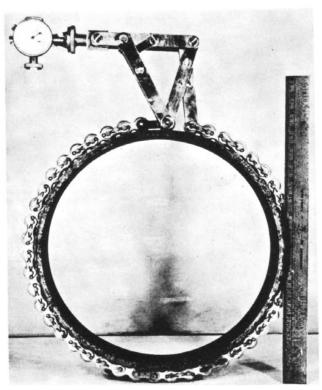


FIG. A2.8 Roller Chain Type Extensometer, Clamped

Rockwell hardness test. When a comparison is made between Rockwell determinations made on the outside surface and determinations made on the inside surface, adjustment of the readings will be required to compensate for the effect of curvature. The Rockwell B scale is used on all materials having an expected hardness range of B0 to B100. The Rockwell C scale is used on material having an expected hardness range of C20 to C68.

A2.4.4 Superficial Rockwell hardness tests are normally performed on the outside surface whenever possible and whenever excessive spring back is not encountered. Otherwise, the tests may be performed on the inside. Superficial Rockwell hardness tests shall not be performed on tubes with an inside diameter of less than ¼ in. (6.4 mm). The wall thickness limitations for the Superficial Rockwell hardness test are given in Tables A2.1 and A2.2.

A2.4.5 When the outside diameter, inside diameter, or wall thickness precludes the obtaining of accurate hardness values, tubular products shall be specified to tensile properties and so tested.

A2.5 Manipulating Tests

A2.5.1 The following tests are made to prove ductility of certain tubular products:

A2.5.1.1 Flattening Test—The flattening test as commonly made on specimens cut from tubular products is conducted by subjecting rings from the tube or pipe to a prescribed degree of flattening between parallel plates (see Fig. A2.4). The severity of the flattening test is measured by the distance between the parallel plates and is varied according to the dimensions of the tube or pipe. The flattening test specimen should not be less than $2\frac{1}{2}$ in. (63.5 mm) in length and should be flattened cold to the extent required by the applicable material specifications.

A2.5.1.2 Reverse Flattening Test—The reverse flattening test is designed primarily for application to electric-welded tubing for the detection of lack of penetration or overlaps resulting from flash removal in the weld. The specimen consists of a length of tubing approximately 4 in. (102 mm) long which is split longitudinally 90° on each side of the weld. The sample is then opened and flattened with the weld at the point of maximum bend (see Fig. A2.9).

TABLE A2.1 Wall Thickness Limitations of Superficial Hardness Test on Annealed or Ductile Materials for Steel Tubular Products^A

("T" Scale (1/4e-in, Ball))

(1 Scale (7)	in. Builly
Wall Thickness, in. (mm)	Load, kgf
Over 0.050 (1.27)	45
Over 0.035 (0.89)	30
0.020 and over (0.51)	15

A The heaviest load recommended for a given wall thickness is generally used.

TABLE A2.2 Wall Thickness Limitations of Superficial Hardness Test on Cold Worked or Heat Treated Material for Steel Tubular Products^A ("N" Scale (Diamond Penetrator))

Wall Thickness, in. (mm)	Load, kgf
Over 0.035 (0.89)	45
Over 0.025 (0.51)	30
0.015 and over (0.38)	15

A The heaviest load recommended for a given wall thickness is generally used.




FIG. A2.9 Reverse Flattening Test

A2.5.1.3 Crush Test—The crush test, sometimes referred to as an upsetting test, is usually made on boiler and other pressure tubes, for evaluating ductility (see Fig. A2.10). The specimen is a ring cut from the tube, usually about 21/2 in. (63.5 mm) long. It is placed on end and crushed endwise by hammer or press to the distance prescribed by the applicable material specifications.

A2.5.1.4 Flange Test—The flange test is intended to determine the ductility of boiler tubes and their ability to withstand the operation of bending into a tube sheet. The test is made on






FIG. A2.10 Crush Test Specimen


a ring cut from a tube, usually not less than 4 in. (100 mm) long and consists of having a flange turned over at right angles to the body of the tube to the width required by the applicable material specifications. The flaring tool and die block shown in Fig. A2.11 are recommended for use in making this test.

A2.5.1.5 Flaring Test—For certain types of pressure tubes, an alternate to the flange test is made. This test consists of driving a tapered mandrel having a slope of 1 in 10 as shown in Fig. A2.12 (a) or a 60° included angle as shown in Fig. A2.12 (b) into a section cut from the tube, approximately 4 in. (100 mm) in length, and thus expanding the specimen until the inside diameter has been increased to the extent required by the applicable material specifications.

A2.5.1.6 Bend Test—For pipe used for coiling in sizes 2 in. and under a bend test is made to determine its ductility and the soundness of weld. In this test a sufficient length of full-size pipe is bent cold through 90° around a cylindrical mandrel having a diameter 12 times the nominal diameter of the pipe. For close coiling, the pipe is bent cold through 180° around a mandrel having a diameter 8 times the nominal diameter of the pipe.

A2.5.1.7 Transverse Guided Bend Test of Welds—This bend test is used to determine the ductility of fusion welds. The specimens used are approximately 1½ in. (38 mm) wide, at least 6 in. (152 mm) in length with the weld at the center, and are machined in accordance with Fig. A2.13 for face and root bend tests and in accordance with Fig. A2.14 for side bend tests. The dimensions of the plunger shall be as shown in Fig. A2.15 and the other dimensions of the bending jig shall be substantially as given in this same figure. A test shall consist of a face bend specimen and a root bend specimen or two side bend specimens. A face bend test requires bending with the inside surface of the pipe against the plunger; a root bend test requires bending with the outside surface of the pipe against the plunger; and a side bend test requires bending so that one of the side surfaces becomes the convex surface of the bend specimen.

(1) Failure of the bend test depends upon the appearance of cracks in the area of the bend, of the nature and extent described in the product specifications.

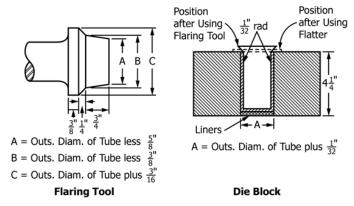

Note 1—Metric equivalent: 1 in. = 25.4 mm.

FIG. A2.11 Flaring Tool and Die Block for Flange Test






FIG. A2.12 Tapered Mandrels for Flaring Test

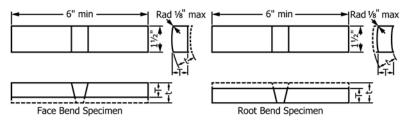

Note 1—Metric equivalent: 1 in. = 25.4 mm.

Pipe Wall Thickness (t), in.	Test Specimen Thickness, in.
Up to 3/8, incl	t
Over 3/8	3/8


FIG. A2.13 Transverse Face- and Root-bend Test Specimens



 Specimens may be cut into approximately equal strips between 3/4 in. and 1½ in. wide for testing or the specimens may be bent at full width (see requirements on jig width in Fig. A2.15.)

Note 1—Metric equivalent: 1 in. = 25.4 mm.

FIG. A2.14 Side-bend Specimen for Ferrous Materials

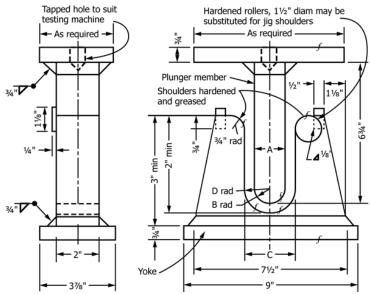

Note 1—Metric equivalent: 1 in. = 25.4 mm.

Test Specimen Thickness, in.	А	В	С	D	
3/8	11/2	3/4	23/8	13/16	
t	4 <i>t</i>	2 <i>t</i>	$6t + \frac{1}{8}$	$3t + \frac{1}{16}$	
					Material
3/8	21/2	11/4	3%	1 ¹¹ / ₁₆	Materials with a specified minimum tensile strength of 95 ksi or
t	6²⁄₃ t	31/3 t	8 ² / ₃ t + ¹ / ₈	$4\frac{1}{2}t + \frac{1}{16}$	greater.

FIG. A2.15 Guided-bend Test Jig

A3. STEEL FASTENERS

A3.1 Scope

A3.1.1 This annex contains testing requirements for Steel Fasteners that are specific to the product. The requirements contained in this annex are supplementary to those found in the general section of this specification. In the case of conflict between requirements provided in this annex and those found in the general section of this specification, the requirements of this annex shall prevail. In the case of conflict between requirements provided in this annex and requirements found in product specifications, the requirements found in the product specification shall prevail.

A3.1.2 These tests are set up to facilitate production control testing and acceptance testing with certain more precise tests to be used for arbitration in case of disagreement over test results.

A3.2 Tension Tests

A3.2.1 It is preferred that bolts be tested full size, and it is customary, when so testing bolts to specify a minimum ultimate load in pounds, rather than a minimum ultimate strength in pounds per square inch. Three times the bolt nominal diameter has been established as the minimum bolt length subject to the tests described in the remainder of this

section. Subsections A3.2.1.1 – A3.2.1.6 apply when testing bolts full size. Subsection A3.2.1.4 shall apply where the individual product specifications permit the use of machined specimens.

A3.2.1.1 *Proof Load*—Due to particular uses of certain classes of bolts it is desirable to be able to stress them, while in use, to a specified value without obtaining any permanent set. To be certain of obtaining this quality the proof load is specified. The proof load test consists of stressing the bolt with a specified load which the bolt must withstand without permanent set. An alternate test which determines yield strength of a full size bolt is also allowed. Either of the following Methods, 1 or 2, may be used but Method 1 shall be the arbitration method in case of any dispute as to acceptance of the bolts.

A3.2.1.2 *Proof Load Testing Long Bolts*—When fasteners are too long to test in the available equipment they may be cut to 8 ± 0.125 in. and tested using Method 1. If there is a dispute over results when testing the same part or lot of parts both full size and cut to 8 in., the 8 in. test results shall be used to determine acceptance.

(a) Method 1, Length Measurement—The overall length of a straight bolt shall be measured at its true center line with an instrument capable of measuring changes in length of

0.0001 in. (0.0025 mm) with an accuracy of 0.0001 in. in any 0.001-in. (0.025 mm) range. The preferred method of measuring the length shall be between conical centers machined on the center line of the bolt, with mating centers on the measuring anvils. The head or body of the bolt shall be marked so that it can be placed in the same position for all measurements. The bolt shall be assembled in the testing equipment as outlined in A3.2.1.4, and the proof load specified in the product specification shall be applied. Upon release of this load the length of the bolt shall be again measured and shall show no permanent elongation. A tolerance of ± 0.0005 in. (0.0127 mm) shall be allowed between the measurement made before loading and that made after loading. Variables, such as straightness and thread alignment (plus measurement error), may result in apparent elongation of the fasteners when the proof load is initially applied. In such cases, the fastener may be retested using a 3 % greater load, and may be considered satisfactory if the length after this loading is the same as before this loading (within the 0.0005-in. tolerance for measurement error).

A3.2.1.3 *Proof Load-Time of Loading*—The proof load is to be maintained for a period of 10 s before release of load, when using Method 1.

(1) Method 2, Yield Strength—The bolt shall be assembled in the testing equipment as outlined in A3.2.1.4. As the load is applied, the total elongation of the bolt or any part of the bolt which includes the exposed six threads shall be measured and recorded to produce a load-strain or a stress-strain diagram. The load or stress at an offset equal to 0.2 % of the length of bolt occupied by six full threads shall be determined by the method described in 14.2.1 of these methods, A370. This load or stress shall not be less than that prescribed in the product specification.

A3.2.1.4 Axial Tension Testing of Full Size Bolts—Bolts are to be tested in a holder with the load axially applied between the head and a nut or suitable fixture (see Fig. A3.1), either of which shall have sufficient thread engagement to




FIG. A3.1 Tension Testing Full-size Bolt

develop the full strength of the bolt. The nut or fixture shall be assembled on the bolt leaving six complete bolt threads unengaged between the grips, except for heavy hexagon structural bolts which shall have four complete threads unengaged between the grips. To meet the requirements of this test, there shall be a tensile failure in the body or threaded section with no failure at the junction of the body and head. When tensile testing externally threaded fasteners made of austenitic stainless steel and the test fastener's thread pulls out of the internally threaded test fixture after the minimum tensile strength requirement has been reached, the fasteners shall be considered conforming to the tensile strength requirement and, in addition to the tensile strength, the failure mode shall be reported to the purchaser. If it is necessary to record or report the tensile strength of bolts as psi values, the stress area shall be calculated from the mean of the mean root and pitch diameters of Class 3 external threads as follows:

$$A_s = 0.7854 \left[D - (0.9743/n) \right]^2 \tag{A3.1}$$

where:

 $A_s = \text{stress area, in.}^2$,

D = nominal diameter, in., and

n = number of threads per in.


A3.2.1.5 Tension Testing of Full-size Bolts with a Wedge— The purpose of this test is to obtain the tensile strength and demonstrate the "head quality" and ductility of a bolt with a standard head by subjecting it to eccentric loading. The ultimate load on the bolt shall be determined as described in A3.2.1.4, except that a 10° wedge shall be placed under the same bolt previously tested for the proof load (see A3.2.1.1). The bolt head shall be so placed that no corner of the hexagon or square takes a bearing load, that is, a flat of the head shall be aligned with the direction of uniform thickness of the wedge (see Fig. A3.2). The wedge shall have an included angle between its faces as shown in Table A3.1 and shall have a thickness of one-half of the nominal bolt diameter at the short side of the hole. The hole in the wedge shall have the following clearance over the nominal size of the bolt, and its edges, top and bottom, shall be rounded to the following radius:

	Clearance in Hole,	Radius on Corners of
Nominal Bolt Size, in.	in. (mm)	Hole, in. (mm)
1/4 to 1/2	0.030 (0.76)	0.030 (0.76)
9/16 to 3/4	0.050 (1.3)	0.060 (1.5)
⁷ ⁄₂ to 1	0.063 (1.5)	0.060 (1.5)
11/8 to 11/4	0.063 (1.5)	0.125 (3.2)
13/8 to 11/2	0.094 (2.4)	0.125 (3.2)

A3.2.1.6 Wedge Testing of HT Bolts Threaded to Head—For heat-treated bolts that are threaded 1 diameter and closer to the underside of the head, the wedge angle shall be 6° for sizes ½ through ¾ in. (6.35 to 19.0 mm) and 4° for sizes over ¾ in.

A3.2.1.7 Tension Testing of Bolts Machined to Round Test Specimens:

(1) Bolts under 1½ in. (38 mm) in nominal diameter which require machined tests shall preferably use a standard ½-in., (13 mm) round 2-in. (50 mm) gauge length test specimen (see Fig. 4); however, bolts of small cross-section that will not permit the taking of this standard test specimen shall use one of the small-size-specimens-proportional-to-standard (see Fig. 4) and the specimen shall have a reduced section as large as possible. In all cases, the longitudinal axis of

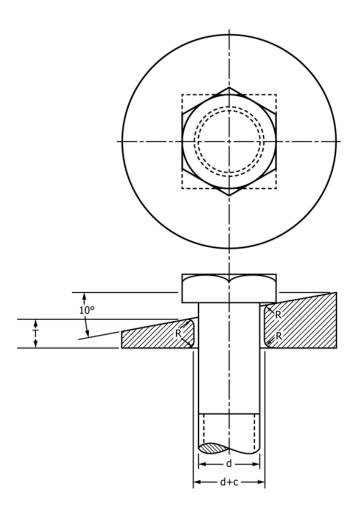

- c = Clearance of wedge hole
- d = Diameter of bolt
- R = Radius
- T = Thickness of wedge at short side of hole equal to one-half diameter of bolt

FIG. A3.2 Wedge Test Detail

TABLE A3.1 Tension Test Wedge Angles


	D	egrees
Nominal Product Size, in.	Bolts	Studs and Flange
	DOILS	Bolts
1/4 - 1	10	6
Over 1	6	4

the specimen shall be concentric with the axis of the bolt; the head and threaded section of the bolt may be left intact, as in Fig. A3.3 and Fig. A3.4, or shaped to fit the holders or grips of the testing machine so that the load is applied axially. The gauge length for measuring the elongation shall be four times the diameter of the specimen.

- (2) For bolts 1½ in. and over in nominal diameter, a standard ½-in. round 2-in. gauge length test specimen shall be turned from the bolt, having its axis midway between the center and outside surface of the body of the bolt as shown in Fig. A3.5.
- (3) Machined specimens are to be tested in tension to determine the properties prescribed by the product specifications. The methods of testing and determination of properties shall be in accordance with Section 14 of these test methods.


A3.3 Hardness Tests for Externally Threaded Fasteners

A3.3.1 When specified, externally threaded fasteners shall be hardness tested. Fasteners with hexagonal or square heads shall be Brinell or Rockwell hardness tested. For hexagonal and square head bolts, test shall be conducted on the wrench flats, top of head, unthreaded shank, end of bolt or at the arbitration location. For studs, products without parallel



Note 1—Metric equivalent: 1 in. = 25.4 mm.

FIG. A3.3 Tension Test Specimen for Bolt with Turned-down Shank



Note 1—Metric equivalent: 1 in. = 25.4 mm.

FIG. A3.4 Examples of Small Size Specimens Proportional to Standard 2-in. Gauge Length Specimen




FIG. A3.5 Location of Standard Round 2-in. Gauge Length Tension Test Specimen When Turned from Large Size Bolt

wrench flats and for head styles other than hexagonal and square, tests shall be conducted on the unthreaded shank, end of the bolt or stud or at the arbitration location. Due to possible distortion from the Brinell load, care should be taken that this test meets the requirements of Section 17 of these test methods where the Brinell hardness test is impractical, the Rockwell

hardness test shall be substituted. Rockwell hardness test procedures shall conform to Section 18 of these test methods.

A3.3.2 In cases where a dispute exists between buyer and seller as to whether externally threaded fasteners meet or exceed the hardness limit of the product specification, for purposes of arbitration, hardness may be taken on two transverse sections through a representative sample fastener selected at random. Hardness readings shall be taken at the locations shown in Fig. A3.6. All hardness values must conform with the hardness limit of the product specification in order for the fasteners represented by the sample to be considered in compliance. This provision for arbitration of a dispute shall not be used to accept clearly rejectable fasteners.

A3.4 Testing of Nuts


A3.4.1 *Hardness Test*—Rockwell hardness of nuts shall be determined on the top or bottom face of the nut. Brinell hardness shall be determined on the side of the nuts. Either method may be used at the option of the manufacturer, taking into account the size and grade of the nuts under test. When the standard Brinell hardness test results in deforming the nut it will be necessary to use a minor load or substitute a Rockwell hardness test.

A3.4.2 Cross Sectional Hardness Test—Nuts whose proof stress requires a load exceeding 160 000 lb shall, unless otherwise specified in the purchase order, contract or product specification, be considered too large for full size proof load testing and shall be subjected to a cross sectional hardness test. Sample nuts shall be sectioned laterally at approximately one half (½) of the nut height. Such samples need not be threaded, but shall be part of the manufacturing lot, including heat treatment. All tests shall be conducted using Rockwell Hardness test scales. Two sets of three readings shall be taken in locations ~180° apart (see Fig. A3.7). All readings shall be reported when certification is required and shall meet the hardness requirements listed in the product specification. The readings shall be taken across the section of the nut at the following positions:

Position 1—as close as practical to the major diameter (if threaded) or hole side wall (if blank), but no closer than $2\frac{1}{2}$ times the diameter of the indenter.

Position 2—at the core (halfway between the major diameter (if threaded) or hole side wall, if blank) and a corner of the nut.

Position 3—as close as practical to the corner of the nut, but no closer than 2½ times the diameter of the indenter.

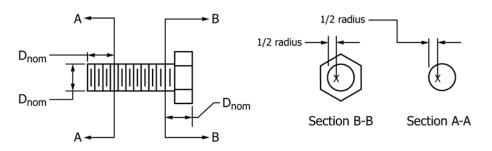

X = Location of Hardness Impressions

FIG. A3.6 Hardness Test Locations for Bolts in a Dispute




FIG. A3.7 Hardness Test Locations

A4. STEEL ROUND WIRE PRODUCTS

A4.1 Scope

A4.1.1 This annex contains testing requirements for Round Wire Products that are specific to the product. The requirements contained in this annex are supplementary to those found in the general section of this specification. In the case of conflict between requirements provided in this annex and those found in the general section of this specification, the requirements of this annex shall prevail. In the case of conflict between requirements provided in this annex and requirements found in product specifications, the requirements found in the product specification shall prevail.

A4.2 Apparatus

A4.2.1 *Gripping Devices*—Grips of either the wedge or snubbing types as shown in Figs. A4.1 and A4.2 shall be used (see Note A4.1). When using grips of either type, care shall be taken that the axis of the test specimen is located approximately at the center line of the head of the testing machine (see Note A4.2). When using wedge grips the liners used behind the grips shall be of the proper thickness.

Note A4.1—Testing machines usually are equipped with wedge grips. These wedge grips, irrespective of the type of testing machine, may be referred to as the "usual type" of wedge grips. The use of fine (180 or 240) grit abrasive cloth in the "usual" wedge type grips, with the abrasive contacting the wire specimen, can be helpful in reducing specimen




FIG. A4.1 Wedge-type Gripping Device




FIG. A4.2 Snubbing-type Gripping Device

slipping and breakage at the grip edges at tensile loads up to about 1000 lb. For tests of specimens of wire which are liable to be cut at the edges by the "usual type" of wedge grips, the snubbing type gripping device has proved satisfactory.

For testing round wire, the use of cylindrical seat in the wedge gripping device is optional.

Note A4.2—Any defect in a testing machine which may cause nonaxial application of load should be corrected.

A4.2.2 *Pointed Micrometer*—A micrometer with a pointed spindle and anvil suitable for reading the dimensions of the wire specimen at the fractured ends to the nearest 0.001 in. (0.025 mm) after breaking the specimen in the testing machine shall be used.

A4.3 Test Specimens

A4.3.1 Test specimens having the full cross-sectional area of the wire they represent shall be used. The standard gauge length of the specimens shall be 10 in. (254 mm). However, if the determination of elongation values is not required, any convenient gauge length is permissible. The total length of the specimens shall be at least equal to the gauge length (10 in.) plus twice the length of wire required for the full use of the grip employed. For example, depending upon the type of testing machine and grips used, the minimum total length of specimen may vary from 14 to 24 in. (360 to 610 mm) for a 10-in. gauge length specimen.

A4.3.2 Any specimen breaking in the grips shall be discarded and a new specimen tested.

A4.4 Elongation

A4.4.1 In determining permanent elongation, the ends of the fractured specimen shall be carefully fitted together and the distance between the gauge marks measured to the nearest 0.01 in. (0.25 mm) with dividers and scale or other suitable device. The elongation is the increase in length of the gauge length, expressed as a percentage of the original gauge length. In recording elongation values, both the percentage increase and the original gauge length shall be given.

A4.4.2 In determining total elongation (elastic plus plastic extension) autographic or extensometer methods may be employed.

A4.4.3 If fracture takes place outside of the middle third of the gauge length, the elongation value obtained may not be representative of the material.

A4.5 Reduction of Area

A4.5.1 The ends of the fractured specimen shall be carefully fitted together and the dimensions of the smallest cross section measured to the nearest 0.001 in. (0.025 mm) with a pointed micrometer. The difference between the area thus found and the area of the original cross section, expressed as a percentage of the original area, is the reduction of area.

A4.5.2 The reduction of area test is not recommended in wire diameters less than 0.092 in. (2.34 mm) due to the difficulties of measuring the reduced cross sections.

A4.6 Rockwell Hardness Test

A4.6.1 On heat-treated wire of diameter 0.100 in. (2.54 mm) and larger, the specimen shall be flattened on two parallel sides by grinding before testing. The hardness test is

not recommended for any diameter of hard drawn wire or heat-treated wire less than 0.100 in. (2.54 mm) in diameter. For round wire, the tensile strength test is greatly preferred over the hardness test.

A4.7 Wrap Test

A4.7.1 This test is used as a means for testing the ductility of certain kinds of wire.

A4.7.2 The test consists of coiling the wire in a closely spaced helix tightly against a mandrel of a specified diameter for a required number of turns. (Unless other specified, the required number of turns shall be five.) The wrapping may be done by hand or a power device. The wrapping rate may not exceed 15 turns per min. The mandrel diameter shall be specified in the relevant wire product specification.

A4.7.3 The wire tested shall be considered to have failed if the wire fractures or if any longitudinal or transverse cracks develop which can be seen by the unaided eye after the first complete turn. Wire which fails in the first turn shall be retested, as such fractures may be caused by bending the wire to a radius less than specified when the test starts.

A4.8 Coiling Test

A4.8.1 This test is used to determine if imperfections are present to the extent that they may cause cracking or splitting during spring coiling and spring extension. A coil of specified length is closed wound on an arbor of a specified diameter. The closed coil is then stretched to a specified permanent increase in length and examined for uniformity of pitch with no splits or fractures. The required arbor diameter, closed coil length, and permanent coil extended length increase may vary with wire diameter, properties, and type.

A5. NOTES ON SIGNIFICANCE OF NOTCHED-BAR IMPACT TESTING

A5.1 Notch Behavior

A5.1.1 The Charpy and Izod type tests bring out notch behavior (brittleness versus ductility) by applying a single overload of stress. The energy values determined are quantitative comparisons on a selected specimen but cannot be converted into energy values that would serve for engineering design calculations. The notch behavior indicated in an individual test applies only to the specimen size, notch geometry, and testing conditions involved and cannot be generalized to other sizes of specimens and conditions.

A5.1.2 The notch behavior of the face-centered cubic metals and alloys, a large group of nonferrous materials and the austenitic steels can be judged from their common tensile properties. If they are brittle in tension they will be brittle when notched, while if they are ductile in tension, they will be ductile when notched, except for unusually sharp or deep notches (much more severe than the standard Charpy or Izod specimens). Even low temperatures do not alter this characteristic of

these materials. In contrast, the behavior of the ferritic steels under notch conditions cannot be predicted from their properties as revealed by the tension test. For the study of these materials the Charpy and Izod type tests are accordingly very useful. Some metals that display normal ductility in the tension test may nevertheless break in brittle fashion when tested or when used in the notched condition. Notched conditions include restraints to deformation in directions perpendicular to the major stress, or multiaxial stresses, and stress concentrations. It is in this field that the Charpy and Izod tests prove useful for determining the susceptibility of a steel to notchbrittle behavior though they cannot be directly used to appraise the serviceability of a structure.

A5.1.3 The testing machine itself must be sufficiently rigid or tests on high-strength low-energy materials will result in excessive elastic energy losses either upward through the pendulum shaft or downward through the base of the machine. If the anvil supports, the pendulum striking edge, or the

machine foundation bolts are not securely fastened, tests on ductile materials in the range of 80 ft·lbf (108 J) may actually indicate values in excess of 90 to 100 ft·lbf (122 to 136 J).

A5.2 Notch Effect

A5.2.1 The notch results in a combination of multiaxial stresses associated with restraints to deformation in directions perpendicular to the major stress, and a stress concentration at the base of the notch. A severely notched condition is generally not desirable, and it becomes of real concern in those cases in which it initiates a sudden and complete failure of the brittle type. Some metals can be deformed in a ductile manner even down to the low temperatures of liquid air, while others may crack. This difference in behavior can be best understood by considering the cohesive strength of a material (or the property that holds it together) and its relation to the yield point. In cases of brittle fracture, the cohesive strength is exceeded before significant plastic deformation occurs and the fracture appears crystalline. In cases of the ductile or shear type of failure, considerable deformation precedes the final fracture and the broken surface appears fibrous instead of crystalline. In intermediate cases the fracture comes after a moderate amount of deformation and is part crystalline and part fibrous in appear-

A5.2.2 When a notched bar is loaded, there is a normal stress across the base of the notch which tends to initiate fracture. The property that keeps it from cleaving, or holds it together, is the "cohesive strength." The bar fractures when the normal stress exceeds the cohesive strength. When this occurs without the bar deforming it is the condition for brittle fracture.

A5.2.3 In testing, though not in service because of side effects, it happens more commonly that plastic deformation precedes fracture. In addition to the normal stress, the applied load also sets up shear stresses which are about 45° to the normal stress. The elastic behavior terminates as soon as the shear stress exceeds the shear strength of the material and deformation or plastic yielding sets in. This is the condition for ductile failure.

A5.2.4 This behavior, whether brittle or ductile, depends on whether the normal stress exceeds the cohesive strength before the shear stress exceeds the shear strength. Several important facts of notch behavior follow from this. If the notch is made sharper or more drastic, the normal stress at the root of the notch will be increased in relation to the shear stress and the bar will be more prone to brittle fracture (see Table A5.1). Also,

as the speed of deformation increases, the shear strength increases and the likelihood of brittle fracture increases. On the other hand, by raising the temperature, leaving the notch and the speed of deformation the same, the shear strength is lowered and ductile behavior is promoted, leading to shear failure.

A5.2.5 Variations in notch dimensions will seriously affect the results of the tests. Tests on E4340 steel specimens have shown the effect of dimensional variations on Charpy results (see Table A5.1).

A5.3 Size Effect

A5.3.1 Increasing either the width or the depth of the specimen tends to increase the volume of metal subject to distortion, and by this factor tends to increase the energy absorption when breaking the specimen. However, any increase in size, particularly in width, also tends to increase the degree of restraint and by tending to induce brittle fracture, may decrease the amount of energy absorbed. Where a standard-size specimen is on the verge of brittle fracture, this is particularly true, and a double-width specimen may actually require less energy for rupture than one of standard width.

A5.3.2 In studies of such effects where the size of the material precludes the use of the standard specimen, as for example when the material is ½-in. plate, subsize specimens are necessarily used. Such specimens (see Fig. 6 of Test Methods E23) are based on the Type A specimen of Fig. 4 of Test Methods E23.

A5.3.3 General correlation between the energy values obtained with specimens of different size or shape is not feasible, but limited correlations may be established for specification purposes on the basis of special studies of particular materials and particular specimens. On the other hand, in a study of the relative effect of process variations, evaluation by use of some arbitrarily selected specimen with some chosen notch will in most instances place the methods in their proper order.

A5.4 Effects of Testing Conditions

A5.4.1 The testing conditions also affect the notch behavior. So pronounced is the effect of temperature on the behavior of steel when notched that comparisons are frequently made by

TABLE A5.1 Effect of Varying Notch Dimensions on Standard Specimens

	High-energy Specimens, ft-lbf (J)	Medium-energy Specimens, ft·lbf (J)	Low-energy Specimens, ft-lbf (J)
Specimen with standard dimensions	$76.0 \pm 3.8 \ (103.0 \pm 5.2)$	$44.5 \pm 2.2 \ (60.3 \pm 3.0)$	12.5 ± 1.0 (16.9 ± 1.4)
Depth of notch, 0.084 in. (2.13 mm) ^A	72.2 (97.9)	41.3 (56.0)	11.4 (15.5)
Depth of notch, 0.0805 in. (2.04 mm) ^A	75.1 (101.8)	42.2 (57.2)	12.4 (16.8)
Depth of notch, 0.0775 in. (1.77 mm) ^A	76.8 (104.1)	45.3 (61.4)	12.7 (17.2)
Depth of notch, 0.074 in. (1.57 mm) ^A	79.6 (107.9)	46.0 (62.4)	12.8 (17.3)
Radius at base of notch, 0.005 in. (0.127 mm) ^B	72.3 (98.0)	41.7 (56.5)	10.8 (14.6)
Radius at base of notch, 0.015 in. (0.381 mm) ^B	80.0 (108.5)	47.4 (64.3)	15.8 (21.4)

^A Standard 0.079 ± 0.002 in. (2.00 ± 0.05 mm).

^B Standard 0.010 \pm 0.001 in. (0.25 \pm 0.025 mm).

examining specimen fractures and by plotting energy value and fracture appearance versus temperature from tests of notched bars at a series of temperatures. When the test temperature has been carried low enough to start cleavage fracture, there may be an extremely sharp drop in impact value or there may be a relatively gradual falling off toward the lower temperatures. This drop in energy value starts when a specimen begins to exhibit some crystalline appearance in the fracture. The transition temperature at which this embrittling effect takes place varies considerably with the size of the part or test specimen and with the notch geometry.

A5.4.2 A problem peculiar to Charpy-type tests occurs when high-strength, low-energy specimens are tested at low temperatures. These specimens may not leave the machine in the direction of the pendulum swing but rather in a sidewise direction. To ensure that the broken halves of the specimens do not rebound off some component of the machine and contact the pendulum before it completes its swing, modifications may be necessary in older model machines. These modifications differ with machine design. Nevertheless the basic problem is the same in that provisions must be made to prevent rebounding of the fractured specimens into any part of the swinging pendulum. Where design permits, the broken specimens may be deflected out of the sides of the machine and yet in other designs it may be necessary to contain the broken specimens within a certain area until the pendulum passes through the anvils. Some low-energy high-strength steel specimens leave impact machines at speeds in excess of 50 ft (15.3 m)/s although they were struck by a pendulum traveling at speeds approximately 17 ft (5.2 m)/s. If the force exerted on the pendulum by the broken specimens is sufficient, the pendulum will slow down and erroneously high energy values will be recorded. This problem accounts for many of the inconsistencies in Charpy results reported by various investigators within the 10 to 25-ft·lbf (14 to 34 J) range. The Apparatus section (subsection regarding specimen clearance) of Test Methods E23 discusses the two basic machine designs and a modification found to be satisfactory in minimizing jamming.

A5.5 Velocity of Straining

A5.5.1 Velocity of straining is likewise a variable that affects the notch behavior of steel. The impact test shows somewhat higher energy absorption values than the static tests above the transition temperature and yet, in some instances, the reverse is true below the transition temperature.

A5.6 Correlation With Service

A5.6.1 While Charpy or Izod tests may not directly predict the ductile or brittle behavior of steel as commonly used in large masses or as components of large structures, these tests can be used as acceptance tests of identity for different lots of the same steel or in choosing between different steels, when correlation with reliable service behavior has been established. It may be necessary to make the tests at properly chosen temperatures other than room temperature. In this, the service temperature or the transition temperature of full-scale specimens does not give the desired transition temperatures for Charpy or Izod tests since the size and notch geometry may be so different. Chemical analysis, tension, and hardness tests may not indicate the influence of some of the important processing factors that affect susceptibility to brittle fracture nor do they comprehend the effect of low temperatures in inducing brittle behavior.

A6. PROCEDURE FOR CONVERTING PERCENTAGE ELONGATION OF STANDARD ROUND TENSION TEST SPECIMEN TO EQUIVALENT PERCENTAGE ELONGATION OF STANDARD FLAT SPECIMEN

A6.1 Scope

A6.1.1 This method specifies a procedure for converting percentage elongation after fracture obtained in a standard 0.500-in. (12.7 mm) diameter by 2-in. (51 mm) gauge length test specimen to standard flat test specimens $\frac{1}{2}$ by 2 in. and $\frac{1}{2}$ by 8 in. (38.1 by 203 mm).

A6.2 Basic Equation

A6.2.1 The conversion data in this method are based on an equation by Bertella, and used by Oliver and others. The relationship between elongations in the standard 0.500-in. diameter by 2.0-in. test specimen and other standard specimens can be calculated as follows:

$$e = e_o \left[4.47 \left(\sqrt{A} \right) / L \right]^a \tag{A6.1}$$

where:

- e_o = percentage elongation after fracture on a standard test specimen having a 2-in. gauge length and 0.500-in. diameter.
- e = percentage elongation after fracture on a standard test specimen having a gauge length L and a cross-sectional area A, and
- a =constant characteristic of the test material.

A6.3 Application

A6.3.1 In applying the above equation the constant a is characteristic of the test material. The value a = 0.4 has been found to give satisfactory conversions for carbon, carbon-manganese, molybdenum, and chromium-molybdenum steels within the tensile strength range of 40 000 to 85 000 psi (275 to 585 MPa) and in the hot-rolled, in the hot-rolled and

normalized, or in the annealed condition, with or without tempering. Note that the cold reduced and quenched and tempered states are excluded. For annealed austenitic stainless steels, the value a = 0.127 has been found to give satisfactory conversions.

A6.3.2 Table A6.1 has been calculated taking a = 0.4, with the standard 0.500-in. (12.7 mm) diameter by 2-in. (51 mm) gauge length test specimen as the reference specimen. In the case of the subsize specimens 0.350 in. (8.89 mm) in diameter by 1.4-in. (35.6 mm) gauge length, and 0.250-in. (6.35 mm) diameter by 1.0-in. (25.4 mm) gauge length the factor in the equation is 4.51 instead of 4.47. The small error introduced by using Table A6.1 for the subsized specimens may be neglected.

TABLE A6.1 Carbon and Alloy Steels—Material Constant a = 0.4. Multiplication Factors for Converting Percent Elongation From $\frac{1}{2}$ -in. Diameter by 2-in. Gauge Length Standard Tension Test Specimen to Standard $\frac{1}{2}$ by 2-in. and $\frac{1}{2}$ by 8-in. Flat Specimens

		-		
Thickness,	½ by	1½ by	Thickness	11/2 by
in.	2-in.	8-in.	in.	8-in.
	Specimen	Specimen		Specimen
0.025	0.574		0.800	0.822
0.030	0.596		0.850	0.832
0.035	0.614		0.900	0.841
0.040	0.631		0.950	0.850
0.045	0.646		1.000	0.859
0.050	0.660		1.125	0.880
0.055	0.672		1.250	0.898
0.060	0.684		1.375	0.916
0.065	0.695		1.500	0.932
0.070	0.706		1.625	0.947
0.075	0.715		1.750	0.961
0.080	0.725		1.875	0.974
0.085	0.733		2.000	0.987
0.090	0.742	0.531	2.125	0.999
0.100	0.758	0.542	2.250	1.010
0.110	0.772	0.553	2.375	1.021
0.120	0.786	0.562	2.500	1.032
0.130	0.799	0.571	2.625	1.042
0.140	0.810	0.580	2.750	1.052
0.150	0.821	0.588	2.875	1.061
0.160	0.832	0.596	3.000	1.070
0.170	0.843	0.603	3.125	1.079
0.180	0.852	0.610	3.250	1.088
0.190	0.862	0.616	3.375	1.096
0.200	0.870	0.623	3.500	1.104
0.225	0.891	0.638	3.625	1.112
0.250	0.910	0.651	3.750	1.119
0.275	0.928	0.664	3.875	1.127
0.300	0.944	0.675	4.000	1.134
0.325	0.959	0.686	1.000	
0.350	0.973	0.696	1	
0.375	0.987	0.706	1	
0.400	1.000	0.715	I	
0.425	1.012	0.724	I	• • • •
0.450	1.024	0.732	I	• • • •
0.475	1.035	0.740	l	• • •
0.500	1.045	0.748	l	• • •
0.525	1.056	0.755	l	• • •
0.550	1.066	0.762	l	• • •
0.575	1.075	0.770	I	
0.600	1.084	0.776	I	
0.625	1.093	0.782	l	
0.650	1.093	0.788	l	• • •
0.675	1.110	0.766	l	• • •
0.700	1.118	0.800	l	• • •
0.725	1.126		I	
0.750	1.134	0.811	I	• • •
0.750	1.134	0.011	I	

Table A6.2 for annealed austenitic steels has been calculated taking a = 0.127, with the standard 0.500-in. diameter by 2-in. gauge length test specimen as the reference specimen.

A6.3.3 Elongation given for a standard 0.500-in. diameter by 2-in. gauge length specimen may be converted to elongation for $\frac{1}{2}$ by 2 in. or $\frac{1}{2}$ by 8 in. (38.1 by 203 mm) flat specimens by multiplying by the indicated factor in Table A6.1 and Table A6.2.

A6.3.4 These elongation conversions shall not be used where the width to thickness ratio of the test piece exceeds 20, as in sheet specimens under 0.025 in. (0.635 mm) in thickness.

A6.3.5 While the conversions are considered to be reliable within the stated limitations and may generally be used in

TABLE A6.2 Annealed Austenitic Stainless Steels—Material Constant a=0.127. Multiplication Factors for Converting Percent Elongation From $\frac{1}{2}$ -in. Diameter by 2-in. Gauge Length Standard Tension Test Specimen to Standard $\frac{1}{2}$ by 2-in. and $\frac{1}{2}$ by 8-in.

Flat Specimens					
Thickness,	½ by 2-in.	1½ by 8-in.	Thickness,	1½ by 8-in.	
in.	Specimen	Specimen	in.	Specimen	
0.025	0.839		0.800	0.940	
0.030	0.848		0.850	0.943	
0.035	0.857		0.900	0.947	
0.040	0.864		0.950	0.950	
0.045	0.870		1.000	0.953	
0.050	0.876		1.125	0.960	
0.055	0.882		1.250	0.966	
0.060	0.886		1.375	0.972	
0.065	0.891		1.500	0.978	
0.070	0.895		1.625	0.983	
0.075	0.899		1.750	0.987	
0.080	0.903		1.875	0.992	
0.085	0.906		2.000	0.996	
0.090	0.909	0.818	2.125	1.000	
0.095	0.913	0.821	2.250	1.003	
0.100	0.916	0.823	2.375	1.007	
0.110	0.921	0.828	2.500	1.010	
0.120	0.926	0.833	2.625	1.013	
0.130	0.931	0.837	2.750	1.016	
0.140	0.935	0.841	2.875	1.019	
0.150	0.940	0.845	3.000	1.022	
0.160	0.943	0.848	3.125	1.024	
0.170	0.947	0.852	3.250	1.027	
0.180	0.950	0.855	3.375	1.029	
0.190	0.954	0.858	3.500	1.032	
0.200	0.957	0.860	3.625	1.034	
0.225	0.964	0.867	3.750	1.036	
0.250	0.970	0.873	3.875	1.038	
0.275	0.976	0.878	4.000	1.041	
0.300	0.982	0.883			
0.325	0.987	0.887			
0.350	0.991	0.892			
0.375	0.996	0.895			
0.400	1.000	0.899			
0.425	1.004	0.903			
0.450 0.475	1.007 1.011	0.906 0.909			
0.500					
	1.014	0.912			
0.525	1.017	0.915			
0.550	1.020	0.917			
0.575 0.600	1.023 1.026	0.920 0.922			
0.625	1.026	0.925			
0.650	1.029	0.925			
0.675	1.034				
0.700	1.034	0.932			
0.700	1.038				
0.750	1.041	0.936			
0.750	1.041	0.330			

specification writing where it is desirable to show equivalent elongation requirements for the several standard ASTM tension specimens covered in Test Methods A370, consideration must be given to the metallurgical effects dependent on the thickness of the material as processed.

A7. TESTING MULTI-WIRE STRAND

This annex has been replaced by Test Methods A1061/A1061M, and procedures for the tension testing of multi-wire strand for prestressed concrete have been integrated into the relevant product specifications.

A8. ROUNDING OF TEST DATA

A8.1 Application

- A8.1.1 This annex shall apply to rounding test data for the purpose of determining conformance to product specification requirements.
- A8.1.2 This annex shall apply only when rounding is not specified in the product specification.
- A8.1.3 Observed or calculated test results and records maintained by testing laboratories are not subject to this annex.

A8.2 Method

- A8.2.1 Values shall be rounded in accordance with the rules of Practice E29 unless otherwise stated herein.
- A8.2.2 In the special case of rounding the number "5" when no additional numbers other than "0" follow the "5," rounding shall be in accordance with Practice E29 except where this would result in rejection of the product.

- A8.2.3 Requirements for rounding levels for determining product acceptance or rejection are given in Table A8.1. Specific reported test data values shall be rounded to Table A8.1 for determining product acceptance or rejection.
- A8.2.4 Table A8.1 values are designed to provide uniformity in determining conformance to product specification requirements and should be considered when rounding requirements are stated in product specifications.
- A8.2.5 When rounding requirements are neither stated in the product specification nor listed in Table A8.1, an observed or calculated value shall be rounded to the nearest unit in the last right hand digit used in expressing the specification requirement.

TABLE A8 1 Rounded	Test Data for Determining	Conformance to Specification
IADLE AO. I NOUIIUEU	rest Data for Determining	Comornance to Specification

Test Quality	Test Data Range	Rounded Value ^A
Yield Point, Yield Strength, Tensile Strength	<50 000 psi (<50 ksi)	100 psi (0.1 ksi)
	50 000 to <100 000 psi (50 to 100 ksi)	500 psi (0.5 ksi)
	≥100 000 psi (≥100 ksi)	1000 psi (1 ksi)
	(<350 MPa)	(1 MPa)
	(350 to 700 MPa)	(5 MPa)
	(>700 MPa)	(10 MPa)
Elongation	0 to <10 %	0.5 %
	≥10 %	1 %
Reduction of Area	0 to <10 %	0.5 %
	≥10 %	1 %
Absorbed Energy	0 to ≤240 ft · lbf [0 to ≤325 J]	1 ft ⋅ lbf [1 J] ^B
Brinell Hardness	all values	tabular value ^C
Rockwell Hardness	all scales	1 Rockwell Number

A Round test data to the nearest integral multiple of the values in this column. If the data value is exactly midway between two rounded values, round in accordance with A8.2.2.

A9. METHODS FOR TESTING STEEL REINFORCING BARS

The testing requirements for steel reinforcing bars contained in this annex have been integrated into the relevant product specifications.

A10. PROCEDURE FOR USE AND CONTROL OF HEAT-CYCLE SIMULATION

A10.1 Purpose

A10.1.1 To ensure consistent and reproducible heat treatments of production forgings and the test specimens that represent them when the practice of heat-cycle simulation is used.

A10.2 Scope

- A10.2.1 Generation and documentation of actual production time—temperature curves (MASTER CHARTS).
- A10.2.2 Controls for duplicating the master cycle during heat treatment of production forgings. (Heat treating within the essential variables established during A1.2.1.)
- A10.2.3 Preparation of program charts for the simulator unit.
- A10.2.4 Monitoring and inspection of the simulated cycle within the limits established by the ASME Code.
- A10.2.5 Documentation and storage of all controls, inspections, charts, and curves.

A10.3 Referenced Documents

A10.3.1 ASME Standards:

A10.3.1.1 ASME Boiler and Pressure Vessel Code Section III, latest edition.

A10.3.1.2 ASME Boiler and Pressure Vessel Code Section VIII, Division 2, latest edition.

A10.4 Procedure

A10.4.1 Production Master Charts:

A10.4.1.1 Thermocouples shall be imbedded in each forging from which a master chart is obtained. Temperature shall be monitored by a recorder with resolution sufficient to clearly define all aspects of the heating, holding, and cooling process. All charts are to be clearly identified with all pertinent information and identification required for maintaining permanent records.

A10.4.1.2 Thermocouples shall be imbedded 180° apart if the material specification requires test locations 180° apart.

A10.4.1.3 One master chart (or two if required in accordance with A10.4.3.1) shall be produced to represent essentially identical forgings (same size and shape). Any change in size or geometry (exceeding rough machining tolerances) of a forging will necessitate that a new master cooling curve be developed.

A10.4.1.4 If more than one curve is required per master forging (180° apart) and a difference in cooling rate is achieved, then the most conservative curve shall be used as the master curve.

^B These units are not equivalent but the rounding occurs in the same numerical ranges for each. (1 ft-lbf = 1.356 J).

^C Round the mean diameter of the Brinell impression to the nearest 0.05 mm and report the corresponding Brinell hardness number read from the table without further rounding.

A10.4.2 Reproducibility of Heat Treatment Parameters on Production Forgings:

A10.4.2.1 All information pertaining to the quench and temper of the master forging shall be recorded on an appropriate permanent record, similar to the one shown in Table A10.1.

A10.4.2.2 All information pertaining to the quench and temper of the production forgings shall be appropriately recorded, preferably on a form similar to that used in A10.4.2.1. Quench records of production forgings shall be retained for future reference. The quench and temper record of the master forging shall be retained as a permanent record.

A10.4.2.3 A copy of the master forging record shall be stored with the heat treatment record of the production forging.

A10.4.2.4 The essential variables, as set forth on the heat treat record, shall be controlled within the given parameters on the production forging.

A10.4.2.5 The temperature of the quenching medium prior to quenching each production forging shall be equal to or lower than the temperature of the quenching medium prior to quenching the master forging.

A10.4.2.6 The time elapsed from opening the furnace door to quench for the production forging shall not exceed that elapsed for the master forging.

A10.4.2.7 If the time parameter is exceeded in opening the furnace door to beginning of quench, the forging shall be placed back into the furnace and brought back up to equalization temperature.

A10.4.2.8 All forgings represented by the same master forging shall be quenched with like orientation to the surface of the quench bath.

A10.4.2.9 All production forgings shall be quenched in the same quench tank, with the same agitation as the master forging.

A10.4.2.10 *Uniformity of Heat Treat Parameters*—(1) The difference in actual heat treating temperature between production forgings and the master forging used to establish the simulator cycle for them shall not exceed ± 25 °F (± 14 °C) for

the quench cycle. (2) The tempering temperature of the production forgings shall not fall below the actual tempering temperature of the master forging. (3) At least one contact surface thermocouple shall be placed on each forging in a production load. Temperature shall be recorded for all surface thermocouples on a Time Temperature Recorder and such records shall be retained as permanent documentation.

A10.4.3 Heat-cycle Simulation:

A10.4.3.1 Program charts shall be made from the data recorded on the master chart. All test specimens shall be given the same heating rate above, the AC1, the same holding time and the same cooling rate as the production forgings.

A10.4.3.2 The heating cycle above the AC1, a portion of the holding cycle, and the cooling portion of the master chart shall be duplicated and the allowable limits on temperature and time, as specified in (a) through (c), shall be established for verification of the adequacy of the simulated heat treatment.

(a) Heat Cycle Simulation of Test Coupon Heat Treatment for Quenched and Tempered Forgings and Bars—If cooling rate data for the forgings and bars and cooling rate control devices for the test specimens are available, the test specimens may be heat-treated in the device.

(b) The test coupons shall be heated to substantially the same maximum temperature as the forgings or bars. The test coupons shall be cooled at a rate similar to and no faster than the cooling rate representative of the test locations and shall be within 25 °F (14 °C) and 20 s at all temperatures after cooling begins. The test coupons shall be subsequently heat treated in accordance with the thermal treatments below the critical temperature including tempering and simulated post weld heat treatment.

(c) Simulated Post Weld Heat Treatment of Test Specimens (for ferritic steel forgings and bars)—Except for carbon steel (P Number 1, Section IX of the Code) forgings and bars with a nominal thickness or diameter of 2 in. (51 mm) or less, the test specimens shall be given a heat treatment to simulate any thermal treatments below the critical temperature that the

TABLE A10.1 Heat-treat Record-essential Variables

	Master	Production	Production	Production	Production	Production
	Forging	Forging 1	Forging 2	Forging 3	Forging 4	Forging 5
Program chart number						
Time at temperature and actual temperature of heat treatment						
Method of cooling						
Forging thickness						
Thermocouple immersion						
Beneath buffer (yes/no)						
Forging number						
Product						
Material						
Thermocouple location—0 deg						
Thermocouple location—180 deg						
Quench tank No.						
Date of heat treatment						
Furnace number						
Cycle number						
Heat treater						
Starting quench medium temperature						
Time from furnace to quench						
Heating rate above 1000 °F (538 °C)						
Temperature upon removal from quench after 5 min						
Orientation of forging in quench						

forgings and bars may receive during fabrication. The simulated heat treatment shall utilize temperatures, times, and cooling rates as specified on the order. The total time at temperature(s) for the test material shall be at least 80 % of the total time at temperature(s) to which the forgings and bars are subjected during postweld heat treatment. The total time at temperature(s) for the test specimens may be performed in a single cycle.

A10.4.3.3 Prior to heat treatment in the simulator unit, test specimens shall be machined to standard sizes that have been determined to allow adequately for subsequent removal of decarb and oxidation.

A10.4.3.4 At least one thermocouple per specimen shall be used for continuous recording of temperature on an independent external temperature-monitoring source. Due to the sensitivity and design peculiarities of the heating chamber of certain equipment, it is mandatory that the hot junctions of control and monitoring thermocouples always be placed in the same relative position with respect to the heating source (generally infrared lamps).

A10.4.3.5 Each individual specimen shall be identified, and such identification shall be clearly shown on the simulator chart and simulator cycle record.

A10.4.3.6 The simulator chart shall be compared to the master chart for accurate reproduction of simulated quench in accordance with A10.4.3.2(a). If any one specimen is not heat treated within the acceptable limits of temperature and time, such specimen shall be discarded and replaced by a newly machined specimen. Documentation of such action and reasons for deviation from the master chart shall be shown on the simulator chart, and on the corresponding nonconformance report.

A10.4.4 Reheat Treatment and Retesting:

A10.4.4.1 In the event of a test failure, retesting shall be handled in accordance with rules set forth by the material specification.

A10.4.4.2 If retesting is permissible, a new test specimen shall be heat treated the same as previously. The production forging that it represents will have received the same heat treatment. If the test passes, the forging shall be acceptable. If it fails, the forging shall be rejected or shall be subject to reheat treatment if permissible.

A10.4.4.3 If reheat treatment is permissible, proceed as follows: (1) Reheat treatment same as original heat treatment (time, temperature, cooling rate). Using new test specimens from an area as close as possible to the original specimens, repeat the austenitize and quench cycles twice, followed by the tempering cycle (double quench and temper). The production forging shall be given the identical double quench and temper as its test specimens above. (2) Reheat treatment using a new heat treatment practice. Any change in time, temperature, or cooling rate shall constitute a new heat treatment practice. A new master curve shall be produced and the simulation and testing shall proceed as originally set forth.

A10.4.4.4 In summation, each test specimen and its corresponding forging shall receive identical heat treatment or heat treatment; otherwise the testing shall be invalid.

A10.4.5 Storage, Recall, and Documentation of Heat-cycle Simulation Data—All records pertaining to heat-cycle simulation shall be maintained and held for a period of ten years or as designed by the customer. Information shall be so organized that all practices can be verified by adequate documented records.

SPECIFICATION FOR CARBON AND ALLOY STEEL FORGINGS FOR THIN-WALLED PRESSURE VESSELS



SA-372/SA-372M



(23)

(Identical with ASTM Specification A372/A372M-20 $^{\epsilon 1}$.)

Specification for Carbon and Alloy Steel Forgings for Thin-Walled Pressure Vessels

1. Scope

1.1 This specification covers relatively thin-walled forgings (including gas bottles) for pressure vessel use. Three types of carbon steel and six types of alloy steel are included. Provision is made for integrally forging the ends of vessel bodies made from seamless pipe or tubing.

Note 1—When working to the chemical and tensile requirements of this specification, the influence of wall thickness and cooling rate will necessarily eliminate certain forging sizes in each class.

Note 2—Designations have been changed as follows:

THORE 2 Designations have been ename.	a as rono ws.
Current	Formerly
Grade A	Type I
Grade B	Type II
Grade C	Type III
Grade D	Type IV
Grade E Class 55	Type V Grade 1 Class 55
Grade E Class 65	Type V Grade 1 Class 65
Grade E Class 70	Type V Grade 1 Class 70
Grade F Class 55	Type V Grade 2 Class 55
Grade F Class 65	Type V Grade 2 Class 65
Grade F Class 70	Type V Grade 2 Class 70
Grade G Class 55	Type V Grade 3 Class 55
Grade G Class 65	Type V Grade 3 Class 65
Grade G Class 70	Type V Grade 3 Class 70
Grade H Class 55	Type V Grade 4 Class 55
Grade H Class 65	Type V Grade 4 Class 65
Grade H Class 70	Type V Grade 4 Class 70
Grade J Class 55	Type V Grade 5 Class 55
Grade J Class 65	Type V Grade 5 Class 65
Grade J Class 70	Type V Grade 5 Class 70
Grade K	Type VI
Grade L	Type VII
Grade J Class 110	Type VIII
Grade M Class 85	Type IX Class A
Grade M Class 100	Type IX Class B

1.2 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in

each system are not necessarily exact equivalents; therefore, to ensure conformance with the standard, each system shall be used independently of the other, and values from the two systems shall not be combined.

- 1.3 Unless the order specifies the applicable "M" specification designation (SI units), the material shall be furnished to inch-pound units.
- 1.4 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A275/A275M Practice for Magnetic Particle Examination of Steel Forgings
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A388/A388M Practice for Ultrasonic Examination of Steel Forgings
- A530/A530M Specification for General Requirements for Specialized Carbon and Alloy Steel Pipe
- A788/A788M Specification for Steel Forgings, General Requirements
- E112 Test Methods for Determining Average Grain Size
- E165/E165M Practice for Liquid Penetrant Testing for General Industry
- E290 Test Methods for Bend Testing of Material for Ductility
- E433 Reference Photographs for Liquid Penetrant Inspection

TABLE 2 Mechanical Requirements

		•		
		Yield	Elongation	
	T 11 O1 11	Strength	in 2 in.	Hardness,
_	Tensile Strength,	(0.2 % Offset),		HB, min ^A
Туре	ksi [MPa]	ksi [MPa], min	min, %	
Grade A	60-85 [415-585]	35 [240]	20	121
Grade B	75–100 [515–690]	45 [310]	18	156
Grade C	90-115 [620-795]	55 [380]	15	187
Grade D	105-130 [725-895]	65 [450]	15	217
Grades E, F, G, H, J, R (Class 55)	85–110 [585†–760]	55 [380]	20	179
Grades E, F, G, H, J, R (Class 65)	105–130 [725–895]	65 [450]	19	217
Grades E, F, G, H, J, R (Class 70)	120–145 [825–1000]	70 [485]	18	248
Grades J, R (Class 90)	120–145 [825–1000]	90 [620]	18	248
Grades J, R (Class 110)	135–160 [930–1100]	110 [760]	15	277
Grade K	100-125 [690-860]	80 [550]	20	207
Grade L	155–180 [1070–1240]	135 [930]	12	311
Grade M (Class 85)	105–130 [725–895]	85 [585]	18	217
Grade M (Class 100)	120–145 [825–1000]	100 [690]	16	248
Grades N and P (Class 100)	115–140 [795–965]	100 [690]	16	248
Grades N and P (Class 120)	135–160 [930–1105]	120 [825]	14	277
Grades N and P (Class 140)	155–180 [1070–1240]	140 [965]	13	311
+Editorially corrected				

[†]Editorially corrected.

2.2 ASME Standard:

ASME Boiler and Pressure Vessel Code

3. Ordering Information and General Requirements

- 3.1 In addition to the ordering information required by Specification A788/A788M, the purchaser shall include with the inquiry and order a detailed drawing, sketch, or written description of the forging and the areas of significant loading in the forging when required (see 6.4.2.2).
- 3.2 Material supplied to this specification shall conform to the requirements of Specification A788/A788M, which outlines additional ordering information, manufacturing requirements, testing and retesting methods and procedures, marking, certification, product analysis variations, and additional supplementary requirements.
- 3.3 If the requirements of this specification are in conflict with the requirements of Specification A788/A788M, the requirements of this specification shall prevail.

4. Materials and Manufacture

4.1 *Melting Practice*—The steel melting procedures of Specification A788/A788M shall apply except that for Grades M, N, P, and Grades J and Class 110 forgings, only steel that

has been vacuum treated before or during the pouring of the ingot, to remove objectionable gases, particularly hydrogen, shall be used.

4.2 Production Methods—Methods for the production of gas bottles and similar vessels shall include the cupping of slabs or plates, the piercing of billets or plates, and the subsequent drawing of cups so produced. Such semifinished forgings or seamless steel pipe or tubing shall be closed by spinning, swedging, or pressing. In all cases, there shall be sufficient discard to ensure soundness in the completed forging.

4.3 *Heat Treatment:*

- 4.3.1 At the option of the manufacturer, Grades A, B, C, and D and Classes 55, 65, and 70 of Grades E, F, G, H, and J forgings shall be normalized, normalized and tempered, liquid quenched and tempered, or normalized followed by liquid quench and temper.
- 4.3.2 Grades K, L, M, N, P, and Classes 90 and 110 of Grades J and R forgings shall be liquid quenched and tempered, or normalized followed by liquid quench and temper.
- 4.3.3 When normalized forgings are to be tempered, or when forgings have been quenched, they shall be reheated to a subcritical temperature and held for at least ½ h/in. [25 mm] of maximum cross section.
- 4.3.3.1 Minimum tempering temperatures shall be as follows:

Grades E, F, G, H, J in Classes 55, 65, 70, 90	1100 °F [595 °C]
Grade K	1100 °F [595 °C]
Grades L, N, P, R	1000 °F [540 °C]
Grade J Class 110	1000 °F [540 °C]
Grade M	1100 °F [595 °C]

- 4.3.3.2 If an attachment is welded onto a previously quenched and tempered pressure vessel, the post-weld heat treatment temperature of a weldment shall not exceed the prior tempering temperature of the pressure vessel. Fabrication welding of pressure shell is not permitted. Attachment welding before heat treatment is not permitted.
- 4.3.4 All quenched and tempered forgings shall be subject to magnetic particle examination in accordance with Section 7.
- 4.3.5 Heat treatment is to be performed after all forming operations.

5. Chemical Composition

- 5.1 *Heat Analysis*—The heat analysis obtained from sampling in accordance with Specification A788/A788M shall comply with Table 1.
- 5.2 Product Analysis—The purchaser may use the product analysis provision of Specification A788/A788M to obtain a product analysis from a forging representing each heat or multiple heat.
- 5.3 Starting material produced to a specification that specifically requires the addition of any element beyond those listed in Table 1 for the applicable grade of material is not permitted. This does not preclude use of deoxidation or inclusion control additions. Supplementary Requirements S1 and S2 of Specification A788/A788M shall apply.

A When required by 6.6.

TABLE 1 Chemical Requirements

		- 1 Chemica			
Element		Compos	sition, %		
	Grade A	Grade B	Grade C	Grade D	Grade E Classes 55, 65, 70
Carbon Manganese	0.30 max 1.00 max	0.35 max 1.35 max	0.48 max 1.65 max	0.40-0.50 1.40-1.80	0.25-0.35 0.40-0.90
Phosphorus, max	0.015	0.015	0.015	0.015	0.015
Sulfur, max Silicon Nickel	0.010 0.15–0.35	0.010 0.15–0.35 	0.010 0.15–0.35 	0.010 0.15–0.35	0.010 0.15–0.35
Chromium Molybdenum Vanadium				 0.17–0.27	0.80–1.15 0.15–0.25
Boron					
	Grade F Classes 55, 65, 70	Grade G Classes 55, 65, 70	Grade H Classes 55, 65, 70	Grade J Classes 55, 65, 70, 110	Grade K
Carbon Manganese	0.30-0.40 0.70-1.00	0.25-0.35 0.70-1.00	0.30-0.40 0.75-1.05	0.35-0.50 0.75-1.05	0.18 max 0.10-0.40
Phosphorus, max	0.015	0.015	0.015	0.015	0.015
Sulfur, max Silicon Nickel	0.010 0.15–0.35	0.010 0.15–0.35	0.010 0.15–0.35	0.010 0.15–0.35	0.010 0.15–0.35 2.0–3.3
Chromium Molybdenum Vanadium	0.80-1.15 0.15-0.25	0.40-0.65 0.15-0.25	0.40-0.65 0.15-0.25	0.80-1.15 0.15-0.25	1.00–1.80 0.20–0.60
Boron					
	Grade L	Grade M Classes 85 and 100	Grade N Classes 100, 120, 140	Grade P Classes 100, 120, 140	Grade R Classes 55, 65, 70, 90, 110
Carbon Manganese	0.38-0.43 0.60-0.80	0.23 max 0.20-0.40	0.35 max 0.90 max	0.40 max 0.90 max	0.35-0.50 0.75-1.05
Phosphorus, max	0.015	0.015	0.015	0.015	0.015
Sulfur, max Silicon Nickel Chromium	0.010 0.15-0.35 1.65-2.00 0.70-0.90	0.010 0.30 max 2.8–3.9 1.50–2.00	0.015 0.35 max 1.5–2.25 0.80–2.00	0.015 0.35 max 2.3–3.3 0.80–2.00	0.010 0.15–0.35 0.80–1.15
Molybdenum Vanadium Boron	0.20–0.30 	0.40–0.60 0.08 max 	0.20-0.40 0.20 max 	0.30-0.50 0.20 max	0.15–0.25 5–20 ppm

5.4 Temper Embrittlement Control—The purchaser's attention is drawn to Supplementary Requirement S24 in Specification A788/A788M for application of the J Factor, which may be of assistance in the control of temper embrittlement in forgings produced to Specification A372/A372M.

6. Mechanical Properties

- 6.1 Mechanical tests for acceptance shall be made after the final heat treatment of the forgings.
- 6.2 Tension Test—When tested in accordance with Test Methods and Definitions A370, the material shall conform to the requirements of Table 2. The yield strength shall be determined by the 0.2% offset method.
- 6.3 *Bending Properties*—Depending upon the outside diameter, *D*, and the wall thickness, *T*, of hollow or bored forgings, a bend test or flattening test will be required.
- 6.3.1 For bored or hollow forgings with outside diameters of 14 in. [355 mm] or less and with a *D/T* ratio of more than 10.0, a flattening test is required. This shall be carried out in accordance with Specification A530/A530M and Table 3. No

TABLE 3 Distance Between Plates for Flattening Tests^A

Туре	Distance Between Plates
Grade A	0.50 D
Grade B	0.6 D
Grade C	0.65 <i>D</i>
Grade D	0.7 D
Grades E, F, G, H, J, R (Class 55)	0.7 D
Grades E, F, G, H, J, R (Class 65)	0.8 <i>D</i>
Grades E, F, G, H, J, R Class 70) and Grades J, R (Class 90)	0.8 <i>D</i>
Grades J, R (Class 110)	0.9 D
Grade K	0.8 D
Grade L	0.9 D
Grade M (Class 85)	0.7 D
Grade M (Class 100)	0.8 D
Grades N, P (Class 100)	0.8 D
Grades N, P (Classes 120, 140)	0.9 <i>D</i>

 $^{^{}A}$ D = outside diameter.

breaks or cracks in the test ring are acceptable until the distance between the plates is less than that shown in Table 3.

6.3.2 For bored or hollow forgings with outside diameters over 14 in. [355 mm], or where the *D/T* ratio is 10.0 or less at the manufacturer's option, the flattening test specified in 6.3.1, or a transverse bend test in accordance with Test Methods E290 is required. In cases in which the Test Methods E290 method used stipulates a bend test pin or mandrel, the diameter shall be as specified in Table 4. No cracks or ruptures in the test piece are allowable when the test piece is bent through the required angle.

6.4 Orientation and Location of Test Specimens:

- 6.4.1 Test specimens representing vessel bodies or shells shall be taken from a prolongation of a forging, from test rings that have been heat treated with the forgings they represent, or from a representative forging after heat treatment in accordance with 4.3.
- 6.4.1.1 Test specimens representing vessel bodies or shells for properties other than bending properties shall be located at a position corresponding to the mid-wall location of the parallel side wall of the heat-treated forging and shall be oriented parallel to the longitudinal axis of the vessel.
- 6.4.1.2 A test ring shall be in the shape of a right circular cylinder having the same diameter and wall thickness as the cylinders it represents. In addition, the test ring shall be from the same heat of steel and be subjected to the same heat

TABLE 4 Maximum Pin Diameters and Minimum Angle for Bend Test

Dena Test				
Туре	Pin Diameter	Angle, deg		
Grade A	2 <i>T</i>	180		
Grade B	2 <i>T</i>	180		
Grade C	3 <i>T</i>	180		
Grade D	4 <i>T</i>	150		
Grades E, F, G, H, J, R (Class 55)	4 <i>T</i>	150		
Grades E, F, G, H, J, R (Class 65)	4 <i>T</i>	150		
Grades E, F, G, H, J, R (Class 70) and Grades J, R (Class 90)	4 <i>T</i>	150		
Grades J, R (Class 110)	6 <i>T</i>	150		
Grade K	4 <i>T</i>	150		
Grade L	6 <i>T</i>	150		
Grade M (Class 85)	4 <i>T</i>	150		
Grade M (Class 100)	4 <i>T</i>	150		
Grades N, P (Class 100)	6 <i>T</i>	150		
Grades N, P (Classes 120, 140)	6 <i>T</i>	150		

treatment as the cylinders it represents. The method of quenching the test ring shall duplicate that of the cylinders; if the cylinders are quenched from the outside only, then the test ring shall have its ends closed. The length of test rings that will be liquid quenched shall be at least 24 in. [610 mm]. The ends of such test rings may be vented to prevent pressure buildup during heat treating.

- 6.4.2 Test specimens representing vessel covers or similar components may be taken from a full-section prolongation of the cover, a representative forging, or an integral prolongation when the part is contour machined before heat treatment.
- 6.4.2.1 Test specimens taken from full size prolongations or representative forgings shall be located at a position midway between the center and the surface.
- 6.4.2.2 When forgings are contour machined before heat treatment so that highly stressed surfaces are exposed, the test specimens may be taken at an equal distance (t) from the nearest quenched surface as the highly stressed area but not less than $\frac{3}{4}$ in. [20 mm]. The location of the specimens from a second surface shall be at least the greater of $\frac{1}{2}$ in. [40 mm] or 2t.

6.5 Number of Tests:

- 6.5.1 Up to 200 like forgings, each with a heat-treated weight of less than 1000 lb [450 kg] when heat treated in a single-batch furnace charge, shall have one tension test taken in accordance with 6.4.1 or 6.4.2 to represent each heat. In addition, for hollow or bored forgings, one bend or flattening test shall be taken in accordance with 6.3.
- 6.5.2 Like forgings, weighing less than 1000 lb [450 kg] each when heat treated in a continuous furnace, shall have one tensile test taken to represent each heat and not more than 200 forgings in any continuous period up to 4 h duration. In addition, bored or hollow forgings shall have one bend or flattening test taken per heat per 200 forgings in any continuous period up to 4 h duration in accordance with 6.3.
- 6.5.3 For heat-treated forgings weighing 1000 lb [450 kg] or more, one tension test shall be taken in accordance with 6.4.1 or 6.4.2 to represent each heat and not more than ten forgings in a heat-treat lot. In addition, hollow or bored forgings shall have one bend or flattening test, taken in accordance with 6.3, to represent each ten or fewer forgings from the same heat and heat-treatment lot.

6.6 Hardness Testing:

6.6.1 Forgings under 1000 lb [450 kg] in weight, heat treated in a batch lot of up to 200 pieces (6.5.1) or in a

continuous furnace run covering up to 200 pieces in up to 4 h production (6.5.2) shall be subject to a uniformity check by Brinell hardness testing or an equivalent method. For this purpose, 10 % of the furnace production shall be sampled and shall meet the minimum hardness specified in Table 2 for the type and shall also be within 20 Brinell points of the hardness of the forging from which the tensile test was taken.

6.6.2 In the event that the test sample does not meet these criteria, the remainder of that production group shall be hardness tested and all of those forgings that fall outside these limits shall be retempered or reheat-treated at the manufacturer's option and retested.

7. Magnetic Particle Examination

- 7.1 All quenched and tempered forgings shall be subject to magnetic particle examination after heat treatment. The methods used shall be in accordance with Practice A275/A275M.
- 7.2 Only direct current or rectified alternating (full or half wave) current shall be used as the electric power source for any of the magnetizing methods.
- 7.3 The forgings shall be free from linear indications indicative of cracks. In case of doubt as to the type of condition giving rise to linear magnetic particle indications, they may be inspected for Type II indications referenced in Reference Photographs E433 when inspected by the liquid penetrant method in accordance with Practice E165/E165M. Alternatively, some other suitable method for classifying the indications may be used as agreed upon between the manufacturer and the purchaser.

8. Workmanship

8.1 If the thickness of a portion of the wall of a forging is less than that specified, the forgings may be accepted by the purchaser, provided that such irregularity will not require lowering the allowable working pressure below that for which the forging was designed.

9. Repair Welding

9.1 Repair welding shall be permitted when mutually agreed upon between the purchaser and the manufacturer and shall be performed in accordance with all the requirements of the applicable code or rules of construction.

10. Keywords

10.1 alloy steel forgings; carbon steel forgings; gas bottles; pressure vessels; thin wall

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall apply only when specified by the purchaser on the inquiry, contract, or order. Details of these supplementary requirements shall be agreed upon by the manufacturer and the purchaser.

S1.Grain Size

- S1.1 When a grain size range is required, it shall be specified in the ordering information and shall be determined by an agreed-upon method from Test Methods E112.
- S1.2 Samples for grain size estimation shall be taken from the tension test specimen location.

S2. Rough Machining

S2.1 Rough machining shall be performed in the sequence and manner as specified.

S3. Impact Testing

S3.1 Charpy V-notch test specimens shall be taken from the same location and in the same orientation as tension test specimens. The number of specimens, minimum energy values, and test temperature(s) shall be as specified.

S4. Fracture Toughness

- S4.1 Specific fracture toughness requirements are levied by certain sections of the ASME Boiler and Pressure Vessel Code. Forgings in the permitted types shall comply with the applicable code sections.
- S4.2 The necessary code references toughness criteria and test temperature data shall be included in the ordering information.

S5. Ultrasonic Examination

- S5.1 Ultrasonic examination of forgings shall be carried out in accordance with Practice A388/A388M.
- S5.2 Acceptance criteria shall be specified and shall be in accordance with the applicable code or purchaser's specification and shall be included as part of the ordering information.

SPECIFICATION FOR SEAMLESS AUSTENITIC STEEL PIPE FOR HIGH-TEMPERATURE SERVICE



SA-376/SA-376M

(23)

(Identical with ASTM Specification A376/A376M-19 except for the deletion of HT-O option from 5.2.1 and 13.1, and clarification of heat-treatment requirements in 5.2.1.)

Specification for Seamless Austenitic Steel Pipe for High-Temperature Service

1. Scope

1.1 This specification covers seamless austenitic steel pipe intended for high-temperature service. Among the grades covered are H grades and nitrogen grades that are specifically intended for high-temperature service.

Note 1—This specification was originally developed for use for piping in the central stations of electric-power generating thermal plants. However, its use is not restricted to such applications and it may be used in other applications for which the attributes of the materials, as defined by this specification, are appropriate.

- 1.2 Optional supplementary requirements (S1 through S10) are provided. These supplementary requirements specify additional tests that will be made only when stated in the order, together with the number of such tests required.
- 1.3 Grades TP321 and TP321H have lower strength requirements for nominal wall thicknesses greater than 3/8 in. [9.5 mm].
- 1.4 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.

Note 2—The dimensionless designators NPS (nominal pipe size) and DN (Diametre Nominel) have been substituted in this standard for such traditional terms as "nominal diameter," "size," and "nominal size."

1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A262 Practices for Detecting Susceptibility to Intergranular Attack in Austenitic Stainless Steels
- A999/A999M Specification for General Requirements for Alloy and Stainless Steel Pipe
- E112 Test Methods for Determining Average Grain Size
- E213 Practice for Ultrasonic Testing of Metal Pipe and Tubing
- E381 Method of Macroetch Testing Steel Bars, Billets, Blooms, and Forgings
- E426 Practice for Electromagnetic (Eddy Current) Examination of Seamless and Welded Tubular Products, Titanium, Austenitic Stainless Steel and Similar Alloys
- 2.2 Other Standards:
- SNT-TC-1A Personnel Qualification and Certification in Nondestructive Testing

3. Ordering Information

- 3.1 Orders for material to this specification should include the following, as required to describe the desired material adequately:
 - 3.1.1 Quantity (feet, centimetres, or number of lengths),
 - 3.1.2 Name of material (seamless austenitic steel pipe),
 - 3.1.3 Grade (Table 1),
- 3.1.4 Size (nominal size, or outside diameter and schedule number or average wall thickness),
- 3.1.5 Lengths (specific or random), (Permissible Variations in Length Section of Specification A999/A999M),
- 3.1.6 End finish (Ends Section of Specification A999/A999M),
- 3.1.7 Optional requirements (Section 8) (see Hydrostatic Test Requirements Section and the Permissible Variation in Weight for Seamless Pipe Section for weighing individual lengths, of Specification A999/A999M), (see 9.6, repairing by welding; 13.3, die stamping),

TABLE 1 Chemical Requirements

	UNS							Composition	n, % ^A					
Grade	Desig- nation	Carbon	Man- ganese	Phos- phorus	Sul- fur	Sili- con	Nickel	Chromium	Molyb- denum	Tita- nium	Colum- bium	Tan- talum	Nitro- gen ^B	Others
TP304	S30400	0.08	2.00	0.045	0.030	0.75	8.0-11.0	18.0-20.0						
TP304H	S30409	0.04-0.10	2.00	0.045	0.030	0.75	8.0-11.0	18.0-20.0						
TP304N	S30451	0.08	2.00	0.045	0.030	0.75	8.0-11.0	18.0-20.0					0.10-0.16	
TP304LN	S30453	0.035	2.00	0.045	0.030	0.75	8.0-11.0	18.0-20.0					0.10-0.16	
TP316	S31600	0.08	2.00	0.045	0.030	0.75	11.0-14.0	16.0-18.0	2.00-3.00					
TP316H	S31609	0.04-0.10	2.00	0.045	0.030	0.75	11.0-14.0	16.0-18.0	2.00-3.00					
TP316N	S31651	0.08	2.00	0.045	0.030	0.75	11.0-14.0	16.0-18.0	2.00-3.00				0.10-0.16	
TP316LN	S31653	0.035	2.00	0.045	0.030	0.75	11.0-14.0	16.0-18.0	2.00-3.00				0.10-0.16	
TP321	S32100	0.08	2.00	0.045	0.030	0.75	9.0-13.0	17.0-19.0		C				
TP321H	S32109	0.04-0.10	2.00	0.045	0.030	0.75	9.0-13.0	17.0-19.0		D				
TP347	S34700	0.08	2.00	0.045	0.030	0.75	9.0-13.0	17.0-19.0			E			
TP347H	S34709	0.04-0.10	2.00	0.045	0.030	0.75	9.0-13.0	17.0-19.0			F			
TP347LN	S34751	0.005-	2.00	0.045	0.030	1.00	9.0-13.0	17.0- 19.0			0.20-		0.06-0.10	
		0.020									0.50 ^G			
TP348 ^H	S34800	0.08	2.00	0.045	0.030	0.75	9.0-13.0	17.0-19.0			E	0.10		Co 0.20
TP348H	S34809	0.04-0.10	2.00	0.045	0.030	1.00	9.0-13.0	17.0-19.0			F	0.10		
16-8-2H	S16800	0.05-0.10	2.00	0.045	0.030	0.75	7.5-9.5	14.5-16.5	1.50-2.00					
	S31725	0.030	2.00	0.045	0.030	0.75	13.5-17.5	18.0-20.0	4.0-5.0				0.20 max	Cu 0.75
	S31726	0.030	2.00	0.045	0.030	0.75	14.5-17.5	17.0-20.0	4.0-5.0				0.10-0.20	Cu 0.75
	S34565	0.030	5.0-7.0	0.030	0.010	1.0	16.0-18.0	23.0-25.0	4.0-5.0				0.040-0.060	Cb 0.10
	S31266	0.030	2.00-4.00	0.035	0.020	1.00	21.0-24.0	23.0-25.0	5.2-6.2				0.035-0.060	Cu
														1.00-2.50
														W 1.50-2.50

AMaximum, unless otherwise indicated. Where ellipses (...) appear in this table, there is no requirement and analysis for the element need not be determined or reported.

- 3.1.8 Test report required (Certification Section of Specification A999/A999M),
 - 3.1.9 Specification designation, and
- 3.1.10 Special requirements or any supplementary requirements selected, or both.

4. General Requirements

4.1 Material furnished to this specification shall conform to the applicable requirements of the current edition of Specification A999/A999M unless otherwise provided herein.

5. Materials and Manufacture

- 5.1 *Manufacture*—At the manufacturer's option, pipe may be either hot finished or cold finished, with a suitable finishing treatment, where necessary.
 - 5.2 Heat Treatment:
- 5.2.1 All pipe shall be furnished in the heat-treated condition. For H grades, separate solution treatments are required for solution annealing; in-process heat treatments are not permitted as a substitute for the separate solution annealing treatments.
- 5.2.2 As an alternate to final heat treatment in a continuous furnace or batch-type furnace, immediately following hot forming while the temperature of the pipes is not less than the specified minimum solution treatment temperature, pipes may be individually quenched in water or rapidly cooled by other means.
- 5.2.3 Grades TP304, TP304N, TP304LN, TP316, TP316N, TP316LN, TP321, TP347, TP347LN, TP348, 16-8-2H, S 31725, and S 31726—Unless otherwise stated in the order,

heat treatment shall consist of heating to a minimum temperature of 1900 $^{\circ}$ F [1040 $^{\circ}$ C] and quenching in water or rapidly cooling by other means.

- 5.2.3.1 The purchaser may specify controlled structural or special service characteristics which shall be used as a guide for the most suitable heat treatment. If the final heat treatment is at a temperature under 1900 °F [1040 °C], each pipe shall be stenciled with the final heat treatment temperature in degrees Fahrenheit or Celsius after the suffix "HT."
- 5.2.4 Grades TP304H, TP316H, TP321H, TP347H, TP348H, and 16-8-2H—If cold working is involved in processing, the minimum solution-treating temperature for Grades TP321H, TP347H, and TP348H shall be 2000 °F [1100 °C], for Grades TP304H and TP316H, 1900 °F [1040 °C], and for Grade 16-8-2H, 1800 °F [980 °C]. If the material is hot-rolled, the minimum solution-treating temperatures for Grades TP321H, TP347H, and TP348H shall be 1925 °F [1050 °C], for Grades TP304H and TP316H, 1900 °F [1040 °C], and for Grade 16-8-2H, 1800 °F [980 °C].
- 5.2.5 *Grade S34565*—Heat treatment shall consist of heating to a temperature in the range of 2050 °F [1120 °C] minimum and 2140 °F [1170 °C] maximum, and quenching in water or rapidly cooling by other means.
- 5.2.6 *Grade S31266*—Heat treatment shall consist of heating to a temperature in the range of 2100 °F [1150 °C] minimum and quenching in water or rapidly cooling by other means.
- 5.3 A solution annealing temperature above 1950 °F [1065 °C] may impair the resistance to intergranular corrosion after

^B The method of analysis for nitrogen shall be a matter of agreement between the purchaser and manufacturer.

 $^{^{\}it C}$ The titanium content shall be not less than five times the carbon content and not more than 0.70 %. $^{\it D}$ The titanium content shall be not less than four times the carbon content and not more than 0.70 %.

E The columbium content shall be not less than ten times the carbon content and not more than 1.10 %.

F The columbium content shall be not less than eight times the carbon content and not more than 1.10 %.

^GThe columbium content shall not be less than 15 times the carbon content.

^H This grade is intended for special purpose applications.

subsequent exposure to sensitizing conditions in TP321, TP321H, TP347, TP347H, TP348, and TP348H. When specified by the purchaser, a lower temperature stabilization or re-solution anneal shall be used subsequent to the initial high temperature solution anneal (see Supplementary Requirement S9).

5.4 The grain size of grades 304H, 316H, 321H, 347H, and 348H as determined in accordance with Test Methods E112, shall be No. 7 or coarser.

6. Chemical Composition

6.1 The steel shall conform to the requirements as to chemical composition prescribed in Table 1.

7. Product Analysis

7.1 At the request of the purchaser, an analysis of one billet from each heat or two pipes from each lot shall be made by the manufacturer. A lot of pipe shall consist of the number of lengths as a function of size, as shown below, of the same size and wall thickness from any one heat of steel:

NPS [DN] Designator	Lengths of Pipe in Lot
Under NPS 2 [DN 50]	400 or fraction thereof
NPS 2 [DN 50] to NPS 5	200 or fraction thereof
[DN 125], incl	
Over NPS 5 [DN 125]	100 or fraction thereof

- 7.2 The results of these analyses shall be reported to the purchaser or the purchaser's representative, and shall conform to the requirements specified in Table 1.
- 7.3 If the analysis of one of the tests specified in Section 8 does not conform to the requirements specified in Section 6, an analysis of each billet or pipe from the same heat or lot may be made, and all billets or pipe conforming to the requirements shall be accepted.

8. Tensile Requirements

8.1 The material shall conform to the requirements as to tensile properties prescribed in Table 2.

9. Workmanship, Finish, and Appearance

- 9.1 The pipe manufacturer shall explore a sufficient number of visual surface imperfections to provide reasonable assurance that they have been properly evaluated with respect to depth. Exploration of all surface imperfections is not required but may be necessary to assure compliance with 9.2.
- 9.2 Surface imperfections that penetrate more than $12\frac{1}{2}$ % of the nominal wall thickness or encroach on the minimum wall thickness shall be considered defects. Pipe with such defects shall be given one of the following dispositions:
- 9.2.1 The defect may be removed by grinding provided that the remaining wall thickness is within specified limits.
- 9.2.2 Repaired in accordance with the repair welding provisions of 9.6.
- 9.2.3 The section of pipe containing the defect may be cut off within the limits of requirements on length.
 - 9.2.4 Rejected.
- 9.3 To provide a workmanlike finish and basis for evaluating conformance with 9.2, the pipe manufacturer shall remove by grinding the following:

TABLE 2 Tensile Requirements

Grade	Tensile ^A strength, min, ksi [MPa]	Yield strength min,	Elongation in 2 in. or 50 mm (or 4D) min, %		
	,	ksi [MPa]	Longitudinal	Transverse	
TP304, TP304H, TP304LN, TP316, TP316H, TP316LN, TP347, TP347H, TP347LN, TP348, TP348H, 16-8-2H, S31725	75 [515]	30 [205]	35	25	
TP304N, TP316N, S31726	80 [550]	35 [240]	35	25	
S34565	115 [790]	60 [415]	35	30	
TP321, 321H ≤0.375 in. [9.50 mm]	75 [515]	30 [205]	35	25	
>0.375 in. [9.50 mm] ^B	70 [480]	25 [170]	35	25	
S31266	109 [750]	61 [420]	35	25	

 $^{^{}A}\!For$ grade TP304, NPS8 or larger, and in schedules 140 and heavier, the required minimum tensile strength shall be 70 ksi [480 MPa].

9.3.1 Mechanical marks, abrasions (see Note 3), and pits, any of which imperfections are deeper than ½ in. [1.6 mm].

Note 3—Marks and abrasions are defined as cable marks, dinges, guide marks, roll marks, ball scratches, scores, die marks, and so forth.

- 9.3.2 Visual imperfections commonly referred to as scabs, seams, laps, tears, or slivers found by exploration in accordance with 9.1 to be deeper than 5 % of the nominal wall thickness.
- 9.4 At the purchaser's discretion, pipe shall be subject to rejection if surface imperfections acceptable under 9.2 are not scattered, but appear over a large area in excess of what is considered a workmanlike finish. Disposition of such pipe shall be a matter of agreement between the manufacturer and the purchaser.
- 9.5 When imperfections or defects are removed by grinding, a smooth curved surface shall be maintained, and the wall thickness shall not be decreased below that permitted by this specification. The outside diameter at the point of grinding may be reduced by the amount so removed.
- 9.5.1 Wall thickness measurements shall be made with a mechanical caliper or with a properly calibrated nondestructive testing device of appropriate accuracy. In case of dispute, the measurement determined by use of the mechanical caliper shall govern.
- 9.6 Weld repair shall be permitted only subject to the approval of the purchaser and in accordance with Specification A999/A999M.
 - 9.7 The finished pipe shall be reasonably straight.
- 9.8 The pipe shall be free of scale and contaminating iron particles. Pickling, blasting, or surface finishing is not mandatory when pipe is bright annealed. The purchaser may request that a passivating treatment be applied.

^B Prior to the issuance of A376/A376M – 88, the tensile and yield strength values were 75 [520] and 30 [210] respectively, for nominal wall greater than 0.375 in. [9.5 mm].

10. Hydrostatic or Nondestructive Electric Test

- 10.1 Each pipe shall be subjected to the Nondestructive Electric Test or the Hydrostatic Test. Unless specified by the purchaser, either test may be used at the option of the producer.
- 10.2 *Hydrostatic Test*—Each length of finished pipe shall be subjected to the hydrostatic test in accordance with Specification A999/A999M, unless specifically exempted under the provisions of 10.3 and 10.4.
- 10.3 For pipe sizes NPS 24 [DN 600] and over, the purchaser, with the agreement of the manufacturer, may complete the hydrostatic test requirement with the system pressure test, which may be lower or higher than the specification test pressure, but in no case shall the test pressure be lower than the system design pressure. Each length of pipe furnished without the completed manufacturer's hydrostatic test shall include with the mandatory marking the letters "NH."
- 10.4 Nondestructive Examination—Each pipe shall be examined with a nondestructive test in accordance with Practice E213 or Practice E426. Unless specifically called out by the purchaser, the selection of the nondestructive electric test will be at the option of the manufacturer. The range of pipe sizes that may be examined by each method shall be subject to the limitations in the scope of the respective practices.
- 10.4.1 The following information is for the benefit of the user of this specification:
- 10.4.1.1 The reference standards defined in 10.10.1 through 11.10.4 are convenient standards for calibration of nondestructive testing equipment. The dimensions of these standards should not be construed as the minimum size imperfection detectable by such equipment.
- 10.4.1.2 The ultrasonic testing (UT) can be performed to detect both longitudinally and circumferentially oriented defects. It should be recognized that different techniques should be employed to detect differently oriented imperfections. The examination may not detect short, deep, defects.
- 10.4.1.3 The eddy-current testing (ET) referenced in Practice E426 has the capability of detecting significant discontinuities, especially the short abrupt type.
- 10.4.1.4 A purchaser interested in ascertaining the nature (type, size, location, and orientation) of discontinuities that can be detected in the specific application of these examinations should discuss this with the manufacturer of the tubular product.
- 10.5 *Time of Examination*—Nondestructive testing for specification acceptance shall be performed after all mechanical processing, heat treatments, and straightening operations. This requirement does not preclude additional testing at earlier stages in the processing.
 - 10.6 Surface Condition:
- 10.6.1 All surfaces shall be free of scale, dirt, grease, paint, or other foreign material that could interfere with interpretation of test results. The methods used for cleaning and preparing the surfaces for examination shall not be detrimental to the base metal or the surface finish.
- 10.6.2 Excessive surface roughness or deep scratches can produce signals that interfere with the test.

- 10.7 Extent of Examination:
- 10.7.1 The relative motion of the pipe and the transducer(s), coil(s), or sensor(s) shall be such that the entire pipe surface is scanned, except as in 5.2.
- 10.7.2 The existence of end effects is recognized, and the extent of such effects shall be determined by the manufacturer, and, if requested, shall be reported to the purchaser. Other nondestructive tests may be applied to the end areas, subject to agreement between the purchaser and the manufacturer.
- 10.8 *Operator Qualifications*—The test unit operator shall be certified in accordance with SNT-TC-1A, or an equivalent recognized and documented standard.
 - 10.9 Test Conditions:
- 10.9.1 For eddy-current testing, the excitation coil frequency shall be chosen to ensure adequate penetration yet provide good signal-to-noise ratio.
- 10.9.2 The maximum eddy-current coil frequency used shall be as follows:

 Specified Wall Thickness, in. [mm]
 Maximum Frequency, KHz

 <0.050 [1.25]</td>
 100

 0.050 to 1.50 [1.25 to 3.80]
 50

 >0.150 [3.80]
 10

- 10.9.3 *Ultrasonic*—For examination by the ultrasonic method, the minimum nominal transducer frequency shall be 2.00 MHz and the maximum nominal transducer size shall be 1.5 in. [38 mm].
- 10.9.3.1 If the equipment contains a reject notice filter setting, this shall remain off during calibration and testing unless linearity can be demonstrated at that setting.
 - 10.10 Reference Standards:
- 10.10.1 Reference standards of convenient length shall be prepared from a length of pipe of the same grade, size (NPS, or outside diameter and schedule or wall thickness), surface finish, and heat treatment condition as the pipe to be examined.
- 10.10.2 For Ultrasonic Testing, the reference ID and OD notches shall be any one of the three common notch shapes shown in Practice E213, at the option of the manufacturer. The depth of each notch shall not exceed 12½% of the specified nominal wall thickness of the pipe or 0.004 in. [0.1 mm], whichever is greater. The width of the notch shall not exceed twice the depth. Notches shall be placed on both the OD and ID surfaces
- 10.10.3 For Eddy-Current Testing, the reference standard shall contain, at the option of the manufacturer, any one of the following discontinuities:
- 10.10.3.1 Drilled Hole—The reference standard shall contain three or more holes, equally spaced circumferentially around the pipe and longitudinally separated by a sufficient distance to allow distinct identification of the signal from each hole. The holes shall be drilled radially and completely through the pipe wall, with care being taken to avoid distortion of the pipe while drilling. One hole shall be drilled in the weld, if visible. Alternately, the producer of welded pipe may choose to drill one hole in the weld and run the calibration standard through the test coils three times with the weld turned at 120° on each pass. The hole diameter shall vary with NPS as follows:

NPS [DN] Designator	Hole Diameter
	0.039 in. [1 mm]
above 1/2 to 11/4 [15 to 32]	0.055 in. [1.4 mm]
above 11/4 to 2 [32 to 50]	0.071 in. [1.8 mm]
above 2 to 5 [50 to 125]	0.087 in. [2.2 mm]
above 5 [125]	0.106 in. [2.7 mm]

10.10.3.2 Transverse Tangential Notch—Using a round tool or file with a $\frac{1}{4}$ -in. [6.4-mm] diameter, a notch shall be filed or milled tangential to the surface and transverse to the longitudinal axis of the pipe. Said notch shall have a depth not exceeding $12\frac{1}{2}$ % of the specified nominal wall thickness of the pipe or 0.004 in. [0.102 mm], whichever is greater.

10.10.3.3 Longitudinal Notch—A notch 0.031 in. [0.8 mm] or less in width shall be machined in a radial plane parallel to the tube axis on the outside surface of the pipe, to have a depth not exceeding 12½% of the specified wall thickness of the pipe or 0.004 in. [0.1 mm], whichever is greater. The length of the notch shall be compatible with the testing method.

10.10.3.4 More or smaller reference discontinuities, or both, may be used by agreement between the purchaser and the manufacturer.

10.11 Standardization Procedure:

10.11.1 The test apparatus shall be standardized at the beginning and end of each series of pipes of the same size (NPS or diameter and schedule or wall thickness), grade and heat treatment condition, and at intervals not exceeding 4 h. More frequent standardization may be performed at the manufacturer's option or may be required upon agreement between the purchaser and the manufacturer.

10.11.2 The test apparatus shall also be standardized after any change in test system settings; change of operator; equipment repair; or interruption due to power loss, process shutdown, or when a problem is suspected.

10.11.3 The reference standard shall be passed through the test apparatus at the same speed and test system settings as the pipe to be tested.

10.11.4 The signal-to-noise ratio for the reference standard shall be $2\frac{1}{2}$ to 1 or greater. Extraneous signals caused by identifiable causes such as dings, scratches, dents, straightener marks, and so forth, shall not be considered noise. The rejection amplitude shall be adjusted to be at least 50 % of full scale of the readout display.

10.11.5 If upon any standardization, the rejection amplitude has decreased by 29 % (3 dB) of peak height from the last standardization, the pipe since the last calibration shall be rejected. The test system settings may be changed, or the transducer(s), coil(s) or sensor(s) adjusted, and the unit restandardized, but all pipe tested since the last acceptable standardization must be retested for acceptance.

10.12 Evaluation of Imperfections:

10.12.1 Pipes producing a signal equal to or greater than the lowest signal produced by the reference standard(s) shall be identified and separated from the acceptable pipes. The area producing the signal may be reexamined.

10.12.2 Such pipes shall be rejected if the test signal was produced by imperfections that cannot be identified or was produced by cracks or crack-like imperfections. These pipes may be repaired in accordance with Sections 12 and 13. To be accepted, a repaired pipe must pass the same nondestructive

test by which it was rejected, and it must meet the minimum wall thickness requirements of this specification.

10.12.3 If the test signals were produced by visual imperfections such as:

- (1) Scratches,
- (2) Surface roughness,
- (3) Dings,
- (4) Straightener marks,
- (5) Cutting chips,
- (6) Steel die stamps,
- (7) Stop marks, or
- (8) Pipe reducer ripple.

The pipe may be accepted based on visual examination provided the imperfection is less than 0.004 in. [0.1 mm] or $12\frac{1}{2}$ % of the specified wall thickness (whichever is greater).

10.12.4 Rejected pipe may be reconditioned and retested providing the wall thickness is not decreased to less than that required by this or the product specification. The outside diameter at the point of grinding may be reduced by the amount so removed. To be accepted, retested pipe shall meet the test requirement.

10.12.5 If the imperfection is explored to the extent that it can be identified as non-rejectable, the pipe may be accepted without further test providing the imperfection does not encroach on the minimum wall thickness.

11. Mechanical Tests Required

11.1 Lot—For tension and flattening tests, the term "lot" shall be as follows:

11.1.1 Where the final heat treated condition is obtained in a continuous furnace or by quenching after hot forming, the term lot shall apply to all pipes of the same specified outside diameter and specified wall thickness (or schedule) of the same heat, heat treated in the same furnace at the same temperature, time at heat, and furnace speed in the same production run, or all pipes of the same specified outside diameter and specified wall thickness (schedule) of the same heat, hot formed and quenched in the same production run.

11.1.2 Where the final heat treated condition is obtained in a batch-type furnace equipped with recording pyrometers and automatically controlled within a 50 °F [30 °C] or lesser range, the term lot shall apply to all pipes of the same specified outside diameter and specified wall thickness (schedule) of the same heat, subjected to the same finishing temperature within the same production run.

11.1.3 Where the final heat treated condition is obtained in a batch-type furnace not equipped with recording pyrometers and automatically controlled within a 50 °F [30 °C] or lesser range, the term lot shall apply to the larger of: (*I*) each 200 ft [60 m] or fraction thereof and (2) those pipes heat treated in the same furnace batch charge for pipes of the same specified outside diameter and specified wall thickness (or schedule) that are produced from the same heat of steel and are subjected to the same finishing temperature within the same production run.

11.2 Transverse or Longitudinal Tension Test—One tension test shall be made on a specimen for lots of not more than 100 pipes. Tension tests shall be made on specimens from two tubes for lots of more than 100 pipes.

11.3 Flattening Test—For pipe heat treated in a batch-type furnace not equipped with recording pyrometers and automatically controlled within a 50 °F [30 °C] or lesser range, the flattening test shall be made on 5 % of the pipe from each heat-treated lot. When heat treated by the continuous process, by quenching after hot forming or in a batch-type furnace equipped with recording pyrometers and automatically controlled within a 50 °F [30 °C] or lesser range, this test shall be made on a sufficient number of pipe to constitute 5 % of the lot but in no case less than two pipes.

12. Certification

12.1 In addition to the certification required by Specification A999/A999M, the certification for pipe furnished to this specification shall identify each length of pipe which is furnished without the manufacturer's completed hydrostatic test, in accordance with 10.3.

13. Product Marking

13.1 In addition to the marking prescribed in Specification A999/A999M, the marking shall include the ANSI schedule

- number, the heat number or manufacturer's number by which the heat can be identified, and if applicable, NH when hydrotesting is not performed and ET when eddy-current testing is performed, or UT when ultrasonic testing is performed.
- 13.2 If the pipe conforms to any of the supplementary requirements specified in S1 through S10, compliance shall be so indicated by adding the symbol "S" directly followed by the number of the applicable supplementary requirement to the marking prescribed in 13.1.
- 13.3 No steel indentation stamping shall be done without the purchaser's consent.

14. Keywords

14.1 austenitic stainless steel; central station service; feedwater heater tubes; stainless steel tube; steel tube; welded steel tube

SUPPLEMENTARY REQUIREMENTS

FOR PIPE REQUIRING SPECIAL CONSIDERATION

One or more of the following supplementary requirements shall apply only when specified in the purchase order. The purchaser may specify a different frequency of test or analysis than is provided in the supplementary requirement. Subject to agreement between the purchaser and manufacturer, retest and retreatment provisions of these supplementary requirements may also be modified.

S1. Product Analysis

S1.1 Product analysis shall be made on each length of pipe. Individual lengths failing to conform to the chemical composition requirements shall be rejected.

S2. Transverse Tension Tests

S2.1 A transverse tension test shall be made on a specimen from one end or both ends of each pipe NPS 8 [DN 200] and over in nominal diameter. If this supplementary requirement is specified, the number of tests per pipe shall also be specified. If a specimen from any length fails to meet the required tensile properties (tensile, yield, and elongation), that length shall be rejected subject to retreatment in accordance with Specification A999/A999M and satisfactory retest.

S3. Flattening Test

S3.1 The flattening test of Specification A999/A999M shall be made on a specimen from one end or both ends of each pipe. Crop ends may be used. If this supplementary requirement is specified, the number of tests per pipe shall also be specified. If a specimen from any length fails because of lack of ductility prior to satisfactory completion of the first step of the flattening test requirement that pipe shall be rejected subject to retreatment in accordance with Specification A999/A999M and satisfactory retest. If a specimen from any length of pipe fails

because of a lack of soundness that length shall be rejected, unless subsequent retesting indicates that the remaining length is sound.

S4. Etching Tests

S4.1 The steel shall be homogeneous as shown by etching tests conducted in accordance with the appropriate portions of Method E381. Etching tests shall be made on a cross section from one end or both ends of each pipe and shall show sound and reasonably uniform material free from injurious laminations, cracks, and similar objectionable defects. If this supplementary requirement is specified, the number of tests per pipe required shall also be specified. If a specimen from any length shows objectionable defects, the length shall be rejected, subject to removal of the defective end and subsequent retests indicating the remainder of the length to be sound and reasonably uniform material.

S5. Photomicrographs

S5.1 Photomicrographs at 100 diameters may be made from one end of each piece of pipe furnished in sizes NPS 6 [DN 150] and larger in the as-furnished condition. Such photomicrographs shall be suitably identified as to pipe size, wall thickness, piece number, and heat. Such photomicrographs are for information only, and shall show the actual metal structure of the pipe as finished.

S6. Ultrasonic Test

S6.1 Each piece of pipe may be ultrasonically tested to determine its soundness throughout the entire length of the pipe. Each piece shall be ultrasonically tested in a circumferential direction in such a manner that the entire piece is scanned by the ultrasonic beam. The calibration standard shall be prepared from a section of pipe which has two notches, one in the inside surface and one in the outside surface. The notches shall be at least 1½-in. [38-mm] long and have a depth of 3 % of the wall thickness, or 0.004 in. [0.102 mm], whichever is the greater. Any pipe showing an ultrasonic indication of greater amplitude than the amplitude of the indication from the calibration standard shall be subject to rejection.

S7. Hot Ductility Test for Indicating Weldability

S7.1 A high-temperature ductility test may be made upon each heat of material supplied in heavy-wall pipe sections. An appropriate specimen shall be heated to an initial temperature, cooled 100 °F [50 °C], then subjected to a tension test, and shall show a minimum reduction of area of 60 %. The initial temperature is that temperature 50 °F [30 °C] below the temperature at which material exhibits zero ductility. Rejection of material shall not be based upon this test.

S8. Retests

S8.1 Upon the purchaser's request, retests shall be made from sections of material removed from any part of the pipe. Failure to meet the requirements stated in this specification shall be cause for rejection.

S9. Stabilization Heat Treatment

S9.1 Subsequent to the solution anneal required in 5.4, Grades TP321, TP321H, TP347, TP347H, TP348, and TP348H shall be given a stabilization heat treatment at a temperature lower than that used for the initial solution annealing heat treatment. The temperature of stabilization heat treatment shall be at a temperature as agreed upon between the purchaser and vendor.

S10. Intergranular Corrosion Test

S10.1 When specified, material shall pass intergranular corrosion tests conducted by the manufacturer in accordance with Practices A262, Practice E.

Note S10.1—Practice E requires testing on the sensitized condition for low carbon or stabilized grades, and on the as-shipped condition for other grades.

S10.2 A stabilization heat treatment in accordance with Supplementary Requirement S9 may be necessary and is permitted in order to meet this requirement for the grades containing titanium or columbium, particularly in their H versions.

SPECIFICATION FOR PRESSURE VESSEL PLATES, ALLOY STEEL, CHROMIUM-MOLYBDENUM



SA-387/SA-387M



(Identical with ASTM Specification A387/A387M-17a.)

Standard Specification for Pressure Vessel Plates, Alloy Steel, Chromium-Molybdenum

1. Scope

- 1.1 This specification covers chromium-molybdenum alloy steel plates intended primarily for welded boilers and pressure vessels designed for elevated temperature service.
- 1.2 Plates are available under this specification in several grades having different alloy contents as follows:

	Nominal	Nominal
	Chromium	Molybdenum
Grade	Content, %	Content, %
2	0.50	0.50
12	1.00	0.50
11	1.25	0.50
22	2.25	1.00
21	3.00	1.00
5	5.00	0.50
9	9.00	1.00
91	9.00	1.00

1.3 Each grade except Grade 91 is available in two classes of tensile strength levels as defined in the Tensile Requirements tables. Grade 91 is available only as Class 2. Grade 91 consists of two types, with Type 2 differentiated from Type 1 by requiring restricted composition for the enhancement of creep resistance.

Note 1—Grade 911, previously covered by this specification, is now covered by Specification A1017/A1017M.

- 1.4 The maximum thickness of plates is limited only by the capacity of the composition to meet the specified mechanical property requirements.
- 1.5 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents. Therefore, each system must

be used independently of the other. Combining values from the two systems may result in nonconformance with this specification.

1.6 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A20/A20M Specification for General Requirements for Steel Plates for Pressure Vessels
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A435/A435M Specification for Straight-Beam Ultrasonic Examination of Steel Plates
- A577/A577M Specification for Ultrasonic Angle-Beam Examination of Steel Plates
- A578/A578M Specification for Straight-Beam Ultrasonic Examination of Rolled Steel Plates for Special Applica-
- A1017/A1017M Specification for Pressure Vessel Plates, Alloy Steel, Chromium-Molybdenum-Tungsten
- 2.2 AWS Specifications:
- A5.5/A5.5M Low-Alloy Steel Electrodes for Shielded Metal Arc Welding
- A5.23/A5.23M Low-Alloy Steel Electrodes and Fluxes for Submerged Arc Welding
- A5.28/A5.28M Low-Alloy Steel Electrodes and Rods for Gas Shielded Arc Welding

A5.29/A5.29M Low-Alloy Steel Electrodes for Flux Cored Arc Welding

3. General Requirements and Ordering Information

- 3.1 Material supplied to this material specification shall conform to Specification A20/A20M. These requirements outline the testing and retesting methods and procedures, permissible variations in dimensions and weight, quality and repair of defects, marking, loading, and ordering information.
- 3.2 In addition to the basic requirements of this specification, certain supplementary requirements are available when additional control, testing, or examination is required to meet end use requirements. The purchaser is referred to the listed supplementary requirements in this specification and to the detailed requirements in Specification A20/A20M.
- 3.3 If the requirements of this specification are in conflict with the requirements of Specification A20/A20M, the requirements of this specification shall prevail.

4. Manufacture

4.1 Steelmaking Practice—The steel shall be killed.

5. Heat Treatment

5.1 Except for Grade 91, all plates shall be thermally treated either by annealing, normalizing and tempering, or, when permitted by the purchaser, accelerated cooling from the austenitizing temperature by air blasting or liquid quenching, followed by tempering. Minimum tempering temperatures shall be as follows:

Grade	Temperature, °F [°C]				
2, 12, and 11	1150 [620]				
22, 21, and 9	1250 [675]				
5	1300 [705]				

- 5.1.1 Grade 91 plates shall be thermally treated, either by normalizing and tempering or by accelerated cooling from the austenitizing temperature by air blasting or liquid quenching, followed by tempering. Grade 91 plates shall be austenitized at 1900 to 1975°F [1040 to 1080°C] and shall be tempered at 1350 to 1470°F [730 to 800°C].
- 5.2 Grade 5, 9, 21, 22, and 91 plates ordered without the heat treatment required by 5.1 shall be furnished in either the stress relieved or the annealed condition.
- 5.3 For plates ordered without the heat treatment required by 5.1, heat treatment of the plates to conform to 5.1 and to Table 2 or Table 3, as applicable, shall be the responsibility of the purchaser.

6. Chemical Requirements

6.1 The steel shall conform to the requirements as to chemical composition shown in Table 1 unless otherwise modified in accordance with Supplementary Requirement S17, Vacuum Carbon-Deoxidized Steel, in Specification A20/A20M for grades other than Grade 11.

7. Metallurgical Structure

7.1 Austenitic Grain Size—Grade 2 material shall have a coarse austenitic grain size.

8. Mechanical Requirements

- 8.1 Tension Test Requirements:
- 8.1.1 The material as represented by the tension test specimens shall conform to the applicable requirements of Table 2 or Table 3, as specified on the order.
- 8.1.2 Adjustment of the percentage elongation requirements is permitted in accordance with Specification A20/A20M for plates up to ¾ in. [20 mm] inclusive, in thickness when an 8-in. [200-mm] gage length is used.

9. Repair Welding

- 9.1 Repair welding shall be permitted only with the approval of the purchaser. Repair welds shall meet the requirements of the construction code specified by the purchaser.
- 9.2 All repair welds in Grade 91 shall be made with one of the following welding processes and consumables: SMAW, A5.5/A5.5M E90XX-B9; SAW, A5.23/A5.23M EB9 + neutral flux; GTAW, A5.28/A5.28M ER90S-B9; and FCAW A5.29/A5.29M E91T1-B9. In addition, the sum of the Ni+Mn content of all welding consumables used to weld repair Grade 91 plate shall not exceed 1.0 %.

10. Marking

10.1 In addition to the marking required in Specification A20/A20M, each plate shall be legibly stamped or stenciled, depending upon the ordered thickness, with the letter A for annealed, N for normalized and tempered, and Q for accelerated cooled and tempered, as applicable. Grade 91 plates shall be marked with the appropriate type. Plates ordered to, and conforming to, Type 2 may be marked Type 1 as well.

11. Keywords

11.1 alloy steel; alloy steel plate; creep resistance; elevated temperature; pressure containing parts; pressure vessel steels; steel plates; steel plates for pressure vessels

648

TABLE 1 Chemical Requirements

Note 1—Where "..." appears, there is no requirement.

		Composition, % Grade and UNS Number							
Element	Grade 2 S50460	Grade 12 K11757	Grade 11 K11789	Grade 22 K21590	Grade 21 K31545	Grade 5 S50200	Grade 9 K90941	Grade 91 Type 1 K90901	Grade 91 Type 2 K90901
Carbon:									
Heat analysis	0.05-0.21	0.05-0.17	0.05-0.17	0.05-0.15 ^A	0.05-0.15 ^A	0.15 max	0.15 max	0.08-0.12	0.08-0.12
Product analysis	0.04-0.21	0.04-0.17	0.04-0.17	0.04–0.15 ^A	0.04-0.15 ^A	0.15 max	0.15 max	0.06-0.15	0.06-0.15
Manganese:									
Heat analysis	0.55-0.80	0.40-0.65	0.40-0.65	0.30-0.60	0.30-0.60	0.30-0.60	0.30-0.60	0.30-0.60	0.30-0.50
Product analysis	0.50-0.88	0.35-0.73	0.35-0.73	0.25-0.66	0.25-0.66	0.25-0.66	0.25-0.66	0.25-0.66	0.30-0.50
Phosphorus, max:									
Heat analysis	0.025	0.025	0.025	0.025	0.025	0.025	0.025	0.020	0.020
Product analysis	0.025	0.025	0.025	0.025	0.025	0.025	0.025	0.025	0.020
Sulfur, max:									
Heat analysis	0.025	0.025	0.025	0.025	0.025	0.025	0.025	0.010	0.005
Product analysis	0.025	0.025	0.025	0.025	0.025	0.025	0.025	0.012	0.005
Silicon:									
Heat analysis	0.15-0.40	0.15-0.40	0.50-0.80	0.50 max	0.50 max	0.50 max	1.00 max	0.20-0.50	0.20-0.40
Product analysis	0.13-0.45	0.13-0.45	0.44-0.86	0.50 max	0.50 max	0.55 max	1.05 max	0.18-0.56	0.20-0.40
Chromium:									
Heat analysis	0.50-0.80	0.80-1.15	1.00-1.50	2.00-2.50	2.75-3.25	4.00-6.00	8.00-10.00	8.00-9.50	8.0-9.50
Product analysis	0.46-0.85	0.74–1.21	0.94-1.56	1.88–2.62	2.63–3.37	3.90–6.10	7.90–10.10	7.90–9.60	8.0-9.50
Molybdenum:									
Heat analysis	0.45-0.60	0.45-0.60	0.45-0.65	0.90-1.10	0.90-1.10	0.45-0.65	0.90-1.10	0.85-1.05	0.85-1.05
Product analysis	0.40-0.65	0.40-0.65	0.40-0.70	0.85-1.15	0.85–1.15	0.40-0.70	0.85-1.15	0.80-1.10	0.80-1.05
Nickel, max:	0.10 0.00	0.10 0.00	0.10 0.70	0.000	0.00 11.10	0.10 0.70	0.00 1.10	0.000	0.00 1.00
Heat analysis								0.40	0.20
Product analysis		•••	•••	***		•••		0.43	0.20
Vanadium:			•••	•••		•••		0.40	0.20
Heat analysis							0.04 max	0.18-0.25	0.18-0.25
Product analysis	•••	•••	•••	•••			0.05 max	0.16-0.27	0.16-0.27
Columbium (niobium): ^B			•••	•••			0.05 max	0.10-0.27	0.10-0.27
Heat analysis								0.06-0.10	0.06-0.10
Product analysis			•••	•••				0.05-0.10	0.05-0.10
Boron, max ^C			•••						0.05-0.11
*	•••								0.001
Nitrogen:								0.000 0.070	0.005.0.070
Heat analysis	•••	***	•••	•••	***	***	•••	0.030-0.070	0.035-0.070
Product analysis	•••	•••	•••	•••		•••		0.025-0.080	0.035-0.070
Nitrogen/aluminum									≥4.0
Aluminum, max ^C								0.02	0.020
Titanium, max ^C								0.01	0.01
Zirconium, max ^C				•••				0.01	0.01
Tungsten, max ^C	•••		•••	•••		•••			0.05
Copper, max ^C	•••		•••	•••		•••			0.10
Antimony, max ^C			•••	•••		•••			0.003
Arsenic, max ^C			•••	•••		•••			0.010
Tin, max ^C	•••								0.010

^A The carbon content for plates over 5 in. [125 mm] in thickness is 0.17 max on product analysis.

^B Columbium and niobium are interchangeable names for the same element and both names are acceptable for use in A01 specifications.

^C Applies to both heat and product analysis.

TABLE 2 Tensile Requirements for Class 1 Plates

	Grades 2 and 12	Grade 11	Grades 22, 21, 5, 9
Tensile strength, ksi [MPa]	55 to 80 [380 to 550]	60 to 85 [415 to 585]	60 to 85 [415 to 585]
Yield strength, min, ksi [MPa]	33 [230]	35 [240]	30 [205]
Elongation in 8 in. [200 mm], min, % ^A	18	19	
Elongation in 2 in. [50 mm], min, % ^A	22	22	18
Reduction of area, min, %			45 ⁸ 40 ^C

^A See Specification A20/A20M, elongation adjustments.

TABLE 3 Tensile Requirements for Class 2 Plates^A

	Grade 2	Grade 11	Grade 12	Grades 22, 21, 5, 9	Grade 91
Tensile strength, ksi [MPa]	70 to 90	75 to 100	65 to 85	75 to 100	85 to 110
	[485 to 620]	[515 to 690]	[450 to 585]	[515 to 690]	[585 to 760]
Yield strength, min, ksi [MPa]/(0.2 % offset)	45 [310]	45 [310]	40 [275]	45 [310]	60 [415]
Elongation in 8 in. [200 mm], min, % ^B	18	18	19		
Elongation in 2 in. [50 mm], min, % ^B	22	22	22	18	18
Reduction of area, min, %	•••			45 ^C	
				40 ^D	

^A Not applicable to annealed material.

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall not apply unless specified in the order. A list of standardized supplementary requirements for use at the option of the purchaser is included in Specification A20/A20M. Several of those considered suitable for use with this specification are listed below by title. Other tests may be performed by agreement between the supplier and the purchaser.

- S1. Vacuum Treatment,
- S2. Product Analysis,
- S3. Simulated Post-Weld Heat Treatment of Mechanical Test Coupons,
 - S4.1 Additional Tension Test,
 - S5. Charpy V-Notch Impact Test,
- S6. Drop Weight Test (for Material 0.625 in. [16 mm] and over in Thickness),
 - S7. High-Temperature Tension Test,
- S8. Ultrasonic Examination in accordance with Specification A435/A435M,
 - S9. Magnetic Particle Examination,
- S11. Ultrasonic Examination in accordance with Specification A577/A577M,
- S12. Ultrasonic Examination in accordance with Specification A578/A578M, and
 - S17. Vacuum Carbon-Deoxidized Steel.

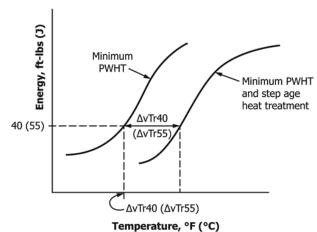


FIG. S1.1 Transition Temperature Curves Before and After Step Cool Heat Treatment

^B Measured on round test specimens.

^C Measured on flat specimen.

^B See Specification A20/A20M, elongation adjustments.

^C Measured on round test specimens.

^D Measured on flat specimen.

ADDITIONAL SUPPLEMENTARY REQUIREMENTS

In addition, the following supplementary requirements are suitable for this application. S62 and S63 are applicable for Grades 22 and 21 only.

S53. Alternative Location for Mechanical Testing

When specified by the purchaser, the axis of the tensile and impact test specimens shall come from the mid-thickness of each plate tested, in lieu of midway between the center thickness and the top or bottom surface of the plate.

S60. Restricted Carbon

S60.1 The maximum carbon content of Grade 5 shall be 0.10 %.

S62. Temper Embrittlement Factor

S62.1 The composition of the steel, based on heat analysis, shall be restricted in accordance with the following equations:

$$J = \left(Si + Mn\right) \times \left(P + Sn\right) \times 10^4 \leq 150 \quad \left(Si, \, Mn, \, P \text{ and } Sn \text{ in wt \%}\right)$$

 $Cu \le 0.20\%$

 $Ni \le 0.30\%$

- S62.1.1 Lower values of J, Cu, and Ni can be specified by agreement between purchaser and the supplier.
- S62.1.2 When so specified by the purchaser, the maximum value of J shall not exceed 100.
 - S62.1.3 The values of J shall be reported.
- S62.1.4 If the plates are repaired by welding, the composition of the weld deposit shall be restricted in accordance with the following equations:

$$X = \left(10P + 5\,Sb + 4\,Sn + As\right)/100 \le 15 \quad \left(P, \, Sb, \, Sn \text{ and } As \text{ in ppm}\right)$$

$$Cu \le 0.20\%$$

 $Ni \le 0.30\%$

S62.1.5 The values of X shall be reported.

S63. Impact Properties After Step Cooling

- S63.1 The Charpy V-notch impact properties shall be determined as follows:
- S63.1.1 A sufficient amount of Charpy V-notch test specimens shall be taken from the same location from a plate from each heat of steel to construct two transition temperature curves.

S63.1.2 The test specimens for one transition temperature curve shall be given the minimum post weld heat treatment (PWHT) cycle specified by the purchaser.

S63.2 The test specimens for the other transition temperature curve shall be given the PWHT cycle specified in S63.1.2 plus the following step cooling heat treatment:

Hold at $1100^{\circ}F$ (593°C) for 1 h, then cool at $10^{\circ}F$ (5.6°C)/h to $1000^{\circ}F$ (538°C).

Hold at $1000^{\circ}F$ (538°C) for 15 h, then cool at $10^{\circ}F$ (5.6°C)/h to 975°F (524°C).

Hold at 975°F (524°C) for 24 h, then cool at 10°F (5.6°C)/h to 925°F (496°C).

Hold at $925^{\circ}F$ ($496^{\circ}C$) for 60 h, then cool at $5^{\circ}F$ ($2.8^{\circ}C$)/h to $875^{\circ}F$ ($468^{\circ}C$).

Hold at $875^{\circ}F$ (468°C) for 100 h, then cool at $50^{\circ}F$ (27.8°C)/h to $600^{\circ}F$ (315°C).

Cool in still air.

S63.3 Test the Charpy V-notch test specimens in accordance with Test Methods and Definitions A370 to determine the 40 ft-lbs (55 J) transition temperature from each transition temperature curve using a set of three test specimens at each test temperature. The test temperatures shall include tests on the upper and lower shelves and a minimum of four intermediate temperatures.

S63.4 The following requirements shall be met.

 $vTr40 + 2.5\Delta vTr40 \le 50^{\circ}F$

 $vTr55 + 2.5\Delta vTr55 \le 10^{\circ}C$

where:

vTr40 (vTr55)

= the 40 ft-lbs (55 J) transition temperature of the material subjected to the minimum PWHT specified by the purchaser.

 $\Delta v Tr 40 (\Delta v Tr 55) =$

the shift of the 40 ft-lbs (55 J) transition temperature the of the step cooled material. (The 40 ft-lbs (55 J) transition temperature the of the step cooled material minus that of the material subjected to the minimum PWHT only).

S63.5 The 40 ft-lbs (55 J) transition temperatures for the two material conditions shall be reported.

SPECIFICATION FOR FERRITIC DUCTILE IRON PRESSURE-RETAINING CASTINGS FOR USE AT ELEVATED TEMPERATURES



SA-395/SA-395M



(Identical with ASTM Specification A395/A395M-99(2018).)

SPECIFICATION FOR FERRITIC DUCTILE IRON PRESSURE-RETAINING CASTINGS FOR USE AT ELEVATED TEMPERATURES



SA-395/SA-395M



[Identical with ASTM Specification A 395/A 395M-99(2018).]

1. Scope

- **1.1** This specification covers ductile iron castings for pressure-retaining parts for use at elevated temperatures. Castings of all grades are suitable for use up to 450°F. For temperatures above 450°F and up to 650°F, only Grade 60–40–18 castings are suitable (Note 1).
- **1.2** Valves, flanges, pipe fittings, pumps, and other piping components are generally manufactured in advance and supplied from stock by the manufacturer, jobber, or dealer.
- **1.3** For supplemental casting requirements, Specification A 834 may be utilized.
- 1.4 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in nonconformance to the specification.

NOTE 1 — For service other than as specified in this section, reference should be made to Specification A 536 for Ductile Iron Castings.

2. Referenced Documents

- **2.1** ASTM Standards:
- A 247 Test Method for Evaluating the Microstructure of Graphite in Iron Castings
- A 370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A 536 Specification for Ductile Iron Castings
- A 732/A 732M Specification for Castings, Investment, Carbon and Low Alloy Steel for General Application,

- and Cobalt Alloy for High Strength at Elevated Temperatures
- A 834 Specification for Common Requirements for Iron Castings for General Industrial Use
- E 8 Test Methods for Tension Testing of Metallic Materials
- E 10 Test Method for Brinell Hardness of Metallic Materials
- E 186 Reference Radiographs for Heavy-Walled (2 to $4\frac{1}{2}$ in. [51 to 114 mm]) Steel Castings
- E 280 Reference Radiographs for Heavy-Walled ($4\frac{1}{2}$ to 12 in. [114 to 305 mm]) Steel Castings
- E 446 Reference Radiographs for Steel Castings up to 2 in. [51 mm] in Thickness
- E 689 Reference Radiographs for Ductile Iron Castings
- E 1806 Practice for Sampling Steel and Iron for Determination of Chemical Composition
- F 1476 Specification for Performance of Gasketed Mechanical Couplings for Use in Piping Applications
- F 1548 Specification for the Performance of Fittings for Use with Gasketed Mechanical Couplings used in Piping Applications
- **2.2** Manufacturer's Standardization Society of the Valve and Fittings Industry Standard:
- SP 25 Standard Marking Systems for Valves, Flanges, Pipe Fittings, and Unions

3. Classification

3.1 Castings ordered to this specification are classified by grades based on mechanical property requirements, as listed in Table 1. See note following Table 1.

4. Ordering Information

4.1 Orders for material under this specification shall include the following applicable information:

- **4.1.1** Drawing, catalog number, or part identifications,
- **4.1.1.1** For grade 65-45-15, drawing indicating critical area(s) of casting (see 7.2.2 and 7.3.2).
 - **4.1.2** Quantity (weight or number of pieces),
 - **4.1.3** ASTM designation and year of issue,
- **4.1.4** Grade (See Table 1), if a Grade is not specified, the manufacturer shall supply grade 60-40-18.
 - **4.1.5** Heat-treating requirements (see 5.2.1),
 - **4.1.6** Pressure test requirements (see 7.4.3),
- **4.1.7** Test samples from castings (see 11.1.1 and 12.1.1),
 - **4.1.8** Test coupons size (see 11.2),
 - **4.1.9** Metallographic option (see 12.1.1),
 - **4.1.10** Place of inspection (see 16.1),
 - **4.1.11** Certification requirements (see 17.1),
 - 4.1.12 Identification marking (see 18.2), and
- **4.1.13** Supplemental Requirements (see 1.4, 7.4.2, S1 and S2).

5. Materials and Manufacture

- **5.1** The melting method and the nodularizing practice shall be optional with the foundry.
- **5.2** Except as provided in 5.2.1, all castings Grade 60-40-18 shall be given a ferritizing heat treatment that produces essentially a ferritic structure that contains no massive carbides.
- **5.2.1** When specified in the purchase order, Grade 60-40-18 castings may be provided in an as-cast condition provided they comply with the requirements of 7.1 and 7.2.1.
- **5.2.2** Castings supplied in accordance with 5.2.1 may be stress relieved by agreement between the manufacturer and purchaser.
- **5.3** Castings Grade 65-45-15 may be provided in ascast condition or heat treated, provided they comply with the requirements of 7.1, 7.2.2, and 7.3.2.

6. Chemical Requirements

6.1 The casting shall conform to the following requirements for chemical composition (Note 2):

Total carbon, min, %	3.00
Silicon, max, %	2.50
Phosphorus, max, %	0.08

6.1.1 The chemical analysis for total carbon shall be made on chilled cast pencil type specimens or from thin

wafers approximately $\frac{1}{32}$ in. [0.8 mm] thick cut from test coupons. Drillings are not reliable because of the probable loss of graphite.

6.1.2 For each reduction of 0.01% below the maximum specified phosphorus content, an increase of 0.08% silicon above the specified maximum will be permitted up to a maximum of 2.75%.

NOTE 2 — Silicon contents above 2.75%, or phosphorus contents above 0.08 % have a tendency to lower the impact resistance of the material. If the carbon content is below 3.00%, excess cementite may form during cooling and if this is not removed during heat treatment, the impact resistance of the material may be lowered.

7. Requirements

7.1 Tensile Properties:

7.1.1 The ductile iron as represented by the test specimens shall conform to the mechanical property requirements in Table 1.

7.2 Hardness:

- **7.2.1** For Grade 60–40–18, the hardness of the castings and test specimens shall be within the limits in Table 1.
- **7.2.2** For Grade 65–45–15, the hardness of test specimen and the critical area(s) of the casting, as identified on the casting drawing, shall be within the limits in Table 1. If the grade 65–45–15 casting drawing does not have critical area(s) of the casting identified, all areas of the casting shall be within the hardness limits in Table 1.

7.3 Microstructure:

- **7.3.1** For Grade 60-40-18, the microstructure of the separately cast test coupon or the casting shall be essentially ferritic and contain no massive carbides, and have a minimum of 90% Type I and Type II Graphite as in Fig. 1 or Plate I of Test Method A 247.
- **7.3.2** For Grade 65-45-15, the microstructure of the critical areas of the casting, as identified on the casting drawing, shall be 45% pearlitic, maximum, contain no massive carbides, and have a minimum 90% Type I and Type II Graphite as in Fig. 1 or Plate I of Test Method A 247.

7.4 Pressure Test Requirements:

- **7.4.1** Each pressure retaining Grade 60-40-18 casting shall be tested after machining to the test pressure specified by the applicable standard of ANSI, ASME Boiler and Pressure Vessel Code, or other pertinent code, and shall show no leaks.
- **7.4.2** Castings Grade 65-45-15 manufactured under this specification shall be capable of passing hydrostatic test(s) compatible with the rating of the finished cast component. Such tests shall be conducted by the casting manufacturer only when Supplementary Requirement S2 is specified.

- **7.4.3** Castings Grade 60-40-18, ordered under this specification not covered by ANSI standards and ASME Pressure Vessel Code, and castings for special service applications, shall be tested to such pressures as may be agreed upon by the manufacturer and the purchaser.
- **7.4.4** For castings Grade 60-40-18, it is realized that the foundry may be unable to perform the hydrostatic test prior to shipment, or that the purchaser may wish to defer testing until additional work or machining has been performed on the casting. Castings ordered in the rough state for final machining by the purchaser may be tested hydrostatically prior to shipment by the manufacturer at pressures to be agreed upon with the purchaser. However, the foundry is responsible for the satisfactory performance of the castings under the final hydrostatic test.

8. Workmanship and Finish

8.1 The surface of the casting shall be examined visually and shall be free from adhering sand, scale, cracks, and hot tears. Any other surface discontinuities shall meet visual acceptance standards specified in the order.

9. Repair

- **9.1** Castings for valves, flanges, pipe fittings, pumps, and other piping components ordered under applicable ANSI standards shall not be repaired by plugging, welding, brazing, or impregnation.
- **9.2** Castings Grade 60-40-18 not covered in 9.1 which leak on hydrostatic tests may be repaired by plugging, provided the following requirements are met:
 - **9.2.1** No welding or brazing is permitted.
- **9.2.2** The diameter of the plug shall not exceed the diameter of a standard 2 in. [ISO R2] pipe plug.
- 9.2.3 The plugs, where practical, shall conform in all dimensions to the standard ISO \(^3\)\seta plugs. In addition, they shall have full thread engagement corresponding to the thickness in the repaired section. Where a tapered plug is impractical because of the excess wall thickness in terms of plug diameter and coincident thread engagement, other types of plugs may be used provided both full engagement and effective sealing against pressure are obtained. Where possible, the ends of the plug should be ground smooth after installation to conform to the inside and outside contours of the wall of the pressure vessel or pressure part.
- **9.2.4** The material from which the plug is manufactured shall conform in all respects to the materials specifications that apply to the pressure vessel or pressure part.
- **9.2.5** The area adjacent to the drilled hole shall be examined by radiography, and shall meet the Level 3 acceptance requirements of Reference Radiographs E 689

- and supporting Reference Radiographs E 446, E 186, or E 280 as applicable and defined in accordance with Reference Radiographs E 689.
- **9.2.6** The thickness of any repaired section in relation to the size of the plug used shall not be less than that given in Table 2.
- **9.2.7** The minimum radius of repaired sections of cylinders or cones in relation to the size of plug used shall not be less than that given in Table 3.
- **9.2.8** A repaired area may consist of a maximum of three plugs with a spacing such that the ligaments between adjacent plugs shall not be less than listed in Table 4. Other defective areas may also be repaired by plugging provided the minimum ligament between plugs in adjacent areas is not less than twice the distance from the nearest plug, the values for which are listed in Table 4.
- **9.3** Surface imperfections in castings Grade 60-40-18 other than valves, flanges, pipe fittings, pumps, and other piping components may be repaired by plugging provided the depth of the plug is not greater than 20% of the thickness of the casting section and the diameter of the plug is not greater than its length. Repair of surface defects may not be done on pressure-containing portions of castings. The plug need not be threaded. The conditions of 9.2.1 and 9.2.4 shall also be satisfied.

10. Sampling

- **10.1** A lot shall consist of one of the following:
- **10.1.1** All the metal from a single heating in a batchtype melting furnace.
- **10.1.2** All the metal poured from two or more batch-type melting furnaces into a single ladle or a single casting.
- **10.1.3** All the metal poured from a continuous melting furnace for a given period of time between changes in charge, processing conditions, or aim-for chemistry, or 8 h, whichever is the shorter period.

11. Test Coupon

- 11.1 The separately cast test coupons poured from the same lot as the castings they represent from which the tension test specimen is machined shall be cast to the size and shape shown in Fig. 2, Fig. 3, or Fig. 4. Cast coupons shall be identified with the castings they represent. Sectioning procedure for removing test specimens from Y-blocks is shown in Fig. 5.
- **11.1.1** Test samples may be removed from castings at locations designated on a drawing or as agreed to by manufacturer and purchaser.

- 11.1.2 Test bars removed from castings shall conform to Fig. 6. The testing diameter shall be $\frac{1}{2}$ in. [12.5 mm] if possible. Smaller diameters shall be utilized if necessary.
- 11.2 The test coupon size shall be as mutually agreed upon between the manufacturer and purchaser. In the absence of agreement, it shall be the option of the manufacturer.
- 11.3 The test coupons shall be cast in molds made of suitable core sand having a minimum wall thickness of $1\frac{1}{2}$ in. [38 mm] for the $\frac{1}{2}$ in. [12.5 mm], 1 in. [25 mm] sizes, and 3 in. [75 mm] for the 3 in. [75 mm] size. The coupons shall be left in the mold until they have changed to a black color (approximately 900°F [480°C] or less). The keel block as shown in Fig. 2 or the modified keel block produced from the mold shown in Fig. 4 may be substituted for the 1 in. [25 mm] block shown in Fig. 3.
- 11.4 When investment castings are made to this specification, the manufacturer may use test specimens cast to size incorporated in the mold with the castings or separately cast to size using the same type of mold and the same thermal conditions that are used to produce the castings. These test specimens shall be made to the dimensions shown in Fig. 1 of Specification A 732/A 732M or Fig. 5 and Fig. 6 of Test Methods and Definitions A 370.
- 11.5 The manufacturer shall cast a sufficient number of test coupons to provide for each ferritizing anneal. The test coupons shall be heat treated with the castings they represent. Sectioning of the test coupons prior to heat treating is not permitted.
- 11.6 The metallographic examination shall be made on a test lug from the test coupon shown in Fig. 7 or from a casting; or from a representative test coupon poured with the casting(s). The test coupon shall represent the metal treated with the nodularizing agent.

12. Number of Tests and Retests

- **12.1** One tension test shall be made from sections cut from the test coupons (Fig. 5) required by Section 11.
- **12.1.1** Unless otherwise stated in the contract or order for castings, a metallographic examination may be substituted for the tension test when separately cast test coupons are used. When the microstructure option is used, a minimum of one tension test is required from each day's melt and for each heat treatment (see 12.2).
- 12.2 If any tension test specimen shows obvious defects, another from the same coupon, or from another coupon/or representing the same metal and the same anneal charge, may be tested. If an apparently sound test specimen fails to conform to this specification, castings may be reannealed, if required, and two retests made. If either retest

fails to conform to this specification, the castings they represent shall be rejected.

13. Tension Test Specimen Preparation

13.1 The standard machined $\frac{1}{2}$ in. [12.5 mm] round tension test specimen with 2 in. [50 mm] gage length as shown in Fig. 6 shall be used except where the $\frac{1}{2}$ in. [12.5 mm] Y-block test coupon is required. In this case, either of the small size specimens, 0.375 or 0.250 in. [9 or 6.5 mm] round as shown in Fig. 6, shall be used.

14. Test Methods

- **14.1** Chemical analysis shall be made in accordance with Test Method E 1806.
- **14.2** The yield strength shall be determined in accordance with Test Methods E 8 using one of the following methods:
 - **14.2.1** The 0.2% off-set method, or
- **14.2.2** Extension under load method where the yield strength may be determined as the stress producing an elongation under load of 0.375%; that is, 0.0075 in. [0.19 mm] in a gage length of 2 in. [50 mm].
- **14.3** The hardness of the ductile iron as represented by the test specimens and castings shall be determined in accordance with Test Method E 10.
- 14.4 The percentage of each graphite type shall be determined by manual counting, semi-automatic, or automatic image analysis methods. The sum of all graphite types shall total to 100%.

15. Records

15.1 Records of the chemical composition, mechanical properties, and metallographic examination, when applicable, shall be systematically made and maintained.

16. Inspection

- **16.1** Unless otherwise specified in the contract or purchase order, the manufacturer shall be responsible for carrying out all the tests and inspection required by this specification.
- 16.2 The inspector representing the purchaser shall have entry at all time, while work on the contract of the purchaser is being performed, to all parts of the manufacturer's works which concern the manufacturer of the material ordered. The manufacturer shall afford the inspector all

reasonable facilities to satisfy him that the material is being furnished in accordance with these specifications. Unless otherwise specified, all tests and inspection shall be made at the place of manufacture or by an approved independent laboratory prior to shipment, and shall be so conducted as not to interfere unnecessarily with the operation of the works.

17. Certification

17.1 When agreed upon in writing by the purchaser and the supplier, a certification shall be made on the basis of acceptance of the material. This shall consist of a copy of the manufacturer's test report or a statement by the supplier accompanied by a copy of the test results, that the material has been sampled, tested, and inspected in accordance with the provisions of this specification. Each certification so furnished shall be signed by an authorized agent of the supplier or manufacturer.


18. Product Marking

- **18.1** Castings for valves, flanges, pipe fittings, and unions shall be marked for material identification in accordance with the Standard Marking System for Valves, Flanges, Pipe Fittings, and Unions, SP-25. Castings for gasketed mechanical couplings and fittings may be marked in accordance with Specification F 1476 or F 1548 respectively.
- **18.2** Castings, other than valves, flanges, pipe fittings, and unions, shall be identified subject to agreement by the manufacturer and the purchaser.
- **18.3** Marking shall be in such a position as not to injure the usefulness of the castings.

19. Keywords


19.1 casting; ductile iron; mechanical properties; pressure-retaining; pressure test; tensile strength; tension testing; yield strength

FIG. 1 SUGGESTED CLASSIFICATION OF GRAPHITE FORM IN DUCTILE CAST IRON

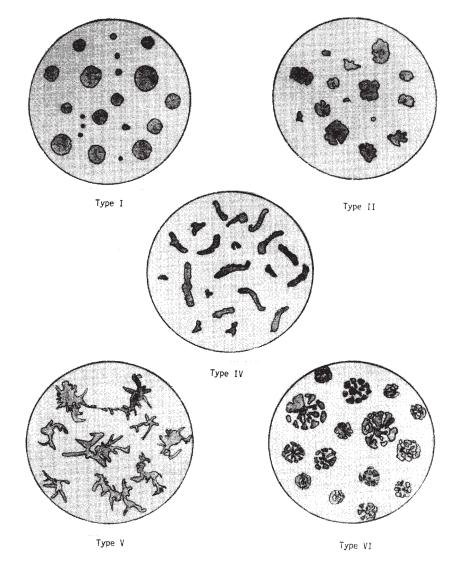


 $\label{thm:note-model} \mbox{Note-Graphite types are identical with Plate 1 of Test Method A 247 and are so identified.}$

FIG. 2 KEEL BLOCK FOR TEST COUPONS



NOTE: The length of the keel block shall be 6 in. [152 mm]

FIG. 3 Y-BLOCKS FOR TEST COUPONS



For Castings of For Castings of For Castings of Thickness Thickness of Thickness Less $\frac{1}{2}$ in. [13 mm] $1 \frac{1}{2}$ in. Than $\frac{1}{2}$ in. to $1\frac{1}{2}$ in. [38 mm] [13 mm] [38 mm] and Over Dimensions in. [mm] in. [mm] in. [mm] ½ [13] Α 1 [25] 3 [75] В 1 1 [40] 2½ [55] 5 [125] С 2 [50] 3 [75] 4 [100] D 4 [100] 6 [150] 8 [200] Ε 7 [175] 7 [175] 7 [175] approx. approx. approx.

FIG. 4 MOLD FOR MODIFIED KEEL BLOCK



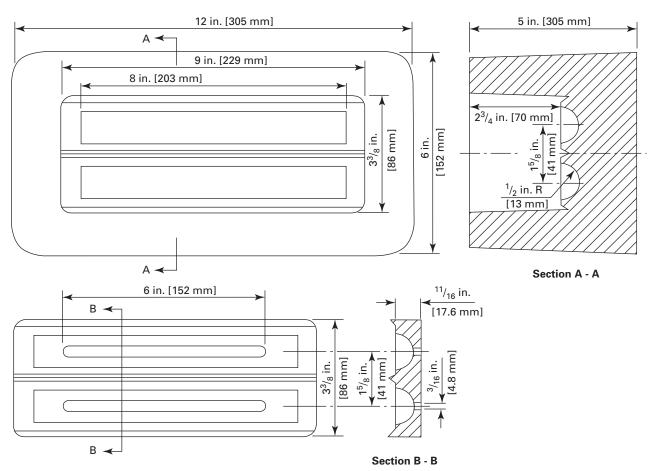



FIG. 5 SECTIONING PROCEDURE FOR Y-BLOCKS



(a) $^{1}\!/_{\!2}$ in. [13 mm] Y-block — two blanks for 0.252 in. [6.40 mm] diameter tension test specimens.




(b) 1 in. [25 mm] Y-block — two blanks for 0.50 in. [12.5 mm] diameter tension test specimens.



(c) 3 in. [75 mm] Y-block — two blanks for 0.50 in. [12.5 mm] diameter tension test specimens.

FIG. 6 STANDARD $\frac{1}{2}$ IN. [12.5 MM] ROUND TENSION TEST SPECIMEN WITH 2 IN. [50.0 MM] GAGE LENGTH AND EXAMPLES OF SMALL SIZE SPECIMENS PROPORTIONAL TO THE STANDARD SPECIMEN




_	Standard Specimen, in. [mm]	Small Size Specimens Propo	ortionate to Standard, in. [mm]
Dimensions	½ [12.5] Round	0.350 [9] Round	0.250 [6.5] Round
G—Gage length D—Diameter (Note 1) R—Radius of fillet A—Length of reduced section (Note 2)	2.000 \pm 0.005 [50 \pm 0.13] 0.500 \pm 0.010 [12.5 \pm 0.25] $\frac{3}{6}$ [9.5], min $\frac{2^{1}}{4}$ [58], min	1.4 \pm 0.005 [35 \pm 0.13] 0.350 \pm 0.007 [9 \pm 0.18] $\frac{3}{8}$ [9.5], min $\frac{13}{4}$ [45], min	1.0 \pm 0.005 [25 \pm 0.13] 0.250 \pm 0.005 [6.5 \pm 0.13] $\frac{1}{4}$ [6.5], min 1 $\frac{1}{4}$ [32], min

NOTES:

- (1) The reduced section may have a gradual taper from the ends toward the center, with the ends not more than 0.005 in. [0.13 mm] larger in diameter than the center on the standard specimen, and not more than 0.003 in. [0.076 mm] larger in diameter than the center on the small size specimens.
- (2) If desired, on the small size specimens the length of the reduced section may be increased to accommodate an extensometer. However, reference marks for measurement of elongation should nevertheless be spaced at the indicated gage length.
- (3) The gage length and fillets shall be as shown, but the ends may be of any form to fit the holders of the testing machine in such a way that the load shall be axial. If the ends are to be held in grips it is desirable, to make the length of the grip section great enough to allow the specimen to extend into the grips a distance equal to two thirds or more of the length of the grips.

FIG. 7 TEST COUPONS FOR MICROSCOPICAL EXAMINATION OF DUCTILE IRON

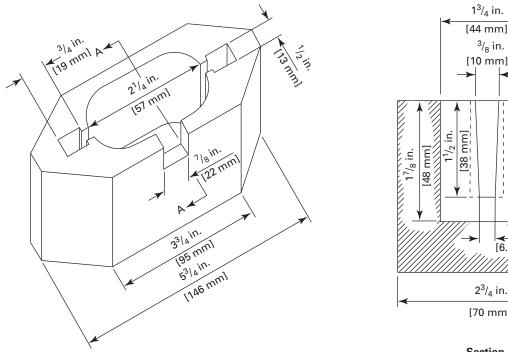

Section A-A

TABLE 1
MECHANICAL PROPERTY REQUIREMENTS

Property	Grade 60-40-18	Grade 65-45-15
Tensile Strength Minimum, psi [MPa]	60 000 [415]	65 000 [450]
Yield Strength Minimum, psi [MPa]	40 000 [275]	45 000 [310]
Elongation in 2 in. Minimum, %	18	15
Hardness HB, 3000 kgf Load	143–187	156–201

NOTE: If a grade is not specified in the ordering information, grade 60-40-18 will be supplied.

TABLE 2
MINIMUM THICKNESS OF REPAIRED SECTIONS

Iron Pipe Size Plug, in.	Minimum Thickness Repaired Section, in. [mm]
1/8	¹¹ ⁄ ₃₂ [8]
1/8 1/4 3/8 1/2 3/4	⁷ ∕ ₁₆ [10]
³ / ₈	1/2 [13]
1/2	²¹ / ₃₂ [17]
3/4	³ / ₄ [19]
1	¹³ ⁄ ₁₆ [21]
11/4	⁷ ⁄ ₈ [23]
1½	¹⁵ ⁄ ₁₆ [24]
2	1 [26]

TABLE 3
MINIMUM RADIUS OF REPAIRED SECTIONS

Iron Pipe Size Plug, in.	Minimum Radius of Cylinder or Cone, in. [mm]
i iug, iii.	or cone, in: Ellins
1/8	% ₁₆ [15]
1/8 1/4 3/8 1/2 3/4	¹¹⁄ ₁₆ [18]
³ / ₈	1½ ₁₆ [28]
1/2	11/4 [32]
3/4	2 [52]
1	$2\frac{1}{2}$ [64]
$1\frac{1}{4}$	4 [104]
1½	5½ [136]
2	8½ [208]

TABLE 4
MINIMUM LIGAMENT BETWEEN PLUGS^{A,B}

Nominal Plug	Minimun	Minimum Ligament Between Plugs, in. [mm]				
Diameter, in.	1/8, 1/4, 3/8	1/2, 1/4	1, 11/4	1½, 2		
1/8, 1/4, 3/8 1/2, 3/4 1, 11/4 1 1/2, 2	2 ⁵ / ₈ [67] 4 ¹ / ₈ [105] 6 ⁵ / ₈ [169] 9 ¹ / ₂ [242]	4½ [105] 4½ [105] 6½ [169] 9½ [242]	6 ⁵ / ₈ [169] 6 ⁵ / ₈ [169] 6 ⁵ / ₈ [169] 9 ¹ / ₂ [242]	9½ [242] 9½ [242] 9½ [242] 9½ [242]		

^A Based on efficiency of 80%.

B Example: Assume three plugs are required for repair, one $\frac{1}{8}$ in., one $\frac{3}{8}$ in., and one $\frac{11}{2}$ in. The minimum distance permitted is as follows:

Ligament distance between $\frac{1}{8}$ and $\frac{3}{8}$ in. plugs is $2\frac{5}{8}$ in. [67 mm] Ligament distance between $\frac{1}{8}$ and $1\frac{1}{2}$ in. plugs is $9\frac{1}{2}$ in. [242 mm]

Ligament distance between $^3\!\!/_8$ and 1 $^1\!\!/_2$ in. plugs is $9^1\!\!/_2$ in. [242 mm]

SUPPLEMENTARY REQUIREMENTS

The following supplementary requirement shall not apply unless specified in the purchase order.

S1. Casting

S1.1 For Castings Grade 60-40-18, a microstructure test lug is to be cast attached to the casting at the location designated on the casting drawing. The microstructure of the test lug shall be essentially ferritic and contain no massive carbides.

S2. Pressure Test, Casting Grade 65-45-15

S2.1 A hydrostatic test at a pressure agreed upon by the manufacturer and the purchaser shall be applied by the manufacturer.



SPECIFICATION FOR STEEL WIRE, CHROMIUM-SILICON ALLOY



SA-401/SA-401M



(23)

(Identical with ASTM Specification A401/A401M-18.)

Specification for Steel Wire, Chromium-Silicon Alloy

1. Scope

- 1.1 This specification covers round and shaped chromium-silicon alloy steel spring wire having properties and quality intended for the manufacture of springs resistant to set when used at moderately elevated temperatures. This product is not meant to be used for non-static applications involving moderate fatigue stresses (see Specification A1000/A1000M) or high cycle fatigue applications (see Specification A877/A877M). This wire shall be provided either in the annealed and cold-drawn or quench and tempered condition as specified by the purchaser.
- 1.2 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.2.1 Within the text, the inch-pound units are shown in brackets.
- 1.3 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A510/A510M Specification for General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel, and

- A700 Guide for Packaging, Marking, and Loading Methods for Steel Products for Shipment
- A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- A877/A877M Specification for Steel Wire, Chromium-Silicon Alloys, Chrome-Silicon-Vanadium Alloy Valve Spring Quality
- A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys
- A1000/A1000M Specification for Steel Wire, Carbon and Alloy Specialty Spring Quality
- E8/E8M Test Methods for Tension Testing of Metallic Materials
- E29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications

3. Terminology

- 3.1 Definitions:
- 3.1.1 For definitions of terms used in this specification, see Terminology A941.
 - 3.2 Definitions of Terms Specific to This Standard:
- 3.2.1 *equivalent round diameter, n*—diameter of a round wire having equivalent cross sectional area to a given shaped wire.
 - 3.2.2 round wire, n—wire having a circular cross section.
- 3.2.3 *shape factor*, *n*—this value is used to obtain cross sectional area for shaped wires when multiplied by measured width and thickness.
- 3.2.4 *shaped wire*, *n*—wire having a non-circular cross section.

4. Ordering Information

- 4.1 It shall be the responsibility of the purchaser to specify all requirements that are necessary for material under this specification. Such requirements may include, but are not limited to, the following:
 - 4.1.1 Quantity (mass),
 - 4.1.2 Name of material (chromium-silicon alloy steel wire),
 - 4.1.3 Dimensions (Table 1 and Section 9),
 - 4.1.4 Condition (Section 7), and
 - 4.1.5 ASTM designation and year of issue.
- 4.2 The purchaser shall have the option to specify additional requirements, including but not limited to:

TABLE 1 Tensile Requirements^A

	SI Units					
Diameter, ^B mm	MPa, min	MPa, max	Reduction of Area, min, % ^{C,D}			
	0000	2000				
0.80	2080	2260				
0.90	2070	2250				
1.00	2060	2240				
1.10	2040	2220				
1.20	2020	2200				
1.40	2000	2180				
1.60	1980	2160				
1.80	1960	2140				
2.00	1940	2120				
2.20	1920	2100				
2.50	1900	2080	45			
2.80	1880	2060	45			
3.00	1860	2040	45			
3.50	1840	2020	40			
4.00	1820	2000	40			
4.50	1800	1980	40			
5.00	1780	1960	40			
5.50	1760	1940	40			
6.00	1740	1920	40			
6.50	1720	1900	40			
7.00	1700	1880	40			
8.00	1680	1860	40			
9.00	1660	1840	40			
10.00	1640	1820	40			
11.00	1620	1800	35			
12.0	1600	1780	35			
13.0	1580	1760	30			
14.0	1570	1750	30			
15.0	1560	1740	30			
16.0	1550	1730	30			
17.0	1540	1720	30			
18.0	1530	1710	30			

Inch-Pound I	Jnits
--------------	--------------

Diameter, in.	ksi, min	ksi, max	Reduction of Area, min, % ^{C,E}
0.032	300	325	
0.041	298	323	
0.054	292	317	
0.062	290	315	
0.080	285	310	
0.092	280	305	45
0.120	275	300	45
0.135	270	295	40
0.162	265	290	40
0.177	260	285	40
0.192	260	283	40
0.219	255	278	40
0.250	250	275	40
0.312	245	270	40
0.375	240	265	40
0.438	235	260	35
0.500	230	255	35
0.562	228	253	30
0.625	226	251	30
0.687	224	249	30

 $^{^{}A}$ Tensile strength values for intermediate diameters shall be interpolated. $^{\mathcal{B}}$ Preferred sizes.

- 4.2.1 Requirements for certifications, heat analysis or test reports (6.2 and Section 14),
- 4.2.2 Special packing, marking, and loading requirements (Section 15), and

4.2.3 Other special requirements, if any.

Note 1—A typical ordering description is as follows: 20 000-kg, quench and tempered chromium-silicon alloy steel wire, size 6.00 mm in 150 kg coils to ASTM A401/A401M dated _____, or for inch-pound units, 40 000-lb quench and tempered chromium-silicon alloy steel spring wire, size 0.250 in. in 350-lb coils to ASTM A401/A401M dated _____.

5. Materials and Manufacture

- 5.1 The steel may be made by any commercially accepted steel making process. The steel may be either ingot cast or strand cast.
- 5.2 The finished wire shall be free from detrimental pipe and undue segregation.

6. Chemical Composition

- 6.1 The steel shall conform to the requirements of Grade 9254 for chemical composition specified in Table 2.
- 6.2 *Heat Analysis*—Each heat of steel shall be analyzed to determine the percentage of elements prescribed in Table 2. This analysis shall be made from a test specimen preferably taken during the pouring of the heat. When requested, this shall be reported to the purchaser and shall conform to the requirements of Table 2.
- 6.3 *Product Analysis*—An analysis may be made by the purchaser from finished wire representing each heat of steel. The chemical composition thus determined, as to elements required or restricted, shall conform to the product analysis requirements in Table 4 of Specification A510/A510M.
- 6.4 For referee purposes, Test Methods, Practices, and Terminology A751 shall be used.

7. Mechanical Properties

- 7.1 Annealed and Cold Drawn—When purchased in the annealed and cold-drawn condition, the wire shall have been given a sufficient amount of cold working to meet the purchaser's coiling requirements and shall be in a suitable condition to respond properly to heat treatment. In special cases the hardness or tensile strength, if desired, shall be stated in the purchase order.
- 7.2 Quench and Tempered—When purchased in the quench and tempered condition, the tensile strength and minimum percent reduction of area shall conform to the requirements prescribed in Table 1. Tensile strength of shaped wires shall conform to this table based on the conversion to equivalent round dimensions.
- 7.2.1 *Number of Tests*—One test specimen shall be taken for each ten coils, or fraction thereof, in a lot. Each heat in a given lot shall be tested.

TABLE 2 Chemical Requirements

UNS	Designation (Grade No. 9254					
Ranges and Limits, %							
Carbon	Manga- nese	Phosphorus,	Sulfur, max	Silicon	Chro- mium		
0.51-0.59	0.60-0.80	0.035	0.040	1.20–1.60	0.60-0.80		

 $^{^{\}it C}$ The reduction of area test is not applicable to wire under 2.34 mm [0.092 in.] in diameter. For intermediate wire diameters, the reduction of area requirement shall be that of the next larger wire.

D"..." Indicates no minimum requirement.

- 7.2.2 Location of Tests—It shall be permissible to take test specimens from either end of the coil.
- 7.2.3 Test Method—The tension test shall be made in accordance with Test Methods and Definitions A370. For shaped wires, cross sectional area shall be calculated either by using the procedure in Test Methods E8/E8M for uniform but nonsymmetrical cross-sections, or by measuring width and thickness and multiplying by a shape factor. Reduction of area for shaped wires shall be calculated by using this shape factor. Measure the maximum and minimum dimension on the necked down section and multiply by the shape factor to estimate the cross sectional area for use in the standard reduction of area calculation.
- 7.2.4 Upon agreement between purchaser and supplier, the shape factor for the cross section design provided by the wire mill shall be permissible to be adopted for use. In other situations, if the shape factor is not available from the wire mill, the shape factor shall be calculated by measuring the cross sectional area in accordance with Test Methods E8/E8M and dividing by the width and thickness.

7.3 Wrap Test:

- 7.3.1 Quench and tempered or cold drawn wire 4.00 mm [0.157 in.] and smaller in diameter shall wind on itself as an arbor without breakage. Larger diameter wire up to and including 8.00 mm [0.315 in.] in diameter shall wrap without breakage on a mandrel twice the wire diameter. The wrap test is not applicable to wire over 8.00 mm [0.315 in.] in diameter or to shaped and flat rolled wires.
- 7.3.2 *Number of Tests*—One test specimen shall be taken for each 10 coils, or fraction thereof, in a lot. Each heat in a given lot shall be tested.
- 7.3.3 Location of Test—It shall be permissible to take test specimens from either end of the coil.
- 7.3.4 *Test Method*—The wrap test shall be made in accordance with Test Methods and Definitions A370.

8. Metallurgical Requirements

8.1 Surface Condition:

- 8.1.1 On the whole, the surface of the wire as received shall be free of rust and excessive scale. Based upon examination of end specimens, no serious die marks, scratches, or other continuous surface imperfections shall be present. Based upon examination of etched-end specimen, seams shall not exceed 3.5 % of the wire diameter, or 0.25 mm [0.010 in.], whichever is the smaller as measured on a transverse section.
- 8.1.2 *Number of Tests*—For the purpose of examination of etched-end specimens, one test specimen shall be taken for each 10 coils, or fraction thereof, in a lot. Each cast or heat in a given lot shall be tested.
- 8.1.3 *Location of Test*—Test specimens shall be taken from either or both ends of the coil.
- 8.1.4 Test Method—The surface shall be examined after etching in a solution of equal parts of hydrochloric acid and water that has been heated to approximately 80°C for up to two minutes in order to remove the oxide scale layer from the wire surface. Test ends shall be examined using 10× magnification. Any specimens showing the presence of a questionable surface imperfection shall have a transverse section taken from the

unetched area, properly mounted and polished and examined to measure the depth of the surface imperfection.

8.2 Decarburization:

- 8.2.1 The depth of complete decarburization (free ferrite) shall not exceed 0.75 % of the equivalent round wire diameter. The total affected depth (free ferrite plus partial decarburization) shall not exceed 2.0 % of the equivalent round wire diameter on all sizes of wire.
- 8.2.2 *Test Method*—Decarburization shall be determined by etching a suitably polished transverse section of wire with nital. The entire periphery to be examined should be in a single plane with no edge rounding.
- 8.2.3 The entire periphery shall be examined at a magnification of no less than 100× for depth of free ferrite and total affected depth. Smaller wire sizes may require higher magnification. Measure the worst area present excluding decarburization associated with any surface imperfections. Complete decarburization exists when only free ferrite is present. Partial decarburization exists when ferrite is found mixed with pearlite or tempered martensite. Structures of 100 % tempered martensite shall be defined as not decarburized.
- 8.2.4 Decarburization shall be checked on annealed wire by giving a wire sample an austenitize, oil quench and temper heat treatment. A flat shall be ground on the test sample prior to heat treatment. The flat shall have a minimum width equal to one half of the wire diameter. Any decarburization visible on this ground section shall necessitate a retest with new samples. If no decarburization is visible on the ground flat, evaluate the complete wire section in accordance with 8.2.3.

9. Dimensions and Permissible Variations

9.1 The permissible variations in the diameter of the wire shall be as specified in Table 3. Any definition of shaped tolerances shall be agreed upon by the producer and the purchaser.

10. Workmanship, Finish, and Appearance

10.1 Annealed and Cold Drawn—The wire shall not be kinked or improperly cast. To test for cast, a few convolutions of wire shall be cut loose from the coil and placed on a flat

TABLE 3 Permissible Variations in Wire Diameter^A

TABLE OF CHINGSIDIC VARIATIONS IN WITE DIAMETER							
SI	Units						
Diameter	Permissible Variations, ±mm	Permissible Out- of-Round					
0.80 to 2.00, incl Over 2.00 to 11.0, incl Over 11.00	0.03 0.05 0.07	0.03 0.05 0.07					
Inch-Po	Inch-Pound Units						
Diameter	Permissible Variations, ±in.	Permissible Out- of-Round					
0.032 to 0.075, incl Over 0.075 to 0.438, incl Over 0.438	0.001 0.002 0.003	0.001 0.002 0.003					

^A For purposes of determining conformance with this specification, all specified limits are absolute as defined in Practice E29.

surface. The wire shall lie substantially flat on itself and not spring up nor show a wavy condition.

- 10.2 *Quench and Tempered*—The wire shall be uniform in quality and temper and shall not be wavy or crooked.
- 10.3 Each coil shall be one continuous length of wire properly coiled. Welds made prior to cold drawing are permitted. If unmarked welds are unacceptable to the purchaser, special arrangements should be made with the manufacturer at the time of the purchase.

11. Retests

- 11.1 If any tested specimen exhibits an obvious defect or condition of non-conformance that is not representative of the coil from which it was collected, or shows the presence of a weld, it shall be discarded and another specimen substituted.
- 11.2 If any tested specimen exhibits an obvious defect or condition of non-conformance that is representative of a portion of the coil from which it was collected, the manufacturer shall remove from the coil the portion containing the obvious defect or condition of non-conformance before collecting another test specimen from the coil for the purpose of retesting.

12. Inspection

12.1 Unless otherwise specified in the contract or purchase order, the manufacturer is responsible for the performance of all inspection and test requirements specified in this specification. Except as otherwise specified in the contract or purchase order, the manufacturer may use his own or any other suitable facilities for the performance of the inspection and test requirements unless disapproved by the purchaser at the time the order is placed. The purchaser shall have the right to perform any of the inspections and tests set forth in this specification when such inspections and tests are deemed necessary to assure that the material conforms to prescribed requirements.

13. Rejection and Rehearing

- 13.1 Unless otherwise specified, any rejection based on tests made in accordance with these specifications shall be reported to the manufacturer as soon as possible so that an investigation may be initiated.
- 13.2 The material must be adequately protected and correctly identified in order that the manufacturer may make a proper investigation.

14. Certification

- 14.1 When specified in the purchase order or contract, a manufacturer's or supplier's certification shall be furnished to the purchaser that the material was manufactured, sampled, tested, and inspected in accordance with this specification and has been found to meet the requirements. When specified in the purchase order or contract, a report of the test results shall be furnished.
- 14.2 The certification shall include the specification number, year date of issue, and revision letter, if any.

15. Packaging, Marking, and Loading for Shipment

- 15.1 The coil mass, dimensions, and the method of packaging shall be agreed upon between the manufacturer and purchaser.
- 15.2 The size of the wire, purchaser's order number, ASTM specification number, heat number, and name or mark of the manufacturer shall be marked on a tag securely attached to each coil of wire.
- 15.3 Unless otherwise specified in the purchaser's order, packaging, marking, and loading for shipments shall be in accordance with those procedures recommended by Practices A700.

16. Keywords

16.1 annealed chromium-silicon alloy; springs; tempered; wire



SPECIFICATION FOR WROUGHT AUSTENITIC STAINLESS STEEL PIPING FITTINGS



SA-403/SA-403M

(23)

(Identical with ASTM Specification A403/A403M-19a except for the deletion of 5.14 and 5.15, clarified heat treatment requirements in 6.1 and 6.4, and the deletion of requirements for Grades 321 and 321H in Table 5. For welded with filler metal products ordered to Section III, Division 1 of the ASME Boiler and Pressure Vessel Code, Supplementary Requirement S3 is mandatory.)

Specification for Wrought Austenitic Stainless Steel Piping Fittings

1. Scope

- 1.1 This specification covers wrought stainless steel fittings for pressure piping applications.
- 1.2 Several grades of austenitic stainless steel alloys are included in this specification Grades are designated with a prefix, WP or CR, based on the applicable ASME or MSS dimensional and rating standards, respectively.
- 1.3 For each of the WP stainless grades, several classes of fittings are covered, to indicate whether seamless or welded construction was utilized. Class designations are also utilized to indicate the nondestructive test method and extent of nondestructive examination (NDE). Table 1 is a general summary of the fitting classes applicable to all WP grades of stainless steel covered by this specification. There are no classes for the CR grades. Specific requirements are covered elsewhere.
- 1.4 This specification is expressed in both inch-pound units and in SI units. However, unless the order specifies the applicable "M" specification designation (SI units), the material shall be furnished to inch-pound units.
- 1.5 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard
- 1.6 This specification does not apply to cast steel fittings. Austenitic stainless steel castings are covered in Specifications A351/A351M, A743/A743M, and A744/A744M.
- 1.7 This international standard was developed in accordance with internationally recognized principles on standard-

ization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A351/A351M Specification for Castings, Austenitic, for Pressure-Containing Parts
- A743/A743M Specification for Castings, Iron-Chromium, Iron-Chromium-Nickel, Corrosion Resistant, for General Application
- A744/A744M Specification for Castings, Iron-Chromium-Nickel, Corrosion Resistant, for Severe Service
- A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products
- A960/A960M Specification for Common Requirements for Wrought Steel Piping Fittings
- E112 Test Methods for Determining Average Grain Size E165/E165M Practice for Liquid Penetrant Testing for General Industry
- 2.2 ASME Standards:
- ASME B16.9 Factory-Made Wrought Steel Butt-Welding Fittings
- ASME B16.11 Forged Steel Fittings, Socket-Welding and Threaded
- 2.3 MSS Standards:
- MSS SP-25 Standard Marking System for Valves, Fittings, Flanges, and Unions
- MSS SP-43 Standard Practice for Light Weight Stainless Steel Butt-Welding Fittings
- MSS SP-79 Socket-Welding Reducer Inserts

TABLE 1 Fitting Classes for WP Grades

Class	Construction	Nondestructive Examination
S	Seamless	None
W	Welded	Radiography or Ultrasonic
WX	Welded	Radiography
WU	Welded	Ultrasonic

MSS-SP-83 Steel Pipe Unions, Socket-Welding and Threaded

MSS SP-95 Swage(d) Nipples and Bull Plugs

MSS-SP-97 Integrally Reinforced Forged Branch Outlet Fittings—Socket Welding, Threaded and Buttwelding Ends

2.4 ASME Boiler and Pressure Vessel Code:

Section III

Section VIII Division I

Section IX

2.5 AWS Standards:

A 5.4 Specification for Corrosion-Resisting Chromium and Chromium-Nickel Steel Covered Welding Electrodes

A 5.9 Specification for Corrosion-Resisting Chromium and Chromium-Nickel Steel Welding Rods and Bare Electrodes

A 5.11 Specification for Nickel and Nickel-Alloy Welding Electrodes for Shielded Metal Arc Welding

A5.14 Specification for Nickel and Nickel-Alloy Bare Welding Rods and Electrodes

2.6 *ASNT*:

SNT-TC-1A (1984) Recommended Practice for Nondestructive Testing Personnel Qualification and Certification

3. Common Requirements and Ordering Information

- 3.1 Material furnished to this specification shall conform to the requirements of Specification A960/A960M including any supplementary requirements that are indicated in the purchase order. Failure to comply with the common requirements of Specification A960/A960M constitutes nonconformance with this specification. In case of conflict between this specification and Specification A960/A960M, this specification shall prevail.
- 3.2 Specification A960/A960M identifies the ordering information that should be complied with when purchasing material to this specification.

4. Material

- 4.1 The material for fittings shall consist of forgings, bars, plates, or seamless or welded tubular products that conform to the chemical requirements in Table 2. See Table 3 for a list of common names.
- 4.2 The steel shall be melted by one of the following processes:
- 4.2.1 Electric furnace (with separate degassing and refining optional),

- 4.2.2 Vacuum furnace, or
- 4.2.3 One of the former followed by vacuum or electroslagconsumable remelting.
- 4.3 If secondary melting is employed, the heat shall be defined as all ingots remelted from a primary heat.
- 4.4 *Grain Size*—Annealed Alloys UNS N08810 and UNS N08811 shall conform to an average grain size of ASTM No. 5 or coarser.

5. Manufacture

- 5.1 Forming—Forging or shaping operations may be performed by hammering, pressing, piercing, extruding, upsetting, rolling, bending, fusion welding, machining, or by a combination of two or more of these operations. The forming procedure shall be so applied that it will not produce injurious defects in the fittings.
- 5.2 All fittings shall be heat treated in accordance with Section 6.
- 5.3 Grade WP fittings ordered as Class S shall be of seamless construction and shall meet all requirements of ASME B16.9, ASME B16.11, MSS SP-79, MSS SP-83, MSS SP-95, or MSS SP-97.
- 5.4 Grade WP fittings ordered as Class W shall meet the requirements of ASME B16.9 and:
- 5.4.1 Shall have all pipe welds made by mill or the fitting manufacturer with the addition of filler metal radiographically examined throughout the entire length in accordance with the Code requirements stated in 5.5, and,
- 5.4.2 Radiographic inspection is not required on single longitudinal seam welds made by the starting pipe manufacturer if made without the addition of filler metal; and
- 5.4.3 Radiographic inspection is not required on longitudinal seam fusion welds made by the fitting manufacturer when all of the following conditions have been met:
 - 5.4.3.1 No addition of filler metal,
 - 5.4.3.2 Only one welding pass per weld seam, and,
 - 5.4.3.3 Fusion welding from one side only.
- 5.4.4 In place of radiographic examination, welds made by the fitting manufacturer may be ultrasonically examined in accordance with the Code requirements stated in 5.6.
- 5.5 Grade WP fittings ordered as Class WX shall meet the requirements of ASME B16.9 and shall have all welds, whether made by the fitting manufacturer or the starting material manufacturer, radiographically examined throughout their entire length in accordance with Paragraph UW-51 of Section VIII, Division I, of the ASME Boiler and Pressure Vessel Code.
- 5.6 Grade WP fittings ordered as Class WU shall meet the requirements of ASME B16.9 and shall have all welds, whether made by the fitting manufacturer or the starting material manufacturer, ultrasonically examined throughout their entire length in accordance with Appendix 12 of Section VIII, Division 1 of ASME Boiler and Pressure Vessel Code.
- 5.7 The radiography or ultrasonic examination of welds for this class of fittings may be done at the option of the manufacturer, either prior to or after forming.

TABLE 2 Chemical Requirements

Note 1—Where an ellipsis (...) appears in this table, there is no requirement and the element need neither be analyzed for or reported.

Gı	rade ^A								Compos	ition, %			
rade WP	Grade CR	UNS Des- ignation	- Carbon ^B		Phos- phorous ^B	Sul- phur ^B	Silicon ^B	Nickel	Chromium	Molybdenum	Titanium	Nitrogen ^C	Others
KM-19	CRXM-19	S20910	0.06	4.0-6.0	0.045	0.030	1.00	11.5–13.5	20.5–23.5	1.50-3.00		0.20- 0.40	Е
20CB	CR20CB	N08020	0.07	2.00	0.045	0.035	1.00	32.0–38.0	19.0–21.0	2.00-3.00			Cu 3.0–4.0 Nb ^D 8XC min, 1.00 max
6XN 700	CR6XN CR700	N08367 N08700	0.030 0.04	2.00 2.00	0.040 0.040	0.030 0.030	1.00 1.00	23.5–25.5 24.0–26.0	20.0–22.0 19.0–23.0	6.0–7.0 4.3–5.0		0.18-0.25	Cu 0.75 Cu 0.50
PNIC	CRNIC	N08800	0.10	1.50	0.045	0.015	1.00	30.0–35.0	19.0–23.0		0.15–0.60		Nb ^D 8XC min AI 0.15–0.60
													Cu 0.75 Fe 39.5 min
NIC10	CRNIC10	N08810	0.05-0.10	1.50	0.045	0.015	1.00	30.0–35.0	19.0–23.0		0.15-0.60		Al 0.15–0.60 Cu 0.75 Fe 39.5 min
NIC11	CRNIC11	N08811	0.06-0.10	1.50	0.040	0.015	1.00	30.0–35.0	19.0–23.0		0.15-0.60		Al 0.15–0.60 Cu 0.75
20041	00004	NICOCOA	0.000	0.00	0.045	0.005	4.00	00 0 00 0	40.0.00.0	40.50		0.40	Fe 39.5 min
904L	CR904L	N08904	0.020	2.00	0.045	0.035	1.00	23.0-28.0	19.0–23.0	4.0–5.0		0.10	Cu 1.0–2.0
1925 1925N	CR1925 CR1925N	N08925 N08926	0.020 0.020	1.00 2.00	0.045 0.030	0.030	0.50 0.50	24.0–26.0 24.0–26.0	19.0–21.0	6.0–7.0 6.0–7.0		0.10-0.20 0.15-0.25	Cu 0.8–1.5 Cu 0.5–1.5
1925IN 304		S30400	0.020	2.00		0.010	1.00	8.0–11.0	19.0–21.0				
304L	CR304 CR304L	S30400 S30403	0.08 0.030 ^F	2.00	0.045 0.045	0.030	1.00	8.0–11.0	18.0–20.0 18.0–20.0				
304L 304H	CR304H	S30403 S30409	0.030		0.045	0.030	1.00	8.0–12.0	18.0–20.0				
304N	CR304N	S30409	0.04-0.10	2.00	0.045	0.030	1.00	8.0–11.0	18.0–20.0			0.10-	• • •
304IN	CH304N	330431	0.06	2.00	0.045	0.030	1.00	6.0-11.0	16.0-20.0			0.16	
304LN	CR304LN	S30453	0.030	2.00	0.045	0.030	1.00	8.0–11.0	18.0–20.0			0.10- 0.16	
309	CR309	S30900	0.20	2.00	0.045	0.030	1.00	12.0-15.0	22.0-24.0				
310S	CR310S	S31008	0.08	2.00	0.045	0.030	1.00	19.0-22.0	24.0-26.0				
310H	CR310H	S31009	0.04-0.10	2.00	0.045	0.030	1.00	19.00-22.0	24.0-26.0				
531254	CRS31254	S31254	0.020	1.00	0.030	0.010	0.80	17.5–18.5	19.5–20.5	6.0–6.5		0.18– 0.25	Cu 0.50-1.00
S31266	CRS31266	S31266	0.030	2.00-4.00	0.035	0.020	1.00	21.00–24.00	23.00–25.00	5.2-6.2		0.35-0.60	Cu 1.00-2.50 W 1.50-2.50
316	CR316	S31600	0.08	2.00	0.045	0.030	1.00	10.0-14.0	16.0-18.0	2.00-3.00			
316L	CR316L	S31603	0.030^{F}	2.00	0.045	0.030	1.00	10.0–14.0 ^{<i>G</i>}	16.0-18.0	2.00-3.00			
316H	CR316H	S31609	0.04-0.10		0.045	0.030	1.00	10.0-14.0	16.0-18.0	2.00-3.00			
316N	CR316N	S31651	0.08	2.00	0.045	0.030	1.00	10.0–13.0	16.0–18.0	2.00-3.00		0.10- 0.16	
316LN	CR316LN	S31653	0.030	2.00	0.045	0.030	1.00	10.0–13.0	16.0–18.0	2.00-3.00		0.10- 0.16	
317	CR317	S31700	0.08	2.00	0.045	0.030	1.00	11.0-15.0	18.0-20.0	3.0-4.0			
317L	CR317L	S31703	0.030	2.00	0.045	0.030		11.0-15.0	18.0-20.0	3.0-4.0			
S31725	CRS31725	S31725	0.030	2.00	0.045	0.030	1.00	13.5-17.5	18.0-20.0	4.0-5.0		0.20	
331726	CRS31726	S31726	0.030	2.00	0.045	0.030	1.00	13.5-17.5	17.0-20.0	4.0-5.0		0.10-	
S31727	CRS31727	S31727	0.030	1.00	0.030	0.030	1.00	14.5–16.5	17.5–19.0	3.8–4.5		0.20 0.15–	Cu 2.8–4.0
004700	00004700	004700	0.000	0.00	0.040	0.616	4 00	45.0 40.5	170 100	00.40		0.21	010.50
S31730	CRS31730	S31730	0.030	2.00	0.040	0.010	1.00	15.0–16.5	17.0–19.0	3.0–4.0		0.045	Cu 4.0-5.0
S32053	CRS32053	S32053	0.030	1.00	0.030	0.010	1.00	24.0–26.0	22.0–24.0	5.0–6.0		0.17- 0.22	
321	CR321	S32100	0.08	2.00	0.045	0.030	1.00	9.0-12.0	17.0-19.0		Н		
321H	CR321H	S32109	0.04-0.10	2.00	0.045	0.030	1.00	9.0-12.0	17.0-19.0		1		
S33228	CRS33228	S33228	0.04-0.08	1.00	0.020	0.015	0.30	31.0-33.0	26.0-28.0				Ce 0.05-0.10

TABLE 2 Continued

G	rade ^A								Compos	ition, %			
Grade WP	Grade CR	UNS Designation	- Carbon ^B		Phos- phorous ^E	Sul- 3 phur ^B	Silicon ^B	Nickel	Chromium	Molybdenum	Titanium	Nitrogen ^C	Others
WPS34565	CRS34565	S34565	0.030	5.0-7.0	0.030	0.010	1.00	16.0–18.0	23.0–25.0	4.0-5.0		0.40-	Al 0.025 Nb ^D 0.6–1.0 Nb ^D 0.10
WP347 WP347H	CR347 CR347H	S34700 S34709	0.08 0.04–0.10	2.00 2.00	0.045 0.045	0.030 0.030	1.00 1.00	9.0–12.0 9.0–12.0	17.0–19.0 17.0–19.0			0.60	J K
WP347LN	CR347LN	S34751	0.005- 0.020	2.00	0.045	0.030	1.00	9.0-13.0	17.0–19.0				Nb ^D 0.20-0.50, ^L N 0.06-0.10 ^C
WP348	CR348	S34800	0.08	2.00	0.045	0.030	1.00	9.0–12.0	17.0–19.0		• • •		Nb ^D +Ta=10x(C)-1.10 Ta 0.10 Co 0.20
WP348H	CR348H	S34809	0.04-0.10	2.00	0.045	0.030	1.00	9.0–12.0	17.0–19.0				Nb ^D +Ta=8×(C)-1.10 Ta 0.10 Co 0.20
WPS38815	CRS38815	S38815	0.030	2.00	0.040	0.020	5.5–6.5	15.0–17.0	13.0–15.0	0.75-1.50			Cu 0.75–1.50 Al 0.30

^ASee Section 15 for marking requirements.

^BMaximum, unless otherwise indicated.

^cThe method of analysis for nitrogen shall be a matter of agreement between the purchaser and manufacturer.

^pNiobium and columbium are interchangeable names for the same element and both names are acceptable for use in A01.22 specifications.

^ENiobium (columbium) 0.10–0.30 %; Vanadium, 0.10–0.30 %.

For small diameter or thin walls, or both, where many drawing passes are required, a carbon maximum of 0.040 % is necessary in grades TP304L and TP316L. Small outside diameter tubes are defined as those less than 0.500 in. [12.7 mm] in outside diameter and light wall tubes as those less than 0.049 in. [1.24 mm] in average wall thickness.

^GOn pierced tubing, the nickel may be 11.0–16.0 %.

H5X(C+N) min-0.70 max.

¹4X(C+N) min-0.70 max.

The niobium (columbium) content shall be not less than ten times the carbon content and not more than 1.10 %.

KThe niobium (columbium) content shall be not less than eight times the carbon content and not more than 1.10 %.

^LThe niobium (columbium) content shall be not less than 15 times the carbon content.

TABLE 3 Common Names

	TABLE 3 Common Names						
Grade WP ^A	Grade CR ^A	UNS Designation	Type ^B				
WPXM-19	CRXM-19	S20910	XM-19 ^C				
WP20CB	CR20CB	N08020					
WP6XN	CR6XN	N08367					
WP700	CR700	N08700					
WPNIC	CRNIC	N08800	800 ^C				
WPNIC10	CRNIC10	N08810	800H ^C				
WPNIC11	CRNIC11	N08811					
WP904L	CR904L	N08904	904L ^C				
WP1925	CR1925	N08925					
WP1925N	CR1925N	N08926					
WP304	CR304	S30400	304				
WP304L	CR304L	S30403	304L				
WP304H	CR304H	S30409	304H				
WP304N	CR304N	S30451	304N				
WP304LN	CR304LN	S30453	304LN				
WP309	CR309	S30900	309				
WP310S	CR310S	S31008	310S				
WP310H	CR310H	S31009	310H				
WPS31254	CRS31254	S31254					
WPS31266	CRS31266	S31266					
WP316	CR316	S31600	316				
WP316L	CR316L	S31603	316L				
WP316H	CR316H	S31609	316H				
WP316N	CR316N	S31651	316N				
WP316LN	CR316LN	S31653	316LN				
WP317	CR317	S31700	317				
WP317L	CR317L	S31703	317L				
WPS31725	CRS31725	S31725	317LM ^C				
WPS31726	CRS31726	S31726	317LMN ^C				
WPS31727	CRS31727	S31727					
WPS31730	CRS31730	S31730					
WPS32053	CRS32053	S32053					
WP321	CR321	S32100	321				
WP321H	CR321H	S32109	321H				
WPS33228	CRS33228	S33228					
WPS34565	CRS34565	S34565					
WP347	CR347	S34700	347				
WP347H	CR347H	S34709	347H				
WP347LN	CR347LN	S34751	347LN				
WP348	CR348	S34800	348				
WP348H	CR348H	S34809	348H				
WPS38815	CRS38815	S38815					

^A Naming system developed and applied by ASTM International.

- 5.8 Personnel performing NDE examinations shall be qualified in accordance with SNT-TC-1A.
- 5.9 Grade CR fittings shall meet the requirements of MSS SP-43 and do not require nondestructive examination.
- 5.10 All fittings shall have the welders, welding operators, and welding procedures qualified under the provisions of Section IX of the ASME Boiler and Pressure Vessel Code except that starting pipe welds made without the addition of filler metal do not require such qualification.
- 5.11 All joints welded with filler metal shall be finished in accordance with the requirements of Paragraph UW-35 (a) of Section VIII, Division I, of the ASME Boiler and Pressure Vessel Code.
- 5.12 Fittings machined from bar shall be restricted to NPS 4 or smaller. Elbows, return bends, tees, and header tees shall not be machined directly from bar stock.

- 5.12.1 All caps machined from bar shall be examined by liquid penetrant in accordance with Supplementary Requirement S52 in Specification A960/A960M.
- 5.13 Weld buildup is permitted to dimensionally correct unfilled areas produced during cold forming of stub ends. Radiographic examination of the weld buildup shall not be required provided that all the following steps are adhered to:
- 5.13.1 The weld procedure and welders or welding operators meet the requirements of 5.10.
- 5.13.2 Annealing is performed after welding and prior to machining.
- 5.13.3 All weld surfaces are liquid penetrant examined in accordance with Appendix 8 of Section VIII, Division 1 of the ASME Boiler and Pressure Vessel Code.
- 5.13.4 Repair of areas in the weld is permitted, but 5.13.1, 5.13.2, and 5.13.3 must be repeated.
 - 5.14 DELETED
 - 5.15 DELETED
- 5.16 After final heat treatment, all "H-Grade" steel fittings shall have a grain size of 7 or coarser in accordance with Test Methods E112.

6. Heat Treatment

- 6.1 All fittings shall be furnished in the heat-treated condition. For H grades, including Grade S33228, separate solution heat treatments are required for solution annealing; in-process heat treatments are not permitted as a substitute for the separate solution annealing treatments. The heat-treat procedure, except for those grades listed in 6.2, shall consist of solution annealing the fittings at the temperatures listed for each grade in Table 4 until the chromium carbides go into solution, and then cooling at a sufficient rate to prevent reprecipitation.
- 6.2 A solution annealing temperature above 1950 °F [1065 °C] may impair the resistance to intergranular corrosion after subsequent exposure to sensitizing conditions in 321, 321H,

^B Unless otherwise indicated, a grade designation originally assigned by the American Iron and Steel Institute (AISI).

^C Common name, not a trademark widely used, not associated with any one producer.

TABLE 4 Heat Treatment

Grade	Grade	UNS Designation	Solution Anneal	Quench Media
WP ^A	CR ^A		Temperature, min °F [°C] ^B	
WPXM-19	CRXM-19	S20910	1900 [1040]	water or other rapid cool
WP20CB	CR20CB	N08020	1700–1850	water or other rapid cool
			[927–1010]	
WP6XN	CR6XN	N08367	2025 [1107]	water or other rapid cool
WP700	CR700	N08700	2025–2100	water or other rapid cool
			[1107–1150]	
WPNIC	CRNIC	N08800	1800–1900	water or other rapid cool
			[983–1038] ^C	
WPNIC10	CRNIC10	N08810	2100–2150	water or other rapid cool
			[1147–1177] ^C	
WPNIC11	CRNIC11	N08811	2100–2150	water or other rapid cool
			[1147–1177] ^C	
WP904L	CR904L	N08904	1985–2100	water or other rapid cool
			[1085–1150]	
WP1925	CR1925	N08925	1800–1900	water or other rapid cool
			[983–1038]	
WP1925N	CR1925N	N08926	2150 [1177]	water or other rapid cool
WP304	CR304	S30400	1900 [1040]	water or other rapid cool
WP304L	CR304L	S30403	1900 [1040]	water or other rapid cool
WP304H	CR304H	S30409	1900 [1040]	water or other rapid cool
WP304N	CR304N	S30451	1900 [1040]	water or other rapid cool
WP304LN	CR304LN	S30453	1900 [1040]	water or other rapid cool
WP309	CR309	S30900	1900 [1040]	water or other rapid cool
WP310S	CR310S	S31008	1900 [1040]	water or other rapid cool
WP310H	CR310H	S31009	1900 [1040]	water or other rapid cool
WPS31254	CR31254	S31254	2100 [1150]	water or other rapid cool
WPS31266	CRS31266	S31266	2100 [1150]	water or other rapid cool
WP316	CR316	S31600	1900 [1040]	water or other rapid cool
WP316L	CR316L	S31603	1900 [1040]	water or other rapid cool
WP316H	CR316H	S31609	1900 [1040]	water or other rapid cool
WP316N	CR316N	S31651	1900 [1040]	water or other rapid cool
WP316LN	CR316LN	S31653	1900 [1040]	water or other rapid cool
WP317	CR317	S31700	1900 [1040]	water or other rapid cool
WP317L	CR317L	S31703	1900 [1040]	water or other rapid cool
WPS31725	CRS31725	S31725	1900 [1040]	water or other rapid cool
WPS31726	CRS31726	S31726	1900 [1040]	water or other rapid cool
WPS31727	CRS31727	S31727	1975–2155	water or other rapid cool
			[1080–1180]	
WPS31730	CRS31730	S31730	1900 [1040]	water or other rapid cool
WPS32053	CRS32053	S32053	1975–2155	water or other rapid cool
	01100=000		[1080–1180]	
WP321	CR321	S32100	1900 [1040]	water or other rapid cool
WP321H	CR321H	S32109	1925 [1050]	water or other rapid cool
WPS33228	CRS33228	S33228	2050–2160	water or other rapid cool
W COOLLO	011000220	000220	[1120–1180]	water or earler rapid ecor
WPS34565	CRS34565	S34565	2050–2140	water or other rapid cool
501000	011001000	30.000	[1120–1170]	nater of other rapid cool
WP347	CR347	S34700	1900 [1040]	water or other rapid cool
WP347H	CR347H	S34700 S34709	1925 [1050]	water or other rapid cool
WP347LN	CR347I1	S34709 S34751	1923 [1030]	water or other rapid cool
WP348	CR348	S34731 S34800	1900 [1040]	water or other rapid cool
WP348H	CR348H	S34800 S34809		water or other rapid cool
WPS38815	CR348H CRS38815	S34809 S38815	1925 [1050]	water or other rapid cool water or other rapid cool
VVF338815	CH938815	538815	1950 [1065]	water or other rapid cool

^ANaming system developed and applied by ASTM International.

347, and 347H. When specified by the purchaser a lower temperature stabilizing treatment or a second solution anneal shall be used subsequent to the initial high-temperature solution anneal (see Supplementary Requirement S2).

- 6.3 All welding shall be done prior to heat treatment.
- 6.4 Fittings machined directly from solution-annealed forgings and bar stock that were solution annealed in accordance with 6.1 need not be annealed again.

7. Chemical Composition

7.1 The chemical composition of each cast or heat used shall be determined and shall conform to the requirements of the chemical composition for the respective grades of materials listed in Table 2. The ranges as shown have been expanded to include variations of the chemical analysis requirements that are listed in the various specifications for starting materials

^bWhere a range of temperature is not listed, the single value shown shall be the minimum required temperature.

Cheat Treatment is highly dependent on intended service temperature; consult material manufacturer for specific heat treatments for end use temperature.

(pipe, tube, plate, bar, and forgings) normally used in the manufacturing of fittings to this specification. Methods and practices relating to chemical analyses required by this specification shall be in accordance with Test Methods, Practices, and Terminology A751. Product analysis tolerances in accordance with Specification A960/A960M are applicable.

- 7.2 The steel shall not contain any unspecified elements for the ordered grade to the extent that it conforms to the requirements of another grade for which that element is a specified element having a required minimum content.
- 7.3 In fittings of welded construction, the alloy content (carbon, chromium, nickel, molybdenum, niobium (columbium), and tantalum) of the deposited weld metal shall conform to that required of the base metal or for equivalent weld metal as given in the AWS filler metal specification A 5.4 or A 5.9 (Type 348 weld metal is listed in AWS A 5.9 but not in AWS A 5.4). Exceptions are when welding on Types 304L and 304 base metals, the deposited weld metal shall correspond, respectively, to AWS E308L (ER308L) and E308 (ER308). When welding 310S or 310H, the weld metal shall correspond to AWS ER310 unless otherwise advised by the purchaser at the time of placement on the purchase order. When welding on Type 321 base metal, the weld metal shall correspond to AWS Type E347 (ER347 or ER321); and, when welding on S31725, S31726, S31254, S31266, or S33228 deposited weld metal shall correspond either to the alloy content of the base metal or to AWS A5.11 E NiCrMo·3 (UNS W86112) (AWS A5.14 Ni Cr Mo·3 (UNS N06625)), and when welding on S31730, deposited weld metal and filler metal used shall correspond either to the alloy content of the base metal or to AWS A5.14 ERNiCr-3 (UNS N06082), or ERNiCrMo-3 (UNS N06625), or ERNiCrMo-4 (UNS N10276). On S38815 base metals, the deposited weld metal and filler metal used shall be agreed upon between purchaser and manufacturer. In fittings of welded construction made from predominantly ferrous alloys N08020, N08367, N08700, N08800, N08810, N08811, N08904, N08925 & N08926, the alloy content of the deposited weld metal shall conform to that required of the base metal or for the equivalent weld metal given in the AWS Filler Metal Specification A5.11 and A5.14. However, it is possible that weld deposit chemistry will not meet the limits of either the base metal or the filler metal for some elements. The weld deposit chemistry shall meet the lowest minimum and highest maximum values for each specification element in either of the base metal or filler metal specification. Dilution of the base and filler metal must be considered when determining weld deposit criteria for over-alloyed filler metals.
- 7.3.1 Supplementary Requirement S1 may be specified where 16-8-2 filler metal is required for joining thick sections of Types 316, 321, or 347 and has adequate corrosion resistance for the intended service.

8. Tensile Properties

8.1 The tensile properties of the fitting material shall conform to the requirements of Table 5. The testing and reporting shall be performed in accordance with Specification A960/ A960M.

TABLE 5 Tensile Requirements

All WP and CR Grades	/ield Strength, min, ksi [MPa]	Tensile Strength, min, ksi [MPa]
304, 304LN, 304H, 309, 310S, 310H, 316, 316LN, 316H, 317, 317L, 321, 321H, 347, 347H, 347LN, 348, 348H	30 [205]	75 [515]
S31266 S31725	61 [420]	109 [750]
S31727	36 [245]	80 [550]
S31730	25 [175]	70 [480]
S32053	43 [295]	93 [640]
304L, 316L	25 [170]	70 [485]
304N, 316N, S31726	35 [240]	80 [550]
XM-19	55 [380]	100 [690]
N08020	35 [240]	80 [550]
N08367	45 [310]	95 [655]
N08700	35[240]	80[550]
N08800	25 [205]	65 [520]
N08810	25 [170]	65 [450]
N08811	25 [170]	65 [450]
N08904	31 [220]	71 [490]
N08925	43[295]	87 [600]
N08926	43 [295]	94 [650]
S31254	44 [300]	94 [650] to 119 [820]
S33228	27 [185]	73 [500]
S34565	60 [415]	115 [795]
S38815	37 [255]	78 [540]
Elonç	gation Requirements	
	Longitudinal	Transverse
Standard round specimen, or sn	nall 28	20

proportional specimen, or strip-type specimen, minimum %

- ^A S38815 Elongation in 2 in. 30 % min.
- 8.1.1 Specimens cut either longitudinally or transversely shall be acceptable for the tensile test.
- 8.1.2 While Table 5 specifies elongation requirements for both longitudinal and transverse specimens, it is not the intent that both requirements apply simultaneously. Instead, it is intended that only the elongation requirement that is appropriate for the specimen used be applicable.
- 8.2 Records of the tension test made on the starting material shall be certification that the material of the fitting meets the requirements of this specification provided that heat treatments are the same.
- 8.3 If the raw material was not tested, or if the heat treatment of the raw material was different than the heat treatment of the fitting, the fitting manufacturer shall perform at least one tension test per heat on material representative of the fitting, and in the same condition of heat treatment as the fitting it represents. Qualification of welding procedures shall be in accordance with 5.8.
- 8.4 If a tension test through the weld is desired, Supplementary Requirement S51 in Specification A960/A960M should be specified.

9. Hydrostatic Tests

- 9.1 Hydrostatic testing is not required by this specification.
- 9.2 All Grade WP fittings shall be capable of withstanding without failure, leakage, or impairment of serviceability, a test pressure equal to that prescribed for the specified matching pipe or equivalent material.
- 9.3 All Grade CR fittings, except tees covered in 9.3.1, shall be capable of withstanding without failure, leakage, or impairment of serviceability, a test pressure based on the ratings in MSS SP-43.
- 9.3.1 Grade CR tees fabricated using intersection welds shall be capable of passing a hydrostatic test based on 70 % of the ratings in MSS SP-43.

10. Surface Finish, Appearance, and Corrosion Protection

- 10.1 The requirements of Specification A960/A960M apply except as modified as follows:
- 10.2 Fittings supplied under this specification shall be examined visually. Selected typical surface discontinuities shall be explored for depth. The fittings shall be free from surface discontinuities that penetrate more than 5 % of the specified nominal wall thickness, except as defined in 10.4 and 10.5, and shall have a workmanlike finish.
- 10.3 Surface discontinuities deeper than 5 % of the specified nominal wall thickness, except as defined in 10.4 and 10.5, shall be removed by the manufacturer by machining or grinding to sound metal, and the repaired areas shall be well faired. The wall thickness at all points shall be at least $87\frac{1}{2}$ % of the specified nominal wall thickness, and the diameters at all points shall be within the specified limits.
- 10.4 Surface checks (fish scale) deeper than $\frac{1}{64}$ in. [0.4 mm] shall be removed.
- 10.5 Mechanical marks deeper than ½16 in. [1.6 mm] shall be removed.
- 10.6 When the removal of a surface discontinuity reduces the wall thickness below 87½ % of the specified nominal wall thickness at any point, the fitting shall be subject to rejection or to repair as provided in Section 11.
- 10.7 The fittings shall be free of scale and shall be passivated.

11. Repair by Welding

- 11.1 Repair of unacceptable imperfections in the base metal is permissible for fittings made to the dimensional standards listed in 1.1 or for other standard fittings made for stock by the manufacturer. Prior approval of the purchaser is required to repair special fittings made to the purchaser's requirements. Welding of unacceptable imperfections in no case shall be permitted when the depth of defect exceeds 33½ % of the nominal wall thickness or the defect area exceeds 10 % of the surface area of the fitting.
- 11.2 The welding procedure and welders shall be qualified in accordance with Section IX of the ASME Boiler and Pressure Vessel Code.

- 11.3 The composition of the weld deposits shall be in accordance with 7.3 and in accordance with the procedure qualification for the applicable material.
- 11.4 Unacceptable imperfections shall be removed by mechanical means or by thermal cutting or gouging methods. Cavities prepared for welding shall be examined with liquid penetrant in accordance with Practice E165/E165M. No cracks are permitted in the prepared cavities. Personnel performing NDE examinations shall be qualified in accordance with SNT-TC-1A
- 11.5 The weld repair shall be permanently identified with the welder's stamp or symbol in accordance with Section VIII of the ASME Boiler and Pressure Vessel Code.
- 11.6 Weld repair area(s) shall be blended uniformly to the base metal and shall be examined by liquid penetrant in accordance with Practice E165/E165M. No cracks are permitted in the weld or surrounding ½ in. [12.7 mm] of base metal. Personnel performing NDE examinations shall be qualified in accordance with SNT-TC-1A.
- 11.7 After weld repair, material shall be heat treated in accordance with Section 6.

12. Dimensions

- 12.1 For fittings covered by ASME B16.9, ASME B16.11, MSS SP-43, MSS SP-79, MSS SP-83, MSS SP-95, or MSS SP-97, the sizes, shapes, and dimensions of the fittings shall be as specified in those standards.
- 12.1.1 Fittings of size or shape differing from these standards, but meeting all other requirements of this specification, may be furnished in accordance with Supplementary Requirement S58 Specification A960/A960M.

13. Rejection and Rehearing

- 13.1 Material that fails to conform to the requirements of this specification may be rejected. Rejection should be reported to the producer or supplier promptly and in writing. In case of dissatisfaction with the results of the tests, the producer or supplier may make claim for rehearing.
- 13.2 Fittings that develop defects in shop working or application operations may be rejected. Upon rejection, the manufacturer shall be notified promptly in writing.

14. Certification

- 14.1 Test reports are required for all fittings covered by this specification. Each test report shall meet the requirements for certification in Specification A960/A960M as well as include the following information specific to this specification:
- 14.1.1 Chemical analyses results for all starting materials, Section 7 (Table 2), reported results shall be to the same number of significant figures as the limits specified in Table 2 for that element,
- 14.1.2 Tensile property results of all starting materials, Section 8 (Table 5), report the yield strength and the tensile strength in ksi [MPa] and elongation in percent,
- 14.1.3 For construction with filler metal added, weld metal chemical analysis,

- 14.1.4 For welded fittings, construction method, weld process and procedure specification number,
 - 14.1.5 Type heat treatment, Section 6 (Table 4),
 - 14.1.6 Results of all nondestructive examinations, and
- 14.1.7 Any supplementary testing required by the purchase order.

15. Product Marking

- 15.1 In addition to marking requirements of Specification A960/A960M, the following additional marking requirements shall apply:
- 15.1.1 All fittings shall have the prescribed information stamped or otherwise suitably marked on each fitting. See Table 6 for marking examples of grades and classes.
- 15.1.2 Marking paint or ink shall not contain harmful amounts of chlorides, metals, or metallic salt, such as zinc or copper, that cause corrosive attack on heating. On wall

TABLE 6 Product Marking Examples for Grades and Classes

Grade and Class Marking	Description
CR304	Single grade: No classes in CR grades
CR304/304L	Multiple grades, meet chemical and mechanical properties of each
WP304-S	Single Grade: seamless
WP304-W	Single Grade; welded: RT or UT pipe welds with filler metal and all fitting manufacturer's welds
WP304-WX	Single grade: welded: RT all welds with or without filler metal
WP304-WU	Single grade; welded: UT all welds with or without filler metal
WP304-304L-S	Multiple grades: meet chemical and mechanical properties of each: seamless

thicknesses thinner than 0.083 in. [2.1 mm], no metal impression stamps shall be used. Vibrating pencil marking is acceptable.

- 15.1.3 Threaded or socket-welding fittings shall be additionally marked with the pressure class. Plugs and bushings furnished to ASME B16.11 requirements are not required to be marked. The class S marking need not be added to the material grade for threaded or socket-welded fittings.
- 15.1.4 When agreed upon between the purchaser and producer, and specified in the order, the markings shall be painted or stenciled on the fitting or stamped on a metal or plastic tag which shall be securely attached to the fitting.
- 15.1.5 Fittings meeting the chemical and mechanical property requirements of Table 2 and Table 5 for more than one grade designation may be marked with more than one class or grade designation, such as WP304/304H; WP304/304L; WP304/304L/304N, WP316/316L, etc.
- 15.2 Bar Coding—In addition to the requirements in 15.1, bar coding is acceptable as a supplemental identification method. The purchaser may specify in the order a specific bar coding system to be used. The bar coding system, if applied at the discretion of the supplier, should be consistent with one of the published industry standards for bar coding. If used on small fittings, the bar code may be applied to the box or a substantially applied tag.

16. Keywords

16.1 austenitic stainless steel; corrosive service applications; pipe fittings; steel; piping applications; pressure containing parts; stainless steel fittings

SUPPLEMENTARY REQUIREMENTS

One or more of the supplementary requirements described below or appearing in Specification A960/A960M may be included in the order or contract. When so included, a supplementary requirement shall have the same force as if it were in the body of the specification. Supplementary requirement details not fully described shall be agreed upon between the purchaser and the supplier.

S1. Special Filler Metal

S1.1 Filler metal shall be AWS Type E16-8-2 or ER 16-8-2 (AWS Specifications A 5.4 and A 5.9, respectively). Fittings welded with 16-8-2 weld metal shall be marked WP ____ HRW or CR ____ HRW, as appropriate.

S2. Stabilizing Treatment

S2.1 Subsequent to the solution anneal required by 6.2, Grades 321, 321H, 347, 347H, 348, and 348H shall be given a stabilizing treatment at 1500 to 1600 °F [815 to 870 °C] for a minimum of 2 h/in. [4.7 min/mm] of thickness and then cooling in the furnace or in air. In addition to the marking

required in Section 15, the grade designation symbol shall be followed by the symbol "S2."

S3. ASME Section III Construction

S3.1 Products welded with filler metal furnished under this specification that are intended for application under the rules of Section III of the ASME Boiler and Pressure Vessel Code shall be manufactured by holders of the appropriate ASME Certificate of Authorization and Certification Mark. The product is subject to all applicable requirements of Section III, including welding, heat treatment, nondestructive examination, authorized inspection at the point of manufacture, and application of the Certification Mark.

- S3.2 The applicable ASME Partial Data Report form, signed by an Authorized Nuclear Inspector, and a material test report shall be furnished for each lot of pipe fittings.
- S3.3 The material used to fabricate the pipe fitting shall conform to the applicable SA specification in ASME Boiler and Pressure Vessel Code, Section II. The welded joints shall be full penetration butt welds as obtained by double welding or by

other means that will obtain the same quality of deposited weld metal on the inside and outside. Welds using metal backing strips that remain in place are prohibited.

S3.4 Each piece of pipe fitting shall be so marked as to identify each such piece of pipe fitting with the lot and the material test report.



SPECIFICATION FOR WELDED LARGE DIAMETER AUSTENITIC STEEL PIPE FOR CORROSIVE OR HIGH-TEMPERATURE SERVICE



SA-409/SA-409M

(23)

(Identical with ASTM Specification A409/A409M-19 except for clarified heat treatment requirements for H grade stainless steels and S30815 in para. 5.3.1, deletion of 5.3.2.2 and 5.3.2.3 for the non-heat treated pipe provisions, and the inclusion of a grain size requirement in para. 5.1.1 for H grade stainless steels and S30815 and mandatory certification in 17. For products ordered to Section III, Division 1 or Section VIII, Division 1 of the ASME Boiler and Pressure Vessel Code, Supplementary Requirement S7 is mandatory.)

Specification for Welded Large Diameter Austenitic Steel Pipe for Corrosive or High-Temperature Service

1. Scope

- 1.1 This specification covers straight seam or spiral seam electric-fusion-welded, light-wall, austenitic chromium-nickel alloy steel pipe for corrosive or high-temperature service. The sizes covered are NPS 14 to 30 with extra light (Schedule 5S) and light (Schedule 10S) wall thicknesses. Table X1.1 shows the wall thickness of Schedule 5S and 10S pipe. Pipe having other dimensions may be furnished provided such pipe complies with all other requirements of this specification.
- 1.2 Several grades of alloy steel are covered as indicated in Table 1.
- 1.3 Optional supplementary requirements are provided. These call for additional tests to be made, and when desired shall be stated in the order, together with the number of such tests required.
- 1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.

Note 1—The dimensionless designator NPS (nominal pipe size) has been substituted in this standard for such traditional terms as *nominal diameter*, *size*, and *nominal size*.

1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A262 Practices for Detecting Susceptibility to Intergranular Attack in Austenitic Stainless Steels

A480/A480M Specification for General Requirements for Flat-Rolled Stainless and Heat-Resisting Steel Plate, Sheet, and Strip

A999/A999M Specification for General Requirements for Alloy and Stainless Steel Pipe

E527 Practice for Numbering Metals and Alloys in the Unified Numbering System (UNS)

2.2 ASME Boiler and Pressure Vessel Code:

Section III

Section VIII, Division 1

Section IX

2.3 AWS Standards:

A 5.22 Flux Cored Arc Welding

A 5.30 Consumable Weld Inserts for Gas Tungsten Arc Welding

A 5.4 Corrosion-Resisting Chromium and Chromium-Nickel Steel Covered Welding Electrodes

A 5.9 Corrosion-Resisting Chromium and Chromium-Nickel Steel Welding Rods and Bare Electrodes

A 5.11 Nickel and Nickel-Alloy Covered Welding Electrodes

A 5.14 Nickel and Nickel-Alloy Bare Welding Rods and Electrodes

2.4 Other Standard:

SAE J1086 Practice for Numbering Metals and Alloys (UNS)

TABLE 1 Chemical Requirements

	UNS						C	omposition, %					
	Designa- tions ^A	Car- bon, max	Man- ganese, max	Phos- phorus, max	Sulfur, max	Sili- con	Nickel	Chromium	Molyb- denum	Tita- nium	Colum- bium	Cerium	Other Elements
TP201	S20100	0.15	5.5–7.5	0.060	0.030	1.00	3.5-5.5	16.0–18.0					N 0.25
TP201LN	S20153	0.03	6.4–7.5	0.045	0.015	0.75	4.0–5.0	16.0–17.5					N 0.10-0.25, Cu 1.00
TP304	S30400	0.08	2.00	0.045	0.030	1.00 max	8.0-11.0	18.0-20.0					
TP304L	S30403	0.035	2.00	0.045	0.030	1.00 max	8.0-12.0	18.0-20.0					
TP309Cb	S30940	0.08	2.00	0.045	0.030	1.00 max	12.0–16.0	22.0–24.0					Cb 10 × C min, 1.10 max
TP309S	S30908	0.08	2.00	0.045	0.030	1.00 max	12.0–15.0	22.0–24.0					
TP310Cb	S31040	0.08	2.00	0.045	0.030	1.00 max	19.0-22.0	24.0-26.0					Cb 10 × C min,
													1.10 max
TP310S	S31008	0.08	2.00	0.045	0.030	1.00 max	19.0–22.0	24.0–26.0					
TP316	S31600	0.08	2.00	0.045	0.030	1.00 max	10.0-14.0	16.0-18.0	2.00 - 3.00				
TP316L	S31603	0.035	2.00	0.045	0.030	1.00 max	10.0-14.0	16.0-18.0	2.00 - 3.00				
TP317	S31700	0.08	2.00	0.045	0.030	1.00 max	11.0–15.0	18.0-20.0	3.0-4.0				
	S31727	0.030	1.00	0.030	0.030	1.00 max	14.5–16.5	17.5–19.0	3.8–4.5			• • •	N 0.15–0.21 Cu 2.8–4.0
	S32053	0.030	1.00	0.030	0.010	1.00 max	24.0-26.0	22.0-24.0	5.0-6.0				N 0.17-0.22
TP321	S32100	0.08	2.00	0.045	0.030	1.00 max	9.00-12.0	17.0-20.0		В			
TP347	S34700	0.08	2.00	0.045	0.030	1.00 max	9.00-12.0	17.0-19.0			С		
TP348	S34800	0.08	2.00	0.045	0.030	1.00 max	9.00-12.0	17.0-19.0			D		
	S31254	0.020	1.00	0.030	0.010	0.80 max	17.5–18.5	19.5–19.5	6.0-6.5				Cu 0.50-1.00
													N 0.18-0.25
	S30815			0.040	0.030	1.40-2.00	10.0-12.0	20.0-22.0				0.03-0.08	N 0.14-0.20
	S31725	0.030	2.00	0.045	0.030	1.00 max	13.5–17.5	18.0–20.0	4.0-5.0				N 0.020 max
	S31726	0.030	2.00	0.045	0.030	1.00 max	14.5–17.5	17.0–20.0	4.0-5.0				N 0.10-0.20
	S34565	0.030	5.0–7.0	0.030	0.010	1.00 max	16.0–18.0	23.0–25.0	4.0–5.0		0.10 max		N 0.40-0.60
	N08367	0.030	2.00	0.040	0.030	1.00 max	23.5–25.5	20.0–22.0	6.0–7.0				Cu 0.75 max Ni 0.18-0.25
	S20400	0.030	7.0-9.0	0.45	0.030	1.00 max	1.50-3.00	15.0-17.0					N 0.15-0.30
	S31266	0.030	2.00-4.00	0.035	0.020	1.00 max	21.0-24.0	23.0-25.0	5.2-6.2				Cu 1.00-2.50
													W 1.50–2.50 N 0.35–0.60

^A New designation established in accordance with ASTM E527 and SAE J1086.

3. Ordering Information

- 3.1 Orders for material to this specification should include the following, as required, to describe the desired material adequately:
 - 3.1.1 Quantity (feet, centimetres, or number of lengths),
- 3.1.2 Name of material (straight seam or spiral seam electric-fusion-welded austenitic steel pipe),
 - 3.1.3 Grade (Table 1),
- 3.1.4 Size (outside diameter and schedule number, or wall thickness).
 - 3.1.5 Length (specific or random) (Section 11),
- 3.1.6 End finish (Section on Ends of Specification A999/A999M),
- 3.1.7 Optional requirements (5.2.1 5.2.3 removal of weld bead; 5.3.2, special heat treatment; 15.2, nondestructive test; 10.1.1, outside diameter tolerance; 11.2, length circumferentially welded; 12.3, repair by welding and heat treatment subsequent to repair welding; 12.4, sand blasted or pickled; 17.1 Certification; Supplementary Requirements S1 to S6).
 - 3.1.8 Specification designation, and
 - 3.1.9 Special requirements.

4. General Requirements

4.1 Material furnished to this specification shall conform to the applicable requirements of the current edition of Specification A999/A999M, unless otherwise provided herein.

5. Materials and Manufacture

- 5.1 If a specific type of melting is required by the purchaser it shall be stated on the order.
- 5.1.1 The grain size for all H grades and S30815 shall be No. 7 or coarser, when determined according to ASTM E112 Test Methods.
 - 5.2 Welding:
- 5.2.1 The welds shall be made by the manual or automatic electric-welding process. For manual welding, the operator and procedure shall be qualified in accordance with the ASME Boiler and Pressure Vessel Code, Section IX. Unless otherwise specified on the purchase order, the pipe may be welded with or without filler metal when the automatic electric-welding process is used.
- 5.2.2 The weld surface on either side of the weld may be flush with the base plate or may have a reasonably uniform

^B The titanium content shall be not less than 5 times the carbon content and not more than 0.70 %.

^C The columbium plus tantalum content shall be not less than 10 times the carbon content and not more than 1.10 %.

^D The columbium plus tantalum content shall be not less than 10 times the carbon content and not more than 1.10 %. The tantalum content shall be 0.10 % maximum, CO 0.20 % maximum.

crown, not to exceed $\frac{1}{16}$ in. [2 mm]. Any weld reinforcement may be removed at the manufacturer's option or by agreement between the manufacturer and purchaser. The contour of the reinforcement should be reasonably smooth and free from irregularities. The weld metal shall be fused uniformly into the plate surface. No concavity of contour is permitted unless the resulting thickness of weld metal is equal to or greater than the minimum thickness of the adjacent base metal.

5.2.3 Weld defects, as determined by specified inspection requirements, shall be repaired by removal to sound metal and rewelding.

5.3 Heat Treatment:

- 5.3.1 Except as provided in 5.3.2, all pipe shall be furnished in the heat-treated condition. For H grades and S30815, separate solution heat treatments are required for solution annealing; in-process heat treatments are not permitted as a substitute for the separate solution heat treatments. The heat-treatment procedure shall consist of heating the material to a minimum temperature of 1900 °F [1040 °C], except for S31254, S31266, and S30815 which shall be heat treated to 2100 °F [1150 °C] and 1920 °F [1050 °C] respectively, S31727 and S32053 which shall be heat treated in the range 1975 to 2155 °F [1080 to 1180 °C], S34565 which shall be heat treated in 2050 °F [1120 °C] to 2140 °F [1170 °C], and N08367, which shall be heated to a minimum temperature of 2025 °F [1107 °C], all materials to be followed by quenching in water or rapidly cooling by other means.
- 5.3.2 The purchase order shall specify one of the following conditions if the heat-treated condition specified in 5.3.1 is not desired by the purchaser:
- 5.3.2.1 A final heat-treatment temperature under 1900 °F [1040 °C]. Each pipe supplied under this requirement shall be stenciled with the final heat-treatment temperature in degrees Fahrenheit or degrees Celsius after the suffix "HT." Controlled structural or special service characteristics may be specified as a guide for the most suitable heat treatment.

5.3.2.2 DELETED

5.3.2.3 DELETED

5.4 A solution annealing temperature above 1950 °F [1065 °C] may impair the resistance to intergranular corrosion after subsequent exposure to sensitizing conditions in TP321, TP347, and TP348. When specified by the purchaser, a lower temperature stabilization or re-solution anneal shall be used subsequent to the initial high temperature solution anneal (see Supplementary Requirement S5).

6. Chemical Composition

- 6.1 The steel shall conform to the chemical composition in
- 6.2 When specified on the purchase order, a product analysis shall be supplied from one tube or coil of steel per heat. The product analysis tolerance of Specification A480/A480M shall apply.

6.3 Unless otherwise specified in the purchase order, the chemical composition of the welding filler metal shall conform to the requirements of the applicable AWS specification for the corresponding grade shown in Table 2. Grades with no filler metal classification indicated shall be welded with filler metals producing deposited weld metal having a composition in accordance with the chemical composition specified in Table 1. The method of analysis for nitrogen and cerium shall be a matter of agreement between the purchaser and manufacturer. The purchaser may choose a higher-alloy filler metal when needed for corrosion resistance.

7. Tensile Requirements

- 7.1 The tensile properties of the plate or sheet used in making the pipe shall conform to the requirements prescribed in Table 3. Certified mill test reports shall be submitted to the pipe manufacturer.
- 7.2 A transverse tension test taken across the welded joint of the finished pipe shall meet the same minimum tensile strength requirements as the sheet or plate. The weld section on the tension specimen shall be in the same condition as the finished pipe (with or without bead as specified).

8. Mechanical Tests Required

8.1 *Tension Test*—One transverse tension test of the weld shall be made on each lot (Note 2) of finished pipe.

Note 2—The term "lot" applies to each 200 ft [60 m] or less of pipe of the same NPS and wall thickness (or schedule number) which is produced from the same heat of steel and subjected to the same finishing treatment in a continuous furnace. When final heat treatment is in a batch-type furnace, the lot shall include only that pipe which is heat treated in the same furnace charge. When no heat treatment is performed following final forming operations, the lot shall include each 200 ft [60 m] or less of pipe of the same NPS and wall thickness (or schedule number) which is produced from the same heat of steel.

- 8.2 Transverse Guided-Bend Weld Test—One test (two specimens) of the weld shall be made on each lot (Note 2) of finished pipe.
- 8.3 Pressure or Nondestructive Electric Test—Each length of pipe shall be subjected to a pressure test or a nondestructive electric test as prescribed in Section 15.

9. Permissible Variations in Wall Thickness

9.1 The minimum wall thickness at any point shall not be more than 0.018 in. [0.46 mm] under the specified wall thickness. (This tolerance is slightly more than commercial tolerances on sheet and plate to allow for possible loss of thickness caused by manufacturing operations.)

10. Permissible Variations in Dimensions

- 10.1 Permissible variations in dimensions shall not exceed the following at any point in each length of pipe.
- 10.1.1 Specified Diameter—Where the specified wall thickness is less than 0.188 in. [4.8 mm], the actual outside diameter, based on circumferential measurement, shall not vary more than ± 0.20 % from the specified outside diameter. Where the specified wall thickness is 0.188 in. [4.8 mm] and heavier, the actual outside diameter, based on circumferential

TABLE 2 Filler Metal Specifications

	UNS							ion ^A for Applicable					
Grade	Designation		5.4		\5.9	A5.		A5.1			5.22		5.30
		Class.	UNS	Class.	UNS	Class.	UNS	Class.	UNS	Class.	UNS	Class.	UNS
TP201	S20100												
TP201LN	S20153												
TP304	S30400	E308	W30810	ER308	S30880 W30840					E308T	W30831	IN308	S30880
TP304L	S30403	E308L	W30813	ER308L	S30883 W30843					E308T	W30835	IN308L	S30883
TP309Cb	S30940	E309Cb	W30917										
TP310Cb	S31040	E310Cb	W31017										
TP316	S31600	E316	W31610	ER316	S31680 W31640					E316T	W31631	IN316	S31680
TP316L	S31603	E316L	W31603	ER316L	S31683 W31643					E316LT	W31635	IN316L	S31683
TP317	S31700	E317	W31700	ER317	S31783 W31743					E317T	W31731	IN317	S31780
	S31727												
	S32053												
TP321	S32100	E347	W34710	ER321 ER347	S32180 W32140 S34780 W34740					E347T	W34733	IN348	S34780
TP347	S34700	E347	W34710	ER347	S34780 W34740					E347T	W34733	IN348	S34780
TP348	S34800	E347	W34710	ER347	S34780 W34740					E347T	W34733	IN348	S34780
	S31254					ENiCrMo-3	W86112	ERNiCrMo-3	NO6625				
	S31725					ENiCrMo-3	W86112	ERNiCrMo-3	NO6625				
	S31726					ENiCrMo-3	W86112	ERNiCrMo-3	NO6625				
	S34565												
	N08367					ENiCrMo-3	W86112	ErNiCrMo-3	N06625				
	S20400	E209	W32210	ER209	W32240								
	S31266					ENiCrMo-4	W80276	ERNiCrMo-4	N10276				
						ENiCrMo-10		ERNiCrMo-10	NO6022				
						ENiCrMo-13		ERNiCrMo-13	NO6059				
						ENICTMo-14		ERNiCrMo-14	N06686				
						ENiCrMo-17	vv86200	ERNiCrMo-17	N06200				

ANew designation established in accordance with Practice E527 and SAE J1086, Practice for Numbering Metals and Alloys (UNS).

TABLE 3 Tensile Requirements

Grade	UNS	Tensile Strength,	Yield Strength,
	Designation	min, ksi [MPa]	min, ksi [MPa]
TP201	S20100	75 [515]	38 [260]
TP201LN	S20153	95 [655]	45 [310]
TP304	S30400	75 [515]	30 [205]
TP304L	S30403	70 [485]	25 [170]
TP309Cb	S30940	75 [515]	30 [205]
TP309S	S30908	75 [515]	30 [205]
TP310Cb	S31040	75 [515]	30 [205]
TP310S	S31008	75 [515]	30 [205]
TP316	S31600	75 [515]	30 [205]
TP316L	S31603	70 [485]	25 [170]
TP317	S31700	75 [515]	30 [205]
	S31727	80 [550]	36 [245]
	S32053	93 [640]	43 [295]
TP321	S32100	75 [515]	30 [205]
TP347	S34700	75 [515]	30 [205]
TP348	S34800	75 [515]	30 [205]
	S31254	94 [650]	44 [300]
	S30815	87 [600]	45 [310]
	S31725	75 [515]	30 [205]
	S31726	80 [550]	35 [240]
	S34565	115 [795]	60 [415]
	S20400	95 [655]	48 [330]
	N08367		
	t ≤ 0.187	100 [690]	45 [310]
	t > 0.187	95 [655]	45 [310]
	S31266	109 [750]	61 [420]

measurement, may vary a maximum of $\pm 0.40\%$ from the specified outside diameter. (Outside diameter tolerances closer than shown above may be obtained by agreement between the pipe manufacturer and purchaser.)

10.1.2~Out-of-Roundness—The difference between the major and the minor outside diameter shall not be more than 1.5~% of the specified outside diameter.

10.1.3 *Alignment (Camber)*—Using a 10-ft [3.0-m] straightedge placed so that both ends are in contact with the pipe, the camber shall not be more than $\frac{3}{16}$ in. [4.8 mm].

11. Lengths

11.1 Unless otherwise specified in the purchase order, pipe of NPS 22 or less will be furnished in random lengths of 9 to 12 ft (Note 3). For outside diameters of over NPS 22, the minimum length will be 5 ft (Note 3).

Note 3—This value(s) applies when the inch-pound designation of this specification is the basis of purchase. The corresponding metric value(s) shall be agreed upon between the manufacturer and the purchaser.

- 11.2 When specified by the purchaser, two or more lengths may be circumferentially welded together to produce longer lengths.
- 11.3 Circumferentially welded joints shall be of the same quality as the longitudinal joints.

^BChoice of American Welding Society specification depends on the welding process used.

12. Workmanship, Finish, and Appearance

- 12.1 The finished pipe shall have a workmanlike finish.
- 12.2 Repair of Defects by Machining or Grinding—Pipe showing moderate slivers or other surface defects may be machined or ground inside or outside to a depth which will ensure the removal of all defects providing the wall thickness is not reduced below the minimum specified in 9.1.
- 12.3 Repair of Defects by Welding-Defects which violate minimum wall thickness may be repaired by welding, but only with the approval of the purchaser. Areas shall be suitably prepared for welding with tightly closed defects removed by grinding. Open, clean defects, such as pits or impressions, may require no preparation. All welders, welding operators, and weld procedures shall be qualified to the ASME Boiler and Pressure Vessel Code, Section IX. Unless the purchaser specifies otherwise, pipe required to be heat treated under the provisions of 5.3 shall be heat treated or reheat treated following repair welding. Repaired lengths, where repair depth is greater than 1/4 of the thickness, shall be pressure tested or repressure tested after repair and heat treatment (if any). Repair welds shall also be examined by suitable non-destructive examination techniques, including any techniques specifically required of the primary weld.
- 12.4 The pipe shall be free of scale and contaminating iron particles. Pickling, blasting, or surface finishing is not mandatory when pipe is bright annealed. The purchaser may request that a passivating treatment be applied.

13. Test Specimens

- 13.1 Transverse tension and bend test specimens may be taken from a test plate of the same material as the pipe, made by attaching a formed cylinder to the end of the pipe and welding the abutting edges as a continuation and duplication of the seam of the pipe (run-off plate). As an alternative to a formed cylinder, the run-off plate may consist of flat plates with reinforcing bars clamped to the underside to prevent distortion. The run-off plate material shall be of the same heat, preferably shear croppings from the same plate.
- 13.2 When heat treatment is required, test specimens shall be cut from pipe after the heat treating has been completed, or specimens removed from the pipe prior to heat treating shall be heat treated with the pipe.

14. Transverse Guided-Bend Weld Tests

14.1 Two bend test specimens shall be taken transversely across the weld. One shall be subject to a face guided-bend test and the second to a root guided-bend test. One specimen shall

be bent with the inside surface of the pipe against the plunger, and the other with the outside surface against the plunger.

14.2 The bend test shall be acceptable if no cracks or other defects exceeding ½ in. [3 mm] in any direction are present in the weld metal or between the weld and the pipe metal after bending. Cracks which originate along the edges of the specimen during testing, and that are less than ¼ in. [6.5 mm] measured in any direction shall not be considered.

15. Pressure Tests

- 15.1 Where hydrostatic test equipment is not available, the pipe may be air or gas pressure tested with an internal pressure of 100 psi [700 kPa]. The weld and weld area shall be inspected with the use of soap solution or any other prepared solution which will detect the leakage of air or gas from the inside.
- 15.2 Instead of a pressure test, when mutually agreed upon between the purchaser and manufacturer, the entire weld area of each pipe, including circumferential welds, may be tested by nondestructive testing methods. These methods shall be capable of detecting both surface and subsurface defects.

16. Inspection

16.1 When specified in the purchase order, the pipe may be inspected at the manufacturer's plant by an inspector representing the purchaser. The inspector shall have entry at all times. The manufacturer shall afford the inspector, all reasonable facilities to satisfy him that the material is being furnished in accordance with these specifications.

17. Certification

17.1 Certification in accordance with the provisions of Specification A999/A999M shall be furnished. When specified on the purchase order or when a specific type of melting has been specified on the purchase order, the type of melting used shall also be reported to the purchaser or the purchaser's representative.

18. Product Marking

- 18.1 Each length of pipe manufactured in accordance with this specification shall have the following identifying marking within 12 in. [300 mm] of one end: manufacturer's name or trade-mark, specification number, grade number of the alloy, the manufacturer's heat number, size, and schedule number. Additional marking requirements for heat treatment are described in Supplementary Requirement S2.
- 18.2 Marking shall be legibly stenciled with a suitable paint or permanent marking compound, except when otherwise specified by the purchaser.

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall apply only when specified in the purchase order. The purchaser may specify a different frequency of test or analysis than is provided in the supplementary requirement. Subject to agreement between the purchaser and manufacturer, retest and retreatment provisions of these supplementary requirements may also be modified.

S1. Product Analysis

S1.1 At the request of the purchaser a product analysis of one coupon representing finished sheet or plate from each heat shall be made by the pipe manufacturer. The drillings for product analysis may be taken from shear crop or test specimens. The results of product analysis shall conform to the requirements in Table 1 and shall be reported to the purchaser.

S2. Radiographic Examination

S2.1 Weld soundness shall be determined through radiographic examination made in accordance with requirements as agreed upon between the pipe manufacturer and purchaser.

S3. Corrosion Requirements

S3.1 Boiling Nitric Acid Test—Except for Grade TP321, coupons representing finished pipe made of nonmolybdenumbearing material (0.50 % and less molybdenum) shall meet the requirement of the boiling nitric acid test conducted according to Practice C of Practices A262. The condition of the test specimens and the corrosion rates are as follows: Type 347 and Type 348 shall be tested in the sensitized condition (heated for 1 h at 1240 °F [675 °C]) and the rate of penetration shall not exceed 0.0020 in. [0.05 mm]/month. All other nonmolybdenum-bearing types, except for Grade TP321, shown in Table 1 shall be tested in the annealed and unsensitized condition and the rate of penetration shall not exceed 0.0015 in. [0.04 mm]/month.

S3.2 Acidified Copper Sulfate Test—Coupons representing finished pipe made of molybdenum-bearing material and Type 321 (over 0.50 % molybdenum) shall meet the requirements of the copper-copper sulfate-sulfuric acid test (intergranular corrosion test) conducted in accordance with Practice E of Practices A262. The condition of the test specimen is as follows: All molybdenum-bearing types shown in Table 1 shall be tested in the annealed and unsensitized condition. Type 321 shall be tested in the sensitized condition (heated for 1 h at 1240 °F [675 °C]). All specimens shall meet the requirements of the prescribed bend test.

S4. Ferrite Control of Weld Deposits

S4.1 The ferrite content of the deposited weld metal in any length of pipe may be determined. The procedural details pertaining to this subject (that is, welding, plate and weld deposit chemistry, testing equipment and method, number and location of test sites, and ferrite control limits) shall be a matter for agreement between the purchaser and the manufacturer.

S5. Stabilizing Heat Treatment

S5.1 Subsequent to the heat treatment required in 5.3, Grades TP321, TP347, and TP348 shall be given a stabilization heat treatment at a temperature lower than that used for the

initial solution annealing heat treatment. The temperature of stabilization heat treatment shall be at a temperature as agreed upon between the purchaser and vendor.

S6 Intergranular Corrosion Test

S6.1 When specified, material shall pass intergranular corrosion tests conducted by the manufacturer in accordance with Practices A262, Practice E.

Note S6.1—Practice E requires testing on the sensitized condition for low carbon or stabilized grades, and on the as-shipped condition for other grades.

S6.2 A stabilization heat treatment in accordance with Supplementary Requirement S5 may be necessary and is permitted in order to meet this requirement for the grades containing titanium or columbium.

S7. ASME Section III or Section VIII, Division 1, Code Construction

S7.1 All products furnished under this SA specification are intended for application under the rules of Section III or for application under the rules of Section VIII-1. Furnishing of such products is limited to manufacturers who hold the appropriate ASME Certification Mark. Weld procedures, welders, and welding machine operators shall be qualified in accordance with ASME Boiler and Pressure Vessel Code, Section IX.

S7.2 The product shall meet all applicable requirements of Section III or Section VIII, Division 1, if applicable, including those requirements pertaining to heat treatment and butt welds. Authorized inspection at the point of manufacture and application of the appropriate Certification Mark is required.

S7.3 The applicable ASME partial data report form, signed by an authorized inspector, and a certified mill test report shall be furnished for each lot of pipe. The term "lot" applies to all pipe of the same mill heat of material and wall thickness which is heat treated in one furnace charge. For pipe which is not heat treated or which is heat treated in a continuous furnace, a lot shall consist of each 200 ft [61 m] or fraction thereof of all pipe of the same mill heat of material and wall thickness, subjected to the same heat treatment. For pipe which is heat treated in a batch-type furnace which is automatically controlled within a 50 °F range and is equipped with recording pyrometer so that the heating records are available, a lot may be defined the same as for continuous furnaces.

S7.4 Each length of pipe shall be marked in such a manner as to identify each such piece with the "lot" and the representative certified mill test report.

APPENDIX

(Nonmandatory Information)

X1. Wall Thickness of Schedule 5S and Schedule 10S

TABLE X1.1 Pipe Dimensions

		Wall Th	nickness		
NPS Designator	Schedu	ıle 5S	Schedule 10S		
	in.	mm	in.	mm	
14	0.156	3.96	0.188	4.78	
16	0.165	4.19	0.188	4.78	
18	0.165	4.19	0.188	4.78	
20	0.188	4.78	0.218	5.54	
22	0.188	4.78	0.218	5.54	
24	0.218	5.54	0.250	6.35	
30	0.250	6.35	0.312	7.92	

SPECIFICATION FOR STEEL, SHEET, CARBON, AND HIGH-STRENGTH, LOW-ALLOY FOR PRESSURE VESSELS



SA-414/SA-414M



(23)

(Identical with ASTM Specification A414/A414M-14(2019).)

Specification for Steel, Sheet, Carbon, and High-Strength, Low-Alloy for Pressure Vessels

1. Scope

- 1.1 This specification covers hot-rolled carbon steel sheet for pressure vessels involving fusion welding or brazing. Welding and brazing technique is of fundamental importance and shall be in accordance with commercial practices.
 - 1.2 The following grades are included in this specification:

		Mechanical F	lequirements	
	Yield Stre	ngth, min	Tensile Str	ength, min
Grade	ksi	MPa	ksi	MPa
Α	25	170	45	310
В	30	205	50	345
С	33	230	55	380
D	35	240	60	415
E	38	260	65	450
F	42	290	70	485
G	45	310	75	515
Н	45	310	75	515

1.3 Hot-rolled carbon steel sheet is generally furnished in cut lengths and to decimal thickness only. Coils may be furnished, provided tension test specimens are taken to represent the middle of the slab as required by 6.1.3. The purchaser should recognize this may require cutting the coils to obtain test samples and results in half-size coils. The sheet is furnished to the following size limits:

	Width, in. [mm]
Thickness, in. [mm]	Over 12 [Over 300]
0.270 to 0.230 [7.0 to 6.0] Under 0.230 to 0.057 [6.0 to 1.5]	sheet (coils only) sheet

1.4 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in nonconformance with the specification.

- 1.5 Tolerances are found in General Requirements Specifications A568/A568M and A635/A635M. The appropriate General Requirements specification is applied based on the thickness and width of the product ordered.
- 1.6 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A568/A568M Specification for Steel, Sheet, Carbon, Structural, and High-Strength, Low-Alloy, Hot-Rolled and Cold-Rolled, General Requirements for
- A635/A635M Specification for Steel, Sheet and Strip, Heavy-Thickness Coils, Hot-Rolled, Alloy, Carbon, Structural, High-Strength Low-Alloy, and High-Strength Low-Alloy with Improved Formability, General Requirements for
- A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys

3. Terminology

- 3.1 *Definitions*—For definitions of other terms used in this specification refer to Terminology A941.
 - 3.2 Definitions of Terms Specific to This Standard:
- 3.2.1 *lot*, n—all coils of one thickness and width combination from one heat and one rolling on the hot mill, up to 100 tons [90 tonnes] total mass.

4. Ordering Information

4.1 Orders for material under this specification shall include the following information, as required, to describe the material adequately:

- 4.1.1 Designation or specification number, date of issue, and grade,
- 4.1.1.1 Grade H may be substituted for Grade G upon agreement between the purchaser and producer,
 - 4.1.2 Copper bearing steel, when required,
 - 4.1.3 Special requirements, if required,
- 4.1.3.1 Charpy impact properties may be specified for Grade H at the time of order,
- 4.1.3.2 Strength levels at other than room temperature may be specified for Grade H at the time of order,
- 4.1.4 Condition—pickled (or blast cleaned), if required (material so ordered will be oiled unless ordered dry), and
 - 4.1.5 Dimensions, including type of edges.
- 4.1.5.1 When the purchaser requires thickness tolerances for 3/8 in. [10 mm] minimum edge distance (see Supplementary Requirement in Specifications A568/A568M or A635/A635M, as applicable), this requirement shall be specified in the purchase order or contract.

Note 1—Not all producers are capable of meeting all of the limitations of the thickness tolerance tables in Specification A568/A568M or Specification A635/A635M. The purchaser should contact the producer regarding possible limitations prior to placing an order.

4.1.6 Cast or heat analysis, or test report request, or both, if required.

Note 2—A typical ordering description is as follows: "ASTM A414, Grade A, Hot-Rolled Sheet, 0.100 in. [2.54 mm] by 36 in. [914.4 mm] by 96 in. [2438 mm], cut edges."

5. Chemical Requirements

- 5.1 Cast or Heat Analysis—The analysis of the steel shall conform to the requirements prescribed in Table 1.
- 5.1.1 Each of the elements listed in Table 2 shall be included in the report of the heat analysis. When the amount of an element present is less than $0.02\,\%$, the analysis may be reported as "<0.02 %."

TABLE 2 Limits on Unspecified Elements (See 5.1.1)

Copper, max % ^A	Heat analysis	0.40
	Product analysis	0.43
Nickel, max % ^A	Heat analysis	0.40
	Product analysis	0.43
Chromium, max %A,B	Heat analysis	0.30
	Product analysis	0.34
Molybdenum, max %A,B	Heat analysis	0.12
•	Product analysis	0.13
Vanadium, max % ^C	Heat analysis	0.03
	Product analysis	0.04
Columbium, max % ^C	Heat analysis	0.02
	Product analysis	0.03

^A The sum of copper, nickel, chromium, and molybdenum shall not exceed 1.00 % on heat analysis. When one or more of these elements are specified, the sum does not apply, in which case, only the individual limits on the remaining unspecified elements will apply.

- 5.2 *Product, Check, or Verification Analysis*—Analyses may be made by the purchaser from finished material representing each heat.
- 5.3 *Deoxidation*—For all grades, killed steel is required. See Table 1 and footnote B.

6. Mechanical Property Requirements

- 6.1 Tensile Strength:
- 6.1.1 Requirements—Material as represented by the test specimen shall conform to the tensile requirements specified in Table 3. One coil per lot shall have test specimens taken from locations representing the front end, middle, and back end of the coil. If all tensile results conform to the requirements, other coils of that lot may be tested only at the middle position.
 - 6.1.2 Location and Orientation (see Fig. 1):

TABLE 1 Chemical Requirements

	% Heat Analysis, Element Maximum Unless Otherwise Shown														
Grade	С	Mn ^A	Р	S	Al ^B	Si ^B	Cu ^c ,	Ni ^D	Cr ^{D, E}	Mo ^{D, E}	V	Cb	Ti ^F	N	В
A	0.15	0.90	0.035	0.035	0.02-0.08	0.30	0.40	0.40	0.30	0.12	0.03	0.02	0.025		
В	0.22	0.90	0.035	0.035	0.02-0.08	0.30	0.40	0.40	0.30	0.12	0.03	0.02	0.025		
С	0.25	0.90	0.035	0.035	0.02-0.08	0.30	0.40	0.40	0.30	0.12	0.03	0.02	0.025		
D	0.25	1.20	0.035	0.035	0.02-0.08	0.30	0.40	0.40	0.30	0.12	0.03	0.02	0.025		
E	0.27	1.20	0.035	0.035	0.02-0.08	0.30	0.40	0.40	0.30	0.12	0.03	0.02	0.025		
F	0.31	1.20	0.035	0.035	0.02-0.08	0.30	0.40	0.40	0.30	0.12	0.03	0.02	0.025		
G	0.31	1.35	0.035	0.035	0.02-0.08	0.30	0.40	0.40	0.30	0.12	0.03	0.02	0.025		
$H^{A,\;G}$	0.14	1.25	0.020	0.015	0.02-0.08	0.30	0.20	0.20	0.15	0.06	0.05	0.005/	0.005	0.009	
											min	0.05	min		

^A For each reduction of 0.01 % below the specified carbon maximum, an increase of 0.06 % manganese above the specified maximum wll be permitted up to a maximum of 1.50 %

^B The sum of chromium and molybdenum shall not exceed 0.32 % on heat analysis. When one or more of these elements are specified, the sum does not apply, in which case, only the individual limits on the remaining unspecified elements will apply.

^C By agreement, the heat analysis limits for vanadium or columbium, or both, may be increased up to 0.10 % and 0.05 %. respectively.

^B The steel shall be considered aluminum-silicon killed when the silicon is between 0.15 % and 0.30 %, otherwise it shall be considered aluminum killed.

^C When copper is specified, a minimum of 0.20 % is required. When copper is not specified, the copper limit is a maximum requirement.

^D The sum of copper, nickel, chromium, and molybdenum shall not exceed 1.00 % on heat analysis. When one or more of these elements are specified, the sum does not apply, in which case, only the individual limits on the remaining unspecified elements will apply.

E The sum of chromium and molybdenum shall not exceed 0.32 % on heat analysis. When one or more of these elements are specified, the sum does not apply, in which case, only the individual limits on the remaining unspecified elements will apply.

Filtanium is permitted for Grades A through G, at the producer's option, to the lesser of 3.4N + 1.5S or 0.025 %.

^G Grade H contains the strengthening elements columbium (niobium), vanadium, titanium and molybdenum added singly or in combination. The minimum requirements only apply to the microalloy elements selected for strengthening of the steel.

TARI F	3	Tensile	Requirements
IADLL	J	ICHOUG	neuuliellellis

Designation	n Yield Strength ^A Tensile Strength		Elongation in 2 [50 mm] min. %	Elongation in 8 in. [200 mm], min. %			
		Minimum	Maximum	Under 0.270 in. [7.0 mm] to 0.145 in. [3.8 mm]	Under 0.145 in. [3.8 mm] to 0.089 in. [2.2 mm]	Under 0.089 in. [2.2 mm] to 0.057 in. [1.5 mm]	
	ksi [MPa]	ksi [MPa]	ksi [MPa]	-	-	-	-
Grade A	25 [170]	45 [310]	60 [415]	26	24	23	20
Grade B	30 [205]	50 [345]	65 [450]	24	22	21	18
Grade C	33 [230]	55 [380]	70 [485]	22	20	19	16
Grade D	35 [240]	60 [415]	75 [515]	20	18	17	14
Grade E	38 [260]	65 [450]	85 [585]	18	16	15	12
Grade F	42 [290]	70 [485]	90 [620]	16	14	13	10
Grade G	45 [310]	75 [515]	95 [655]	16	14	13	10
Grade H	45 [310]	75 [515]	90 [620]	25	24	23	20

^A Yield strength determined by the 0.2 % offset or 0.5 % extension under load methods.




FIG. 1 Location of Test Specimens

- 6.1.2.1 Tensile test samples shall be taken from the full thickness of the sheet as rolled.
- 6.1.2.2 Tensile test specimens shall be taken from a location approximately halfway between the center of the sheet and the edge of the material as-rolled.
- 6.1.2.3 Tensile test specimens shall be taken with the axis of the test specimen perpendicular to the rolling direction (transverse test).
- 6.1.3 *Test Method*—Yield strength shall be determined by either the 0.2 % offset method or by the 0.5 % extension under load method, unless otherwise specified per Test Method A370.
 - 6.2 Impact Properties:
- 6.2.1 *Requirements*—At the time of order, Charpy impact properties may be specified by the purchaser for Grade H only.
- 6.2.1.1 Impact energy minimums and testing temperatures shall be agreed upon between the producer and the purchaser.
- 6.2.2 *Number of Tests*—Three samples taken in the transverse direction shall be taken at mid-length (middle) of each coil to be certified.
- 6.2.3 Testing shall be in accordance with Test Method A370.

7. General Requirements for Delivery

7.1 Material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A568/A568M or Specification A635/A635M unless otherwise provided herein.

8. Workmanship

8.1 The material shall be free from injurious defects (see Specifications A568/A568M or A635/A635M, as appropriate due to thickness).

9. Finish and Appearance

- 9.1 Surface Finish:
- 9.1.1 Unless otherwise specified, the material shall be furnished without removing the hot-rolled oxide or scale.
- 9.1.2 When required, the material may be specified to be pickled or blast cleaned.
 - 9.2 Oiling:
- 9.2.1 Unless otherwise specified, the material shall be furnished not oiled.
- 9.2.2 When specified to be pickled or blast cleaned, the material shall be furnished oiled. When required, pickled or blast-cleaned material may be specified to be furnished dry.
- 9.3 *Edges*—Unless otherwise specified, mill edges shall be furnished on material that has not had the hot-rolled oxide or scale removed and cut edges shall be furnished on material that has had the hot-rolled oxide or scale removed.

10. Certification and Reports

- 10.1 The manufacturer or processor shall furnish copies of a test report showing the results of the heat analysis and mechanical property tests made to determine compliance with this specification.
- 10.2 The report shall include the purchase order number, the specification number and year date, product designation, grade, the heat number, and heat analysis and mechanical properties as indicated by the tension test.
- 10.2.1 All the mechanical properties from the coil used to qualify the lot and the middle test from the particular coil shall be reported along with the coil identification for that coil. If the

source of the material is the coil used to qualify the lot, the middle test shall be reported as the second middle test on the report. The test report shall contain the results of four tensile tests and all must meet the requirements tensile requirements table.

- 10.3 A signature is not required on the test report. However, the document shall clearly identify the organization submitting the report. Notwithstanding the absence of a signature, the organization submitting the report is responsible for the content of the report.
- 10.4 A Material Test Report, Certificate of Inspection, or similar document printed from or used in electronic form from an electronic data interchange (EDI) transmission shall be regarded as having the same validity as a counterpart printed in the certifier's facility. The content of the EDI transmitted document must meet the requirements of the invoked ASTM standard and the purchaser and supplier. Notwithstanding the absence of a signature, the organization submitting the EDI transmission is responsible for the content of the report.

11. Product Marking

- 11.1 The name or brand of the manufacturer, heat and slab number, specification designation number, and grade shall be legibly and durably marked on each cut length sheet in two places not less than 12 in. [300 mm] from the edges. Cut length sheets, the maximum lengthwise and crosswise, dimensions of which do not exceed 72 in. [1800 mm], shall be legibly and durably marked in one place approximately midway between the center and a side edge. The manufacturer's test identification number shall be legibly and durably marked on each test specimen. Steel-die marking of sheets is prohibited on material < 0.250 in. [6 mm].
- 11.2 For coil product, the information required in 11.1 shall be legibly and durably marked both on each coil and on a tag affixed to each coil.

12. Keywords

12.1 carbon steel sheet; pressure vessel steels; steel sheet



SPECIFICATION FOR PIPING FITTINGS OF WROUGHT CARBON STEEL AND ALLOY STEEL FOR LOW-TEMPERATURE SERVICE



SA-420/SA-420M



(Identical with ASTM Specification A420/A420M-19a.)
For products welded with filler metal ordered to Section III, Division 1, Supplementary Requirement S1 is mandatory.

Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Low-Temperature Service

1. Scope

- 1.1 This specification covers wrought carbon steel and alloy steel fittings of seamless and welded construction, covered by the latest revision of ASME B16.9, ASME B16.11, MSS SP-79, MSS SP-83, MSS SP-95, and MSS SP-97. Fittings differing from these ASME and MSS standards shall be furnished in accordance with Supplementary Requirement S58 of Specification A960/A960M. These fittings are for use in pressure piping and pressure vessel service at low temperatures.
- 1.2 Optional supplementary requirements are provided for fittings where a greater degree of examination is desired. When desired, one or more of these supplementary requirements shall be specified in the order.
- 1.3 This specification is expressed in both inch-pound units and in SI units. However, unless the order specifies the applicable "M" specification designation (SI units), the material shall be furnished to inch-pound units.
- 1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
- 1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 In addition to those Referenced Documents listed in Specification A960/A960M, the following list of standards apply to this specification.

2.2 ASTM Standards:

A350/A350M Specification for Carbon and Low-Alloy Steel Forgings, Requiring Notch Toughness Testing for Piping Components

A370 Test Methods and Definitions for Mechanical Testing of Steel Products

A960/A960M Specification for Common Requirements for Wrought Steel Piping Fittings

A1058 Test Methods for Mechanical Testing of Steel Products—Metric

2.3 ASME Standards:

B16.9 Factory-Made Wrought Steel Butt-Welding Fittings B16.11 Forged Steel Fittings, Socket-Welding Threaded

2.4 ASME Boiler and Pressure Vessel Code:

Section III

Section VIII Division 1, Pressure Vessels

Section IX

2.5 MSS Standards:

MSS SP-25 Standard Marking System for Valves, Fittings, Flanges, and Unions

MSS SP-79 Socket Welding Reducer Inserts

MSS SP-83 Steel Pipe Unions, Socket-Welding and

MSS SP-95 Swage(d) Nipples and Bull Plugs

MSS SP-97 Integrally Reinforced Forged Branch Outlet Fittings—Socket Welding, Threaded and Buttwelding Ends

TABLE 1 Chemical Requirements

Note 1—All requirements are maximum unless otherwise indicated.

Note 2—Where an ellipsis (...) appears in this table, there is no requirement.

Grade ^A		Composition, %									
	С	Mn	Р	S	Si	Ni	Cr	Мо	Cu	Nb ^E	V
WPL6	0.30	0.50-1.35	0.035	0.040	0.15-0.40	0.40	0.30	0.12	0.40	0.02 ^B	0.08
WPL9	0.20	0.40-1.06	0.030	0.030		1.60-2.24			0.75 - 1.25		
WPL3 ^C	0.20	0.31-0.64	0.05	0.05	0.13-0.37	3.2-3.8					
WPL8 ^D	0.13	0.90	0.030	0.030	0.13-0.37	8.4-9.6					

A When fittings are of welded construction, the symbols above shall be supplemented by the letter "W".

2.6 ASNT Standards:

SNT-TC-1A Recommended Practice for Nondestructive Testing Personnel Qualification and Certification

3. Ordering Information

3.1 See Specification A960/A960M.

4. General Requirements

4.1 Product furnished to this specification shall conform to the requirements of Specification A960/A960M, including any supplementary requirements that are indicated in the purchase order. Failure to comply with the general requirements of Specification A960/A960M constitutes non-conformance with this specification. In case of conflict between the requirements of this specification and Specification A960/A960M, this specification shall prevail.

5. Material

5.1 The starting material for fittings shall be fully killed steel, consisting of forgings, bars, plates, sheet, and seamless or fusion welded tubular products with filler metal added and shall conform to the chemical requirements in Table 1. The steels shall be made using recognized melting practices necessary to produce steels that shall meet the impact requirements of this specification.

6. Manufacture

- 6.1 Forging or forming operations shall be performed by hammering, pressing, piercing, extruding, upsetting, working, bending, fusion-welding, or machining, or by a combination of two or more of these operations. The forming procedure shall be so applied that it will not produce injurious defects in the fittings.
- 6.2 All welds, including welds in tubular products from which fittings are made, shall be (I) made by welders, welding operators and welding procedures qualified under the provisions of ASME Section IX, (2) heat treated in accordance with Section 7 of this specification, and (3) nondestructively examined throughout the entire length of each weld in accordance with Section 15 of this specification. The radiography of welds

shall be done either prior to or after forming at option of manufacturer. Personnel performing NDE examinations shall be qualified in accordance with SNT-TC-1A.

- 6.3 The welded joints of the fittings shall be finished in accordance with the requirements of Paragraph UW-35 (a) of Section VIII, Division 1 of ASME Boiler and Pressure Vessel Code.
- 6.4 All butt-weld tees manufactured by cold-forming methods shall be liquid penetrant or magnetic particle examined by one of the methods specified in Supplementary Requirement S52 or S53 of Specification A960/A960M. This examination shall be performed after final heat treatment by NDE personnel qualified under the provisions of SNT-TC-1A. Only the sidewall areas of the tee need be examined. This area is defined by a circle that covers the area from the weld bevel of the branch outlet to the centerline of the body or run. Internal and external surfaces shall be examined when size permits accessibility. After the removal of any cracks, the tees shall be re-examined by the original method. Acceptable tees shall be marked with the symbol PT or MT, as applicable, to indicate compliance.
- 6.5 Stubends may be produced with the entire lap added by the welding of a ring, made from plate or bar of the same alloy grade and composition, to the outside of a straight section of pipe, provided the weld is double welded, is a full penetration joint, satisfies the requirements of 6.2 for qualifications and radiography and 7.1 for post weld heat treatment.

7. Heat Treatment

- 7.1 All fittings shall be furnished in the normalized, normalized and tempered, annealed, or quenched and tempered condition. All welding shall be completed prior to the austenitizing heat treatment.
- 7.2 The full thickness of the material from which impact test specimens are to be obtained shall be heat treated with a furnace charge as specified in 10.4.2 or 10.4.3.
- 7.3 After forming, the fittings shall be allowed to cool below the lower critical before applying one of the heat treatments listed in 7.1.
- 7.4 When specified in the order, the test specimens shall be subjected to a simulated post-weld heat treatment before testing. The simulated post-weld heat treatment used shall be

^B By agreement, the limit for niobium may be increased up to 0.05 % on heat analysis and 0.06 % on product analysis.

^C Fittings made from plate or forgings may have 0.90 % max manganese.

^D Fittings made from plate may have 0.98 % max manganese.

ENiobium and columbium are interchangeable names for the same element and both names are acceptable for use in A01.22 specifications.

as shown in Table 2, unless the purchaser has otherwise specified in the order.

8. Chemical Composition

- 8.1 The steel shall conform to requirements of chemical composition for the respective material prescribed in Table 1.
- 8.2 The steel shall not contain any unspecified elements for the ordered grade to the extent that it then conforms to the requirements of another grade for which that element is a specified element having a required minimum content.
- 8.3 The chemical composition of weld metal is not required to meet the same limits of the base materials however, the composition of the weld deposit shall be such that it meets the minimum mechanical and impact requirements of this specification. In general, the alloy content shall be similar to that of the base metal but shall not exceed 6 % except in the case of fittings of 9 % nickel steel.
 - 8.4 A product analysis is optional.

9. Tensile Properties

- 9.1 The tensile properties of the fittings material shall conform to the requirements for the applicable grade of material as listed in Table 3.
- 9.1.1 Longitudinal or transverse specimens cut from either a fitting or from starting plate or pipe they were manufactured from shall be acceptable for the tension test. For fittings made from forgings, the test specimen shall meet the requirements of Specification A350/A350M for the tension test.
- 9.1.2 While Table 3 specifies elongation requirements for both longitudinal and transverse specimens, it is not the intent that both requirements apply simultaneously. Instead, it is intended that only the elongation requirement that is appropriate for the specimen used be applicable. Unless specified by the customer, tensile test orientation is at the discretion of the manufacturer.
- 9.2 At least one tension test shall be made on each heat of material and in the same condition of heat treatment as the finished fittings it represents provided that the wall thickness of the fitting and the representative sample thickness do not vary more than ½ in. [6 mm]. At least one tension test per heat of weld metal shall be made after heat treatment in the same manner as the base metal. Results of the tension test of the weld metal need not be reported unless Supplementary Requirement S51 of Specification A960/A960M is specified.

TABLE 2 Post-Weld Heat Treatment

Grade	Metal Tem	perature	Minimum Holding Time
	°F	°C	
WPL6 WPL3 WPL8 WPL9 ^A	1100–1200 1100–1150 1050–1100 1025–1085	595–650 540–620 565–595 550–585	1 h/in. [25 mm] ¾ h min ¼ h/in. [25 mm] 1 h min ½ h/in. [25 mm] 1 h min 1 h/in. [25 mm] 2 h min

 A 2 in. [51 mm] thickness and over. The cooling rate shall not be less than 300 °F [150 °C] per hour down to a temperature of 600 °F [315 °C].

9.3 Records of the tension tests shall be certification that the material of the fitting meets the tensile requirements of this specification.

10. Impact Test Properties

10.1 Properties:

- 10.1.1 The notched bar impact properties of the base metal and weld metal shall conform to the requirements of Table 4 or Table 5 for the applicable grade of material.
- 10.1.2 Retest—When the average value of the three specimens equals or exceeds the minimum value permitted for a single specimen and the value for more than one specimen is below the required average value, or when the value for one specimen is below the minimum value permitted for a single specimen, a retest of three additional specimens shall be made. The value for each of these retest specimens shall equal or exceed the required average value. When an erratic result is caused by a defective specimen, or there is uncertainty in test procedure, a retest shall be allowed.

10.2 Procedures:

- 10.2.1 All material furnished under this specification shall be tested for impact resistance at the temperature for the respective grade in Table 6. Exceptions to these requirements are permissible when agreed upon between the purchaser and producer and specified in the order, in that the impact test is acceptable when made at temperatures different from those shown in Table 6, provided the test temperature is at least as low as the intended service temperature, and fittings are suitably marked in accordance with Section 19 to identify the reported test temperature.
- 10.2.2 The notched-bar impact test shall be made in accordance with the procedure for the simple-beam, Charpy-type test of Test Methods and Definitions A370 if the inch-pound units are specified or Test Methods A1058 if the M suffix (SI units) standard is specified. Each impact test shall consist of breaking three specimens.

10.3 Specimens:

- 10.3.1 Notched-bar impact specimens shall be simple-beam, Charpy-type A with a V-notch in accordance with Test Methods and Definitions A370 if the inch-pound units are specified or Test Methods A1058 if the M suffix (SI Units) standard is specified. Standard specimens 10 by 10 mm in cross section shall be used unless the material to be tested is of insufficient thickness, in which case the largest obtainable standard subsize impact specimens shall be used. When the size or shape of the finished fittings is insufficient to permit obtaining the smallest standard subsize impact specimens, an impact test by the fitting manufacturer will not be required. The material from which the specimens are taken shall be heat treated with a furnace charge in accordance with 10.4.2 or 10.4.3. Impact tests shall be made from either the raw material from which the fittings are made or from a finished fitting at the option of the manufacturer.
- 10.3.2 Test specimens shall be obtained so that the longitudinal axis of the specimen is parallel to the longitudinal axis of the fitting while the axis of the "V" shall be perpendicular to the surface. On wall thickness over 1 in. [25 mm] the specimens shall be obtained with their longitudinal axis located ½ in. [13 mm] from the outer surface.

TABLE 3 Tensile Requirements

Note 1—Where an ellipsis (. . .) appears in this table, there is no requirement.

Doguiroment	Grade					
Requirement	WPL6	WPL9	WPL3	WPL8		
Tensile strength, min ksi [MPa] Yield strength, min ksi [MPa]	60 [415] – 95 [655] 35 [240]	63 [435] – 88 [610] 46 [315]	65 [450] – 90 [620] 35 [240]	100 [690] – 125 [865] 75 [515]		

Florenties Descriptions				Gra	ades			
Elongation Requirements	WPL6		WPL9		WPL3		WPL8	
	Longi- tudinal	Trans- verse	Longi- tudinal	Trans- verse	Longi- tudinal	Trans- verse	Longi- tudinal	Trans- verse
Standard round specimen, or small proportional specimen, min % in 4 D	22	12	20		22	14	16	
Rectangular specimen for wall thickness 5/16 in. [7.94 mm] and over, and for all small sizes tested in full section; min % in 2 in. or 50 mm	30	16.5	28	18	30	20	22	
Rectangular specimen for wall thickness less than \$\frac{1}{6}\$ in. [7.94 mm]; min % in 2 in. or 50 mm (\frac{1}{2}\$-in. [12.7-mm] wide specimen)	Α	Α	Α	Α	Α	Α	Α	

^A For each ½ in. [0.79 mm] decrease in wall thickness below ½ in. [7.94 mm], a deduction of 1.5 % (grades WPL6, WPL9, and WPL3) or 1.25 % (WPL8) for longitudinal and 1.0 % (grades WPL6, WPL9 and WPL3) for transverse from the values shown above is permitted. The following table gives the minimum value for various wall thicknesses:

Wall Thic	kness	Grades							
		WF	PL6	WF	PL9	WF	PL3	WP	L8
in.	[mm]	Longi- tudinal	Trans- verse	Longi- tudinal	Trans- verse	Longi- tudinal	Trans- verse	Longi- tudinal	Trans- verse
5/16 (0.312)	[7.94]	30.0	16.5	28.0	18.0	30.0	20.0	22.0	
9/32 (0.281)	[7.14]	28.5	15.5	26.5	17.0	28.5	19.0	20.75	
1/4 (0.250)	[6.35]	27.0	14.5	25.0	16.0	27.0	18.0	19.5	
7/32 (0.219)	[5.56]	25.5		23.5		25.5		18.25	
3/16 (0.188)	[4.76]	24.0		22.0		24.0		17.0	
5/32 (0.156)	[3.97]	22.5		20.5		22.5		15.75	
1/8 (0.125)	[3.17]	21.0		19.0		21.0		14.5	
3/32 (0.094)	[2.38]	19.5		17.5		19.5		13.25	
1/16 (0.062)	[1.59]	18.0		16.0		18.0		12.0	

Note—The preceding table gives the computed minimum elongation value for each ½2 in. [0.79 mm] decrease in wall thickness. Where the wall thickness lies between two values above, the minimum elongation value is determined by the following equations:

Direction of Test		Equat	ions	
	WPL6	WPL9	WPL3	WPL8
Longitudinal	E = 48t + 15.00	48t + 13.00	E = 48t + 15.00	40t + 9.50
Transverse	t = 32t + 6.50	32t + 8.00	E = 32t + 10.00	• • •

where:

E = elongation in 2 in. or 50 mm, %, and t = actual thickness of specimen, in.

TABLE 4 Charpy Impact Requirements for WPL6, WPL9, and

		WPL3		
Size of Specimen, mm	Value Re Acceptance	Notch Impact equired for e (Average of pecimens)	Impact Va Requiring	harpy V-Notch alue Without Retest (One Only of a Set)
	ft⋅lbf	J	ft·lbf	J
10 by 10.0	13	17.6	10	13.6
10 by 7.5	10	13.6	8	10.8
10 by 5.0	7	9.5	5	7.0
10 by 2.5	4	5.4	3	4.1

^A Straight-line interpolation for intermediate values is permitted.

10.3.3 When testing welds, the notch of the specimen shall be in the welded joint and, where the diameter and wall thickness permit, the longitudinal axis of the specimen shall be

TABLE 5 Charpy Impact Requirements for WPL8

Size of Specimen, mm	Charpy V-Notch Impact Value Required for Acceptance (Average of Specimens)		Minimum Charpy V-Notch Impact Value Without Requiring Retest (One Specimen Only of a Set)		
	ft⋅lbf	J	ft⋅lbf	J	
10 by 10.0	25.0	33.9	20.0	27.1	
10 by 7.5	21.0	28.5	17.0	23.1	
10 by 5.0	17.0	23.1	14.0	19.0	
10 by 2.5	8.0	10.8	6.0	8.1	

transverse to the longitudinal axis of the weld. The axis of the notch shall be perpendicular to the surface.

10.4 Number of Tests:

TABLE 6 Impact Test Temperature

(Grade	Impact Test Temperature, °F [°C]
WPL6		-50 [-45]
WPL9		-100 [-75]
WPL3		-150 [-100]
WPL8		-320 [- 195]

- 10.4.1 A notched-bar impact test, consisting of breaking three specimens shall be made. Each test shall represent only such fittings from a heat that do not vary from the thickness of the material from which the test specimens are taken by more than $\frac{1}{4}$ in. [6 mm].
- 10.4.2 When heat treatment is performed in furnaces not equipped with calibrated recording pyrometers, one impact test shall be made for each heat in each heat-treatment load. Test specimens shall be included with each furnace charge. If this heat treatment is conducted in continuous-type furnaces not equipped with calibrated recording pyrometers, then one test per heat shall be conducted for each 5000 lb or 2550 kg (or less) of product.
- 10.4.3 When heat treatment is performed in furnaces controlled within a 50 °F [28 °C] range and equipped with calibrated recording pyrometers so that records of heat treatment are available, then one impact test from each heat is required, provided that all other heat treatments are conducted at the same temperatures and within the same 50 °F [28 °C] range as the furnace charge that contained the test specimens.
- 10.4.4 On fittings of welded construction, additional impact tests of the same number as required in 10.4.1 or 10.4.2 shall be made to test the weld metal.
- 10.4.5 Specimens showing defects while being machined or prior to testing shall be discarded, and replacements shall be considered as original specimens.

10.5 Retreatment:

10.5.1 If the results of impact tests conducted in accordance with 10.4.2 and 10.4.3 fail to conform to the test requirements specified in 10.1, that group of fittings shall be retreated and submitted for test. No group of fittings shall be retreated more than twice.

11. Hydrostatic Tests

- 11.1 Hydrostatic testing of fittings is not required by this specification.
- 11.2 All fittings shall be capable of withstanding without failure, leakage, or impairment of their serviceability, a hydrostatic test pressure equal to that prescribed for the specified matching pipe of equivalent material.

12. Dimensions

12.1 Butt-welding fittings and butt-welding short-radius elbows and returns purchased in accordance with this specification shall conform to the dimensions and tolerances given in the latest revision of ASME B16.9 or MSS SP-95. Steel socket-welding and threaded fittings purchased in accordance with this specification shall conform to the sizes, shapes, dimensions, and tolerances specified in the latest revision of ASME B16.11, MSS SP-79, or MSS SP-83. Swage(d) Nipples,

Bull Plugs, and Integrally Reinforced Forged Branch Outlet Fittings purchased in accordance with this specification shall conform to the sizes, shapes, dimensions, and tolerances specified in the latest revision of MSS SP-95 or MSS SP-97.

12.2 Fittings of size or shape differing from these standards, but meeting all other requirements of the specification, shall be furnished in accordance with Supplementary Requirement S58 of Specification A960/A960M only by agreement with the purchaser.

13. Surface Finish, Appearance, and Corrosion Protection

13.1 The requirements of Specification A960/A960M apply.

14. Repair by Welding

- 14.1 The requirements of Specification A960/A960M apply except as follows:
- 14.1.1 Repair welding, by the manufacturer, is permissible for parts made to dimensional standards such as those of ASME or equivalent standards.
- 14.1.2 Prior approval of the purchaser shall be required to weld repair special parts made to the purchaser's dimensional requirements.
- 14.1.3 Welding shall be accomplished with a weld procedure designed to produce low hydrogen in the weldment. Short circuit gas metal arc welding is permissible only with the approval of the purchaser.
- 14.1.4 The weld repair shall be permanently identified with the welder's stamp or symbol in accordance with Section IX of the ASME Boiler and Pressure Vessel Code.
- 14.1.5 After weld repair, material shall be heat treated in accordance with 7.1.
- 14.1.6 Tension and impact testing of representative deposited weld metal for each heat shall meet the requirements of 9.2 and 10.1.

15. Radiographic Examination

15.1 All fusion-welded butt joints shall be radiographically examined throughout the entire length in accordance with Paragraph UW-51 of Section VIII, Division 1, of the ASME Boiler and Pressure Vessel Code. Instead of radiographic examination, welds made by the manufacturer may be ultrasonically examined in accordance with Appendix 12 of Section VIII, Division 1, of the ASME Boiler and Pressure Vessel Code. In general, radiography or ultrasonic examination shall be performed after all forming operations have been completed. Fittings made from fusion-welded pipe need not be radiographed if the pipe has been radiographed, provided the fitting forming process does not materially affect the weld.

16. Inspection

- 16.1 All tests and inspections shall be made at the place of manufacture, unless otherwise agreed to.
- 16.2 Other tests, when required by agreement shall be made from materials of the lots covered in the order.

17. Rejection and Rehearing

- 17.1 Material that fails to conform to the requirements of this specification shall be rejected. Rejection should be reported to the producer or supplier promptly and in writing. In case of dissatisfaction with the results of the test, the producer or supplier shall make claim for a rehearing.
- 17.2 Fittings that develop defects in shop working or application operations shall be rejected. Upon rejection, the manufacturer shall be notified promptly in writing.

18. Certification

- 18.1 Test reports are required for all fittings covered by this specification. Each test report shall meet the requirements for certification in Specification A960/A960M as well as include the following information specific to this specification:
- 18.1.1 Chemical analysis results, Section 8 (Table 1), reported results shall be to the same number of significant figures as the limits specified in Table 1 for that element,
- 18.1.2 Tensile property results, Section 9 (Table 3) report yield strength and tensile strength in ksi [MPa] and elongation in percent, and tensile test orientation,
 - 18.1.3 Impact test results, Section 10 (Table 4 and Table 5),
 - 18.1.4 Type heat treatment, Section 7,
- 18.1.5 Statement regarding radiographic or ultrasonic examination of welds, Section 15, and
- 18.1.6 Any supplementary testing required by the purchase order.

19. Product Marking

19.1 In addition to marking requirements of Specification A960/A960M, the following additional marking requirements shall apply:

- 19.1.1 Fittings shall be marked by any method which will identify the fittings and not result in sharp discontinuities. Stamping, when used, shall be done with blunt-nosed continuous or blunt-nosed interrupted dot stamps.
- 19.1.2 When agreed upon between the purchaser and producer, and specified in the order, the markings shall be painted or stenciled on the fitting or stamped on a metal or plastic tag which shall be securely attached to the fitting.
- 19.1.3 Fittings containing welds that have been ultrasonically examined instead of radiography shall be marked U after heat identity.
- 19.1.4 Threaded or socket welding fittings shall be marked with the pressure class. Plugs and bushings furnished to ASME B16.11 requirements are not required to be marked.
- 19.1.5 The impact test temperature shall also be shown if it is different from the standard test temperature specified in Table 6, for example: WPL-6-60 or WPL3-176.
- 19.2 Bar Coding—In addition to the requirements in 19.1, bar coding is acceptable as a supplemental identification method. The purchaser may specify in the order a specific bar coding system to be used. The bar coding system, if applied at the discretion of the supplier, should be consistent with one of the published industry standards for bar coding. If used on small fittings, the bar code may be applied to the box or a substantially applied tag.

20. Keywords

20.1 pipe fittings; piping applications; pressure containing parts; pressure vessel service; temperature service applications, low

SUPPLEMENTARY REQUIREMENTS

One or more of the supplementary requirements appearing in Specification A960/A960M may be included in the order or contract. When so included, a supplementary requirement shall have the same force as if it were in the body of the specification. Supplementary requirement details not fully described shall be agreed upon between the purchaser and the supplier.

S1. ASME Section III Construction

- S1.1 Products welded with filler metal furnished under this specification that are intended for application under the rules of Section III of the ASME Boiler and Pressure Vessel Code shall be manufactured by holders of the appropriate ASME Certificate of Authorization and Certification Mark. The product is subject to all applicable requirements of Section III, including welding, heat treatment, nondestructive examination, authorized inspection at the point of manufacture, and application of the Certification Mark.
- S1.2 The applicable ASME Partial Data Report form, signed by an Authorized Nuclear Inspector, and a material test report shall be furnished for each lot of pipe.
- S1.3 The material used to fabricate the pipe fitting shall conform to the applicable SA specification in ASME Boiler and Pressure Vessel Code, Section II. The welded joints shall be full penetration butt welds as obtained by double welding or by other means that will obtain the same quality of deposited weld metal on the inside and outside. Welds using metal backing strips that remain in place are prohibited.
- S1.4 Each piece of pipe fitting shall be so marked as to identify each such piece of pipe fitting with the lot and the material test report.



SPECIFICATION FOR SEAMLESS AND ELECTRIC-WELDED LOW-ALLOY STEEL TUBES



SA-423/SA-423M



(23)

(Identical with ASTM Specification A423/A423M-19.)

Specification for Seamless and Electric-Welded Low-Alloy Steel Tubes

1. Scope

- 1.1 This specification covers minimum-wall-thickness, low-alloy steel tubes for pressure containing parts such as economizers or other applications where corrosion resistance is important.
- 1.2 The tubing sizes and thicknesses usually furnished to this specification are $\frac{1}{2}$ to 5 in. [12.7 to 127 mm] in outside diameter and 0.035 to 0.500 in. [0.9 to 12.7 mm] inclusive, in minimum wall thickness. Tubing having other dimensions may be furnished, provided such tubes comply with all other requirements of this specification.
- 1.3 Mechanical property requirements do not apply to tubing smaller than $\frac{1}{4}$ in. [3.2 mm] in inside diameter or 0.015 in. [0.4 mm] in thickness.
- 1.4 This specification covers three grades, two types, and two manufacture finishes:
- 1.4.1 Grades 1, 2, and 3 are identified in Table 1 (Chemical Requirements), and Table 3 (Tensile Requirements),
 - 1.4.2 Type (seamless or electric-resistance welded),
 - 1.4.3 Manufacture (hot finished or cold finished).
- 1.5 Optional supplementary requirements S1 and S2 are provided and, when desired, shall be so stated in the order.
- 1.6 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation of this specification is specified in the order.
- 1.7 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recom-

mendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A450/A450M Specification for General Requirements for Carbon and Low Alloy Steel Tubes
- E213 Practice for Ultrasonic Testing of Metal Pipe and Tubing
- E273 Practice for Ultrasonic Testing of the Weld Zone of Welded Pipe and Tubing

3. Ordering Information

- 3.1 Orders for material under this specification shall include the following, as required, to describe the desired material adequately:
 - 3.1.1 Quantity (feet, metres, or number of lengths),
- 3.1.2 Type of material (seamless or electric-resistance-welded tubes),
 - 3.1.3 Grade 1, 2, or 3 (Table 1 and Table 3),
 - 3.1.4 Manufacture (hot finished or cold finished),
 - 3.1.5 Size (outside diameter and minimum wall thickness),
 - 3.1.6 Length (specific or random),
- 3.1.7 Required test options (hydrostatic or electric test, 11.7),
- 3.1.8 Test report required (see Certification Section of Specification A450/A450M),
- 3.1.9 Specification designation (including year of issue), and
- 3.1.10 Special requirements and any supplementary requirements selected.

4. Manufacture

4.1 Tubes made by the seamless process may be hot finished or cold finished.

5. Heat Treatment

5.1 All tubes shall be normalized or given such heat treatment as may be necessary to conform to the requirements of this specification.

TABLE 1 Chemical Requirements

	Compos		
	Grade 1	Grade 2	Grade 3
Carbon, max	0.15	0.15	0.06
Manganese	0.55 max	0.50-1.00	0.70-1.40
Phosphorus	0.06-0.16	0.04 max	0.020 max
Sulfur, max	0.060	0.05	0.020
Silicon	0.10 min		0.55 max
Copper	0.20-0.60	0.30-1.00	0.25-0.45
Chromium	0.24-1.31		
Nickel	0.20-0.70	0.40-1.10	0.50 max
Molybdenum		0.10 min	0.20 max
Antimony			0.05-0.15

TABLE 3 Tensile Requirements

	Grades 1 and 2	Grade 3
Tensile strength, min, ksi [MPa]	60 [415]	55 [380]
Yield strength, min, ksi [MPa]	37 [255]	33 [230]
Elongation in 2 in. or 50 mm, min, %	25	35
For longitudinal strip tests a deduction for each ½2 in. [0.8 mm] decrease in wall thickness below ½6 in. [8 mm] from the basic minimum elongation of the following percentage points shall be made	1.25 ^A	1.25 ^A

^A Calculated elongation requirements shall be rounded to the nearest whole number.

6. Chemical Composition

6.1 The steel shall conform to the requirements as to chemical composition prescribed in Table 1.

7. Product Analysis

- 7.1 An analysis of either one billet, one length of flat-rolled stock or one tube shall be made from each heat. The chemical composition thus determined shall conform to the requirements specified.
- 7.2 If the original test for product analysis fails, retests of two additional billets, lengths of flat-rolled stock, or tubes shall be made. Both retests, for the elements in question shall meet the requirements of the specification; otherwise all remaining material in the heat or lot (Note 1) shall be rejected or, at the option of the producer, each billet, length of flat-rolled stock or tube may be individually tested for acceptance. Billets, lengths of flat-rolled stock or tubes which do not meet the requirements of the specification shall be rejected.

Note 1—For flattening, flaring, and flange requirements, the term *lot* applies to all tubes prior to cutting of the same nominal size and wall thickness that are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of the same size and from the same heat which are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace the number of tubes of the same size and from the same heat in a lot shall be determined from the size of the tubes as prescribed in Table 2.

Note 2—For tensile and hardness test requirements, the term *lot* applies to all tubes prior to cutting, of the same nominal diameter and wall thickness that are produced from the same heat of steel. When final heat treatment is in a batch-type furnace, a lot shall include only those tubes of

TABLE 2 Number of Tubes in a Lot Heat Treated by the Continuous Process

Continuous Frocess	
Size of Tube	Size of Lot
2 in. [50.8 mm] and over in outside diameter and 0.200 in. [5.1 mm] and over in wall thickness Less than 2 in. [50.8 mm] but over 1 in. [25.4 mm] in outside diameter or over 1 in. [25.4 mm] in outside diameter and under 0.200 in. [5.1 mm] in wall thickness	not more than 50 tubes not more than 75 tubes
1 in. [25.4 mm] or less in outside diameter	not more than 125 tubes

the same size and the same heat which are heat treated in the same furnace charge. When the final heat treatment is in a continuous furnace, a lot shall include all tubes of the same size and heat, heat treated in the same furnace at the same temperature, time at heat, and furnace speed.

8. Tensile Requirements

8.1 The material shall conform to the requirements as to tensile properties prescribed in Table 3.

9. Hardness Requirements

9.1 The tubes shall have a hardness number not exceeding 170 HBW or 87 HRBW.

10. Forming Operations

10.1 Tubes when inserted in the boiler shall stand expanding and beading without showing cracks or flaws.

11. Mechanical Tests Required

- 11.1 *Tension Test*—One tension test shall be made on a specimen for lots of not more than 50 tubes. Tension tests shall be made on specimens from two tubes for lots of more than 50 tubes (Note 2).
- 11.2 Flattening Test—One flattening test shall be made on specimens from each end of one finished tube, not the one used for the flaring or flanging test, from each lot (Note 1).
- 11.3 Flaring Test (Seamless Tubes)—One flaring test shall be made on specimens from each end of one finished tube, not the one used for the flattening test, from each lot (Note 1).
- 11.4 Flange Test (Welded Tubes)—One flange test shall be made on specimens from each end of one finished tube, not the one used for the flattening test, from each lot (Note 1).
- 11.5 *Hardness Test*—Brinell or Rockwell hardness tests shall be made on specimens from two tubes from each lot (Note 2).
- 11.6 Reverse Flattening Test—For welded tubes, one reverse flattening test shall be made on a specimen from each 1500 ft [460 m] of finished tubing.
- 11.7 Hydrostatic or Nondestructive Electric Test—Each tube shall be subjected to the hydrostatic test, or, instead of this test, a nondestructive electric test may be used when specified by the purchaser.

12. General Requirements

12.1 Material furnished under this specification should conform to the applicable requirements of the current edition of Specification A450/A450M, unless otherwise provided herein.

13. Product Marking

13.1 In addition to the marking prescribed in Specification A450/A450M, the marking shall include whether hot finished or cold finished, and whether seamless or welded.

14. Keywords

14.1 seamless steel tube; steel tube; alloy; welded steel tube

SUPPLEMENTARY REQUIREMENTS

S1. Surface Condition

S1.1 If pickling or shot blasting, or both, are required, this shall be specifically stated in the order and shall be done at the purchaser's expense. Pickling or shot blasting shall apply only when specified by the purchaser in the inquiry, contract, or order. Details of this supplementary requirement shall be agreed upon by the manufacturer and the purchaser.

S2. Additional Testing of Welded Tubing per ASME Request

- S2.1 Each tube shall be subjected to an ultrasonic inspection employing Practices E273 or E213 with the rejection criteria referenced in Specification A450/A450M.
- S2.2 If Practice E273 is employed, a $100\,\%$ volumetric inspection of the entire length of each tube shall also be performed using one of the non-destructive electric tests permitted by Specification A450/A450M.

- S2.3 The test methods described in the supplement may not be capable of inspecting the end portions of tubes. This condition is referred to as end effect. This portion, as determined by the manufacturer, shall be removed and discarded.
- S2.4 In addition to the marking prescribed in Specification A450/A450M, "S2" shall be added after the grade designation.
- S2.5 Additional Testing of Welded Tubing shall have been specified in the inquiry or invitation to bid, and purchase order or contract. The requirements shall not be considered unless specified in the order and the necessary tests shall be made at the mill.

SPECIFICATION FOR CENTRIFUGALLY CAST FERRITIC ALLOY STEEL PIPE FOR HIGH-TEMPERATURE SERVICE



SA-426/SA-426M



(Identical with ASTM Specification A426/A426M-13.)

Standard Specification for Centrifugally Cast Ferritic Alloy Steel Pipe for High-Temperature Service

1. Scope

- 1.1 This specification covers centrifugally cast alloy steel pipe intended for use in high-temperature, high-pressure service.
- 1.2 Several grades of ferritic steels are covered. Their compositions are given in Table 1.
- 1.3 Supplementary Requirements S1 through S12 are provided. The supplementary requirements provide for additional tests of an optional nature and when desired shall be so stated in the order (Section 4).
- 1.4 The values stated in either inch-pound units or SI units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.
 - 1.4.1 Within the text, the SI units are shown in brackets.
- 1.5 This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.

2. Referenced Documents

2.1 ASTM Standards:

A370 Test Methods and Definitions for Mechanical Testing of Steel Products

A609/A609M Practice for Castings, Carbon, Low-Alloy, and Martensitic Stainless Steel, Ultrasonic Examination Thereof

- A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys
- A999/A999M Specification for General Requirements for Alloy and Stainless Steel Pipe

E94 Guide for Radiographic Examination

- E165 Practice for Liquid Penetrant Examination for General Industry
- E186 Reference Radiographs for Heavy-Walled (2 to 4½-in. (50.8 to 114-mm)) Steel Castings
- E208 Test Method for Conducting Drop-Weight Test to Determine Nil-Ductility Transition Temperature of Ferritic Steels
- E280 Reference Radiographs for Heavy-Walled (4½ to 12-in. (114 to 305-mm)) Steel Castings
- E446 Reference Radiographs for Steel Castings Up to 2 in. (50.8 mm) in Thickness

E709 Guide for Magnetic Particle Testing

2.2 ANSI Standard:

B46.1 Surface Texture

2.3 ASME Boiler and Pressure Vessel Code: Section IX Welding and Brazing Qualifications

3. Ordering Information

- 3.1 Orders for material under this specification shall include the following, as required, to describe the desired material adequately:
 - 3.1.1 Quantity (feet, centimetres, or number of lengths),
 - 3.1.2 Name of material (centrifugally cast pipe),
 - 3.1.3 Specification number,
 - 3.1.4 Grade (Table 1),
- 3.1.5 Size (outside or inside diameter and minimum wall thickness),
- 3.1.6 Length (specific or random) (Section on Permissible Variations in Length of Specification A999/A999M),
- 3.1.7 End finish (Section on Ends of Specification A999/A999M),

TABLE 1 Chemical Requirements^A

				Composition, %				
Grade	UNS Number	Carbon	Manganese	Phos- phorus, max	Sulfur, max	Silicon	Chromium	Molybdenum
CP1	J12521	0.25 max	0.30-0.80	0.030	0.025	0.10-0.50		0.44-0.65
CP2	J11547	0.10-0.20	0.30-0.61	0.030	0.025	0.10-0.50	0.50-0.81	0.44-0.65
CP5	J42045	0.20 max	0.30-0.70	0.030	0.025	0.75 max	4.00-6.50	0.45-0.65
CP5b	J51545	0.15 max	0.30-0.60	0.030	0.025	1.00-2.00	4.00-6.00	0.45-0.65
CP9	J82090	0.20 max	0.30-0.65	0.030	0.025	0.25-1.00	8.00-10.00	0.90-1.20
CP11	J12072	0.05-0.20	0.30-0.80	0.030	0.025	0.60 max	1.00-1.50	0.44-0.65
CP12	J11562	0.05-0.15	0.30-0.61	0.030	0.025	0.50 max	0.80-1.25	0.44-0.65
CP15	J11522	0.15 max	0.30-0.60	0.030	0.025	1.15-1.65		0.44-0.65
CP21	J31545	0.05-0.15	0.30-0.60	0.030	0.025	0.50 max	2.65-3.35	0.80-1.06
CP22	J21890	0.05-0.15	0.30-0.70	0.030	0.025	0.60 max	2.00-2.75	0.90-1.20
CPCA15	J91150	0.15	1.00	0.030	0.025	1.50	11.5-14.0	0.50
		max	max			max		max

A Where ellipses appear in this table, there is no requirement.

- 3.1.8 Optional Requirements S1 through S12 and Section 14.1
- 3.1.9 Test report required (Section on Certified Test Report of Specification A999/A999M),
- 3.1.10 Service temperature if over 1000°F [540°C] (Note 1), and
- 3.1.11 Special requirements or additions to specification.

4. General Requirements for Delivery

4.1 Material furnished under this specification shall conform to the applicable requirements of the current edition of Specification A999/A999M unless otherwise provided herein.

5. Materials and Manufacture

- 5.1 *Heat-Treatment*—The pipe shall be furnished in the austenitized and tempered condition (Note 1) according to the requirements of Table 2.
- 5.1.1 Heat treatment shall be performed after the pipe has been allowed to cool below the transformation range. Definition of heat-treatment terms shall be as given in Terminology A941.

Note 1—It is recommended that the temperature for tempering should be at least $100^{\circ}F$ [55°C] above the intended service temperature. The purchaser shall advise the manufacturer of the service temperature when it is over $1000^{\circ}F$ [540°C]. (See 3.1.10.)

5.2~Machining—The pipe shall be machined on the inner and outer surfaces to a roughness value no greater than 250 μ in. [6.35 μ m] arithmetical average deviation (AA) from the mean line unless otherwise specified as in ANSI B46.1.

6. Chemical Analysis

6.1 *Heat Analysis*—An analysis of each heat shall be made by the manufacturer to determine the percentages of elements specified in Table 1. The analysis shall be made on a test

sample taken preferable during the pouring of the heat. The chemical composition thus determined shall conform to the requirements specified in Table 1.

6.2 *Product Analysis*—A product analysis may be made by the purchaser. The sample for analysis shall be selected so as to be representative of the pipe being analyzed. The chemical composition thus determined shall conform to the requirements of Table 1.

7. Tensile and Hardness Requirements

7.1 Steel used for the castings shall conform to the tensile and hardness requirements specified in Table 3.

8. Permissible Variations in Dimensions

8.1 *Thickness*—The wall thickness shall not vary over that specified by more than ½ in. [3 mm]. There shall be no variation under the specified wall thickness.

9. Number of Tests

- 9.1 One tension and one hardness test shall be made from each heat.
- 9.2 If a specimen is machined improperly or if flaws are revealed by machining or during testing, the specimen may be discarded and another substituted from the same heat.

10. Retests

10.1 If the results of the mechanical tests for any heat do not conform to the requirements specified, the castings may be reheat-treated and retested, but may not be re-austenitized more than twice.

11. Test Specimens

11.1 Test coupons from which tension test specimens are prepared shall be removed from heat-treated casting prolongations.

TABLE 2 Heat Treatment Requirements

TABLE 2 Heat Treatment Requirements							
Grade	Austenitizing Treatment	Tempering Temperature, min, unless a range is shown, °F [°C]					
CP1	Normalized or Liquid Quenched	1100 [595]					
CP2	Normalized or Liquid Quenched	1100 [595]					
CP5	Normalized or Liquid Quenched	1250 [675]					
CP5b	Normalized or Liquid Quenched	1250 [675]					
CP9	Normalized or Liquid Quenched	1250 [675]					
CP11	Normalized or Liquid Quenched	1100 [595]					
CP12	Normalized or Liquid Quenched	1100 [595]					
CP15	Normalized or Liquid Quenched	1100 [595]					
CP21	Normalized or Liquid Quenched	1250 [675]					
CP22	Normalized or Liquid Quenched	1250 [675]					
CPCA15	Normalized or Liquid Quenched	1250 [675]					

- 11.2 When agreed upon between the manufacturer and the purchaser, test coupons from which test specimens are prepared shall be cast attached to separate blocks from the same heat as the casting represented. The test blocks shall be heat treated in the same manner as the casting represented.
- 11.3 Tension test specimens shall be machined to the form and dimensions of the standard round 2-in. [50-mm] gage length specimens shown in Fig. 6 of Test Methods and Definitions A370.

12. Hydrostatic Test

- 12.1 Each length of pipe shall be hydrostatically tested in accordance with Specification A999/A999M.
- 12.2 When agreed to between the manufacturer and the purchaser and so stated in the order, the hydrostatic test may be deferred and shall be performed later by the purchaser. Pipe furnished without the hydrostatic test shall include with the

TABLE 3 Tensile Properties and Hardness Requirements

Tensile strength, min:	psi [MPa]
Grade CP1	65 000 [450]
Grades CP11, CP22	70 000 [485]
Grades CP5, CP9, CPCA15	90 000 [620]
All other grades	60 000 [415]
Yield strength, min:	psi [MPa]
Grade CP1	35 000 [240]
Grades CP11, CP22	40 000 [275]
Grades CP5, CP9	60 000 [415]
Grade CPCA15	65 000 [450]
All other grades	30 000 [205]
Elongation, min:	% ^A
Grade CP1	24
Grades CP11, CP22	20
Grades CP5, CP9, CPCA15	18
All other grades	22
Reduction of area, min:	%
Grades CP1, CP2, CP11, CP12, CP15,	35
CP21, CP22, CP5, CP5b, CP7, CP9	
Grade CPCA15	30
Hardness:	HBW
Grades CP5, CP5b, CP9, CPCA15, max	225
All other grades, max	201

 $^{^{\}rm A}$ Elongation in 2 in. [50 mm] using a standard round specimen, in either the transverse or longitudinal direction.

mandatory marking the letters "NH." The manufacturer is responsible for the satisfactory performance of the casting when it is tested.

12.3 When certification is required by the purchaser and the hydrostatic test has been omitted, the certification shall clearly state "not hydrostatically tested." The specification number and material grade shown on the certification shall be followed by the letters "NH."

13. Visual Inspection

13.1 The surface of the casting shall be free from cracks and hot tears as determined by visual examination. Other surface imperfections shall be judged in accordance with visual acceptance criteria which may be specified in the order.

14. Rework and Retreatment

- 14.1 Defects as defined in Section 13 shall be removed and their removal verified by visual inspection of the resultant cavities. Defects that are located by inspecting with supplementary requirements S6, S7, S8, or S9 shall be removed or reduced to an acceptable size.
- 14.2 If removal of the defect does not infringe upon the minimum wall thickness, the depression may be blended uniformly into the surrounding surface.
- 14.3 If the cavity resulting from defect removal infringes upon the minimum wall thickness, weld repair is permitted subject to the purchaser's approval. The composition of the weld rod used shall be suitable for the composition of the metal being welded.
- 14.3.1 Only welders and procedures qualified in accordance with *ASME Boiler and Pressure Vessel Code*, Section IX, shall be used. All repair welds will be inspected to the same quality standards used to inspect the casting.
- 14.4 Local or full heat treatment in accordance with tempering temperatures specified in 5.1 shall follow welding.

15. Rejection

15.1 Each length of pipe received from the manufacturer may be inspected by the purchaser and, if it does not meet the requirements of the specification based on the inspection and test method as outlined in the specification, the pipe may be rejected and the manufacturer shall be notified. Disposition of rejected pipe shall be a matter of agreement between the manufacturer and the purchaser.

16. Product Marking

16.1 Each length of pipe shall be legibly marked with the manufacturer's name or brand, the specification number and

grade. In addition, heat numbers or serial numbers that are traceable to heat numbers shall be marked on each length of pipe.

17. Keywords

17.1 alloy steel; centrifugal; ferritic; high-temperature service; pipe; stainless steel; steel castings

SUPPLEMENTARY REQUIREMENTS

Supplementary requirements shall be applied only when specified by the purchaser. Details of the supplementary requirements shall be agreed upon between the manufacturer and purchaser. The specified tests shall be performed by the manufacturer prior to shipment of the castings.

S1. Additional Tension Tests

S1.1 Additional tension tests shall be made at a temperature to be specified by the customer, and the properties to be met are a matter of agreement between the purchaser and manufacturer.

S2. Flattening Test

S2.1 The flattening test shall be made on specimens from one or both ends of each length of pipe. If the specimen from any end of any length fails to conform to the requirements of Specification A999/A999M, that length shall be rejected.

S3. Photomicrographs

S3.1 The manufacturer shall furnish one photomicrograph at 100 diameters from one specimen of as-finished pipe from each heat in each heat-treatment lot. Such photomicrographs shall be suitable identified as to pipe size, wall thickness, and heat. Such photomicrographs are for information only, to show the actual metal structure of the pipe as furnished. No photomicrographs for the individual pieces purchased shall be required except as specified in Section S4.

S4. Photomicrographs for Individual Pieces

S4.1 The manufacturer shall furnish photomicrographs from one or both ends of each pipe. All photomicrographs required shall be properly identified as to heat number, size, and wall thickness of pipe from which the section was taken. Photomicrographs shall be further identified to permit association of each photomicrograph with the individual length of pipe it represents.

S5. Metal Structure and Etching Tests

S5.1 Etching tests shall be made on transverse sections from the pipe and shall reveal the macrostructure of the material. Such tests are for information only.

S6. Radiographic Examination

S6.1 The castings shall be examined for internal defects by means of X rays or gamma rays. The inspection procedure shall be in accordance with Guide E94 and the types and degrees of discontinuities considered shall be judged by Reference Radiographs E186, E280, or E446. The extent of the examination and the basis for acceptance shall be subject to agreement between the manufacturer and the purchaser.

S7. Liquid Penetrant Examination

S7.1 The castings shall be examined for surface discontinuities by means of liquid penetrant inspection. The method of performing the liquid penetrant test shall be in accordance with Practice E165. The areas to be inspected, the methods and types of liquid penetrants to be used, the developing procedure, and the basis for acceptance shall be as specified on the inquiry or invitation to bid and on the purchase order or contract or both, or as agreed upon between the manufacturer and purchaser.

S8. Magnetic Particle Inspection

S8.1 The castings shall be examined by magnetic particle inspection. The inspection procedure used shall be in accordance with Practice E709. The extent of examination and the basis for acceptance shall be subject to agreement between the manufacturer and the purchaser.

S9. Ultrasonic Inspection

S9.1 The castings shall be examined ultrasonically in accordance with Practice A609/A609M. The extent of the examination and the basis of acceptance shall be subject to agreement between the manufacturer and the purchaser.

S10. Residual Elements

S10.1 An analysis for the elements specified in Table S1.1 shall be included in those analyses specified in Section 6. The chemical composition thus determined shall conform to the requirements of Table S1.1.

TABLE S1.1 Residual Elements

Grade	Copper, max	Nickel, max	Chromium, max	Tungsten, max	Total Contents of These Unspecified Elements, max, %
CP1	0.50	0.50	0.35	0.10	1.00
CP2	0.50	0.50		0.10	1.00
CP5	0.50	0.50		0.10	1.00
CP5b	0.50	0.50		0.10	1.00
CP7	0.50	0.50		0.10	1.00
CP9	0.50	0.50		0.10	1.00
CP11	0.50	0.50		0.10	1.00
CP12	0.50	0.50		0.10	1.00
CP15	0.50	0.50	0.35	0.10	1.00
CP21	0.50	0.50		0.10	1.00
CP22	0.50	0.50		0.10	1.00
CPCA15	0.50	1.00		0.10	1.50

S11. Charpy Impact Test

S11.1 Charpy impact test properties shall be determined on each heat from a set of three Charpy V-notch specimens. The test coupons shall be taken as specified for tension specimens in Section 11 and tested at a test temperature agreed upon by the manufacturer and purchaser. The acceptance requirements shall be either energy absorbed or lateral expansion or percent

shear area, and shall be that agreed upon by the manufacturer and purchaser. Test specimens shall be prepared as Type A and tested in accordance with Test Methods and Definitions A370.

S11.2 Absorbed Energy Value, of three specimens shall not be less than that agreed upon by the manufacturer and purchaser, with no more than one value permitted below the minimum average specified and no value permitted below the minimum specified for a single specimen.

S11.3 *Lateral Expansion Value*, shall be agreed upon by the manufacturer and purchaser.

S11.4 Percent Shear Area, shall be agreed upon by the manufacturer and purchaser.

S12. Drop Weight Test

S12.1 Drop weight test properties shall be determined by preparing and testing either Type P1, P2, or P3 specimens in accordance with Test Method E208. The test coupons shall be taken as specified for tension specimens in Section 11. The crack starter weld shall be deposited on the surface of the specimen which was nearest to the casting surface. Each test shall consist of at least two specimens tested at a temperature agreed upon by the manufacturer and purchaser. Each specimen shall exhibit a "no break" performance.

SPECIFICATION FOR STAINLESS AND ALLOY-STEEL TURBINE-TYPE BOLTING SPECIALLY HEAT TREATED FOR HIGH-TEMPERATURE SERVICE



SA-437/SA-437M



(23)

(Identical with ASTM Specification A437/A437M-15(2021).)

Specification for Stainless and Alloy-Steel Turbine-Type Bolting Specially Heat Treated for High-Temperature Service

1. Scope

- 1.1 This specification covers stainless and alloy-steel bolting material and bolting components specially heat treated for high-temperature service, such as steam turbine, gas turbine, and similar uses. See Specification A962/A962M for the definition of bolting. This material requires special processing and should not be used in general-purpose applications. Bolting furnished as bars shall be hot wrought and may be further processed by centerless grinding or by cold drawing.
- 1.2 The high-temperature properties of the bolting materials and components covered by this specification are dependent upon special heat treatment, which is required. Although the high-temperature properties are not specified, they are implied by control of the chemistry, heat treatment, and room-temperature properties of the bolting material.
- 1.3 Three levels of bolting strength are covered, designated Grades B4B, B4C, and B4D.
- 1.4 The following referenced general requirements are indispensable for application of this specification: Specification A962/A962M.
- 1.5 Supplementary requirements are provided for use at the option of the purchaser. The supplementary requirements shall apply only when specified individually by the purchaser in the purchase order or contract.
- 1.6 This specification is expressed in both inch-pound units and in SI units; however, unless the purchase order or contract specifies the applicable *M* specification designation (SI units), the inch-pound units shall apply.
- 1.7 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each

system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.8 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:

A962/A962M Specification for Common Requirements for Bolting Intended for Use at Any Temperature from Cryogenic to the Creep Range

E292 Test Methods for Conducting Time-for-Rupture Notch Tension Tests of Materials

E112 Test Methods for Determining Average Grain Size

3. Ordering Information

- 3.1 It shall be the responsibility of the purchaser to specify all requirements necessary for product under this specification. Such requirements to be considered include, but are not limited to, the following:
- 3.1.1 Specification designation, grade, issue date, and revision letter,
 - 3.1.2 Quantity (weight or number of pieces),
 - 3.1.3 Description (bars, bolts, nuts, etc.),
 - 3.1.4 Dimensions,
 - 3.1.5 Finish, and
 - 3.1.6 Impact testing of nuts, if required (see Section 8).

4. Common Requirements

4.1 Bolting materials and bolting components supplied to this specification shall conform to the requirements of Specification A962/A962M. These requirements include test

methods, finish, thread dimensions, macroetch (Grade B4D only), marking, certification, optional supplementary requirements, and others. Failure to comply with the requirements of Specification A962/A962M constitutes nonconformance with this specification. In case of conflict between this specification and Specification A962/A962M, this specification shall prevail.

5. Heat Treatment

- 5.1 Grades B4B and B4C shall be heated to a temperature range of 1875 to 1925 °F [1025 to 1050 °C] and liquid quenched to below 600 °F [316 °C]. The material Grades B4B and B4C shall then be uniformly reheated for tempering at a tempering temperature at least 100 °F [55 °C] higher than the proposed operating temperature but not less than 1150 °F [620 °C], then air or furnace cooled to room temperature. The material shall be at the tempering temperature for a minimum of 2 h. Double tempering may be used to enhance properties.
- 5.2 Grade B4D shall be heated to a temperature range of 1700 to 1750 °F [925 to 954 °C] and oil quenched. The material shall then be uniformly reheated or tempered at a temperature of 1200 °F [650 °C] minimum, followed by air or furnace cooling to room temperature.
- 5.3 Stress relieving treatment of the bar material is required after any stretcher, roller, or rotary-straightening or cold-finishing operations performed after heat treatment for mechanical properties. Local gagging or press straightening to correct camber limitations in excess of ½ in. in any 5 ft [6 mm in any 1.5 m] shall be followed by a stress relieving heat treatment. The minimum stress relieving temperature shall be 100 °F [55 °C] below the minimum tempering temperature as shown in 5.1 for Grades B4B and B4C or in 5.2 for Grade B4D.

6. Chemical Composition

6.1 Bolting material shall conform to the requirements as to chemical composition specified in Table 1.

TABLE 1 Chemical Requirements^A

Element	Grades B	4B, B4C ^B	Grade B4D		
	Range, %	Product	Range, %	Product	
		Variation, %,	,	Variation, %,	
		Over or		Over or	
		Under		Under	
Carbon	0.20-0.25	0.02	0.36-0.44	0.02	
Manganese	0.50 - 1.00	0.03	0.45-0.70	0.03	
Phosphorus, max	0.025	0.005 over	0.04	0.005 over	
Sulfur, max	0.025	0.005 over	0.04	0.005 over	
Silicon	0.20-0.50	0.05	0.20-0.35	0.02	
Nickel	0.50-1.00	0.03			
Chromium	11.0-12.5	0.15	0.80-1.15	0.05	
Molybdenum	0.90-1.25	0.05	0.50-0.65	0.03	
Vanadium	0.20-0.30	0.03	0.25-0.35	0.03	
Tungsten	0.90-1.25	0.05			
Aluminum, max ^C	0.05		0.015		
Titanium, max	0.05				
Tin, max	0.04				

A Steel to which lead has been added shall not be used.

7. Tensile Requirements

- 7.1 Bolting material shall conform to the requirements as to tensile properties prescribed in Table 2 at room temperature after heat treatment.
- 7.2 The longitudinal axis of the test specimen shall be parallel to the direction of rolling.

8. Impact Requirements

8.1 Grades B4B, B4C, and B4D shall conform to the requirements as to impact properties prescribed in Table 3 at room temperature after heat treatment.

9. Hardness Tests

9.1 Grades B4B, B4C, and B4D shall conform to the requirements as to hardness as prescribed in Table 4 and Table 5 at room temperature after heat treatment.

10. Nuts

10.1 When specified by the purchaser, nuts shall be subject to the impact and tension requirements of this specification. The tests shall be made on test specimens taken from the bar or plate used in the manufacture of the nuts.

11. Threads

11.1 All threads shall be formed after heat treatment.

12. Nondestructive Inspection

12.1 Each bar or forged blank of starting material shall be subjected to NDE following final heat treatment. The method used shall be either the Eddy Current (EC), the Magnetic Particle (MPI) (wet or dry), the Liquid Penetrant (LPI), the Ultrasonic (UT), or the Visual Testing (VT), at the option of the producer. For LPI or MPI, linear indications (those indications longer than ½6 in. [1.5 mm] with a length greater than three times their width) are unacceptable. For UT or ET, reject levels for linear indications shall be based on the alarm response from a surface notch with a maximum depth of 0.012 in. [0.30 mm] in a calibration bar. Product being subjected to VT shall be pickled prior to inspection. VT indications longer than ½8 in. [3.2 mm] are prohibited.

13. Certification

13.1 Certification is required. See Specification A962/A962M.

TABLE 2 Tensile Requirements

Grade	Diameter, in. [mm]	Tensile Strength, min, ksi [MPa]	Yield Strength (0.2 % offset) min, ksi [MPa]	Elongation in 2 in. or 50 mm, min, %	Reduction of Area, min, %				
B4B		145 [1000]	105 [720]	13	30				
B4C		115 [790]	85 [585]	18	50				
B4D	21/2 [65] and under	125 [860]	105 [720]	18	50				
	over 2½ to 4 [65 to 100]	110 [760]	95 [655]	17	45				
	over 4 to 7 [100 to 180]	100 [690]	85 [585]	16	45				

^B UNS S42200.

^C Total, Soluble + Insoluble

TABLE 3 Impact Requirements

	<u> </u>
Grade	Minimum Impact Value, ft-lbf [J]
B4B	10 [14]
B4C	25 [34]
B4D ^A	25 [34]

^A For bars over 5-in. [127-mm] diameter only.

TABLE 4 Hardness Requirements for Bolts and Studs

Grade	Brinell Hardness Number, max
B4B	331
B4C	277
B4D	302

14. Product Marking

14.1 Use the grade symbol shown in Table 4. See Specification A962/A962M.

TABLE 5 Hardness Requirements for Nuts and Washers

Grade	Brinell Hardness Number	Rockwell Hardness Number
B4B	293–341	C 31–37
B4C	229–277	C 21-29
B4D	263–311	C 27–33

15. Keywords

15.1 bolts—steel; chromium alloy steel; bolting components—steel; marking on bolting components; nuts—steel; stainless steel; steel bars—alloy; steel bolting material; temperature service applications—high; turbine materials

SUPPLEMENTARY REQUIREMENTS

One or more of the following supplementary requirements shall be applied only when specified by the purchaser in the inquiry, contract, or order; in which event the specified tests shall be made before shipment of the product.

S1. Non-Destructive Examination

S1.1 NDE is required following all machining and threading. The acceptance criteria of 12.1 shall apply.

S2. Stress Rupture Testing—Grade B4B

S2.1 Stress rupture testing shall be conducted at 1200 °F [650 °C] and 26 000 psi [180 MPa] using a combination test bar in accordance with Test Methods E292. Rupture shall occur in the smooth section of each test specimen. The test may be

discontinued after 25 h provided the certification so notes. Stress rupture testing is not required on bars less than $\frac{1}{2}$ in. [12.7 mm] in diameter or thickness.

S3. Grain Size—Grades B4B and B4C

S3.1 The average grain size shall be 4 or finer. The maximum size of individual grains, distributed at random, shall be a 2. When the average grain size is 5 or finer, only the average size need be reported. Grain size determination shall be performed in accordance with Test Methods E112.

SPECIFICATION FOR AUSTENITIC DUCTILE IRON CASTINGS



SA-439/SA-439M

(23)

(Identical with ASTM Specification A439/A439M-18 except for repair by welding and plugging is not permitted, and certification made mandatory.)

Specification for Austenitic Ductile Iron Castings

1. Scope

- 1.1 This specification covers austenitic ductile iron castings, which are used primarily for their resistance to heat, corrosion, and wear, and for other special purposes.
- 1.2 Austenitic ductile iron, also known as austenitic nodular iron or austenitic spheroidal iron, is characterized by having its graphite substantially in a spheroidal form and substantially free of flake graphite. It contains some carbides and sufficient alloy content to produce an austenitic structure.
- 1.3 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in nonconformance with the standard.
- 1.4 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A247 Test Method for Evaluating the Microstructure of Graphite in Iron Castings
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- E8/E8M Test Methods for Tension Testing of Metallic Materials
- E10 Test Method for Brinell Hardness of Metallic Materials

- E30 Test Methods for Chemical Analysis of Ferroalloys
- E59 Practice for Sampling Steel and Iron for Determination of Chemical Composition
- E351 Test Methods for Chemical Analysis of Cast Iron—All Types

3. Ordering Information

- 3.1 Orders for material to this specification shall include the following information:
 - 3.1.1 ASTM designation,
 - 3.1.2 Type of austenitic ductile iron required (see 6.1),
 - 3.1.3 Heat treatment options (see 4.3 4.6),
 - 3.1.4 DELETED
- 3.1.5 Size and number of test bars required (see 9.1 9.4 and 10.1),
 - 3.1.6 Special tests, if required (see 12.1),
 - 3.1.7 DELETED
- 3.1.8 Different preparation for delivery requirements, if needed (see 15.1).

4. Manufacture

- 4.1 Melting may be done in any furnaces that produce castings meeting the chemical and mechanical requirements outlined in this specification. These include cupolas, air furnaces, electric furnaces, crucible furnaces, and so forth. Nodularizing and inoculation practice shall be optional with the foundry to produce a microstructure in accordance with 1.2 and Test Method A247.
- 4.2 Austenitic ductile iron castings may be supplied in either the as-cast or the heat-treated condition.
- 4.3 By agreement between the manufacturer and the purchaser, the castings may be stress relieved by heating to 1150 to 1200 °F [620 to 650 °C] for not less than 1 h and not for more than 2 h per inch [25 mm] of thickness in the thickest section. Heating and cooling shall be uniform and shall not be more than 400 °F/h [220 °C/h] for castings less than 1 in. [25 mm] in maximum thickness and shall be not more than 400 °F/h [220 °C/h] divided by the maximum section thickness in inches [25 mm] for thicker castings. During the cooling

cycle, castings may be cooled in still air after the temperature has dropped to 600 °F [310 °C].

- 4.4 By agreement between the manufacturer and the purchaser, the castings may be in-mold stress relieved by allowing castings to cool slowly in the mold at a rate not exceeding 400 °F/h [220 °C/h]. Once the temperature has dropped below 600 °F [310 °C], castings can be removed from the mold and cooled in still air.
- 4.5 Whenever dimensional changes in high-temperature service are a problem, by agreement between the manufacturer and the purchaser, the castings may be stabilized by heating at 1600 °F [870 °C] for a period of 1 h per inch [25 mm] of section, with a minimum period of 1 h, followed by uniform cooling, preferably in still air. Otherwise, the austenite, which is super saturated with respect to carbon, can reject carbon during service and produce dimensional changes.
- 4.6 By agreement between the manufacturer and the purchaser, castings with chilled edges or excessive carbides may be annealed at 1750 to 1900 °F [960 to 1040 °C] for 0.5 h to 5 h followed by uniform cooling, preferably in still air.
- 4.7 Repair by welding, plugging, or other methods is not permitted.

5. Magnetic Properties

5.1 In the event that nonmagnetic castings are specified, the magnetic permeability test shall be used. The maximum magnetic permeability value shall be agreed upon between the manufacturer and the purchaser.

Note 1—A convenient shop test for differentiating the various types of austenitic ductile iron is based on the fact that a ground face of either the test bar or the castings of Types D-2 and D-2C does not attract a small steel horseshoe-type magnet which is normally attracted to steel (Alnico magnet should not be used). Types D-3, D-3A, D-5, and D-5B are attracted, and types D-2B, D-2S, D-4, and D-5S are slightly attracted. This nonmagnetic test is a convenient qualitative test only for Types D-2 and D-2C, and shall not be used as a basis for acceptance.

6. Chemical Requirements

- 6.1 Many combinations of alloys can be used to obtain an austenitic ductile iron. This specification includes ten general types defined by the composition limits in Table 1.
- 6.2 Samples taken from test coupons, broken test specimens, or castings shall conform to the requirements as to

chemical composition prescribed in Table 1. Sampling shall be conducted in accordance with Practice E59 and chemical analyses in accordance with Test Methods E351 and E30. Test Methods E30 should only be used for analyzing those elements for which specific coverage is not provided for in Test Methods E351.

- 6.3 Spectrometric techniques may also be used for analysis, but should a dispute arise concerning chemical composition. Test Methods E351 and E30 shall be used for referee methods.
- 6.4 The chemical analysis for total carbon shall be made on either chilled cast pencil-type specimens or thin wafers approximately ½32 in. [1.0 mm] thick cut from test coupons. Drillings shall not be used because of attendant loss of graphite.

7. Mechanical Requirements

- 7.1 Test specimens of austenitic ductile iron made according to this specification shall meet the test requirements prescribed in Table 2.
- 7.2 The yield strength shall be determined in accordance with Test Methods E8/E8M, using one of the following procedures: the 0.2 % offset method or the extension-underload method may be used, by agreement between the purchaser and the manufacturer.
- 7.3 Brinell hardness shall be determined as HBW 10/3000 in accordance with Test Method E10.

8. Workmanship, Finish, and Appearance

8.1 The castings shall conform substantially to the dimensions on the drawings furnished by the purchaser, or if no drawing has been provided, to the dimensions predicated by the pattern supplied by the purchaser. The castings shall be free of injurious defects. Surfaces of the castings shall be free of burnt-on sand and shall be reasonably smooth. Runners, risers, fins, and other cast-on pieces shall be removed. In other respects, the castings shall conform to whatever points are specifically agreed upon between the manufacturer and the purchaser.

9. Test Bars

9.1 The standard test bars shall be the 1-in. [25-mm] "Y" block and 1-in. [25-mm] keel block as shown in Figs. 1 and 2,

Туре

Element	D-2 ^A	D-2B	D-2C	D-2S	D-3 ^A	D-3A	D-4	D-5	D-5B	D-5S
		Composition, %								
Total carbon, max	3.00	3.00	2.90	2.6	2.60	2.60	2.60	2.40	2.40	2.30
Silicon Manganese	1.50-3.00 0.70-1.25	1.50-3.00 0.70-1.25	1.00-3.00 1.80-2.40	4.80-5.80 1.00 max	1.00–2.80 1.00 max ^B	1.00–2.80 1.00 max ^B	5.00–6.00 1.00 max ^B	1.00–2.80 1.00 max ^B	1.00–2.80 1.00 max ^B	4.90-5.50 1.00 max
Phosphorus, max	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
Nickel Chromium	18.00-22.00 1.75-2.75	18.00-22.00 2.75-4.00	21.00-24.00 0.50 max ^B	24.00–28.00 1.75–2.25	28.00-32.00 2.50-3.50	28.00-32.00 1.00-1.50	28.00-32.00 4.50-5.50	34.00–36.00 0.10 max	34.00-36.00 2.00-3.00	34.00–37.00 1.75–2.25

TABLE 1 Chemical Requirements

^B Not intentionally added.

^A Additions of 0.7 to 1.0 % of molybdenum can increase the mechanical properties above 800 °F [425 °C].

Brinell hardness (3000 kg)

TABLE 2 Mechanical Requirements

TABLE 2 Mechanical nequirements										
Inch-Pound Grades										
Туре										
Element	D-2	D-2B	D-2C	D-2S	D-3	D-3A	D-4	D-5	D-5B	D-5S
					Prop	erties				
Tensile strength, min, ksi	58	58	58	55	55	55	60	55	55	55
Yield strength (0.2 % offset), min, ksi	30	30	28	30	30	30		30	30	30
Elongation in 2 in., min, %	8.0	7.0	20.0	10.0	6.0	10.0		20.0	6.0	10.0
Brinell hardness (3000 kg)	139–202	148–211	121-171	131–193	139–202	131–193	202-273	131–185	139–193	131–193
			Metri	c Grade						
					Ту	ре				
Element	D-2	D-2B	D-2C	D-2S	D-3	D-3A	D-4	D-5	D-5B	D-5S
	Properties									
Tensile strength, min, MPa	400	400	400	380	380	380	415	380	380	380
Yield strength (0.2 % offset), min, MPa	210	210	195	210	210	210		210	210	210
Elongation in 50 mm, min, %	8.0	7.0	20.0	10.0	6.0	10.0		20.0	6.0	10.0

131-193

139-202

131-193

202-273

131-185


139-193

131-193

121-171

139-202

148-211

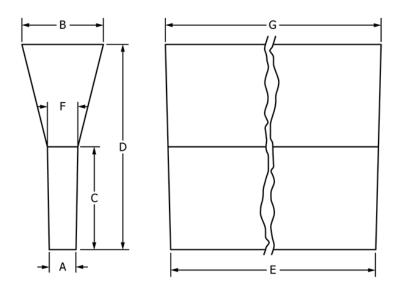


	"Y" Block Size							
Dimensions		For Castings of Thickness Less Than ½ in. [13 mm]		Thickness ½ in. ½ in. [38 mm]	For Castings of Thickness 1½ in. [38 mm] and Over			
	in.	mm	in.	mm	in.	mm		
A	1/2	13	1	25	3	75		
В	15⁄8	40	21/8	54	5	125		
С	2	50	3	75	4	100		
D	4	100	6	150	8	200		
E	7	175	7	175	7	175		
	approx	approx	approx	approx	approx	approx		
F	9/16	15	1 ½16	28	31/16	80		
G	71/8	180	71/8	180	71/8	180		
	approx	approx	approx	approx	approx	approx		

FIG. 1 "Y" Blocks for Test Coupons

respectively. A modified keel block cast from the mold shown in Fig. 3 may be substituted for the 1-in. [25-mm] "Y" block or the 1-in. [25-mm] keel block.

- 9.2 Whenever the section size of the castings is considerably less or greater than 1 in. [25 mm], and by agreement between the purchaser and the manufacturer, the ½-in. [13mm] or 3-in. [75-mm] "Y" blocks shown in Fig. 1 may be used.
- 9.3 The test bars shall be cast in open molds made of a suitable core sand with a minimum of $1\frac{1}{2}$ in. [38 mm] of sand on all sides and bottom of the ½ and 1-in. [13 and 25-mm] test bars and 3 in. [75 mm] of sand for the 3-in. [75-mm] test bar.
- 9.4 When investment castings are made to this specification, the manufacturer may use test specimens cast to size incorporated in the mold with the castings, or separately cast to size using the same type of mold and the same thermal conditions

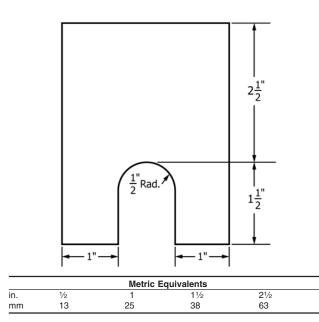

Note 1—The length of the keel block shall be 6 in. [150 mm].

FIG. 2 Keel Block for Test Coupons

that are used to produce the castings. These test specimens shall be made to the dimensions shown in Fig. 3 and Fig. 4 of Test Methods and Definitions A370.

9.5 Test bars representing the furnace heat of iron shall be cast from the same ladle of metal as soon as practicable after the last iron is poured to produce castings, unless otherwise specified. Test bars shall be left in the mold until they have cooled to less than 930 °F [500 °C]; cooling to a black appearance is acceptable if the manufacturer has established that such black appearance corresponds to a temperature less than 930 °F [500 °C].

10. Number of Tests

- 10.1 Test bars shall be poured from each ladle treated with nodularizing agent, unless otherwise specified.
- 10.2 The number of test bars cast shall be agreed upon by the manufacturer and the purchaser.
- 10.3 One tension test shall be made from sections cut from the test bars as shown in Fig. 4. If any tension test shows obvious foundry or machining defects, another specimen shall be cut from the same test bar or from another test bar representing the same metal. If the retest specimen fails to conform to this specification, the castings they represent shall be rejected.

11. Tension Test Specimens

11.1 The standard round tension test specimen with 2-in. [50-mm] gauge length shown in Fig. 5 shall be used, except

when the ½-in. [13-mm] "Y" block is used or when specimens are cut from castings under ¾-in. [20-mm] thickness. In these cases, either of the test specimens shown in Fig. 6 shall be satisfactory.

11.2 By agreement between the manufacturer and the purchaser, tension test specimens may be cut directly from centrifugal or other permanent mold castings. The location and orientation of such tension test specimens cut from castings shall be specified as agreed upon by the manufacturer and the purchaser.

12. Additional Tests

12.1 Hydrostatic tests for pressure castings, radiography standards, fracture tests, microstructure standards, or any other special tests may be set up by mutual agreement between the manufacturer and the purchaser.

13. Responsibility for Inspection

13.1 Unless otherwise specified in the contract or purchase order, the manufacturer is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract or order, the manufacturer may use their own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the purchaser. The purchaser reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to ensure supplies and services conform to prescribed requirements.

14. Certification

14.1 A certification shall be made the basis of acceptance of the material. This shall consist of a copy of the manufacturer's test report or a statement by the supplier, accompanied by a copy of the test results that the material has been tested and inspected in accordance with the provisions of this specification. Each certification so furnished shall be signed by an authorized agent of the supplier or manufacturer.

15. Packaging and Package Marking

15.1 Unless otherwise specified in the contract or purchase order, preservation and packaging of casting shall be in accordance with the manufacturer's commercial practice. Packing and marking shall also be adequate to ensure acceptance and safe delivery by the carrier for the mode of transportation employed.

16. Keywords

16.1 austenitic; corrosion resistant; ductile iron; mechanical properties; nodular iron; tensile strength; yield strength



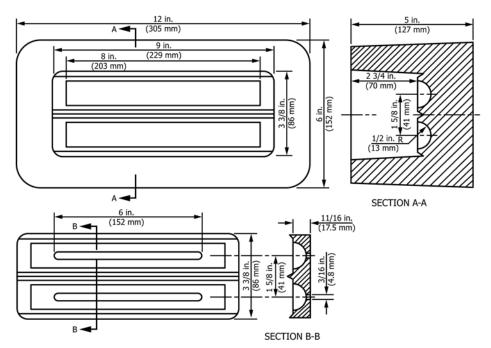


FIG. 3 Mold for Modified Keel Block

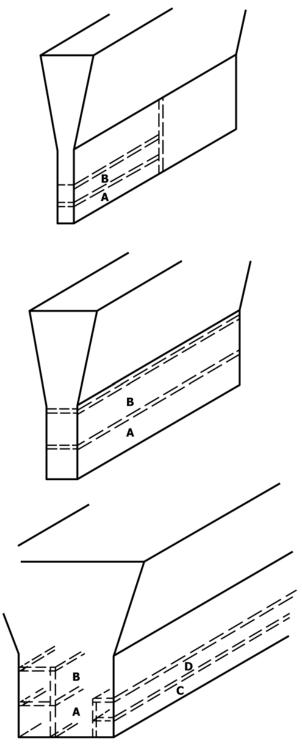

- (a) $^{1}\!\!/_{2}$ -in. [13 mm] "Y" Block-Two blanks for 0.25-in [6.5-mm] diameter
- (b) 1-in. [25 mm] "Y" Block-Two blanks for 0.50-in [13-mm] diameter
- (c) 3-in. [75 mm] "Y" block-Two blanks for 0.50-in [13-mm] diameter tension test specimens.


FIG. 4 Sectioning Procedure for "Y" Blocks




Metric Equivalents						
in.	mm	in.	mm			
0.005	0.01	0.50	12.7			
0.01	0.3	2	50.8			
1/8	3.2	21/4	57.2			
3/8	9.5					

Note 1—The gauge length and fillets shall be as shown, but the ends may be of any shape to fit the holders of the testing machine in such a way that the load shall be axial. The reduced section shall have a gradual taper from the ends toward the center, with the ends 0.003 to 0.005 in. [0.08 to 0.13 mm] larger in diameter than the center.

FIG. 5 Standard Round Tension Test Specimen With 2-in. [50-mm] Gauge Length





Metric Equivalents							
in.	mm	in.	mm				
0.005	0.13	1.0	25.4				
0.007	0.18	11/4	31.8				
0.252	6.40	1.4	35.6				
0.357	9.07	13/4	44.4				

Note 1—If desired, the length of the reduced section may be increased to accommodate an extensometer.

FIG. 6 Examples of Small-Size Specimens Proportional to Standard ½-in. [13-mm] Round Specimen

SPECIFICATION FOR HEX CAP SCREWS, BOLTS AND STUDS, STEEL, HEAT TREATED, 120/105/90 ksi MINIMUM TENSILE STRENGTH, GENERAL USE



SA-449

(Identical with ASTM Specification A449-10 except for requiring that all mating fastener components be coated by the same zinc-coating process in 5.1.4, the removal of reference to bolts in 6.4, and the deletion of the term "private label distributor" in 16.1 and 16.3.2.)

Standard Specification for Hex Cap Screws, Bolts and Studs, Steel, Heat Treated, 120/ 105/90 ksi Minimum Tensile Strength, General Use

1. Scope

- 1.1 This specification covers quenched and tempered steel hex cap screws, bolts, and studs having a minimum tensile strength of 120 ksi for diameters 1.0 in. and smaller; 105 ksi for diameters over 1.0 in. to $1\frac{1}{2}$ in.; and 90 ksi for diameters $1\frac{3}{4}$ in. to 3.0 in. inclusive. The term "fasteners" in this specification denotes hex cap screws, bolts, and studs.
 - 1.2 The fasteners are intended for general engineering use.
- 1.3 The fasteners are furnished in diameters $\frac{1}{4}$ to 3.0 in. inclusive. They are designated by type denoting chemical composition as follows:

туре	Description
Type I	Plain carbon steel, carbon boron steel, alloy steel, or alloy boron steel
Type 2	Withdrawn 2003
Type 3	Weathering steel
Type o	WCallioning Steel

- 1.4 Terms used in this specification are defined in Terminology F1789 unless otherwise defined in this specification.
- 1.5 The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are provided for information purposes only.
- 1.6 This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.

2. Referenced Documents

2.1 ASTM Standards:

A563 Specification for Carbon and Alloy Steel Nuts A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products

B695 Specification for Coatings of Zinc Mechanically Deposited on Iron and Steel

D3951 Practice for Commercial Packaging

F436 Specification for Hardened Steel Washers

F606 Test Methods for Determining the Mechanical Properties of Externally and Internally Threaded Fasteners, Washers, Direct Tension Indicators, and Rivets

F788/F788M Specification for Surface Discontinuities of Bolts, Screws, and Studs, Inch and Metric Series

F1470 Practice for Fastener Sampling for Specified Mechanical Properties and Performance Inspection

F1789 Terminology for F16 Mechanical Fasteners

F2329 Specification for Zinc Coating, Hot-Dip, Requirements for Application to Carbon and Alloy Steel Bolts, Screws, Washers, Nuts, and Special Threaded Fasteners

G101 Guide for Estimating the Atmospheric Corrosion Resistance of Low-Alloy Steels

2.2 ASME Standards:

B 1.1 Unified Screw Threads

B 18.2.1 Square and Hex Bolts and Screws

B 18.24 Part Identifying Number (PIN) Code System Standard for B18 Fastener Products

3. Ordering Information

- 3.1 Orders for fasteners under this specification shall include the following:
 - 3.1.1 Quantity (number of pieces),
 - 3.1.2 Size, including nominal diameter and length,
 - 3.1.3 Name of product,

- 3.1.4 Type, that is, Type 1, or Type 3 as required,
- 3.1.5 ASTM designation and year of issue, and
- 3.1.6 Other components such as nuts and washers if required.
- 3.1.7 Hot-Dip or Mechanically Deposited Zinc Coatings—For hot-dip or mechanically deposited zinc coatings covered by 5.1 and requiring over-tapped nuts, specify the zinc coating process required, that is, hot-dip, mechanically deposited, or no preference (see 5.1).
- 3.1.8 *Other Coatings*—Specify other protective coating if required (see 5.2).
- 3.1.9 Specify if inspection at point of manufacture is required.
 - 3.1.10 Test reports if required.
 - 3.1.11 Supplementary or special requirements.
- 3.1.12 For establishment of a part identifying system, see ASME B18.24.

Note 1—A typical ordering description follows: 1000 pieces $\frac{1}{8}$ in. diameter \times 4.0 in. long hex cap screw, Type 1, ASTM A449–XX, each with one finished hex nut ASTM A563, Grade DH. Each component mechanically zinc coated in accordance with B695, Class 5, Type II.

- 3.2 Suitable Nuts and Washers:
- 3.2.1 Suitable nuts are covered in Specification A563. Unless otherwise specified, the grade and style of nut shall be as follows:

Fastener Size and Surface Finish	Nut Grade and Style ²
1/4 to 11/2 in., plain (or with a coating of insufficient thickness to require over-tapped nuts)	B, hex
Over 1½ to 3 in., plain (or with a coating of insufficient thickness to require over-tapped nuts)	A, heavy hex
1/4 to 3 in., zinc-coated (or with a coating thickness requiring over-tapped nuts)	DH, heavy hex
1/4 to 3 in., Type 3	C3, DH3, heavy hex

A Nuts of other grades and styles having specified proof load stresses (Specification A563, Table 3) greater than the specified grade and style of nut are suitable.

3.2.2 Unless otherwise specified, washers ordered with fasteners shall be furnished to the requirements of Specification F436, Type 1 or Specification F436, Type 3. Washers for A449 Type 3 fasteners shall conform to Specification F436 Type 3.

4. Materials and Manufacture

- 4.1 Heat Treatment:
- 4.1.1 Type 1 fasteners produced from medium carbon steel shall be quenched in a liquid medium from the austenitizing temperature.
- 4.1.2 Type 1 fasteners produced from medium carbon steel to which chromium, nickel, molybdenum, or boron were intentionally added, and Type 3 fasteners, shall be quenched in oil from the austenitizing temperature.
- 4.1.3 Type 1 and Type 3 fasteners, regardless of the steel used, shall be tempered by reheating to not less than 800°F.
 - 4.2 Threading—Threads shall be rolled, cut, or ground.
- 4.3 Secondary Processing—If any processing which can affect the mechanical properties of the fasteners is performed after the initial testing, the fasteners shall be retested for all specified mechanical properties affected by the reprocessing.

5. Protective Coatings

- 5.1 Zinc, Hot Dip, and Mechanically Deposited Requiring Over-tapped Nuts:
- 5.1.1 When zinc-coated fasteners are required, the purchaser shall specify the zinc-coating process, such as, hot-dip, mechanically deposited, or no preference.
- 5.1.2 When hot dip is specified, the fasteners shall be zinc coated by the hot-dip process in accordance with the requirements of Specification F2329.
- 5.1.3 When mechanically deposited is specified, the fasteners shall be zinc coated by the mechanical deposition process in accordance with the requirements of Class 55 of Specification B695.
- 5.1.4 When no preference is specified, the supplier may furnish either a hot-dip zinc coating in accordance with Specification F2329, or a mechanically deposited zinc coating in accordance with Specification B695, Class 55. All mating components shall be coated by the same zinc coating process, and the suppliers' option shall be limited to one process per item with no mixed processes in a lot.

Note 2—When the intended application requires that assembled tension exceeds 50 % of minimum bolt or stud proof load, an anti-galling lubricant may be needed. Application of such a lubricant to nuts and a test of the lubricant efficiency are provided in Supplementary Requirement S1 of Specification A563 and should be specified when required.

5.2 Other Coatings:

- 5.2.1 When other coatings are required, the purchaser shall specify the coating specification, including the classification codes or grade numbers to identify the coating material, thickness, supplemental treatments, or other requirements to define the coating. The fasteners shall be coated in accordance with and conform to the specified coating specification.
- 5.2.2 When a specification does not apply, the purchaser shall specify the desired coating, coating thickness, supplemental treatments, or other requirements to define the coating.

6. Chemical Composition

- 6.1 Type 1 fasteners shall be plain carbon steel, carbon boron steel, alloy steel, or alloy boron steels, at the manufacturers option, conforming to the requirements in Table 1.
- 6.2 Type 3 fasteners shall be weathering steel and shall conform to one of the chemical compositions specified in Table 2. The selection of the chemical composition, A, B, C, D, E or F, shall be a the option of the manufacuturer. See Guide G101 for methods of estimating the atmospheric corrosion resistance of low alloy steel.
- 6.3 Product analyses made on finished fasteners representing each lot shall conform to the product analysis requirements specified in Table 1 or Table 2, as applicable.
- 6.4 Heats of steel to which bismuth, selenium, tellurium, or lead has been intentionally added shall not be permitted for bolts. Compliance shall be based on certification that heats of steel having any of the listed elements intentionally added were not used.
- 6.5 Chemical analyses shall be performed in accordance with Test Methods, Practices, and Terminology A751.

TABLE 1 Chemical Requirements for Type 1 Fasteners					
Florent	Carbo	Carbon Steel			
Element	Heat Analysis	Product Analysis			
Carbon	0.30-0.52	0.28-0.55			
Manganese, min	0.60	0.57			
Phosphorus, max	0.040	0.048			
Sulfur, max	0.050	0.058			
Silicon	0.15-0.30	0.13-0.32			
Element	Boro	n Steel			
Element	Heat Analysis	Product Analysis			
Carbon	0.30-0.52	0.28-0.55			
Manganese, min	0.60	0.57			
Phosphorus, max	0.040	0.048			
Sulfur, max	0.050	0.058			
Silicon	0.10-0.30	0.08-0.32			
Boron	0.0005-0.003	0.0005-0.003			
Element	Alloy	Alloy Steel			
Element	Heat Analysis	Product Analysis			
Carbon	0.30-0.52	0.28-0.55			
Manganese, min	0.60	0.57			
Phosphorus, max	0.035	0.040			
Sulfur, max	0.040	0.045			
Silicon	0.15-0.35	0.13-0.37			
Alloying Elements	A	Α			
Element	Alloy Bo	oron Steel			
	Heat Analysis	Product Analysis			
Carbon	0.30-0.52	0.28-0.55			
Manganese, min	0.60	0.57			
Phosphorus, max	0.035	0.040			
Sulfur, max	0.040	0.045			
Silicon	0.15-0.35	0.13-0.37			
Boron	0.0005-0.003	0.0005-0.003			
Alloying Elements	Α	Α			

^A Steel, as defined by the American Iron and Steel Institute, shall be considered to be alloy when the maximum of the range given for the content of alloying elements exceeds one or more of the following limits: manganese, 1.65 %; silicon, 0.60 %; copper, 0.60 % or in which a definite range or a definite minimum quantity of any of the following elements is specified or required within the limits of the recognized field of constructional alloy steels: aluminum, chromium up to 3.99 %, cobalt, columbium, molybdenum, nickel, titanium, tungsten, vanadium, zirconium, or any other alloying elements added to obtain a desired alloying effect.

7. Mechanical Properties

7.1 Hardness—The fasteners shall conform to the hardness specified in Table 3. See Table 3, Note A.

7.2 Tensile Properties:

7.2.1 Except as permitted in 7.2.2 for long fasteners and 7.2.3 for short fasteners, hex cap screws and hex and square head bolts in sizes 1.00 in. and smaller having a length of 21/4 D and longer and sizes 11/8 to 11/2 in. inclusive having a length of 3D and longer shall be wedge tested full size. Bolts with heads other than hex or square shall be axially tested. Both wedge and axially tested hex cap screws and bolts shall conform to the proof load or alternative proof load, and minimum wedge tensile load in Tables 4 and 5, as applicable. The load applied during proof load testing shall be equal to or greater than the proof load in Table 4 or Table 5 as applicable.

7.2.2 Hex cap screws and square head bolts larger than 1½ in. diameter, other than those excepted in 7.2.3, shall preferably be tested full size and when so tested shall conform to the tensile strength and either the specified proof load or yield strength requirements in Tables 4 and 5, as applicable. When equipment of sufficient capacity for full size testing is not available, or when the length of the bolt makes full size testing impractical, machined specimens shall be tested and shall conform to the requirements of Table 6.

7.2.3 Sizes 1.00 in. and smaller having a length shorter than 21/4 D down to 2D inclusive, which cannot be wedge tensile tested shall be axially tension tested full size and shall conform to the minimum tensile load and proof load or alternate proof load specified in Tables 4 and 5. Sizes 1.00 in. and smaller having a length shorter than 2D which cannot be axially tensile tested shall be qualified on the basis of hardness.

7.2.4 Studs 3D and longer shall be axially tension tested full size and shall conform to the tensile and proof load or alternate proof load specified in Table 4 and Table 5, as applicable. When equipment for full size testing is not available, or when the studs are too long for full size testing, machined specimens shall be tested and shall conform to the tensile requirements in Table 6.

7.2.5 If fasteners are subjected to both hardness and tensile tests, the tensile test results shall take precedence in the event of low hardness test results.

7.2.6 If fasteners are subjected to both full size and machined specimen tests, the full size test results shall take precedence if the results of the two methods differ.

8. Dimensions

8.1 Head and Body:

- 8.1.1 Hex Cap Screws—Unless otherwise specified, hex cap screws shall be furnished with dimensions conforming to ASME B18.2.1.
- 8.1.2 Bolts—When styles other than specified in 8.1.1 are required, they shall have dimensions conforming to those specified by the purchaser.
- 8.1.3 Studs—Studs shall have dimensions conforming to those specified by the purchaser.

8.2 Threads:

8.2.1 Uncoated—Unless otherwise specified, uncoated threads shall be the Unified Coarse Thread Series as specified in the latest issue of ASME B1.1, and shall have Class 2A tolerances.

8.2.2 Coated—Unless otherwise specified, zinc-coated bolts, to be used with zinc-coated nuts or tapped holes, which are tapped oversize in accordance with Specification A563, shall have UNC Class 2A threads before hot-dip or mechanically deposited zinc-coating. After zinc coating, the pitch diameter and major diameter shall not exceed the Class 2A limits by more than the following amounts:

Nominal Diameter, in.	Oversize Limit, in. ^A				
Nominai Diameter, in.	Hot-Dip Zinc	Mechanical Zinc			
1/4	0.016	0.012			
5/16, 3/8	0.017	0.012			
7/16, 1/2	0.018	0.012			
9/16, 5/8,3/4	0.020	0.013			
7/8	0.022	0.015			
1.0 to 11/4	0.024	0.016			
13/8, 11/2	0.027	0.018			
13/4 to 3.0, incl	0.050	0.033			

^A Hot-dip zinc nuts are tapped oversize after coating and mechanical zinc coated nuts are tapped oversize before coating.

TABLE 2 Chemical Requirements for Type 3 Fasteners^A

Element			Composition	, %				
	Type 3 Fasteners ^A							
	Α	В	С	D	Е	F		
Carbon:								
Heat analysis	0.33-0.40	0.38-0.48	0.15-0.25	0.15-0.25	0.20-0.25	0.20-0.25		
Product analysis	0.31-0.42	0.36-0.50	0.14-0.25	0.14-0.25	0.18-0.27	0.19-0.25		
Manganese:								
Heat analysis	0.90-1.20	0.70-0.90	0.80-1.35	0.40-1.20	0.60-1.00	0.90-1.20		
Product analysis	0.86-1.24	0.67-0.93	0.76-1.39	0.36-1.24	0.56-1.04	0.86-1.24		
Phosphrous:								
Heat analysis	0.035 max	0.06-0.12	0.035 max	0.035 max	0.035 max	0.035 max		
Product analysis	0.040 max	0.06-0.125	0.040 max	0.040 max	0.040 max	0.040 max		
Sulfur:								
Heat analysis	0.040 max	0.040 max	0.040 max	0.040 max	0.040 max	0.040 max		
Product analysis	0.045 max	0.045 max	0.045 max	0.045 max	0.045 max	0.045 max		
Silicon:								
Heat analysis	0.15-0.35	0.30-0.50	0.15-0.35	0.25-0.50	0.15-0.35	0.15-0.35		
Product analysis	0.13-0.37	0.25-0.55	0.13-0.37	0.20-0.55	0.13-0.37	0.13-0.37		
Copper:								
Heat analysis	0.25-0.45	0.20-0.40	0.20-0.50	0.30-0.50	0.30-0.60	0.20-0.40		
Product analysis	0.22-0.48	0.17-0.43	0.17-0.53	0.27-0.53	0.27-0.53	0.17-0.43		
Nickel:								
Heat analysis	0.25-0.45	0.50-0.80	0.25-0.50	0.50-0.80	0.30-0.60	0.20-0.40		
Product analysis	0.22-0.48	0.47-0.83	0.22-0.53	0.47-0.83	0.27-0.63	0.17-0.43		
Chromium:								
Heat analysis	0.45-0.65	0.50-0.75	0.30-0.50	0.50-1.00	0.60-0.90	0.45-0.65		
Product analysis	0.42-0.68	0.47-0.83	0.27-0.53	0.45-1.05	0.55-0.95	0.42-0.68		
Vanadium:								
Heat analysis	В	В	0.020 min	В	В	В		
Product analysis	В	В	0.010 min	В	В	В		
Molybdenum:								
Heat analysis	В	0.06 max	В	0.10 max	В	В		
Product analysis	В	0.07 max	В	0.11 max	В	В		
Titanium:								
Heat analysis	В	В	В	0.05 max	В	В		
Product analysis	В	В	В	0.06 max	В	В		

AA,B,C,D, E and F are classes of material used for Type 3 fasteners. Selection of a class shall be at the option of the bolt manufacturer.

TABLE 3 Hardness Requirements for Hex Cap Screws, Bolts, and Studs

Nominal Diameter, in.	Longth in	Brit	Brinell		Rockwell C	
	Length, in.	Min	Max	Min	Max	
1/4 to 1, inclusive	Less than 2D ^A	253	319	25	34	
	2D and over		319		34	
Over 1 to 11/2, inclusive	Less than 3D ^A	223	286	19	30	
	3D and over		286		30	
Over 11/2 to 3, inclusive	Less than 3D ^A	183	235			
	3D and over		235			

A Hex cap screws and bolts larger than 1.00 in. diameter and shorter than 3D and all studs shorter than 3D are subject only to minimum and maximum hardness.

D = Nominal diameter or thread size

8.2.3 Unless otherwise specified, fasteners electroplated or mechanically coated to 0.0005 in. or less, threads prior to plating shall conform to ASME B1.1 Class 2A and after plating shall not exceed the Class 3A maximum limits, that is, Class 2A plus the allowance.

9. Workmanship, Finish, and Appearance

9.1 Surface discontinuity limits, inspection, and evaluation shall be in accordance with Specification F788/F788M.

10. Number of Tests and Retests

- 10.1 Testing Responsibility:
- 10.1.1 Each lot shall be tested by the manufacturer prior to shipment in accordance with the lot identification control quality assurance plan in 10.2-10.5.

- 10.1.2 When fasteners are furnished by a source other than the manufacturer, the responsible party as defined in 15.1 shall be responsible for assuring all tests have been performed and the fasteners comply with the requirements of this specification (see 4.3).
- 10.2 Purpose of Lot Inspection—The purpose of a lot inspection program is to ensure that each lot conforms to the requirements of this specification. For such a plan to be fully effective, it is essential that secondary processors, distributors, and purchasers maintain the identification and integrity of each lot until the product is installed.
- 10.3 Lot Processing—All fasteners shall be processed in accordance with a lot identification-control quality assurance plan. The manufacturer, secondary processors, and distributors

^BThese elements are not specified or required.

TABLE 4 Tensile Load Requirements for Coarse-Thread Full-Size Hex Cap Screws, Bolts and Studs

Bolt or Stud Diameter, in.	Threads per in. ^A	Stress Area, ^B in. ²	Tensile Load, min, lbf ^C	Proof Load, Length Measurement Method, lbf ^C	Alternative Proof Load Yield Strength Method (0.2 % Offset), lbf ^C
Column 1	Column 2	Column 3	Column 4	Column 5	Column 6
1/4	20	0.0318	3 800	2 700	2 900
5/16	18	0.0524	6 300	4 450	4 800
3/8	16	0.0775	9 300	6 600	7 100
7/16	14	0.1063	12 750	9 050	9 800
1/2	13	0.1419	17 050	12 050	13 050
9/16	12	0.182	21 850	15 450	16 750
5/8	11	0.226	27 100	19 200	20 800
3/4	10	0.334	40 100	28 400	30 700
7/8	9	0.462	55 450	39 250	42 500
1	8	0.606	72 700	51 500	55 750
1½	7	0.763	80 100	56 450	61 800
11/4	7	0.969	101 700	71 700	78 500
13/8	6	1.155	121 300	85 450	93 550
11/2	6	1.405	147 500	104 000	113 800
13/4	5	1.90	171 000	104 500	110 200
174	J	1.50	171 000	104 300	110 200
2	41/2	2.50	225 000	137 500	145 000
21/4	41/2	3.25	292 500	178 750	188 500
21/2	4	4.00	360 000	220 000	232 000
23/4	4	4.93	443 700	271 150	286 000
3	4	5.97	537 300	328 350	346 200

A For 8 threads per in., sizes 11/6 to 11/2 in., inclusive, stresses of 105 000 psi, 74 000 psi, and 81 000 psi shall be used for calculating the values in columns 4, 5, and

 $A_s = 0.7854[D - (0.9743/n)]^2$

where:

 A_s = stress area,

= nominal diameter, and

= threads per in.

 $n={\rm threads}\ {\rm per}\ {\rm in}.$ $^{C}\ {\rm Values}\ {\rm tabulated}\ {\rm are}\ {\rm based}\ {\rm on}\ {\rm the}\ {\rm following}:$

Bolt Size, in.	Column 4, psi	Column 5, psi	Column 6, psi
1/4 to 1, incl.	120 000	85 000	92 000
11/8 to 11/2, incl.	105 000	74 000	81 000
13/4 to 3, incl.	90 000	55 000	58 000

shall identify and maintain the integrity of each lot from raw material selection through all operations and treatments to final packing and shipment. Each lot shall be assigned its own lot-identification number, each lot shall be tested, and the inspection test reports for each lot shall be retained.

10.4 Lot Definition:

10.4.1 Standard Lot—A lot shall be a quantity of uniquely identified fasteners of the same nominal size and length produced consecutively at the initial operation from a single mill heat of material and processed at one time, by the same processor in the same manner so that statistical sampling is valid. The identity of the lot and lot integrity shall be maintained throughout all subsequent operations and packaging.

10.5 Number of Tests—The minimum number of tests from each lot for the tests specified below shall be as follows:

Tests Number of Tests in Accordance With

Hardness, tensile strength, proof load Coating weight/thickness Surface discontinuities Dimensions and thread fit

Guide F1470 The referenced coating specification^A Specification F788/F788M ASME B18.2.1

11. Test Methods

11.1 Tensile, proof load, and hardness tests shall be conducted in accordance with Test Methods F606.

11.2 Tensile strength for hex cap screws and hex and square bolts shall be determined using the wedge or axial tension testing method of full size product method or the machined test specimens method depending on size and length as specified in 7.2.2-7.2.6. Bolts with heads other than hex or square shall be

⁶ respectively. $^{\it B}$ The stress area is taken from ASME B1.1 which uses the equation below to calculate the values:

^A Guide F1470 if the coating specification does not specify a testing frequency.

86 900

106 500

128 000

Alternative Proof Load Yield Bolt or Stud Proof Load, Length Threads per in. Stress Area. A in. 2 Tensile Load, min. lbf^E Strength Method (0.2 % Diameter, in. Measurement Method, Ibf^B Offset), min, lbf^B Column 1 Column 2 Column 3 Column 4 Column 5 Column 6 1/4 28 0.0364 4 350 3 100 3 500 5/16 24 0.0580 6 950 4 950 5 350 3/8 24 0.0878 10 550 7 450 8 100 7/16 20 0.1187 14 250 10 100 10 900 19 200 14 700 20 0.1599 13 600 1/2 24 350 17 250 0.203 18 700 9/16 18 0.256 30 700 21 750 23 500 5/Ω 18 3/4 16 0.373 44 750 31 700 34 300 0.509 61 100 43 250 46 800 7/8 14 12 0.663 79 550 56 350 61 000

89 900

112 650

138 100

166 000

TABLE 5 Tensile Load Requirements for Fine-Thread Full-Size Hex Cap Screws, Bolts, and Studs

11/4 13/8

TABLE 6 Tensile Strength Requirements for Specimens Machined from Hex Cap Screws, Bolts, and Studs

12

12

12

12

0.856

1.073

1.315

1.581

Nominal	Tensile	Yield	Elongation	Reduction
Diameter,	Strength,	Strength,	in 4 <i>D</i> ,	of Area,
in.	min, psi	min, psi	min, %	min, %
1/4 to 1, incl.	120 000	92 000	14	35
Over 1 to 11/2, incl.	105 000	81 000	14	35
Over 11/2 to 3, incl.	90 000	58 000	14	35

axially tested. Fracture on full size tests shall be in the body or threads of the fastener without a fracture at the junction of the head and body.

- 11.3 Studs shall be tested by the axial tension method as described in the second paragraph of axial tension testing of full size products in the Test Methods section of Test Methods F606.
- 11.4 Proof load shall be determined using Method 1, length measurement, or Method 2, yield strength, at the option of the manufacturer.

12. Inspection

- 12.1 If the inspection described in 12.2 is required by the purchaser, it shall be specified in the inquiry and contract or order.
- 12.2 The purchaser's representative shall have free entry to all parts of the manufacturer's works or supplier's place of business that concern the manufacture or supply of the fasteners. The manufacturer shall afford the purchaser's representative all reasonable facilities to satisfy him that the fasteners are being furnished in accordance with this specification. All tests and inspections required by the specification that are requested by the purchaser's representative shall be made before shipment, and shall be conducted as not to interfere unneces-

sarily with the operation of the manufacturer's works or supplier's place of business.

63 350

79 400

97 300

117 000

13. Rejection and Rehearing

13.1 Disposition of nonconforming fasteners shall be in accordance with the section on Disposition of Nonconforming Lots of Guide F1470.

14. Certification

- 14.1 When specified on the purchase order, the manufacturer or supplier, whichever is the responsible party as defined in Section 15, shall furnish the purchaser test reports which include the following:
- 14.1.1 Heat analysis, heat number, and a statement certifying that heats having the elements listed in 6.4 intentionally added were not used to produce the fasteners,
 - 14.1.2 Results of hardness, tensile, and proof load tests,
- 14.1.3 Zinc coating measured coating weight/thickness for coated fasteners,
- 14.1.4 Statement of compliance with dimensional and thread fit requirements,
 - 14.1.5 Lot number and purchase order number,
 - 14.1.6 Complete mailing address of responsible party, and
- 14.1.7 Title and signature of the individual assigned certification responsibility by the company officers.
- 14.2 Failure to include all the required information on the test report shall be cause for rejection.

15. Responsibility

15.1 The party responsible for the fastener shall be the organization that supplies the fastener to the purchaser.

16. Product Marking

16.1 Manufacturers Identification—All hex cap screws and bolts and one end of studs 3/8 in. and larger, and whenever

 $[\]frac{11/2}{^{A}}$ See footnote *B* in Table 4.

^B See footnote C in Table 4.

feasible studs smaller than 3/8 in., shall be marked by the manufacturer with a unique identifier to identify the manufacturer.

- 16.2 Type Identification:
- 16.2.1 Type 1 hex cap screws and bolts and one end of Type 1 studs 3/8 in. and larger, and whenever feasible studs smaller than 3/8 in., shall be marked "A449."
- 16.2.2 All Type 3 hex cap screws, blots, and studs shall be marked to indicate that they are produced from weathering steel. Heads of type 3 hex cap screws and bolts shall be marked "A449" underlined. Type 3 studs 3/8 in. and larger, and whenever feasible studs smaller than 3/8 in., shall be marked "A449" underlined on at least one end. Studs under 3/8 in. not marked "A449" underlined, shall be marked with the use of additional marks to indicate that they are produced from weathering steel.
 - 16.3 Marking Location and Methods:
- 16.3.1 All markings shall be located on the top of a hex cap screw and bolt heads and on one end of studs and shall be either raised or depressed at the manufacturer's option.
- 16.3.2 Type and manufacturer's identification shall be separate and distinct. The two identifications shall preferably be in different locations and, when on the same level, shall be separated by at least two spaces.

16.4 Acceptance Criteria—Fasteners which are not marked in accordance with these provisions shall be considered non-conforming and subject to rejection.

17. Packaging and Package Marking

- 17.1 Packaging:
- 17.1.1 Unless otherwise specified, packaging shall be in accordance with Practice D3951.
- 17.1.2 When special packaging requirements are required, they shall be defined at the time of the inquiry and order.
 - 17.2 Package Marking:
- 17.2.1 Each shipping unit shall include or be plainly marked with the following information:
 - 17.2.1.1 ASTM designation and type,
 - 17.2.1.2 Size,
 - 17.2.1.3 Name and brand or trademark of the manufacturer,
 - 17.2.1.4 Number of pieces,
 - 17.2.1.5 Lot number,
 - 17.2.1.6 Purchase order number, and
 - 17.2.1.7 Country of origin.

18. Keywords

18.1 bolts; carbon steel; hex cap screws; steel; studs

SUPPLEMENTARY REQUIREMENTS

S1. Marking

S1.1 Studs that are continuously threaded with the same class of thread shall be marked on each end with the marking required by Section 16.

S1.2 Marking small sizes (customarily less than 0.375 in.) may not be practical. Consult the producer for the minimum size that can be marked.

SPECIFICATION FOR GENERAL REQUIREMENTS FOR CARBON AND LOW ALLOY STEEL TUBES



SA-450/SA-450M



(23)

(Identical with ASTM Specification A450/A450M-21.)

Specification for General Requirements for Carbon and Low Alloy Steel Tubes

1. Scope

1.1 This specification covers a group of requirements which, with the exceptions of 6.3 and Sections 7, 8, 19, 20, 21, 22, 23, 24, and 25, are mandatory requirements to the following ASTM tubular product specifications:

Title of Specification	ASTM Designation
Electric-Resistance-Welded Carbon Steel and Carbon- Manganese Steel Boiler Tubes	A178/A178M
Seamless Cold-Drawn Low-Carbon Steel Heat- Exchanger and Condenser Tubes	A179/A179M
Seamless Carbon Steel Boiler Tubes for High-Pressure Service	A192/A192M
Seamless Medium-Carbon Steel Boiler and Superheater Tubes	A210/A210M
Electric-Resistance-Welded Carbon Steel Heat- Exchanger and Condenser Tubes	A214/A214M
Seamless and Electric-Welded Low-Alloy Steel Tubes	A423/A423M
Specification for Seamless and Welded Carbon Steel Heat-Exchanger Tubes with Integral Fins	A498/A498M
Seamless Cold-Drawn Carbon Steel Feedwater Heater Tubes	A556/A556M
Seamless, Cold-Drawn Carbon Steel Tubing for Hydraulic System Service	A822/A822M

^A These designations refer to the latest issue of the respective specifications.

- 1.2 One or more of Sections 6.3, 7, 8, 19, 20, 21, 22, 22.1, 24, and 25 apply when the product specification or purchase order has a requirement for the test or analysis described by these sections.
- 1.3 In case of conflict between a requirement of the product specification and a requirement of this general requirement specification only the requirement of the product specification need be satisfied.
- 1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. Within the text, the

SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units shall apply unless the "M" designation (SI) of the product specification is specified in the order.

1.5 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

- 2.1 ASTM Standards:
- A178/A178M Specification for Electric-Resistance-Welded Carbon Steel and Carbon-Manganese Steel Boiler and Superheater Tubes
- A179/A179M Specification for Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes
- A192/A192M Specification for Seamless Carbon Steel Boiler Tubes for High-Pressure Service
- A210/A210M Specification for Seamless Medium-Carbon Steel Boiler and Superheater Tubes
- A214/A214M Specification for Electric-Resistance-Welded Carbon Steel Heat-Exchanger and Condenser Tubes
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A423/A423M Specification for Seamless and Electric-Welded Low-Alloy Steel Tubes
- A498/A498M Specification for Seamless and Welded Carbon Steel Heat-Exchanger Tubes with Integral Fins
- A530/A530M Specification for General Requirements for Specialized Carbon and Alloy Steel Pipe
- A556/A556M Specification for Seamless Cold-Drawn Carbon Steel Feedwater Heater Tubes

- A700 Guide for Packaging, Marking, and Loading Methods for Steel Products for Shipment
- A751 Test Methods and Practices for Chemical Analysis of Steel Products
- A822/A822M Specification for Seamless Cold-Drawn Carbon Steel Tubing for Hydraulic System Service
- A941 Terminology Relating to Steel, Stainless Steel, Related Alloys, and Ferroalloys
- A1047/A1047M Test Method for Pneumatic Leak Testing of Tubing
- A1058 Test Methods for Mechanical Testing of Steel Products—Metric
- D3951 Practice for Commercial Packaging
- E92 Test Methods for Vickers Hardness and Knoop Hardness of Metallic Materials
- E213 Practice for Ultrasonic Testing of Metal Pipe and Tubing
- E273 Practice for Ultrasonic Testing of the Weld Zone of Welded Pipe and Tubing
- E309 Practice for Eddy Current Examination of Steel Tubular Products Using Magnetic Saturation
- E426 Practice for Electromagnetic (Eddy Current) Examination of Seamless and Welded Tubular Products, Titanium, Austenitic Stainless Steel and Similar Alloys
- E570 Practice for Flux Leakage Examination of Ferromagnetic Steel Tubular Products
- 2.2 SAE Aerospace Material Specifications:
- SAE-AMS2806 Identification Bars, Wire, Mechanical Tubing, and Extrusions, Carbon and Alloy Steels and Corrosion and Heat-Resistant Steels and Alloys
- 2.3 Military Standards:
- MIL-STD-792 Identification Marking Requirements for Special Purpose Equipment
- NAVSEA T9074-AS-GIB-010/271 Requirements for Non-destructive Testing Methods
- 2.4 ASME Boiler and Pressure Vessel Code:

Section IX

- 2.5 Steel Structures Painting Council:
- SSPC-SP 6 Surface Preparation Specification No. 6 Commercial Blast Cleaning
- 2.6 Other Document:
- SNT-TC-1A Recommended Practice for Nondestructive Personnel Qualification and Certification.

3. Terminology

- 3.1 Definitions of Terms Specific to This Standard:
- 3.1.1 *remelted heat*—in secondary melting, all of the ingots remelted from a single primary heat.

3.1.2 *thin-wall tube*—a tube meeting the specified outside diameter and specified wall thickness set forth as follows:

Specified Outside
Diameter

2 in. [50.8 mm] or less
Greater than 2 in. [50.8 mm]
Any

Specified Wall Thickness
2 % or less of specified outside diameter
3 % or less of specified outside diameter
0.020 in. [0.5 mm] or less

3.2 Other defined terms—The definitions in Test Methods and Definitions A370, Test Methods, Practices, and Terminology A751, and Terminology A941 are applicable to this specification and to those listed in 1.1.

4. Ordering Information

- 4.1 It is the purchaser's responsibility to specify in the purchase order all ordering information necessary to purchase the needed material. Examples of such information include, but are not limited to, the following:
 - 4.1.1 Quantity (feet, metres, or number of lengths),
- 4.1.2 Specificiation number with grade or class, or both, as applicable and year date,
 - 4.1.3 Manufacture (hot-finished or cold-finished),
 - 4.1.4 Size (outside diameter and minimum wall thickness),
 - 4.1.5 Length (specific or random),
- 4.1.6 Choice of testing track from the options listed in Test Methods A1058 when material is ordered to an M suffix (SI units) product standard. If the choice of test track is not specified in the order, then the default ASTM test track shall be used as noted in Test Methods A1058.
 - 4.1.7 Supplementary Requirements, and
 - 4.1.8 Additional requirements.

5. Process

- 5.1 The steel may be made by any process.
- 5.2 If a specific type of melting is required by the purchaser, it shall be as stated on the purchase order.
- 5.3 The primary melting may incorporate separate degassing or refining and may be followed by secondary melting, such as electroslag remelting or vacuum-arc remelting.
- 5.4 Steel may be cast in ingots or may be strand cast. When steel of different grades is sequentially strand cast, identification of the resultant transition material is required. The producer shall remove the transition material by an established procedure that positively separates the grades.

6. Chemical Composition

- 6.1 Samples for chemical analysis, and method of analysis shall be in accordance with Test Methods, Practices, and Terminology A751.
- 6.2 Heat Analysis—If the heat analysis reported by the steel producer is not sufficiently complete for conformance with the heat analysis requirements of the applicable product specification to be fully assessed, the manufacturer may complete the assessment of conformance with such heat analysis requirements by using a product analysis for the specified elements that were not reported by the steel producer, provided that product analysis tolerances are not applied and the heat analysis is not altered.

6.3 *Product Analysis*—Product analysis requirements and options, if any, are contained in the product specification.

7. Tensile Properties

- 7.1 The material shall conform to the requirements as to tensile properties prescribed in the individual specification.
- 7.2 The yield strength corresponding to a permanent offset of 0.2 % of the gage length or to a total extension of 0.5 % of the gage length under load shall be determined.
- 7.3 If the percentage of elongation of any test specimen is less than that specified and any part of the fracture is more than $\frac{3}{4}$ in. [19.0 mm] from the center of the gage length, as indicated by scribe marks on the specimen before testing, a retest shall be allowed.

8. Standard Weights

8.1 The calculated weight per unit length, based upon a specified minimum wall thickness, shall be determined by the following equation:

$$W = C(D - t)t \tag{1}$$

where:

C = 10.69 [0.0246615],

W = weight, lb/ft [kg/m],

D =specified outside diameter, in. [mm], and

t = specified minimum wall thickness, in. [mm]

8.2 The permissible variations from the calculated weight per foot [kilogram per metre] shall be as prescribed in Table 1.

9. Permissible Variations in Wall Thickness

- 9.1 Variations from the specified minimum wall thickness shall not exceed the amounts prescribed in Table 2.
- 9.2 For tubes 2 in. [50.8 mm] and over in outside diameter and 0.220 in. [5.6 mm] and over in thickness, the variation in wall thickness in any one cross section of any one tube shall not exceed the following percentage of the actual mean wall at the section. The actual mean wall is defined as the average of the thickest and thinnest wall in that section.

Seamless tubes $\pm 10 \%$ Welded tubes $\pm 5 \%$

9.3 When cold-finished tubes as ordered require wall thicknesses ¾ in. [19.1 mm] or over, or an inside diameter 60 % or less of the outside diameter, the permissible variations in wall thickness for hot-finished tubes shall apply.

TABLE 1 Permissible Variations in Weight Per Unit Length^A

Method of Manufacture	Permissible Variation in Weight per Unit Length, %			
	Over	Under		
Seamless, hot-finished Seamless, cold-finished:	16	0		
1½ in. [38.1 mm] and under OD	12	0		
Over 1½ in. [38.1 mm] OD	13	0		
Welded	10	0		

^A These permissible variations in weight apply to lots of 50 tubes or more in sizes 4 in. [101.6 mm] and under in outside diameter, and to lots of 20 tubes or more in sizes over 4 in. [101.6 mm] in outside diameter.

TABLE 2 Permissible Variations in Wall Thickness^A

	Wall Thickness, %							
	0.095		Over		Over 0.150		Over	
Outside	[2	.4]	0.0	095	to 0	.180	0.1	80,
Diameter,	а	nd	to 0	.150	[3.	8 to	[4	.6]
in. [mm]	Un	der		4 to	4.6]	, incl		
			3.8]	, incl				
	Over	Under	Over	Under	Over	Under	Over	Under
		Seamle	ss, Hot	-Finished	l Tubes			
4 [101.6] and	40	0	35	0	33	0	28	0
under								
Over 4			35	0	33	0	28	0
[101.6]								
	Seamless, Cold-Finished Tubes							
			0	ver		l	Jnder	
1½ [38.1] and under			2	20			0	
Over 1½ [38.1]			2	22			0	
			Welde	d Tubes				
All sizes				8			0	

^A These permissible variations in wall thickness apply only to tubes, except internal-upset tubes, as rolled or cold-finished, and before swaging, expanding, bending, polishing, or other fabricating operations.

10. Permissible Variations in Outside Diameter

- 10.1 Except as provided in 10.2, variations from the specified outside diameter shall not exceed the amounts prescribed in Table 3.
- 10.2 Thin-wall tubes usually develop significant ovality (out of roundness) during final annealing, or straightening, or both. The diameter tolerances of Table 3 are not sufficient to provide for additional ovality expected in thin-wall tubes, and, for such tubes, are applicable only to the *mean* of the extreme (maximum and minimum) outside diameter readings in any one cross section. However, for thin wall tubes the *difference* in extreme outside diameter readings (ovality) in any one cross section shall not exceed the following ovality allowances:

Outside Diameter Ovality Allowance
1 in. [25.4 mm] and under 0.020 in. [0.5 mm]
Over 1 in. [25.4 mm] 2.0 % of specified outside diameter

TABLE 3 Permissible Variations in Outside Diameter^A

Outside Diameter,	Permissible Variations, in. [mm]		
in. [mm]	Over	Under	
Hot-Finished Seamless Tubes			
4 [101.6] and under	1/64 [0.4]	1/32 [0.8]	
Over 4 to 7½ [101.6 to 190.5], incl	1/64 [0.4]	3/64 [1.2]	
Over 71/2 to 9 [190.5 to 228.6], incl	1/64 [0.4]	1/16 [1.6]	
Welded Tubes and Cold-Finished Seamless Tubes			
Under 1 [25.4]	0.004 [0.1]	0.004 [0.1]	
1 to 11/2 [25.4 to 38.1], incl	0.006 [0.15]	0.006 [0.15]	
Over 11/2 to 2 [38.1 to 50.8], excl	0.008 [0.2]	0.008 [0.2]	
2 to 21/2 [50.8 to 63.5], excl	0.010 [0.25]	0.010 [0.25]	
21/2 to 3 [63.5 to 76.2], excl	0.012 [0.3]	0.012 [0.3]	
3 to 4 [76.2 to 101.6], incl	0.015 [0.38]	0.015 [0.38]	
Over 4 to 7½ [101.6 to 190.5], incl	0.015 [0.38]	0.025 [0.64]	
Over 7½ to 9 [190.5 to 228.6], incl	0.015 [0.38]	0.045 [1.14]	

^A Except as provided in 10.2, these permissible variations include out-of-roundness. These permissible variations in outside diameter apply to hot-finished seamless, welded and cold-finished seamless tubes before other fabricating operations such as upsetting, swaging, expanding, bending, or polishing.

11. Permissible Variations in Length

11.1 Variations from the specified length shall not exceed the amounts prescribed in Table 4.

12. Permissible Variations in Height of Flash on Electric-Resistance-Welded Tubes

- 12.1 For tubes manufactured to this specification, the weld flash on the outside of the tube shall be mechanically removed by cutting prior to any subsequent cold work or sizing.
- 12.2 For tubes over 2 in. [50.8 mm] in outside diameter, or over 0.135 in. [3.44 mm] in wall thickness, the flash on the inside of the tubes shall be mechanically removed by cutting to a maximum height of 0.010 in. [0.25 mm] at any point on the tube.
- 12.3 For tubes 2 in. [50.8 mm] and under in outside diameter and 0.135 in. [3.4 mm] and under in wall thickness, the flash on the inside of the tube shall be mechanically removed by cutting to a maximum height of 0.006 in. [0.15 mm] at any point on the tube.

13. Straightness and Finish

13.1 Finished tubes shall be reasonably straight and have smooth ends free of burrs. They shall have a workmanlike finish. Surface imperfections (see Note 1) may be removed by grinding, provided that a smooth curved surface is maintained, and the wall thickness is not decreased to less than that permitted by this or the product specification. The outside diameter at the point of grinding may be reduced by the amount so removed.

Note 1—An imperfection is any discontinuity or irregularity found in the tube.

14. Repair by Welding

14.1 Repair welding of base metal defects in tubing is permissible only with the approval of the purchaser and with the further understanding that the tube shall be marked "WR" and the composition of the deposited filler metal shall be suitable for the composition being welded. Defects shall be thoroughly chipped or ground out before welding and each repaired length shall be reheat treated or stress relieved as required by the applicable specification. Each length of repaired tube shall be tested hydrostatically as required by the product specification.

TABLE 4 Permissible Variations in Length^A

Method of Manufacture	Outside Diameter,	Cut Length, in. [mm]	
in. [mm]	in. [mm]	Over	Under
Seamless, hot-finished	All sizes	3/16 [5]	0 [0]
Seamless, cold-	Under 2 [50.8]	1/8 [3]	0 [0]
finished	2 [50.8] and over	3/16 [5]	[0] 0
Welded	Under 2 [50.8]	1/8 [3]	0 [0]
	2 [50.8] and over	³ ⁄ ₁₆ [5]	0 [0]

 $[^]A$ These permissible variations in length apply to tubes before bending. They apply to cut lengths up to and including 24 ft [7.3 m]. For lengths greater than 24 ft [7.3 m], the above over-tolerances shall be increased by $\frac{1}{2}$ in. [3 mm] for each 10 ft [3 m] or fraction thereof over 24 ft or $\frac{1}{2}$ in. [13 mm], whichever is the lesser.

14.2 Repair welding shall be performed using procedures and welders or welding operators that have been qualified in accordance with ASME Boiler and Pressure Vessel Code, Section IX.

15. Retests

15.1 If the results of the mechanical tests of any group or lot do not conform to the requirements specified in the individual specification, retests may be made on additional tubes of double the original number from the same group or lot, each of which shall conform to the requirements specified.

16. Retreatment

16.1 If the individual tubes or the tubes selected to represent any group or lot fail to conform to the test requirements, the individual tubes or the group or lot represented may be retreated and resubmitted for test. Not more than two reheat treatments shall be permitted.

17. Test Specimens

- 17.1 Test specimens shall be taken from the ends of finished tubes prior to upsetting, swaging, expanding, or other forming operations, or being cut to length. They shall be smooth on the ends and free of burrs and flaws.
- 17.2 If any test specimen shows flaws or defective machining, it may be discarded and another specimen substituted.

18. Method of Mechanical Testing

- 18.1 The specimens and mechanical tests required shall be made in accordance with Annex A2 of Test Methods and Definitions A370 if inch-pound units are specified or to the requirements described in the applicable track of Test Methods A1058 if SI units are specified.
 - 18.2 Specimens shall be tested at room temperature.
- 18.3 Small or subsize specimens as described in Test Methods and Definitions A370 or Test Methods A1058 may be used only when there is insufficient material to prepare one of the standard specimens. When using small or subsize specimens, the largest one possible shall be used.

19. Flattening Test

19.1 A section of tube not less than 2 $\frac{1}{2}$ in. [63 mm] in length for seamless and not less than 4 in. [100 mm] in length for welded shall be flattened cold between parallel plates in two steps. For welded tubes, the weld shall be placed 90° from the direction of the applied force (at a point of maximum bending). During the first step, which is a test for ductility, no cracks or breaks, except as provided for in 19.4, on the inside, outside, or end surfaces shall occur in seamless tubes, or on the inside or outside surfaces of welded tubes, until the distance between the plates is less than the value of H calculated by the following equation:

$$H = \frac{(1+e)t}{e+t/D} \tag{2}$$

where:

H = distance between flattening plates, in. [mm],

= specified wall thickness of the tube, in. [mm],

D = specified outside diameter of the tube, in. [mm], and

= deformation per unit length (constant for a given grade of steel: 0.07 for medium-carbon steel (maximum specified carbon 0.19 % or greater), 0.08 for low alloy steel, and 0.09 for low-carbon steel (maximum specified carbon 0.18 % or less)).

During the second step, which is a test for soundness, the flattening shall be continued until the specimen breaks or the opposite walls of the tube meet. Evidence of laminated or unsound material, or of incomplete weld that is revealed during the entire flattening test shall be cause for rejection.

- 19.2 Surface imperfections in the test specimens before flattening, but revealed during the first step of the flattening test, shall be judged in accordance with the finish requirements.
- 19.3 Superficial ruptures resulting from surface imperfections shall not be cause for rejection.
- 19.4 When low D-to-t ratio tubular products are tested, because the strain imposed due to geometry is unreasonably high on the inside surface at the six and twelve o'clock locations, cracks at these locations shall not be cause for rejection if the D to t ratio is less than 10.

20. Reverse Flattening Test

20.1~A~5 in. [100 mm] in length of finished welded tubing in sizes down to and including 1/2 in. [12.7 mm] in outside diameter shall be split longitudinally 90° on each side of the weld and the sample opened and flattened with the weld at the point of maximum bend. There shall be no evidence of cracks or lack of penetration or overlaps resulting from flash removal in the weld.

21. Flaring Test

21.1 A section of tube approximately 4 in. [100 mm] in length shall stand being flared with a tool having a 60° included angle until the tube at the mouth of the flare has been expanded to the percentages specified in Table 5 without cracking or showing imperfections rejectable under the provisions of the product specification.

TABLE 5 Flaring Test Requirements

Ratio of Inside	Minimum Expansion of Inside Diameter, %	
Diameter ^A	Carbon Steels	Low Alloy Steels
0.9	21	15
0.8	22	17
0.7	25	19
0.6	30	23
0.5	39	28
0.4	51	38
0.3	68	50

^A In determining the ratio of inside diameter to specified outside diameter, the inside diameter shall be defined as the actual mean inside diameter of the material tested

22. Flange Test

22.1 A section of tube shall be capable of having a flange turned over at a right angle to the body of the tube without cracking or showing imperfections rejectable under the provisions of the product specification. The width of the flange for carbon and alloy steels shall be not less than the percentages specified in Table 6.

23. Hardness Test

- 23.1 For tubes 0.200 in. [5.1 mm] and over in wall thickness, either the Brinell or Rockwell hardness test shall be used. When Brinell hardness testing is used, a 10-mm ball with 3000, 1500, or 500-kg load, or a 5-mm ball with 750-kg load may be used, at the option of the manufacturer.
- 23.2 For tubes less than 0.200 in. [5.1 mm] to and including 0.065 in. [1.7 mm] in wall thickness, the Rockwell hardness test shall be used.
- 23.3 For tubes less than 0.065 in. [1.7 mm] in wall thickness, the hardness test shall not be required.
- 23.4 The Brinell hardness test may be made on the outside of the tube near the end, on the outside of a specimen cut from the tube, or on the wall cross section of a specimen cut from the tube at the option of the manufacturer. This test shall be made so that the distance from the center of the impression to the edge of the specimen is at least 2.5 times the diameter of the impression.
- 23.5 The Rockwell hardness test may be made on the inside surface, on the wall cross section, or on a flat on the outside surface at the option of the manufacturer.
- 23.6 For tubes furnished with upset, swaged, or otherwise formed ends, the hardness test shall be made as prescribed in 23.1 and 23.2 on the outside of the tube near the end after the forming operation and heat treatment.
- 23.7 For welded or brazed tubes, the hardness test shall be made away from the joints.
- 23.8 When the product specification provides for Vickers hardness, such testing shall be in accordance with Test Method E92.

24. Hydrostatic Test

24.1 Except as provided in 24.2 and 24.3, each tube shall be tested by the manufacturer to a minimum hydrostatic test pressure determined by the following equation:

$$Inch - Pound\ Units: P = 32000\ t/D$$

$$SI\ Units: P = 220.6t/D$$
(3)

TABLE 6 Flange Requirements

Outside Diameter of Tube, in. [mm]	Width of Flange
To 2½ [63.5], incl	15 % of OD
Over 21/2 to 33/4 [63.5 to 95.2], incl	121/2 % of OD
Over 3¾ to 8 [95.2 to 203.2], incl	10 % of OD

where:

P = hydrostatic test pressure, psi or MPa,

t = specified wall thickness, in. or mm, and

D = specified outside diameter, in. or mm.

- 24.1.1 The hydrostatic test pressure determined by Eq 3 shall be rounded to the nearest 50 psi [0.5 MPa] for pressure below 1000 psi [7 MPa], and to the nearest 100 psi [1 MPa] for pressures 1000 psi [7 MPa] and above. The hydrostatic test may be performed prior to cutting to final length, or prior to upsetting, swaging, expanding, bending or other forming operations, or both.
- 24.2 Regardless of the determination made by Eq 3, the minimum hydrostatic test pressure required to satisfy these requirements need not exceed the values given in Table 7. This does not prohibit testing at higher pressures at manufacturer's option or as provided in 24.3.
- 24.3 With concurrence of the manufacturer, a minimum hydrostatic test pressure in excess of the requirements of 24.2 or 24.1, or both, may be stated on the order. The tube wall stress shall be determined by the following equation:

$$S = PD/2t \tag{4}$$

where:

- S = tube wall stress, psi or MPa, and all other symbols as defined in 24.1.1.
 - 24.4 The test pressure shall be held for a minimum of 5 s.
- 24.5 If any tube shows leaks during the hydrostatic test, it shall be rejected.
- 24.6 The hydrostatic test may not be capable of testing the end portion of the pipe. The lengths of pipe that cannot be tested shall be determined by the manufacturer and, when specified in the purchase order, reported to the purchaser.

25. Air Pressure Test

25.1 Air Underwater Test—When this test is employed, each tube, with internal surface clean and dry, shall be internally pressurized to 150 psi [1000 kPa] minimum with clean and dry compressed air while being submerged in clear water. The tube shall be well-lighted, preferably by underwater illumination. Any evidence of air leakage of the pneumatic couplings shall be corrected prior to testing. Inspection shall be made of the entire external surface of the tube after holding the pressure for not less than 5 s after the surface of the water has become calm. If any tube shows leakage during the air

TABLE 7 Hydrostatic Test Pressures

Outside Diameter of Tube, in. [mm]	Hydrostatic Test Pressure, psi [MPa]	
Under 1 [25.4]	1000 [7]	
1 to 11/2 [25.4 to 38.1], excl	1500 [10]	
1½ to 2 [38.1 to 50.8], excl	2000 [14]	
2 to 3 [50.8 to 76.2], excl	2500 [17]	
3 to 5 [76.2 to 127], excl	3500 [24]	
5 [127] and over	4500 [31]	

underwater test, it shall be rejected. Any leaking areas may be cut out and the tube retested.

25.2 *Pneumatic Leak Test*—When this test is employed, each tube shall be subjected to a pneumatic leak test in accordance with Specification A1047/A1047M.

Acceptance criteria shall be as follows:

Tube O.D. in [mm]	Calibration Hole, max. in [mm]
≤1.5 [≤40]	0.003 [0.076]
>1.5≤2.0 [>40≤50]	0.004 [0.162]
>2.0≤2.5 [>50≤65]	0.005 [0.127]
>2.5≤3.0 [>65≤75]	0.006 [0.152]
>3.0 [>75]	by agreement

26. Nondestructive Examination

- 26.1 When nondestructive examination is specified by the purchaser or the product specification, each tube shall be examined by a nondestructive examination method in accordance with Practice E213, Practice E309 (for ferromagnetic materials), Practice E426 (for non-magnetic materials), or Practice E570. Upon agreement, Practice E273 shall be employed in addition to one of the full periphery tests. The range of tube sizes that may be examined by each method shall be subject to the limitations in the scope of that practice. In case of conflict between these methods and practices and this specification, the requirements of this specification shall prevail.
- 26.2 The following information is for the benefit of the user of this specification.
- 26.2.1 Calibration standards for the nondestructive electric test are convenient standards for calibration of nondestructive testing equipment only. For several reasons, including shape, orientation, width, etc., the correlation between the signal produced in the electric test from an imperfection and from calibration standards is only approximate. A purchaser interested in ascertaining the nature (type, size, location, and orientation) of discontinuities that can be detected in the specific application of these examinations should discuss this with the manufacturer of the tubular product.
- 26.2.2 The ultrasonic examination referred to in this specification is intended to detect longitudinal discontinuities having a reflective area similar to or larger than the calibration reference notches specified in 26.4. The examination may not detect circumferentially oriented imperfections or short, deep defects.
- 26.2.3 The eddy current examination referenced in this specification has the capability of detecting significant discontinuities, especially of the short abrupt type. Practices E309 and E426 contain additional information regarding the capabilities and limitations of eddy-current examination.
- 26.2.4 The flux leakage examination referred to in this specification is capable of detecting the presence and location of significant longitudinally or transversely oriented discontinuities. The provisions of this specification only provide for longitudinal calibration for flux leakage. It should be recognized that different techniques should be employed to detect differently oriented imperfections.
- 26.2.5 The hydrostatic test referred to in Section 23 is a test method provided for in many product specifications. This test has the capability of finding defects of a size permitting the test

fluid to leak through the tube wall and may be either visually seen or detected by a loss of pressure. This test may not detect very tight, through-the-wall defects or defects that extend an appreciable distance into the wall without complete penetration.

- 26.2.6 A purchaser interested in ascertaining the nature (type, size, location, and orientation) of discontinuities that can be detected in the specific application of these examinations should discuss this with the manufacturer of the tubular products.
- 26.3 *Time of Examination*—Nondestructive examination for specification acceptance shall be performed after all deformation processing, heat treating, welding, and straightening operations. This requirement does not preclude additional testing at earlier stages in the processing.
 - 26.4 Surface Condition:
- 26.4.1 All surfaces shall be free of scale, dirt, grease, paint, or other foreign material that could interfere with interpretation of test results. The methods used for cleaning and preparing the surfaces for examination shall not be detrimental to the base metal or the surface finish.
- 26.4.2 Excessive surface roughness or deep scratches can produce signals that interfere with the test.
 - 26.5 Extent of Examination:
- 26.5.1 The relative motion of the tube and the transducer(s), coil(s), or sensor(s) shall be such that the entire tube surface is scanned, except for end effects as noted in 26.5.2.
- 26.5.2 The existence of end effects is recognized, and the extent of such effects shall be determined by the manufacturer, and, if requested, shall be reported to the purchaser. Other nondestructive tests may be applied to the end areas, subject to agreement between the purchaser and the manufacturer.
 - 26.6 Operator Qualifications:
- 26.6.1 The test unit operator shall be certified in accordance with SNT-TC-1A, or an equivalent documented standard agreeable to both purchaser and manufacturer.
 - 26.7 Test Conditions:
- 26.7.1 For examination by the ultrasonic method, the minimum nominal transducer frequency shall be 2.0 MHz, and the maximum transducer size shall be 1.5 in. [38 mm].
- 26.7.2 For eddy current testing, the excitation coil frequency shall be chosen to ensure adequate penetration, yet provide good signal-to-noise ratio.
 - 26.7.2.1 The maximum coil frequency shall be:

Specified Wall Thickness	Maximum Frequency
<0.050 in.	100 KHz
0.050 to 0.150	50
>0.150	10

- 26.8 Reference Standards:
- 26.8.1 Reference standards of convenient length shall be prepared from a length of tube of the same grade, specified size (outside diameter and wall thickness), surface finish and heat treatment condition as the tubing to be examined.
- 26.8.2 For eddy current testing, the reference standard shall contain, at the option of the manufacturer, any one of the following discontinuities:

26.8.2.1 *Drilled Hole*—The reference standard shall contain three or more holes, equally spaced circumferentially around the tube and longitudinally separated by a sufficient distance to allow distinct identification of the signal from each hole. The holes shall be drilled radially and completely through the tube wall, with care being taken to avoid distortion of the tube while drilling. The holes shall not be larger than 0.031 in. [0.8 mm] in diameter. As an alternative, the producer may choose to drill one hole and run the calibration standard through the test coil three times, rotating the tube approximately 120° each time. More passes with smaller angular increments may be used, provided testing of the full 360° of the coil is obtained. For welded tubing, if the weld is visible, one of the multiple holes or the single hole shall be drilled in the weld.

26.8.2.2 *Transverse Tangential Notch*—Using a round tool or file with a ½ in. [6.4 mm] diameter, a notch shall be milled or filed tangential to the surface and transverse to the longitudinal axis of the tube. Said notch shall have a depth not exceeding 12½ % of the specified wall thickness of the tube or 0.004 in. [0.1 mm], whichever is greater.

26.8.2.3 Longitudinal Notch—A notch 0.031 in. [0.8 mm] or less in width shall be machined in a radial plane parallel to the tube axis on the outside surface of the tube, to have a depth not exceeding $12\frac{1}{2}$ % of the specified wall thickness of the tube or 0.004 in. [0.1 mm], whichever is greater. The length of the notch shall be compatible with the testing method.

26.8.3 For ultrasonic testing, the reference ID and OD notches shall be any one of the three common notch shapes shown in Practice E213, at the option of the manufacturer. The depth of the notches shall not exceed $12\frac{1}{2}$ % of the specified wall thickness of the tube or 0.004 in. [0.1 mm], whichever is greater. The width of the notch shall not exceed two times the depth. For welded tubing, the notches shall be placed in the weld, if the weld is visible.

26.8.4 For flux leakage testing, the longitudinal reference notches shall be straight-sided notches machined in a radial plane parallel to the tube axis on the inside and outside surfaces of the tube. Notch depth shall not exceed 12½% of the specified wall thickness or 0.004 in. [0.1 mm], whichever is greater. Notch length shall not exceed 1 in. [25.4 mm], and the width shall not exceed the depth. Outside and inside notches shall have sufficient separation to allow distinct identification of the signal from each notch.

26.8.5 More or smaller reference discontinuities, or both, may be used by agreement between the purchaser and the manufacturer.

26.9 Standardization Procedure:

26.9.1 The test apparatus shall be standardized at the beginning and end of each series of tubes of the same specified size (diameter and wall thickness), grade and heat treatment condition, and at intervals not exceeding 4 h during the examination of such tubing. More frequent standardizations may be performed at the manufacturer's option or may be required upon agreement between the purchaser and the manufacturer.

26.9.2 The test apparatus shall also be standardized after any change in test system settings, change of operator, equipment repair, or interruption due to power loss or shutdown.

26.9.3 The reference standard shall be passed through the test apparatus at the same speed and test system settings as the tube to be tested, except that, at the manufacturer's discretion, the tubes may be tested at a higher sensitivity.

26.9.4 The signal-to-noise ratio for the reference standard shall be 2.5:1 or greater, and the reference signal amplitude for each discontinuity shall be at least 50 % of full scale of the display. In establishing the noise level, extraneous signals from identifiable surface imperfections on the reference standard may be ignored. When reject filtering is used during UT testing, linearity must be demonstrated.

26.9.5 If, upon any standardization, the reference signal amplitude has decreased by 29 % (3.0 dB), the test apparatus shall be considered out of standardization. The test system settings may be changed, or the transducer(s), coil(s), or sensor(s) adjusted, and the unit restandardized, but all tubes tested since the last acceptable standardization must be retested.

26.10 Evaluation of Imperfections:

26.10.1 Tubing producing a test signal to or greater than the lowest signal produced by the reference standard shall be designated suspect, shall be clearly marked or identified, and shall be separated from the acceptable tubing.

26.10.2 Such suspect tubing shall be subject to one of the following three dispositions:

26.10.2.1 The tubes may be rejected without further examination, at the discretion of the manufacturer.

26.10.2.2 If the test signal was produced by imperfections such as scratches, surface roughness, dings, straightener marks, loose ID bead and cutting chips, steel die stamps, stop marks, tube reducer ripple, or chattered flash trim, the tubing may be accepted or rejected depending on visual observation of the severity of the imperfection, the type of signal it produces on the testing equipment used, or both.

26.10.2.3 If the test signal was produced by imperfections which cannot be identified, or was produced by cracks or crack-like imperfections, the tubing shall be rejected.

26.10.3 Any tubes with imperfections of the types in 26.10.2.2 and 26.10.2.3, exceeding 0.004 in. [0.1 mm] or $12\frac{1}{2}$ % of the specified minimum wall thickness (whichever is greater) in depth shall be rejected.

26.10.4 Rejected tubes may be reconditioned and retested providing the wall thickness is not decreased to less than that required by this or the product specification. If grinding is performed, the outside diameter in the area of grinding may be reduced by the amount so removed. To be accepted, reconditioned tubes must pass the nondestructive examination by which they were originally rejected.

27. Test Report

27.1 The producer or supplier shall furnish a test report stating that the material was manufactured, sampled, tested and inspected in accordance with the specification, including year date, the supplementary requirements, and any other requirements designated in the purchase order or contract, and that the results met the requirements of that specification, the supplementary requirements and the other requirements. A signature or notarization is not required on the test report, but the

document shall be dated and shall clearly identify the organization submitting the report. Notwithstanding the absence of a signature or notarization, the organization submitting the report is responsible for the contents of the report.

27.2 In addition, the test report shall include the following information and test results, when applicable:

27.2.1 Heat Number.

27.2.2 Heat Analysis,

27.2.3 Product Analysis, when specified,

27.2.4 Tensile Properties,

27.2.5 Width of the gage length, when longitudinal strip tension test specimens are used,

27.2.6 Flattening Test acceptable,

27.2.7 Reverse Flattening Test acceptable,

27.2.8 Flaring Test acceptable,

27.2.9 Flange Test acceptable,

27.2.10 Hardness Test values,

27.2.11 Hydrostatic Test pressure,

27.2.12 Non-destructive Electric Test method,

27.2.13 Impact Test results, and

27.2.14 Other test results or information required to be reported by the product specification.

27.3 Test results or information required to be reported by supplementary requirements, or other requirements designated in the purchase order or contract shall be reported, but may be reported in a separate document.

27.4 The test report shall include a statement of explanation for the letter added to the specification number marked on the tubes (see 30.2), when all of the requirements of the specification have not been completed. The purchaser must certify that all requirements of the specification have been completed before removal of the letter (that is, X, Y, or Z).

27.5 A test report, certificate of compliance, or similar document printed from or used in electronic form from an electronic data interchange (EDI) transmission shall be regarded as having the same validity as a counterpart printed in the certifier's facility. The content of the EDI transmitted document shall meet the requirements of the invoked ASTM standard(s) and conform to any existing EDI agreement between the purchaser and supplier. Notwithstanding the absence of a signature, the organization submitting the EDI transmission is responsible for the content of the report.

28. Inspection

28.1 The inspector representing the purchaser shall have entry at all times while work on the contract of the purchaser is being performed, to all parts of the manufacturer's works that concern the manufacture of the material ordered. The manufacturer shall afford the inspector all reasonable facilities to satisfy him that the material is being furnished in accordance with this specification. All required tests and inspection shall be made at the place of manufacture prior to shipment, unless otherwise specified, and shall be conducted so as not to interfere unnecessarily with the operation of the works.

29. Rejection

29.1 Each length of tubing received from the manufacturer may be inspected by the purchaser and, if it does not meet the requirements of the specification based on the inspection and test method as outlined in the specification, the length may be rejected and the manufacturer shall be notified. Disposition of rejected tubing shall be a matter of agreement between the manufacturer and the purchaser.

29.2 Material that fails in any of the forming operations or in the process of installation and is found to be defective shall be set aside and the manufacturer shall be notified for mutual evaluation of the material's suitability. Disposition of such material shall be a matter for agreement.

30. Product Marking

30.1 Each length of tube shall be legibly stenciled with the manufacturers's name or brand, the specification number, and grade. The marking need not include the year date of the specification. For tubes less than 1½ in. [31.8 mm] in diameter and tubes under 3 ft [1 m] in length, the required information may be marked on a tag securely attached to the bundle or box in which the tubes are shipped.

30.2 When it is specified that certain requirements of a specification adopted by the ASME Boiler and Pressure Vessel Committee are to be completed by the purchaser upon receipt of the material, the manufacturer shall indicate that all requirements of the specification have not been completed by a letter such as X, Y, or Z, immediately following the specification number. This letter may be removed after completion of all requirements in accordance with the specification. An explanation of specification requirements to be completed is provided in Section 27.

30.3 Bar Coding—In addition to the requirements in 30.1 and 30.2, bar coding is acceptable as a supplemental identification method. The purchaser may specify in the order a specific bar coding system to be used.

31. Packaging, Marking, and Loading

31.1 When specified on the purchase order, packaging, marking, and loading for shipment shall be in accordance with the procedures of Practices A700.

32. Government Procurement

- 32.1 Scale Free Pipe:
- 32.1.1 When specified in the contract or order, the following requirements shall be considered in the inquiry contract or order, for agencies of the U.S. Government where scale free tube is required. These requirements shall take precedence if there is a conflict between these requirements and the product specification.
- 32.1.2 Tube shall be ordered to outside diameter (OD) and wall thickness.
- 32.1.3 Responsibility for Inspection—Unless otherwise specified in the contract or purchase order, the manufacturer is responsible for the performance of all inspection and test requirements specified. The absence of any inspection requirements in the specification shall not relieve the contractor of the

responsibility for ensuring that all products or supplies submitted to the Government for acceptance comply with all requirements of the contract. Sampling inspection, as part of the manufacturing operations, is an acceptable practice to ascertain conformance to requirements, however, this does not authorize submission of known defective material, either indicated or actual, nor does it commit the Government to accept the material. Except as otherwise specified in the contract or purchase order, the manufacturer may use his own or any other suitable facilities for the performance of the inspection and test requirements unless disapproved by the purchaser at the time the order is placed. The purchaser shall have the right to perform any of the inspections and tests set forth when such inspections and tests are deemed necessary to ensure that the material conforms to the prescribed requirements.

32.1.4 Sampling for Flattening and Flaring Test and for Visual and Dimensional Examination—Minimum sampling for flattening and flaring tests and visual and dimensional examination shall be as follows:

Lot Size (pieces per lot)	Sample Size
2 to 8	Entire lot
9 to 90	8
91 to 150	12
151 to 280	19
281 to 500	21
501 to 1200	27
1201 to 3200	35
3201 to 10 000	38
10 001 to 35 000	46

In all cases, the acceptance number is zero and the rejection number is one. Rejected lots may be screened and resubmitted for visual and dimensional examination. All defective items shall be replaced with acceptable items prior to lot acceptance

- 32.1.5 Sampling for Chemical Analysis—One sample for chemical analysis shall be selected from each of two tubes chosen from each lot. A lot shall be all material poured from one heat.
- 32.1.6 Sampling for Tension and Bend Test—One sample shall be taken from each lot. A lot shall consist of all tube of the same outside diameter and wall thickness manufactured during an 8-h shift from the same heat of steel, and heat treated under the same conditions of temperature and time in a single charge in a batch type furnace, or heat treated under the same condition in a continuous furnace, and presented for inspection at the same time.
- 32.1.7 Hydrostatic and Ultrasonic Tests—Each tube shall be tested by the ultrasonic (when specified) and hydrostatic tests.
- 32.1.8 Tube shall be free from heavy oxide or scale. The internal surface of hot finished ferritic steel tube shall be pickled or blast cleaned to a free of scale condition equivalent to the CSa2 visual standard listed in SSPC-SP6. Cleaning shall be performed in accordance with a written procedure that has been shown to be effective. This procedure shall be available for audit.
- 32.1.9 In addition to the marking in Specification A530/A530M, each length of tube ½ in. outside diameter and larger shall be marked with the following listed information. Marking shall be in accordance with SAE-AMS2806 and MIL-STD-792. (a) Outside diameter, wall thickness, and length (b) Heat or lot identification number.

- 32.1.10 Tube shall be straight to within the tolerances specified in Table 8:
- 32.1.11 When specified, each tube shall be ultrasonically examined in accordance with NAVSEA T9074-AS-GIB-010/271, except that the notch depth in the calibration standard shall be 5% of the wall thickness or 0.005 in., whichever is greater. Any tube which produces an indication equal to or greater than 100% of the indication from the calibration standard shall be rejected.

TABLE 8 Straightness Tolerances

Specified OD (in.)	Specified Wall Thickness (in.)	Maximum Curvature in Any 3 ft (in.)	Maximum Curvature in Total Length (in.)
Up to 5.0, incl	Over 3 % OD to 0.5, incl	0.030	0.010 × length, ft
Over 5.0 to 8.0, incl	Over 4 % OD to 0.75, incl	0.045	0.015 × length, ft
Over 8.0 to 12.75, incl.	Over 4 % OD to 1.0, incl	0.060	0.020 × length, ft

- 32.1.12 The tube shall be free from repair welds, welded joints, laps, laminations, seams, visible cracks, tears, grooves, slivers, pits, and other imperfections detrimental to the tube as determined by visual and ultrasonic examination, or alternate tests, as specified.
- 32.1.13 Tube shall be uniform in quality and condition and have a finish conforming to the best practice for standard quality tubing. Surface imperfections such as handling marks, straightening marks, light mandrel and die marks, shallow pits, and scale pattern will not be considered injurious if the imperfections are removable within the tolerances specified for wall thickness or 0.005 in., whichever is greater. The bottom of imperfections shall be visible and the profile shall be rounded and faired-in.
 - 32.1.14 No weld repair by the manufacturer is permitted.
- 32.1.15 Packaging, marking, and loading shall be in accordance with Practices A700 or Practice D3951.

33. Keywords

33.1 alloy steel tube; austenitic stainless steel; carbon steel tube; general delivery; stainless steel tube; steel tube

2023 ASME Boiler and Pressure Vessel Code

The ASME Boiler and Pressure Vessel Code (BPVC) is a globally recognized and trusted source of technical requirements and guidance for the design, construction, and certification of boilers, pressure vessels, and nuclear components. With each new edition, the Code continues to evolve, introducing new technologies and processes to promote safety across pressure equipment applications and disciplines. Developed through a rigorous consensus process and fueled by the foresight of leading industry experts from around the world, the ASME BPVC is an ever-evolving set of standards that meets the needs of a changing world.

ASME provides BPVC users with an integrated suite of related offerings, which includes

- referenced standards
- related standards, reports, and guidelines
- conformity assessment programs
- conferences, seminars, and other events
- learning and development solutions
- ASME Press books and journals

For additional information and to order:

Phone: 1.800.THE.ASME (1.800.843.2763)

Email: customercare@asme.org
Website: go.asme.org/bpvc



